



WIRING BY MANUFACTURER, TYPICAL OF FBC, SEE NOTE 3, SH 30

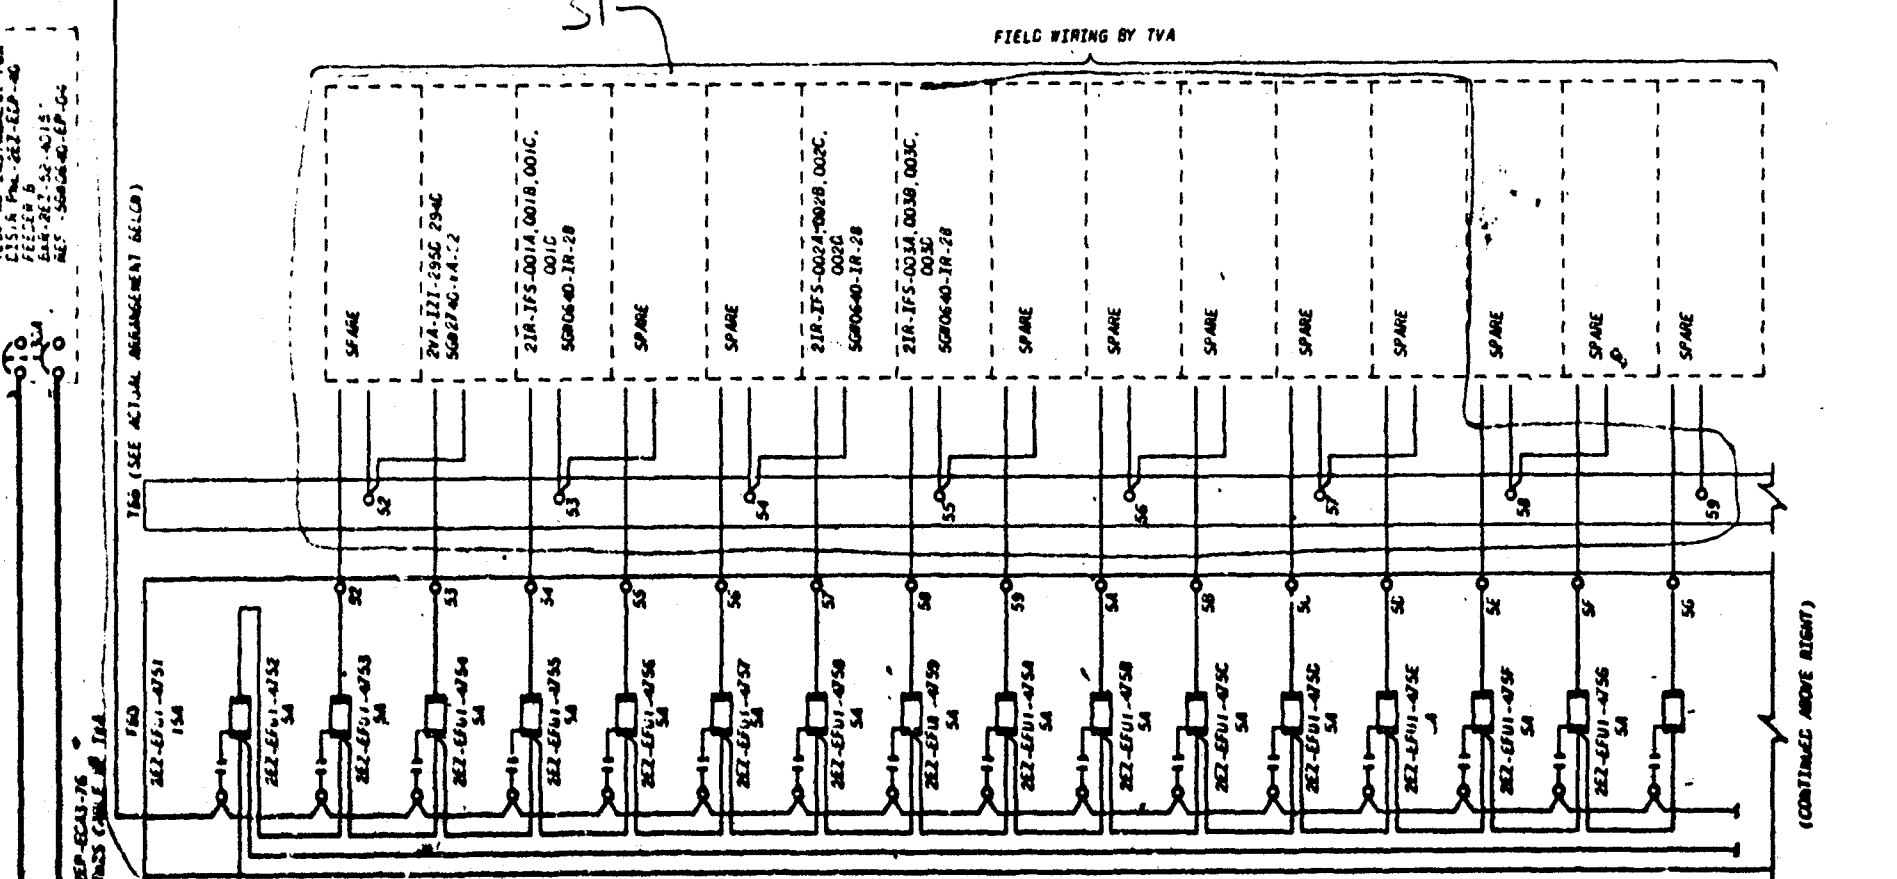

WIRING BY MANUFACTURER, SEE NOTE 3, SH 30

120V AC INSTRUMENT POWER DISTRIBUTION PANEL 2EZ-EDP-47
 (CONTINUED FROM SGM0640-EP-32, 33)
 (CONTINUED ON SGM0640-EP-35)
 FIELD WIRING BY TVA

NEUTRAL CONNECTIONS FOR TERMINAL BOARD AND FUSES ABOVE

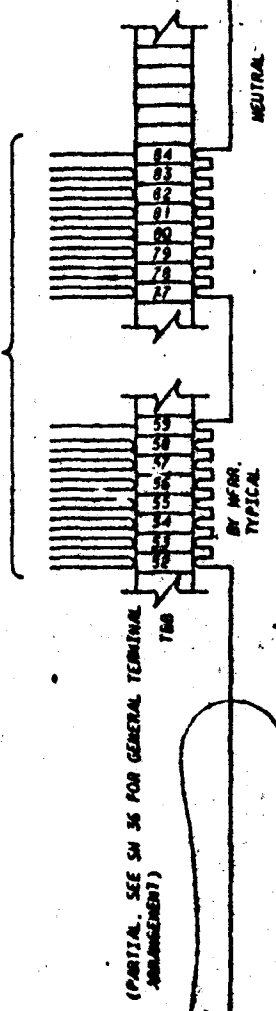

NOTES
 1. FOR GENERAL NOTES REFERENCES, REFER TO SGM0640-EP-30
 2. THIS DRAWING SUPERSEDES COULD DRAWING L-40-13040003, SHEET 3, CONTRACT JBR4-823703, FOR CABINET DOCUMENTATION

Docket # 50-158
 Control # 8304050536
 Draw 3-25-83 of Document
 REGULATORY DOCKET FILE

PRC APERTURE CARD

COMPANION SHEETS:
 SGM0640-EP-30, 32, 33, 35

2EZ-EEOC-08
 AUXILIARY CONTROL ROOM
 120V AC DISTRIBUTION CABINET

1	31,000	1	31,000	1	31,000	1	31,000	1	31,000
REVISION, ADDED FUSE LOAD, POWER FOR 2ZV									
REV	NO	DATE	BY	CHKD	APPD	REASON			
001			C. O. PETERSON						
002			R. E. O'NEAL						
003			C. F. WEAVER						
004			O. K. GANTNER						
SCALE: NTS								EXCEPT AS NOTED	
GENERAL UNITS 1 & 2									
SCHEMATIC DIAGRAM									
250 VDC NORMAL POWER									
DISTRIBUTION SYSTEM									
BELLEFONTE NUCLEAR PLANT									
TENNESSEE VALLEY AUTHORITY									
DIVISION OF ENGINEERING DESIGN									
QUANTITY	RECOMMENDED	APPROVED							
	M. R. STEVENSON	J. L. SPRINGER	R. H. MOYER						
INSPECTED AND APPROVED FOR ISSUE									
KNOXVILLE	SGM 150640-EP-34								N