






11X-14-008
MAIN CONTROL ROOM PANEL
EL 673

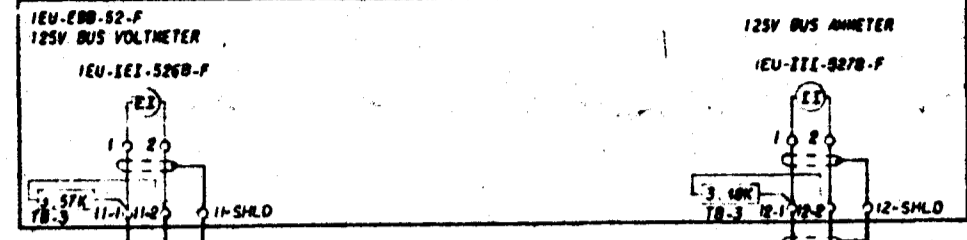

000-EEOC-64
COMMUNICATIONS OPERATIONS RECORDER
TERMINATION CABINET
9CW7364-QA-01


11X-11-020B
UNIT ANNUNCIATOR
TERMINATION CABINET
9CW1640-1A-01

FOR NOTES AND REFERENCES REFER TO 90W140-EU-04

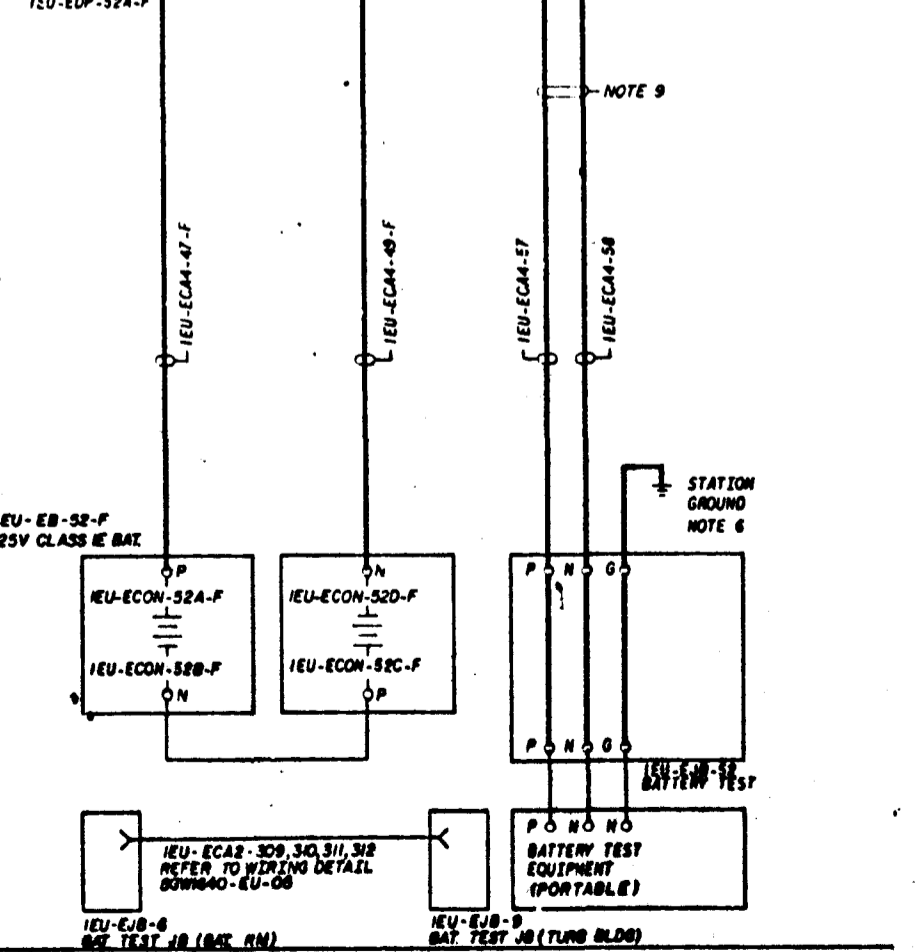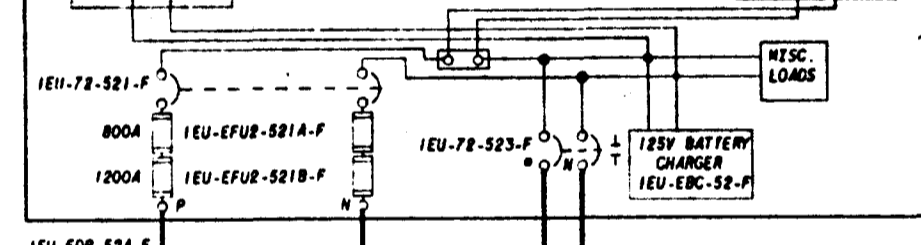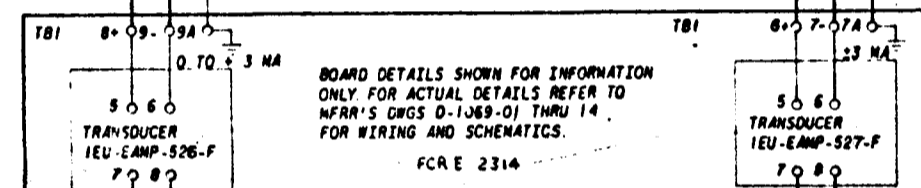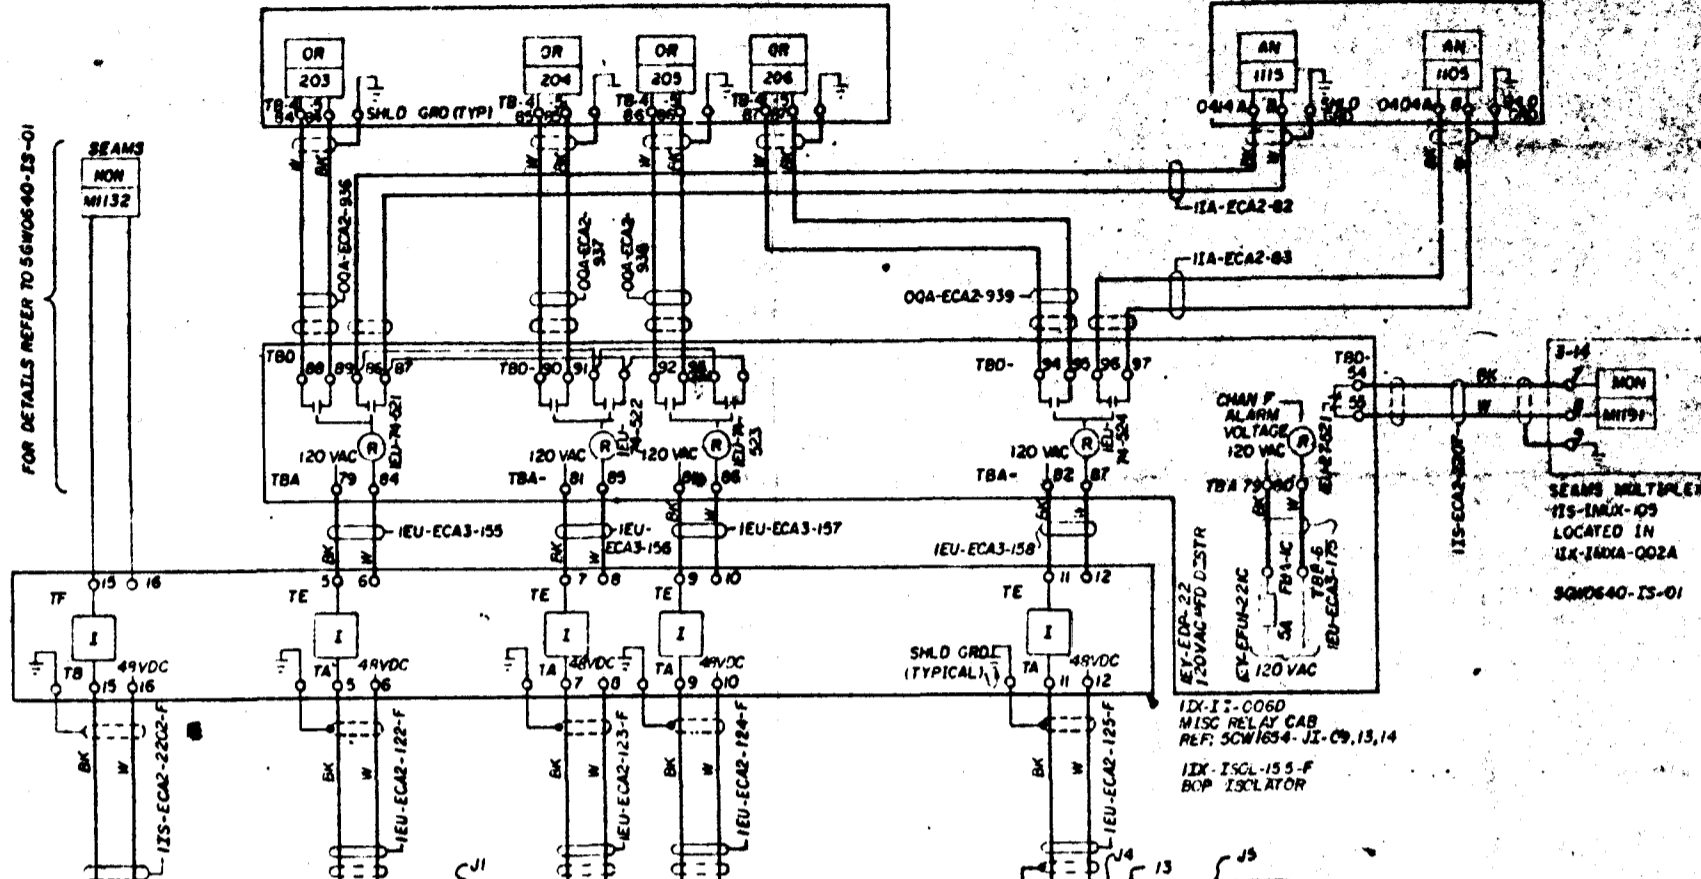

125V CLASS IE BAT IF TEST BAR CLOSED
125V CLASS IE BAT IF TEST BAR OPEN
125V CLASS IE BAT IF TEST BAR DISCONNECT
125V CLASS IE BAT IF TEST BAR DISCHARGE

ALL CONTACTS CLOSE TO ALARM (NOTE 7)
125V CLASS IE BAT IF TEST BAR DISCONNECT
125V CLASS IE BAT IF TEST BAR DISCHARGE

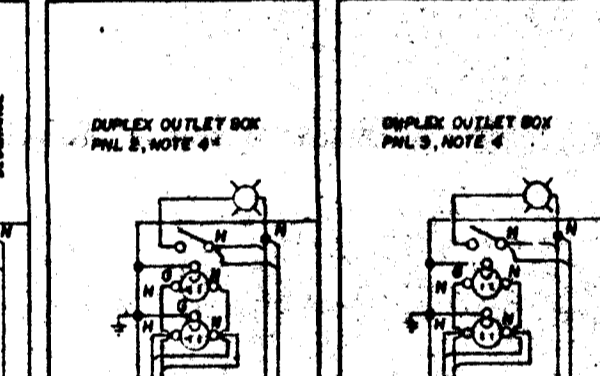

SAW0420-RW-01 (CKT 38) ZONE E2
120V AC LIGHTING POWER (LCB70) SAW0420-RW-01 (CKT 1A) ZONE E2

PRC APERTURE CARD

Doc't # 50-438
Control # 9304050536
Date 5-24-83 of Document
REGULATORY DOCKET FILE

COMPLETION DATE: 02/20/80, 01/04/80, 06/07/80

3	SI	11-16-73	90W140-EU-06	11X-11-020B	11X-14-008
2	INCORPORATED FOR E-234				
2	INCORPORATED FOR E-1743, BAT DISCHARGE TEST EQUIP, MISC CHANGES				
1	ADDED ALARM ISOLATION DETAILS REVISED NUMBER NOT				
1	DATE				
SCALE: GENERAL EXCEPT AS NOTED					
UNIT 1					
SCHEMATIC DIAGRAM					
125V CLASS IE DC POWER DISTRIBUTION SYSTEM					
BELLEFONTE NUCLEAR PLANT					
TENNESSEE VALLEY AUTHORITY					
DIVISION OF ENGINEERING DESIGN					
REVIEWED	RE (ELEC)	RE (MECH)	RE (INSTR)	RE (TEST)	RE (OTHER)
APPROVED	APPROVED	APPROVED	APPROVED	APPROVED	APPROVED
NOV 1979	NOV 1979	NOV 1979	NOV 1979	NOV 1979	NOV 1979
KNOXVILLE 7-2-79 80 E 90W140-EU-06					

INTERCONNECTIONS
125V CLASS IE BATTERY BOARD IEU-EBB-52-F
PANELS IEU-EDP-52A-F, IEU-EDP-52B-F