



11X-14-008
MAIN CONTROL ROOM PANEL
EL 673

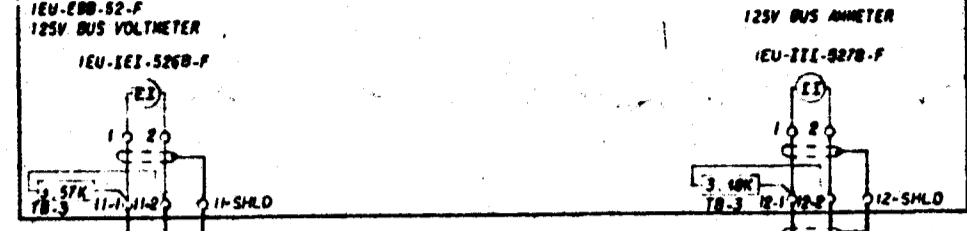








000-EEOC-64
COMMUNICATIONS OPERATIONS RECORDER
TERMINATION CABINET
9CW7364-QA-01

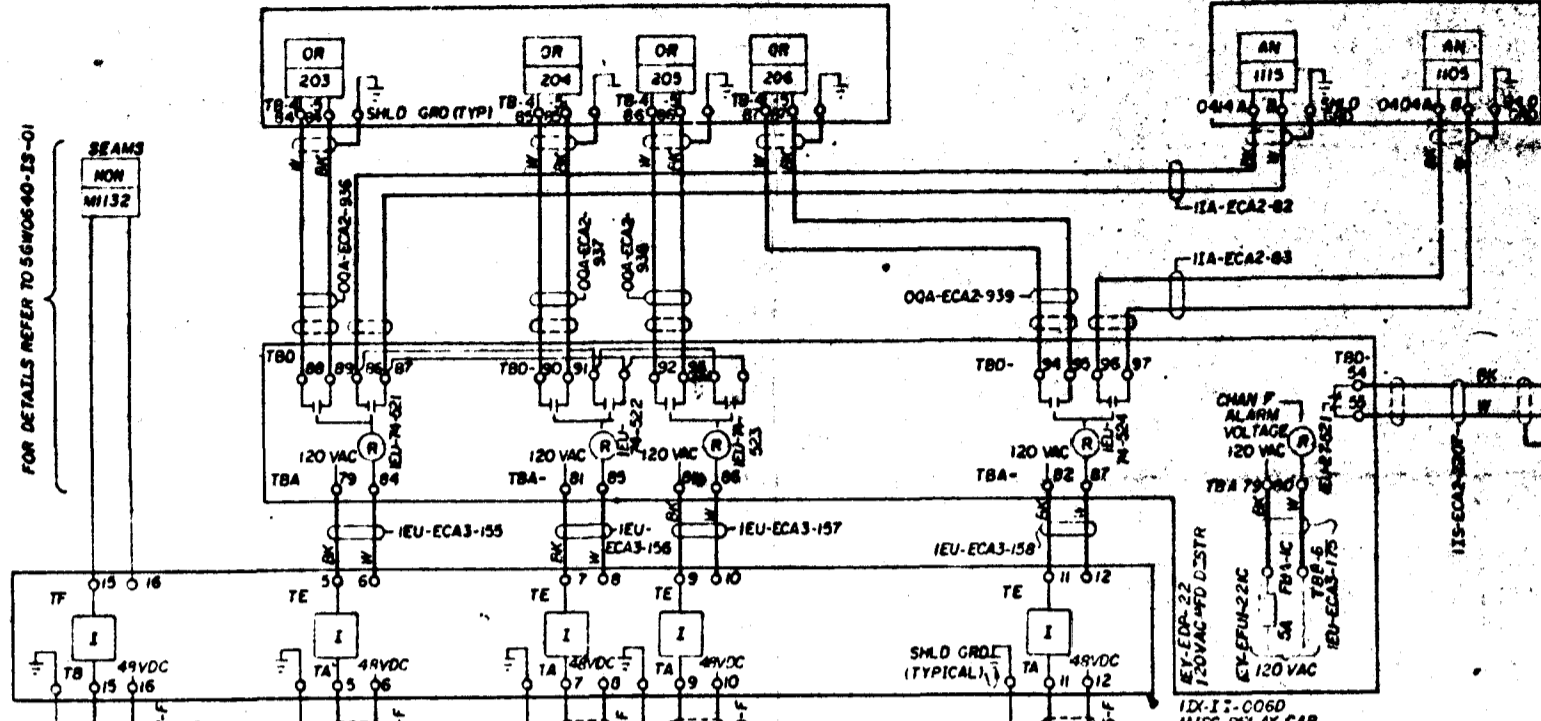

11X-11-020B
UNIT ANNUNCIATOR
TERMINATION CABINET
9CW1640-1A-01

FOR NOTES AND REFERENCES REFER TO 90W1640-EU-04

BOARD DETAILS SHOWN FOR INFORMATION ONLY FOR ACTUAL DETAILS REFER TO NFR'S DWS D-1069-01 THRU 14 FOR WIRING AND SCHEMATICS.
FCRE 2314

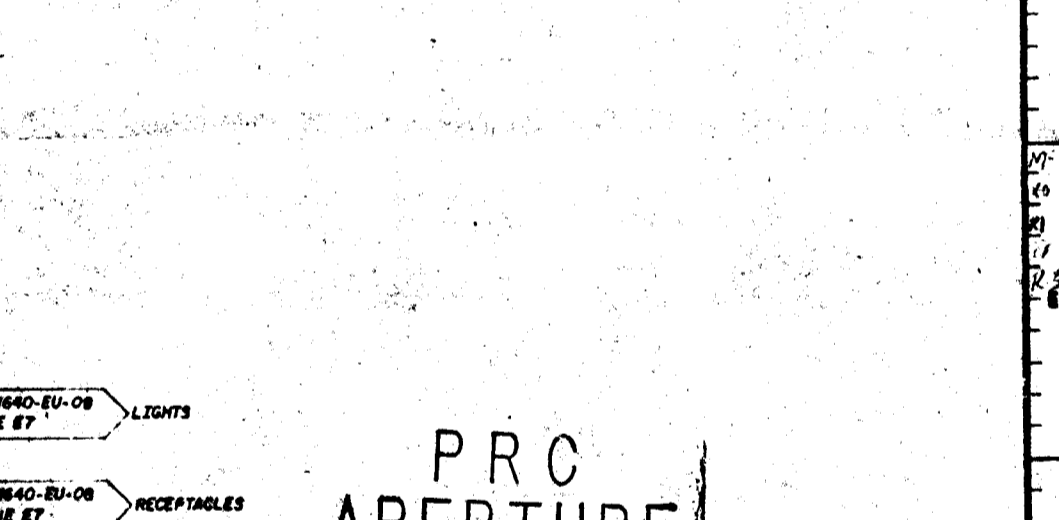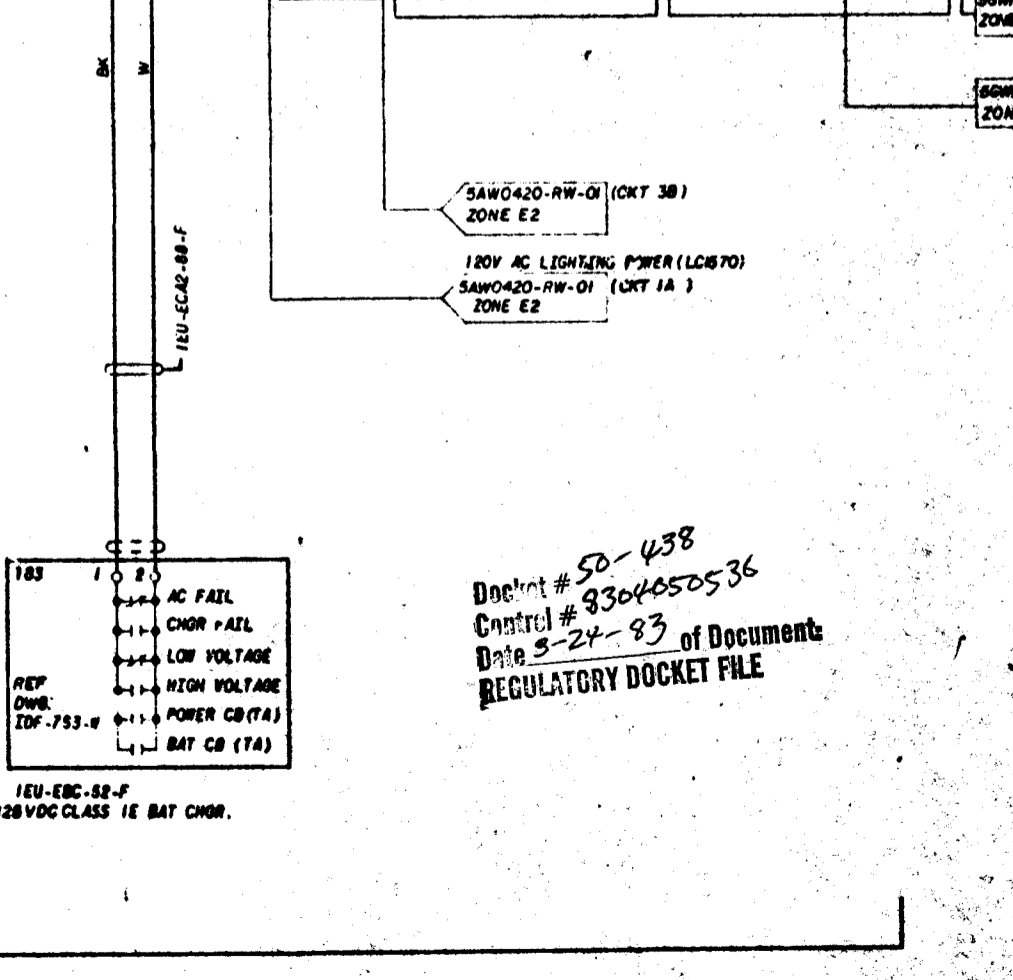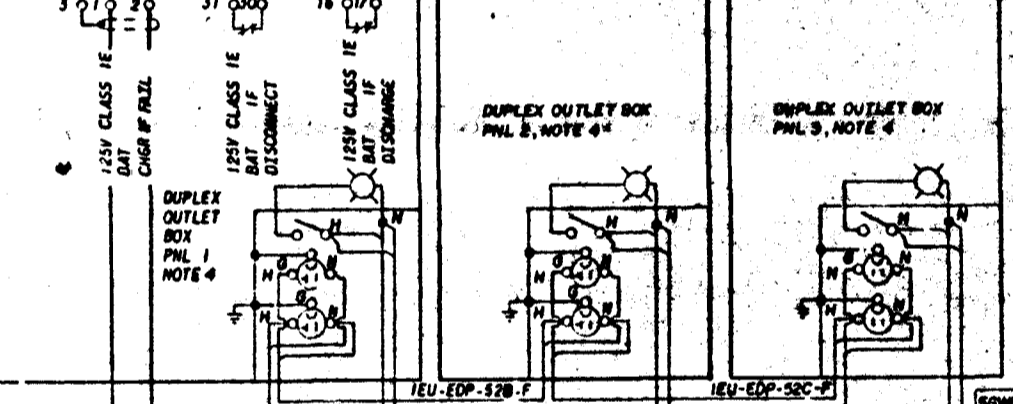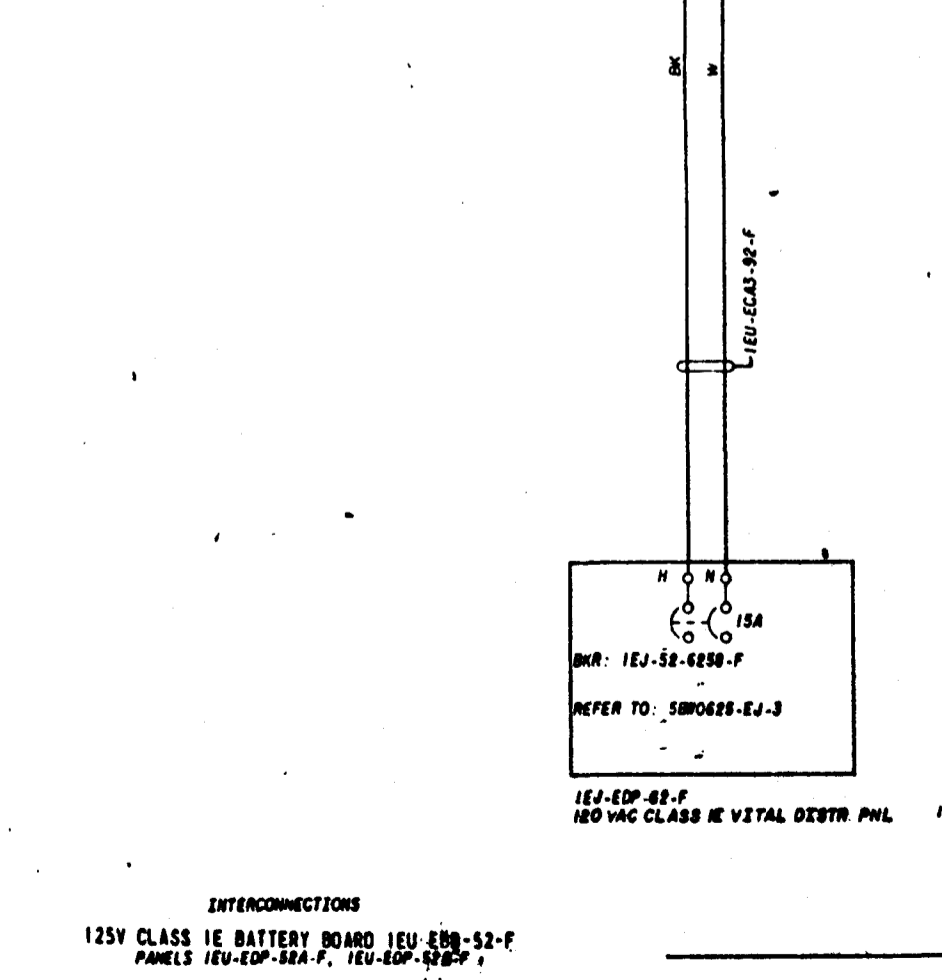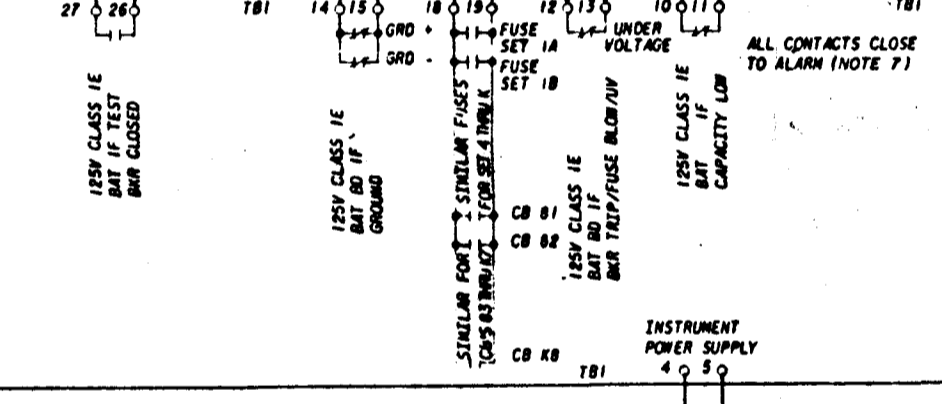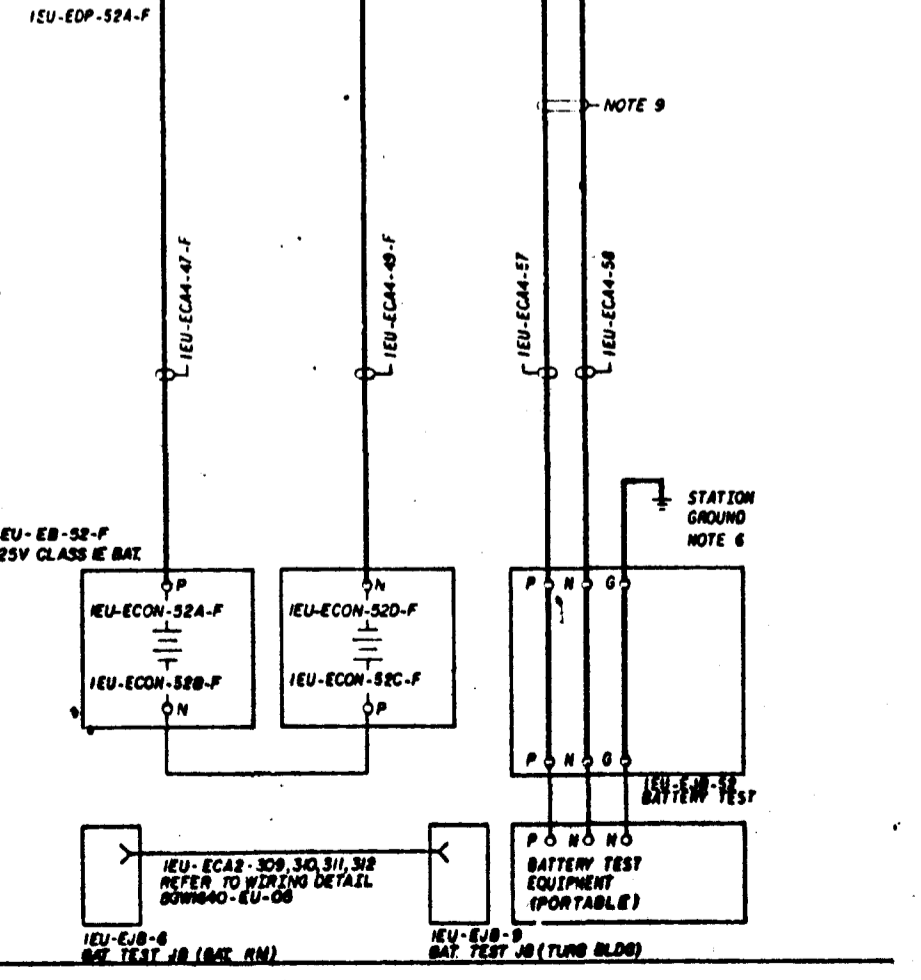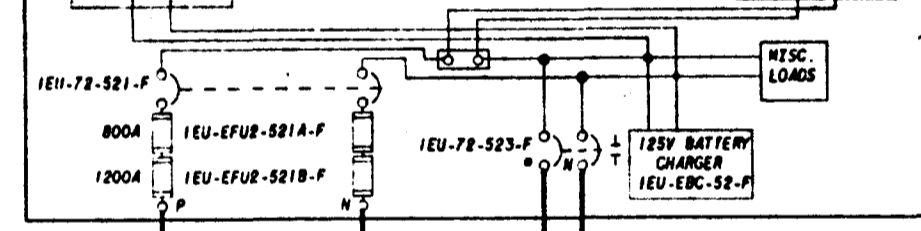

PRC APERTURE CARD

Doc't # 50-438
Control # 9304050536
Date 5-24-83 of Document
REGULATORY DOCKET FILE

COMPLETION DATE: 02/20/80, 01/04/80, 06/07/80

3	SI	11-16-73	90W1640-EU-06	11X-11-020B	11X-14-008
2	SI	2-24-81	90W1640-EU-06	11X-11-020B	11X-14-008
1	SI	9-7-77	90W1640-EU-06	11X-11-020B	11X-14-008
INCORPORATED FOR E-234. INCORPORATED FOR E-1743, BAT DISCHARGE TEST EQUIP, MISC CHANGES. ADD'D ALARM ISOLATION DETAILS REVISED NUMBER NOTED. SCALE: GENERAL EXCEPT AS NOTED UNIT 1 SCHEMATIC DIAGRAM 125V CLASS IE DC POWER DISTRIBUTION SYSTEM BELLEFONTE NUCLEAR PLANT TENNESSEE VALLEY AUTHORITY DIVISION OF ENGINEERING DESIGN SUBMITTED: 7-2-77 RECOMMENDED: [Signature] APPROVED: [Signature] INSPECTED AND APPROVED FOR ISSUE: [Signature] KNOXVILLE 7-2-77 90 E 5GW1640-EU-06					