


LIQUID PLANT DISCH ISOLATION VALVE, IFCV-290

THREE POSITION SELECTOR SWITCH- SPRING RETURN TO CENTER

CONTACT	SWITCH POSITION		
	CLOSE	CENTER	OPEN
A	I	O	O
B	O	O	I


1-CONTACT CLOSED
O-CONTACT OPEN

DETAIL A17

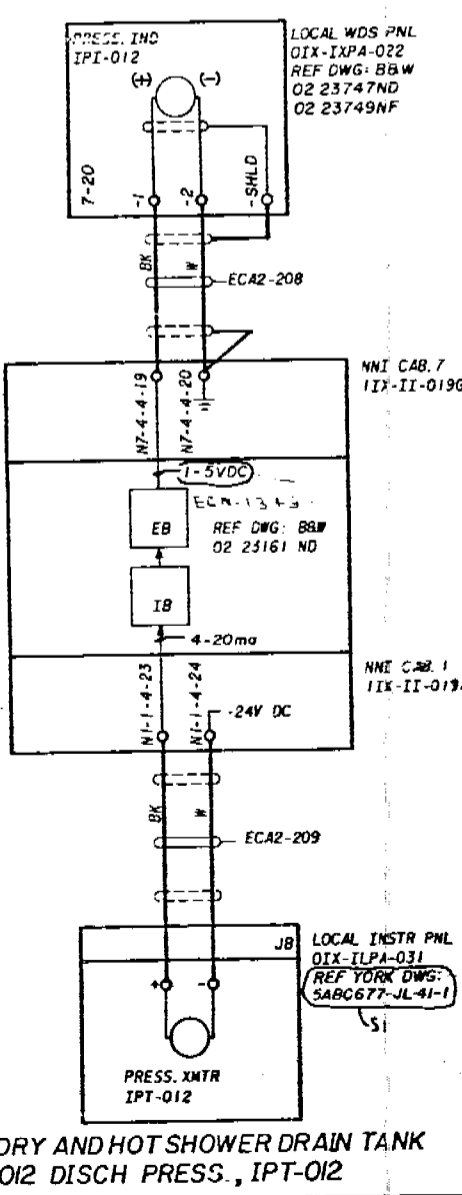

LAUNDRY AND HOT SHOWER DRAIN TANK PUMP I02 DISCH PRESS., IPT-012

WASTE GAS DECAY TANK 004 PRESSURE, OWG-IPT-004

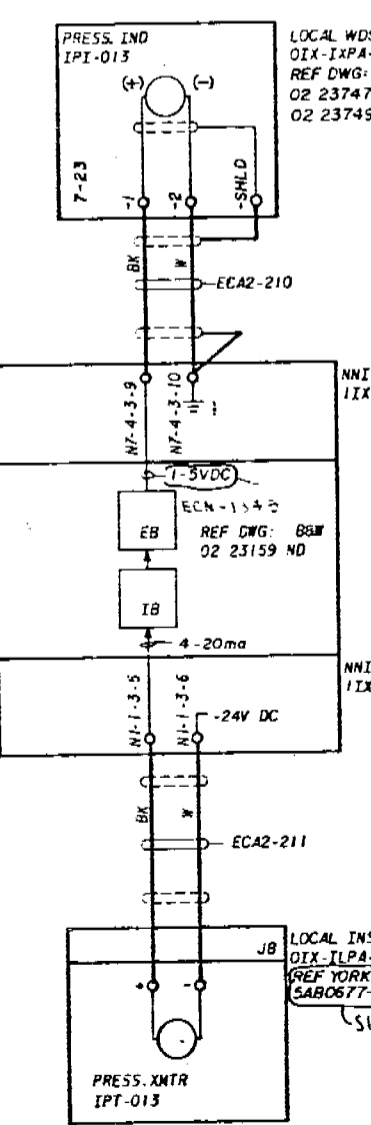

WASTE GAS DECAY TANK 005 PRESSURE, OWG-IPT-005

NOTES:
1. FOR GENERAL NOTES AND SYMBOLS SEE 5G0740-WD-01.

PRC APERTURE CARD

REV	NO	DATE	BY	CHKD	APPD	DESCRIPTION
4	1	12-15-78	W.A. Adams	W.A. Adams	W.A. Adams	CHANGED NNI CAB OUTPUT SIGNAL VOLTAGE RANGE. CHG REF DWG.
3	1	12-15-78	W.A. Adams	W.A. Adams	W.A. Adams	ADDED TERM. NO. 8 MADE MINOR CHANGES.
2	1	12-15-78	W.A. Adams	W.A. Adams	W.A. Adams	MADE MINOR CHANGES.
1	1	12-15-78	W.A. Adams	W.A. Adams	W.A. Adams	ADDED VARIOUS TERM. NO. AND MINOR CHANGES.

SCALE: NONE EXCEPT AS NOTED

GENERAL UNITS 1&2

SYSTEM SCHEMATIC
WASTE DISPOSAL SYSTEM

BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN

SUBMITTED: W.A. Adams
RECOMMENDED: W.A. Adams
APPROVED: R.M. Hodges

INSPECTED AND APPROVED FOR ISSUE: W.A. Adams

KNOXVILLE 12-15-78 88E SGW0740-WD-17 R4

PRINT	NO	DATE	BY	CHKD	APPD
1	1	12-15-78	W.A. Adams	W.A. Adams	W.A. Adams