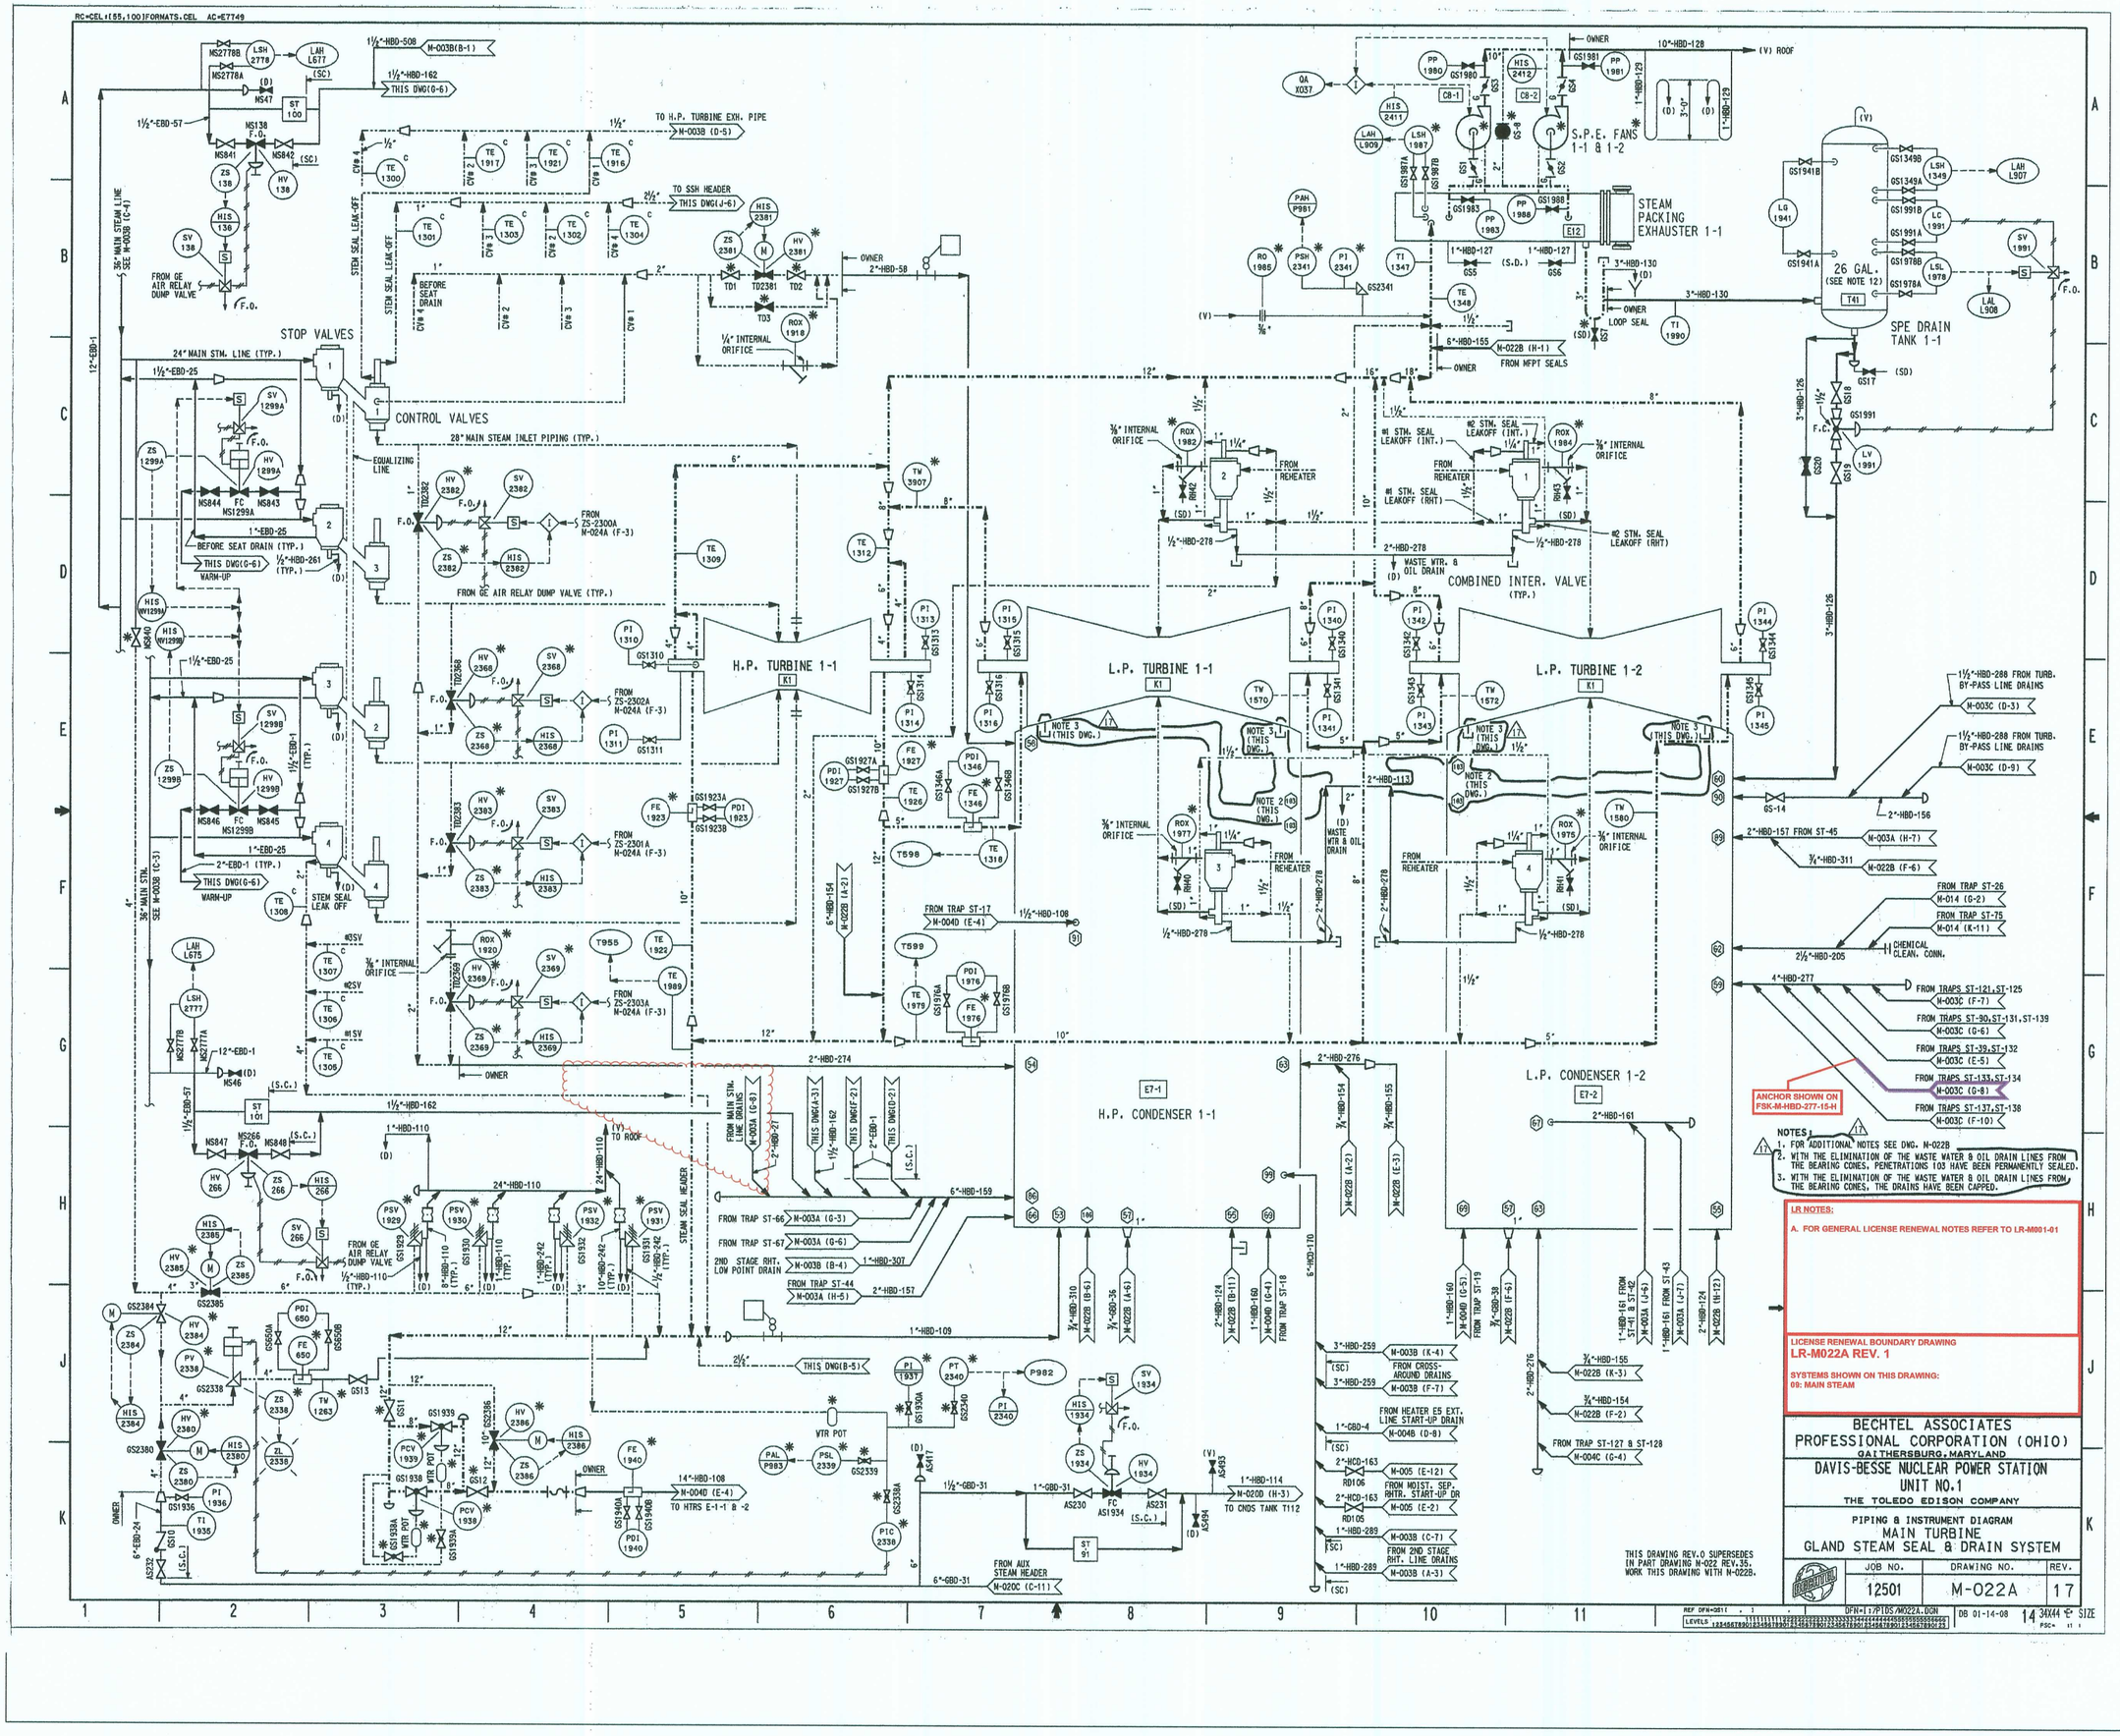
STOP VALVES
CONTROL VALVES
H.P. TURBINE 1-1
L.P. TURBINE 1-1
L.P. TURBINE 1-2
S.P.E. FANS 1-1 & 1-2
STEAM PACKING EXHAUSTER 1-1
26 GAL. (SEE NOTE 12)
SPE DRAIN TANK 1-1
COMBINED INTER. VALVE (TYP.)
H.P. CONDENSER 1-1
L.P. CONDENSER 1-2
ANCHOR SHOWN ON FSK-M-HBD-277-15-H
NOTES:
1. FOR ADDITIONAL NOTES SEE DWG. N-022B
2. WITH THE ELIMINATION OF THE WASTE WATER & OIL DRAIN LINES FROM THE BEARING CONES, PENETRATIONS 103 HAVE BEEN PERMANENTLY SEALED.
3. WITH THE ELIMINATION OF THE WASTE WATER & OIL DRAIN LINES FROM THE BEARING CONES, THE DRAINS HAVE BEEN CAPPED.
LR NOTES:
A. FOR GENERAL LICENSE RENEWAL NOTES REFER TO LR-M001-01
LICENSE RENEWAL BOUNDARY DRAWING
LR-M022A REV. 1
SYSTEMS SHOWN ON THIS DRAWING:
09: MAIN STEAM
BECHTEL ASSOCIATES PROFESSIONAL CORPORATION (OHIO)
GAITHERSBURG, MARYLAND
DAVIS-BESSE NUCLEAR POWER STATION UNIT NO.1
THE TOLEDO EDISON COMPANY
PIPING & INSTRUMENT DIAGRAM
MAIN TURBINE GLAND STEAM SEAL & DRAIN SYSTEM
JOB NO. 12501
DRAWING NO. M-022A
REV. 17
THIS DRAWING REV.0 SUPERSEDES IN PART DRAWING N-022 REV.35. WORK THIS DRAWING WITH N-022B.

01A26