RC-CEL-(155,100)FORMATS.CEL AC-E7749

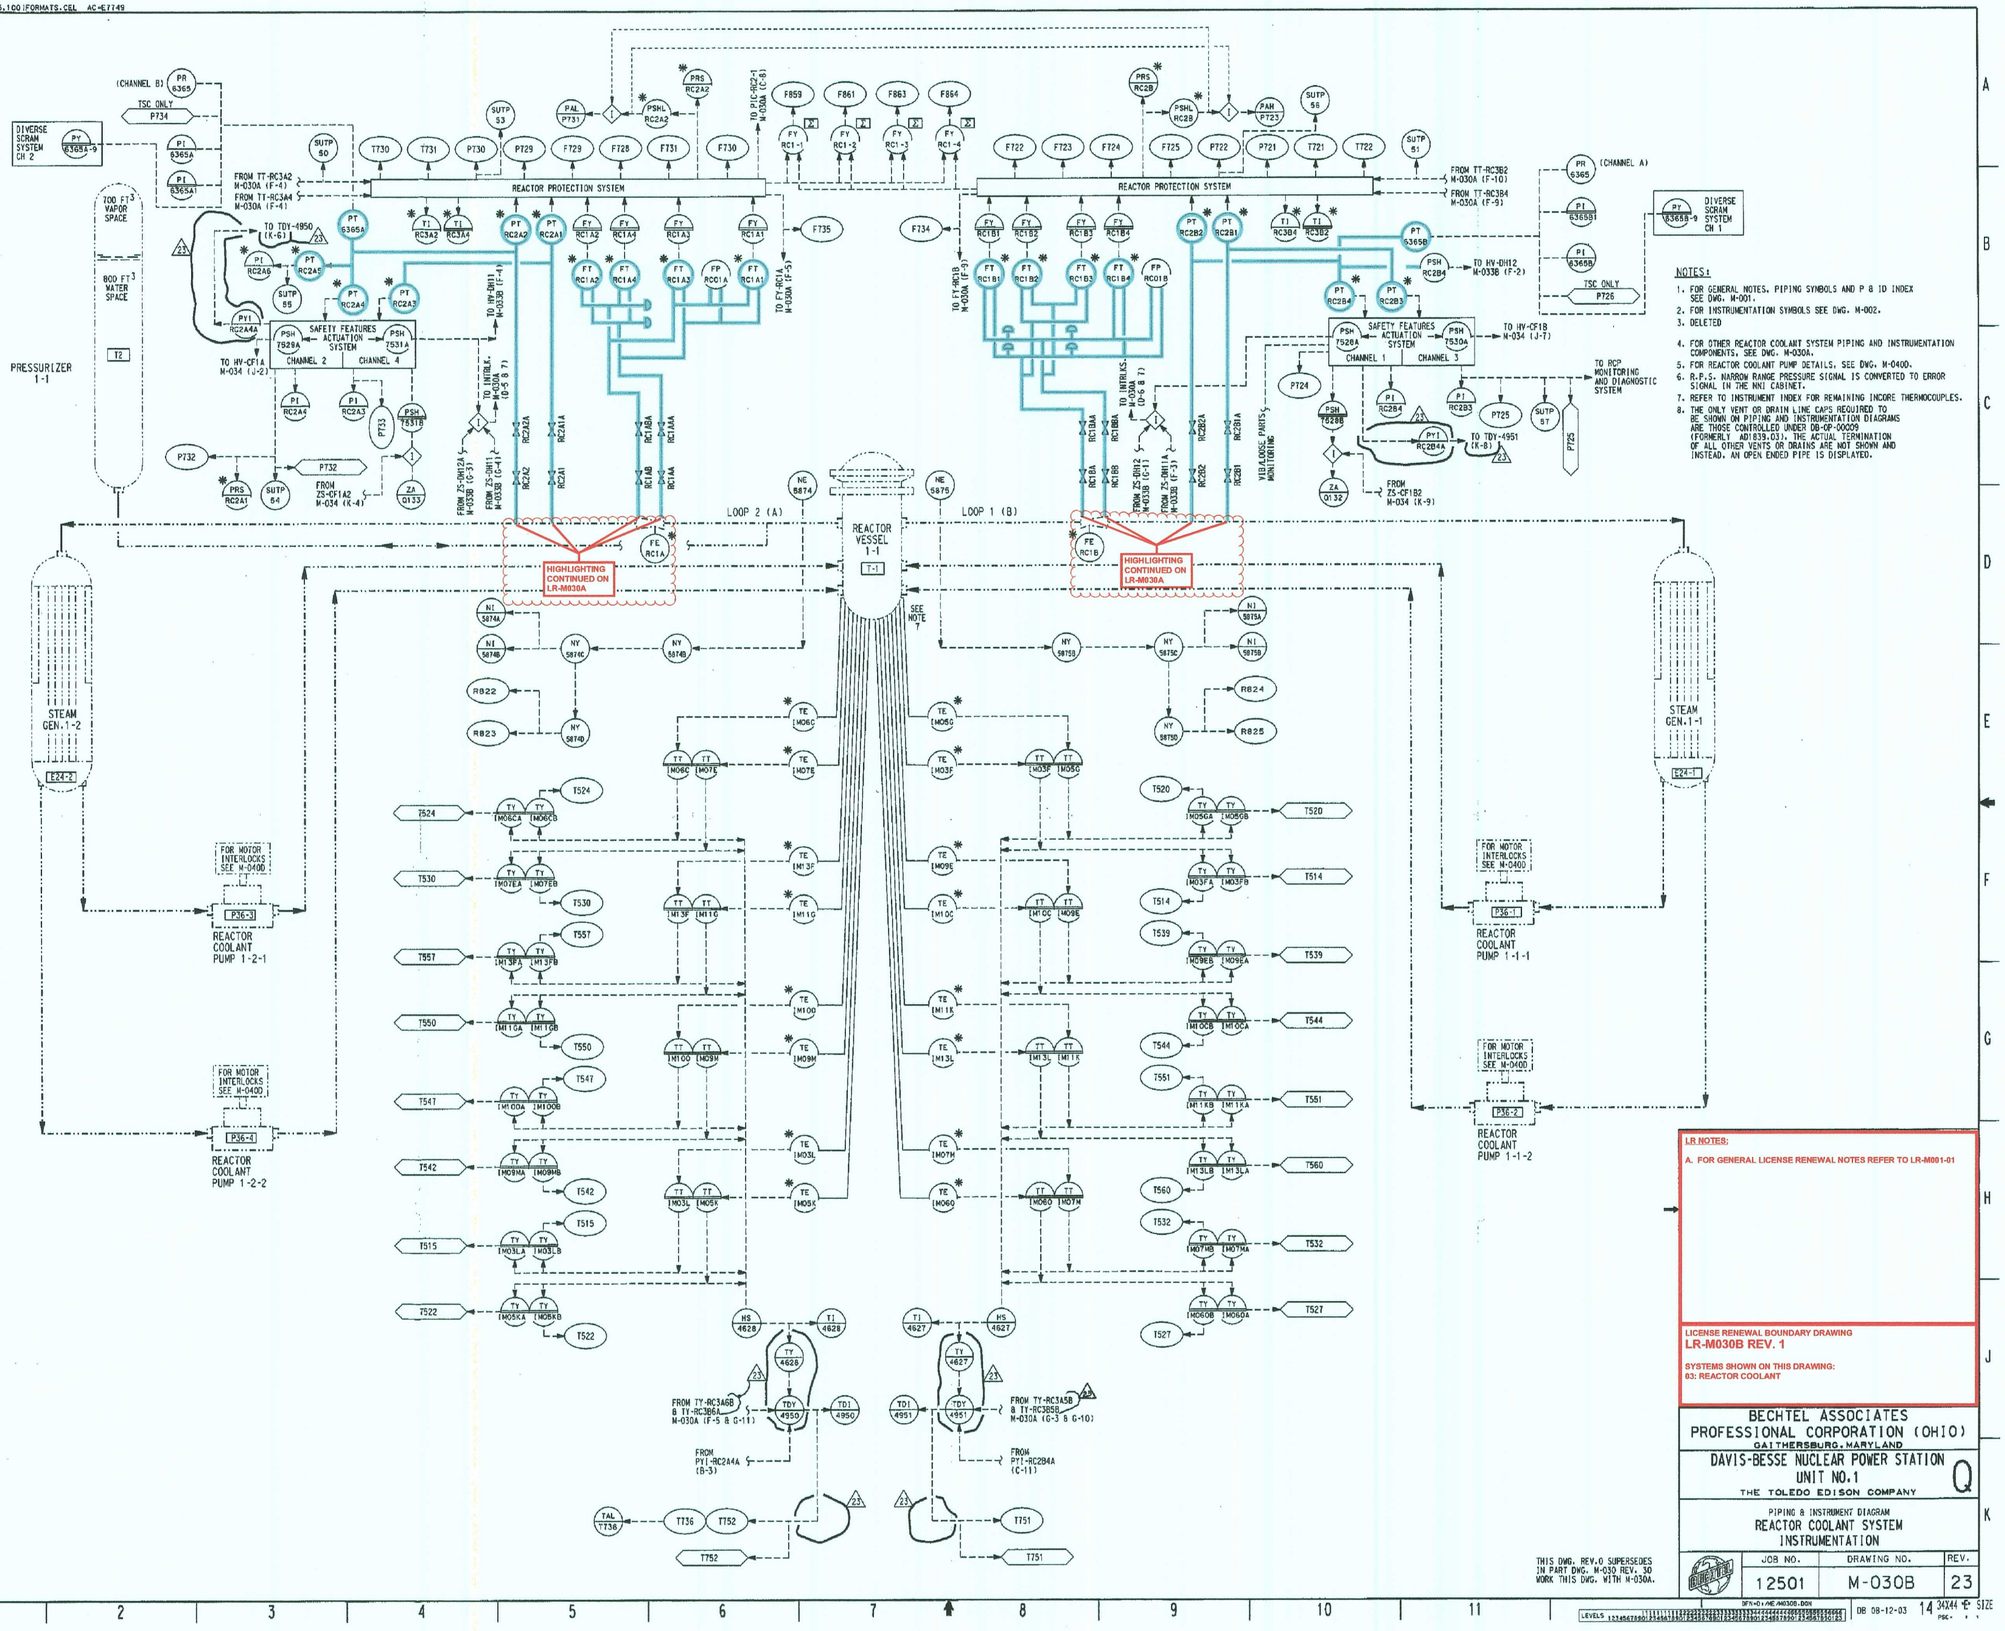

NOTES:

1. FOR GENERAL NOTES, PIPING SYMBOLS AND P & ID INDEX SEE DWG. M-001.
2. FOR INSTRUMENTATION SYMBOLS SEE DWG. M-002.
3. DELETED
4. FOR OTHER REACTOR COOLANT SYSTEM PIPING AND INSTRUMENTATION COMPONENTS, SEE DWG. M-030A.
5. FOR REACTOR COOLANT PUMP DETAILS, SEE DWG. M-0400.
6. R.P.S. NARROW RANGE PRESSURE SIGNAL IS CONVERTED TO ERROR SIGNAL IN THE NNI CABINET.
7. REFER TO INSTRUMENT INDEX FOR REMAINING INCORE THERMOCOUPLES.
8. THE ONLY VENT OR DRAIN LINE CAPS REQUIRED TO BE SHOWN ON PIPING AND INSTRUMENTATION DIAGRAMS ARE THOSE CONTROLLED UNDER DB-OP-00009 (FORMERLY ADI 839.03). THE ACTUAL TERMINATION OF ALL OTHER VENTS OR DRAINS ARE NOT SHOWN AND INSTEAD, AN OPEN ENDED PIPE IS DISPLAYED.

LR NOTES:

A. FOR GENERAL LICENSE RENEWAL NOTES REFER TO LR-M001-01

LICENSE RENEWAL BOUNDARY DRAWING
LR-M030B REV. 1

SYSTEMS SHOWN ON THIS DRAWING:
63: REACTOR COOLANT

THIS DWG. REV.0 SUPERSEDES IN PART DWG. M-030 REV. 30 WORK THIS DWG. WITH M-030A.

BECHTEL ASSOCIATES PROFESSIONAL CORPORATION (OHIO)
GAITHERSBURG, MARYLAND

DAVIS-BESSE NUCLEAR POWER STATION UNIT NO.1 Q
THE TOLEDO EDISON COMPANY

PIPING & INSTRUMENT DIAGRAM
REACTOR COOLANT SYSTEM INSTRUMENTATION

JOB NO.	DRAWING NO.	REV.
12501	M-030B	23

SFN-D-M-M030B-001

DB 08-12-03 14 34X44 SIZE

01036