RC=OSO1[55,100]FORMATS.CEL AC=ESTD

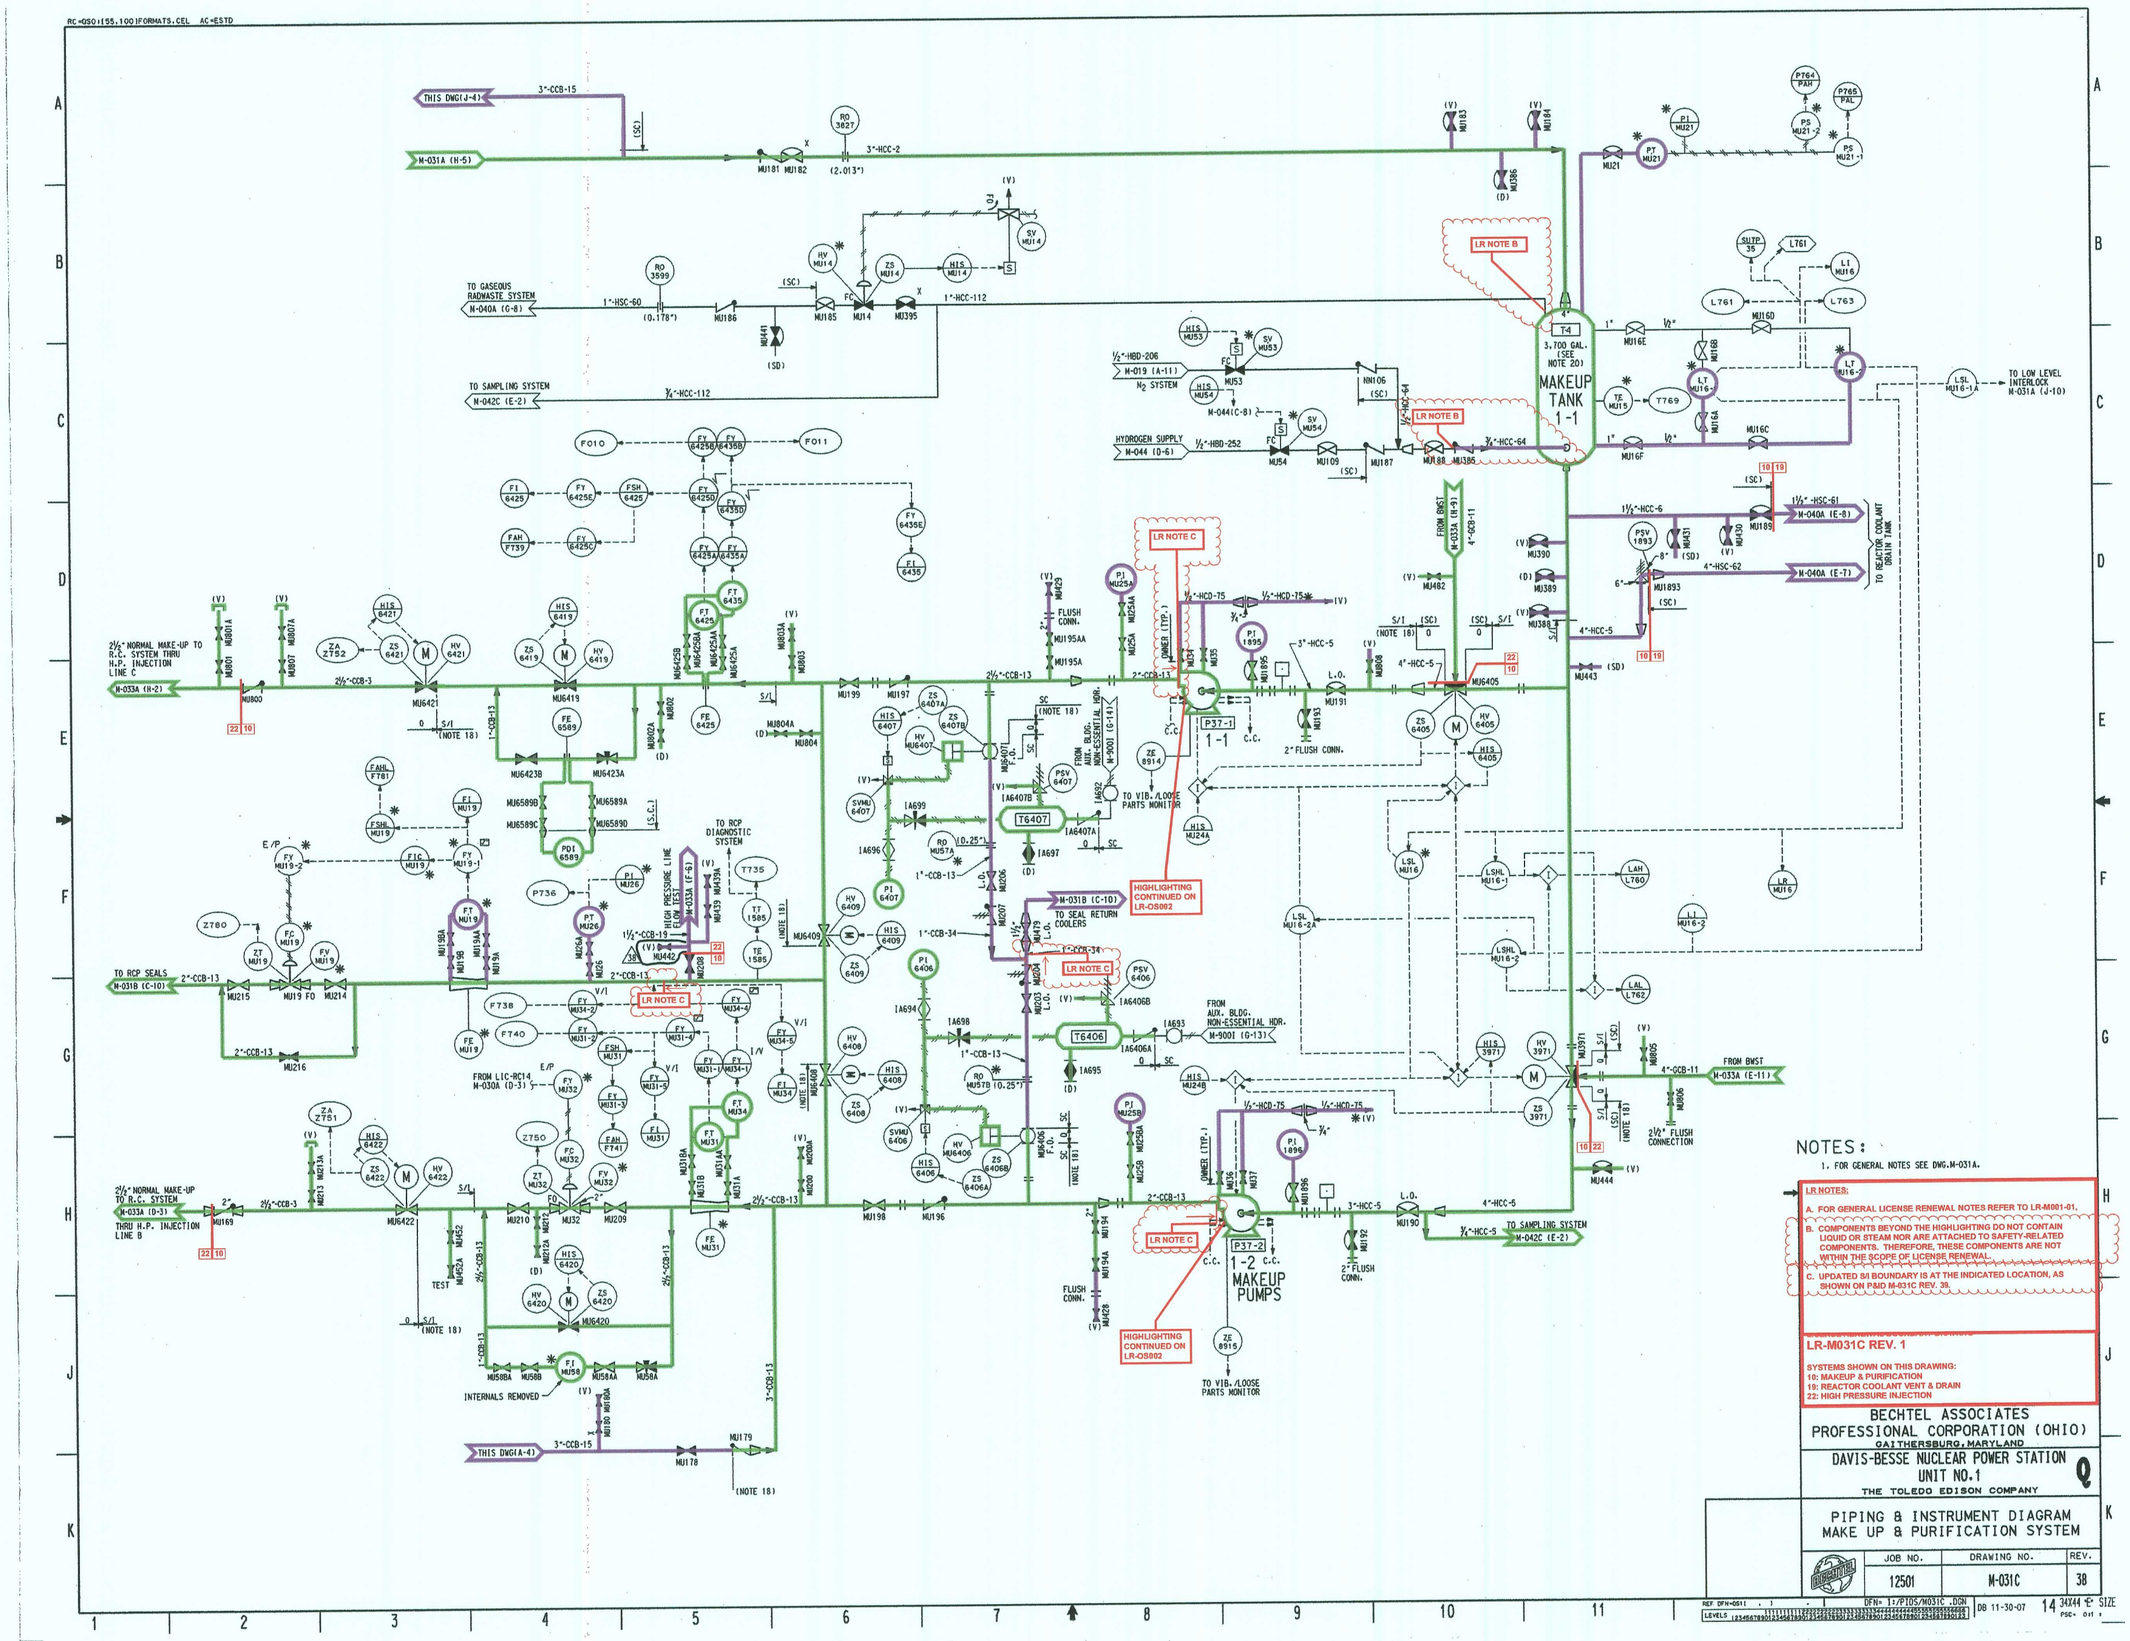

NOTES:

1. FOR GENERAL NOTES SEE DWG.M-031A.

LR NOTES:

A. FOR GENERAL LICENSE RENEWAL NOTES REFER TO LR-M001-01.

B. COMPONENTS BEYOND THE HIGHLIGHTING DO NOT CONTAIN LIQUID OR STEAM NOR ARE ATTACHED TO SAFETY-RELATED COMPONENTS. THEREFORE, THESE COMPONENTS ARE NOT WITHIN THE SCOPE OF LICENSE RENEWAL.

C. UPDATED S/I BOUNDARY IS AT THE INDICATED LOCATION, AS SHOWN ON P&ID M-031C REV. 39.

LR-M031C REV. 1

SYSTEMS SHOWN ON THIS DRAWING:
10: MAKEUP & PURIFICATION
19: REACTOR COOLANT VENT & DRAIN
22: HIGH PRESSURE INJECTION

BECHTEL ASSOCIATES PROFESSIONAL CORPORATION (OHIO)
GAITHERSBURG, MARYLAND

DAVIS-BESSE NUCLEAR POWER STATION UNIT NO.1 Q
THE TOLEDO EDISON COMPANY

PIPING & INSTRUMENT DIAGRAM
MAKE UP & PURIFICATION SYSTEM

JOB NO.	DRAWING NO.	REV.
12501	M-031C	38

REF DFN=0511 . . DFN= 11/P1DS/M031C .DGN DB 11-30-07 14 34X44 E SIZE PSE= 011 .

01039