

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8203170299 DOC. DATE: 82/03/12 NOTARIZED: NO DOCKET #
 FACIL: 50-305 Kewaunee Nuclear Power Plant, Wisconsin Public Service 05000305
 AUTH. NAME AUTHOR AFFILIATION
 MATHEWS, E. R. Wisconsin Public Service Corp.
 RECIP. NAME RECIPIENT AFFILIATION
 VARGA, S. A. Operating Reactors Branch 1

SUBJECT: Comments on unreviewed Safety Issue A-43, containments emergency sump performance, transmitted on 820212. Draft rept acceptable.

DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: General Distribution for after Issuance of Operating License

NOTES: I&E: 3 copies all material. 05000305

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID	CODE/NAME	LTTR	ENCL		ID	CODE/NAME	LTTR	ENCL
	ORB #1	BC	01	13				13	
INTERNAL:	ELD			1	IE	06		1	
	NRR/DHFS	DEPY08		1	NRR/DL DIR			1	
	NRR/DL	ORAB		1	NRR/DSI/RAB			1	
	<u>REG FILE</u>		04	1	RGN3			1	
EXTERNAL:	ACRS		09	10	LPDR	03		1	
	NRC PDR		02	1	NSIC	05		1	
	NTIS			1					


TOTAL NUMBER OF COPIES REQUIRED: LTTR 38 ENCL 0

WISCONSIN PUBLIC SERVICE CORPORATION


P.O. Box 1200, Green Bay, Wisconsin 54305

March 12, 1982

Mr. S. A. Varga, Chief
 Operating Reactors Branch #1
 Division of Licensing
 U. S. Nuclear Regulatory Commission
 Washington, D. C. 20555

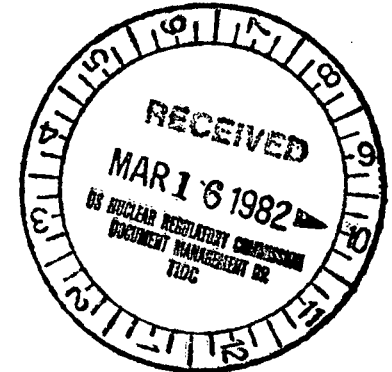

Dear Mr. Varga:

Docket 50-305
 Operating License DPR-43
 Kewaunee Nuclear Power Plant
 Unreviewed Safety Issue A-43, Containment
Emergency Sump Performance

Reference: Letter from Mr. S. A. Varga to Mr. E. R. Mathews dated February 12, 1982

The above referenced letter transmitted a draft report prepared by Burns and Roe, Inc., concerning emergency sump performance. This draft has been reviewed and is generally acceptable. The following minor comments are provided for your information.

- Page G-4 incorrectly lists Emergency Feedwater, Safety Injection and Shutdown Cooling Systems as having reflective metallic or Thermobestos insulation. The shutdown cooling (residual heat removal) and the safety injection systems are only insulated near the reactor vessel and are otherwise not insulated. The auxiliary feedwater piping is not insulated.
- Page 4, third sentence from the bottom; "Polyurethan" should be "polyurethane."
- Page G-5, first paragraph; "inside" is incorrectly spelled.
- Page G-5, first paragraph; "... the floor with two pipes intakes..." Change "pipes" to "pipe."

Very truly yours,

E. R. Mathews, Senior Vice President
 Power Supply & Engineering

snf

cc - Mr. Robert Nelson, US NRC

A001
 6/10