


TI APERTURE CARD

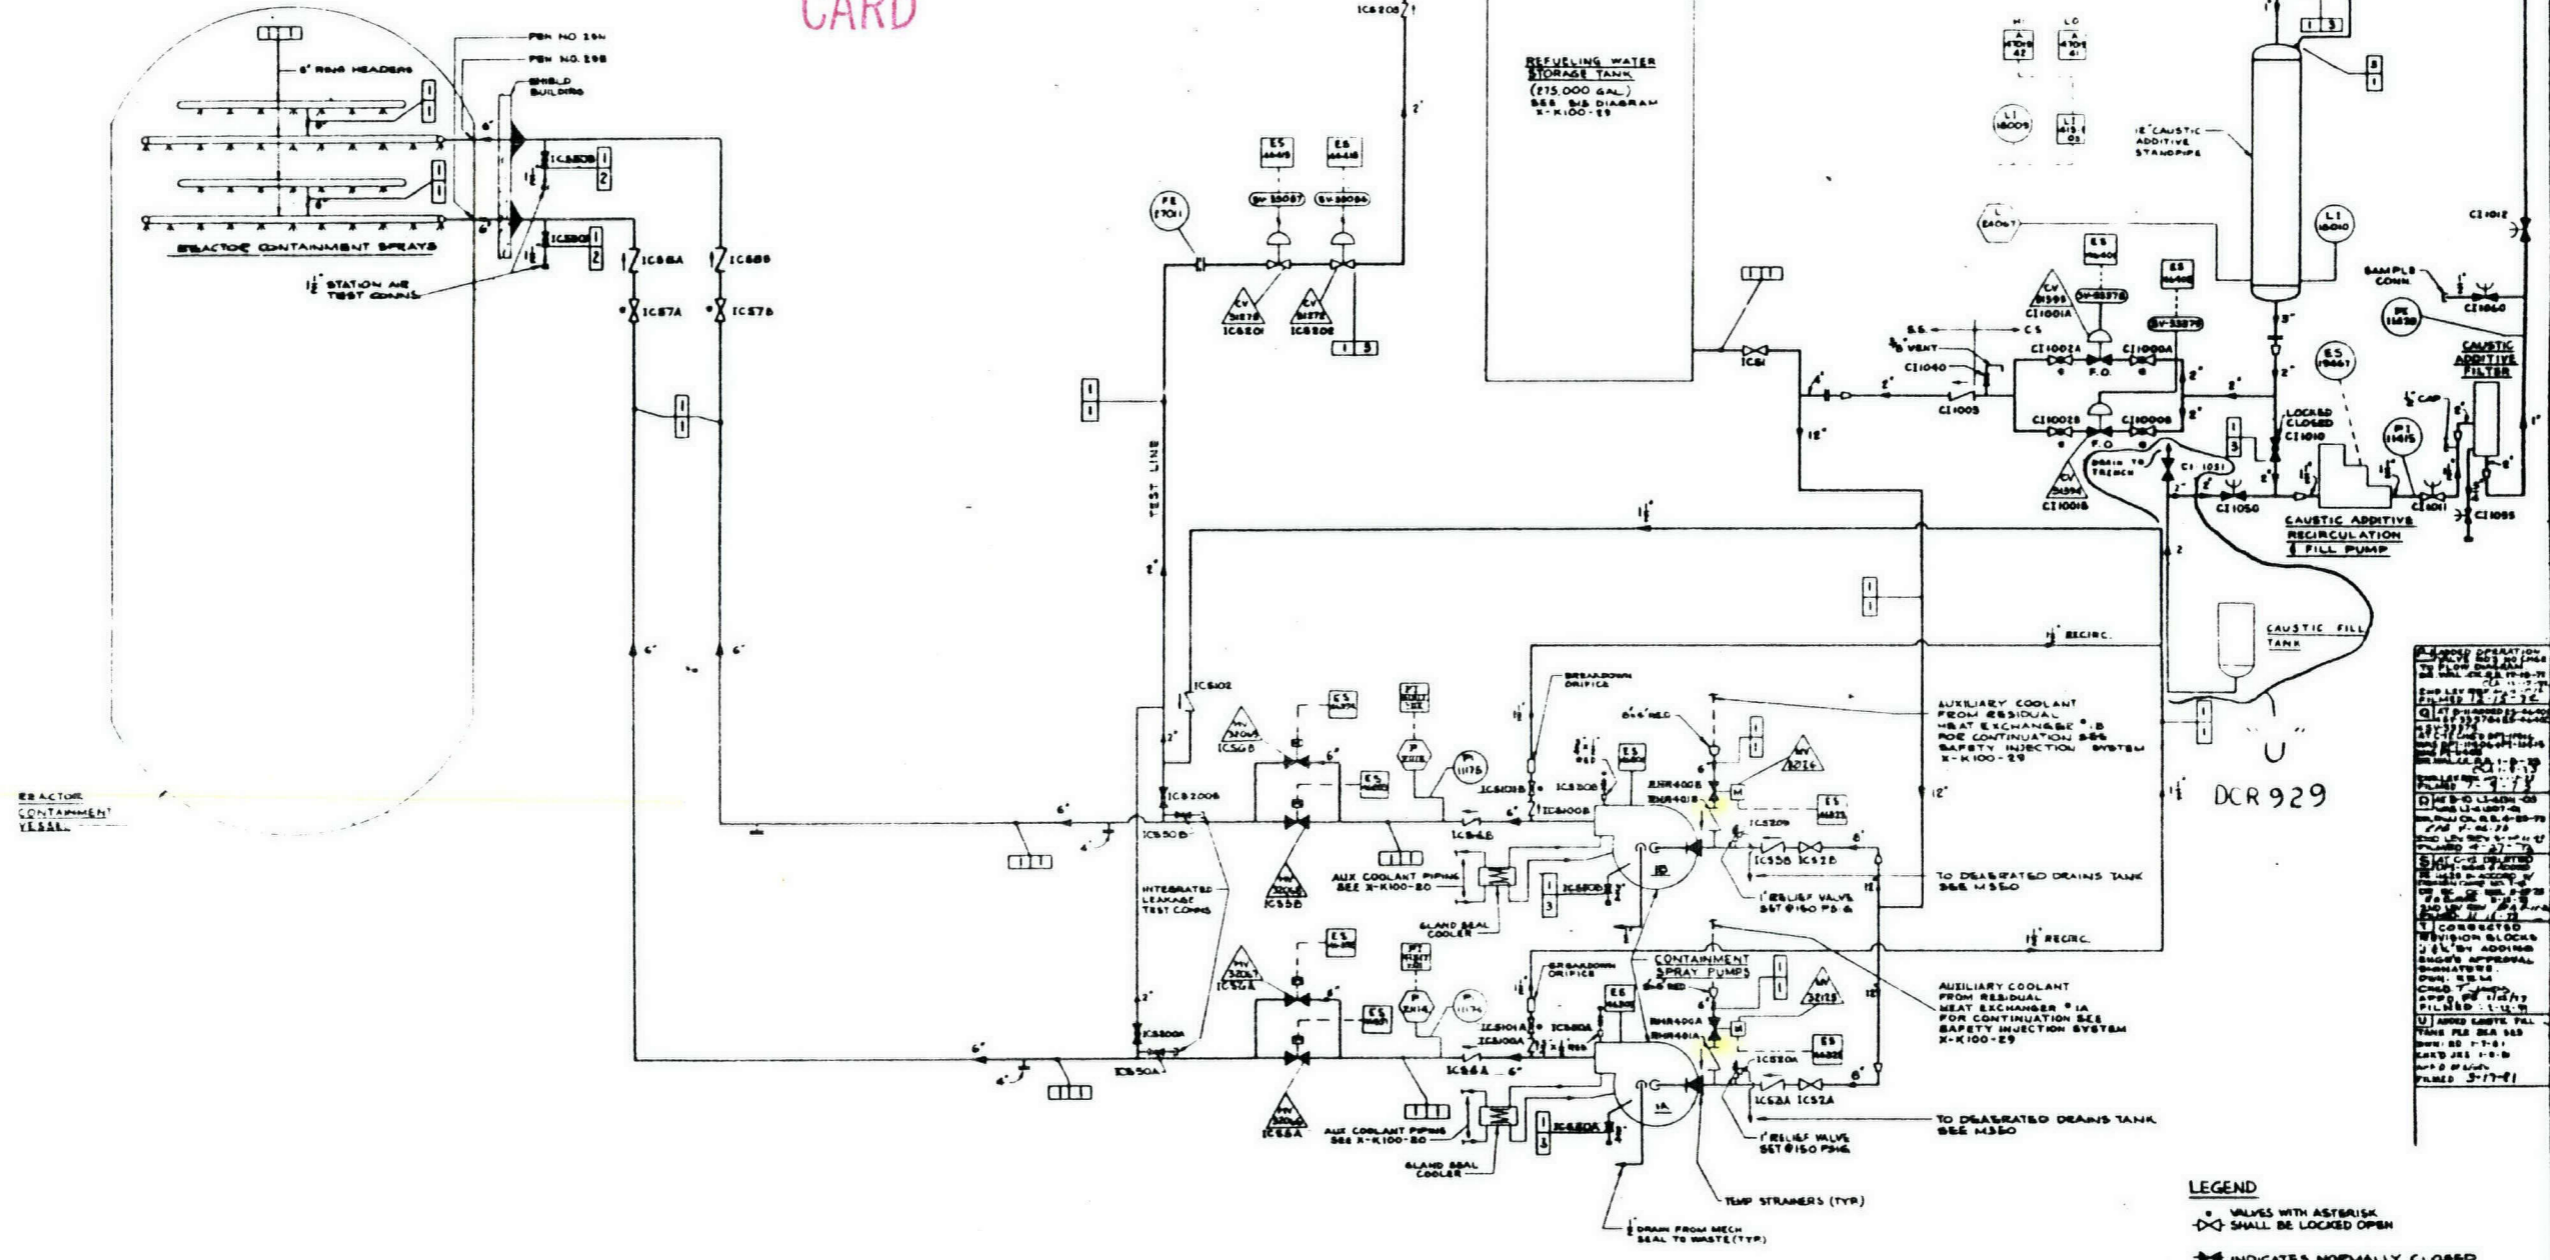

REACTOR CONTAINMENT VESSEL

REFUELING WATER STORAGE TANK (275,000 GAL.) SEE S/D DIAGRAM X-K100-19

DCR 929

LEGEND

- ⊕ VALVES WITH ASTERISK SHALL BE LOCKED OPEN
- ⊕ INDICATES NORMALLY CLOSED
- NON-SV ZONE | SV ZONE

Relief request #3

Also Available On Aperture Card

FUNCTIONAL DESCRIPTION DIAGRAM
237127A-M736

WISCONSIN PUBLIC SERVICE CORPORATION
KEWAUNEE NUCLEAR POWER PLANT UNIT NO. 1
CANTON, WISCONSIN COUNTY, WISCONSIN

FLOW DIAGRAM
INTERNAL CONTAINMENT SPRAY SYSTEM

Preiser Service & Engineering Co.

L.J.P.	R.J.E.	DATE	REV.
NONE	R.J.E.	1-2-61	1

OPERATION-M217-U

