

NRC CONTRIBUTION FOR PART 50 DOCKET MATERIAL
(TEMPORARY FORM)

CONTROL NO: 572

FILE: INCIDENT FILE

FROM: Wisconsin Public SVC. Corp. Green Bay, Wisconsin E.W. James		DATE OF DOC <u>1-16-76</u>	DATE REC'D <u>1-20-76</u>	LTR XXX	TWX	RPT	OTHER
TO: B. Rusche		ORIG <u>1 Signed</u>	CC <u>0</u>	OTHER	SENT NRC PDR <u>XX</u>		SENT LOCAL PDR <u>XX</u>
CLASS	UNCLASS XXX	PROP INFO	INPUT	NO CYS REC'D <u>1</u>	DOCKET NO: <u>50-305</u>		

DESCRIPTION:
Letter trans the following.....

PLANT NAME: Kewaunee

ENCLOSURES:
Abnormal Occurrence # 76-1, on 106076,
Concerning the Containment Pressure Transmitter
output was found to have shifted out of
limits.....

(1 Copy Received) **ACKNOWLEDGED**

DO NOT REMOVE

FOR ACTION/INFORMATION

SAB 1-23-76

BRANCH CHIEF Purple

LIC. ASST. Sheppard W/16 cys ACRS

INTERNAL DISTRIBUTION

REG FILE
NRC PDR
I&E (2)
MIPC (3)
SCHRODER/IPPOLITO
HOUSTON
NOVAK/CHECK
GRIMES/SCHWENCER
CASE
F. WILLIAMS
HANAUER
TEDESCO/MACCARY
EISENHUT
BAER
SHAO

VOLLMER/BUNCH
KREGER/J. COLLINS

NOTE: IF PERSONEL EXPOSURE IS INVOLVED
SEND DIRECTLY TO KREGER/J. COLLINS

EXTERNAL DISTRIBUTION

LOCAL PDR Kewaunee, Wis.
TIC
NSIC


DISTRIBUTION REVISED 1-19-76 by D. CRUTCHFIELD, TECH REVIEW COORDINATOR

2

WISCONSIN PUBLIC SERVICE CORPORATION




P.O. Box 1200, Green Bay, Wisconsin 54305

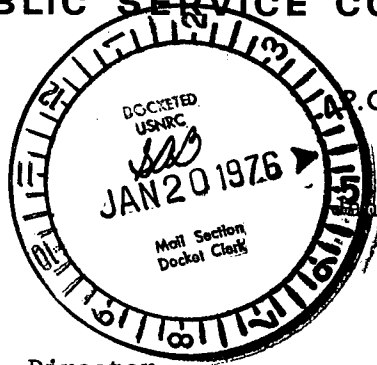

January 16, 1976

Regulatory

File Cy

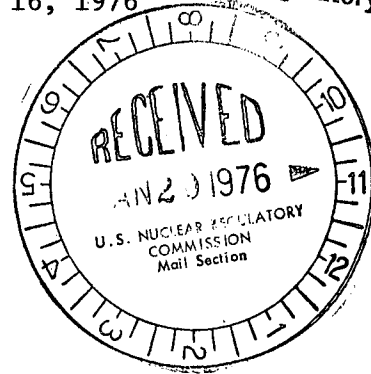

Mr. Benard Rusche, Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Rusche:

Subject: Docket 50-305
Operating License DPR-43
Abnormal Occurrence Report AO 76-1

In accordance with the requirements of Technical Specifications, paragraph 6.6.2, the attached Licensee Event Report Form for Abnormal Occurrence AO 76-1 is submitted.

As indicated in the attached report, the Containment Pressure Transmitter output was found to have shifted low by 6.25%. A maintenance work request was issued to recalibrate the transmitter.

Very truly yours,

E. W. James
Senior Vice President
Power Supply & Engineering

EWJ:sna
Attach.
cc - Mr. J. G. Keppler, US NRC
Mr. Dwane Boyd, US NRC

LICENSEE EVENT REPORT

CONTROL BLOCK:

[PLEASE PRINT ALL REQUIRED INFORMATION]

LICENSEE NAME: 01 | W | I | K | N | P | 1 | LICENSE NUMBER: 0 | 0 | - | 0 | 0 | 0 | 0 | 0 | 0 | - | 0 | 0 | LICENSE TYPE: 4 | 1 | 1 | 1 | 1 | EVENT TYPE: 0 | 1

CON'T: 01 | CATEGORY: P | 0 | REPORT TYPE: T | REPORT SOURCE: L | DOCKET NUMBER: 0 | 5 | 0 | - | 0 | 3 | 0 | 5 | EVENT DATE: 0 | 1 | 0 | 6 | 7 | 6 | REPORT DATE: 0 | 1 | 1 | 6 | 7 | 6

EVENT DESCRIPTION

02 | While performing SP-043, monthly safeguard surveillance, containment pressure
03 | instrument, channel 949, was indicating low. This event is being reported as
04 | AO 76-1. This situation reduced the redundancy of containment hi pressure safeguard
05 | actuation from 2/3 channels to 2/2 channels. Also it reduced the redundancy of
06 | containment hi-hi pressure spray actuation from 1/2 + 1/2 + 1/2 to 1/1 + 1/2 + 1/2.

SYSTEM CODE: I | B | CAUSE CODE: F | COMPONENT CODE: I | N | S | T | R | U | PRIME COMPONENT SUPPLIER: N | COMPONENT MANUFACTURER: F | 1 | 8 | 0 | VIOLATION: N

CAUSE DESCRIPTION

08 | The containment pressure transmitter supplying channel 949 was found to have a
09 | 6.25% zero shift, low. After recalibration the channel functioned properly.
10 |

FACILITY STATUS: E | % POWER: 0 | 9 | 9 | OTHER STATUS: NA | METHOD OF DISCOVERY: B | DISCOVERY DESCRIPTION: Routine surveillance
 FORM OF ACTIVITY RELEASED: Z | CONTENT OF RELEASE: Z | AMOUNT OF ACTIVITY: NA | LOCATION OF RELEASE: NA

PERSONNEL EXPOSURES

13 | NUMBER: 0 | 0 | 0 | TYPE: Z | DESCRIPTION: NA

PERSONNEL INJURIES

14 | NUMBER: 0 | 0 | 0 | DESCRIPTION: NA

OFFSITE CONSEQUENCES

15 | NA

LOSS OR DAMAGE TO FACILITY

16 | TYPE: Z | DESCRIPTION: NA

PUBLICITY

17 | NA

ADDITIONAL FACTORS

18 | NA

19 |

NAME: Mark L. Marchi PHONE: 414/432-3311