


32

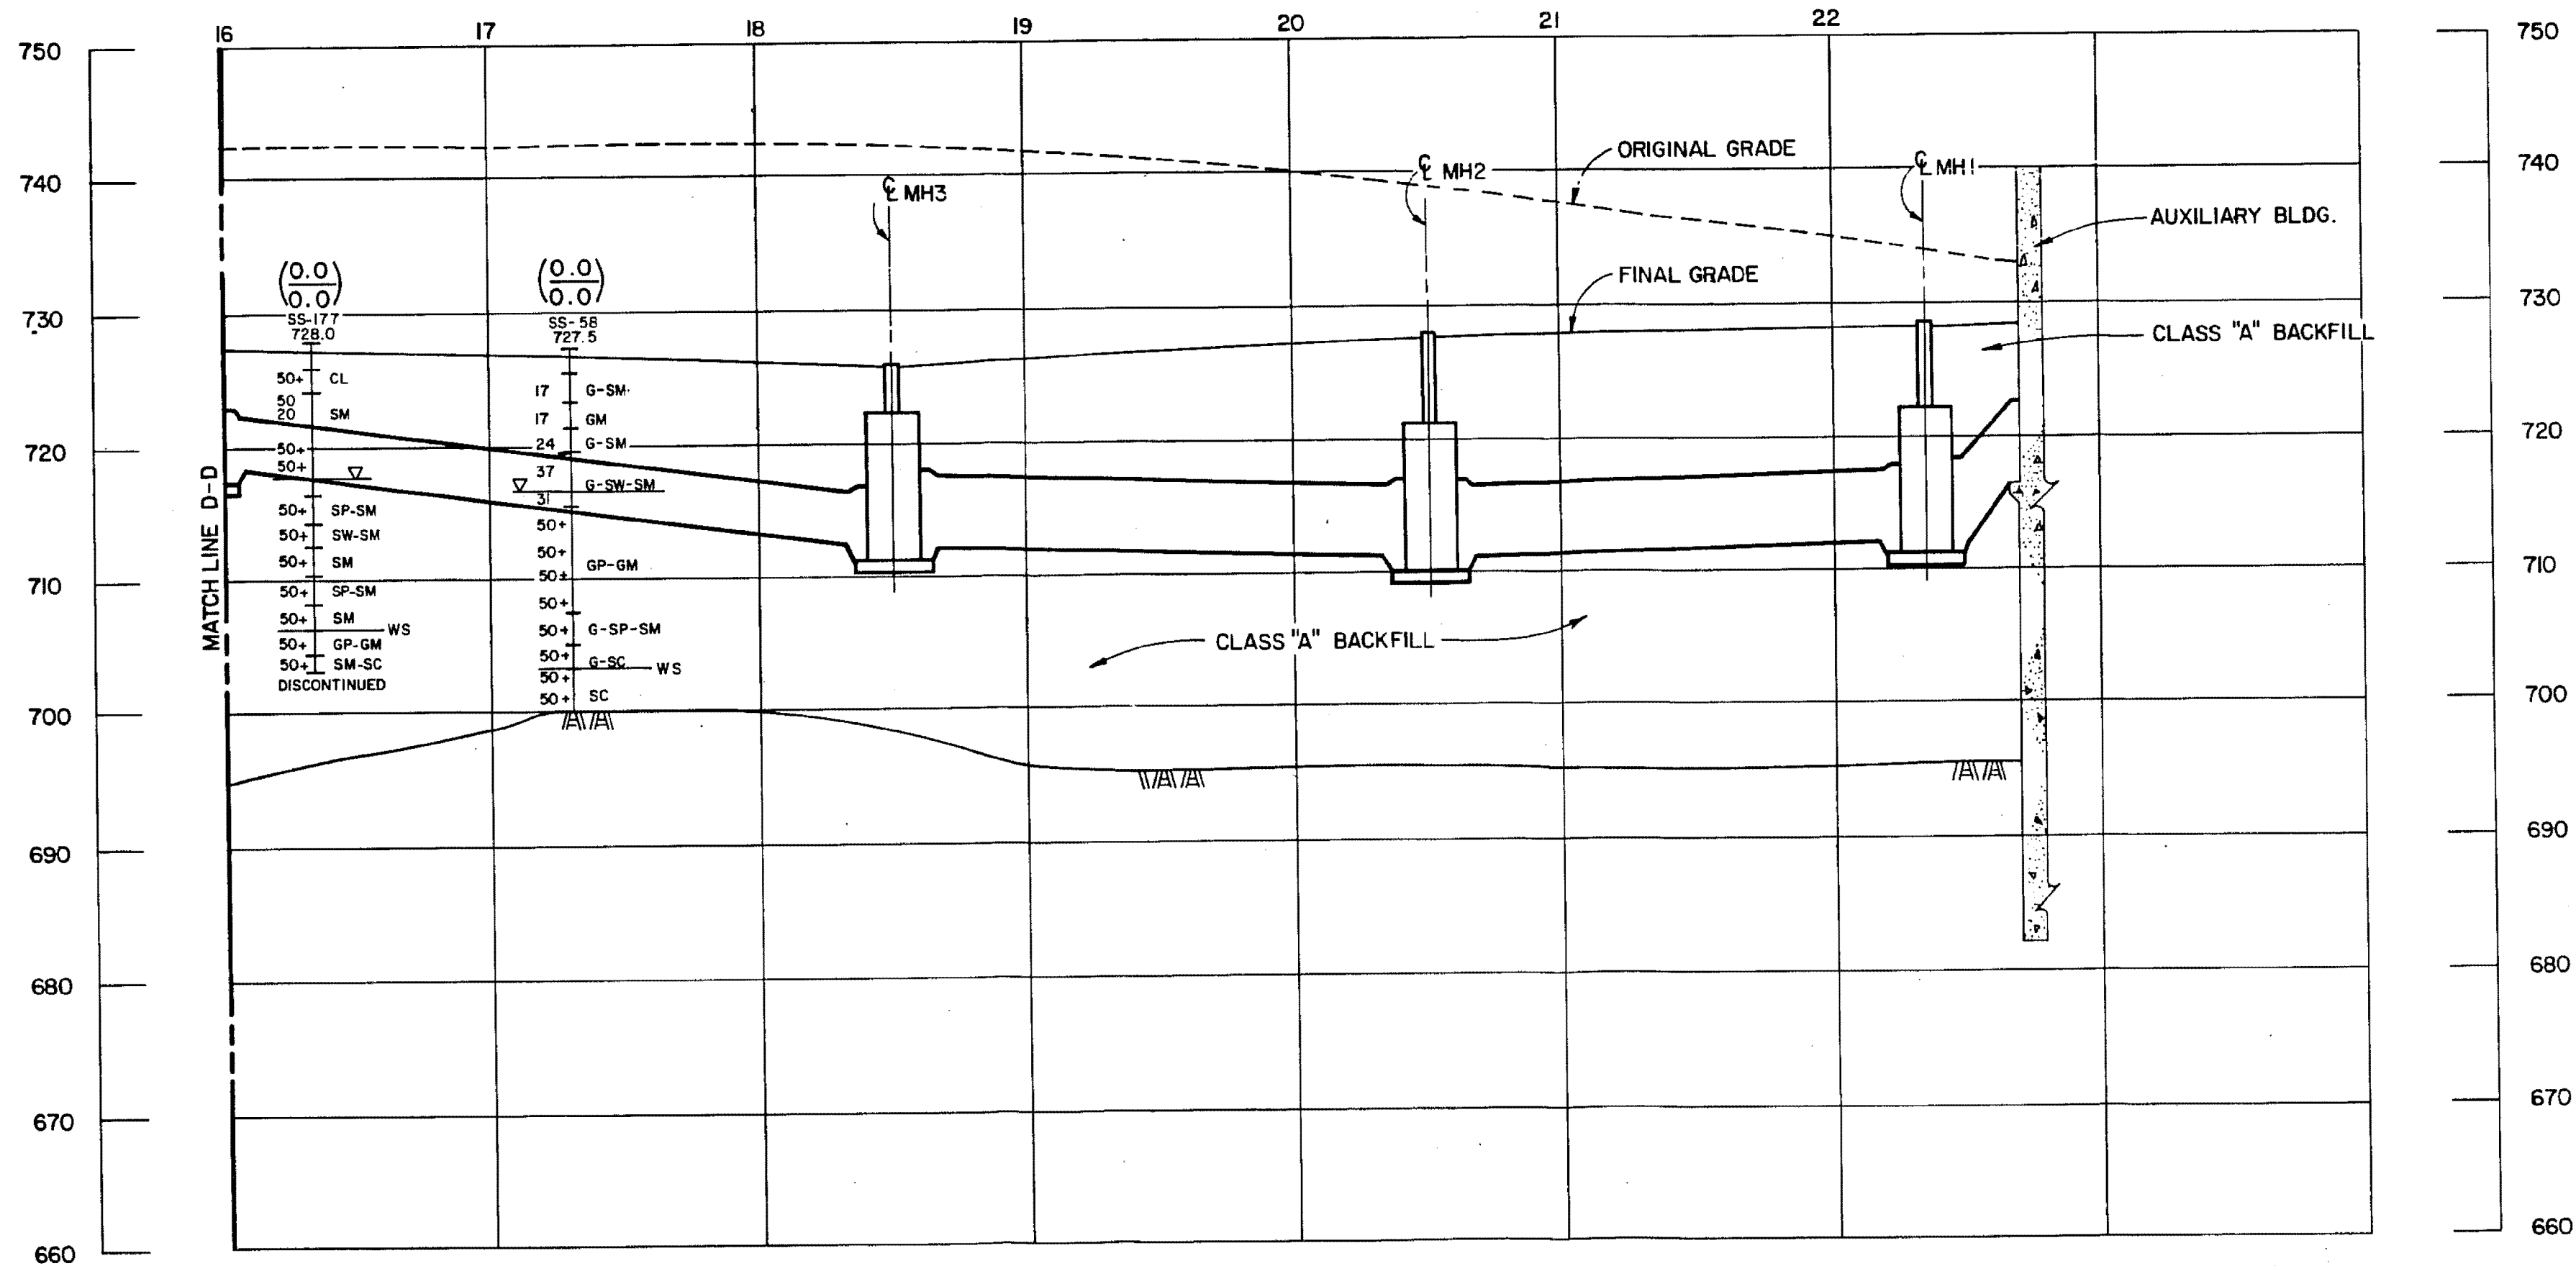

F-F

POTENTIAL SETTLEMENT BASED ON 1.5 %  $\epsilon$  CRITERIA (INCHES)  
(0.0)  
(0.0)  
POTENTIAL SETTLEMENT BASED ON 6 %  $\epsilon$  CRITERIA (INCHES)

- ▽ DESIGN WATER TABLE
- ▼ WATER TABLE (24 HR)
- MH SOIL CLASSIFICATION
- 13 BLOW COUNT
- ▨ POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)
- WS WEATHERED SHALE

NOTE:  
1. LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.4g AND SEED - IDRIS (1971) CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT  
FINAL SAFETY  
ANALYSIS REPORT

CATEGORY I ELECTRICAL CONDUITS  
SECTION F-F SHEET 2 OF 2  
FIGURE 2.5-576