


144

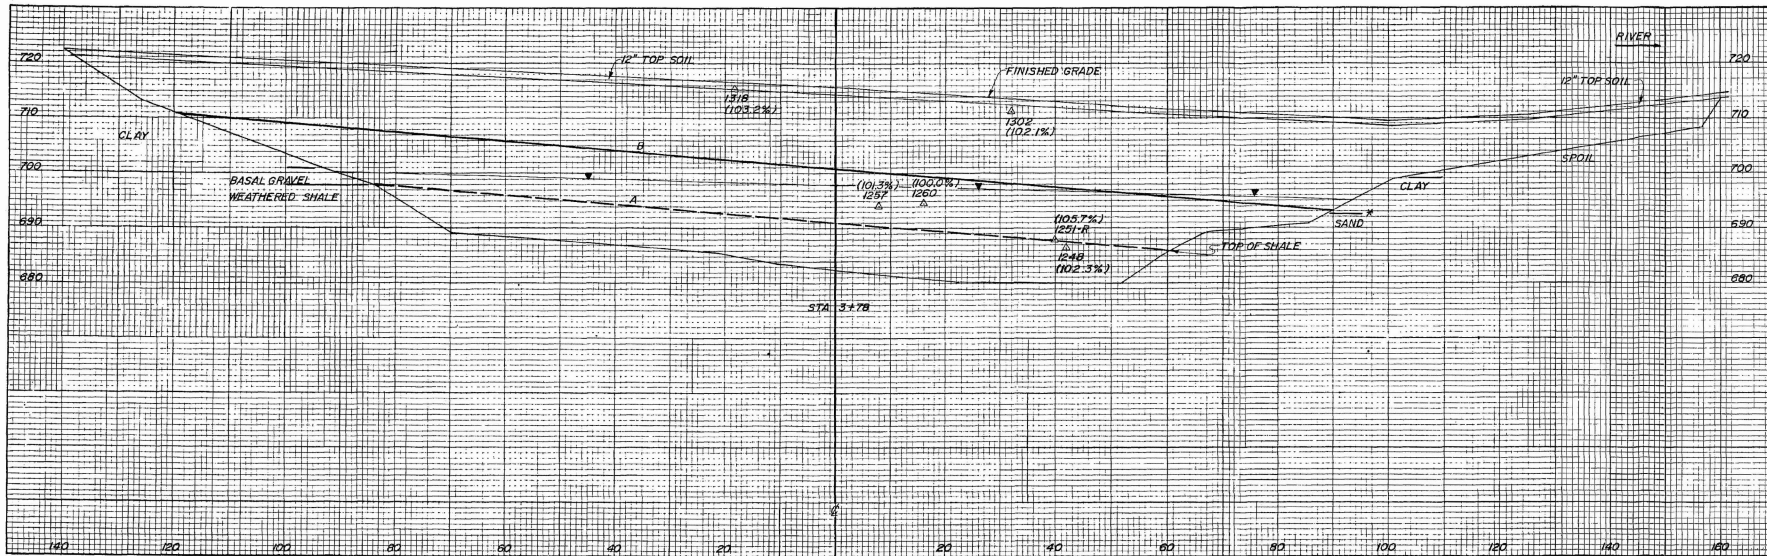

LEGEND:
 △ DENSITY TEST
 1251 TEST NUMBER
 (101.6%) % MAXIMUM DRY DENSITY ASTM D598.
 ▽ WATER TABLE
 B POSTULATED FAILURE PLANE AT INTERFACE BETWEEN TYPE A EARTHFILL (95% MAXIMUM DRY DENSITY) AND TYPE A1 EARTHFILL (100% MAXIMUM DRY DENSITY)
 A POSTULATED FAILURE PLANE
 —* ASSUMED INTERFACE

ADDED BY AMENDMENT 59

YARD	
UNDERGROUND BARRIER	
TRENCH A	
STA. 3+78	
WATTS BAR NUCLEAR PLANT	
DESIGNED BY: []	
CHECKED BY: []	
DATE: []	
PROJ. NO.:	1FSAR 2-5-595