

Comanche Peak Nuclear Power Plant, Units 3 & 4  
 COL Application  
 Part 2, FSAR

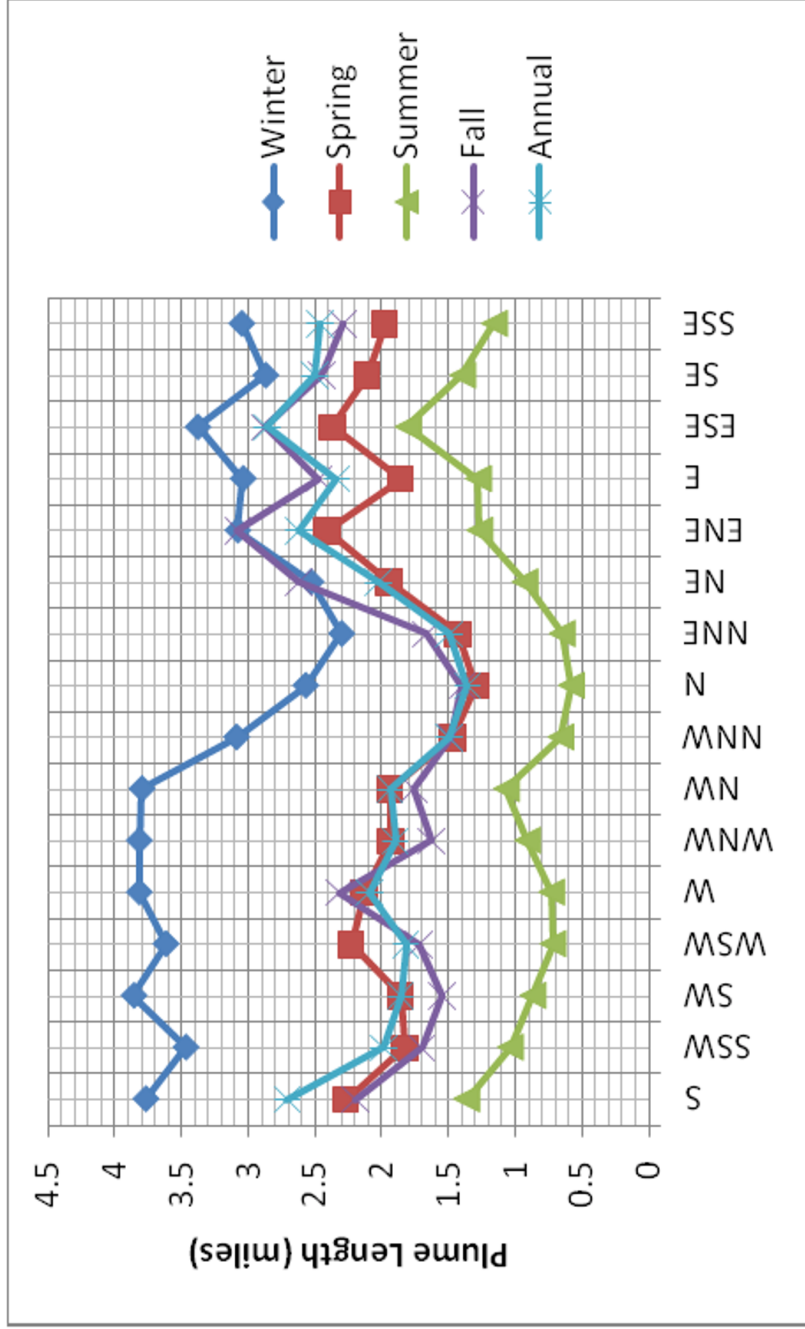


Figure 2.3-372 CPNPP Cooling Tower Seasonal Visible Plume Length