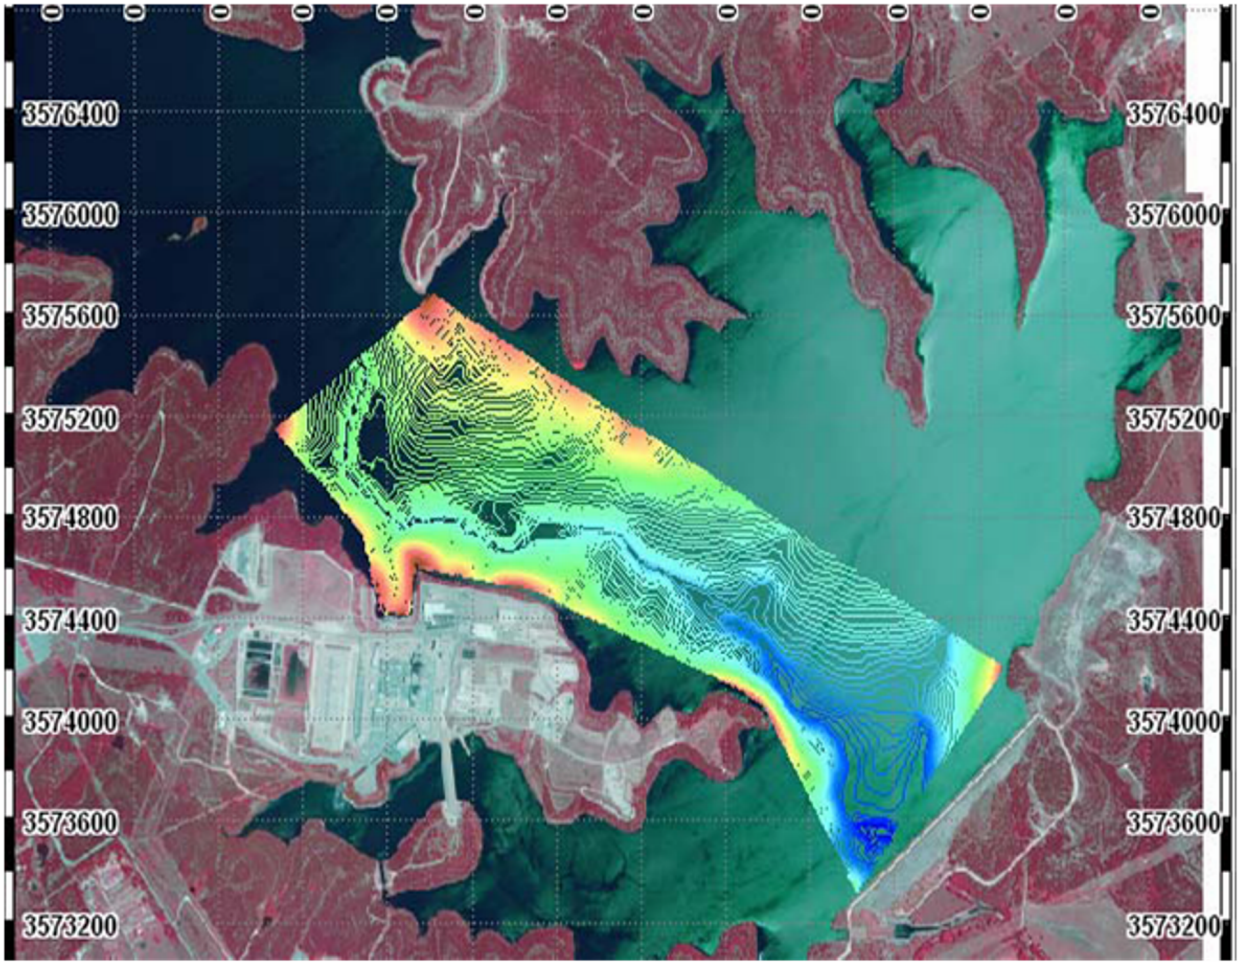

Figure 2.4.13-206 SCR Water Volume Credited for Dilution for No Flow Condition