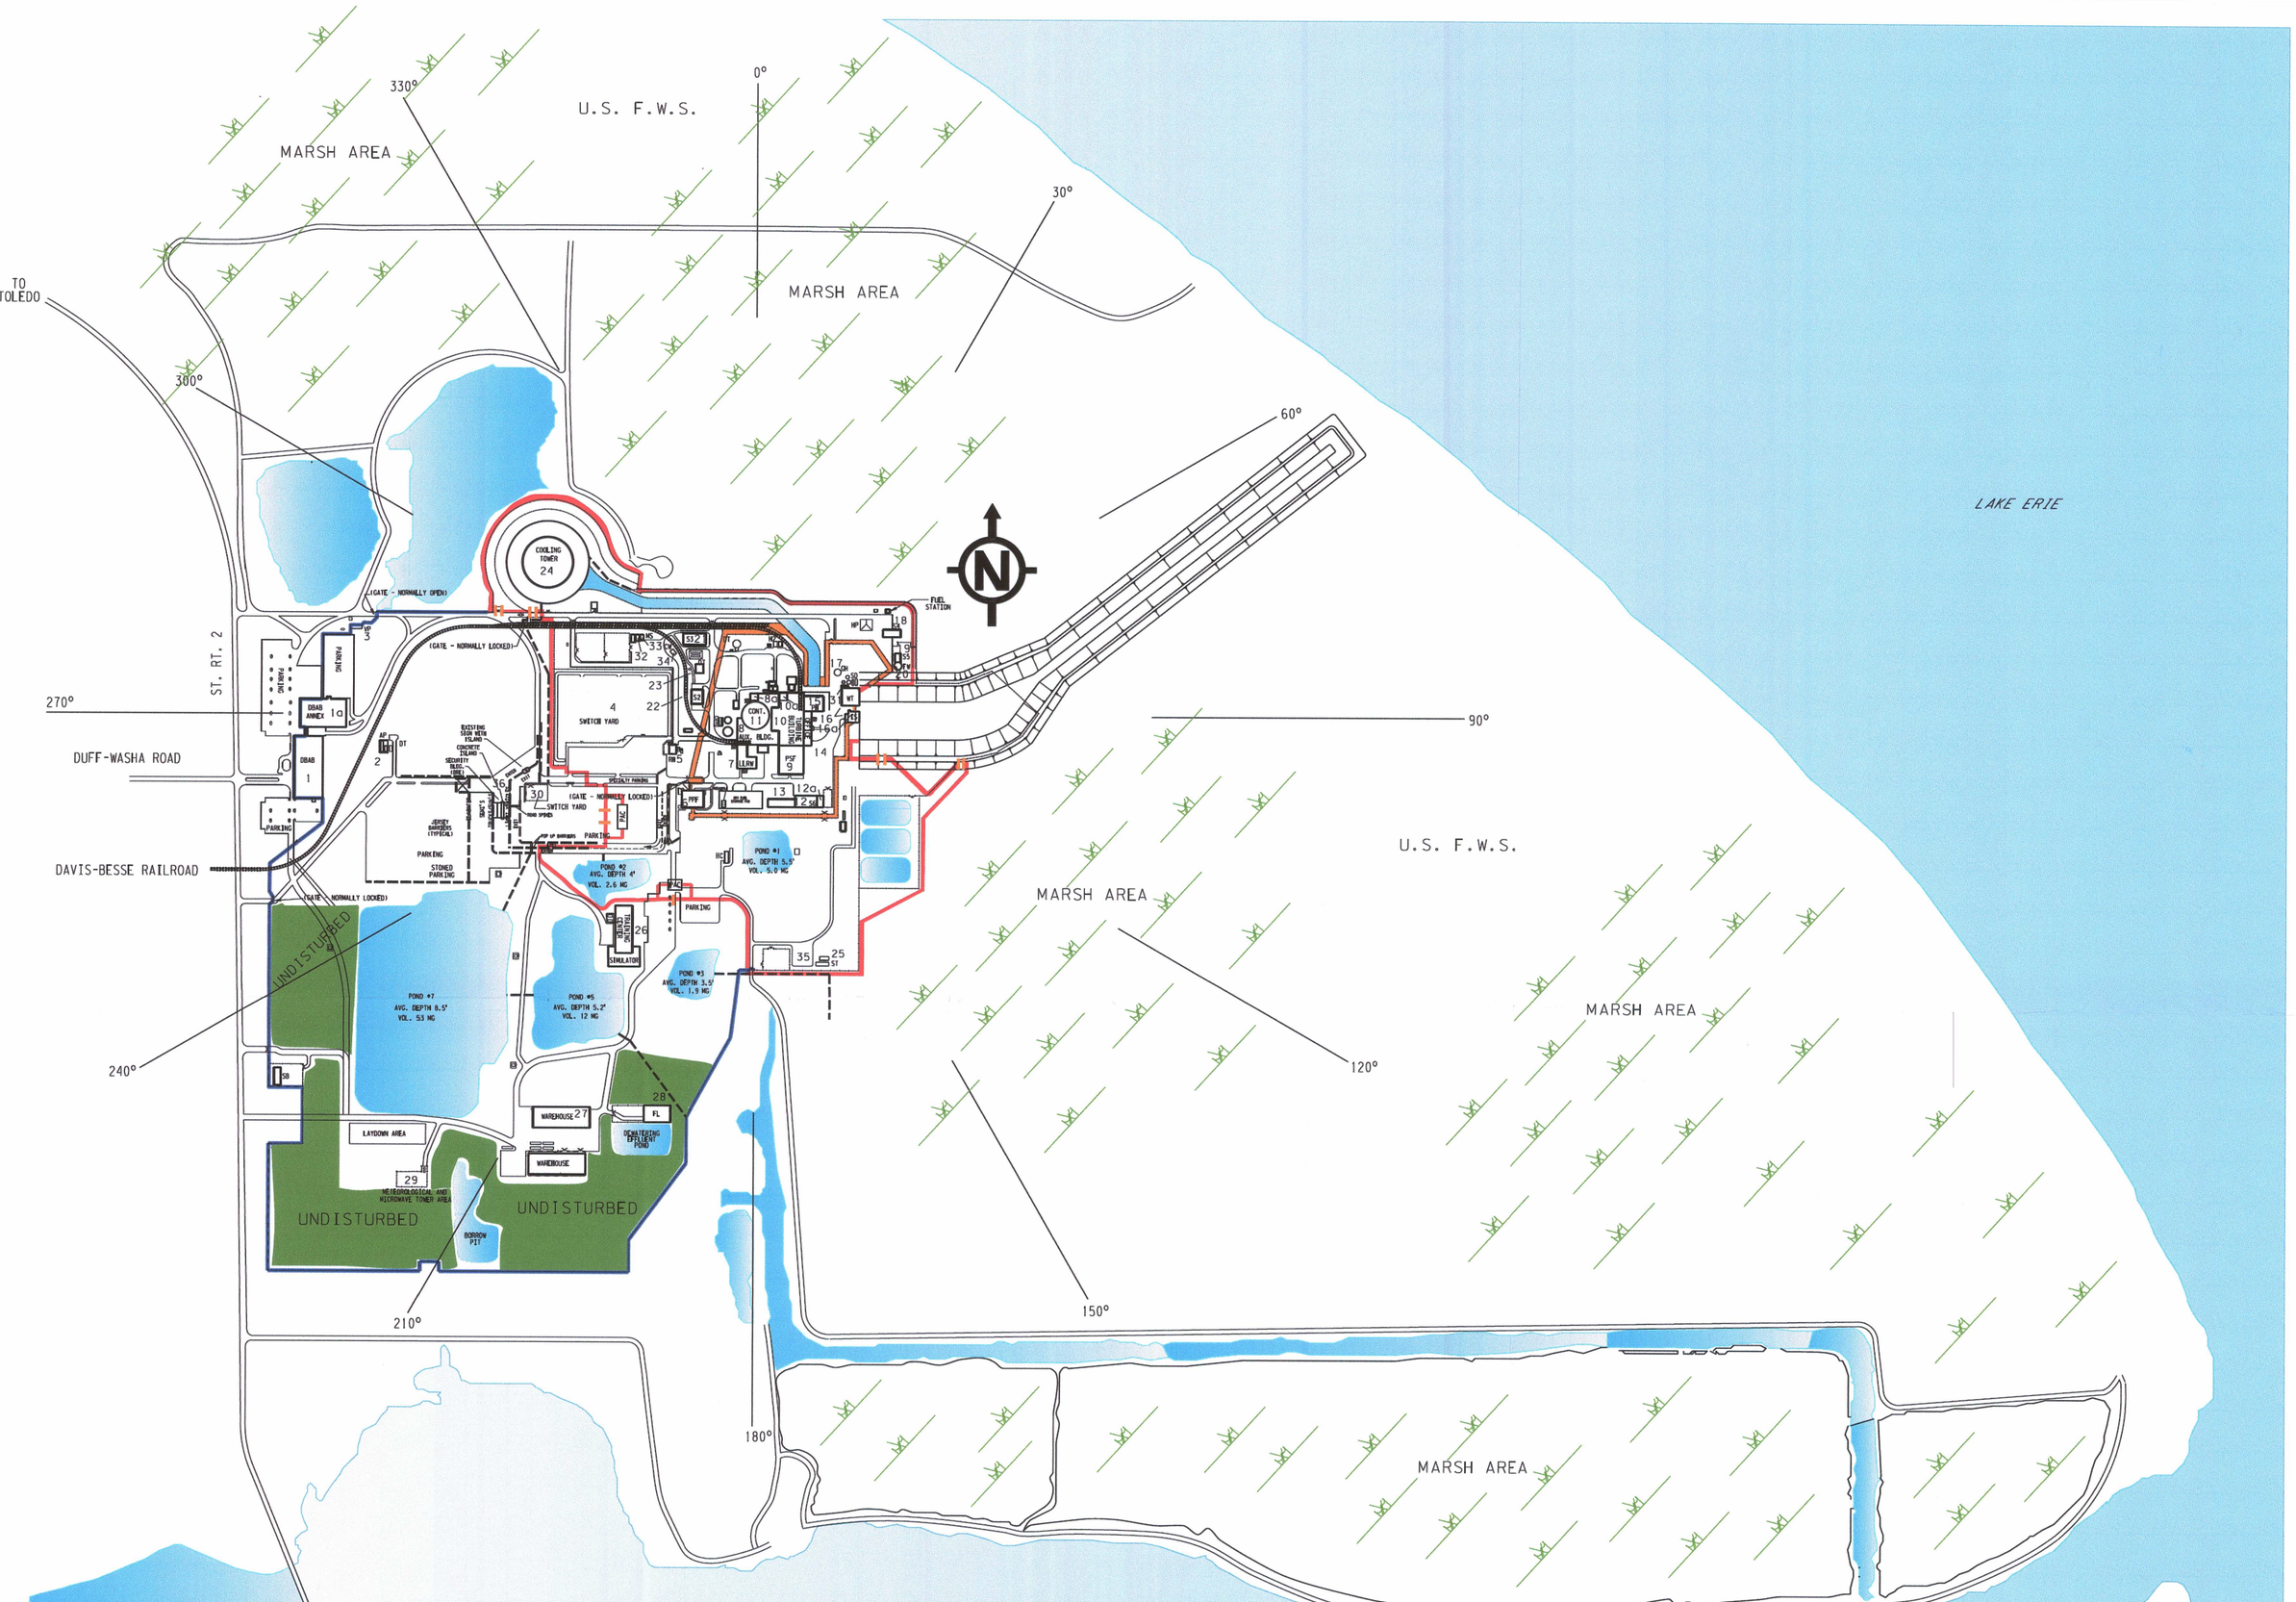

1. DBAB
   a. DBAB ANNEX
2. ERF DBAB DIESEL
3. ACCESS GATE HOUSE
4. SWITCHYARD
5. RELAY HOUSE
6. PERSONNEL PROCESSING FACILITY
7. LOW LEVEL RADWASTE STORAGE FACILITY
8. AUXILIARY BUILDING
   a. EMERGENCY DIESEL GENERATOR
9. PERSONNEL SHOP FACILITY
10. TURBINE BUILDING
    a. AUXILARY BOILER
11. CONTAINMENT
12. SERVICE BUILDING #6
    a. PAINT SHOP
13. STATION BLACKOUT DIESEL
14. PLANT OFFICE BUILDING
15. CIRC WATER PUMP HOUSE
16. WATER TREATMENT/INTAKE STRUCTURE
    a. FIRE PUMP DIESEL
17. OLD GATE HOUSE
18. SERVICE BUILDING #4 (MOBILE CENTER)
19. SERVICE BUILDING #5
20. FIRE WATER STORAGE TANK
21. SERVICE BUILDING #3 (HEALTH & FITNESS CENTER)
22. SERVICE BUILDING #2
23. DIESEL FUEL TANK
24. COOLING TOWER
25. SEWAGE TREATMENT PLANT
26. TRAINING CENTER
    a. ACCESS PROCESSING FACILITY
    b. SIMULATOR BUILDING
27. RECEIVING WAREHOUSE
28. FLAMMABLE LIQUIDS WAREHOUSE
29. METEOROLOGICAL TOWER
30. 69KV SUBSTATION
31. MISCELLANEOUS DIESEL GENERATOR
32. PAINT SHOP
33. SANDBLASTING SHOP
34. CHEMICAL WASTE STORAGE AREA
35. FIRE TRAINING AREA

OWNER CONTROLLED PERIMETER
ROCA BARRIER
PROTECTED AREA
UNDISTURBED

"INFORMATION ONLY"

THIS DRAWING IS UNCONTROLLED
HAS NO DRAWING NUMBER.
IT IS NOT CONTROLLED BY FILENET
OR ANY OTHER PROCEDURE OR PROCESS.

DB 05-24-11 | DFN: /ARCH/CITEMAP.DGN

D-01