

ArevaEPRDCPEm Resource

From: WILLIFORD Dennis (AREVA) [Dennis.Williford@areva.com]
Sent: Wednesday, July 20, 2011 10:33 AM
To: Tesfaye, Getachew
Cc: BENNETT Kathy (AREVA); DELANO Karen (AREVA); ROMINE Judy (AREVA); RYAN Tom (AREVA); Miernicki, Michael
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 25 (Part 2 of 2)
Attachments: RAI 376 Supplement 25 Response US EPR DC - PUBLIC - Part 2 of 2.pdf

Getachew,

Attached is part 2 of 2 of the response to RAI No. 376, Supplement 25 (Revised INTERIM Response to Question 03.08.05-31). Because the response contains security-related sensitive information that should be withheld from public disclosure in accordance with 10 CFR 2.390, a public version is provided with the security-related sensitive information redacted. This email and attached file do not contain any security-related information. An unredacted security-related version will be provided in a separate email.

Sincerely,

Dennis Williford, P.E.
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.

7207 IBM Drive, Mail Code CLT 2B
Charlotte, NC 28262
Phone: 704-805-2223
Email: Dennis.Williford@areva.com

From: WILLIFORD Dennis (RS/NB)
Sent: Wednesday, July 20, 2011 10:27 AM
To: 'Tesfaye, Getachew'
Cc: BENNETT Kathy (RS/NB); DELANO Karen (RS/NB); ROMINE Judy (RS/NB); RYAN Tom (RS/NB); 'Miernicki, Michael'
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 25 (Part 1 of 2)

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted

Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30. AREVA NP submitted Supplement 16 on February 8, 2011, to provide a revised schedule for Question 03.08.05-25 and FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29. On February 11, 2011, AREVA NP submitted Supplement 17, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplements 18 and 19 on March 18, 2011 and April 19, 2011, respectively. On May 2, 2011, AREVA NP submitted Supplement 20, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplement 21 on May 20, 2011. On June 9, 2011, AREVA NP submitted Supplement 22, to provide a final response to Question 03.08.05-25. On June 27, 2011, AREVA NP submitted Supplement 23 to provide a revised INTERIM response for Question 03.08.05-28. On July 7, 2011, AREVA NP submitted Supplement 24 to provide an INTERIM response for Question 03.08.05-31.

The attached file, "RAI 376 Supplement 25 Response US EPR DC – PUBLIC (Part 1 of 2).pdf" and the file "RAI 376 Supplement 25 Response US EPR DC - PUBLIC (Part 2 of 2).pdf" in a subsequent email provide a technically correct revised INTERIM response to Question 03.08.05-31. Appended to these files are the affected pages of the U.S. EPR Final Safety Analysis Report in redline-strikeout format which support the response to RAI 376 Question 03.08.05-31. Because the response contains security-related sensitive information that should be withheld from public disclosure in accordance with 10 CFR 2.390, a public version is provided with the security-related sensitive information redacted. This email and attached file do not contain any security-related information. An unredacted security-related version will be provided in a separate email.

The following table indicates the pages in the response document, "RAI 376 Supplement 25 Response US EPR DC - PUBLIC (Part 1 of 2).pdf" and the file "RAI 376 Supplement 25 Response US EPR DC - PUBLIC (Part 2 of 2).pdf" that contain AREVA NP's response to the subject question.

Question #	Start Page	End Page
RAI 376 — 03.08.05-31	2	4

The schedule for the final responses to the remaining questions is unchanged as provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-28	October 25, 2010 (Actual) June 27, 2011 (Actual)	October 10, 2011
RAI 376-03.08.05-31	October 25, 2010 (Actual) July 20, 2011 (Actual)	November 30, 2011

Sincerely,

Dennis Williford, P.E.
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
 7207 IBM Drive, Mail Code CLT 2B
 Charlotte, NC 28262
 Phone: 704-805-2223
 Email: Dennis.Williford@areva.com

From: WILLIFORD Dennis (RS/NB)
Sent: Thursday, July 07, 2011 1:49 PM
To: Tesfaye, Getachew
Cc: BENNETT Kathy (RS/NB); DELANO Karen (RS/NB); ROMINE Judy (RS/NB); RYAN Tom (RS/NB); Miernicki, Michael
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 24

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30. AREVA NP submitted Supplement 16 on February 8, 2011, to provide a revised schedule for Question 03.08.05-25 and FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29. On February 11, 2011, AREVA NP submitted Supplement 17, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplements 18 and 19 on March 18, 2011 and April 19, 2011, respectively. On May 2, 2011, AREVA NP submitted Supplement 20, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplement 21 on May 20, 2011. On June 9, 2011, AREVA NP submitted Supplement 22, to provide a final response to Question 03.08.05-25. On June 27, 2011, AREVA NP submitted Supplement 23 to provide a revised INTERIM response for Question 03.08.05-28.

The attached file, "RAI 376 Supplement 24 Response US EPR DC - PUBLIC (Part 1 of 2).pdf" and the file "RAI 376 Supplement 24 Response US EPR DC - PUBLIC (Part 2 of 2).pdf" in a subsequent email provides a technically correct INTERIM response to Question 03.08.05-31. Appended to these files are the affected pages of the U.S. EPR Final Safety Analysis Report in redline-strikeout format which support the response to RAI 376 Question 03.08.05-31. Because the response contains security-related sensitive information that should be withheld from public disclosure in accordance with 10 CFR 2.390, a public version is provided with the security-related sensitive information redacted. This email and attached file do not contain any security-related information. An unredacted security-related version will be provided in a separate email.

The following table indicates the page in the response document, "RAI 376 Supplement 24 Response US EPR DC - PUBLIC (Part 1 of 2).pdf" and the file "RAI 376 Supplement 24 Response US EPR DC - PUBLIC (Part 2 of 2).pdf" that contains AREVA NP's response to the subject question.

Question #	Start Page	End Page
RAI 376 — 03.08.05-31	2	4

The schedule for the final responses to the remaining questions is unchanged. The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-28	October 25, 2010 (Actual) June 27, 2011 (Actual)	October 10, 2011
RAI 376-03.08.05-31	October 25, 2010 July 7, 2011 (Actual)	November 30, 2011

Sincerely,

Dennis Williford, P.E.
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
7207 IBM Drive, Mail Code CLT 2B
Charlotte, NC 28262
Phone: 704-805-2223
Email: Dennis.Williford@areva.com

From: WILLIFORD Dennis (RS/NB)
Sent: Monday, June 27, 2011 4:47 PM
To: Tesfaye, Getachew
Cc: BENNETT Kathy (RS/NB); DELANO Karen (RS/NB); ROMINE Judy (RS/NB); RYAN Tom (RS/NB); CORNELL Veronica (External RS/NB)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 23

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30. AREVA NP submitted Supplement 16 on February 8, 2011, to provide a revised schedule for Question 03.08.05-25 and FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29. On February 11, 2011, AREVA NP submitted Supplement 17, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplements 18 and 19 on March 18, 2011 and April 19, 2011, respectively. On May 2, 2011, AREVA NP submitted Supplement 20, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplement 21 on May 20, 2011. On June 9, 2011, AREVA NP submitted Supplement 22 to provide a final response to Question 03.08.05-25.

The attached file, "RAI 376 Supplement 23 Response US EPR DC - INTERIM.pdf (Part 1 of 2).pdf" and the file "RAI 376 Supplement 23 Response US EPR DC - INTERIM.pdf (Part 2 of 2).pdf" in a subsequent email, provide a technically correct INTERIM response to Question 03.08.05-28, as committed. Appended to the file "RAI 376 Supplement 23 Response US EPR DC - INTERIM.pdf (Part 2 of 2).pdf" are the affected pages of the U.S. EPR Final Safety Analysis Report in redline-strikeout format which support the response to RAI 376 Question 03.08.05-28.

The following table indicates the respective pages in the response document, "RAI 376 Supplement 23 Response US EPR DC - INTERIM.pdf (Part 1 of 2).pdf" and "RAI 376 Supplement 23 Response US EPR DC - INTERIM.pdf (Part 2 of 2).pdf" that contain AREVA NP's INTERIM response to Question 03.08.05-28.

Question #	Start Page	End Page
RAI 376 — 03.08.05-28	2	50

The schedule for the final response to Question 03.08.05-28 and Question 03.08.05-31 is being revised. The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-28	October 25, 2010 (Actual) June 27, 2011 (Actual)	October 10, 2011
RAI 376-03.08.05-31	October 25, 2010	November 30, 2011

Sincerely,

Dennis Williford, P.E.
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.

7207 IBM Drive, Mail Code CLT 2B
Charlotte, NC 28262
Phone: 704-805-2223
Email: Dennis.Williford@areva.com

From: WILLIFORD Dennis (RS/NB)
Sent: Thursday, June 09, 2011 12:46 PM
To: 'Tesfaye, Getachew'
Cc: BENNETT Kathy (RS/NB); DELANO Karen (RS/NB); ROMINE Judy (RS/NB); RYAN Tom (RS/NB); CORNELL Veronica (External RS/NB)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 22

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30. AREVA NP submitted Supplement 16 on February 8, 2011, to provide a revised schedule for Question 03.08.05-25 and FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29. On February 11, 2011, AREVA NP submitted Supplement 17, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplements 18 and 19 on March 18,

2011 and April 19, 2011, respectively. On May 2, 2011, AREVA NP submitted Supplement 20, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplement 21 on May 20, 2011.

The attached file, "RAI 376 Supplement 22 Response US EPR DC.pdf" provides a technically correct and complete FINAL response to Question 03.08.05-25. Appended to this file are the affected pages of the U.S. EPR Final Safety Analysis Report in redline-strikeout format which support the response to RAI 376 Question 03.08.05-25.

The following table indicates the pages in the response document, "RAI 376 Supplement 22 Response US EPR DC.pdf" that contain AREVA NP's response to the subject question.

Question #	Start Page	End Page
RAI 376 — 03.08.05-25	2	5

The schedule for the remaining questions is unchanged. The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376—03.08.05-28	October 25, 2010 (Actual)	July 8, 2011
RAI 376—03.08.05-31	October 25, 2010 (Actual)	July 8, 2011

Sincerely,

Dennis Williford, P.E.
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.

7207 IBM Drive, Mail Code CLT 2B
Charlotte, NC 28262
Phone: 704-805-2223
Email: Dennis.Williford@areva.com

From: WILLIFORD Dennis (RS/NB)
Sent: Friday, May 20, 2011 5:19 PM
To: 'Tefaye, Getachew'
Cc: BENNETT Kathy (RS/NB); DELANO Karen (RS/NB); ROMINE Judy (RS/NB); RYAN Tom (RS/NB); CORNELL Veronica (External RS/NB)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 21

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final

response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30. AREVA NP submitted Supplement 16 on February 8, 2011, to provide a revised schedule for Question 03.08.05-25 and FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29. On February 11, 2011, AREVA NP submitted Supplement 17, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplements 18 and 19 on March 18, 2011 and April 19, 2011, respectively. On May 2, 2011, AREVA NP submitted Supplement 20 to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31.

The schedule for Question 03.08.05-25 is being revised. The schedule for the remaining questions is unchanged.

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-25	August 27, 2010 (Actual)	July 8, 2011
RAI 376-03.08.05-28	October 25, 2010 (Actual)	July 8, 2011
RAI 376-03.08.05-31	October 25, 2010 (Actual)	July 8, 2011

Sincerely,

Dennis Williford, P.E.
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.

7207 IBM Drive, Mail Code CLT 2B
Charlotte, NC 28262
Phone: 704-805-2223
Email: Dennis.Williford@areva.com

From: WELLS Russell (RS/NB)
Sent: Monday, May 02, 2011 10:30 AM
To: Tesfaye, Getachew
Cc: CORNELL Veronica (External RS/NB); BENNETT Kathy (RS/NB); DELANO Karen (RS/NB); ROMINE Judy (RS/NB); RYAN Tom (RS/NB)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 20

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to

question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30. AREVA NP submitted Supplement 16 on February 8, 2011, to provide a revised schedule for Question 03.08.05-25 and FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29. On February 11, 2011, AREVA NP submitted Supplement 17, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted a revised schedule for Question 03.08.05-25 in Supplements 18 and 19 on March 18, 2011 and April 19, 2011, respectively.

Due to changes in the schedule for FSAR Sections 3.7 and 3.8 as discussed with NRC, the schedule for Questions 03.08.05-28 and 03.08.05-31 is being revised. The schedule for the remaining question is unchanged.

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-25	August 27, 2010 (Actual)	May 26, 2011
RAI 376-03.08.05-28	October 25, 2010 (Actual)	July 8, 2011
RAI 376-03.08.05-31	October 25, 2010 (Actual)	July 8, 2011

Sincerely,

Russ Wells

U.S. EPR Design Certification Licensing Manager

AREVA NP, Inc.

3315 Old Forest Road, P.O. Box 10935

Mail Stop OF-57

Lynchburg, VA 24506-0935

Phone: 434-832-3884 (work)

434-942-6375 (cell)

Fax: 434-382-3884

Russell.Wells@Areva.com

From: WELLS Russell (RS/NB)

Sent: Tuesday, April 19, 2011 7:39 AM

To: 'Tesfaye, Getachew'

Cc: CORNELL Veronica (External RS/NB); BENNETT Kathy (RS/NB); DELANO Karen (RS/NB); ROMINE Judy (RS/NB); RYAN Tom (RS/NB)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 19

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to

provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30. AREVA NP submitted Supplement 16 on February 8, 2011, to provide a revised schedule for Question 03.08.05-25 and FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29. On February 11, 2011, AREVA NP submitted Supplement 17, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31. AREVA NP submitted Supplement 18 on March 18, 2011, to provide a revised schedule for Question 03.08.05-25.

The schedule for Question 03.08.05-25 is being revised to allow AREVA NP additional time to address NRC comments. The schedule for the remaining questions is unchanged.

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-25	August 27, 2010 (Actual)	May 26, 2011
RAI 376-03.08.05-28	October 25, 2010 (Actual)	May 4, 2011
RAI 376-03.08.05-31	October 25, 2010 (Actual)	May 26, 2011

Sincerely,

Russ Wells

*U.S. EPR Design Certification Licensing Manager
AREVA NP, Inc.*

3315 Old Forest Road, P.O. Box 10935

Mail Stop OF-57

Lynchburg, VA 24506-0935

Phone: 434-832-3884 (work)

434-942-6375 (cell)

Fax: 434-382-3884

Russell.Wells@Areva.com

From: WELLS Russell (RS/NB)

Sent: Friday, March 18, 2011 4:43 PM

To: 'Tefaye, Getachew'

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 18

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14

questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30. AREVA NP submitted Supplement 16 on February 8, 2011, to provide a revised schedule for Question 03.08.05-25 and FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29. On February 11, 2011, AREVA NP submitted Supplement 17, to provide a revised schedule for Question 03.08.05-28 and Question 03.08.05-31.

The schedule for Question 03.08.05-25 is being revised to allow AREVA NP additional time to interact with the NRC. The schedule for the remaining questions is unchanged.

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-25	August 27, 2010 (Actual)	April 21, 2011
RAI 376-03.08.05-28	October 25, 2010 (Actual)	May 4, 2011
RAI 376-03.08.05-31	October 25, 2010 (Actual)	May 26, 2011

Sincerely,

Russ Wells

U.S. EPR Design Certification Licensing Manager

AREVA NP, Inc.

3315 Old Forest Road, P.O. Box 10935

Mail Stop OF-57

Lynchburg, VA 24506-0935

Phone: 434-832-3884 (work)

434-942-6375 (cell)

Fax: 434-382-3884

Russell.Wells@Areva.com

From: BRYAN Martin (External RS/NB)

Sent: Friday, February 11, 2011 2:51 PM

To: 'Tesfaye, Getachew'

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 17

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30. AREVA NP submitted Supplement 16 on February 8, 2011, to provide a revised schedule for Question 03.08.05-25 and FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29.

The schedule for Question 03.08.05-28 and Question 03.08.05-31 has changed. The schedule for the remaining question is unchanged.

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-25	August 27, 2010 (Actual)	March 30, 2011
RAI 376-03.08.05-28	October 25, 2010 (Actual)	May 4, 2011
RAI 376-03.08.05-31	October 25, 2010 (Actual)	May 26, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (External RS/NB)

Sent: Tuesday, February 08, 2011 5:23 PM

To: Tesfaye, Getachew

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 16

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to

provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 25, 2010, to provide a revised schedule for Question 03.08.05-29. On November 22, 2011, AREVA NP submitted Supplement 15 to provide FINAL responses to Questions 03.08.05-27 and 03.08.05-30.

The attached file, "RAI 376 Supplement 16 Response US EPR DC.pdf" provides technically correct and complete FINAL responses to Questions 03.08.05-24, 03.08.05-26 and 03.08.05-29, as committed.

The following table indicates the respective pages in the response document, RAI 376 Supplement 16 Response US EPR DC.pdf," that contains AREVA NP's response to the subject questions.

Question #	Start Page	End Page
RAI 376 – 03.08.05-24	2	5
RAI 376 – 03.08.05-26	6	6
RAI 376 – 03.08.05-29	7	7

The schedule for Question 03.08.05-25 is being revised to allow additional time for AREVA NP to address NRC comments. The schedule for the remaining questions is unchanged.

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-25	August 27, 2010 (Actual)	March 30, 2011
RAI 376-03.08.05-28	October 25, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-31	October 25, 2010 (Actual)	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (External RS/NB)
Sent: Monday, November 22, 2010 7:33 PM
To: 'Tsfaye, Getachew'
Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 15

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31. AREVA NP submitted Supplement 14 on October 27, 2010, to provide a revised schedule for Question 03.08.05-29.

The attached file, "RAI 376 Supplement 15 Response US EPR DC.pdf" provides technically correct and complete FINAL responses to Questions 03.08.05-27 and 03.08.05-30, as committed.

Appended to this file are affected pages of the U.S. EPR Final Safety Analysis Report in redline-strikeout format which support the response to RAI 376 Question 03.08.05-27.

The following table indicates the respective pages in the response document, RAI 376 Supplement 15 Response US EPR DC.pdf," that contains AREVA NP's response to the subject questions. Please note that the similar table for RAI 376 Supplement 13 listed the RAI question as 354 when it should have been 376. The schedule for the remaining questions is unchanged.

Question #	Start Page	End Page
RAI 376 - 03.08.05-27	2	4
RAI 376 - 03.08.05-30	5	5

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	August 27, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-29	August 27, 2010 (Actual)	February 28, 2011
RAI 376-03.08.05-31	October 25, 2010 (Actual)	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (External RS/NB)

Sent: Wednesday, October 27, 2010 1:24 PM

To: 'Tesfaye, Getachew'

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 14

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively. On October 25, 2010, AREVA NP submitted Supplement 13 to provide INTERIM responses for Questions 03.08.05-28 and 03.08.05-31.

The schedule for Question 03.08.05-29 is being revised to allow additional time for AREVA NP to address NRC comments. The schedule for the remaining questions is unchanged.

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	August 27, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-29	August 27, 2010 (Actual)	February 28, 2011
RAI 376-03.08.05-30	N/A	November 22, 2010
RAI 376-03.08.05-31	October 25, 2010 (Actual)	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (External RS/NB)

Sent: Monday, October 25, 2010 4:37 PM

To: Tesfaye, Getachew

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 13

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted a revised schedule for the final response to question 03.08.05-30 in Supplements 11 and 12 on September 15, 2010 and October 7, 2010, respectively.

The attached file, "RAI 376 Supplement 13 Response US EPR DC-INTERIM.pdf" provides a technically correct and complete INTERIM response to Questions 03.08.05-28 and 03.08.05-31, as committed.

The following table indicates the respective pages in the response document, RAI 376 Supplement 13 Response US EPR DC - INTERIM.pdf," that contains AREVA NP's response to the subject questions.

Question #	Start Page	End Page
RAI 354 - 03.08.05-28	2	10
RAI 354 - 03.08.05-31	11	12

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	August 27, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-29	August 27, 2010 (Actual)	October 29, 2010
RAI 376-03.08.05-30	N/A	November 22, 2010
RAI 376-03.08.05-31	October 25, 2010 (Actual)	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (External RS/NB)

Sent: Thursday, October 07, 2010 2:50 PM

To: 'Tesfaye, Getachew'

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 12

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29. AREVA NP submitted Supplement 11 on September 15, 2010, to provide a revised schedule for the final response to question 03.08.05-30

The schedule for Question 03.08.05-30 is being revised to allow additional time for AREVA NP to address NRC comments. The schedule for the remaining questions is unchanged.

The schedule for technically correct and complete responses to the remaining questions is provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	August 27, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 27, 2010 (Actual)	October 29, 2010
RAI 376-03.08.05-30	N/A	November 22, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (External RS/NB)

Sent: Wednesday, September 15, 2010 9:21 AM

To: 'Tesfaye, Getachew'

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 11

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25. On August 27, 2010, AREVA NP submitted Supplement 10 to provide INTERIM responses for Questions 03.08.05-25 and 03.08.05-29.

The schedule for Question 03.08.05-30 is being revised to allow additional time for AREVA NP to interact with the NRC. The schedule for the remaining questions is unchanged.

The schedule for technically correct and complete responses to the remaining 8 questions is unchanged and provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	August 27, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 27, 2010 (Actual)	October 29, 2010
RAI 376-03.08.05-30	N/A	October 14, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (External RS/NB)

Sent: Friday, August 27, 2010 4:58 PM

To: 'Tesfaye, Getachew'

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 10-INTERIM

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29. AREVA NP submitted Supplement 9 on August 16, 2010, to provide INTERIM responses for Questions 03.08.05-26 and 03.08.05-27 and a revised schedule for INTERIM response to question 03.08.05-25.

The attached file, "RAI 376 Supplement 10 Response US EPR DC- INTERIM.pdf" provides a technically correct and complete INTERIM response to 2 of the remaining 8 questions, as committed.

The following table indicates the respective pages in the response document, "RAI 376 Supplement 10 Response US EPR DC- INTERIM.pdf," that contain AREVA NP's response to the subject questions.

Question #	Start Page	End Page
RAI 376 — 03.08.05-25	2	3
RAI 376 — 03.08.05-29	4	5

The schedule for technically correct and complete responses to the remaining questions is unchanged and provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	August 27, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 27, 2010 (Actual)	October 29, 2010
RAI 376-03.08.05-30	N/A	September 16, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (External RS/NB)

Sent: Monday, August 16, 2010 12:34 PM

To: 'Tesyfaye, Getachew'

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (External RS/NB)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 9

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed. AREVA NP submitted Supplement 8 on August 9, 2010, to provide a revised schedule for INTERIM response to question 03.08.05-29.

The schedule for INTERIM response to Question 03.08.05-25 is revised to allow AREVA NP additional time to prepare the response. The FINAL response date for Question 03.08.05-25 has not changed. The FINAL response date for Question 03.08.05-30 is being changed to account for the interaction with NRC being scheduled at a later date than the existing FINAL response date.

The attached file, "RAI 376 Supplement 9 Response - INTERIM.pdf" provides a technically correct and complete INTERIM response to 2 of the remaining 8 questions, as committed.

The following table indicates the respective pages in the response document, "RAI 376 Supplement 9 Response - INTERIM.pdf," that contain AREVA NP's response to the subject questions.

Question #	Start Page	End Page
RAI 376 — 03.08.05-26	2	2
RAI 376 — 03.08.05-27	3	5

The schedule for technically correct and complete responses to the remaining 8 questions is changed and provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	September 8, 2010	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010 (Actual)	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 27, 2010	October 29, 2010
RAI 376-03.08.05-30	N/A	September 16, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (EXT)
Sent: Monday, August 09, 2010 5:45 PM
To: 'Tesfaye, Getachew'

Cc: DELANO Karen (RS/NB); ROMINE Judy (RS/NB); BENNETT Kathy (RS/NB); CORNELL Veronica (EXT)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 8

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed. AREVA NP submitted Supplement 7 on July 29, 2010, to provide a FINAL response to 2 of the remaining 10 question, as committed.

The schedule for INTERIM response to Question 03.08.05-29 is revised to allow AREVA NP additional time to prepare the interim response. The final response date for Question 03.08.05-29 has not changed.

The schedule for technically correct and complete responses to the remaining 8 questions is unchanged and provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	August 16, 2010	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 27, 2010	October 29, 2010
RAI 376-03.08.05-30	N/A	August 16, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (EXT)
Sent: Thursday, July 29, 2010 7:56 PM
To: 'Tefaye, Getachew'
Cc: DELANO Karen V (AREVA NP INC); ROMINE Judy (AREVA NP INC); BENNETT Kathy A (OFR) (AREVA NP INC); CORNELL Veronica (EXT); VAN NOY Mark (EXT)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 7

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on

July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010 to provide an INTERIM response to question 03.08.05-24. AREVA NP submitted Supplement 6 on July 26, 2010, to provide a FINAL response to 3 of the remaining 13 question, as committed.

The attached file, "RAI 376 Supplement 7 FINAL Response US EPR DC.pdf" provides technically correct and complete responses to 2 of the remaining 10 questions, as committed.

Appended to this file are affected pages of the U.S. EPR Final Safety Analysis Report in redline-strikeout format which support the response to RAI 376 Questions 03.08.01-48 and 03.08.03-24.

The following table indicates the respective pages in the response document, RAI 376 Supplement 7 Response US EPR DC.pdf," that contain AREVA NP's response to the subject questions.

Question #	Start Page	End Page
RAI 376 — 03.08.01-48	2	3
RAI 376 — 03.08.03-24	4	8

The schedule for technically correct and complete responses to the remaining 8 questions is unchanged and provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	August 16, 2010	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 9, 2010	October 29, 2010
RAI 376-03.08.05-30	N/A	August 16, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (EXT)
Sent: Monday, July 26, 2010 4:00 PM
To: 'Tefaye, Getachew'
Cc: DELANO Karen V (AREVA NP INC); ROMINE Judy (AREVA NP INC); BENNETT Kathy A (OFR) (AREVA NP INC); VAN NOY Mark (EXT); CORNELL Veronica (EXT)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 6

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14

questions. AREVA NP submitted a revised schedule for the remaining 13 questions in Supplements 2 and 3 on June 8, 2010, and June 24, 2010, respectively. AREVA NP submitted Supplement 4 on July 13, 2010, to provide a revised schedule for question 03.08.05-30. AREVA NP submitted Supplement 5 on July 15, 2010, an INTERIM response to question 03.08.05-24.

The attached file, "RAI 376 Supplement 6 Response U.S. EPR DC.pdf" provides a technically correct and complete FINAL response to 3 of the remaining 13 questions, as committed. The schedule for the remaining 10 questions is unchanged.

The following table indicates the respective pages in the response document, "RAI 376 Supplement 6 Response U.S. EPR DC.pdf," that contain AREVA NP's response to the subject questions.

Question #	Start Page	End Page
RAI 376 — 03.08.01-47	2	3
RAI 376 — 03.08.03-21	4	5
RAI 376 — 03.08.03-22	6	7

The schedule for technically correct and complete responses to the remaining 13 questions is provided below.

Question #	Interim Response Date	Response Date
RAI 376-03.08.01-48	N/A	July 29, 2010
RAI 376-03.08.03-24	N/A	July 29, 2010
RAI 376-03.08.05-24	July 15, 2010 (Actual)	February 17, 2011
RAI 376-03.08.05-25	August 16, 2010	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 9, 2010	October 29, 2010
RAI 376-03.08.05-30	N/A	August 16, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (EXT)
Sent: Thursday, July 15, 2010 7:13 PM
To: 'Tefaye, Getachew'
Cc: DELANO Karen V (AREVA NP INC); ROMINE Judy (AREVA NP INC); BENNETT Kathy A (OFR) (AREVA NP INC); VAN NOY Mark (EXT); CORNELL Veronica (EXT)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 5 - Interim

Getachew,

AREVA NP Inc. provided a schedule for a technically correct and complete response to RAI No. 376 on April 26, 2010. AREVA NP submitted Supplement 1 to the response on May 20, 2010 to address 1 of the remaining 14 questions. AREVA NP submitted Supplement 2 to the response on June 8, 2010, to change the schedule for responding to Question 03.08.05-30. AREVA NP submitted Supplement 3 to the response on June 24, 2010, to provide a changed schedule based upon the civil/structural re-planning activities and revised RAI response schedule presented to the NRC during the June 9, 2010, Public Meeting, and to allow time to interact with the NRC on the responses. AREVA NP submitted Supplement 4 on July 13, 2010 to provide a revised schedule for question 03.08.05-30. The attached file, "RAI 376 Question 03.08.05-24 Response - INTERIM.pdf" provides a technically correct and complete INTERIM response to 1 of the remaining 13 questions, as committed.

The following table indicates the respective pages in the response document, "RAI 376 Question 03.08.05-24 Response - INTERIM.pdf," that contain AREVA NP's response to the subject questions.

Question #	Start Page	End Page
RAI 376 — 03.08.05-24	2	5

The schedule for technically correct and complete FINAL responses to the remaining 13 questions is unchanged and provided below:

Question #	Interim Response Date	Response Date
RAI 376-03.08.01-47	N/A	August 17, 2010
RAI 376-03.08.01-48	N/A	July 29, 2010
RAI 376-03.08.03-21	N/A	July 26, 2010
RAI 376-03.08.03-22	N/A	July 26, 2010
RAI 376-03.08.03-24	N/A	July 29, 2010
RAI 376-03.08.05-24	July 15, 2010 Actual	February 17, 2011
RAI 376-03.08.05-25	August 16, 2010	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 9, 2010	October 29, 2010
RAI 376-03.08.05-30	N/A	August 16, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (EXT)
Sent: Tuesday, July 13, 2010 6:08 PM
To: 'Tesfaye, Getachew'

Cc: DELANO Karen V (AREVA NP INC); ROMINE Judy (AREVA NP INC); BENNETT Kathy A (OFR) (AREVA NP INC); CORNELL Veronica (EXT); VAN NOY Mark (EXT)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 4

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions. AREVA NP submitted Supplement 2 to the response on June 8, 2010, to provide a schedule for the remaining 13 questions, which were affected by the work underway to address NRC comments from the April 26, 2010, audit. AREVA NP submitted RAI No. 376 Supplement 3 on June 24, 2010, to reflect the revised RAI response schedule as a result of the civil/structural re-planning activities.

RAI 376 Supplement 4 revises the schedule for the response to Question 03.08.05-30 to allow time to interact with the NRC on the draft response. The schedule for the remaining 12 questions is unchanged.

The schedule for technically correct and complete responses to the remaining 13 questions is provided below.

Question #	Interim Response Date	Response Date
RAI 376-03.08.01-47	N/A	August 17, 2010
RAI 376-03.08.01-48	N/A	July 29, 2010
RAI 376-03.08.03-21	N/A	July 26, 2010
RAI 376-03.08.03-22	N/A	July 26, 2010
RAI 376-03.08.03-24	N/A	July 29, 2010
RAI 376-03.08.05-24	July 15, 2010	February 17, 2011
RAI 376-03.08.05-25	August 16, 2010	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 9, 2010	October 29, 2010
RAI 376-03.08.05-30	N/A	August 16, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (EXT)

Sent: Thursday, June 24, 2010 11:56 AM

To: 'Tesfaye, Getachew'

Cc: DELANO Karen V (AREVA NP INC); ROMINE Judy (AREVA NP INC); BENNETT Kathy A (OFR) (AREVA NP INC); RYAN Tom (AREVA NP INC); VAN NOY Mark (EXT); CORNELL Veronica (EXT); GARDNER George Darrell (AREVA NP INC)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 3

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14

questions. AREVA NP submitted Supplement 2 to the response on June 8, 2010, to provide a schedule for the remaining 13 questions, which were affected by the work underway to address NRC comments from the April 26, 2010, audit.

Based upon the civil/structural re-planning activities and revised RAI response schedule presented to the NRC during the June 9, 2010, Public Meeting, and to allow time to interact with the NRC on the responses, the schedule has been changed. The schedule for 03.08.05-30 remains unchanged.

Prior to submittal of the final RAI response, AREVA NP will provide an interim RAI response that includes:

- (1) a description of the technical work (e.g., methodology)
- (2) U.S. EPR FSAR revised pages, as applicable

The revised schedule for an interim response and the technically correct and complete response to these questions is provided below.

Question #	Interim Response Date	Response Date
RAI 376-03.08.01-47	N/A	August 17, 2010
RAI 376-03.08.01-48	N/A	July 29, 2010
RAI 376-03.08.03-21	N/A	July 26, 2010
RAI 376-03.08.03-22	N/A	July 26, 2010
RAI 376-03.08.03-24	N/A	July 29, 2010
RAI 376-03.08.05-24	July 15, 2010	February 17, 2011
RAI 376-03.08.05-25	August 16, 2010	February 8, 2011
RAI 376-03.08.05-26	August 16, 2010	February 8, 2011
RAI 376-03.08.05-27	August 16, 2010	February 8, 2011
RAI 376-03.08.05-28	October 25, 2010	February 17, 2011
RAI 376-03.08.05-29	August 9, 2010	October 29, 2010
RAI 376-03.08.05-30	N/A	July 14, 2010
RAI 376-03.08.05-31	October 25, 2010	February 17, 2011

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (EXT)

Sent: Tuesday, June 08, 2010 3:32 PM

To: 'Teshaye, Getachew'

Cc: DELANO Karen V (AREVA NP INC); ROMINE Judy (AREVA NP INC); BENNETT Kathy A (OFR) (AREVA NP INC); VAN NOY Mark (EXT); CORNELL Veronica (EXT)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 2

Getachew,

AREVA NP Inc. (AREVA NP) provided a schedule for a technically correct and complete response to RAI 376 on April 26, 2010. RAI 376 Supplement 1 provided a technically correct and complete response to 1 of 14 questions.

The schedule for the response to Question 03.08.05-30 has been changed. The final schedule for this question as well as the remaining questions below will be evaluated based on the information that will be presented at the June 9, 2010, public meeting and subsequent NRC feedback.

Question #	Response Date
RAI 376-03.08.01-47	July 14, 2010
RAI 376-03.08.01-48	August 3, 2010
RAI 376-03.08.03-21	June 24, 2010
RAI 376-03.08.03-22	June 24, 2010
RAI 376-03.08.03-24	August 3, 2010
RAI 376-03.08.05-24	August 3, 2010
RAI 376-03.08.05-25	August 3, 2010
RAI 376-03.08.05-26	August 3, 2010
RAI 376-03.08.05-27	July 14, 2010
RAI 376-03.08.05-28	August 3, 2010
RAI 376-03.08.05-29	August 3, 2010
RAI 376-03.08.05-30	July 14, 2010
RAI 376-03.08.05-31	August 3, 2010

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (EXT)
Sent: Thursday, May 20, 2010 4:24 PM
To: 'Tefaye, Getachew'
Cc: DELANO Karen V (AREVA NP INC); ROMINE Judy (AREVA NP INC); BENNETT Kathy A (OFR) (AREVA NP INC); VAN NOY Mark (EXT); CORNELL Veronica (EXT)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 1

Getachew,

AREVA NP Inc. provided a schedule for a technically correct and complete response to RAI No. 376 on April 26, 2010. The attached file, "RAI 376 Supplement 1 Response US EPR DC.pdf," provides technically correct and complete responses to 1 of the remaining 14 questions.

Appended to this file are affected pages of the U.S. EPR Final Safety Analysis Report in redline-strikeout format which support the response to RAI 376 Question 03.08.03-23.

The response to one question, 03.08.05-30, cannot be provided at this time due to its dependence on path-to-closure related work-planning currently being rescheduled and reviewed by the NRC.

The following table indicates the respective pages in the response document, "RAI 376 Supplement 1 Response US EPR DC.pdf," that contain AREVA NP's response to the subject questions.

Question #	Start Page	End Page
RAI 376-03.08.03-23	2	2

A complete answer is not provided for 13 of the 14 questions. The schedule for a technically correct and complete response to these questions has been changed and is provided below.

Question #	Response Date
RAI 376-03.08.01-47	July 14, 2010
RAI 376-03.08.01-48	August 3, 2010
RAI 376-03.08.03-21	June 24, 2010
RAI 376-03.08.03-22	June 24, 2010
RAI 376-03.08.03-24	August 3, 2010
RAI 376-03.08.05-24	August 3, 2010
RAI 376-03.08.05-25	August 3, 2010
RAI 376-03.08.05-26	August 3, 2010
RAI 376-03.08.05-27	July 14, 2010
RAI 376-03.08.05-28	August 3, 2010
RAI 376-03.08.05-29	August 3, 2010
RAI 376-03.08.05-30	June 10, 2010
RAI 376-03.08.05-31	August 3, 2010

Sincerely,

Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: BRYAN Martin (EXT)
Sent: Monday, April 26, 2010 12:49 PM
To: 'Tesfaye, Getachew'
Cc: DELANO Karen V (AREVA NP INC); ROMINE Judy (AREVA NP INC); BENNETT Kathy A (OFR) (AREVA NP INC); RYAN Tom (AREVA NP INC); VAN NOY Mark (EXT)
Subject: Response to U.S. EPR Design Certification Application RAI No. 376 (4355,4367,4377), FSAR Ch. 3

Getachew,

Attached please find AREVA NP Inc.'s response to the subject request for additional information (RAI). The attached file, "RAI 376 Response US EPR DC.pdf" provides a schedule since a technically correct and complete response to the 14 questions is not provided.

The following table indicates the respective pages in the response document, "RAI 376 Response US EPR DC.pdf," that contain AREVA NP's response to the subject questions.

Question #	Start Page	End Page
RAI 376-03.08.01-47	2	2

RAI 376-03.08.01-48	3	4
RAI 376-03.08.03-21	5	6
RAI 376-03.08.03-22	7	7
RAI 376-03.08.03-23	8	8
RAI 376-03.08.03-24	9	10
RAI 376-03.08.05-24	11	12
RAI 376-03.08.05-25	13	13
RAI 376-03.08.05-26	14	14
RAI 376-03.08.05-27	15	16
RAI 376-03.08.05-28	17	19
RAI 376-03.08.05-29	20	20
RAI 376-03.08.05-30	21	21
RAI 376-03.08.05-31	22	22

A complete answer is not provided for 14 of the 14 questions. The schedule for a technically correct and complete response to these questions is provided below.

Question #	Response Date
RAI 376-03.08.01-47	July 14, 2010
RAI 376-03.08.01-48	August 3, 2010
RAI 376-03.08.03-21	June 24, 2010
RAI 376-03.08.03-22	June 24, 2010
RAI 376-03.08.03-23	May 20, 2010
RAI 376-03.08.03-24	August 3, 2010
RAI 376-03.08.05-24	August 3, 2010
RAI 376-03.08.05-25	August 3, 2010
RAI 376-03.08.05-26	August 3, 2010
RAI 376-03.08.05-27	July 14, 2010
RAI 376-03.08.05-28	August 3, 2010
RAI 376-03.08.05-29	August 3, 2010
RAI 376-03.08.05-30	May 20, 2010
RAI 376-03.08.05-31	August 3, 2010

Sincerely,
Martin (Marty) C. Bryan
U.S. EPR Design Certification Licensing Manager
AREVA NP Inc.
Tel: (434) 832-3016
702 561-3528 cell
Martin.Bryan.ext@areva.com

From: Tesfaye, Getachew [mailto:Getachew.Tesfaye@nrc.gov]
Sent: Thursday, March 25, 2010 2:13 PM
To: ZZ-DL-A-USEPR-DL
Cc: Xu, Jim; Hawkins, Kimberly; Miernicki, Michael; Colaccino, Joseph; ArevaEPRDCPEm Resource
Subject: U.S. EPR Design Certification Application RAI No. 376 (4355,4367,4377), FSAR Ch. 3

Attached please find the subject requests for additional information (RAI). A draft of the RAI was provided to you on March 11, 2010, and on March 24, 2010, you informed us that the RAI is clear and no further clarification is needed. As a result, no change is made to the draft RAI. The schedule we have established for review of your application assumes technically correct and complete responses within 30 days of receipt of RAIs. For any RAIs that cannot be answered within 30 days, it is expected that a date for receipt of this

information will be provided to the staff within the 30 day period so that the staff can assess how this information will impact the published schedule.

Thanks,
Getachew Tesfaye
Sr. Project Manager
NRO/DNRL/NARP
(301) 415-3361

Hearing Identifier: AREVA_EPR_DC_RAIs
Email Number: 3257

Mail Envelope Properties (2FBE1051AEB2E748A0F98DF9EEE5A5D47EC33B)

Subject: Response to U.S. EPR Design Certification Application RAI No. 376, FSAR Ch. 3, Supplement 25 (Part 2 of 2)
Sent Date: 7/20/2011 10:33:21 AM
Received Date: 7/20/2011 10:34:01 AM
From: WILLIFORD Dennis (AREVA)

Created By: Dennis.Williford@areva.com

Recipients:
"BENNETT Kathy (AREVA)" <Kathy.Bennett@areva.com>
Tracking Status: None
"DELANO Karen (AREVA)" <Karen.Delano@areva.com>
Tracking Status: None
"ROMINE Judy (AREVA)" <Judy.Romine@areva.com>
Tracking Status: None
"RYAN Tom (AREVA)" <Tom.Ryan@areva.com>
Tracking Status: None
"Miernicki, Michael" <Michael.Miernicki@nrc.gov>
Tracking Status: None
"Tsfaye, Getachew" <Getachew.Tsfaye@nrc.gov>
Tracking Status: None

Post Office: auscharm02.adom.ad.corp

Files	Size	Date & Time
MESSAGE	85027	7/20/2011 10:34:01 AM
RAI 376 Supplement 25 Response US EPR DC - PUBLIC - Part 2 of 2.pdf		
6133467		

Options
Priority: Standard
Return Notification: No
Reply Requested: No
Sensitivity: Normal
Expiration Date:
Recipients Received:

**Figure 3.7.2-57—Isometric View of GTSTRUDL FEM for Emergency Power
Generating Building**

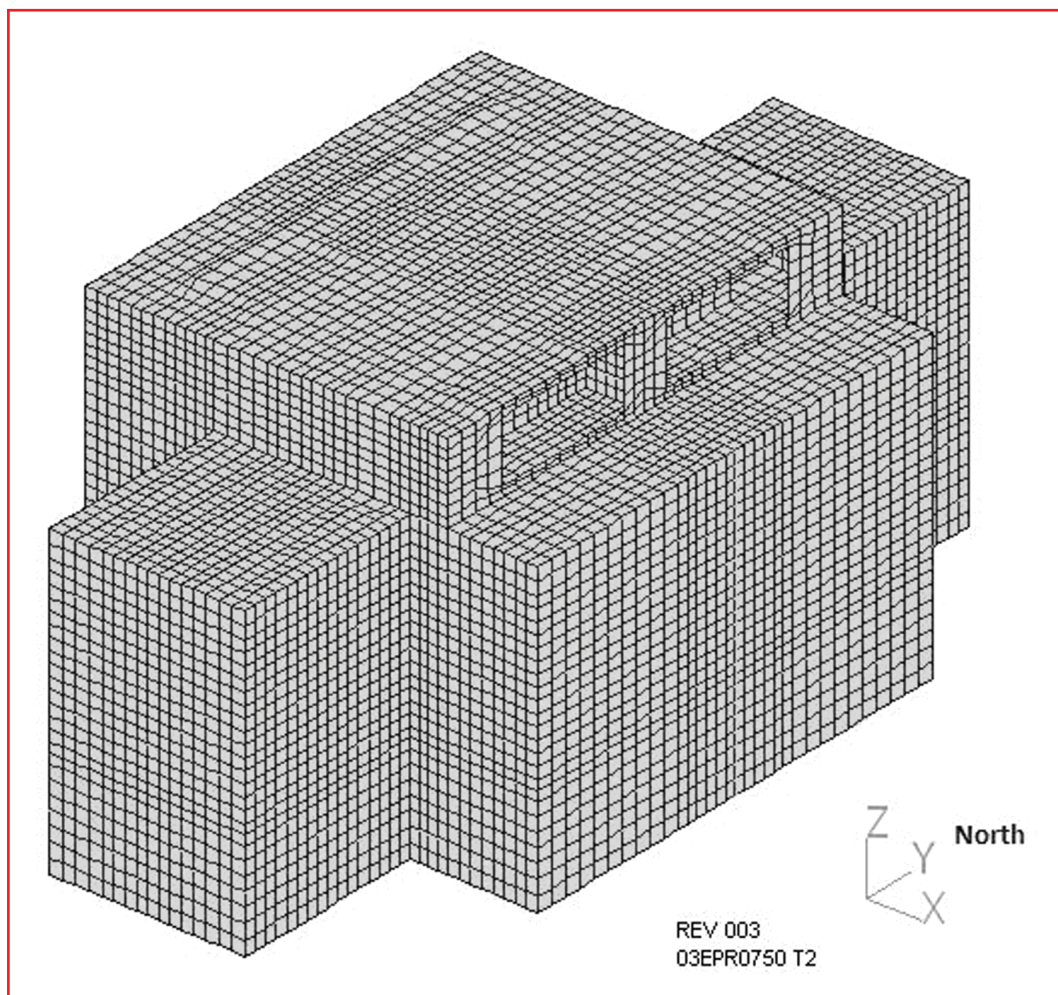


Figure 3.7.2-58—Section View of GTSTRUDL FEM for Emergency Power Generating Building

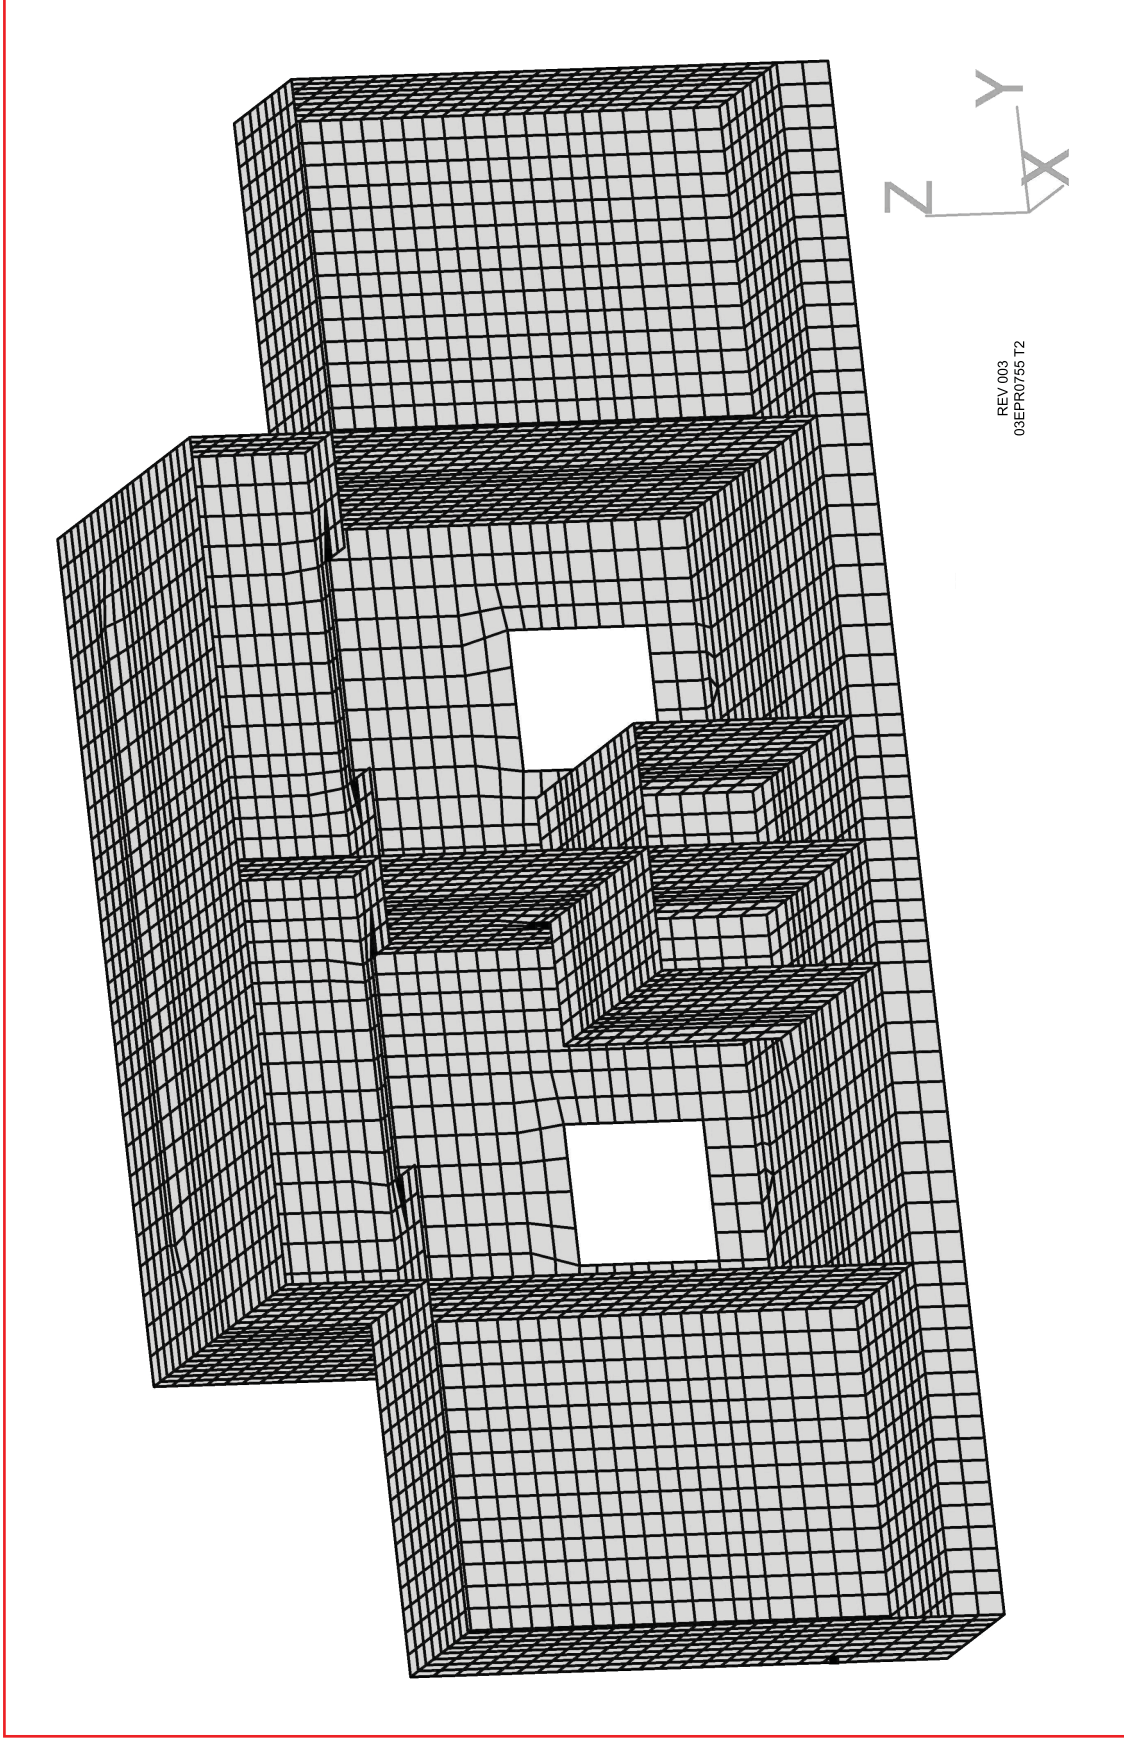




Figure 3.7.2-71—Soil Model Surface Response Spectra at Centers of Footprints of EPGB -
5% Damping, X-Direction


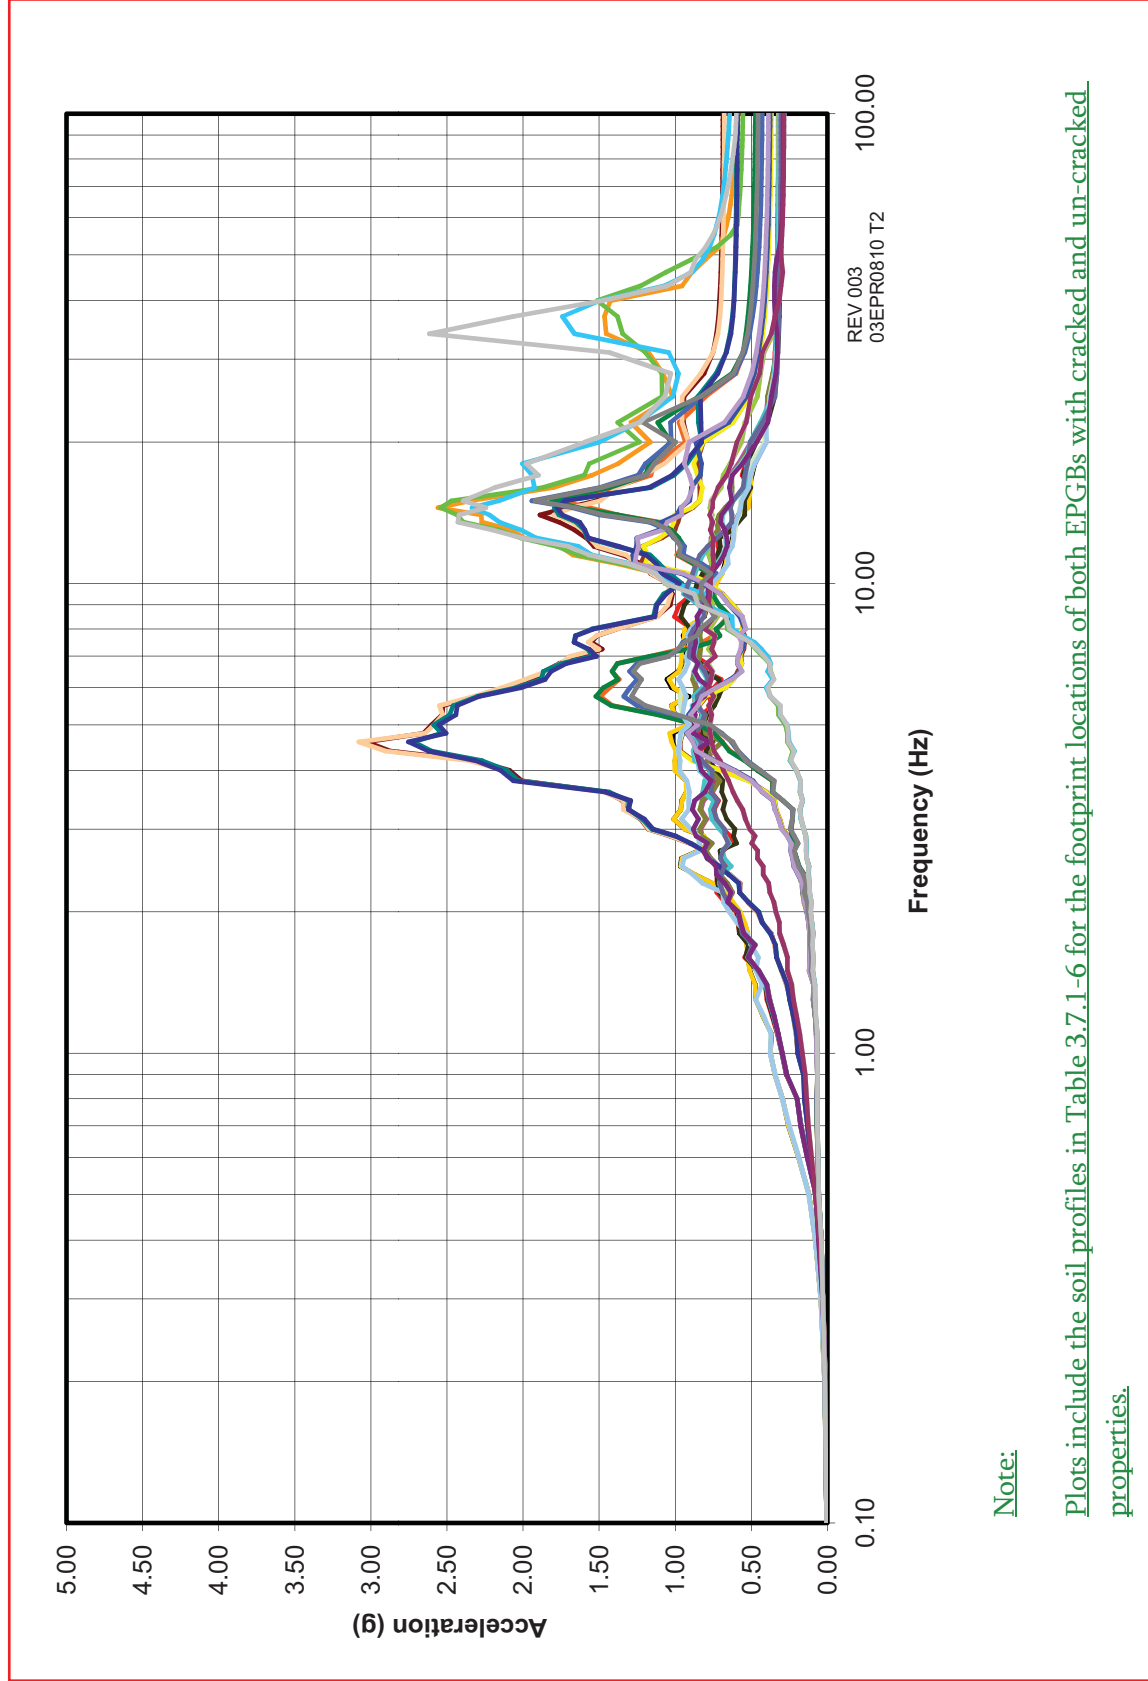




Figure 3.7.2-72—Soil Model Surface Response Spectra at Centers of Footprints of EPGB -
5% Damping, Y-Direction

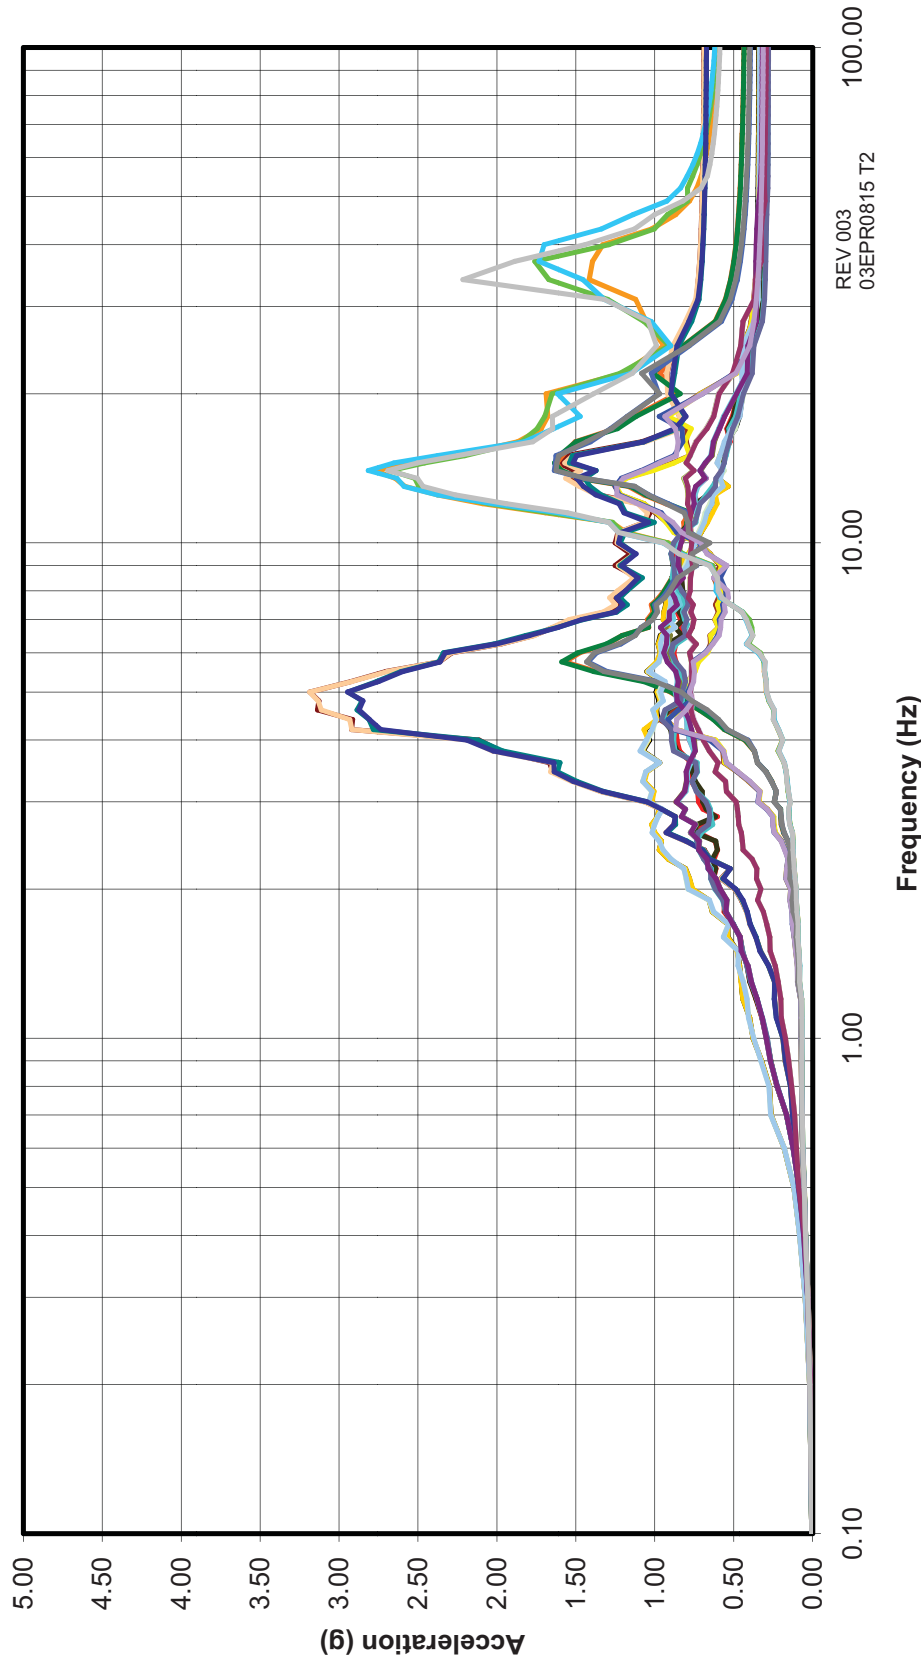

Note:

Plots include the soil profiles in Table 3.7.1-6 for the footprint locations of both EPGBs with cracked and un-cracked properties.



Figure 3.7.2-73—Soil Model Surface Response Spectra at Centers of Footprints of EPGB - 5% Damping, Z-Direction.

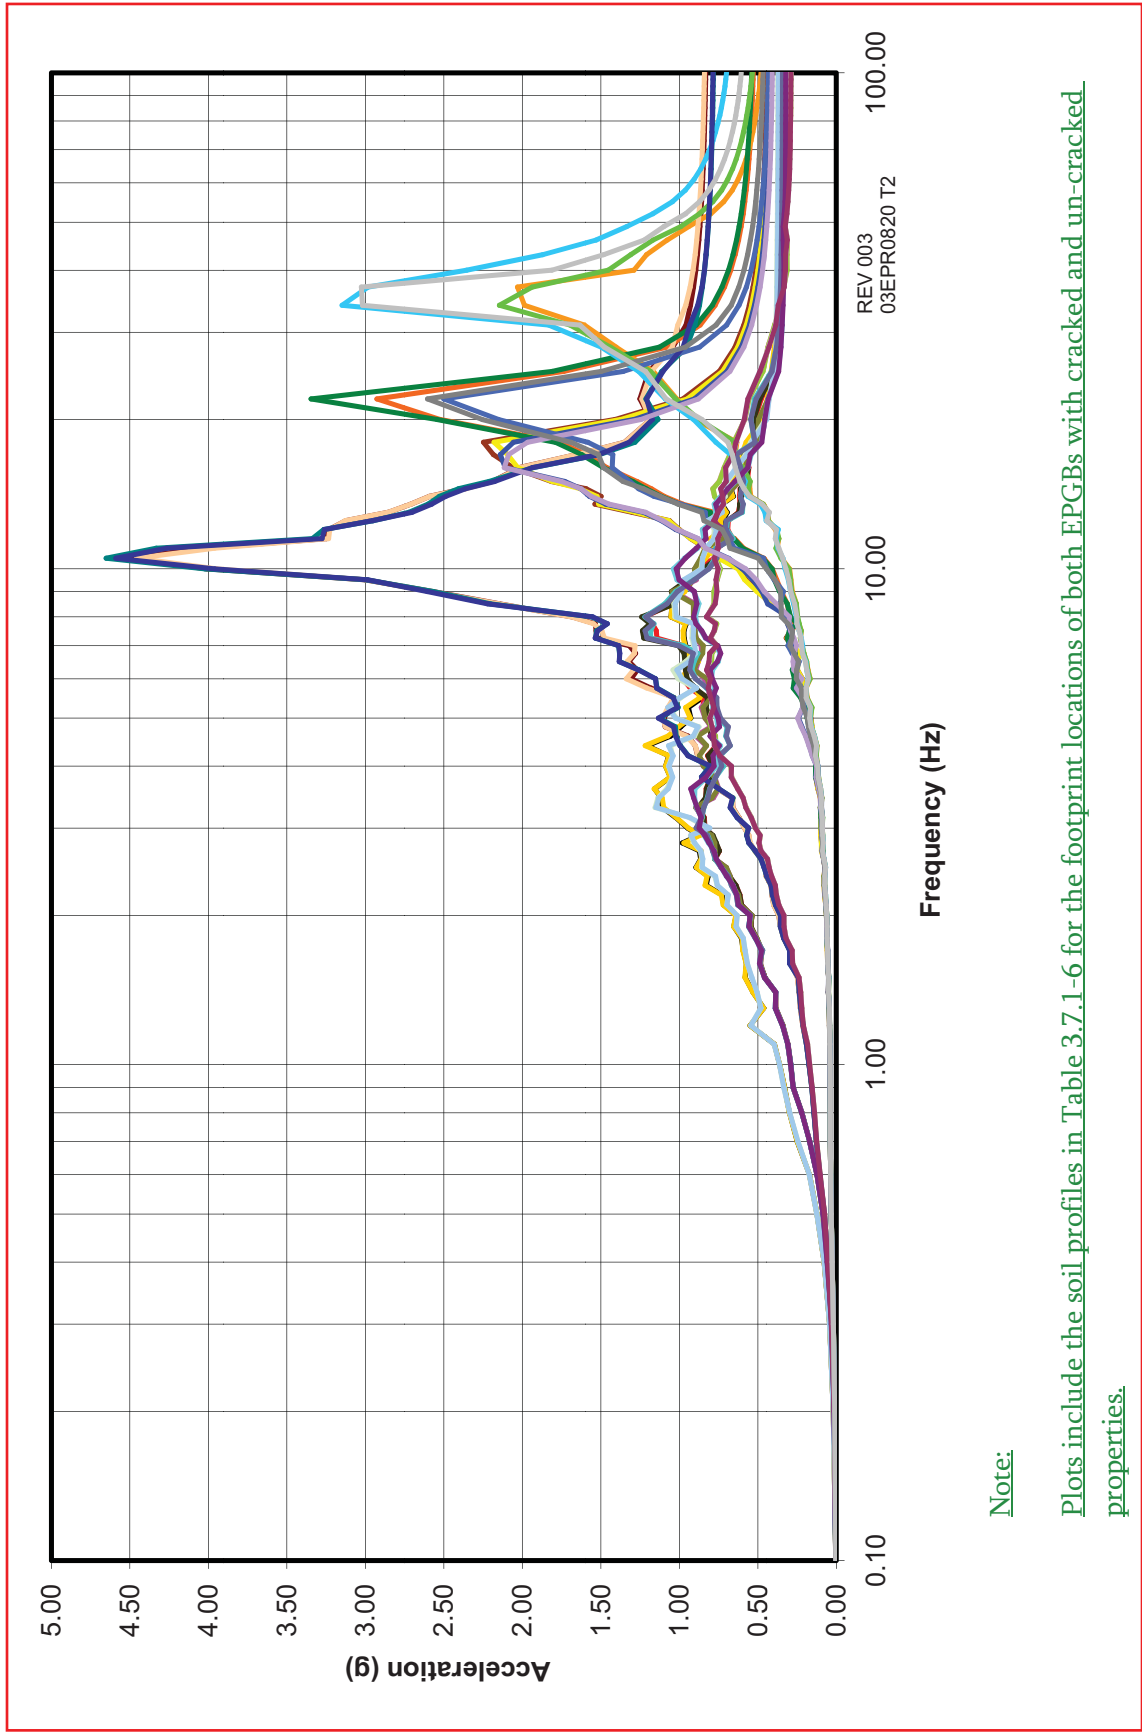




Figure 3.7.2-101—Spectrum Envelope of EPGB at the Center of Basemat - 2%, 3%, 4%, 5%, 7%, and 10% Damping, X-Direction_


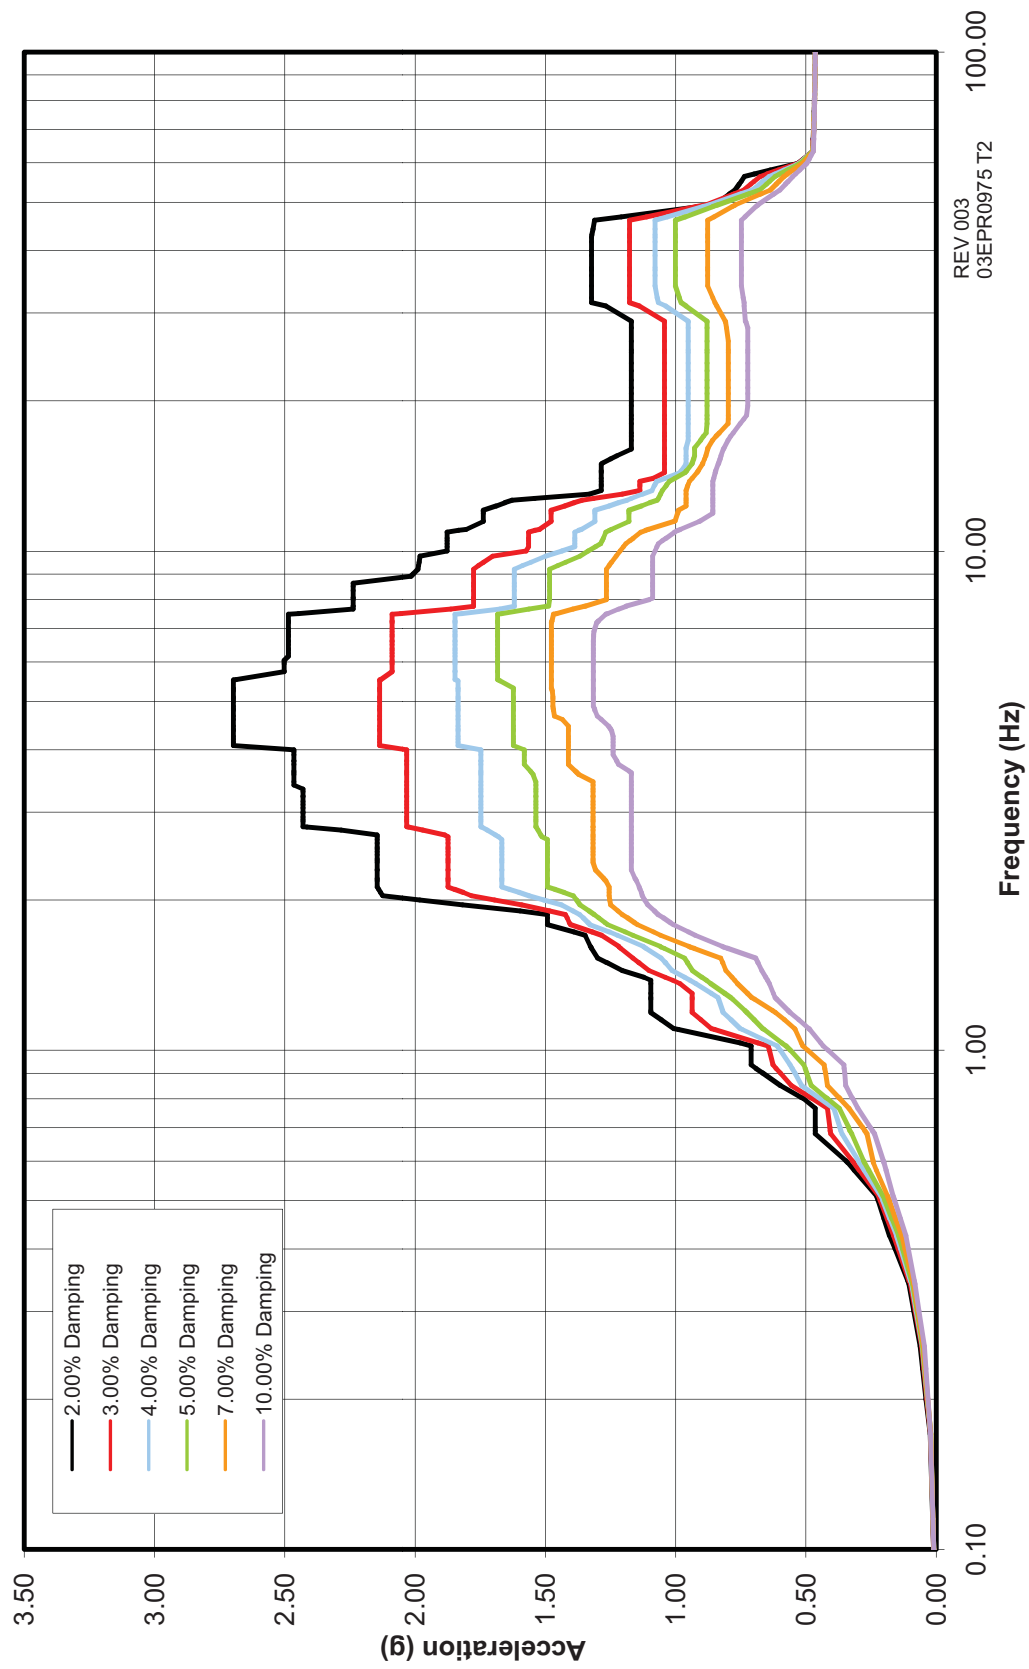




Figure 3.7.2-102—Spectrum Envelope of EPGB at the Center of Basemat - 2%, 3%, 4%, 5%, 7%, and 10% Damping, Y-Direction_

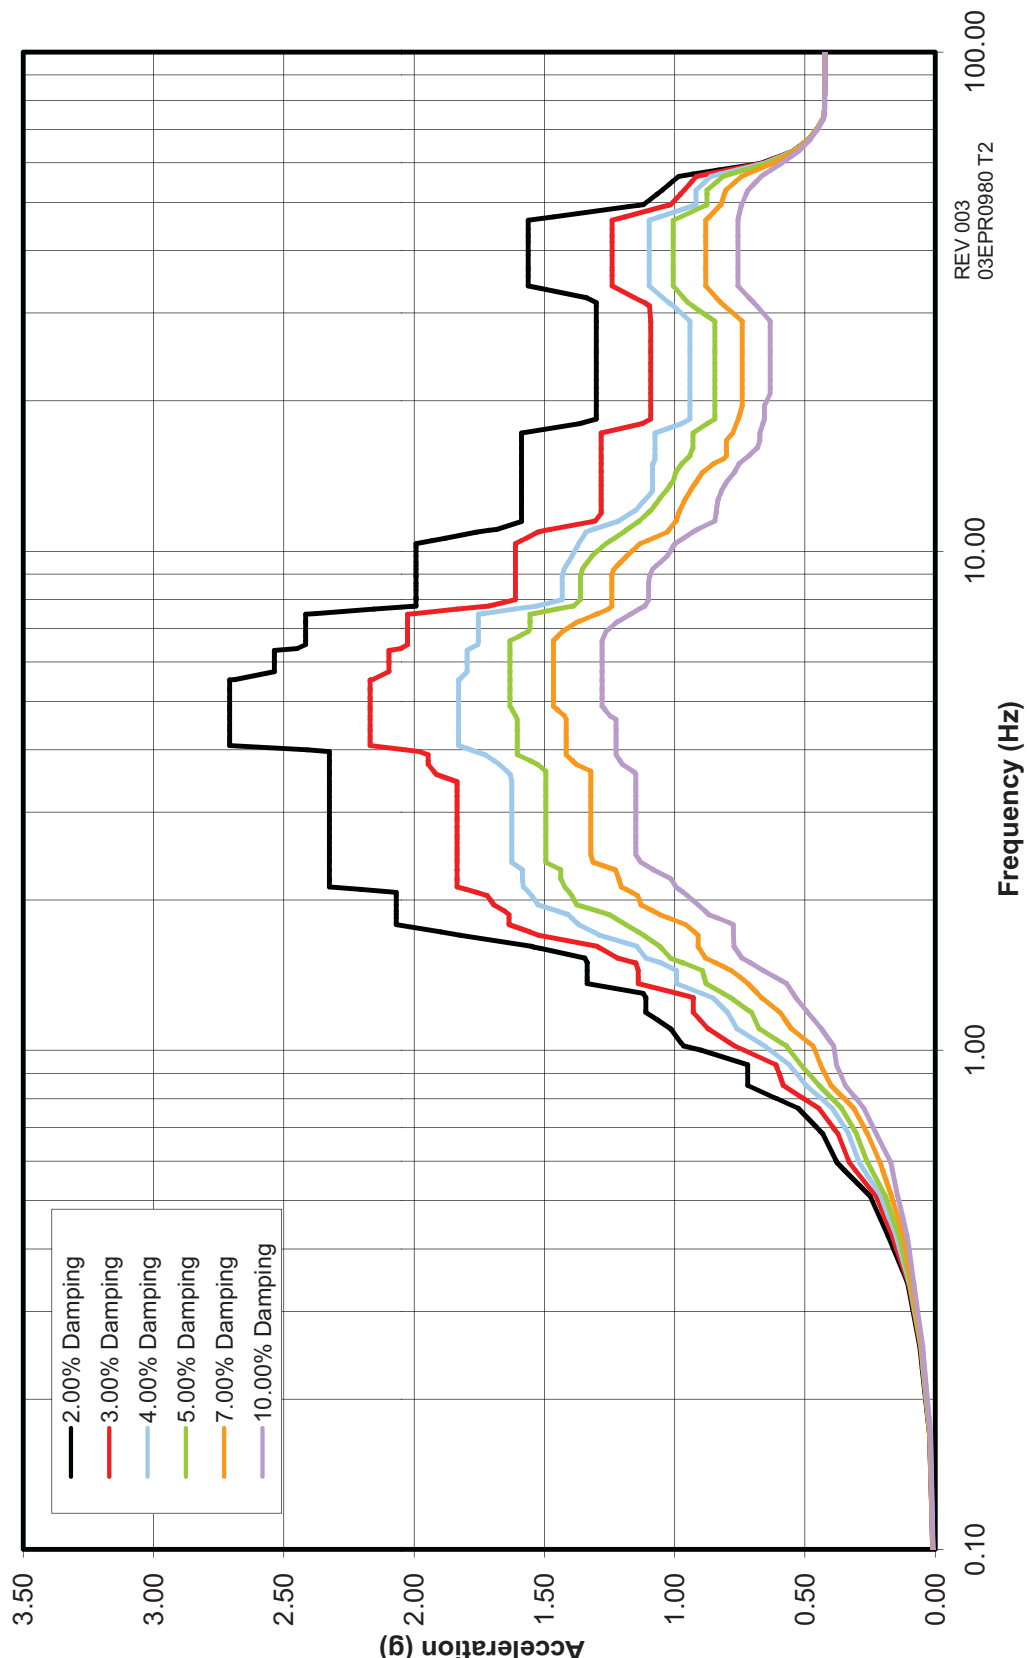

REV 003
03EPR0980 T2



Figure 3.7.2-103—Spectrum Envelope of EPGB at the Center of Basemat - 2%, 3%, 4%, 5%, 7%, and 10% Damping, Z-Direction_

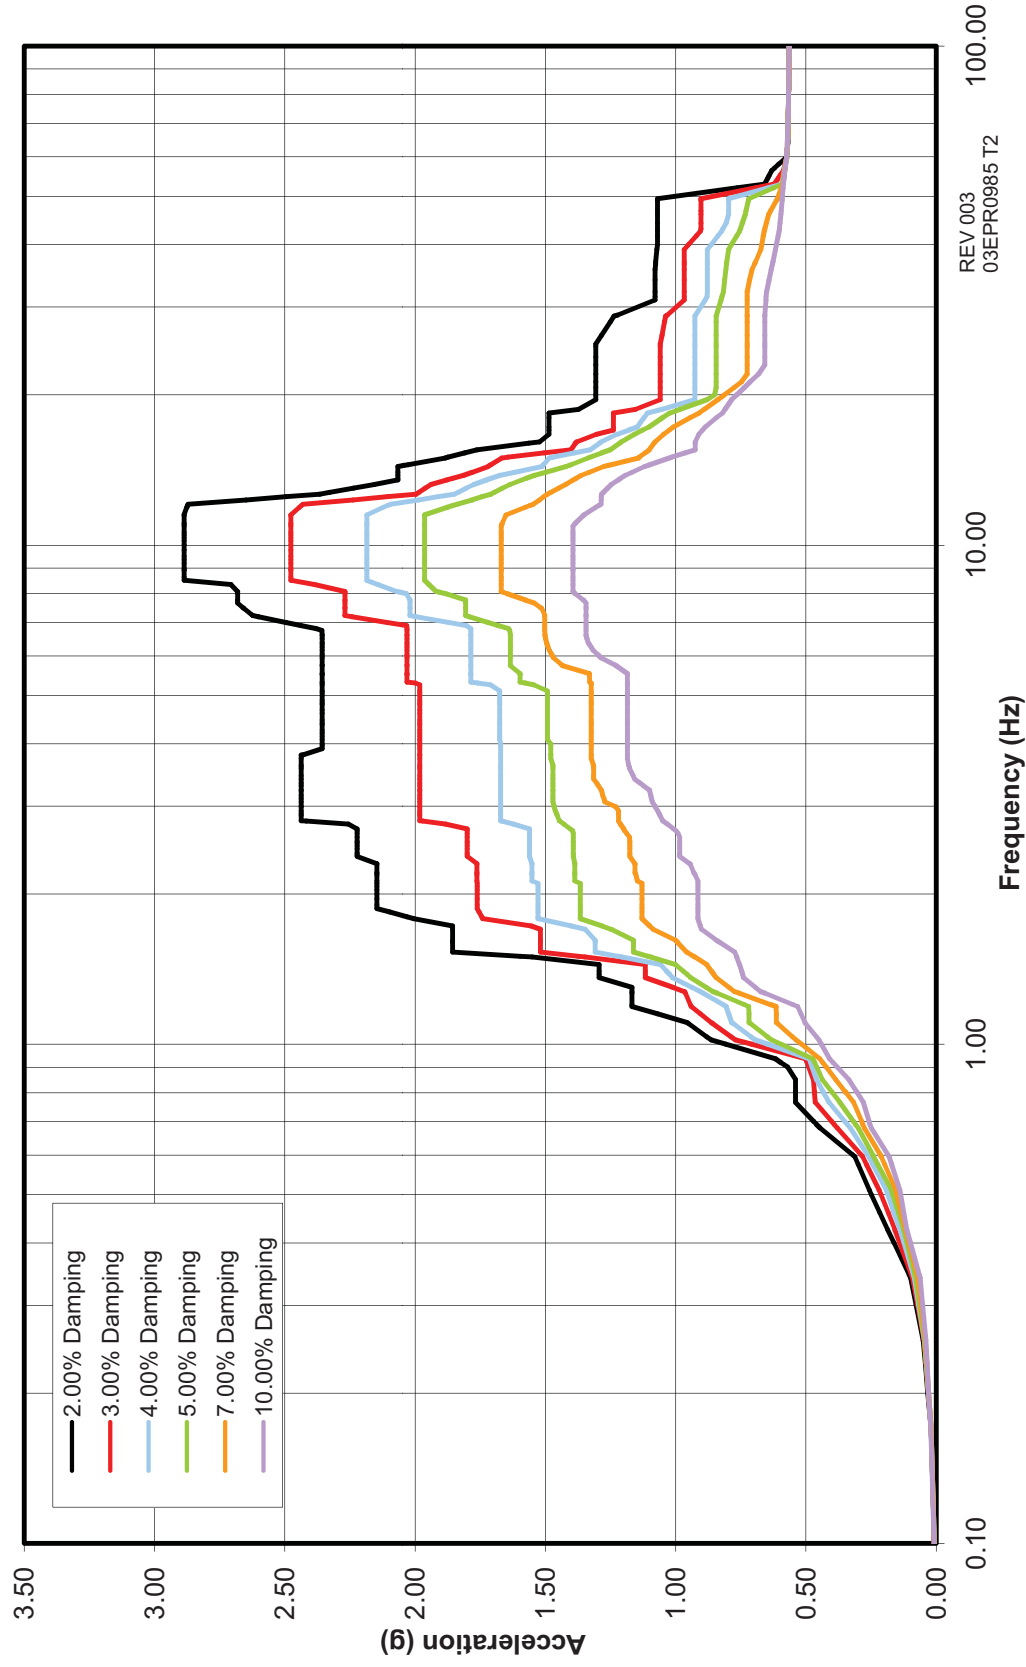




Figure 3.7.2-135—Deleted



Figure 3.7.2-136—Deleted



Figure 3.7.2-148—Spectrum Envelope of EPGB at Elev. +51 ft, 6 in - 2%, 3%, 4%, 5%, 7%, and 10% Damping, X-Direction

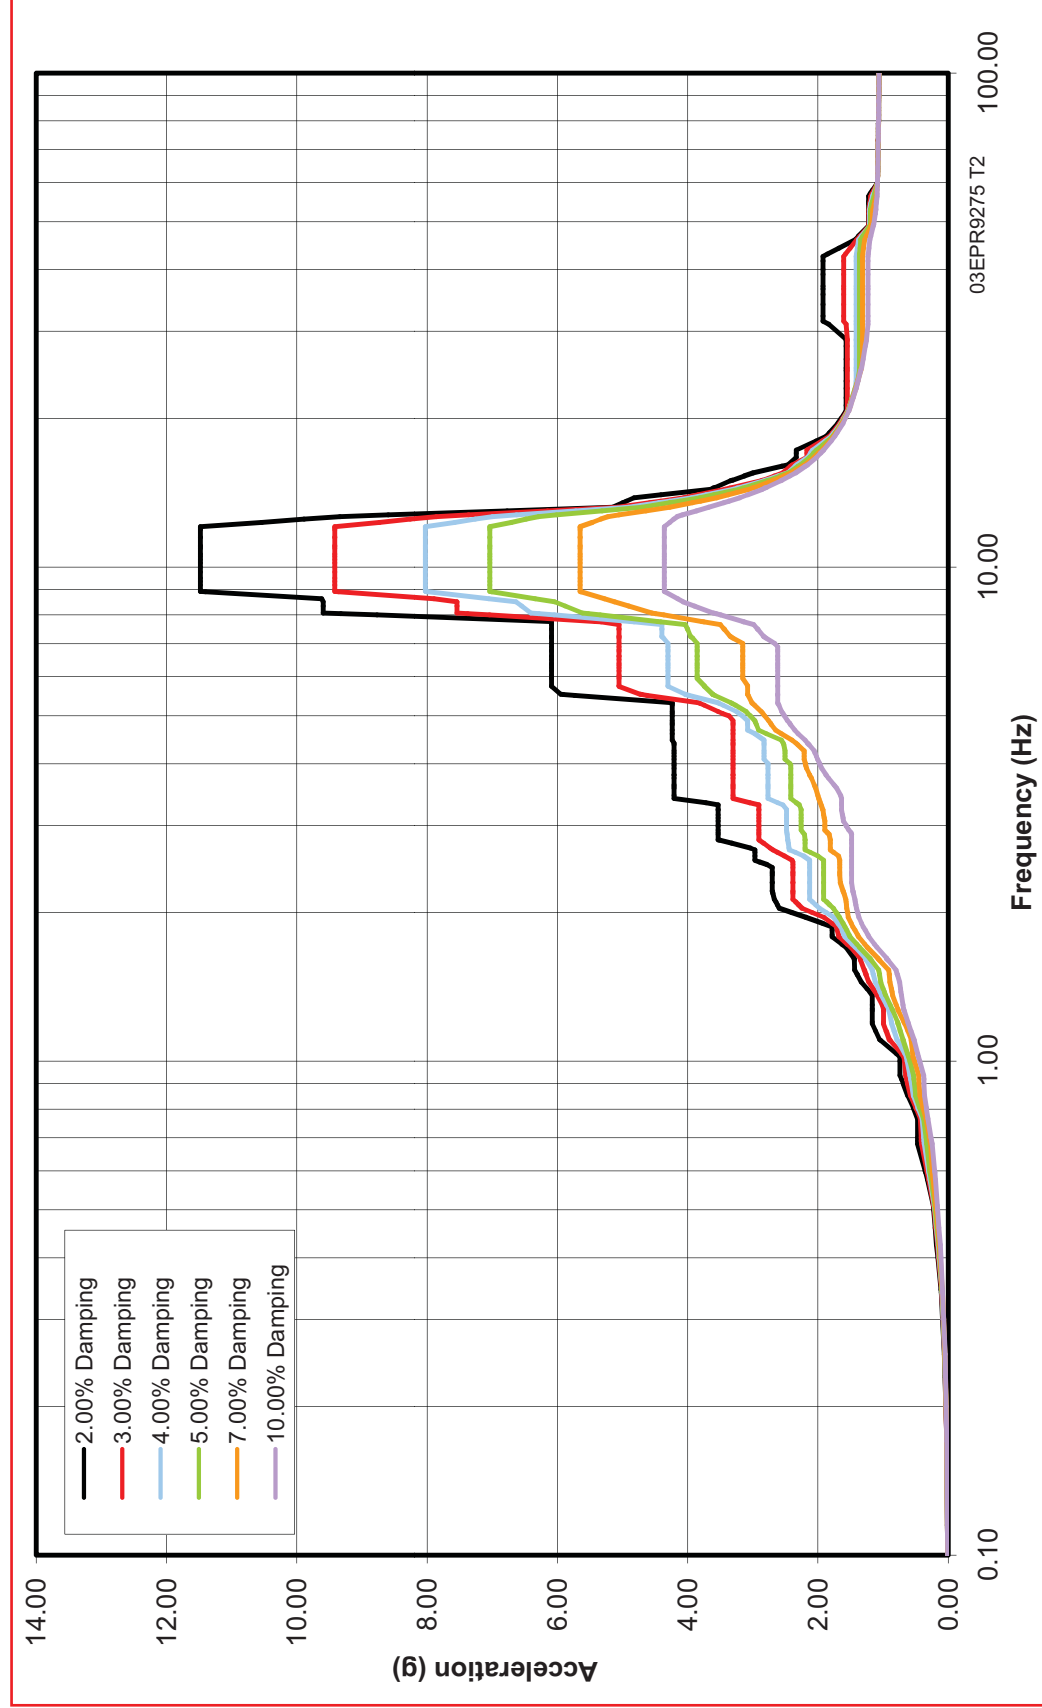




Figure 3.7.2-149—Spectrum Envelope of EPGB at Elev. +51 ft, 6 in - 2%, 3%, 4%, 5%, 7%, and 10% Damping, Y-Direction


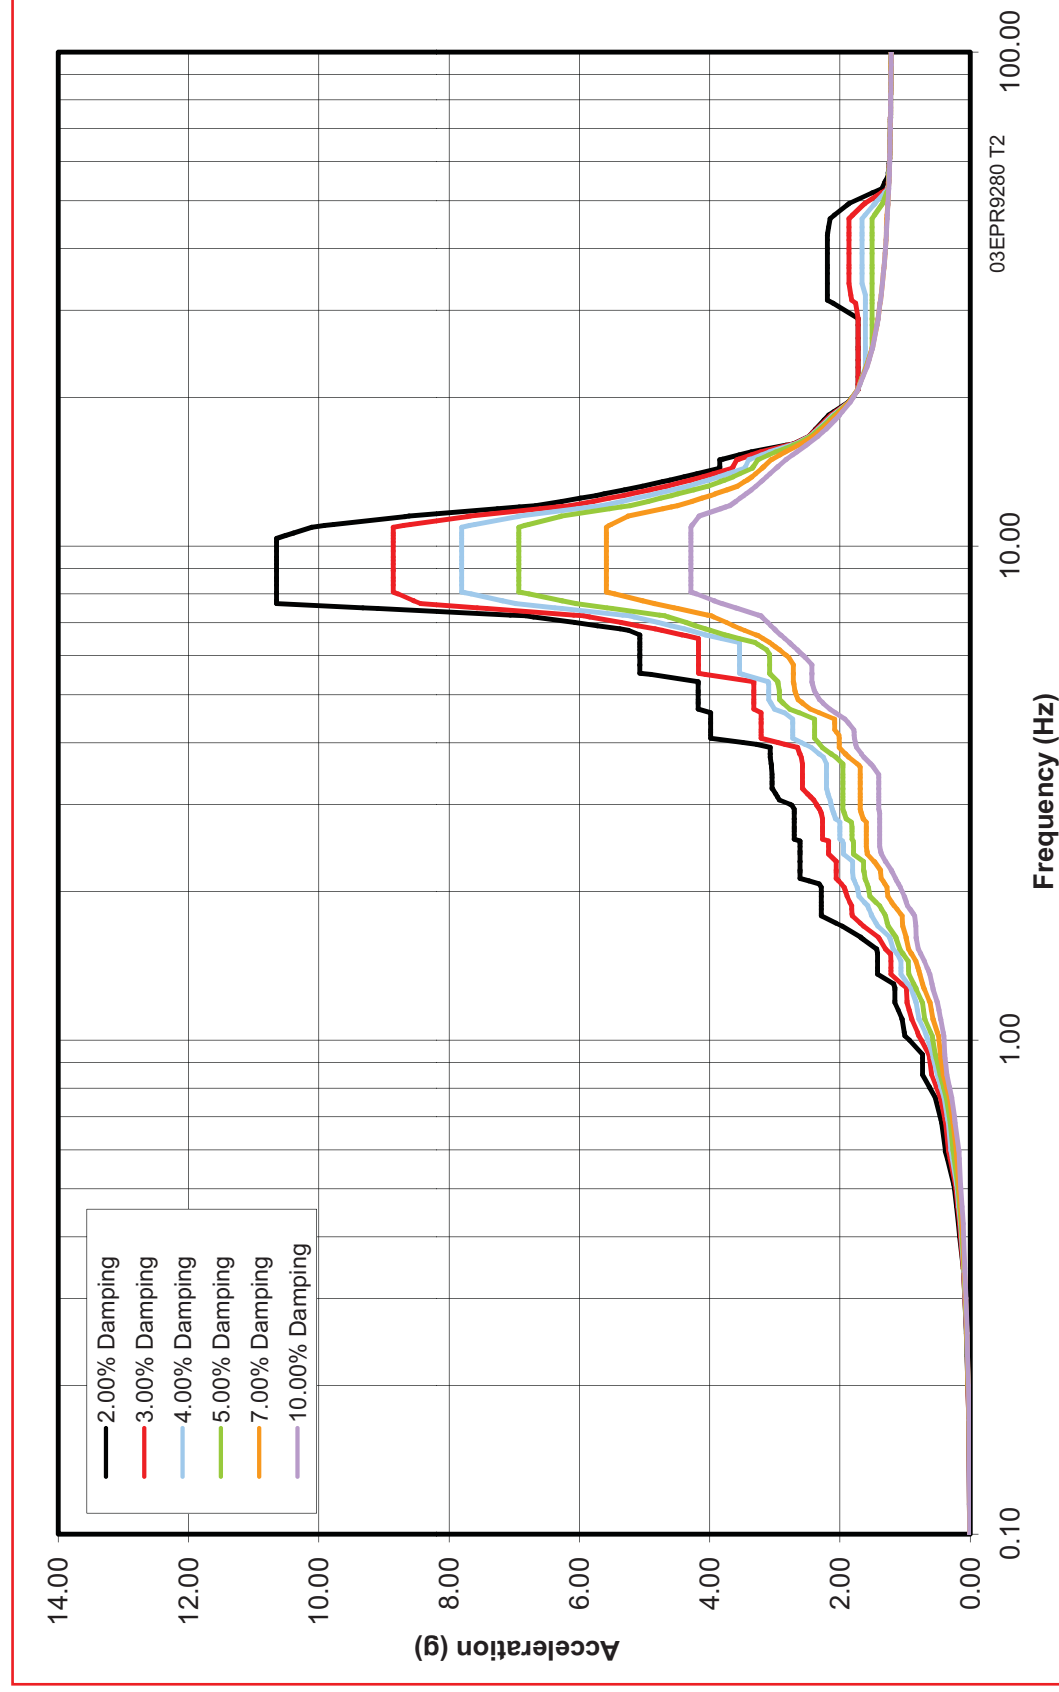




Figure 3.7.2-150—Spectrum Envelope of EPGB at Elev. +51 ft, 6 in - 2%, 3%, 4%, 5%, 7%, 7%, and 10% Damping, Z-Direction



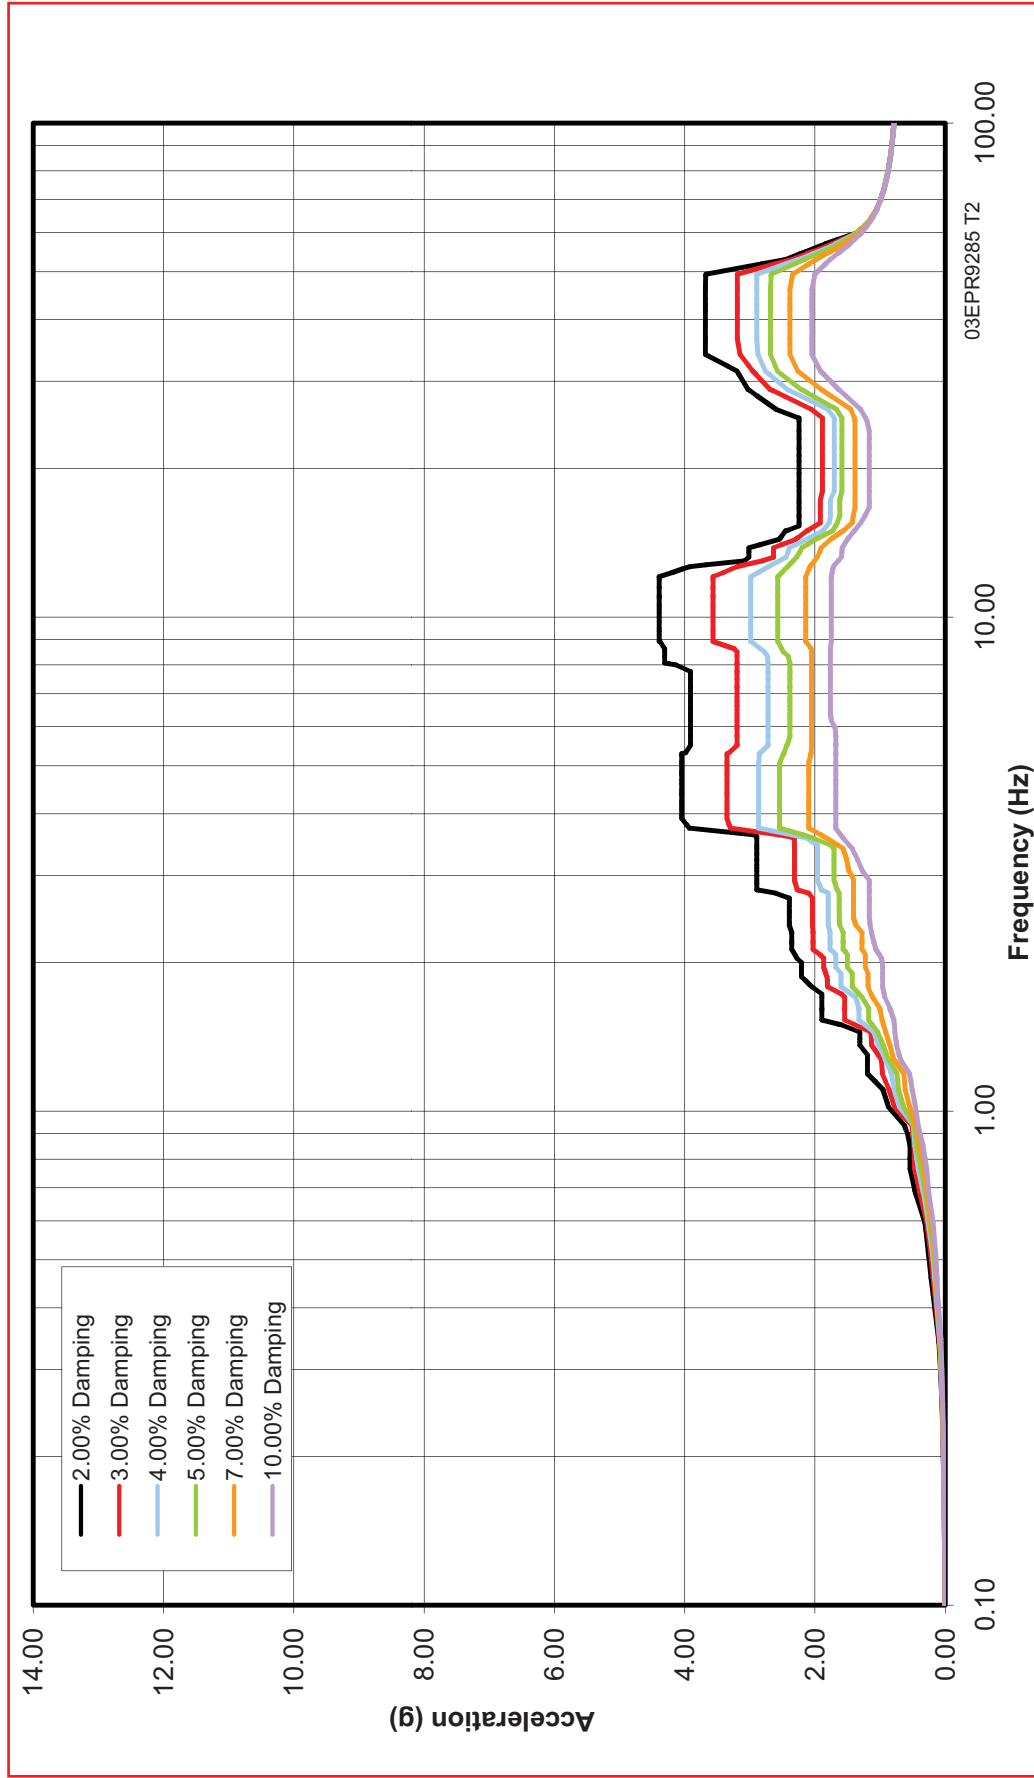

loads to the interior and exterior concrete shear walls. Lateral loads transfer to the soil subgrade by friction and passive earth pressure.

The reinforced concrete roof slabs and intermediate floor slabs are analyzed and designed as two-way slabs. Reinforced concrete walls are analyzed and designed as shear walls and compression members, which are also subjected to out-of-plane bending moments, torsion, and out-of-plane shear. Analysis and design of the NI Common Basemat Structure foundation basemat is addressed in Section 3.8.5.

~~The dynamic increment for the seismic soil surcharge loads on the exterior below-grade walls of NI Common Basemat Structure is determined by multiplying the surcharge static load by the maximum vertical zero period acceleration (ZPA) at the ground surface determined in the seismic analyses described in Section 3.7.2. Lateral pressure due to seismic loads for the below grade NI perimeter walls are obtained from an FEM SSI analysis. Seismic induced lateral soil pressures on below grade walls are evaluated for the following cases:~~

- ~~• The seismic soil pressure is equal to the sum of the static earth pressure plus the dynamic earth pressure calculated in accordance with ASCE 4-98, Section 3.5.3.2.~~
- ~~• The seismic soil pressure is equal to the passive earth pressure for structures other than NI common basemat structures.~~

The NI Common Basemat Structure is included in the ANSYS V10.0 SP1 finite element overall computer model of the NI Common Basemat Structure that is described in Section 3.8.1.4.1. The NI Common Basemat Structure model includes the RSB, FB, and SBs as well as the RCB, RB internal structures, and the NI Common Basemat Structure foundation basemat that are described in other sections. Boundary conditions for the ANSYS computer model and methods used for application of axisymmetric and non-axisymmetric loads, transient and localized loads, and other parameters used in the model are described in Section 3.8.1.4.

The NI Common Basemat Structure is modeled using a mesh of ANSYS finite elements representing primary load-carrying walls, floors, columns, and beams. Gaps are maintained between structures adjacent to Seismic Category I structures to allow for structural movements during seismic events, containment pressurization, missile strikes, aircraft impact, explosions, and other loading conditions. Exterior walls and roofs of the hardened SBs 2 and 3, RSB, and the FB are modeled to be independent of the internal structures, because there is no physical connection of internal walls and slabs in these structures with the outside walls and roof.

ANSYS SHELL43 solid shell elements are used to model walls and floors and other concrete elements in the NI Common Basemat Structure. SHELL43 is a three-dimensional, four-node shell element that is suitable for moderately thick shell structures. SHELL43 can also provide out-of-plane shear forces and has an elastic-



is primarily designed as a one-way slab due to the relative aspect ratio between the lines of support.

The EPGBs are analyzed and designed using a 3D ~~finite element model~~FEM representing the structure. The ~~finite element model~~FEM is generated using the GT STRUDL computer code to accomplish the following:

- Provide an accurate representation of the structure for translation to a soil structure interaction (SSI) model ~~(by SASSI 2000)~~ for seismic analysis (See Section 3.7.2 for information on the extrapolation of the GT STRUDL ~~finite element model~~FEM for the seismic analysis).
- Conduct a static analysis of the EPGBs using equivalent static seismic loads; and other applicable design loads.
- Provide input for the design of reinforced concrete structural elements.

The ~~finite element model~~FEM of the EPGBs consists of SBHQ6 and SBHT6 elements representing the load carrying reinforced concrete walls and slabs, as these element types are suitable for capturing both the in-plane and out-of-plane effects from the corresponding applied loads.

~~Compression only spring boundary conditions are utilized to represent the soil and accurately capture uplift effects in the foundation basemat design.~~ The EPGB is a surface-founded structure, with compression only spring boundary conditions utilized to represent the soil. Soil bearing pressures are determined from the SSI analysis.

For uniformity of site characteristics, the required bearing demand will be the same as for the NI.

The equivalent SSI model includes modifications to the stiffness of the various composite beams at elevation 51 feet, 6 inches, as well as modifications to account for cracking. The stiffness of these composite beams is included in the ~~SASSI 2000~~ model to capture out-of-plane response. Stiffness of the composite beams is not required in the static analysis model as only in-plane stresses in the concrete slab are determined.

For the composite beams and floor slab at elevation 51 feet, 6 inches, the corresponding floor accelerations from the SASSI analysis output are applied to tributary floor areas and walls to obtain the seismic loads associated with the out-of-plane loads. Dead load, live load, equipment loads, and piping loads are combined with the seismic loads. The composite beams are analyzed outside of the ~~finite element model~~FEM. Structural design of the composite beams is in accordance with the provisions of ANSI/AISC N690-1994 (R2004).

The in-plane and out-of-plane results from the GT STRUDL equivalent static analysis are extracted and used to design reinforced concrete shear walls and slabs according to



Horizontal shear loads are transferred from the NI Common Basemat Structure foundation basemat to the underlying soil by friction between the bottom of the basemat, mud mat (or both), and the soil, and by passive earth pressure on the below-grade walls of the NI Common Basemat Structure Seismic Category I structures. In addition, the tendon gallery is classified as a Seismic Category I structure and analyzed as a shear key to transfer loads to the soil. Section 2.5.4.2 describes the friction coefficient properties of soil addressed for the U.S. EPR.

Buildings adjacent to the NI Common Basemat Structure are separated from the NI Common Basemat Structure foundation basemat to allow for differential seismic movements between buildings. Refer to Figure 3B-1, which illustrates the gaps between buildings.

3.8.5.1.2 Emergency Power Generating Buildings Foundation Basemats

Each EPGB foundation basemat supports a building superstructure and associated equipment. At the super-structure and foundation basemat interface, heavily reinforced concrete shear walls function as bearing walls to transfer loads from floors and the roof. Each foundation basemat is embedded approximately five feet into the supporting soil and has overall dimensions of approximately 178 feet long by 94.5 feet wide by 6 feet thick. Each foundation also has a system of shear keys as shown in Figure 3B-63—Emergency Power Generating Buildings Dimensional Plan Elevation 0 m (0 ft). In the areas of the two diesel fuel oil storage tanks, the foundation basemat reduces in width from 94.5 feet to 42 feet.

Figure 3.8-89 illustrates the general arrangement plan, which also shows the primary shear walls at column lines A, C, E, G and J in the east-west direction, and column lines 11, 13, 17 and 19 in the north-south direction. Additional figures, provided in Appendix 3E, illustrate both the shear walls at the super-structure and foundation basemat interface and the foundation basemat reinforcement.

Figures 3.8-93 and 3.8-94 provide section views of the EPGB structure, which further clarify the relationship between the superstructure and the foundation basemat. Isometric views of the GT STRUDL model representing the overall structure are provided in Section 3.7.2.

3.8.5.1.3 Essential Service Water Buildings Foundation Basemats

The reinforced concrete foundation basemat for each ESWB supports the superstructure and water basin. At the super-structure and foundation basemat interface, heavily reinforced concrete shear walls function as bearing walls to transfer loads from the floors and the roof. Each foundation basemat is embedded approximately 21 feet into the supporting soil and has overall dimensions of approximately 164 feet by 108 feet wide by 6 feet thick.



- ESWBs foundation basemats.

3.8.5.4.1 General Procedures Applicable to Seismic Category I Foundations

Concrete foundation basemats for Seismic Category I structures are analyzed as flat slabs on elastic supports to represent the underlying soil. ~~The underlying soil medium is represented by FEM for SSI analyses for the NI and by soil springs for other Category I structures as described in subsequent sections.~~ Loads are applied to the foundation basemats by the interfacing reinforced concrete walls and structural steel columns that comprise the building structures being supported, as well as by equipment supported directly on the foundations. Intersecting concrete walls also serve to stiffen the foundation basemat slabs to increase resistance to bending moments resulting from soil pressures under the slabs. Foundations are analyzed for the various factored loads and load combinations identified in Section 3.8.5.3.

Seismic Category I foundation basemat structures transfer vertical loads from the buildings to the subgrade by direct bearing of the basemats on the subgrade. Horizontal shears, such as those produced by wind, tornados, and earthquakes are transferred to the subgrade by friction along the bottom of the foundation basemat, shear key, or by passive earth pressure.

The stability evaluations for the NI, EPGB, and ESWB are based on SSI analysis results, as described in Section 3.7.2.3. The coefficient of passive soil pressure corresponding to the sidewall movements into the soil are estimated from the SSI analysis and are used to calculate the passive soil pressure resisting sidewall movement.

Passive soil pressure capacities are based on constitutive models, typically used for granular media, such as Drucker-Prager or Coulomb-Mohr. For soil sites, a granular backfill material is used against side walls and underneath the structures, if needed. Backfill shall be installed to meet 95 percent of the Modified Proctor density (ASTM D-1557). For rock sites, controlled low strength material, as described by ACI-229R, is specified on the faces of below grade walls. The tendon gallery acting as a shear key is backfilled with lean concrete. Cohesive materials will be addressed on a site-specific basis.

The wall pressures calculated from SSI analysis, elastic solution by Wood, and those required for sliding stability are considered in the design of embedded walls. Each soil case is analyzed, dynamically and statically, and design loads and controlling loads for each wall are used in the design.

The estimated maximum sidewall movement into the soil that results in the highest K_p value may not necessarily occur when the minimum factor of safety is calculated. Therefore, the minimum factor of safety is investigated using appropriate sidewall movements (using corresponding K_p) at the time of minimum sliding factor of safety.



Design and analysis procedures for Seismic Category I foundations are the same as those described in Sections 3.8.1.4 and 3.8.4.4 for the respective structures that apply loads on the foundations.

Seismic Category I concrete foundations are designed in accordance with ACI 349-01 and its appendices (GDC 1). Exceptions to code requirements specified in RG 1.142 are incorporated into the design and are accommodated in the loading combinations described in Section 3.8.5.3. In addition, the portion of the NI Common Basemat Structure foundation basemat that supports the RCB/RSB is designed in accordance with the ASME Code–2004 Edition, Section III, Division 2 for support and anchorage of the concrete RCB as described in Section 3.8.1.

The design of concrete foundations for Seismic Category I structures is performed using the strength-design methods described in ACI 349-01. The ductility provisions of ACI 349-01 are satisfied to provide a steel reinforcing failure mode and to prevent concrete failure for design basis loadings.

Foundation design is performed for the spectrum of soil cases described in Section 3.7.1. Section 2.5 and Section 3.7 describe seismic parameters and design methods used for analyzing and designing Seismic Category I structures.

Soil-structure interaction and structure-soil-structure interaction effects are considered in the seismic analyses of Seismic Category I structures as described in Section 3.7.2. Figure 3B-1 illustrates separation distances between Seismic Category I structures upon which these interaction evaluations are based.

Dynamic bearing pressures are obtained from the SASSI analysis. Dynamic bearing pressures are calculated at each time step in the x and y input motion to satisfy the equilibrium of vertical forces and moments as a result of dead, live, buoyancy, precipitation, and seismic loads acting on the foundation for each soil case. Dead load pressures account for the deformation effect at the center and/or edges of the basemat.

The NI Common Basemat Structure and EPGB are is designed for an average the static soil bearing pressures of 14,500 pounds per square foot and a dynamic maximum static bearing pressures of 34,560 pounds per square foot in Sections 3.8.5.5.1 and 3.8.5.5.2. Accordingly, Seismic Category I foundations are sized and reinforced to accommodate these bearing pressure values.

The following criteria apply for load combinations for concrete and steel Seismic Category I foundations:

- Where any load reduces the effects of other loads, the corresponding coefficient for that load is 0.9 if it can be demonstrated that the load is always present or occurs simultaneously with other loads.



3.8.5.4.3 Emergency Power Generating Buildings Foundation Basemats

~~Horizontal shear~~ **Shear** loads are transferred from the EPGB foundation basemat to the underlying soil by friction between the bottom of the basemat, mud mat, and the soil, and by passive earth pressure.

The EPGB foundation basemat is analyzed and designed using the GT STRUDL v.29.1 finite element analysis code. The ~~finite element model~~ **FEM** contains both the building superstructure (i.e., reinforced concrete walls and elevated slabs) as well as the foundation basemat. Analysis of the EPGB includes all applicable design loads and design load combinations described in Section 3.8.4.3. Figure 3.8-104—Emergency Power Generating Building Foundation Basemat Model illustrates the foundation basemat portion of the overall EPGB ~~finite element model~~ **FEM**.

The GT STRUDL ~~finite element model~~ **FEM** representing the EPGB foundation basemat consists of SBHQ6 rectangular elements, each with six degrees of freedom. This element type is capable of capturing both in-plane and out-of-plane behavior. Elastic boundary conditions are included in the ~~finite element model~~ **FEM** in order to simulate the stiffness of the supporting soil. Basemat flexibility and SSI are addressed by inclusion of the basemat section properties and aforementioned soil spring boundary conditions in the ~~finite element model~~ **FEM**.

The foundation basemat is included in the overall GT STRUDL ~~finite element model~~ **FEM** used for static analysis of the foundation basemat, along with compression-only soil springs representing static soil stiffness properties ~~of soft, medium and hard soils~~ in Table 3.8-19. Soil spring development and distribution methodologies are the same as those used for the NI soil cases and are described in Section 3.8.5.4.2.

Compression-only effects are included in the boundary conditions in order to capture uplift effects induced by extreme event loading (e.g., SSE). Illustrations of the complete ~~finite element model~~ **FEM** representing the EPGB are provided in Section 3.7.2.

The effect of settlement on the EPGB considers a soft soil site consistent with a soft soil case as shown in Table 3.7.1-6. Soil springs are developed to consider both short term (elastic) and long term (heave and consolidation) effects. The 3D finite element models of the EPGB basemat and superstructure are used in a static structural analysis with elastic soil springs applied in an elliptical distribution. The consolidation effects are approximated by further softening the elastic soil spring stiffness by a factor of two. A settlement load file is created considering 100 percent of the dead load, 25 percent of the live load, and 75 percent of the precipitation loads to determine locked-in forces and moments for all structural elements. The full E_c and section modulus is used in the EPGB settlement analysis. A check is conducted to determine if the basemat concrete has cracked during development of the load file. If the basemat concrete has cracked, a cracked section modulus is used to develop the forces and moments. The



For worst-case loading combinations on the NI Common Basemat Structure foundation basemat, the time history methodology used to calculate sliding and uplift safety factors due to seismic loadings is described in Section 3.8.5.4.2. The calculated values meet the requirements of Table 3.8-11.

For worst-case loading combinations on the RB internal structures basemat above the containment liner, the minimum safety factor against sliding is 2.8 and the 0.16 occurring for soil case 2sn4u, based solely on friction between the liner and the supporting concrete. Because friction will not prevent sliding, the surrounding concrete haunch wall is designed with sufficient capacity to resist the total base shear force. The minimum safety factor against overturning is 1.91.22 occurring for soil case 2sn4u.

3.8.5.5.2 Emergency Power Generating Buildings Foundation Basemats

Appendix 3E provides details of the design of the EPGB foundation basemats critical sections.

The minimum static and dynamic bearing demand for the EPGB foundation basemat will be provided. Maximum soil bearing pressures under the EPGB foundation basemat are 3,800 pounds per square foot for static loading conditions, and 10,800 pounds per square foot for dynamic loading conditions. The factors of safety against overturning, sliding, and flotation are each greater than or equal to 1.1.

A differential settlement evaluation is performed for the EPGB structure considering both short term (elastic) and long term (heave and consolidation) effects.

A COL applicant that references the U.S. EPR design certification will compare the EPGB site-specific predicted angular distortion to the angular distortion in the total differential settlement contours in Figure 3.8-135, using methods described in U.S. Army Engineering Manual 1110-1-1904. The comparison is made throughout the basemat in both the east-west and north-south directions. If the predicted angular distortion of the basemat of EPGB structures is less than the angular distortion shown, the site is considered acceptable. Otherwise, further analysis will be required to demonstrate that the structural design is adequate.

3.8.5.5.3 Essential Service Water Building Foundation Basemats

Appendix 3E provides details of the design of the ESWB foundation basemats critical sections.

Maximum soil bearing pressures under the ESWB foundation basemat are 17,800 pounds per square foot for static loading conditions, and 28,200 pounds per square foot for dynamic loading conditions. For uniformity of site characteristics, the required

Table 3.8-19—Static Foundation Modulus Values for EPGB Soil Cases

<u>Soil Case</u>	<u>K_o (k/ft³)</u>	<u>Springs and Distribution</u>	<u>Min/Max Springs</u>
		<u>Distribution (b=l=88 ft)</u>	
<u>4ue</u>	<u>894</u>	$K(x,y) = K_o \left[5.69 - 4.94 \sqrt{1 - \frac{x^2}{2l^2} - \frac{y^2}{2b^2}} \right]$	<u>0.75 K_o, 2.29 K_o</u>
<u>5ae</u>	<u>12175</u>	$K(x,y) = K_o \left[4.93 - 4.14 \sqrt{1 - \frac{x^2}{2l^2} - \frac{y^2}{2b^2}} \right]$	<u>0.79 K_o, 2.08 K_o</u>
<u>1n5ae</u>	<u>3044</u>	$K(x,y) = K_o \left[5.31 - 4.54 \sqrt{1 - \frac{x^2}{2l^2} - \frac{y^2}{2b^2}} \right]$	<u>0.77 K_o, 2.18 K_o</u>
<u>1n2ue</u>	<u>89</u>	$K(x,y) = K_o \left[5.27 - 4.49 \sqrt{1 - \frac{x^2}{2l^2} - \frac{y^2}{2b^2}} \right]$	<u>0.78 K_o, 2.18 K_o</u>
<u>2sn4ue</u>	<u>359</u>	$K(x,y) = K_o \left[4.58 - 3.77 \sqrt{1 - \frac{x^2}{2l^2} - \frac{y^2}{2b^2}} \right]$	<u>0.81 K_o, 1.98 K_o</u>
<u>34EPGB-UB</u>	<u>149</u>	$K(x,y) = K_o \left[4.83 - 4.03 \sqrt{1 - \frac{x^2}{2l^2} - \frac{y^2}{2b^2}} \right]$	<u>0.8 K_o, 2.05 K_o</u>
<u>12EPGB-UB</u> ¹	<u>370</u>	$K(x,y) = K_o \left[2.60 - 1.69 \sqrt{1 - \frac{x^2}{2l^2} - \frac{y^2}{2b^2}} \right]$	<u>0.91 K_o, 1.44 K_o</u>

Note:

- Soil profile does not consider concrete fill on top of the rock for static foundation modulus.



Indicated changes are in response to RAI 376, Supplement 25, Question 03.08.05-31

Figure 3.8-93—Emergency Power Generating Buildings Section A-A



Indicated changes are in response to RAI 376, Supplement 25, Question 03.08.05-31

Figure 3.8-94—Emergency Power Generating Buildings Section B-B



Foundation Stability

The EPGB is evaluated for stability against overturning, sliding, and floatation for the generic soil profiles used in establishing the certified plant design. Shear keys in the form of grade beams around the periphery of the building and in the middle of the building are used to ~~ensure~~enhance stability. The calculated factors of safety against overturning, sliding and floatation satisfy the acceptance criteria.

Minimum Factors of Safety					
Sliding		Overturning		Floatation	
Required	Calculated	Required	Calculated	Required	Calculated
1.10	1.10	1.10	61.9 <u>1.1</u>	1.10	8.50 <u>8.6</u>

The sliding and overturning factors are determined using load combination containing dead load (D), lateral earth pressure (H), SSE (E'), hydrostatic load (F), and buoyant force (F_b). The floatation factor of safety is determined based on dead load (D) and buoyant force (F_b). The factor of safety against overturning is determined using energy method.

For uniformity of site characteristics, the required bearing pressures will be the same as the NI.

~~The maximum dynamic pressure is 6966 psf and the average static pressure is 2712 psf.~~

Design Criteria

SSI analysis ~~by the Beechtel Code SASSI 2000 (v. 3.1)~~using MTR/SASSI is used to determine enveloping structural response accelerations for development of equivalent static SSE loads for the GT STRUDL FEM.

The use of GT STRUDL for the design of the critical sections is described in Sections 3.8.4.4.3 and Sections 3.8.5.4.3. Design forces and moments are extracted from GT STRUDL analyses for basemat foundation and superstructure component design.

All applicable loads used for the design of the critical sections located within the EPGBs are described in Sections 3.8.4.3.1 and 3.8.5.3; the applicable loading combinations are described in Sections 3.8.4.3.2 and 3.8.5.3. The design also accommodates the soil analysis cases shown in Table 3.7.1-6.

Reinforced concrete and structural steel components (including composite beams) are designed in accordance with the applicable codes, standards, and specifications described in Sections 3.8.4.2 and 3.8.5.2.