



R0090279

HIGH-LEVEL WASTE ENGINEERING
CONCENTRATION, STORAGE,
AND TRANSFER

WSRC-TR-97-0066
REVISION: Revision 1

KEYWORDS:
Waste Characterization, Tank
Farms, Closure, Tank 17

CLASSIFICATION: U
Does not contain UCNI

Paul D. d'Entremont
ADC/RO

Characterization of Tank 17 Residual Waste

BY

P. D. d'ENTREMONT
J. R. HESTER
T. B. CALDWELL

22 September 1997

Paul D. d'Entremont
P. D. d'Entremont, Author, CSTE

Date: 22 Sep 97

James Robert Hester
J. R. Hester, Author, CSTE

Date: 9/22/97

T. B. Caldwell
T. B. Caldwell, Author, CSTE

Date: 9/22/97

M. S. Hay / per telephone
M. S. Hay, Technical Reviewer, SRTC-IWT

Date: 10/31/97

Michael G. Chandler
M. G. Chandler, Manager, CST Engineering Support

Date: 11/3/97

B. L. Lewis
B. L. Lewis, Manager, CST Engineering Support

Date: 11/7/97

T. M. Monahon
T. M. Monahon, Manager, CST Engineering

Date: 11/18/97

Table of Contents

1. Introduction	3
2. Summary	3
3. Background	4
4. Waste Removal in Preparation for Tank Closure	4
4.1 Supernate Removal	5
4.2 Sludge Removal	5
5. Estimating the Mass of Residual Waste	6
5.1 Lifting Plates	7
5.2 Estimating Sludge Volume	9
5.2.1 Solids	9
5.2.2 Cement-like Solids	12
5.2.3 Redistribution with the "Water Mouse"	15
5.2.4 Sludge and Grout Interaction	17
6. Waste Composition and Inventory	17
6.1 Process Knowledge Estimates	17
6.1.1 Chemical Contaminants	18
6.1.2 Radionuclides	18
6.1.3 Tc-99	19
6.2 Samples	20
6.3 Estimated Inventories	21
6.3.1 Radionuclide Inventories	24
6.3.2 Class C Calculation	25
6.3.3 Chemical Inventories	25
6.4 Other Contaminants	26
7. Acronym List	26
8. References	27

1. Introduction

Plans are to close Tank 17, a type IV waste tank in the F-area Tank Farm, by filling it with pumpable backfills. Most of the waste was removed from the tank in the late 1980s, and the remainder of the waste was removed in a short spray washing campaign that began on 11 April 1997. More details on the planned closure can be found in the Closure Plan for the High-Level Waste (HLW) Tanks¹ and the specific closure module for Tank 17.²

To show that closure of the tank is environmentally sound, a performance evaluation has been performed for Tank 17.² The performance evaluation projected the concentration of contaminants at various locations and times after closure. This report documents the basis for the inventories of contaminants that were used in the Tank 17 performance evaluation.

2. Summary

Inspections of Tank 17 show that most of the tank is covered by a thin layer of brown silty solids. Dispersed throughout this layer of brown solids are some light gray flakes that appear to be cement-like debris from the tank ceiling. The total volume of these solids in the tank was estimated to be approximately 2400 gallons, equivalent to about 4700 pounds of dried solids. About 200 gallons of the solids are estimated to be cement-like solids, so the volume of high-level waste sludge is estimated to be 2200 gallons.

The composition of the brown silty solids has been estimated by two means: 1) predictions based on the knowledge that the material entering the tank was Purex Low-Heat Waste, and 2) two samples. The samples showed that the predictions based on process knowledge were reasonable, although a few adjustments were in order. Concentration, Storage, and Transfer Engineering (CSTE) recommends that the process knowledge estimates of the inventory be used for all contaminants except for Tc-99 and the plutonium isotopes. For these radionuclides, the inventory estimates should be raised to reflect what was learned from sample results on Tank 17, and also Tank 20,³ the first HLW tank to be closed at SRS.

The recommended inventories to be assumed for modeling purposes in Tank 17 are shown in Tables 1 and 2 at the end of the report.

The contaminants reported in Tables 1 and 2 are contained in the waste, which is primarily on the bottom of the tank. In addition, the risers on the top of the tank each

contain lead. Based on the design basis drawings, a reasonable estimate is 500 pounds per riser, or 3000 pounds (1400 kg) of lead for the whole tank. Also, we recommend that an amount of waste be assumed to be outside of the tank to account for spills and other contaminated equipment in the Tank 17-20 area, such as the 1F Evaporator and the Concentrate Transfer System (CTS) pump tank. An allowance of 20% of the tank inventory in these four tanks should be sufficient to bound contributions from the other sources.

3. Background

Tank 17 is a type IV waste tank in the F-area Tank Farm. The tank is an underground carbon steel waste tank, 85 feet in diameter, and has a working capacity of 1.3 million gallons. While in service, Tank 17 received both sludge and salt, which is unusual for HLW Tanks. Sludge and salt are normally segregated into different tanks. There are only a handful of tanks in the tank farm that contain both sludge and salt.

Most of the waste was removed from Tank 17 in a waste removal campaign between December 1983 and June 1985.⁴ During the campaign, slurry pumps were used to agitate the tank, and the waste was pumped from the tank using a telescoping transfer pump. Following bulk waste removal, the tank was spray washed in October 1985 using rotary spray jets. The purpose of the spray washing campaign was to remove residual waste on the tank roof and walls, and to remove more of the residual from the tank floor. After spray washing, the residual sludge in the tank was estimated to be about 2000 gallons, although it was recognized that this estimate was highly uncertain because the tank had at least 3 inches of liquid, equivalent to about 10,000 gallons (The sludge estimate following spray washing in 1985 was later shown to be much too low--see below).

In 1992, 112,000 gallons of water with high levels of tritium contamination were transferred into Tank 17 from K area. This was a one-time transfer of liquid contaminated with reactor moderator following a K-area moderator leak. Calculations indicate that the transferred water contained 5,950 Ci of tritium.⁵ As a result of this addition, the concentration of tritium in Tank 17 in 1994 was estimated to be 0.02 Ci/gal, the highest of any HLW tank.⁶

4. Waste Removal in Preparation for Tank Closure

To prepare the tank for closure, the waste first had to be removed. This was done in two steps: supernate removal and sludge removal.

4.1 Supernate Removal

The first step of waste removal was to pump the 279,000 gallons of supernate from Tank 17 to Tank 6. The supernate had to be managed carefully because of its high tritium concentration. For example, if the supernate were simply pumped to an evaporator feed tank, much of the 5,950 Ci of tritium would end up in evaporator overheads and would be released to the river. This could have exceeded release guides.

Therefore, it was decided that the best way to manage the tritium was to store it in tanks in which waste removal is not planned for some time. This method of management gives the tritium an opportunity to decay. Also, because the tritium inventory needs to be managed, it is desirable to send all of the supernate to a single waste tank to minimize the number of tanks that need to be managed.

Tank 6 was chosen as the best tank for storing the waste supernate, based on considerations of tank integrity, available space, and logistics of accomplishing the transfer.⁷ Calculations showed that as long as most of the tritium in Tank 17 was transferred to Tank 6 leaving no more than 2 inches of supernate in Tank 17, the residual tritium in tank 17 would pose no risk of exceeding release criteria and could be transferred into the rest of the tank farm with no restrictions.⁸ The transfer was accomplished using an electrical sump pump and an above ground flexible transfer line encased in a secondary flexible transfer line (to provide secondary containment and leak detection). Before starting the transfer, three submersible Flygt™ mixers (one 15 HP mixer and two 4 HP mixers) were installed in the tank. The purpose of the mixers was to stir up the supernate so that some sludge would be removed during the transfer. The transfer occurred in early March 1997.

4.2 Sludge Removal

After the supernate was removed from Tank 17, photographs of the tank interior taken on 8 March 1997 showed that the sludge inventory in the tank was greatly in excess of the previously estimated 2,000 gallons. The actual volume was difficult to estimate from the photographs because the top of the sludge was relatively featureless, and virtually all of the tank features that could be used to gauge the depth (such as the lifting plates described below) were completely covered by the sludge. However, the appearance of the sludge, combined with observations made during spray washing, suggested that the inventory might have been as high as 10,000 gallons.

No effort was expended to improve this estimate because there was sufficient information to decide that the sludge needed to be removed. Efforts on Tank 17 immediately focused on removing the sludge.

Sludge removal from Tank 17 was accomplished using a water monitor and an air-operated double-diaphragm pump. The water monitor was an Akron Brass™ water monitor, which is a remotely operated fire hose nozzle intended for fighting fires on tall buildings. The monitor was mounted on a plate designed especially for Tank 17 and installed upside down in the northwest riser of the Tank. From this position, the water monitor could spray any part of the tank with about 150 gallons of water per minute and could be remotely operated from above the tank.

The pump used to pump the sludge from the tank was a Wilden™ air-operated double-diaphragm pump, Model M-8. The pump was installed in the southwest riser of Tank 17. During the course of the spray washing a total of three Wilden™ pumps were installed in the tank because two of the pumps plugged with sludge and could not be unplugged. The last pump to be installed incorporated several extra flushing capabilities that prevented the blockages that incapacitated the first two pumps.

This combination of water monitor and sump pump was found to be effective at removing most of the sludge from the tank. However, as would be expected, the efficiency of the tools declined as the volume of sludge in the tank became smaller.

The high amount of water required to remove small volumes of sludge is probably due to the fact that sludge removal from Tank 17 began when the volume of sludge was only 10,000 gallons, which is less than 1% of the volume of the tank. Calculations done at the Army Corps of Engineers Waterways Experiment Station indicate that it should be possible to remove deep sludge from a waste tank with only 3-5 gallons of water sprayed for each gallon of sludge removed.⁹ In deep sludge, the spraying forms a dendridic drainage pattern, similar to the drainage pattern formed by a large river. Such a pattern will efficiently move soil.

However, at low levels in the tank the dendridic pattern breaks down because the channels cut by the flowing water meet the steel bottom of the tank and can cut no deeper into the sludge. Thus, the steepness of the channels decreases, and the amount of water required to remove sludge increases. As the amount of sludge decreases, it must literally be pushed by the water monitor toward the sump pump. Most of the sludge removal from Tank 17 was accomplished in this "pushing" mode.

5. Estimating the Mass of Residual Waste

Estimating the inventory of contaminants in Tank 17 required estimating 1) the mass of residual waste in the tank and 2) the concentration of contaminants in this waste. This

section discusses the mass estimates. Section 6 discusses waste concentration estimates and inventories.

Video inspections of Tank 17 after spray washing revealed that most of the tank contained water, perhaps an inch or two deep. Because of the large amount of water sprayed into the tank and removed by the Wilden™ pump (more than 200,000 gallons), any readily soluble components should have been flushed from the tank, and the residual water should not contain significant contaminants. For this reason, the contaminants in the water layer were neglected in computing the tank inventory.

Underneath the liquid were precipitated solids left after waste removal. These solids consisted mostly of brown, silty solids, similar to Purex sludge. Dispersed throughout the brown solids were thin flakes of hard material that appear to be cement-like solids. (See section 5.2.2, "Cement-like Solids.")

The sections that follow describe the method of determining the volumes of precipitated solids in the tank.

5.1 Lifting Plates


The depth of the sludge over much the floor of Tank 17 was estimated by observing the sludge relative to lifting plates that were placed on the tank floor during construction. The purpose of the lifting plates was to allow the plates forming the floor of the tank to be butt-welded from both sides during construction. The procedure for constructing the tank bottom was as follows:

- The steel plates that formed the tank floor were placed on top of the concrete pad, the top half of all welds was completed, and the lifting plates with lugs were welded into place.
- Using a lifting frame (Print W164197, 2/16/56), the tank floor was lifted off the ground.
- The bottom half of each weld was completed by welders crawling underneath the lifted plates.
- The tank floor was lowered to the concrete pad, and the lifting lugs were ground off.

Although the lifting lugs were removed, the lifting plates were left in place to avoid the possibility of damage to the tank floor, which could have occurred if the lifting plates had been ground off. Thus, the lifting plates now provide convenient "depth gauges" for estimating the depth of solids on parts of the floor where the sludge depth is shallow. Figure 1 shows the arrangement of lifting plates in Tank 17.

Figure 1. Tank 17 Top and Floor

Note: Lifting Plates are not all oriented with the edges aligned north-south east-west

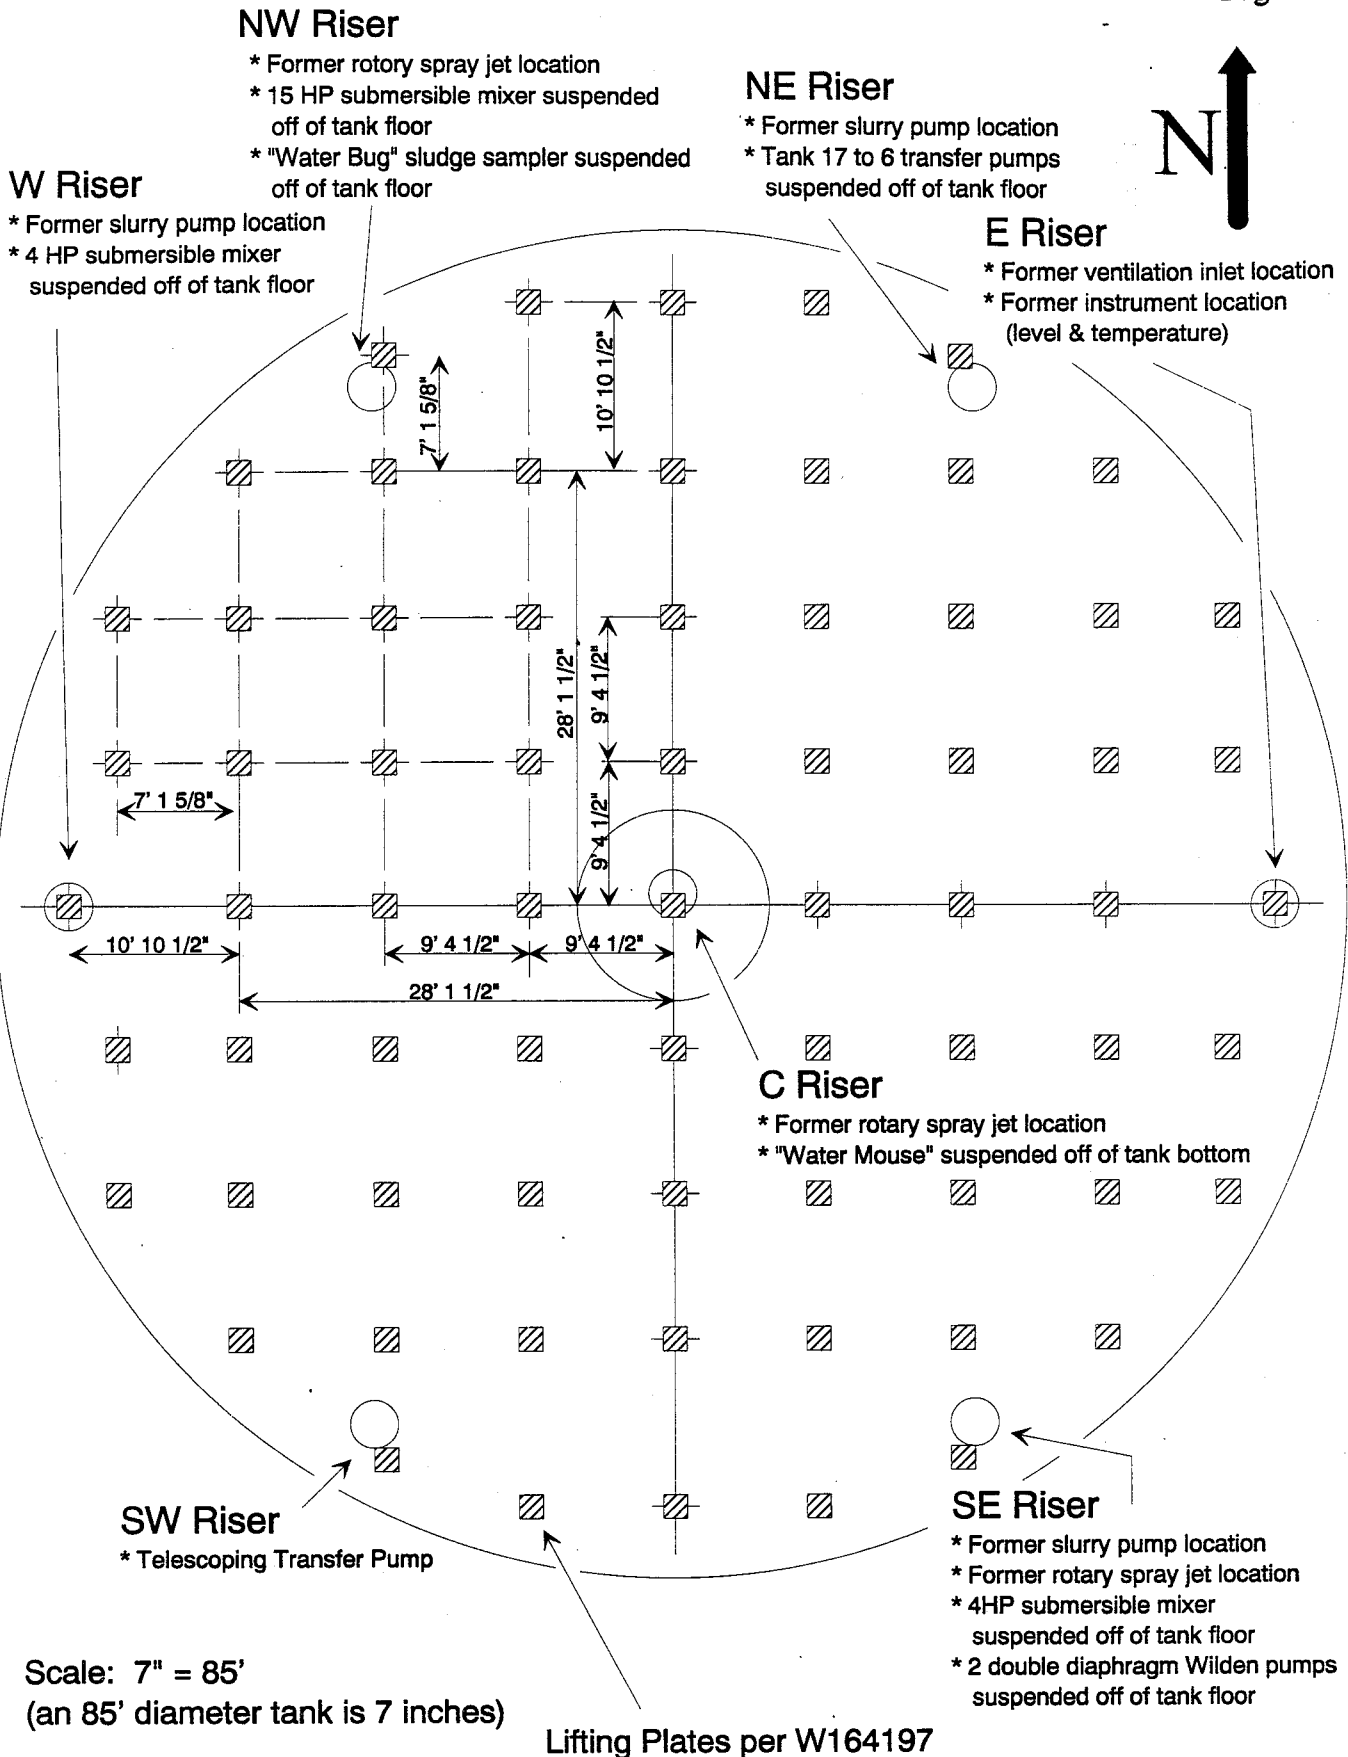

Print W164197 indicates that there are 69 lifting plates on the floor of Tank 17. The print indicates that each lifting plate is square, 12 by 12 inches, 3/8 inches high, and has a 1/4-inch weld bead around its perimeter. The print also instructs the fabricators to make the lifting plates from 1/2-inch plate, which does not agree with the height of 3/8 inch shown for the finished plate. This appears to be an error, but it is possible that the instruction to use a 1/2-inch plate was followed during fabrication, so the plates might actually be 1/2 inch high rather than 3/8 inch high. For the purposes of sludge estimation in Tank 17, it was assumed that the plates are 1/2 inch high because this produces a conservatively high estimate.

The plates that are visible in Tank 17 all appear to be at the locations shown in the print, but the plates are not all oriented with their edges north-south and east-west. Instead, the plates appear to be oriented at somewhat random orientations, indicating no particular care in their orientation when they were welded to the tank floor. The print specifies only the location of the plates, not the orientation, so the placement of the plates appears to satisfy the print. The random orientation of the plates in Tank 17 was surprising because the plates in Tank 20 had been found to be oriented north-south and east-west.³ In this report we have made no attempt to record the specific orientation of each plate because it is not important in assessing the volume of sludge.

5.2 Estimating Sludge Volume

The depth of solids at each point in the tank was estimated from video inspections of the tank floor.

The estimated solids volume is 2400 gallons, as described in the next section. Two hundred gallons of these solids are estimated to be inert, leaving 2200 gallons of actual sludge.

5.2.1 Solids

The estimated solids volume of the tank was based on a video inspection on 11 July 1997. In this inspection, the depth of sludge over each of the 69 lifting plates was estimated. In spots where the solids depth was equal to or less than 1/2 inch, so the lifting plates were visible, the solids depth was estimated relative to the lifting plates. In spots where the solids were higher than 1/2 inch (so the plates were not visible), the depth was estimated from other known dimensions, such as the Wilden™ pump, the three submersible mixers, and the knowledge that the knuckle plate along the edge of the tank floor has a radius of 12 inches. At the time of the 11 July inspection, most of the sludge was located near the edge of the tank, which contained many objects of

known dimensions, so reasonably good estimates could be made of the sludge depth in each spot.

Figure 2 shows the estimated depths at each spot in the tank. It should be noted that the solids have been moved using the water monitor and the "water mouse" (see section 5.2.3, Redistribution with the "Water Mouse") since the time of this inspection. Thus, the solids location at the time of closure will be different from Figure 2, but the volume of solids is the same because no solids have been added to the tank, and the amount removed is negligible.

For the purposes of estimating the volume of solids, it was assumed that the region of the tank closest to each lifting plate was uniformly covered with solids at the same depth as the depth estimated at the plate. The volume of solids in each region was computed by multiplying the region's area by the estimated depth. Of course, the depth in each region was not actually uniform, but this method essentially averages the errors by statistically "sampling" the depth at 69 points distributed in pre-selected locations throughout the tank.

Figure 2 shows the volume of sludge (in gallons) that was estimated in each of the 69 regions. The appendix describes the calculation of the area of each region. As mentioned previously, the total volume of solids was estimated to be 2400 gallons.

Previous studies have demonstrated that there are approximately 1.95 pounds of dry sludge solids per gallons of settled sludge.¹⁰ The density of the solids in the bottom of Tank 17 is not known, but it is expected that the density of a thin layer of solids left after waste removal should be less than deep sludge in a waste tank, which is compacted due to compressive settling. Therefore, 1.95 pounds of dry sludge solids per gallon is probably a reasonable upper bound for the solids density in Tank 17. This is equivalent to an estimated 4700 pounds of dry solids in Tank 17.

Figure 2. Type IV Tank Residual Heel Estimate

TANK NO. **17F**

DATE 7/11/97

TIME 0930

				NW13 1.000 in. 46.36 gal	N04 1.000 in. 47.46 gal	NE13 1.000 in. 46.36 gal	NE12 1.000 in. 34.89 gal		
		NW12 1.000 in. 34.89 gal							
	NW11 1.000 in. 43.14 gal	NW10 0.375 in. 18.05 gal	NW09 0.125 in. 6.88 gal	N03 0.125 in. 6.85 gal	NE09 0.125 in. 6.88 gal	NE10 0.125 in. 6.02 gal	NE11 0.375 in. 16.18 gal		
NW08 1.000 in. 35.06 gal	NW07 0.125 in. 6.47 gal	NW06 0.000 in. 0.00 gal	NW05 0.125 in. 6.83 gal	N02 0.000 in. 0.00 gal	NE05 0.125 in. 6.83 gal	NE06 0.000 in. 0.00 gal	NE07 1.000 in. 51.77 gal	NE08 2.000 in. 70.11 gal	
NW04 1.000 in. 52.43 gal	NW03 0.125 in. 5.56 gal	NW02 0.125 in. 6.83 gal	NW01 0.125 in. 6.83 gal	N01 0.125 in. 6.83 gal	NE01 0.000 in. 0.00 gal	NE02 0.125 in. 6.83 gal	NE03 0.375 in. 16.68 gal	NE04 2.000 in. 104.85 gal	
W04 0.375 in. 20.58 gal	W03 0.125 in. 8.61 gal	W02 0.000 in. 0.00 gal	W01 0.000 in. 0.00 gal	C01 0.000 in. 0.00 gal	E01 0.125 in. 6.83 gal	E02 0.000 in. 0.00 gal	E03 0.125 in. 8.61 gal	E04 2.000 in. 109.76 gal	
SW04 1.000 in. 52.43 gal	SW03 0.125 in. 5.56 gal	SW02 0.125 in. 6.83 gal	SW01 0.125 in. 6.83 gal	S01 0.125 in. 6.83 gal	SE01 0.125 in. 6.83 gal	SE02 0.125 in. 6.83 gal	SE03 0.500 in. 22.24 gal	SE04 3.000 in. 157.28 gal	
SW08 1.000 in. 35.06 gal	SW07 0.500 in. 25.89 gal	SW06 0.125 in. 6.83 gal	SW05 0.250 in. 13.66 gal	S02 0.125 in. 6.83 gal	SE05 0.500 in. 27.33 gal	SE06 0.250 in. 13.66 gal	SE07 3.000 in. 155.32 gal	SE08 4.000 in. 140.23 gal	
	SW11 1.000 in. 43.14 gal	SW10 1.000 in. 48.12 gal	SW09 1.000 in. 55.03 gal	S03 1.000 in. 54.83 gal	SE09 1.000 in. 55.03 gal	SE10 0.500 in. 24.06 gal	SE11 4.000 in. 172.54 gal		
		SW12 2.000 in. 69.77 gal		SW13 2.000 in. 92.72 gal	S04 2.000 in. 94.93 gal	SE13 2.000 in. 92.72 gal	SE12 2.000 in. 69.77 gal		

Evaluator: T. B. Caldwell

Total Volume: 2,421 gallons

5.2.2 Cement-like Solids

In addition to the brown solids in Tank 17, the tank also contains thin flakes of hard, light gray solids, which appear to be cement. The volume of the cement-like solids in the tank was estimated to be about 200 gallons based on a sample taken in late April and received at SRTC on 1 May 1997. The sample was taken using a "mudsnapper," a spring-loaded clam-shell grab sampler. The sample contained about 31% rock-like material, which was probably cement-like debris from the tank ceiling.¹¹ The sample was taken from the "rock pile," a pile of solids estimated to contain about 600 gallons of solids. This is the basis for estimating that the volume of the cement-like solids is about 200 gallons.

The most likely explanation of the flakes is that they were created when the roof of the tank was poured. The top of the domed tank is a domed slab of concrete with reinforcing bar. To pour the concrete, a dome-shaped form was erected in place, supported by scaffolding from the floor of the tank. Because of the domed shape, the form was made of many short pieces of wood.

It is likely that cement and cement bleed water seeped through cracks in the form. There would have been many cracks because of the many pieces of straight wood needed to form a curved dome. After the concrete set, the form and scaffold were removed, and, presumably, the floor of the tank was swept to remove any cement flakes. However, some residual chips might have stuck to the roof of the tank when the form was removed. These chips might have broken off and fallen to the floor during tank service, or, perhaps, fell off when the entire tank (including the roof) was sprayed with powerful rotary sprays in October 1985. The exact mechanism by which the chips made their way to the bottom of the tank is uncertain. But, based on the construction history of the tank, the presence of the chips in the tank is not surprising.

The purpose of the sample was to determine the fraction of potentially non-radioactive material in the "rock pile," a large pile of sludge near the southeast riser (See Figure 3). Many people working on the sludge removal from Tank 17 colloquially called this pile the "rock pile" because it contained a high concentration of chips, and video images of it suggested rocks up to an inch in diameter. The chips were also seen in other parts of the tank, although they appeared in highest concentration in the "rock pile." One theory to explain the location of the "rock pile" was that the chips were actually rocks that had been originally distributed throughout the tank and were pushed by the water monitor to the vicinity of the pump, but the pump was unable to suck them up because of their high settling velocity. If these chips had indeed been large rocks, they would have accounted for a large percentage of residual solids in Tank 17,


which would have dramatically reduced the estimate of the amount of contaminants in the tank.

However, the mudsnapper sample showed that the "rock pile" consisted only of 31% of inert chips, less than suggested by the video images. The chips were quite thin, so they appear large when viewed from the side, although their mass is small. Also, significantly, the large pieces that would be visible in video images, which were from 1/2 inch to 1 inch in diameter, comprised only 5% of the weight of the sample. The balance of the chips (26% of the sample) could be observed only by drying the sample and passing it through a sieve.

Two conclusions were reached based on the results of the sample:

- Video observations are unreliable in determining the percentage of inert solids in any region of the tank. The sample was taken from the pile that had the highest proportion of visible solids, yet the visible solids accounted for only 5 wt% of the sample. Most of the inert solids in the sample were not visible.
- It is reasonable to estimate that the "rock pile" contains about 200 gallons of inert solids. Figure 3 shows the extent of the "rock pile" at the time of a video inspection on 21 April 1997. At that time the pile was estimated to have an area of 320 square feet and an average height of 3 inches, for a volume of about 600 gallons. Thirty-one percent of 600 gallons is the basis for saying that there are approximately 200 gallons of inert solids.

Figure 3. Tank 17 Sludge Depth as of 1500, 21 April 1997

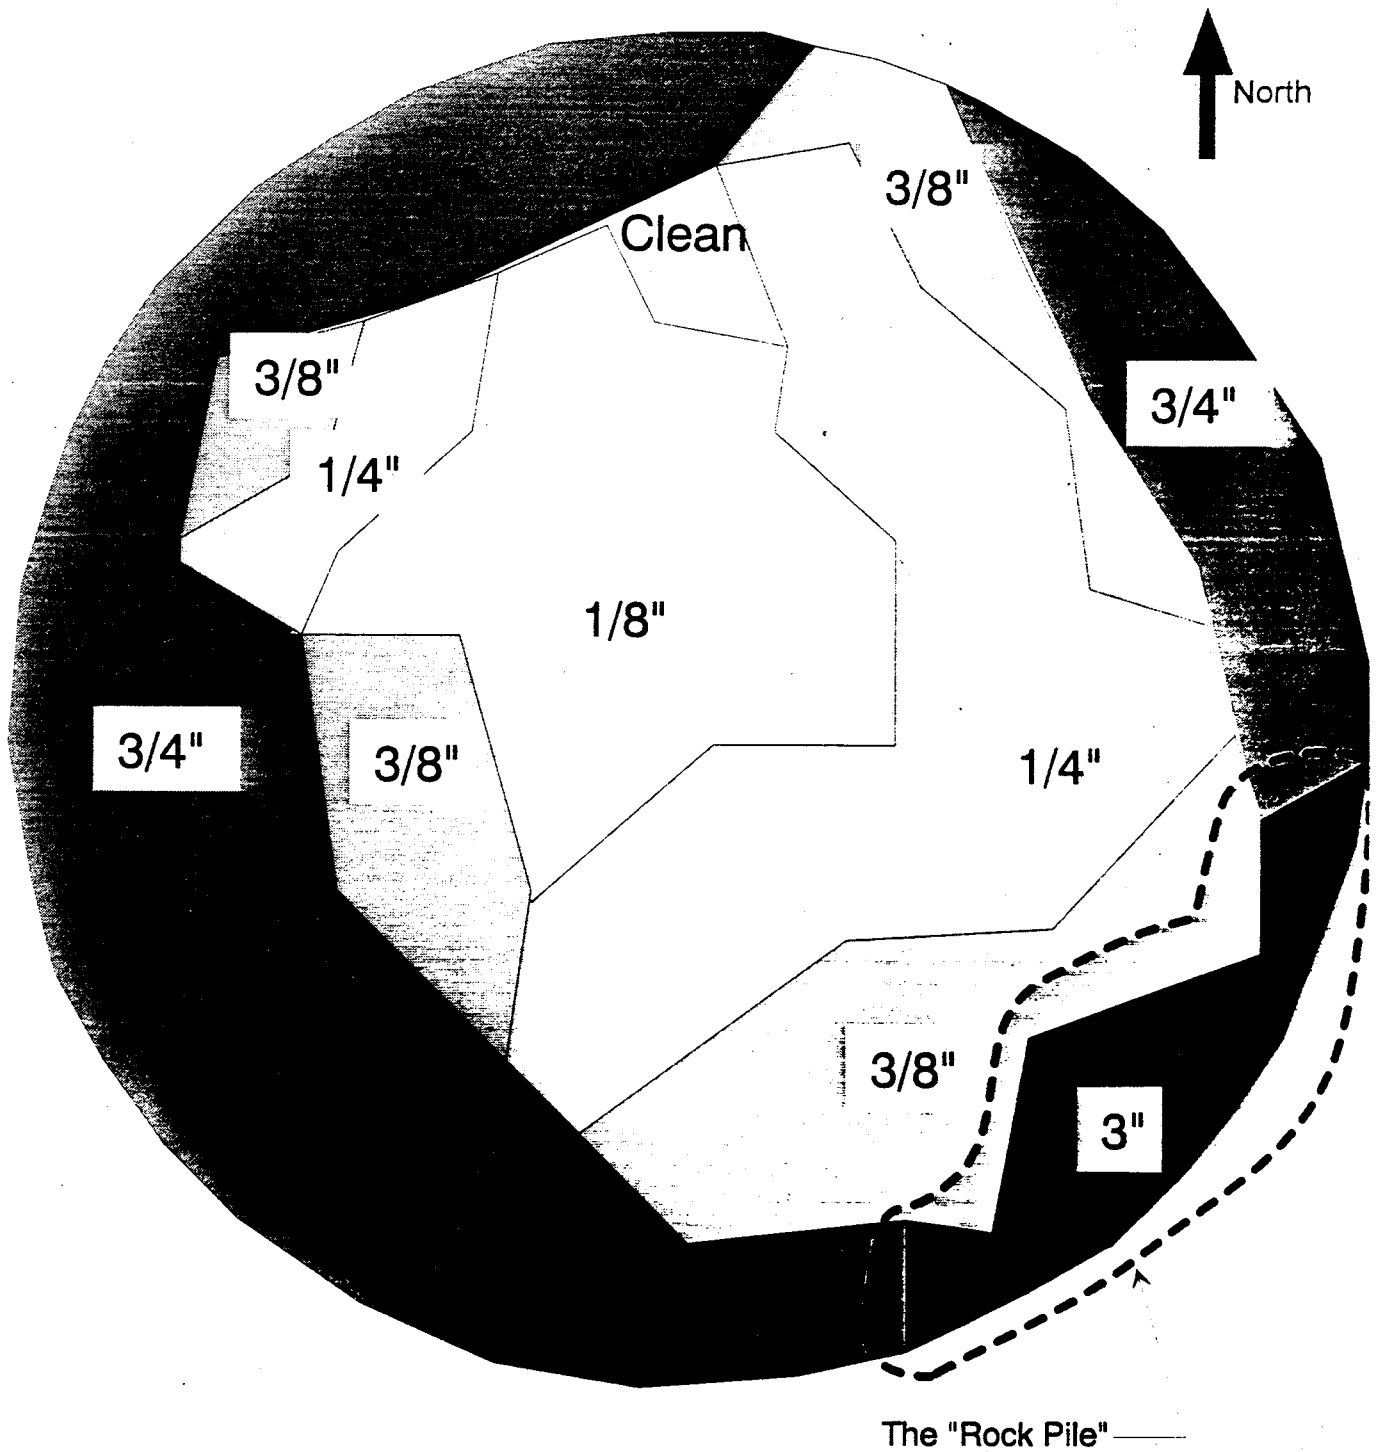

5.2.3 Redistribution with the "Water Mouse"

As can be seen in Figure 2, spray washing of the sludge pushed much of the sludge towards the tank wall, leaving large areas near the center of the tank that were relatively clear of sludge. This distribution was undesirable for two reasons:

- Piles of sludge near the wall of the tank may not be effectively influenced by the reducing grout. The performance evaluation for Tank 17 was based on the assumption that liquid percolating through the waste layer must have first percolated through the reducing grout. Thus, Tc-99 and plutonium were assumed to be relatively immobile because the water in the vicinity of the waste will be reducing and highly alkaline.² However, if large pockets of waste were to remain right up against the tank wall after the tank wall has rusted away, there is the possibility that ordinary groundwater, which is oxidizing and slightly acidic, will percolate into the waste layer, invalidating this assumption.
- The concentration of contaminants in the reducing grout was computed by taking the total contaminant concentration and dividing by the entire mass of reducing grout (See section 6.3.2, "Class C Calculation"). However, if large areas of the tank were to remain clean during closure, it seems inappropriate to take credit for the mass of reducing grout covering these clean areas. For example, if all of the sludge were in one pile covering 10% of the area of the tank, one could argue that it would be reasonable to take credit for only the weight of the reducing grout in that 10% of the tank in computing the contaminant concentration.

For these two reasons, the decision was made to redistribute the sludge away from the tank wall and attempt to cover more of the surface of the floor of the tank, so the extent of the clean areas would be reduced.



The redistribution was accomplished using a high pressure cleaning device called the hydrolazer. The heart of the hydrolazer was a hollow steel cleaning head, roughly rectangular in shape, about 12 inches wide, 13 inches long, and 6 inches tall. High pressure water entered the head through a flexible hose. The hydrolazer had two forward nozzles and ten aft nozzles, so it tended to move forward when water was spraying through it, with the hose trailing like a tail. The head was steered by two cables, one on each side, which were actuated using winches located at the center riser of the tank. By alternately pulling on the cables and letting them out, the hydrolazer could be driven toward the wall of the tank, pulled back toward the center riser, and steered toward the right or left. The installation of the hydrolazer in Tank 17 was dubbed the "Water Mouse" because of the way the device scurried around the tank when manipulated with the two cables.

Figure 4

**TANK 17 SLUDGE DISTRIBUTION MAP
AFTER "WATER MOUSE" OPERATION
WATER REMOVAL - LIQUID DEPTH <3/8"**

9/15/97

North

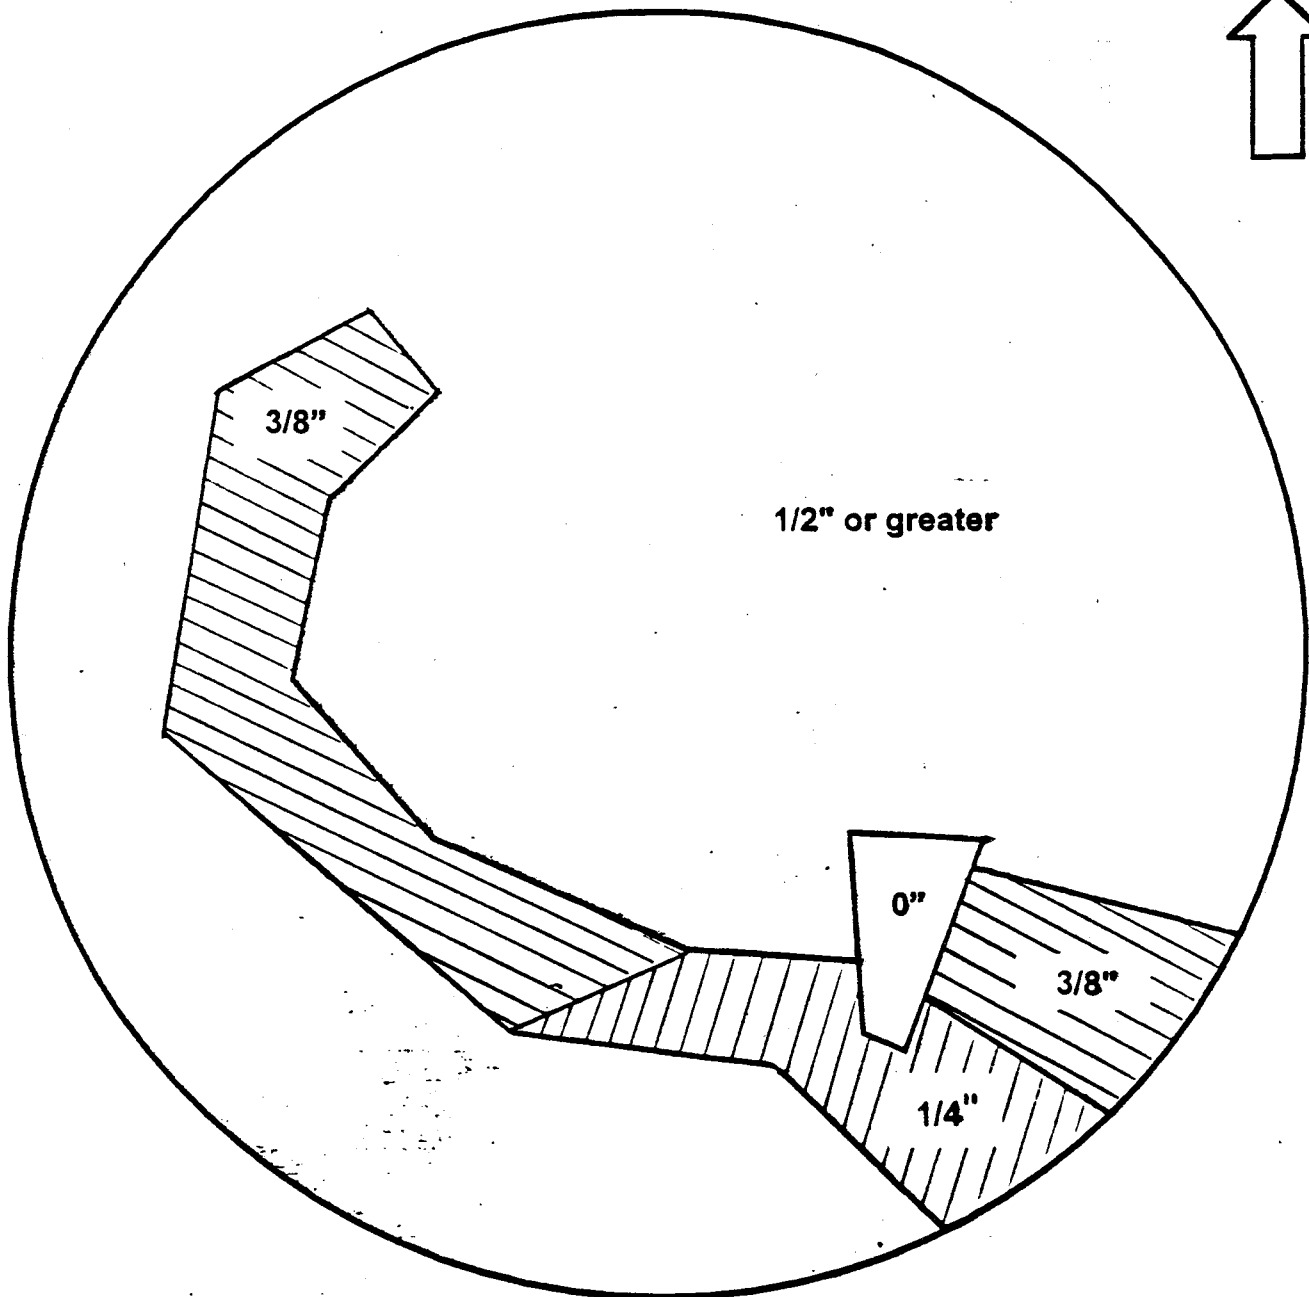

Surface Area Distribution

* 1/2" or greater = 80%

* 3/8" = 13%

* 1/4" = 5%

* 0" = 2%

The Water Mouse was successful at redistributing the sludge in Tank 17. After the Water Mouse operation, a video inspection on 15 September 1997 (See Figure 4) showed that 80% of the tank was covered with sludge greater than 1/2 inch. The exact depth of the sludge at various spots in this region was difficult to estimate because the lifting plates were covered, the sludge was relatively featureless, and there were few objects in this region of the tank that could be used for judging depth.

In the portions of the tank where the lifting plates could be observed, about 13% of the tank had sludge about 3/8 inch, 5% about 1/4 inch, and only 2% of the tank floor appeared to be bare, rusty metal. The piles of coarse sludge that had been near the tank wall, some of which had been higher than 4 inches, were moved toward the interior of the tank. Also, much of the floor of the tank appeared to be covered with fine solids that had settled in a rippled pattern, like miniature sand dunes.

5.2.4 Sludge and Grout Interaction

The configuration of the sludge after Water Mouse operation (Figure 4) was much more desirable than the configuration found in the inspection on 11 July 1997 (Figure 2) at the completion of spray washing. Based on the video inspection of 15 September 1997, the decision was made to close the tank.

Plans are to pour reducing grout into Tank 17 through all seven riser locations (the center riser and six perimeter risers), similar to what was done on Tank 20. This method of pouring was tested at Central Shops and was shown to lift and encapsulate much of the sludge.¹² The grout is expected to interact similarly with the fine sludge in Tank 17. Much of the fine sludge will be folded, perhaps multiple times, into the reducing grout, entrapping the sludge within the grout. When pours are completed, the sludge that has been lifted will be streaked throughout the grout like a marble cake.¹³

6. Waste Composition and Inventory

6.1 Process Knowledge Estimates

Estimates of the composition of residual sludge in Tank 17 were derived from the Waste Characterization System (WCS).¹⁴

The inventories and compositions of major sludge constituents in WCS are based on tank fill histories. WCS sludge inventories are based on sludge transfers from the

canyons to the tank farms and between tanks. WCS contains the following information about each sludge transfer:

- Date
- Source - canyon or tank
- Destination - tank
- Process - PUREX or H Modified (HM)
- Stream - High Heat Waste (HHW), Low Heat Waste (LHW), or Mixed
- Volume
- Major chemical compound weights - $\text{Fe}(\text{OH})_3$, NaAlO_2 , $\text{Ni}(\text{OH})_2$, and MnO_2
- Major actinide weights - Th-232, U-233, U-234, U-235, U-236, U-238, Np-237, Pu-238, Pu-239, Pu-240, Pu-241, and Pu-242

6.1.1 Chemical Contaminants

For each transfer, WCS keeps track of which tank received the waste and how much of each compound was in the transfer. For major chemical compounds (the four listed above) the information comes directly from canyon records. These four compounds account for about 80% of the weight of SRS sludge. The minor compounds are estimated by multiplying the weight of $\text{Fe}(\text{OH})_3$ by the flowsheet ratio of that constituent to $\text{Fe}(\text{OH})_3$. WCS computes the inventory of chemical contaminants that were received in each waste tank by simply summing up the quantity of chemicals in each transfer.

To determine the concentration of each compound, the inventory of that compound is divided by the calculated total mass of sludge in the waste tank. These concentrations were then multiplied by the estimated mass of sludge in Tank 17 (about 4700 pounds) to derive an estimate of the total chemical inventory in the tank, which is reported in Table 2.

6.1.2 Radionuclides

The radionuclide inventory was estimated only for the sludge because the primary salt radionuclide, Cs-137, would have been preferentially washed out during the spray washing in 1985 and during spray washing in 1997.

WCS computes the inventory of fission and activation products (H-3 through Eu-155 in Table 1) using concentrations based on yield distributions in SRS reactor assemblies, solubility data, and other information (for example, the knowledge that a large amount of tritium was added to Tank 17). The concentrations predicted by WCS were used to

estimate the inventory in Tank 17, with the exception of Tc-99, which is discussed in the section below.

WCS computes the inventory of sludge actinides (U-232 through Cm-245 in Table 1) using a combination of techniques used for chemicals and fission and activation products. The mass of major actinides in each transfer are known from canyon accountability records or process records. The concentration of minor actinides was estimated from yield distributions in SRS reactor assemblies.

Similar to the treatment for chemical constituents, the concentration of each radionuclide in Tank 17 was computed by dividing the estimated inventory of that radionuclide fed to the tank by the estimated total mass of sludge fed to the tank. Each of these concentrations was then multiplied by the estimated mass of sludge remaining in Tank 17 to derive the inventories that are reported in Table 1.

6.1.3 Tc-99

The predicted tank inventory reported in Table 1 for Tc-99 is based on an adjusted concentration that is 13.5 times the concentration reported by WCS. This is the only nuclide for which the process knowledge concentration has been adjusted. The value for this radionuclide was adjusted for two reasons:

- The performance evaluation predicts that the dose at the seepline will be predominantly due to Tc-99. Therefore, it is important to estimate this radionuclide conservatively.
- Sample results indicate that the concentration of Tc-99 in the residual sludge in Tanks 17 and 20 is elevated relative to the concentration predicted by WCS for the bulk sludge in these tanks. In particular, the ratio of Tc-99 to iron (iron is an indicator for sludge) was extremely high in the white deposits in Tank 20, which were found to contain a high concentration of cryolite.³ The presence of highly enriched Tc-99 in these deposits suggests that the Tc-99 might have precipitated in the cryolite, so that the residual deposits have a higher amount of Tc-99 than the bulk sludge. The Tc-99 in Tank 17 is also enriched relative to WCS predictions, although not to the same extent as Tank 20.

The adjustment factor of 13.5 was chosen in September 1996 based on sample results from Tank 20. At that time the Tc-99 concentration predicted for Tank 20 by process knowledge was 6.95 E-05 Ci/kg , whereas the measured concentration in the Tank 20 sludge is 0.94 microCi/gm , which is equivalent to 9.4 E-04 Ci/kg .¹⁵ Since that time, the process knowledge estimate has changed slightly due to refinements in the method

of calculation. WCS currently predicts that the sludge in Tank 20 should have a concentration of $6.3 \text{ E-05 Ci of Tc-99 per kg}$. Thus, the appropriate adjustment factor to be used in the performance evaluation should have been 15 (9.2 E-04 divided by 6.3 E-05), about 11% higher. However, the error introduced by using the old adjustment factor is small relative to other conservative assumptions, so there are no plans to revise the Tank 20 performance evaluation.

Samples in Tank 17 show a Tc-99 enrichment factor of 3.4, much less than the enrichment factor of 13.5 in Tank 20. WCS currently predicts the sludge concentration in Tank 17 to be $1.36 \text{ E-04 Ci/kg of Tc-99}$, compared to a sample result of 0.46 microCi/gm (4.6 E-04 Ci/kg).

Because there was only one sample taken from Tank 17, the adjustment factor of 13.5 found in Tank 20 was also applied to the WCS inventory estimate in Tank 17. As more experience is obtained in characterizing residuals, it may be possible to reduce the adjustment factor. For example, cryolite should be relatively easily removed by spray washing, so it is possible that the Tc-99 was removed from Tank 17 during spray washing. However, since samples were not taken after spray washing, there would not be a strong basis for defending an estimate in which the Tc-99 concentration was not adjusted upward. For example, it is possible that Tc-99 may also be enriched by compounds other than cryolite that are less easily removed by the spray washing.

6.2 Samples

Two samples were taken of Tank 17 sludge in January 1997, in addition to a supernate dip sample. The three samples were analyzed at SRTC.¹⁶

The measured supernate composition of the dip sample compared favorably with previous measurements of the Tank 17 supernate. The supernate sample results also showed that most of the contaminants were in the sludge. For example, the Tc-99 concentration in the supernate was $7.4 \text{ E-04 } \mu\text{Ci/mL}$, almost three orders of magnitude lower than the concentration in the sludge, $4.6 \text{ E-01 } \mu\text{Ci/mL}$. Because the supernate concentrations would have been reduced even more during spray washing, which occurred later, the inventory of contaminants in the supernate is negligible and was neglected in assessing the inventories of contaminants in the tank.

The sludge samples were taken using a "water bug" device, which was designed to collect a sludge sample even through the tank still had 279,000 gallons of supernate at this time. The "water bug" device consisted of a floating pump with a weighted length of flexible tubing. The pump sucked liquid through the tubing, effectively "dredging" solids from the bottom of the tank, and exhausted part of its discharge into a filtered

receptacle, which caught the solids. The other part of the discharge of the pump was directed sideways into the liquid, which caused the "water bug" to move around the tank. In effect, the device moved around the tank like a motor boat, dredging up and collecting sludge solids.

One advantage of this technique of sample collection is that the sample is a composite of sludge over a wide area of the tank. The disadvantage of the technique is that the only the top of the sludge is sampled. However, Tank 17 should have been well mixed by the campaigns of waste removal with slurry pumps followed by spray washing with powerful rotary sprays. The fact that the sample results are similar to process knowledge supports this assumption.

6.3 Estimated Inventories

The estimated inventories of contaminants in Tank 17 are reported in Tables 1 and 2.

Table 1
Radionuclide Inventories in Tank 17 Solids

Nuclide	Concentration from WCS (10/31/96) (Ci/kg)	Tank Inventory Based on 2400 gallons (Ci)	"Water Bug" Samples		Conservative Estimate (Highest of WCS and samples) (Ci)	Class C Upper Limit	Class C Units	Tank 17 Concentration in Class C units	Factor Relative to Class C limit	Factor With 72 Inches of Grout
			(microCi/gm)	Inventory Based on 2,400 gal (Ci)						
H-3	0.000E+00	0.00E+00	11.4	24.25	24.25	None	NA			
C-14	1.611E-06	3.42E-03			3.4E-3	8.000E+00	Ci/m ³	0.00038	4.71E-05	4.43E-07
Ni-59	9.478E-05	2.01E-01			2.0E-01	2.200E+02	Ci/m ³	0.0228	0.0001	9.48E-07
Co-60	1.189E-03	2.52E+00	0.393	0.836	2.5E+00	None	NA			
Se-79	7.839E-06	1.66E-02			1.7E-02	None	NA			
Sr-90	4.287E-01	9.10E+02	60.2	128	9.1E+02	7.000E+03	Ci/m ³	100	0.014	0.000135
Y-90	4.287E-01	9.10E+02			9.1E+02	None	NA			
Tc-99	1.360E-04	3.90E+00	0.462	0.983	3.9E+00	3.000E+00	Ci/m ³	0.43	0.143	0.0013
Ru-106	1.031E-06	2.19E-03			2.2E-03	None	NA			
Rh-106	1.031E-06	2.19E-03			2.2E-03	None	NA			
Sb-125	7.395E-04	1.57E+00			1.6E+00	None	NA			
Sn-126	1.456E-05	3.09E-02			3.1E-02	None	NA			
I-129	6.453E-10	1.37E-06			1.4E-06	8.000E-02	Ci/m ³	1.51E-07	1.89E-06	1.78E-08
Cs-134	3.313E-06	7.03E-03			7.0E-03	None	NA			
Cs-135	8.976E-08	1.91E-04			1.9E-04	None	NA			
Cs-137	2.961E-02	6.29E+01	9.57	20.36	6.3E+01	4.600E+03	Ci/m ³	6.920	0.0015	1.42E-05
Ce-144	6.208E-08	1.32E-04			1.3E-04	None	NA			
Pr-144	6.208E-08	1.32E-04			1.3E-04	None	NA			
Pm-147	1.250E-02	2.65E+01			2.7E+01	None	NA			
Eu-154	2.013E-03	4.27E+00	0.0763	0.162	4.3E+00	None	NA			
Eu-155		0.00E+00	0.0413	0.0879	8.8E-02	None	NA			
U-232	2.408E-08	5.11E-05			5.1E-05	100	nCi/gm	0.024	0.00024	3.31E-07
U-235	1.549E-07	3.29E-04	0.00013	0.0003	3.3E-04	100	nCi/gm	0.155	0.00155	2.13E-06
U-238	9.624E-06	2.04E-02	0.003	0.007	2.0E-02	100	nCi/gm	9.60	0.096	0.000132
Np-237	0.000E+00	0.00E+00	0.007	0.015	0.015	100	nCi/gm	7.12	0.071	9.81E-05
Pu-238	0.000E+00	0.00E+00	33.4	71.05	71.05	100	nCi/gm	33400	334	0.46
Pu-239	5.637E-03	1.20E+01	7.58	16.13	16.13	100	nCi/gm	7584	76	0.10
Pu-240	1.488E-03	3.16E+00	1.72	3.66	3.66	100	nCi/gm	1723	17.24	0.024
Pu-241	9.837E-03	2.09E+01	152	323	3.2E+02	3500	nCi/gm	152000	43	0.060
Pu-242	2.145E-06	4.55E-03	0.0027	0.0058	5.8E-03	100	nCi/gm	2.74	0.027	3.78E-05
Am-241	2.021E-02	4.29E+01	4.49	9.55	4.3E+01	100	nCi/gm	20166	202	0.278
Cm-244	3.735E-07	7.93E-04			7.9E-04	100	nCi/gm	0.37	0.0037	5.14E-06
Cm-245	2.244E-13	4.76E-10			4.8E-10	100	nCi/gm	2.24E-07	2.247E-09	3.09E-12

Total alpha emitting nuclides with half lives greater than 5 years (Ci)

130

Sum of Class C Factors

673

0.9283

Table 2
Chemical Inventories in Tank 17 Solids

	Inventory from WCS Adjusted to 2400 gal (kg)	Average of Water Bug Samples (wt%)	Estimated Inventory from samples (kg)	Conservative Estimate (Highest of WCS and Samples) (kg)
Silver	7.2	<2.0E-02	<0.4	7.2
Aluminum	123.7	3.9E+00	83.2	123.7
Barium	4.2	<3.89E-03	<0.08	4.2212
Fluoride	3.8	5.0E-02	1.1	3.8
Chromium	5.1	3.1E-02	0.7	5.1
Copper	3.6	<8.7E-03	<0.2	3.6
Iron	583.7	2.4E+01	510.5	583.7
Mercury	1.5	7.5E-03	0.2	1.5
Nitrate plus Nitrite	39.2	5.3E+00	106.4	106.4
Manganese	27.3	2.4E+00	51.9	51.9
Nickel	0.0	3.0E-02	0.6	0.9
Lead	6.0	<5.23E-02	<1.1	6.0
Uranium	60.9			60.9
Zinc	7.2	3.1E-02	0.7	7.2
Sodium		9.5E+00	202.9	202.9
Silicon		1.8E+00	37.4	37.4
Boron		<2.06E-02	<0.44	<0.44
Calcium		8.7E-01	18.5	18.5
Lithium		<8.28E-03	<0.18	<0.18
Magnesium		1.6E+00	33.4	33.4
Molybdenum		<3.19E-03	<0.068	<0.068
Titanium		<5.0E-03	<0.1	0.8
Zirconium		<8.6E-03	<0.2	0.0
Cadmium		9.2E-01	19.5	19.5
Phosphate		<2.45E-02	<0.5211	<0.5211
Chloride		7.0E-02	1.5	1.5
Sulfate		1.0E-01	2.1	2.1
Oxalate		9.5E-01	20.2	20.2

6.3.1 Radionuclide Inventories

Table 1 shows the radionuclide contaminants. Columns 2 and 3 show the inventories predicted from process knowledge, as discussed previously. Column 4 shows the average concentrations from the "water bug" sampler. Column 5 shows the inventory predicted from sample results.

The inventories of Cs-137 and Pu-239 were below the predictions.

Technetium-99 was lower than predicted, although as discussed previously, the process knowledge prediction was adjusted upward by a factor of 13.5 based on experience in Tank 20. If it were not for this adjustment, the sample result would have been 3.4 times the predicted value. As a result of the adjustment, the sample result is 4 times less than the predicted value.

Plutonium-238 and Np-237 were notably higher than predictions. Seventy-one curies of Pu-238 were found in Tank 17, although none were predicted. Production records do not indicate that any Pu-238 went to Tank 17, which contains Purex Low-Heat Waste. It had long been recognized that some small amount of Pu-238 and other plutonium isotopes would be present in Purex Low-Heat Waste, but the amount was expected to be small enough to be neglected. The sample results from Tank 17 (and also from Tank 20³) shows that this assumption is not correct, because Pu-238 is, in fact, the alpha radionuclide that is present in highest concentration relative to its Class C limit. Pu-241 is present in higher concentration, but its Class C limit is 35 times higher, so its concentration relative to its limit is lower.

For the performance evaluation, Pu-238 is not a concern because it is relatively immobile in the environment and has a half-life of only 86 years. Therefore, virtually no Pu-238 will travel through the environment and outcrop at the seepline. However, the Pu-238 is a concern because of its Class C implications (see next section). Plans are to revise the assumptions in the WCS to specify that some fraction of the Pu-238 and the other plutonium isotopes go to Low-Heat Waste.

The last nuclide that occurred higher than its predicted concentration was Np-237. Similar to Pu-238, Np-237 was thought to be present in low enough concentrations that it could be neglected. The inventory estimate of Np-237 in Tank 17 is low. However, of the nuclides of concern in Tank 17, Np-237 is unique in that it has a high ingestion dose conversion factor, a long half-life, and travels relatively easily through the environment (Most nuclides with high dose conversion factors, such as Pu-239, are relatively immobile). Therefore, it is important to estimate Np-237 conservatively.

For the purposes of Tank 17, Np-237 can be neglected. However, as a result of the discovery of Np-237 in Tank 20 and 17, plans are to revise the WCS to account for Np-237 in Low-Heat Waste. It appears likely that Np-237 will be a significant dose contributor to the performance evaluation for some tanks.

6.3.2 Class C Calculation

The rightmost five columns of Table 1 include a Class C calculation for the waste in Tank 17. The column entitled "Class C Upper Limit" shows the Class C limit for each radionuclide, from Nuclear Regulatory Commission regulation 10 CFR 61.55, effective 1991. The units for the value in the column are shown in the next column, entitled "Class C Units." The next column, "Tank 17 Concentration in Class Units," shows the computed concentration of the Tank 17 sludge converted to the appropriate units.

In the column "Factor relative to Class C Limit" the computed concentration in Tank 17 is divided by the limit to obtain a Class C factor for each radionuclide. To be within the Class C designation the sum of all of these factors must be less than or equal to 1. As can be seen from the sum at the bottom of the column, the sludge in Tank 17 is currently 673 times the upper limit for the Class C waste.

The last column, "Factor with 72 Inches Grout," shows the factors if one takes credit for the mass of 72 inches of grout covering the entire tank floor in computing the radionuclide concentration. The grout is assumed to have a specific gravity of 1.6, which is equivalent to light CLSM. Plans are to pour 72 inches of reducing grout in Tank 17, which has a specific gravity of 2.4, so this calculation incorporates a safety factor of 50%. As can be seen from the summation at the bottom of the column, 72 inches of grout is sufficient to bring the sum of the Class C factors to less than 1.000. Thus, if one takes credit for the mass of 72 inches or more of grout covering the entire tank floor, the concentration of the waste plus grout in Tank 17 will be less than the upper limit for Class C waste.

6.3.3 Chemical Inventories

Table 2 shows the chemical contaminants. Column 2 shows the inventories predicted by WCS. Also shown are the concentrations measured in the tank, and the estimated inventories based on the samples.

6.4 Other Contaminants

The risers in Tank 17 contain lead, which acted as radiation shielding when the tank stored HLW. Plans are to leave these risers in place when the tank is closed. The estimated mass of lead is approximated 500 pounds per riser. There are six risers on the tank, for an estimated total of 3000 pounds of lead.

In addition to the contaminants in Tanks 17-20, there will be contamination in other equipment in the area, such as the 1F Evaporator, the 1F Concentration Transfer System, ventilation systems, and transfer piping. The inventory of contaminants in these locations is expected to be small relative to the amount of contamination in the tanks.

To account for contamination outside of the tank, we recommend that an inventory of contaminants equal to 20% of the waste inside the tank be added to the performance evaluation for each waste tank (i.e. performance modeling of the Tank 17-20 area should add 20% of the inventory in these four tanks). Based on engineering judgment, this 20% should bound the contamination in these locations. As closure modules are prepared for these locations, the modules will show that the contamination left behind is smaller than this estimate, or the estimate will be revised and the performance evaluation repeated.

7. Acronym List

CST	Concentration Storage and Transfer
CSTE	Concentration Storage and Transfer Engineering
CTS	Concentrate Transfer System
HHW	High Heat Waste
HLW	High-Level Waste
LHW	Low Heat Waste
SRS	Savannah River Site
SRTC-IWT	Savannah River Technology Center, Interim Waste Technology section
WCS	Waste Characterization System

8. References

- 1 "Industrial Wastewater Closure Plan for F- and H-Area High-Level Waste Tanks," Rev. 1, 10 July 1996
- 2 "Industrial Wastewater Closure Module for the High-Level Waste Tank 17 System," Revision 2, 26 August 1997
- 3 P. D. d'Entremont and J. R. Hester, "Characterization of Tank 20 Residual Waste," WSRC-TR-96-0267, 17 March 1997
- 4 W. S. Cavin and A. T. Crumm, "Waste Transfers and Miscellaneous Additions," WSRC-TR-93-425, Rev. 1, 21 January 1994
- 5 G. K. Georgetown, "Updated Tritium and Chemistry Calculations for Tank 17 Following K-Area Water Addition," WER-WMT-920142, 13 February 1997
- 6 M. E. Jamison et. al., "HLW Supernate Radionuclide Characterization," WSRC-TR-94-0290, Rev. 2, 22 August 1994
- 7 L. S. Livingston, Evaluation of Receipt Tanks for Long-Term Storage of Tank 17F Tritiated Water," WSRC-TR-96-0349, Rev. 0, 10 March 1997
- 8 P. D. d'Entremont, "Residual Tritium in Tank 17," HLW-HLE-97-0069, 6 March 1997
- 9 L. M. Smith, "Assessment of Soil Erosion Methods for Sludge Recovery, Savannah River Site," Technical Report GL-97-XX, U. S. Army Engineer Waterways Experiment Station, Vicksburg, MS
- 10 L. F. Landon and T. T. Thompson, "Technical Data Summary for the Defense Waste Processing Facility, Stage 2," DPSTD-80-39-2, December 1980
- 11 M. S. Hay, "Observations on the Mudsnapper Sample of the Tank 17F 'Rock Pile'," SRT-LWP-97-059, 7 May 1997
- 12 T. B. Caldwell and C. A. Langton, "Sludge Displacement Verification for Reducing Grout Report," WSRC-TR-97-0101, Revision 0, 10 April 1997
- 13 T. B. Caldwell, "Anticipated Sludge and Grout Behavior in Tank 17F During Tank Closure Operations," HLW-HLE-97-0258, 22 September 1997

- 14 J. R. Hester, "High Level Waste Characterization System," WSRC-TR-96-0264, December 1996
- 15 P. D. d'Entremont and D. T. Bignell, "Options for Meeting Class C Criteria During HLW Tank Closure," WSRC-TR-96-0327, 16 October 1996
- 16 M. S. Hay, "Characterization of Tank 17F Samples in Support of Tank Closure," WSRC-RP-97-066, 28 January 1997

APPENDIX

**SLUDGE HEEL VOLUME ESTIMATION METHOD
FOR TANK 17**

I. INTRODUCTION

The volume of sludge within a Type IV waste tank can be estimated by visually judging the depth of the sludge in the tank and integrating smaller increments of known volumes based on these depths. This technique is a tool for estimating sludge volumes of less than 3000 gallons with sludge depths not exceeding $\frac{3}{4}$ ". The sludge depth is determined by locating tank internal landmarks and judging the sludge depth using a remote video camera that is zoomed and focused on the landmark. The landmark accounts for a fraction of the total surface area of the tank bottom. The volume for that area fraction can be estimated by multiplying the area times the sludge depth. Total sludge volume is then calculated by summing all of the volume fractions.

Tank 17 sludge heel volume was estimated in July 1997 using this method and was found to be approximately 2400 gallons.

II. LANDMARK DESCRIPTION AND FRACTION DEVELOPMENT

One half inch ($\frac{1}{2}$ ") thick plates welded to the tank serve as the landmarks. The plates are twelve inches square (12 in^2) and are placed periodically along the tank bottom. The plates were used during tank construction. Lifting rods were welded to these plates and the rods were then attached to a lifting frame. They were adjusted using turnbuckles. This allowed the tank bottom steel sheets to be welded first on the concrete foundation mat and then lifted to allow for welding of the bottom seams. The bottom was then lowered on the mat for tank wall fabrication. The lifting rods were eventually cut from the lifting plates leaving only a remnant of the rod.

A study of plant drawing W164197 Rev 0, shows that plates to be $\frac{1}{2}$ inch thick attached with a $\frac{1}{4}$ inch filet weld bead. The following is a schematic of the plate.

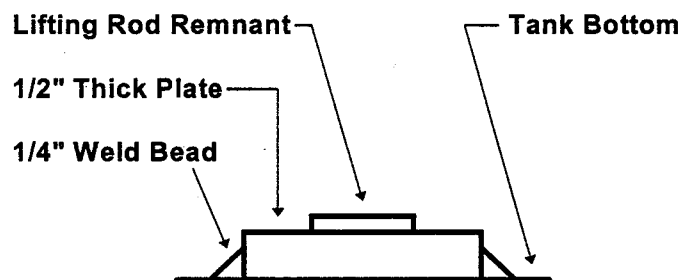


Figure A1. Lifting Plate Elevation View (Not to Scale)

A tank radius of less than the full radius of 42.5 feet is used. Since the tank bottom transitions to the tank wall with a curved 12-inch radius knuckle, a thin layer of sludge will not reach the outer edge of the tank. Assuming a sludge depth of 2", the calculated sludge radius will not exceed 42.0528 feet. Therefore, the total area is 5555.712 ft^2 .

There are sixty-nine (69) lifting plates in the Type IV tanks. They are placed in a symmetrical pattern in accordance with the design drawing (W164197). Some of the plates are placed closer together than others and the contributing area fractions for the plates are therefore different. Refer to the attached computation for the development of the area fractions. In summary, the area fraction for each plate is

constructed by drawing a boundary that is half of the distance to the adjacent plates. The area fractions end up looking like pieces to a jigsaw puzzle. The areas are calculated using geometry and trigonometry. The area fractions are added up and normalized to the total area of 5555.712 ft². Normalization is performed to lessen the additive errors introduced during fraction area development. Each piece is assigned a type and an ID number. For example, the center plate is type "A" and given the ID of "C01". Its normalized area is 87.6624 ft². Refer to Table A2 for a listing of the area fraction types and Table B3 for a listing of each plate ID.

III. SLUDGE VOLUME ESTIMATION

A video camera with pan-tilt-zoom capability is placed in one of the risers. Sufficient lighting is provided to allow a clear view of each lifting plate. Each plate is viewed and assessed for sludge depth. The criteria for estimation is given in Table A1.

Table A1. Sludge Depth Criteria

Depth (Inches)	Method
0	Able to see entire weld bead. No visible sludge around the plate with a clean or mostly clean tank floor.
1/8	A "dusting" of sludge is evident. The weld bead is mostly visible, but there is sufficient sludge surrounding the plate cover portions of the weld bead.
1/4	Weld bead is mostly covered but portions of the bead are still visible.
3/8	The weld bead is completely covered but the edge of the lifting plate is clearly visible
1/2	The square shape of the lifting plate is clearly visible but the sludge appears to be the same depth as the top of the lifting plate.
3/4	Only the remnant of the lifting rod is visible. The shape of the plate may be discerned through the sludge.

If a plate cannot be seen in its intended location, then sludge depth must be estimated by using bottom debris or equipment as a reference point. If no such artifacts are present, then the estimator must make a best guess. After the depths are estimated, they are converted to feet and then multiplied by the normalized area fraction. Summing the volume fractions will yield the total sludge volume in cubic feet which are then converted to the nearest whole gallon.

A detailed inspection was performed on July 11, 1997 at 0930 using this technique. Refer to Table A3 and the *Type IV Tank Residual Heel Estimate Worksheet* for the results of this inspection. It was estimated that approximately 2400 gallons of sludge residue was still left in the tank.

IV. ERROR DISCUSSION

If all of the plates can be seen, and if the sludge residue is relatively level (i.e. no abrupt peaks and valleys), it can be assumed that the sludge can be estimated to within $\pm 1/8$ " which corresponds to ± 433 gallons. This is the smallest resolution that can be ascertained by video inspection. The error increases substantially when there are abrupt changes in sludge depths or when some or all of the plates are not visible. Other errors are introduced by the distortion in the tank bottom. Stresses formed during welding of the tank bottom, caused the tank to buckle in some areas so the tank is not entirely flat. The degree of flatness is difficult to determine from video inspection.

Table A2. Area Fraction Types

Sludge Radius 42.0528 feet
 Total Area 5555.71 ft²

Piece Type	Qty	Calculated Area Each	Calculated Total Area	Normalized Total Area	Normalized Area Ea.
A	25	87.8906	2197.2650	2191.5601	87.6624
B	2	110.8398	221.6796	221.1040	110.5520
C	4	77.3925	309.5700	308.7662	77.1916
D	4	71.5194	286.0776	285.3348	71.3337
E	4	83.2657	333.0628	332.1980	83.0495
F	4	88.5090	354.0360	353.1168	88.2792
G	2	88.1821	176.3642	175.9063	87.9531
H	2	76.3332	152.6664	152.2700	76.1350
I	4	74.5602	298.2408	297.4665	74.3666
J	4	56.1070	224.4280	223.8453	55.9613
K	4	69.3719	277.4876	276.7671	69.1918
L	4	56.3807	225.5228	224.9373	56.2343
M	4	84.3123	337.2492	336.3736	84.0934
N	2	88.2620	176.5240	176.0657	88.0328
TOTALS→	69		5570.1740	5555.7117	1110.0367

Table A3. Tank 17 Sludge Heel Volume Estimate - July 11, 1997 @ 0930

Piece ID No.	Piece Type	Area Ea.	Depth (in.)	Gallons
C01	A	87.6624	0.000	0.00
N01	A	87.6624	0.125	6.83
N02	A	87.6624	0.000	0.00
N03	G	87.9531	0.125	6.85
N04	H	76.1350	1.000	47.46
S01	A	87.6624	0.125	6.83
S02	A	87.6624	0.125	6.83
S03	G	87.9531	1.000	54.83
S04	H	76.1350	2.000	94.93
E01	A	87.6624	0.125	6.83
E02	A	87.6624	0.000	0.00
E03	B	110.5520	0.125	8.61
E04	N	88.0328	2.000	109.76
W01	A	87.6624	0.000	0.00
W02	A	87.6624	0.000	0.00
W03	B	110.5520	0.125	8.61
W04	N	88.0328	0.375	20.58
NE01	A	87.6624	0.000	0.00
NE02	A	87.6624	0.125	6.83
NE03	D	71.3337	0.375	16.68

Table A3. Tank 17 Sludge Heel Volume Estimate - July 11, 1997 @ 0930

Piece ID No.	Piece Type	Area Ea.	Depth (in.)	Gallons
NE04	M	84.0934	2.000	104.85
NE05	A	87.6624	0.125	6.83
NE06	A	87.6624	0.000	0.00
NE07	E	83.0495	1.000	51.77
NE08	L	56.2343	2.000	70.11
NE09	F	88.2792	0.125	6.88
NE10	C	77.1916	0.125	6.02
NE11	K	69.1918	0.375	16.18
NE12	J	55.9613	1.000	34.89
NE13	I	74.3666	1.000	46.36
NW01	A	87.6624	0.125	6.83
NW02	A	87.6624	0.125	6.83
NW03	D	71.3337	0.125	5.56
NW04	M	84.0934	1.000	52.43
NW05	A	87.6624	0.125	6.83
NW06	A	87.6624	0.000	0.00
NW07	E	83.0495	0.125	6.47
NW08	L	56.2343	1.000	35.06
NW09	F	88.2792	0.125	6.88
NW10	C	77.1916	0.375	18.05
NW11	K	69.1918	1.000	43.14
NW12	J	55.9613	1.000	34.89
NW13	I	74.3666	1.000	46.36
SE01	A	87.6624	0.125	6.83
SE02	A	87.6624	0.125	6.83
SE03	D	71.3337	0.500	22.24
SE04	M	84.0934	3.000	157.28
SE05	A	87.6624	0.500	27.33
SE06	A	87.6624	0.250	13.66
SE07	E	83.0495	3.000	155.32
SE08	L	56.2343	4.000	140.23
SE09	F	88.2792	1.000	55.03
SE10	C	77.1916	0.500	24.06
SE11	K	69.1918	4.000	172.54
SE12	J	55.9613	2.000	69.77
SE13	I	74.3666	2.000	92.72
SW01	A	87.6624	0.125	6.83
SW02	A	87.6624	0.125	6.83
SW03	D	71.3337	0.125	5.56
SW04	M	84.0934	1.000	52.43
SW05	A	87.6624	0.250	13.66
SW06	A	87.6624	0.125	6.83
SW07	E	83.0495	0.500	25.89
SW08	L	56.2343	1.000	35.06
SW09	F	88.2792	1.000	55.03
SW10	C	77.1916	1.000	48.12

Table A3. Tank 17 Sludge Heel Volume Estimate - July 11, 1997 @ 0930

Piece ID No.	Piece Type	Area Ea.	Depth (in.)	Gallons
SW11	K	69.1918	1.000	43.14
SW12	J	55.9613	2.000	69.77
SW13	I	74.3666	2.000	92.72
		5555.71	2421 gallons	
		TOTAL AREA (ft²)	TOTAL VOLUME	

TYPE IV TANK RESIDUAL HEEL ESTIMATE WORKSHEET

TANK NO. **17F**

DATE 7/11/97

TIME 0930

				NW13 1.000 in. 46.36 gal	N04 1.000 in. 47.46 gal	NE13 1.000 in. 46.36 gal	NE12 1.000 in. 34.89 gal		
		NW12 1.000 in. 34.89 gal							
	NW11 1.000 in. 43.14 gal	NW10 0.375 in. 18.05 gal	NW09 0.125 in. 6.88 gal	N03 0.125 in. 6.85 gal	NE09 0.125 in. 6.88 gal	NE10 0.125 in. 6.02 gal	NE11 0.375 in. 16.18 gal		
NW08 1.000 in. 35.06 gal	NW07 0.125 in. 6.47 gal	NW06 0.000 in. 0.00 gal	NW05 0.125 in. 6.83 gal	N02 0.000 in. 0.00 gal	NE05 0.125 in. 6.83 gal	NE06 0.000 in. 0.00 gal	NE07 1.000 in. 51.77 gal	NE08 2.000 in. 70.11 gal	
NW04 1.000 in. 52.43 gal	NW03 0.125 in. 5.56 gal	NW02 0.125 in. 6.83 gal	NW01 0.125 in. 6.83 gal	N01 0.125 in. 6.83 gal	NE01 0.000 in. 0.00 gal	NE02 0.125 in. 6.83 gal	NE03 0.375 in. 16.68 gal	NE04 2.000 in. 104.85 gal	
W04 0.375 in. 20.58 gal	W03 0.125 in. 8.61 gal	W02 0.000 in. 0.00 gal	W01 0.000 in. 0.00 gal	C01 0.000 in. 0.00 gal	E01 0.125 in. 6.83 gal	E02 0.000 in. 0.00 gal	E03 0.125 in. 8.61 gal	E04 2.000 in. 109.76 gal	
SW04 1.000 in. 52.43 gal	SW03 0.125 in. 5.56 gal	SW02 0.125 in. 6.83 gal	SW01 0.125 in. 6.83 gal	S01 0.125 in. 6.83 gal	SE01 0.125 in. 6.83 gal	SE02 0.125 in. 6.83 gal	SE03 0.500 in. 22.24 gal	SE04 3.000 in. 157.28 gal	
SW08 1.000 in. 35.06 gal	SW07 0.500 in. 25.89 gal	SW06 0.125 in. 6.83 gal	SW05 0.250 in. 13.66 gal	S02 0.125 in. 6.83 gal	SE05 0.500 in. 27.33 gal	SE06 0.250 in. 13.66 gal	SE07 3.000 in. 155.32 gal	SE08 4.000 in. 140.23 gal	
	SW11 1.000 in. 43.14 gal	SW10 1.000 in. 48.12 gal	SW09 1.000 in. 55.03 gal	S03 1.000 in. 54.83 gal	SE09 1.000 in. 55.03 gal	SE10 0.500 in. 24.06 gal	SE11 4.000 in. 172.54 gal		
		SW12 2.000 in. 69.77 gal		SW13 2.000 in. 92.72 gal	S04 2.000 in. 94.93 gal	SE13 2.000 in. 92.72 gal	SE12 2.000 in. 69.77 gal		

Evaluator: T. B. Caldwell

Total Volume: 2,421 gallons


COMPUTATION SHEET

Tank Closure Program


Type IV Tank Sludge Volume Estimation Method

Computation by:

Reviewed by:

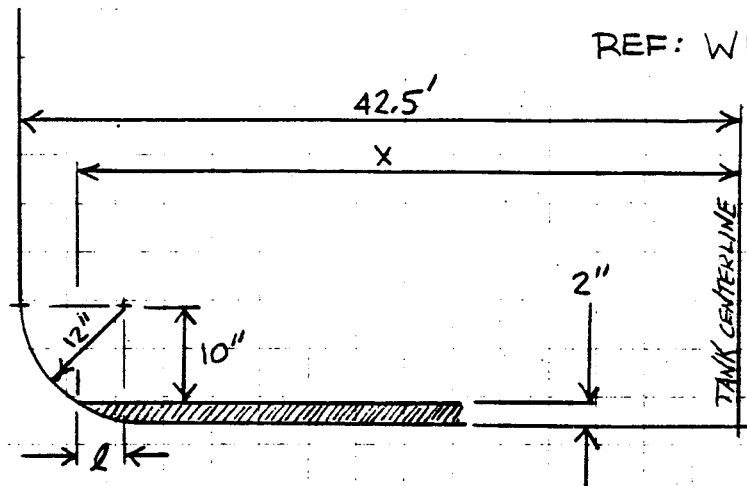James B. Caldwell
Paul D. d'EntremontDETERMINE SLUDGE CIRCLE DIAMETER ASSUMING 2" DEPTHELEVATION VIEW
(NOT TO SCALE)

SOLVE FOR "X":



$$\text{IN THE FORM } a^2 + b^2 = c^2$$

$$\& b = \sqrt{c^2 - a^2}$$

$$l = \sqrt{12^2 - 10^2} = \sqrt{44}$$

$$l = 6.6332" = 0.5528'$$

$$X = 42.5 - (1 - 0.5528) = 42.0528'$$

COMPUTATION SHEET


Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:

James B. Caldwell

Reviewed by:

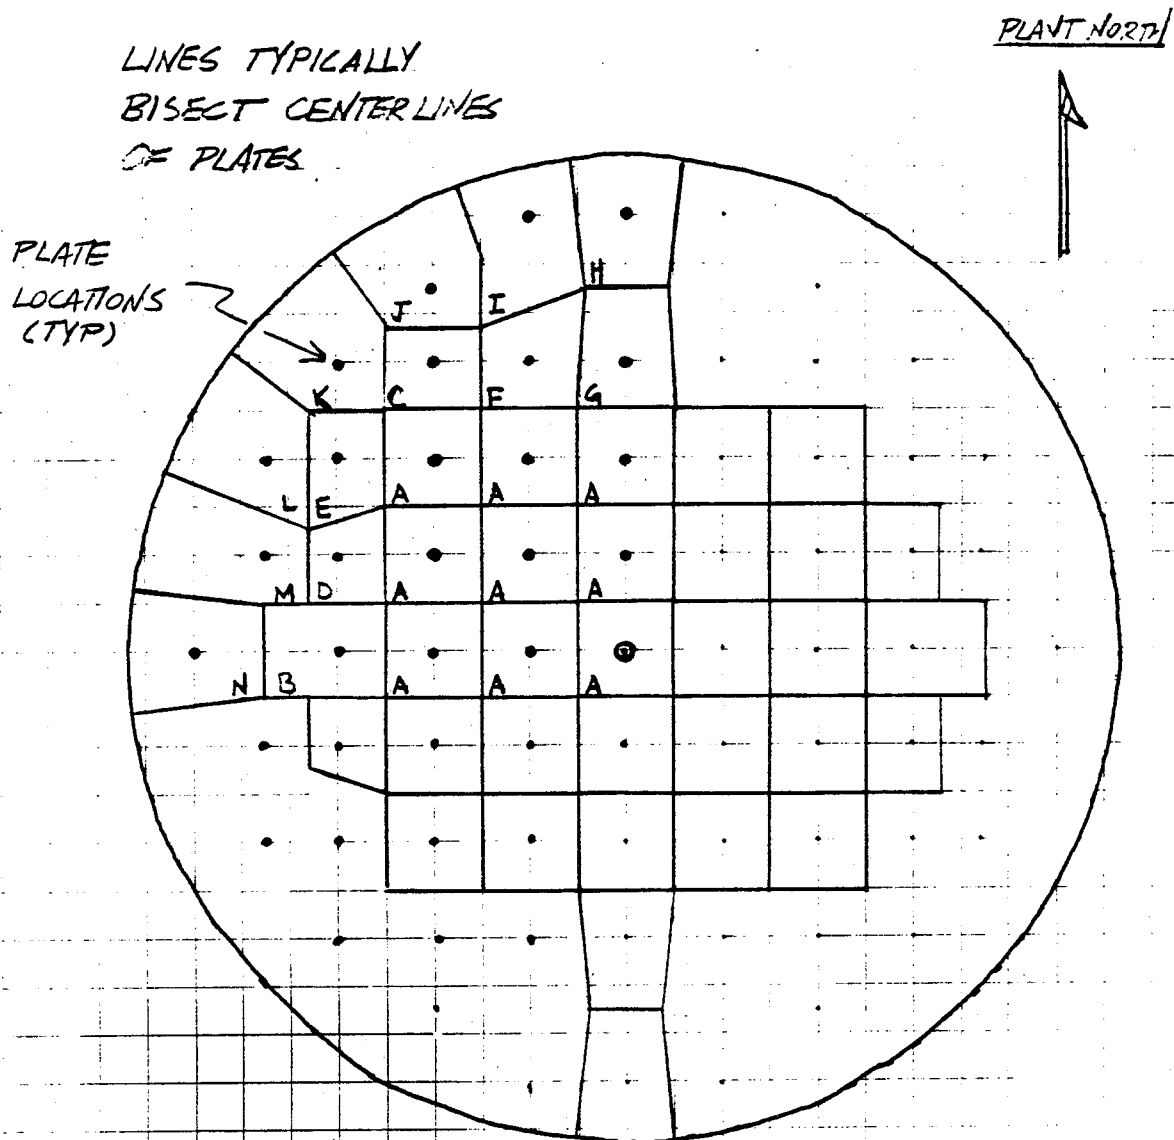Paul D. d'Entremont


COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by: *M. J. Caldwell*Reviewed by: *Paul D. d'Entremont*PIECE "A" (QTY = 25)


$$A = 87.8906 \text{ FT}^2$$
$$\text{TOT A} = 2197.2650 \text{ FT}^2$$

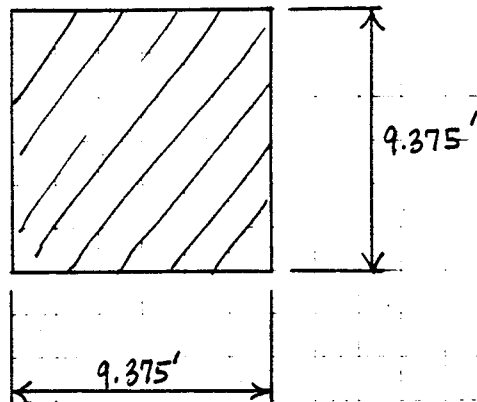

$$A = (9.375)^2 = 87.8906 \text{ FT}^2$$

TOTAL AREA BY "A"
2197.266 FT²PIECE "B" (QTY = 2)

$$A = 110.8398 \text{ FT}^2$$
$$\text{TOT A} = 221.6796 \text{ FT}^2$$

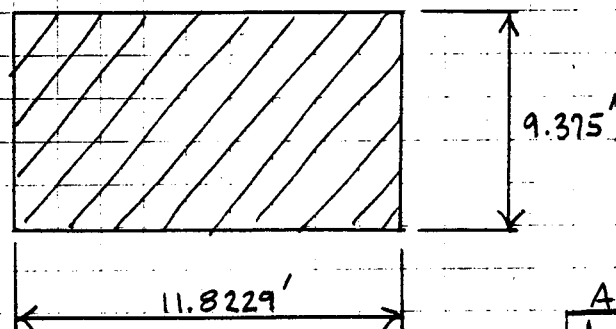

$$A = (9.375)(11.8229)$$
$$A = 110.8398 \text{ FT}^2$$

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method


Computation by:

Reviewed by:

James Caldwell
*Paul D. d'Entremont*PIECE "C" (QTY = 4)

$$A = 77.3925 \text{ FT}^2$$

$$\text{TOT } A = 309.5700 \text{ FT}^2$$

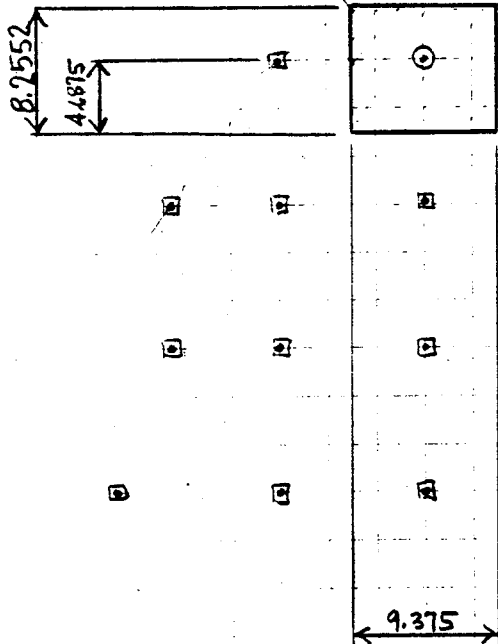

$$A = (8.2552)(9.3750)$$

$$A = 77.3925 \text{ FT}^2$$

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:

Reviewed by:

James B. Caldwell
Paul V. d'Entremont

PIECE "D" (QTY = 4)

$$A = 71.5194 \text{ FT}^2$$

$$\text{TOTAL} = 286.0776 \text{ FT}^2$$

AREA OF RECTANGLE

$$A_R = (8.2552)(7.9521)$$

$$A_R = 65.6462 \text{ FT}^2$$


AREA OF TRIANGLE

$$A_T = \left(\frac{1}{2}\right)(8.2552)(1.4229)$$

$$A_T = 5.8732 \text{ FT}^2$$

$$A = 5.8732 + 65.6462$$

$$A = 71.5194 \text{ FT}^2$$

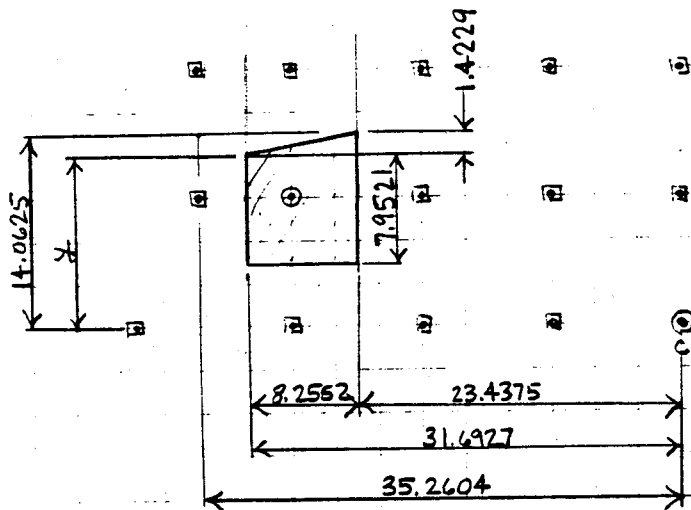SOLVE FOR y

$$y/31.6927 = 14.0625/35.2604$$

$$y = 12.4396$$

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:

Reviewed by:

James B. Caldwell
Paul D. D'Entremont

PIECE "E" (QTY=4)

$$A = 83.2657 \text{ FT}^2$$

$$\text{TOTAL} = 333.0628 \text{ FT}^2$$

AREA OF RECTANGLE

$$A_R = (8.2552)(9.375)$$


$$A_R = 77.3925 \text{ FT}^2$$

AREA OF TRIANGLE

$$A_T = \frac{1}{2}(8.2552)(1.4229)$$

$$A_T = 5.8732 \text{ FT}^2$$

$$A = 83.2657 \text{ FT}^2$$

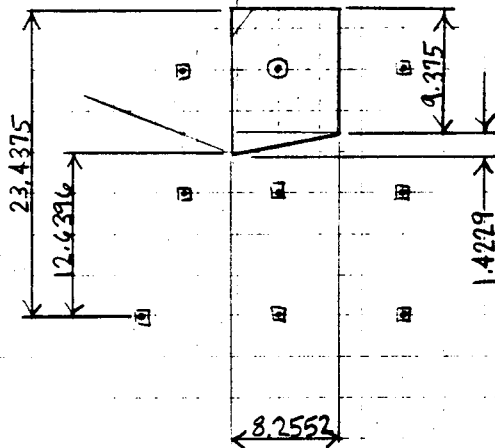

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:


Reviewed by:

Shirley Caldwell
Paul D. d'Entremont

PIECE "F" (QTY = 4)

$$A = 88.5090 \text{ FT}^2$$

$$\text{TOTAL} = 354.0360 \text{ FT}^2$$

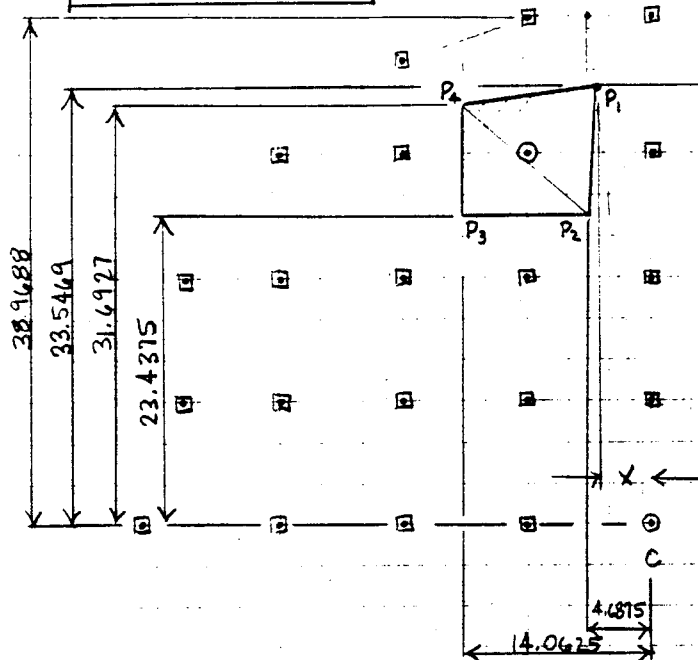

$$x/33.5469 = 4.6875/38.9688$$

$$x = 4.0353$$

AREA OF RIGHT TRIANGLE

$$A = \frac{1}{2} (9.3750) (8.2552)$$

$$A = 38.6962$$

AREA OF LARGE TRIANGLE

$$S = (12.4916 + 10.1972 + 10.1304) \frac{1}{2}$$

$$S = 16.4096$$

$$A_T = \sqrt{16.4096(16.4096 - 12.4916)(16.4096 - 10.1972)(16.4096 - 10.1972)} = 49.8128$$

$$A = 49.8128 + 38.6962 = 88.5090 \text{ FT}^2$$

COORDINATES

$$P_1 (4.0353, 33.5469)$$

$$P_2 (4.6875, 23.4375)$$

$$P_3 (14.0625, 23.4375)$$

$$P_4 (14.0625, 31.6927)$$

 $\overline{P_1 P_2}$:

$$\sqrt{(4.0353 - 4.6875)^2 + (33.5469 - 23.4375)^2}$$

$$= 10.1304$$

 $\overline{P_2 P_3}$

$$14.0625 - 4.6875$$

$$= 9.375$$

 $\overline{P_3 P_4}$

$$31.6927 - 23.4375$$

$$= 8.2552$$

 $\overline{P_4 P_1}$

$$\sqrt{(4.0353 - 14.0625)^2 + (33.5469 - 31.6927)^2}$$

$$= 10.1972$$

 $\overline{P_2 P_4}$

$$\sqrt{(14.0625 - 4.6875)^2 + (31.6927 - 23.4375)^2}$$

$$= 12.4916$$

COMPUTATION SHEET


Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by: *Stan B. Caldwell*Reviewed by: *Paul D. D'Intino*PIECE 'G' (QTV=2)

$$A = 88.1821 \text{ FT}^2$$


$$\text{TOTAL} = 176.3642 \text{ FT}^2$$

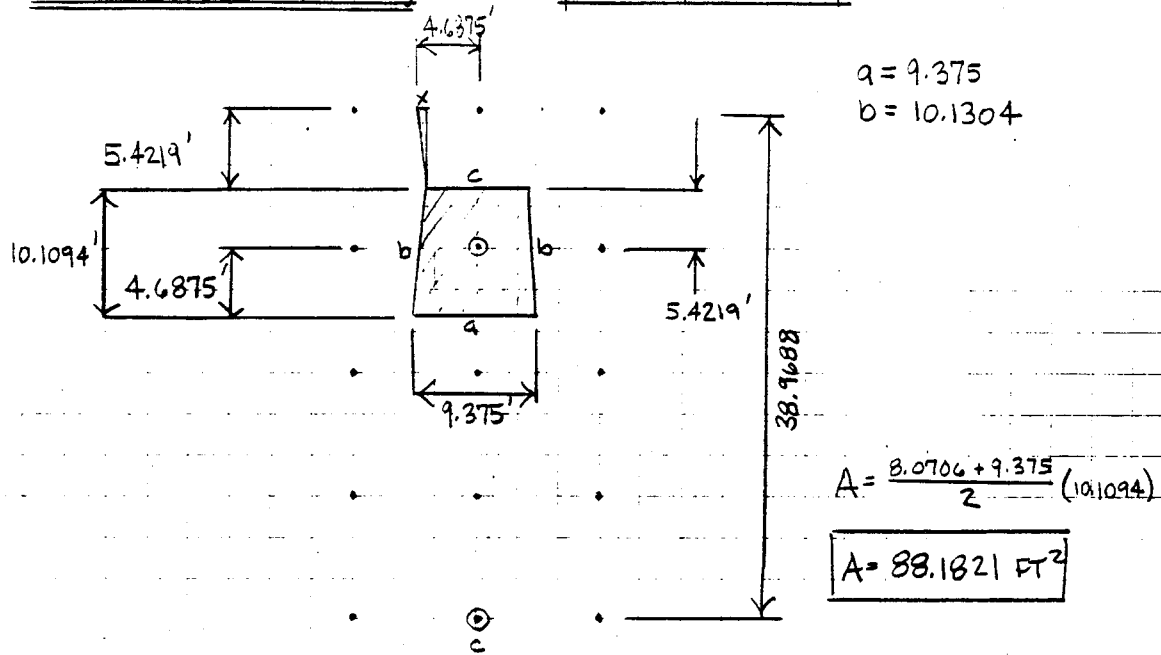

$$X = 4.6875 (5.4219 / 38.9488) = 0.6522'$$

$$C = 9.375 - 2(0.6522) = 8.0706'$$

check 'b' dimension:



$$b = \sqrt{10.109375^2 + 0.6522^2}$$

$$b = 10.13039 \sim 10.1304 \checkmark$$

COMPUTATION SHEET

Tank Closure Program


Type IV Tank Sludge Volume Estimation Method

Computation by: *Shirley B. Caldwell*Reviewed by: *Paul P. D'Intino*

PIECE "H" (QTY = 2)

$$A = 76.3332 \text{ FT}^2$$

$$\text{TOTAL} = 152.6664 \text{ FT}^2$$

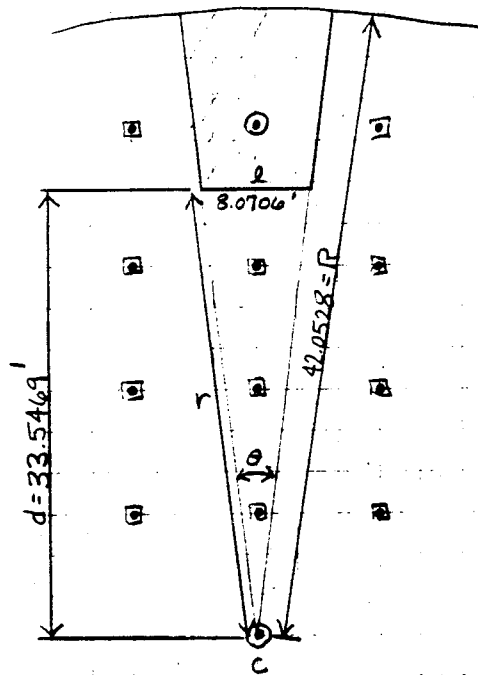

$$l = 2\sqrt{r^2 - d^2}$$

$$\left(\frac{l}{2}\right)^2 = r^2 - d^2$$

$$r = \sqrt{(l/2)^2 + d^2}$$

$$r = \sqrt{(8.0706/2)^2 + 33.5469^2}$$

$$r = 33.7887 \text{ FT}$$

$$\sin \frac{\theta}{2} = \frac{l}{2r}$$

$$\sin \frac{\theta}{2} = 8.0706 / 2(33.7887)$$

$$\theta/2 = 6.8591^\circ$$

$$\theta = 13.7181^\circ$$

AREA OF SECTOR

$$A = \pi R^2 (\theta/360)$$

$$A = \pi (42.0528)^2 (13.7181/360)$$

$$A = 211.7050 \text{ FT}^2$$

AREA OF TRIANGLE

$$A = \frac{1}{2} d l = \frac{1}{2} (33.5469)(8.0706) = 135.3718 \text{ FT}^2$$

AREA OF PIECE

$$A = 211.7050 - 135.3718 = 76.3332 \text{ FT}^2$$

TOTAL AREA
152.6664 FT²

COMPUTATION SHEET


Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by: *Mark G. Bellwell*Reviewed by: *Paul D. D'Entremont*PIECE "I" (QTY = 4)

$$A = 74.5602 \text{ FT}^2$$

$$\text{TOTAL} = 298.2408 \text{ FT}^2$$

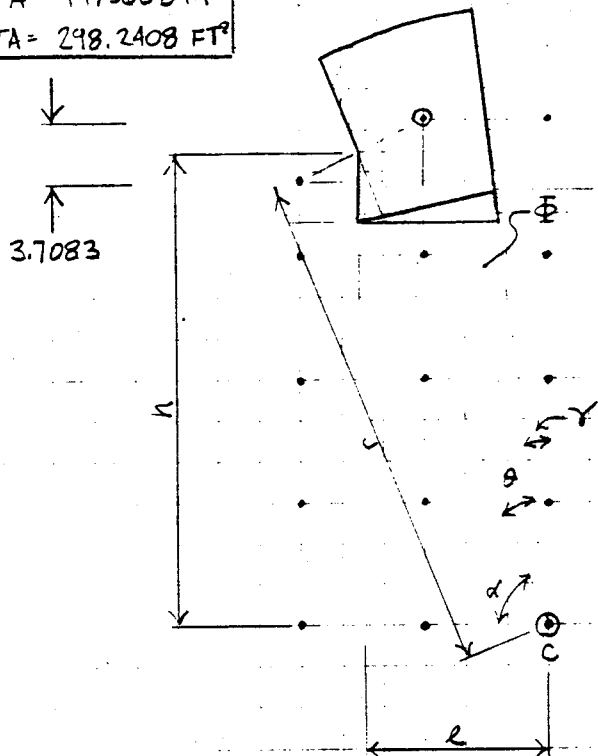DETERMINE θ

$$h = 37.1146'$$

$$l = 14.0625'$$

$$\tan \alpha = 37.1146 / 14.0625$$

$$\alpha = 69.2486^\circ$$

$$\gamma = 6.8591^\circ$$


$$\theta = 90 - (69.2486 + 6.8591)$$

$$\theta = 13.8923^\circ$$

AREA OF SECTOR

$$A = \pi R^2 (\theta / 360)$$

$$A = 214.3934 \text{ FT}^2$$

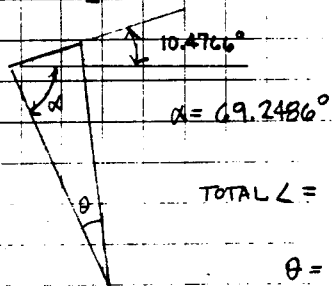TRIANGLE Φ 

$$\text{TOTAL } L = 10.4766 + 69.2486 = 79.7252^\circ$$

$$\theta = 13.8923^\circ$$

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:

Reviewed by:

Theresa E. Edwards
Paul D. D'Amico

PIECE "I" & "F" COMMON LINE CHECK

$b = 0$

$y = mx + b$

$y = mx$

where

$m = \frac{y_2 - y_1}{x_2 - x_1}$

$y_1 = 0$


$x_1 = 0$

$y = \frac{y_2}{x_2} x$

$x = \frac{y x_2}{y_2}$

$x = \frac{33.5469(-4.6875)}{38.9688}$

$x = -4.0353$

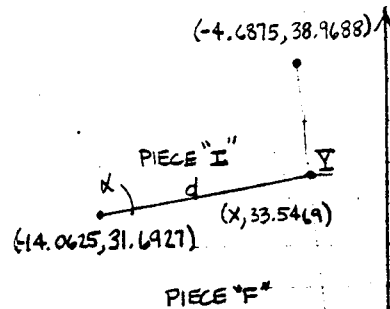


$$d = \sqrt{(-4.0625 + 4.0353)^2 + (31.6927 - 33.5469)^2}$$

$d = 10.1972$

$$\tan \alpha = \frac{33.5469 - 31.6927}{-4.0353 + 14.0625}$$

$\alpha = 10.4766^\circ$

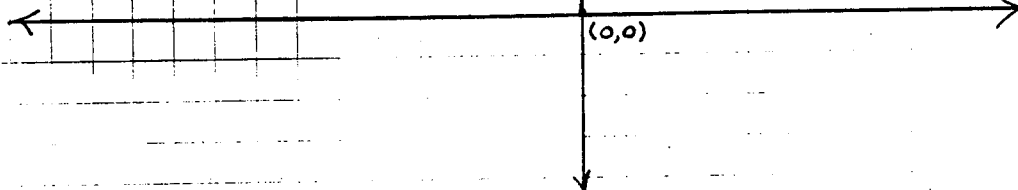

COMPUTATION SHEET

Tank Closure Program


Type IV Tank Sludge Volume Estimation Method.

Computation by:

Reviewed by:

Shirley C. Edwards
Paul V. D'Enten

$$\alpha = 69.2486$$

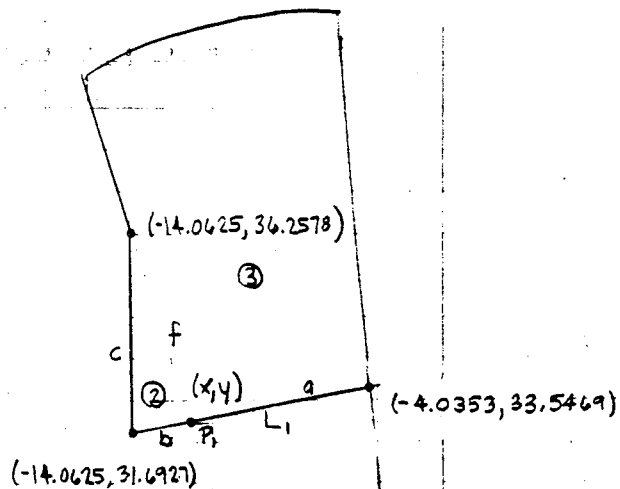LINE L₁:

$$m_1 = \frac{(33.5469 - 31.6927)}{(-4.0353 + 14.0625)}$$

$$m_1 = 0.184917$$

$$b_1 = y - mx$$

$$b_1 = 33.5469 - 0.184917(-4.0353)$$

$$b_1 = 34.2931$$

LINE L₂:

$$m_2 = -2.57833$$

$$b_2 = 0$$

At P₁

$$x = \frac{b_2 - b_1}{m_1 - m_2} = \frac{0 - 34.2931}{0.184917 + 2.57833}$$

$$x = -12.4104 \leftarrow$$

$$y = m_2 x + b_2$$

$$y = -2.57833(-12.4104)$$

$$y = 31.9982 \leftarrow$$

$$a = \sqrt{(-4.0353 + 12.4104)^2 + (33.5469 - 31.9982)^2}$$

$$a = 8.5171$$

$$b = \sqrt{(-12.4104 + 14.0625)^2 + (31.9982 - 31.6927)^2}$$

$$b = 1.6801$$

$$c = 36.2578 - 31.6927$$

$$c = 4.5651$$

$$d = \sqrt{(-4.0353)^2 + (33.5469)^2}$$

$$d = 33.7887$$

$$e = \sqrt{(-12.4104)^2 + (31.9982)^2}$$

$$e = 34.3206$$

TRIANGLE ②

$$S = (34.3206 + 33.7887 + 8.5171) \frac{f}{2}$$

$$S = 38.3132$$

$$A = \sqrt{38.3132(38.3132 - 34.3206)(38.3132 - 33.7887)(38.3132 - 8.5171)}$$

$$A = 143.6042$$

$$f = \sqrt{(-14.0625 + 12.4104)^2 + (36.2578 - 31.9982)^2}$$

$$f = 4.5688$$

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:

Reviewed by:

Paul B. Caldwell
Paul D. D'Eriano

TRIANGLE ②

$$s = (4.5688 + 4.5651 + 1.6301) \frac{1}{2}$$

$$s = 5.4070$$

$$A = \sqrt{5.4070(5.4070 - 4.5688)(5.4070 - 4.5651)(5.4070 - 1.6301)}$$

$$A = 3.7710$$

$$\text{AREA ③} = \text{AREA OF SEGMENT} + \text{AREA OF TRIANGLE ②} - \text{AREA OF TRIANGLE ①}$$

$$\text{AREA ③} = 214.3934 + 3.7710 - 143.6042$$

$$A = 74.5602 \text{ FT}$$

TOTAL AREA

298.2408

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:


Reviewed by:

John B. Caldwell
Paul D. d'Amico

PIECE "J" (QTY = 4)

$$A = 56.1070 \text{ FT}^2$$

$$\text{TOTAL} = 224.4280 \text{ FT}^2$$

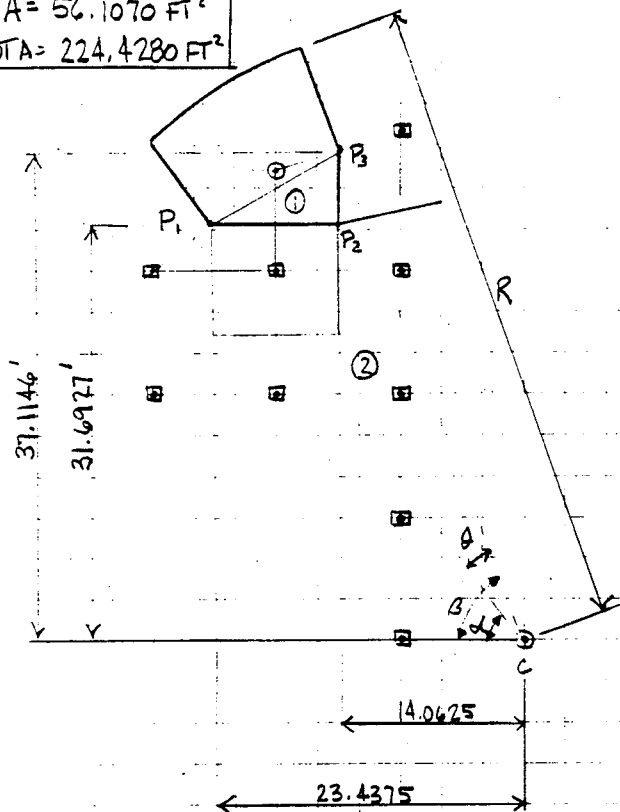

$$R = 42.0528'$$

$$\tan \beta = 37.1146 / 14.0625$$

$$\beta = 69.2486^\circ$$

$$\tan \alpha = 31.6927 / 23.4375$$

$$\alpha = 53.5162^\circ$$

$$\theta = 15.7324^\circ$$

AREA OF SECTOR

$$A = \pi R^2 (\theta / 360)$$

$$A = \pi (42.0528)^2 (15.7324 / 360)$$

$$A = 242.7908$$

AREA OF SMALL TRIANGLE

$$A = \frac{1}{2}bh = \frac{1}{2}(23.4375 - 14.0625)(37.1146 - 31.6927)$$

$$A = 25.4152$$

LENGTH BETWEEN P_2 & P_1

$$d_1 = \sqrt{(37.1146 - 31.6927)^2 + (14.0625 - 23.4375)^2}$$

$$d_1 = 10.8299$$

LENGTH BETWEEN P_2 & C

$$d_3 = \sqrt{37.1146^2 + 14.0625^2}$$

LENGTH BETWEEN P_1 & C

$$d_2 = \sqrt{31.6927^2 + 23.4375^2} = 39.4176$$

$$d_3 = 39.6894$$



COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:

Reviewed by:

AREA OF LARGE TRIANGLE

$$s = \frac{d_1 + d_2 + d_3}{2} = \frac{10.8299 + 39.4176 + 39.6894}{2} = 44.9685$$

$$A = \sqrt{44.9685(44.9685 - 10.8299)(44.9685 - 39.4176)(44.9685 - 39.6894)}$$

$$A = 212.0990 \text{ FT}^2$$

$$\text{AREA OF PIECE "J"} = \text{AREA OF SECTOR} + \text{AREA OF SMALL TRIANGLE} - \text{AREA OF LARGE TRIANGLE}$$

$$A = 242.7908 + 25.4152 - 212.0990$$

$$A = 56.1070 \text{ FT}^2$$

COMPUTATION SHEET

Tank Closure Program


Type IV Tank Sludge Volume Estimation Method

Computation by: *Paul D. D'Amico*Reviewed by: *Paul D. D'Amico*PIECE "K" (QTY = 4)

$$R = 42.0528$$

$$A = 69.3719 \text{ FT}^2$$

$$\text{TOTAL} = 277.4876 \text{ FT}^2$$

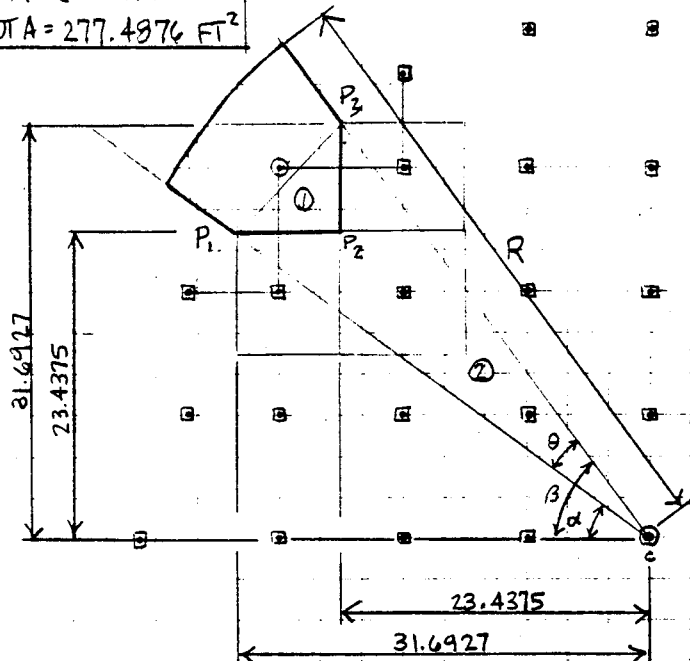

$$\tan \beta = 31.6927 / 23.4375$$

$$\beta = 53.5162^\circ$$

$$\tan \alpha = 23.4375 / 31.6927$$

$$\alpha = 36.4838^\circ$$

$$\theta = \beta - \alpha = 53.5162 - 36.4838$$

$$\theta = 17.0324^\circ$$

AREA OF SECTOR:

$$A = \pi R^2 (\theta / 360)$$

$$A = \pi (42.0528)^2 (17.0324 / 360)$$

$$A = 262.8531 \text{ FT}^2$$

AREA OF SMALL TRIANGLE:

$$A = \frac{1}{2}bh$$

$$A = \frac{1}{2}(31.6927 - 23.4375)(31.6927 - 23.4375)$$

$$A = 34.0742 \text{ FT}^2$$

AREA OF PIECE

$$A = 262.8531 - 227.5554 + 34.0742$$

$$A = 69.3719 \text{ FT}^2$$

$$\overline{P_1C} \text{ BY SYMMETRY} = \overline{P_2C}$$

$$\overline{P_1C} = \overline{P_2C} = \sqrt{31.6927^2 + 23.4375^2} = 39.4176$$

$$\overline{P_3P_1} = \sqrt{2(31.6927 - 23.4375)^2} = 11.6746$$

$$S = (2(39.4176) + 11.6746) \frac{1}{2} = 45.2549$$

AREA OF LARGE TRIANGLE:

$$A = \sqrt{45.2549(45.2549 - 39.4176)^2(45.2549 - 11.6746)}$$

$$A = 227.5554 \text{ FT}^2$$

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by: *Thomas B. Caldwell*Reviewed by: *Paul D. d'Entremont*PIECE "L" (QTY = 4) $R = 42.0528$

$$A = 56.3807 \text{ FT}^2$$

$$\text{TOTAL} = 225.5228 \text{ FT}^2$$

$$\tan \alpha = 14.0625 / 35.2604$$


$$\alpha = 21.7430^\circ$$

$$\tan \beta = 23.4375 / 31.6927$$

$$\beta = 36.4838^\circ$$

$$\theta = 36.4838 - 21.7430$$

$$\theta = 14.7408^\circ$$

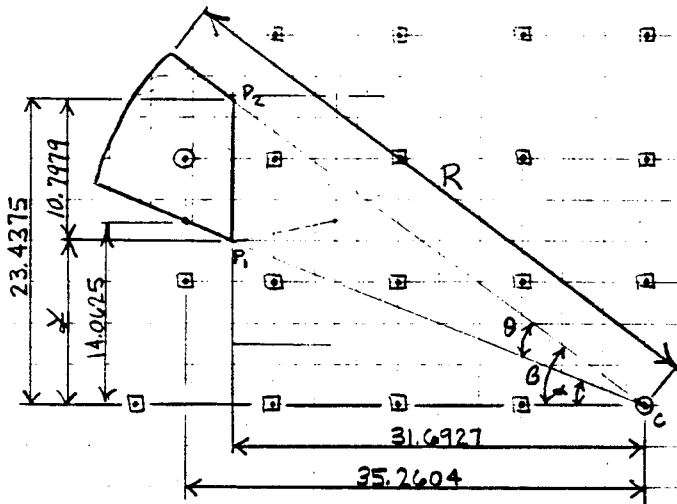

AREA OF SECTOR:

$$A = \pi R^2 (\theta / 360)$$

$$A = \pi (42.0528)^2 (14.7408 / 360)$$

$$A = 227.4879 \text{ FT}^2$$

$$\overline{P_1C} = \sqrt{(12.6396)^2 + (31.6927)^2}$$

$$\overline{P_1C} = 34.1202$$

$$\overline{P_2C} = \sqrt{(23.4375)^2 + (31.6927)^2}$$

$$\overline{P_2C} = 39.4176$$

SOLVE FOR y

$$\frac{y}{31.6927} = \frac{14.0625}{35.2604}$$

$$y = 12.6396$$

$$S = \frac{34.1202 + 39.4176 + 10.7979}{2}$$

$$S = 42.16785$$

AREA OF TRIANGLE

$$A = \sqrt{42.16785(42.16785 - 34.1202)(42.16785 - 39.4176)(42.16785 - 10.7979)}$$

$$A = 171.1072 \text{ FT}^2$$

$$A = 227.4879 - 171.1072$$

$$A = 56.3807$$

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:

Reviewed by:

PIECE "M" (QTY = 4)

 $R = 42.0528$

$$A = 84.3123 \text{ FT}^2$$

$$\text{TOT } A = 337.2492 \text{ FT}^2$$

$$\tan \alpha = (9.375/2) / 35.2604$$

$$\alpha = 7.5725^\circ$$

$$\tan \beta = 14.0625 / 35.2604$$

$$\beta = 21.7430^\circ$$

$$\theta = \beta - \alpha = 21.7430 - 7.5725$$


$$\theta = 14.1705^\circ$$

AREA OF SECTOR:

$$A = \pi R^2 (\theta / 360)$$

$$A = \pi (42.0528)^2 (14.1705 / 360)$$

$$A = 218.6867 \text{ FT}^2$$

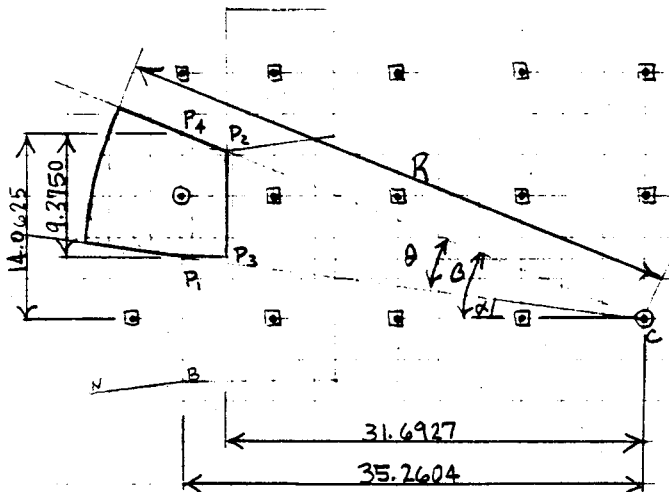 $\overline{P_2 P_3}$:

$$(12.6396 - 9.375/2) = 7.9521$$

 $\overline{P_1 P_3}$:

$$(35.2604 - 31.6927) = 3.5677$$

 $\overline{P_1 P_2}$:

$$\sqrt{(7.9521)^2 + (3.5677)^2} = 8.7158$$

FIND COORD. FOR P_2

$$y / 31.6927 = 14.0625 / 35.2604$$

$$y = 12.6396$$

 $\overline{P_1 C}$:

$$\sqrt{(9.375/2)^2 + (35.2604)^2} = 35.5706$$

AREA OF SMALL TRIANGLE

$$A = \frac{1}{2}bh = \frac{1}{2}(3.5677)(7.9521) = 14.1854 \text{ FT}^2$$

 $\overline{P_2 C}$:

$$\sqrt{(12.6396)^2 + (31.6927)^2} = 34.1202$$

AREA OF LARGE TRIANGLE

$$S = \frac{1}{2}(35.5706 + 34.1202 + 8.7158)$$

$$s = 39.2033$$

$$A = \sqrt{39.2033(39.2033 - 35.5706)(39.2033 - 34.1202)(39.2033 - 8.7158)} = 148.5598 \text{ FT}^2$$

$$\text{AREA} = 218.6867 - 148.5598 + 14.1854 = 84.3123 \text{ FT}^2$$

COMPUTATION SHEET

Tank Closure Program

Type IV Tank Sludge Volume Estimation Method

Computation by:

Reviewed by:

PIECE "N" (QTY = 2) $R = 42.0528$

$$\boxed{A = 88.2620 \text{ FT}^2}$$

$$\text{TOT } A = 176.5240 \text{ FT}^2$$

$$\tan \frac{\theta}{2} = (9.375/2) / 33.5469$$

$$\frac{\theta}{2} = 7.9544^\circ$$

$$\theta = 15.9088^\circ$$

AREA OF SECTOR

$$A = \pi R^2 (\theta / 360)$$

$$A = \pi (42.0528)^2 (15.9088 / 360)$$

$$A = 245.5131 \text{ FT}^2$$


AREA OF TRIANGLE

$$A_t = \frac{1}{2}bh = \frac{1}{2}(9.375)(33.5469)$$

$$A_t = 157.2511 \text{ FT}^2$$

$$A = 245.5131 - 157.2511$$

$$\boxed{A = 88.2620 \text{ FT}^2}$$

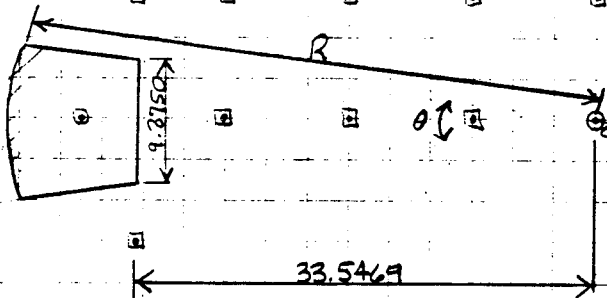

Distribution for WSRC-TR-97-0066, "Characterization of Tank 17 Residual Waste,"
Revision 1, 22 September 1997

L. T. Ling, 703-H
G. R. Hannah, 703-H

M. S. Hay, 703-H
S. D. Fink, 773-A
J. R. Cook, 773-43A
L. B. Collard (c/o J. R. Cook, 773-43A)

R. K. Cauthen, 704-S
J. L. Newman, 703-H

T. M. Monahan, 703-H
V. G. Dickert, 703-H
B. L. Lewis, 703-H
M. C. Chandler, 703-H
J. R. Hester, 703-H
E. Saldivar, 742-4G
T. B. Caldwell, 742-4G
P. D. d'Entremont, 703-H

CSTE File Code 301.7
Central Files