



U.S.NRC

United States Nuclear Regulatory Commission

Protecting People and the Environment

Secondary Plant Systems

- AP1000 TECHNOLOGY SECTIONS:**
- 7.1 MAIN STEAM SUPPLY SYSTEM**
 - 7.2 CONDENSATE & FEEDWATER**
 - 7.3 STARTUP FEEDWATER SYSTEM**
 - 7.4 BOP SYSTEMS**



7.1 Main Steam Supply System Objectives


- 1. State the purposes of the main steam supply system.**
- 2. Describe the major differences between the main steam supply systems of the AP1000 & currently operating Westinghouse plants.**



Main Steam Supply System Purposes

- 1. Transfer steam from the steam generators to the turbine-generator & other secondary system components,**
- 2. Provide overpressure protection for the steam generators, and**
- 3. Provide a path for decay heat removal.**

Fig. 7.1-1

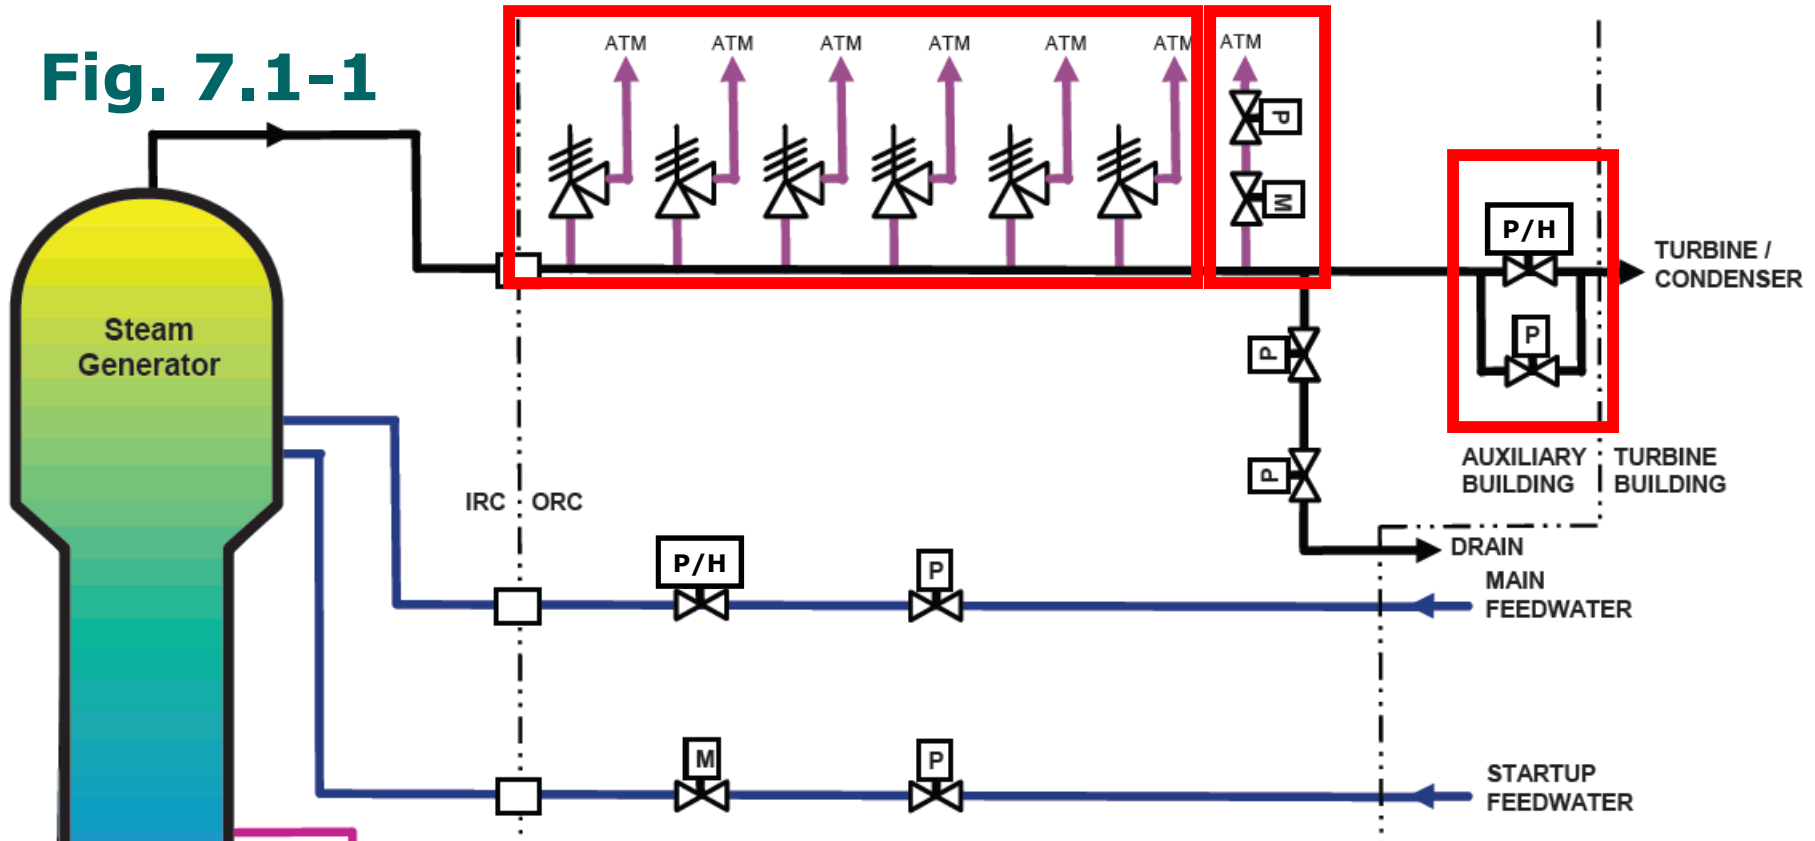

Safety related up to main steam isolation & bypass valve in each steam line.
Major components:

- **Main steam safety valves**
- **Power-operated atmospheric dump valve with iso. valve**
- **MSIV with bypass valve**



Main Steam Isolation Signals

- **Low steam line pressure (either line),**
- **High containment pressure**
- **High negative steam pressure rate (either line)**
- **Low T_{cold} (either RCS loop), and**
- **Manual**


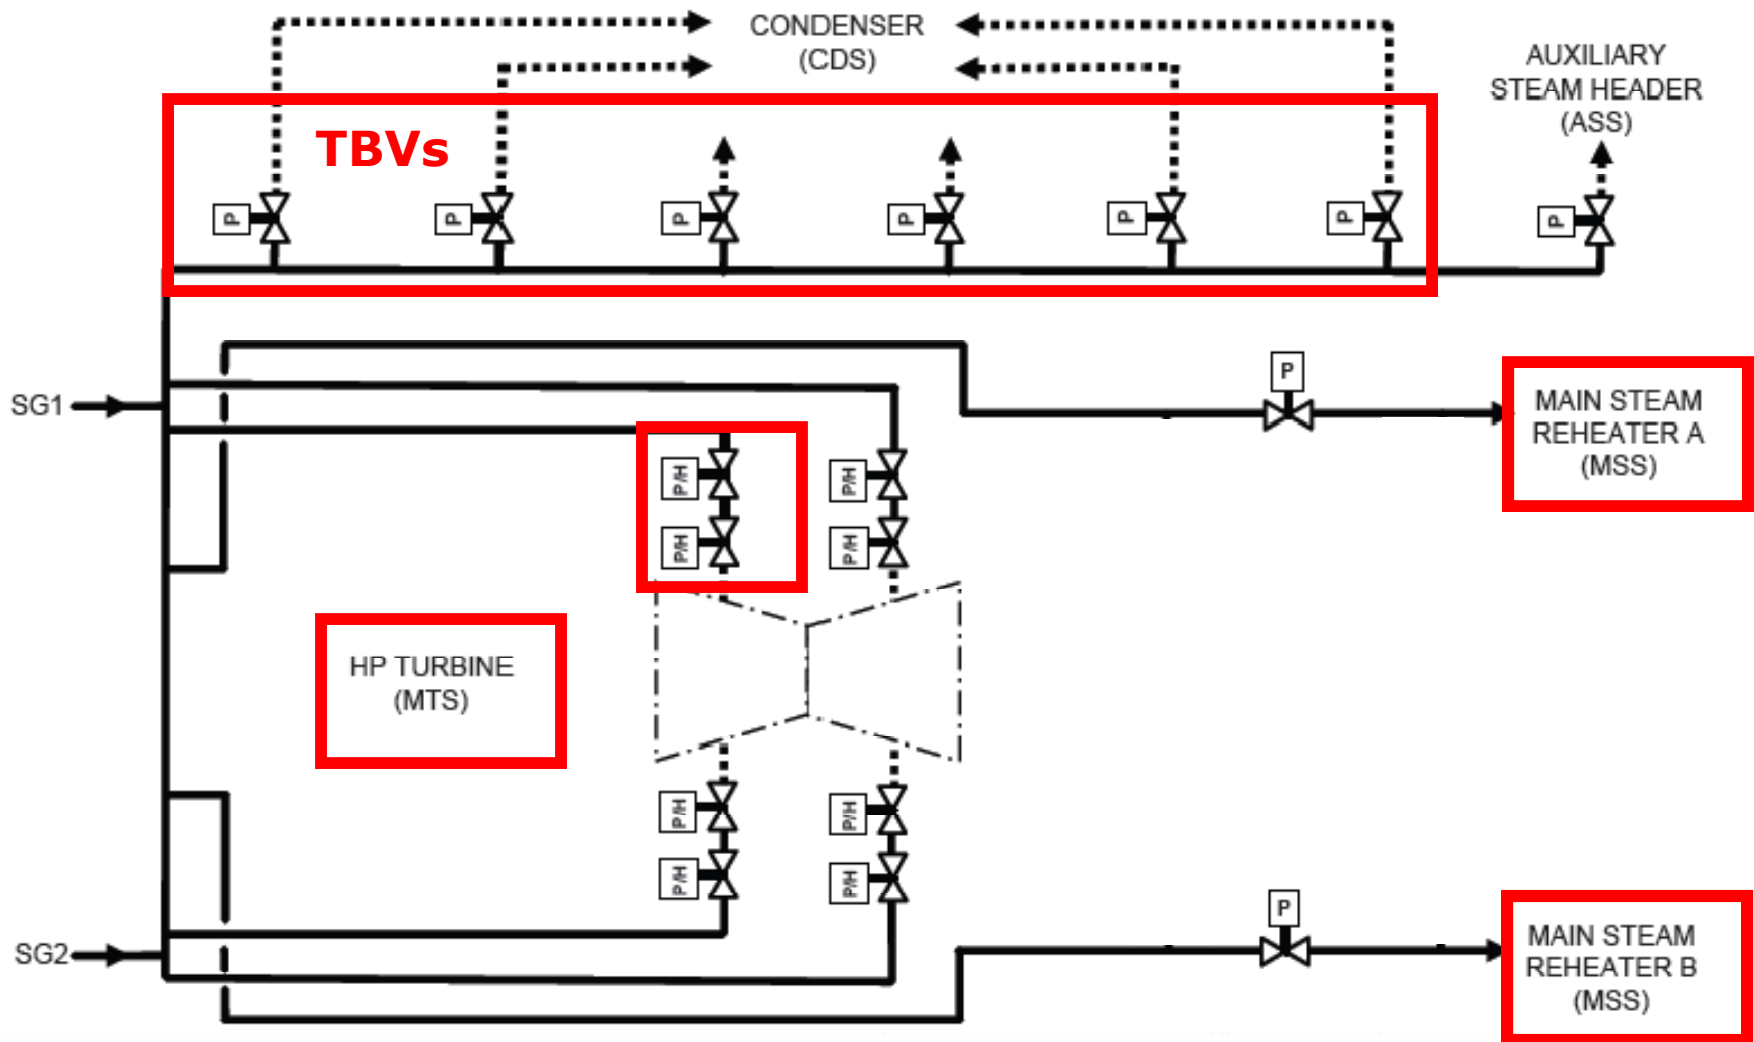


Fig. 7.1-2
Extension of Main Steam Piping

Fig. 7.1-3



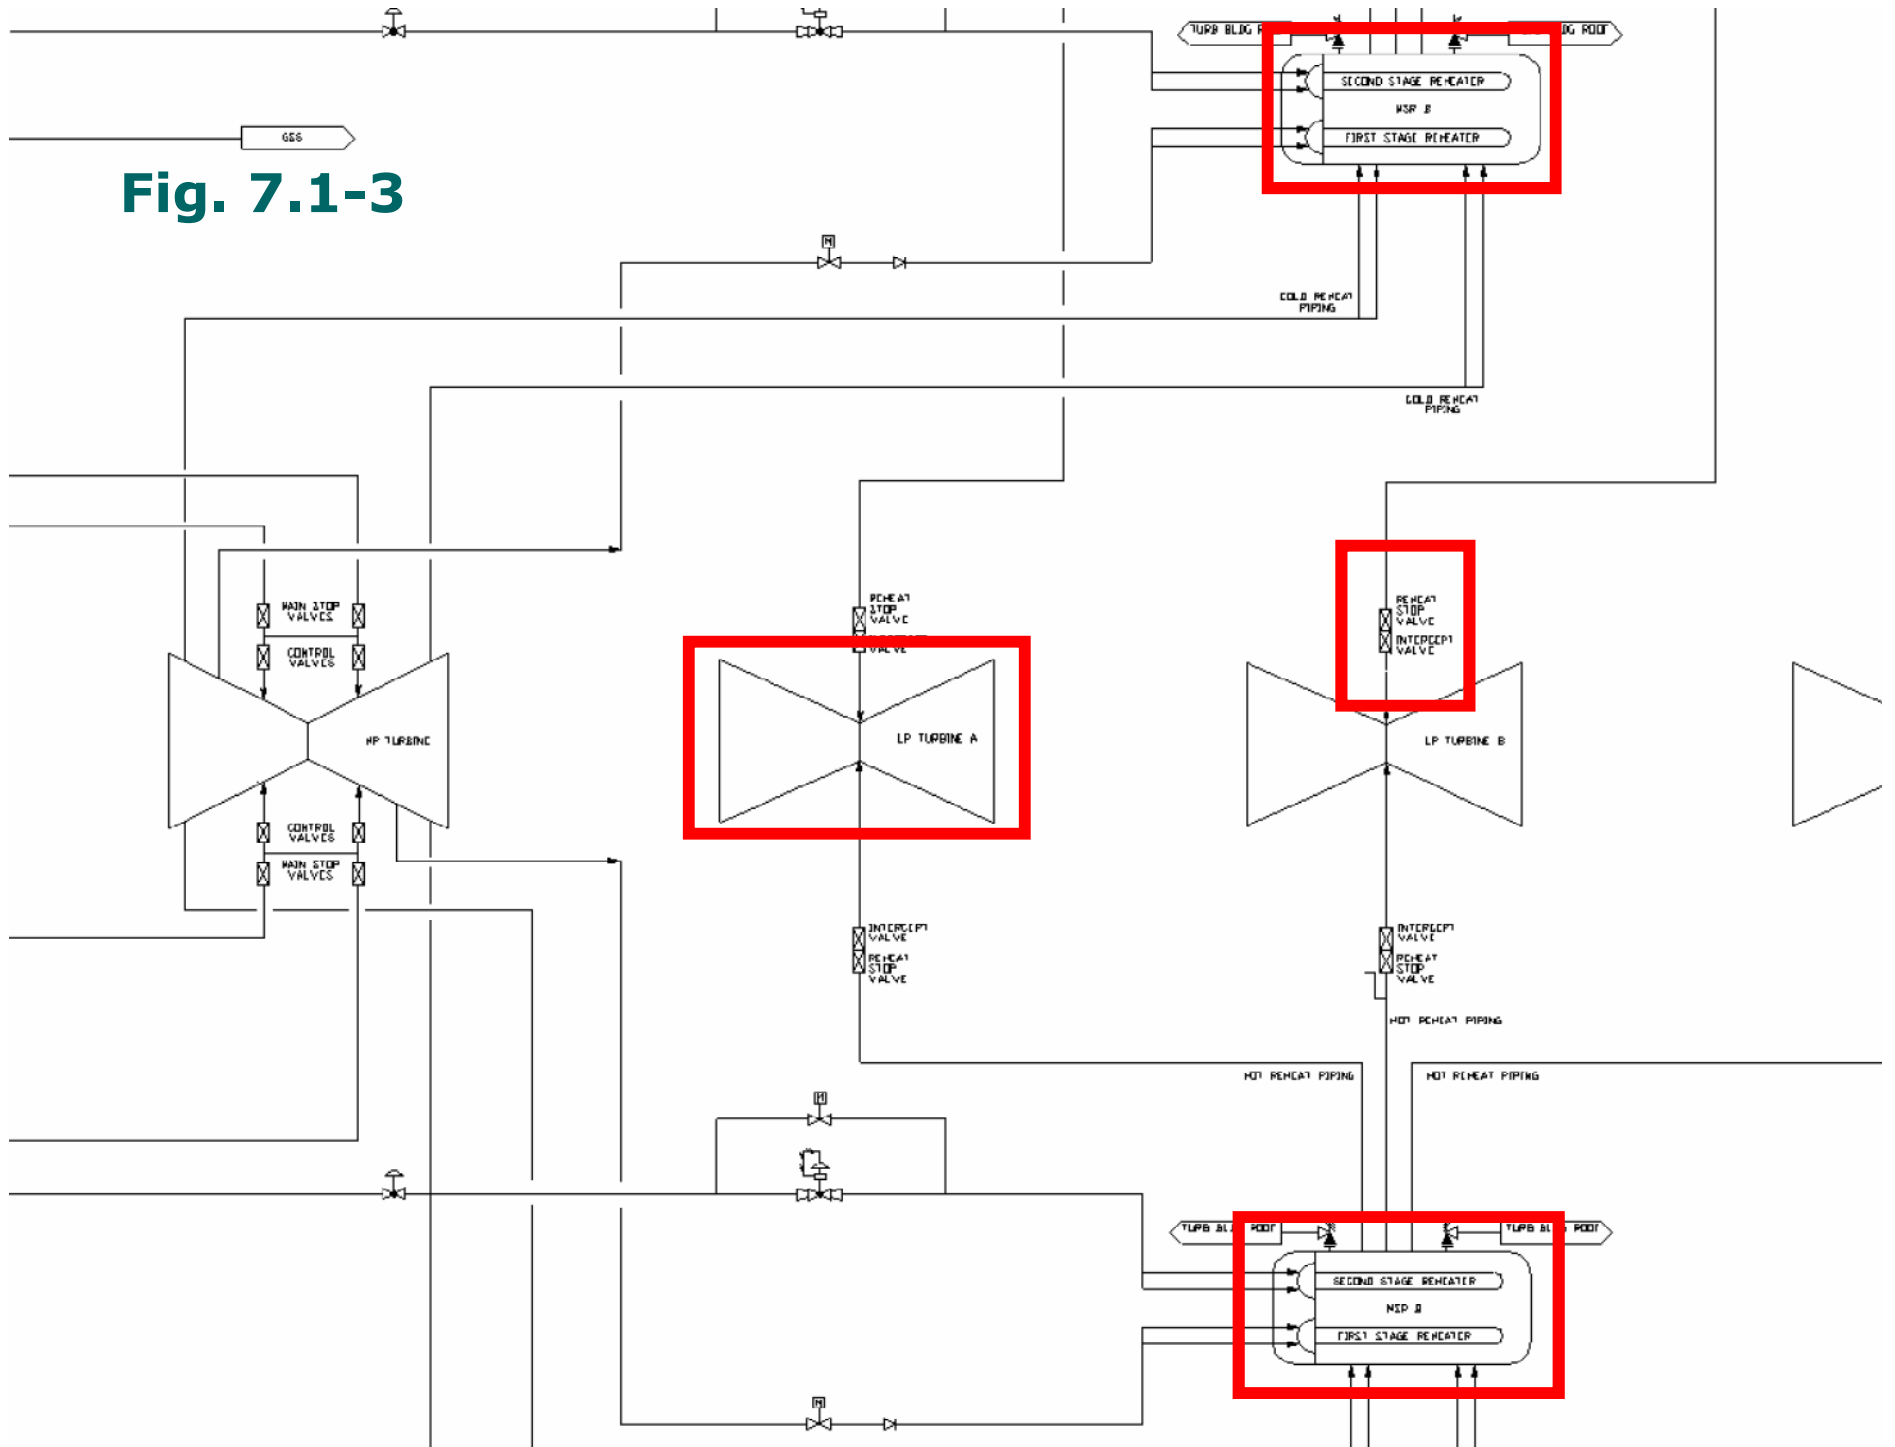

7.1 Main Steam Supply System Objective 2

Major differences?

Nothing major.



7.2 Condensate & Feedwater System Objectives

- 1. State the purposes of the condensate & feedwater system.**
- 2. Describe the major differences between the condensate & feedwater systems of the AP1000 & currently operating Westinghouse plants.**



Condensate & Feedwater System Purposes

- 1. To transfer water from the main condenser to the steam generators & to preheat it,**
- 2. To collect & distribute heater drains, and**
- 3. To purify secondary water & to maintain secondary chemistry control.**

Fig. 7.2-1

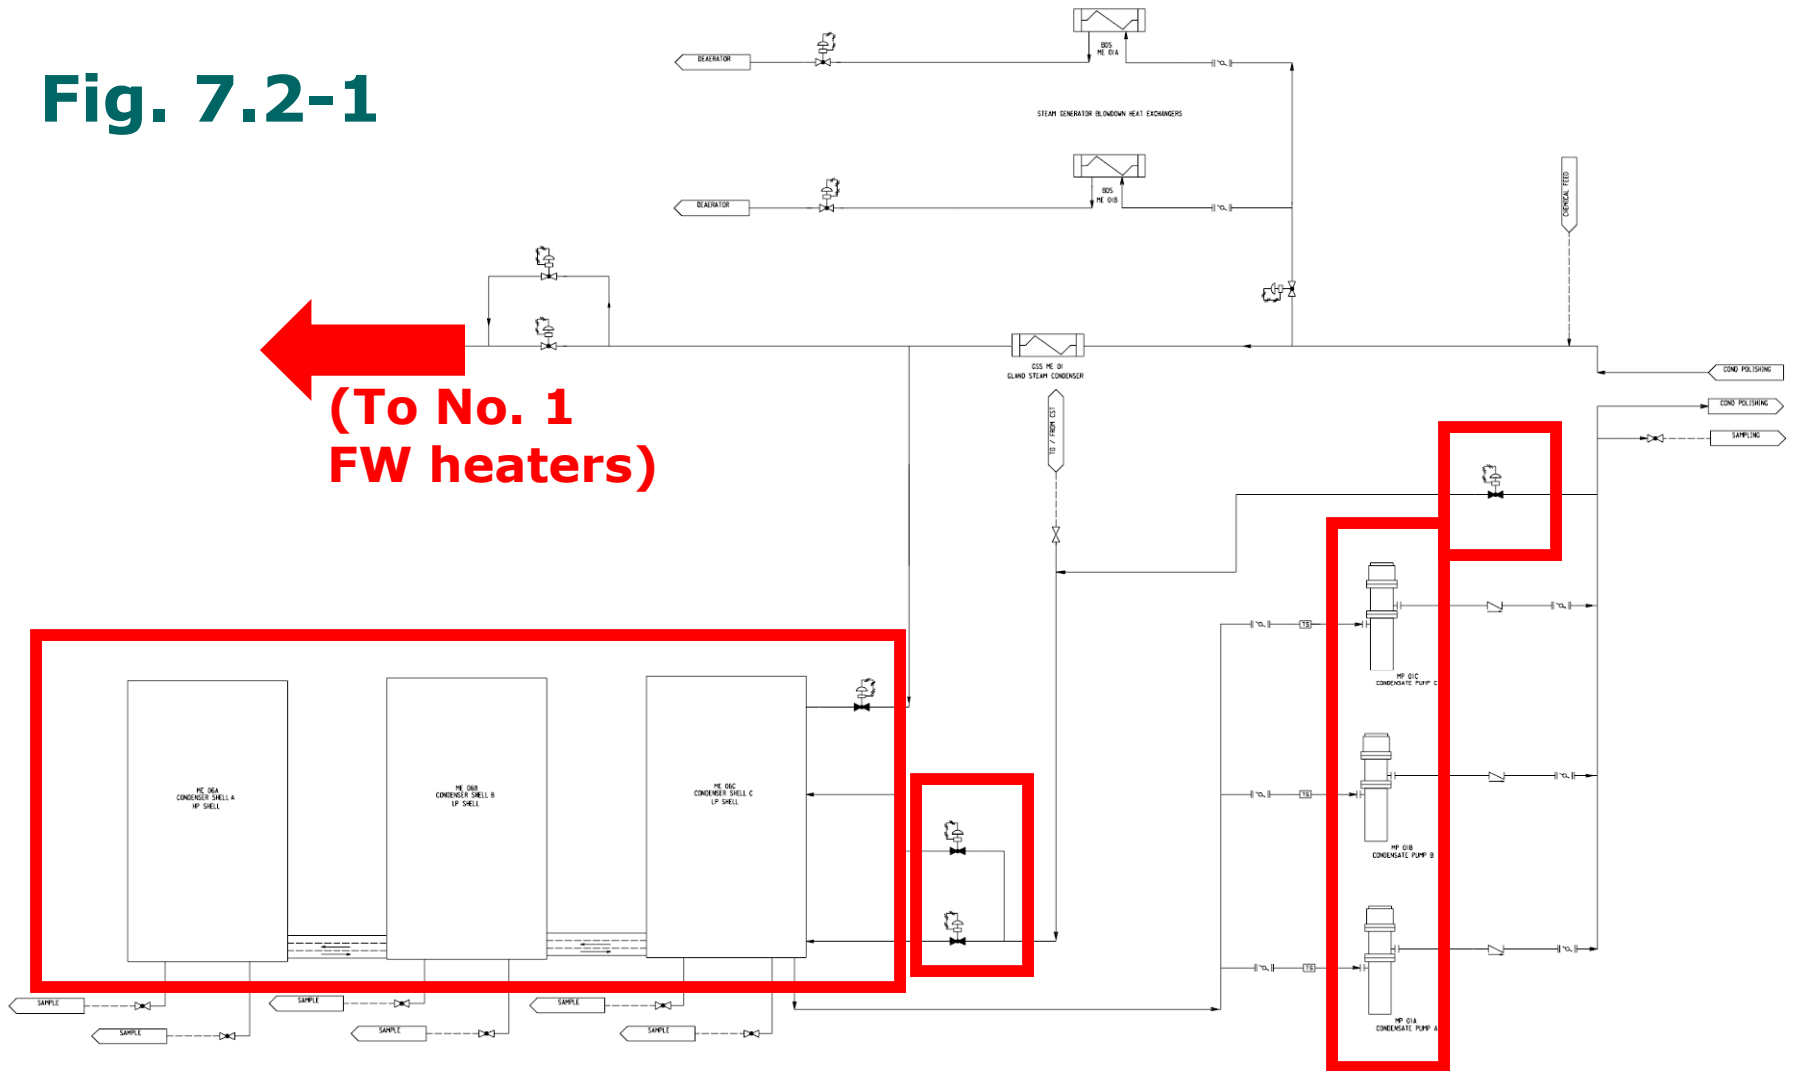


Fig. 7.2-2


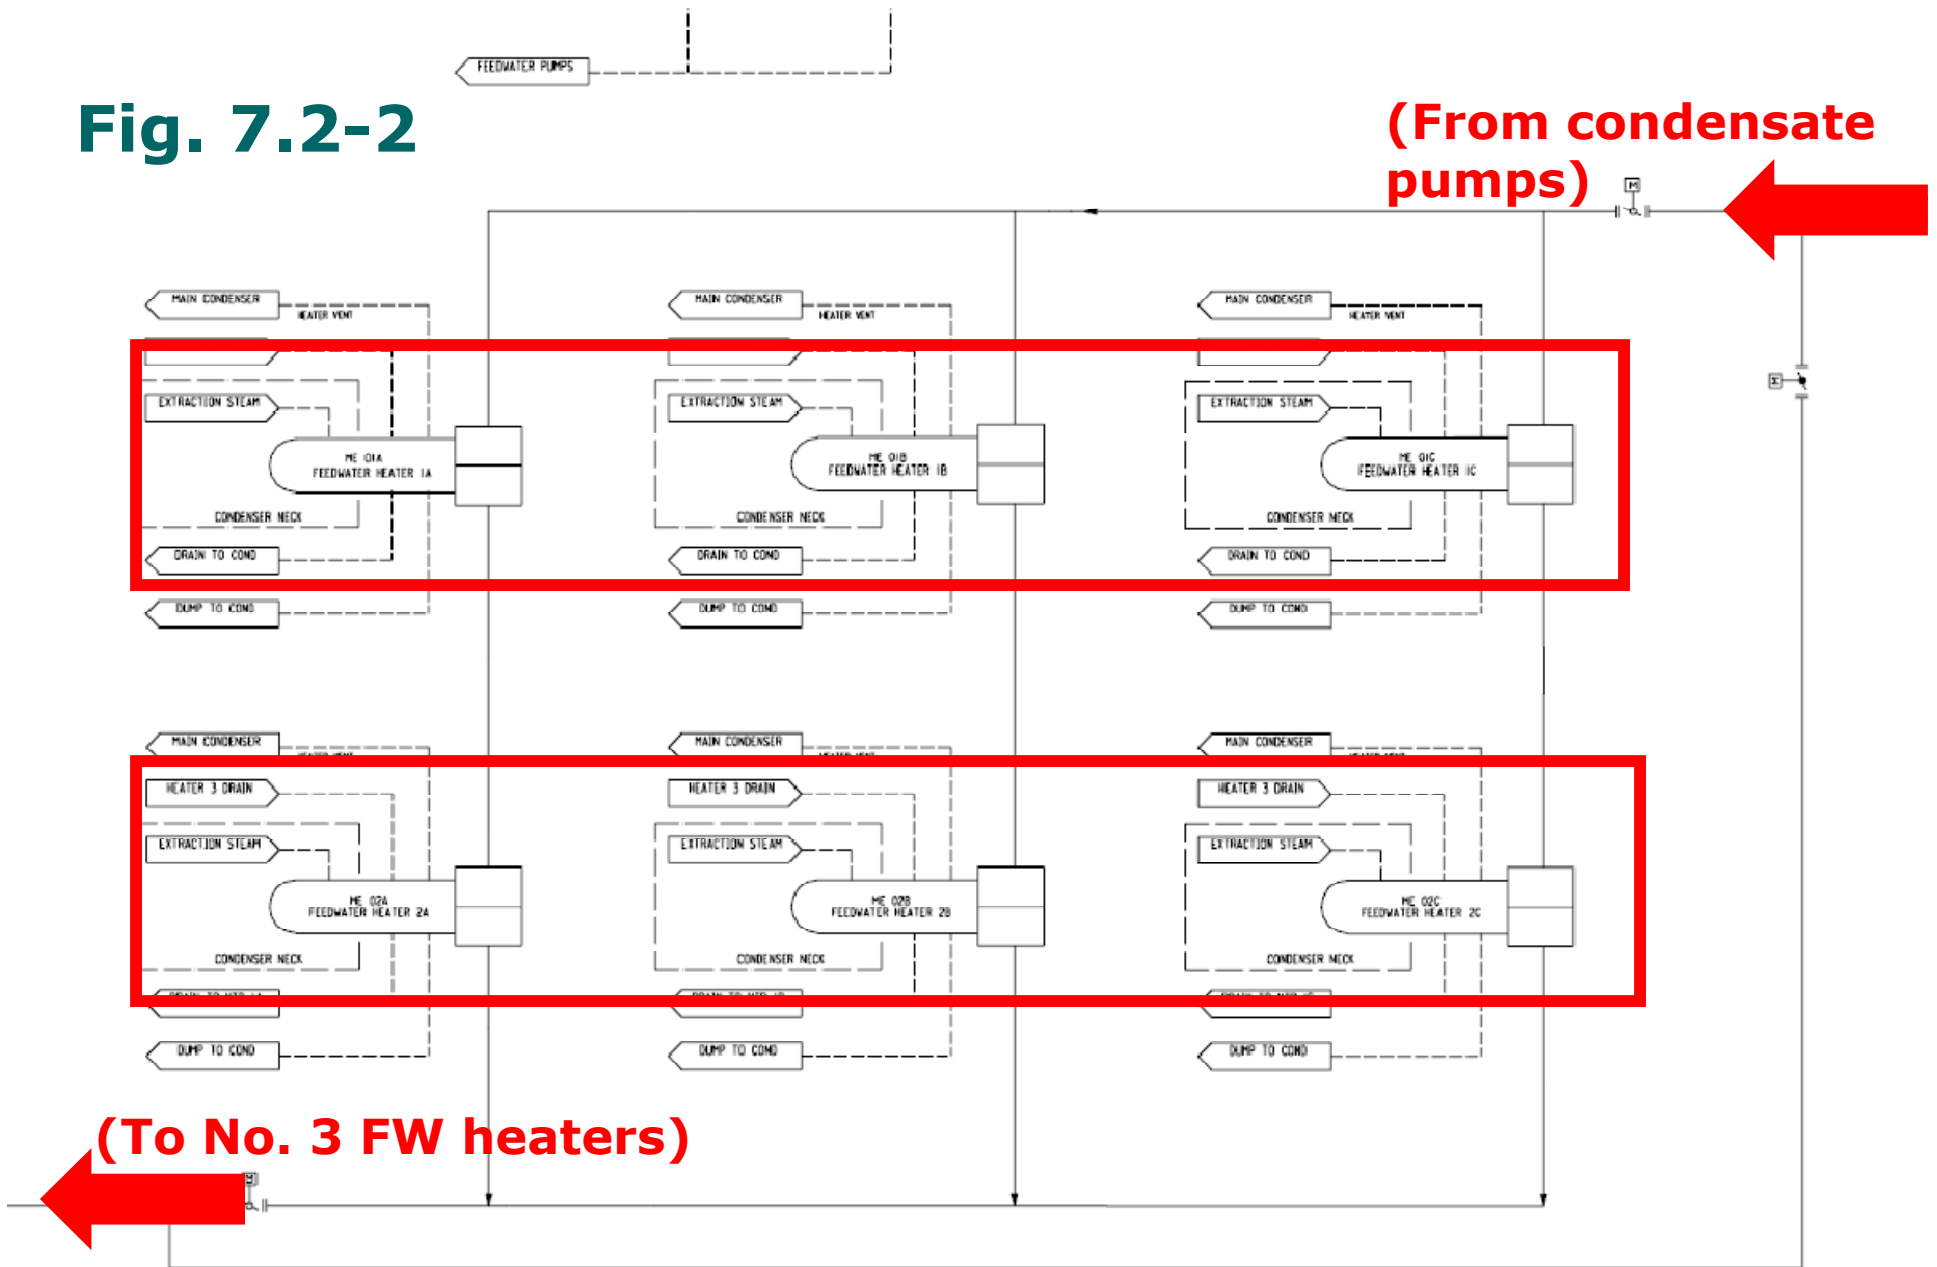


Fig. 7.2-2

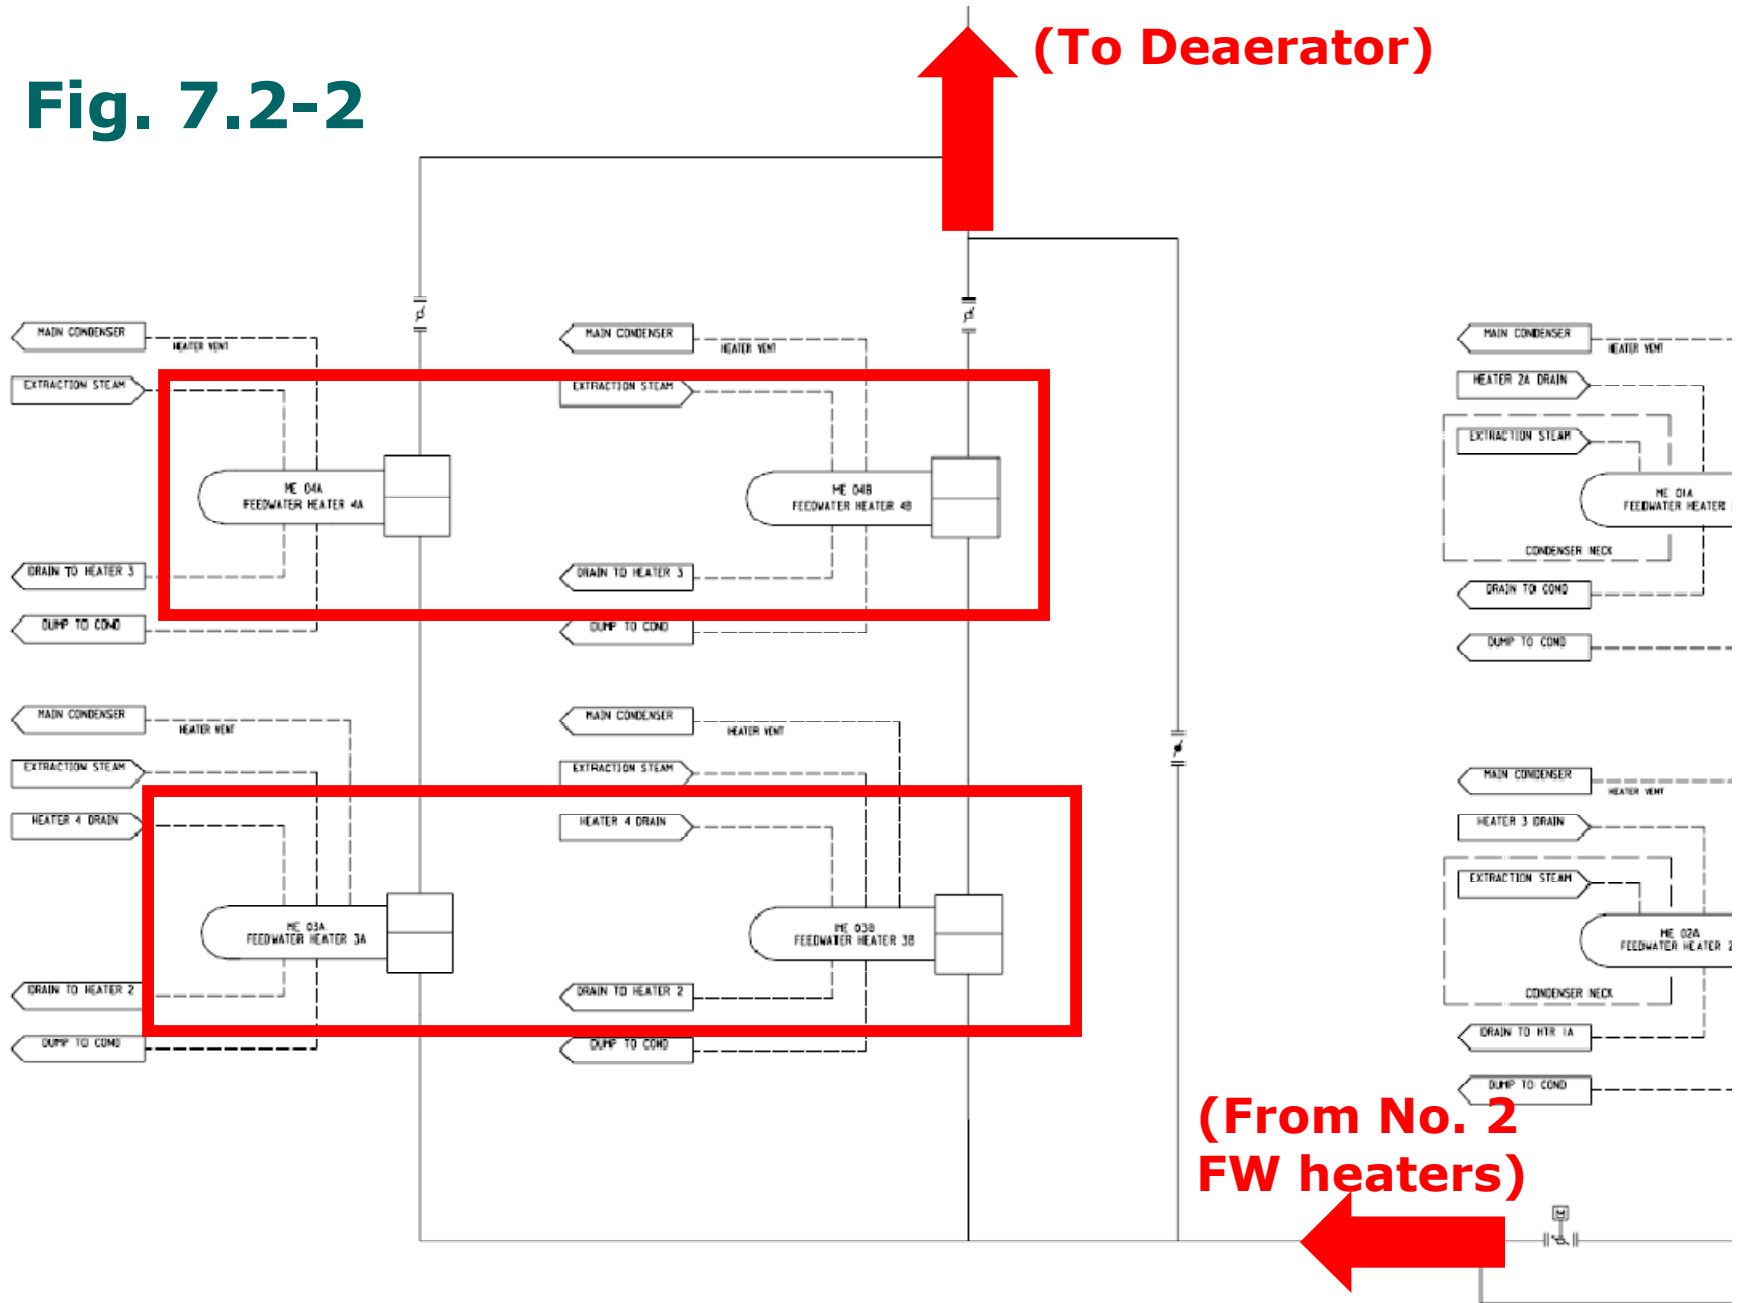

LP Heaters – Simplified Diagram


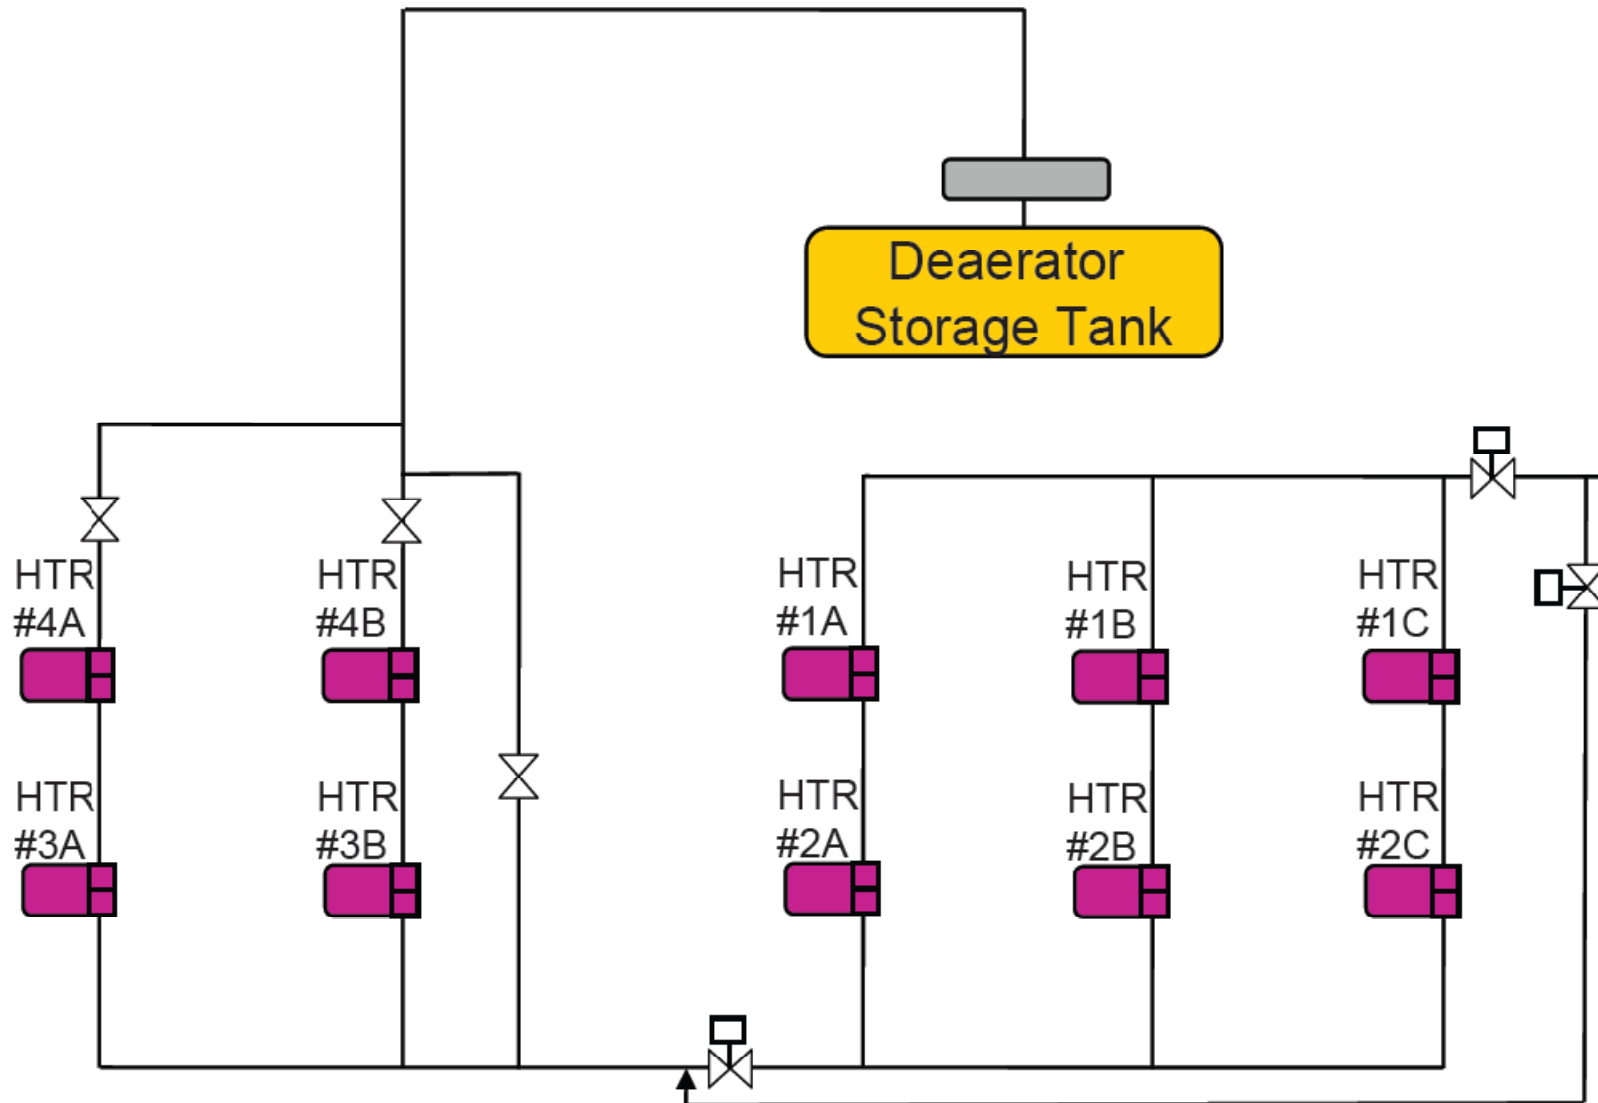


Fig. 7.2-2

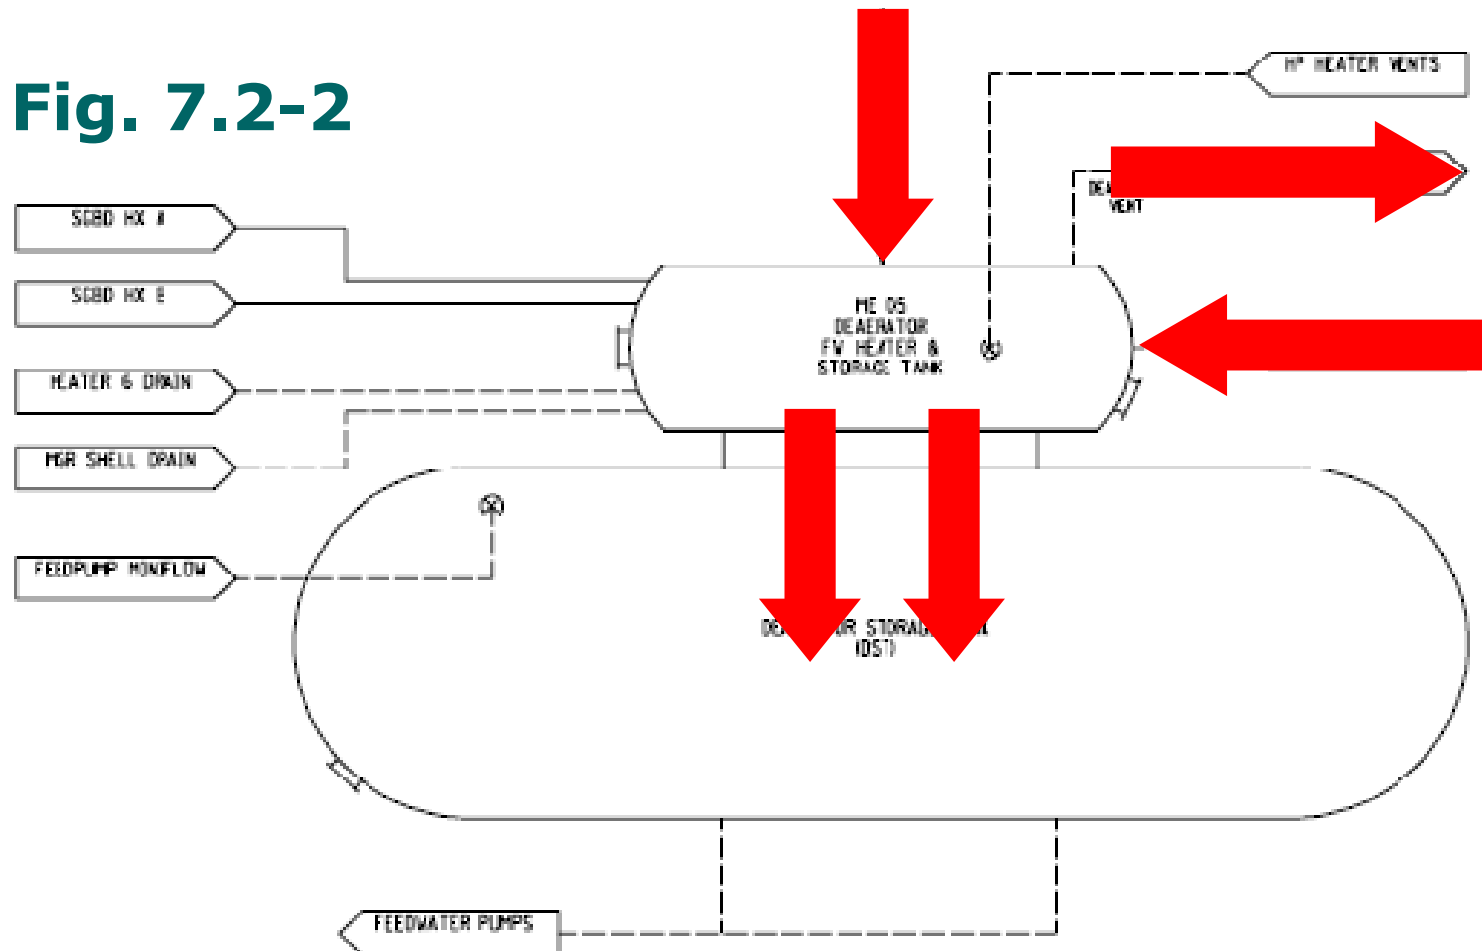

Deaerator (also an open FW heater)

- HP turbine exhaust steam for heating
- FW cascades through tray section
- Dissolved gases come out of solution, vent to condenser
- Heated condensate collects in DST



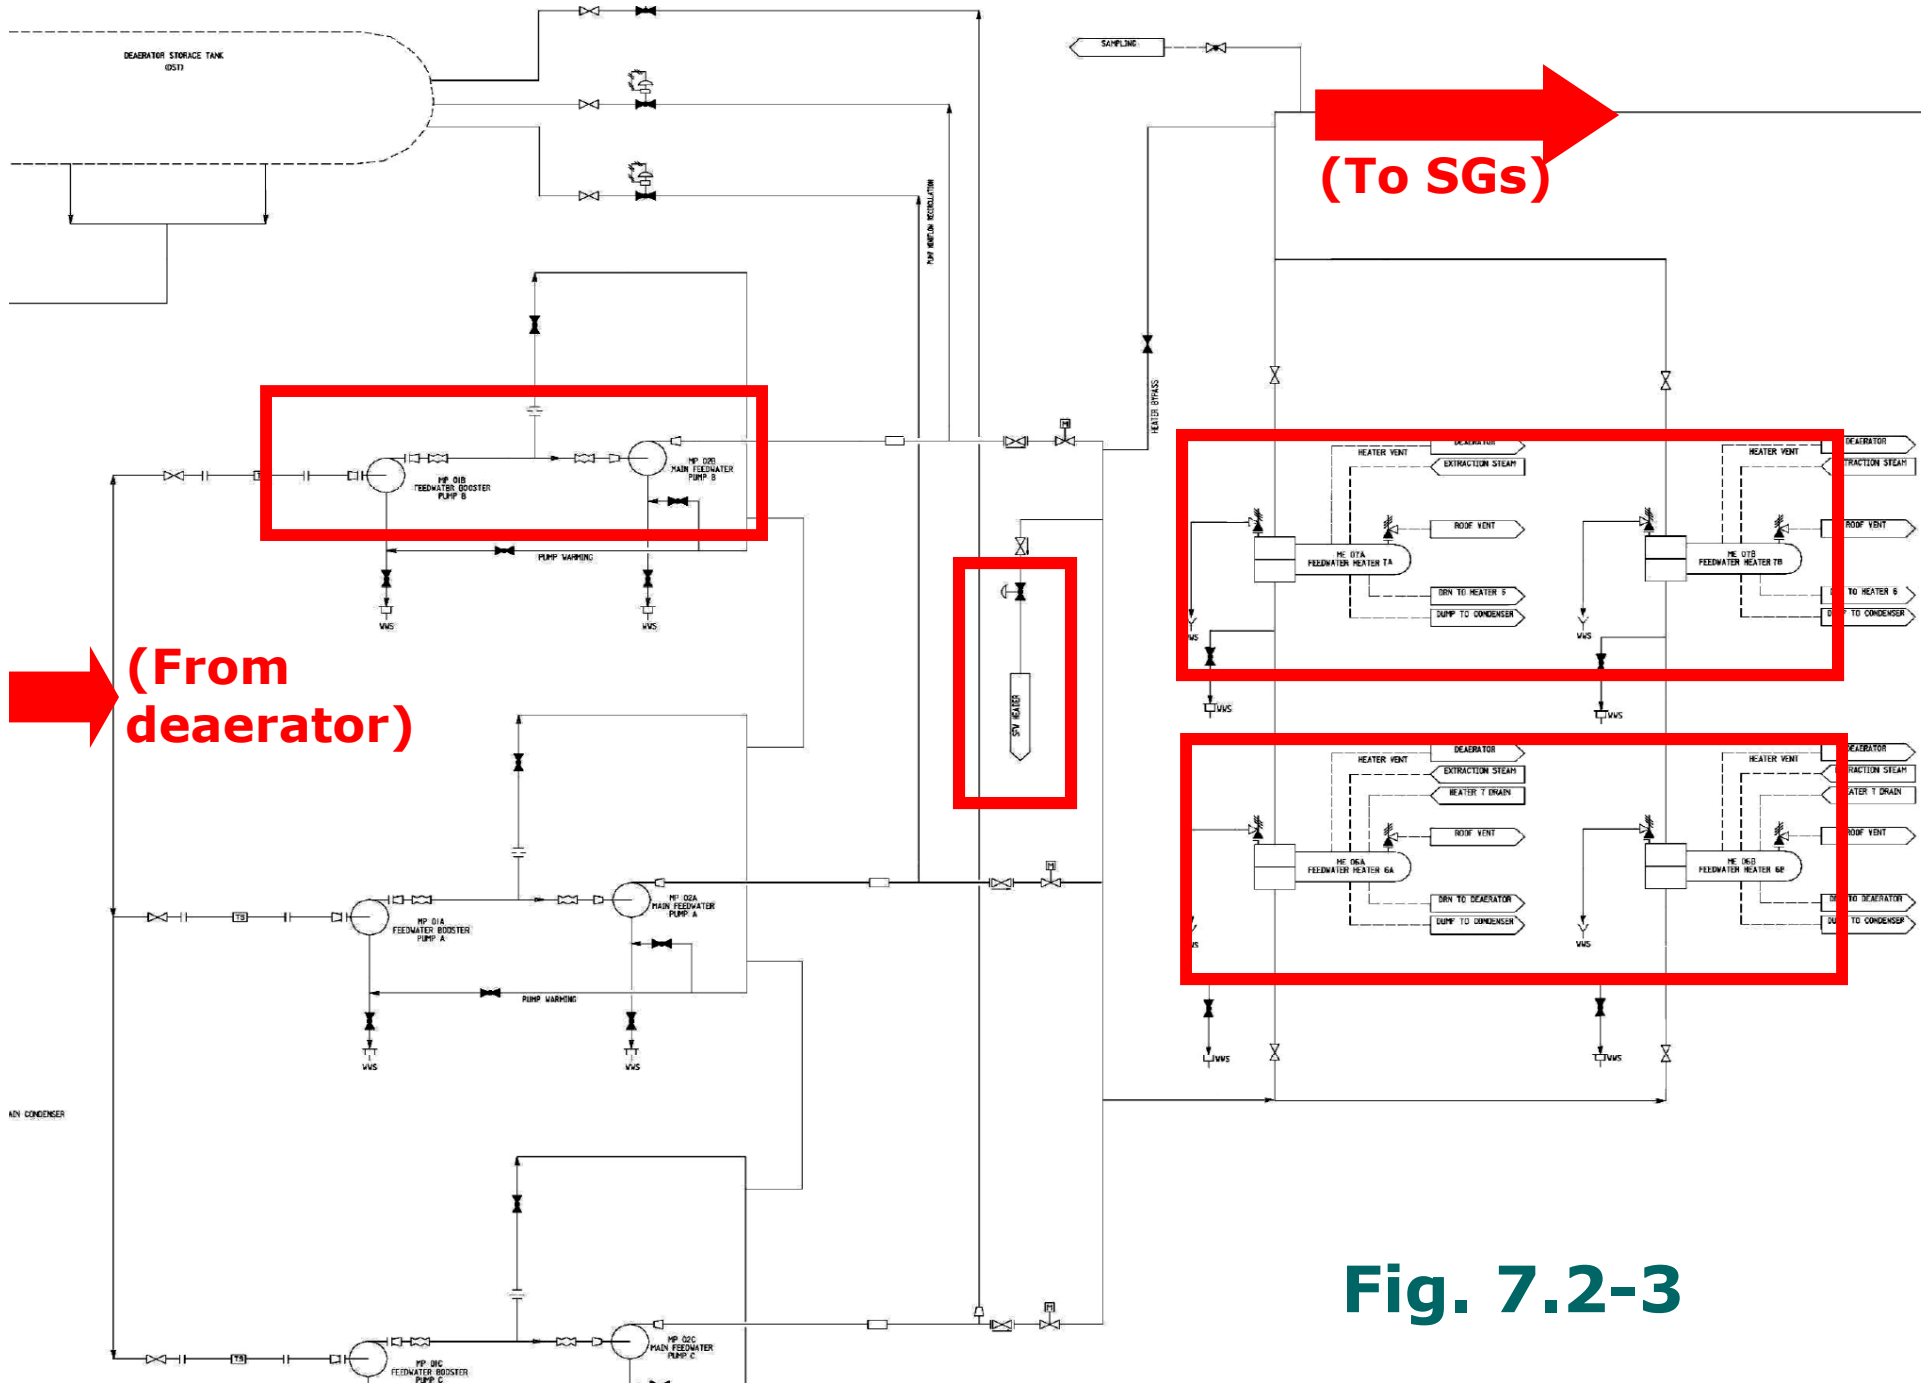


Fig. 7.2-3

FW Pumps, HP Heaters – Simplified Diagram

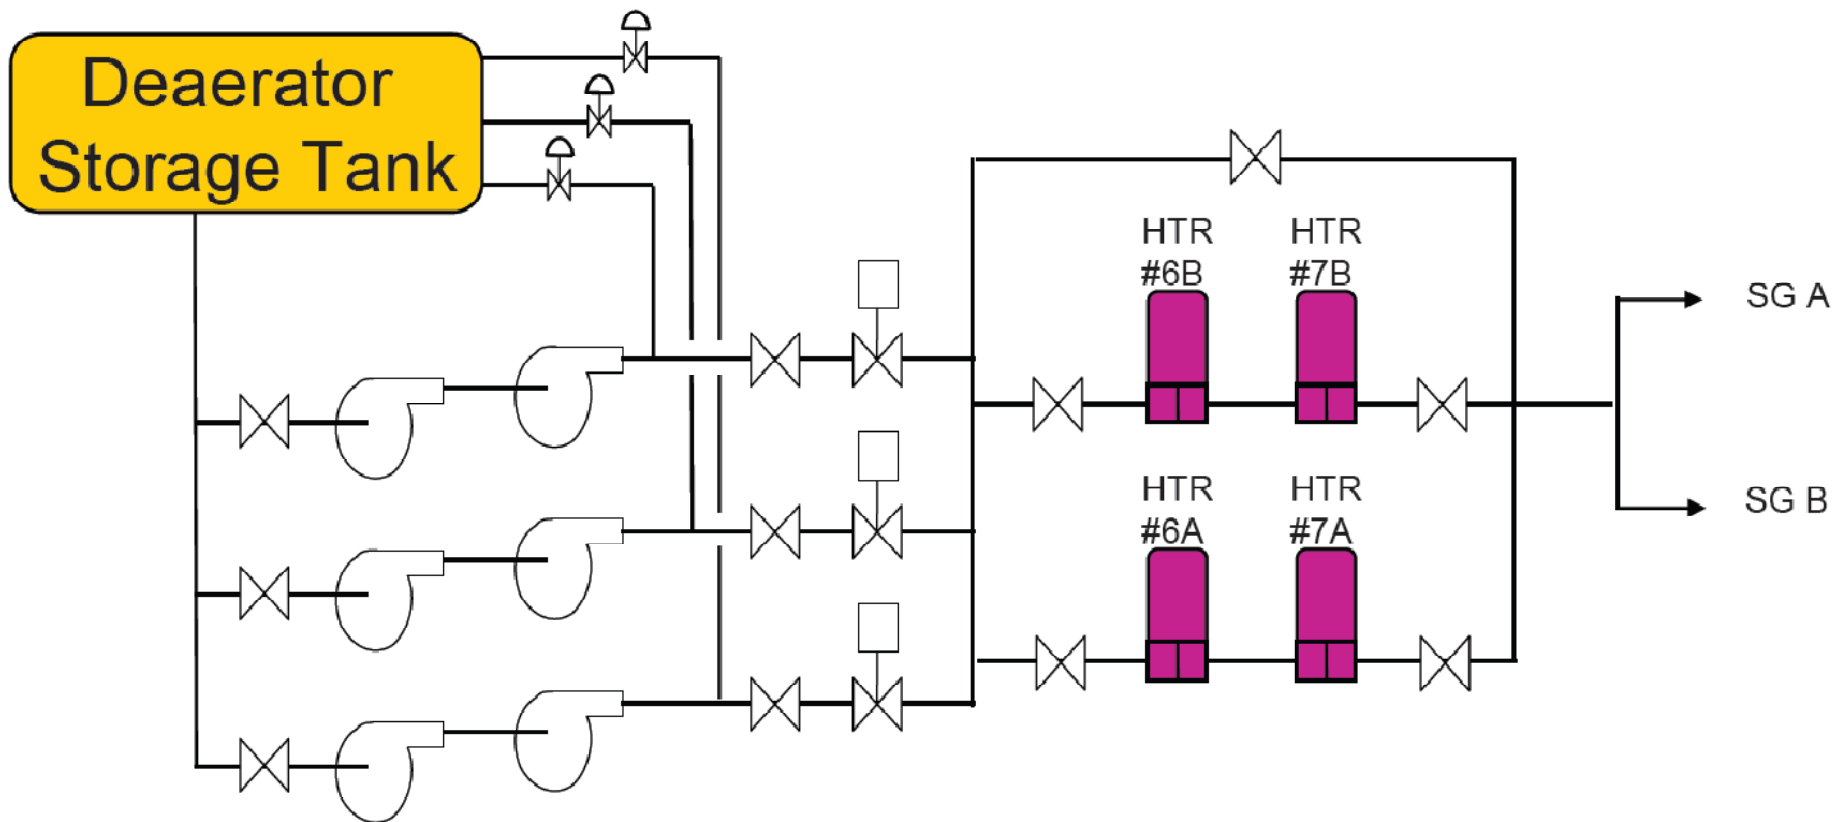

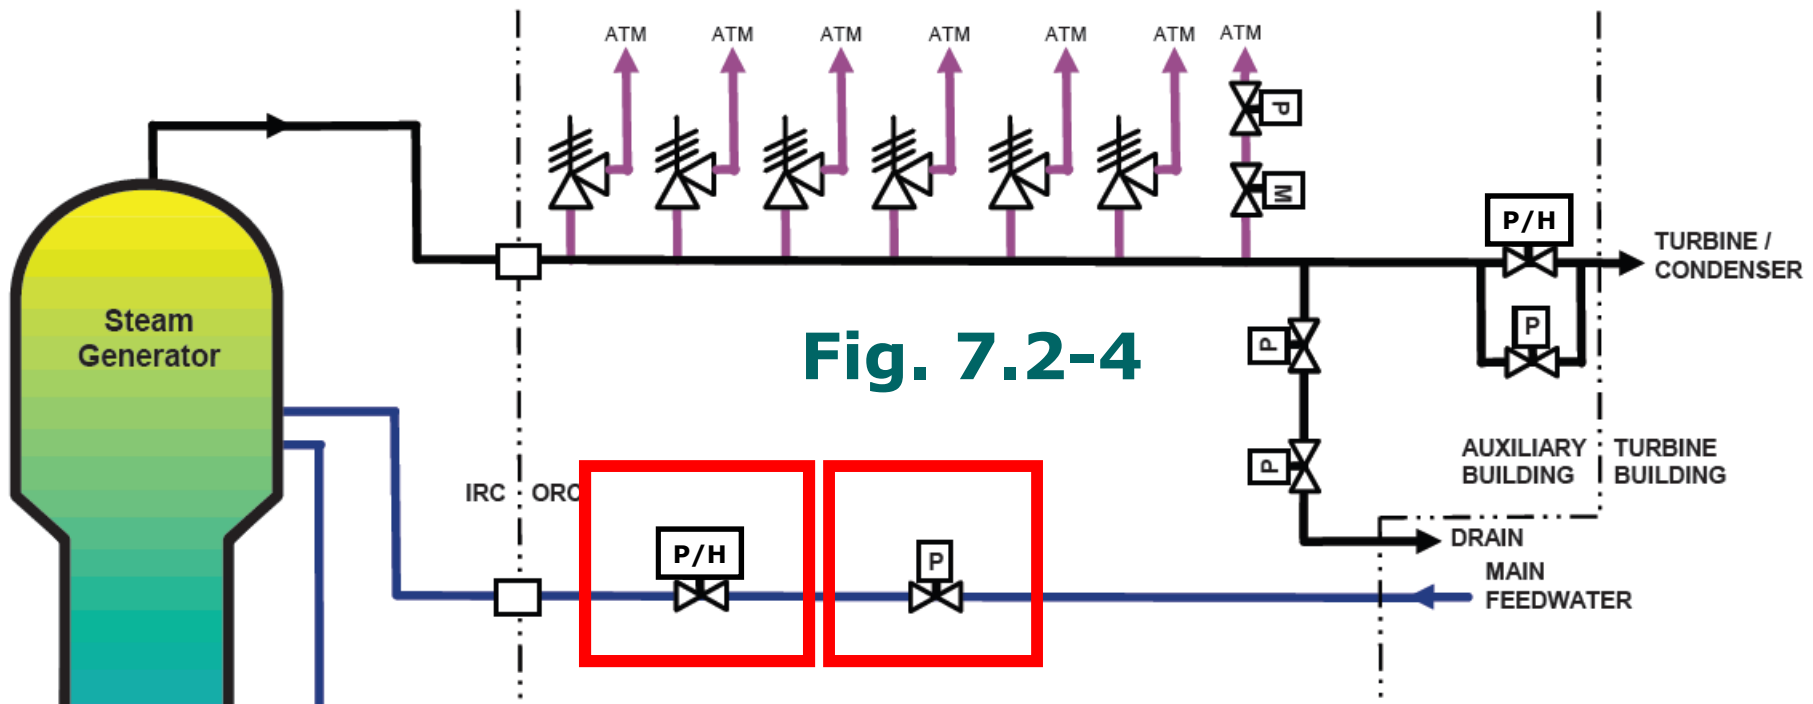

**Seismic Category I back to piping restraint at aux. bldg/turb. bldg interface.
FW isolation signals (close MFIVs, MFCVs, cross-connect to SUFW; trip MFW pumps):**

- **Safeguards actuation**
- **High-2 SG NR level**
- **Reactor trip + Low-1 T_{avg} (550°F) for MFCVs**
- **Reactor trip + Low-2 T_{avg} (542°F) for others**
- **Manual**



7.2 Condensate & FW System Objective 2

Major differences?

- **Use of deaerator. Not standard in existing plants. Removal of dissolved gases is an additional anticorrosion measure.**
- **All motor-driven FW pumps. FW pumps in existing plants are typically turbine driven.**



7.3 Startup Feedwater System Objectives


- 1. State the purposes of the startup feedwater system.**
- 2. List the 2 sources of water for the startup feedwater system, & state when each is used.**
- 3. List the automatic start signals for the startup feedwater system.**



Startup Feedwater System Purposes

- 1. To provide feedwater to the steam generators during transients in the event of main feedwater system unavailability, and**
- 2. To provide feedwater to the steam generators during plant startup, hot standby, and shutdown conditions.**


Fig. 7.3-1

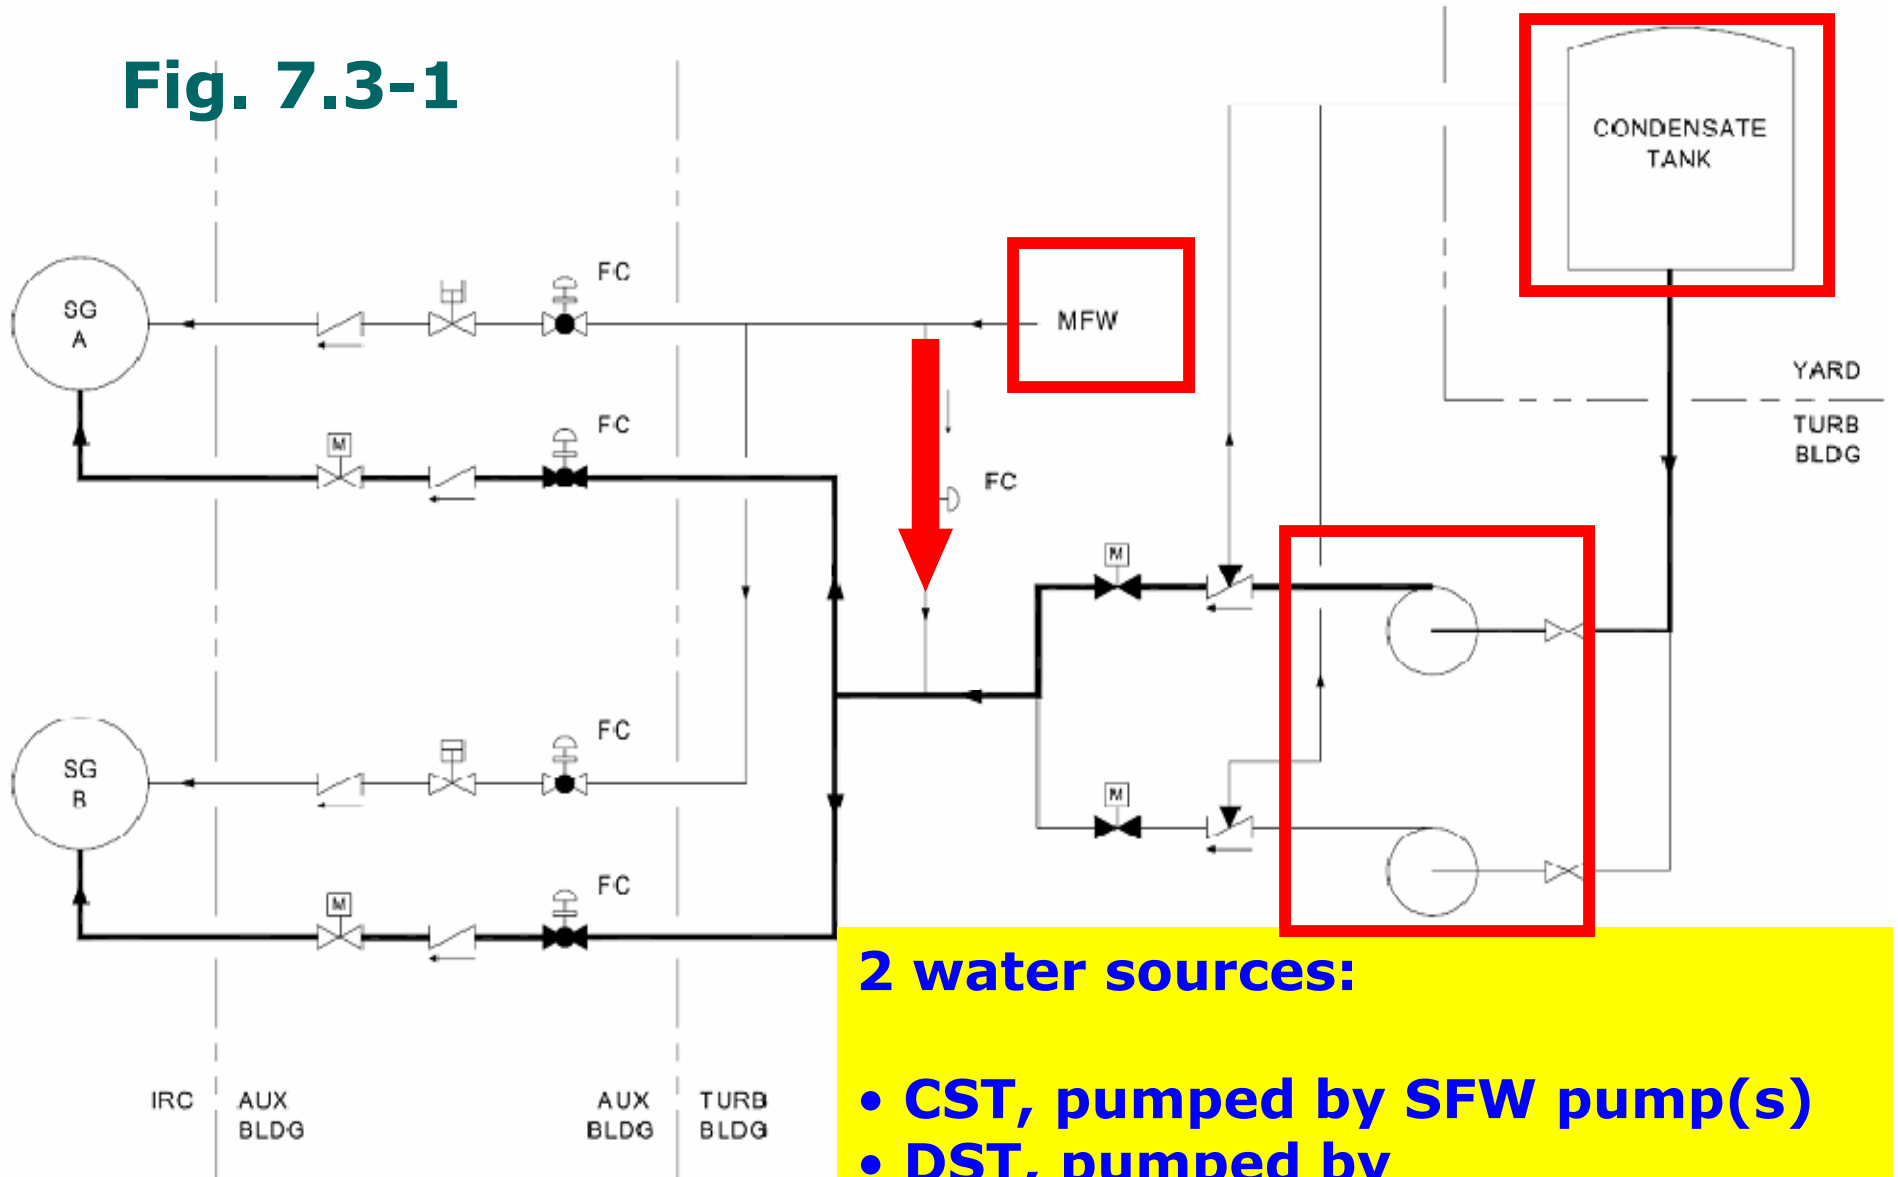

2 water sources:

- **CST, pumped by SFW pump(s)**
- **DST, pumped by booster/MFW pump**


Fig. 7.3-1

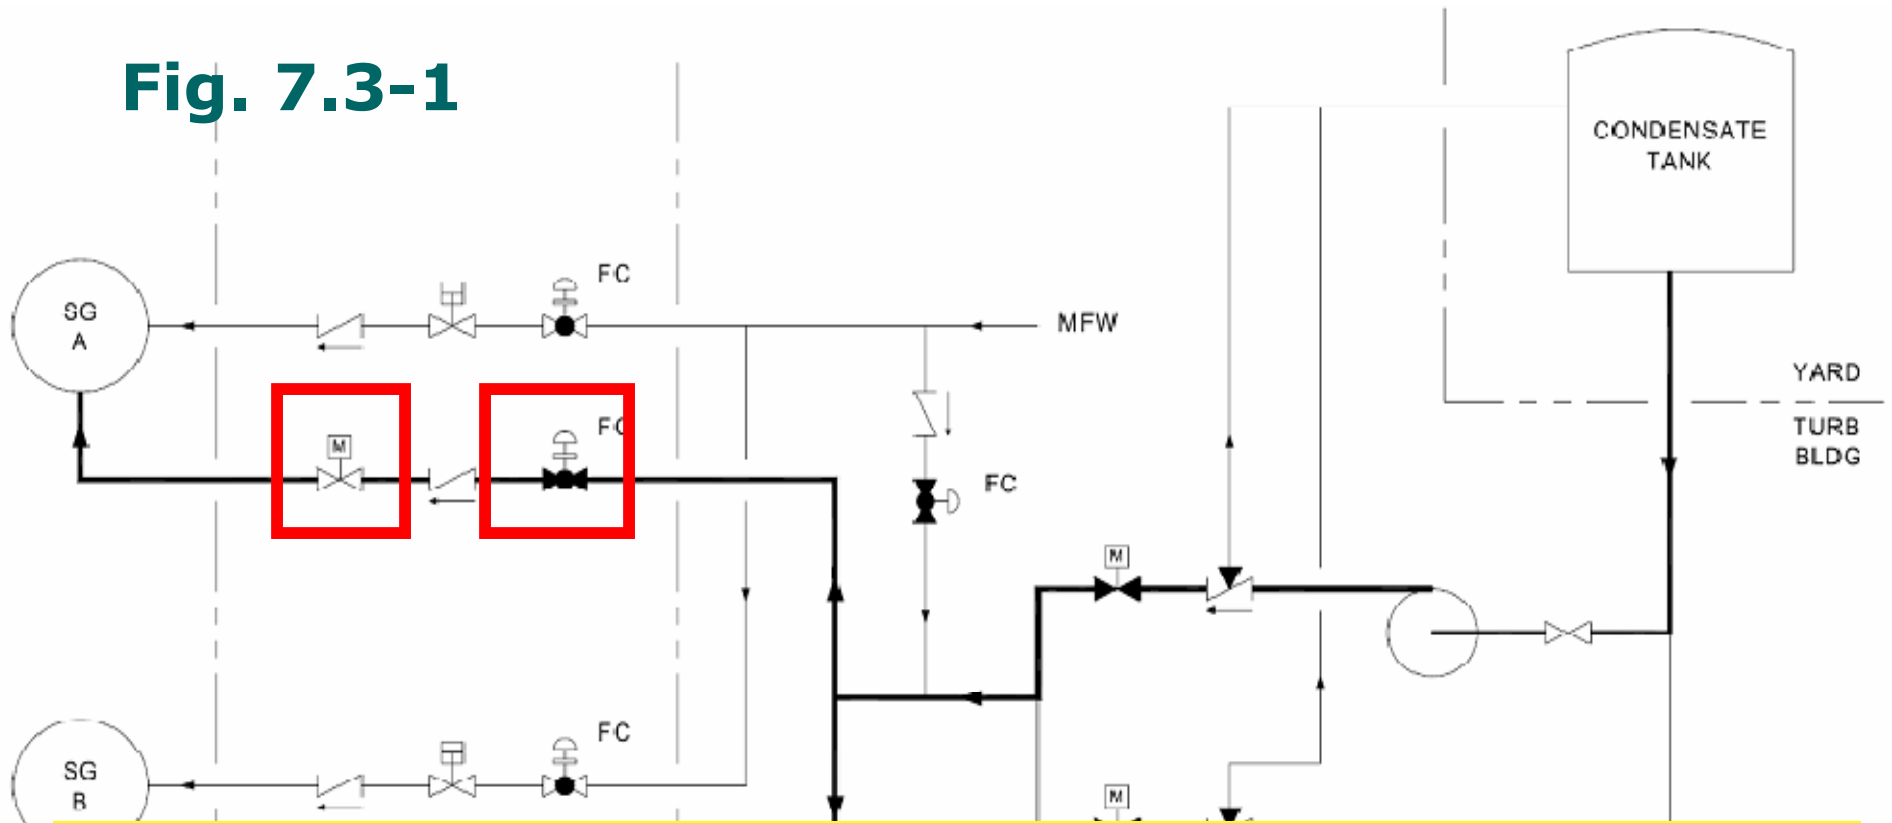

Seismic Category I back to piping restraint at aux. bldg/turb. bldg interface (otherwise nonsafety-related). SUFW isolation (closes SUFIVs, SUFCVs) signals:

- High-2 SG NR level
- Low T_{cold}
- High SG NR level + P-4 (reactor trip)
- Manual

Fig. 7.3-1

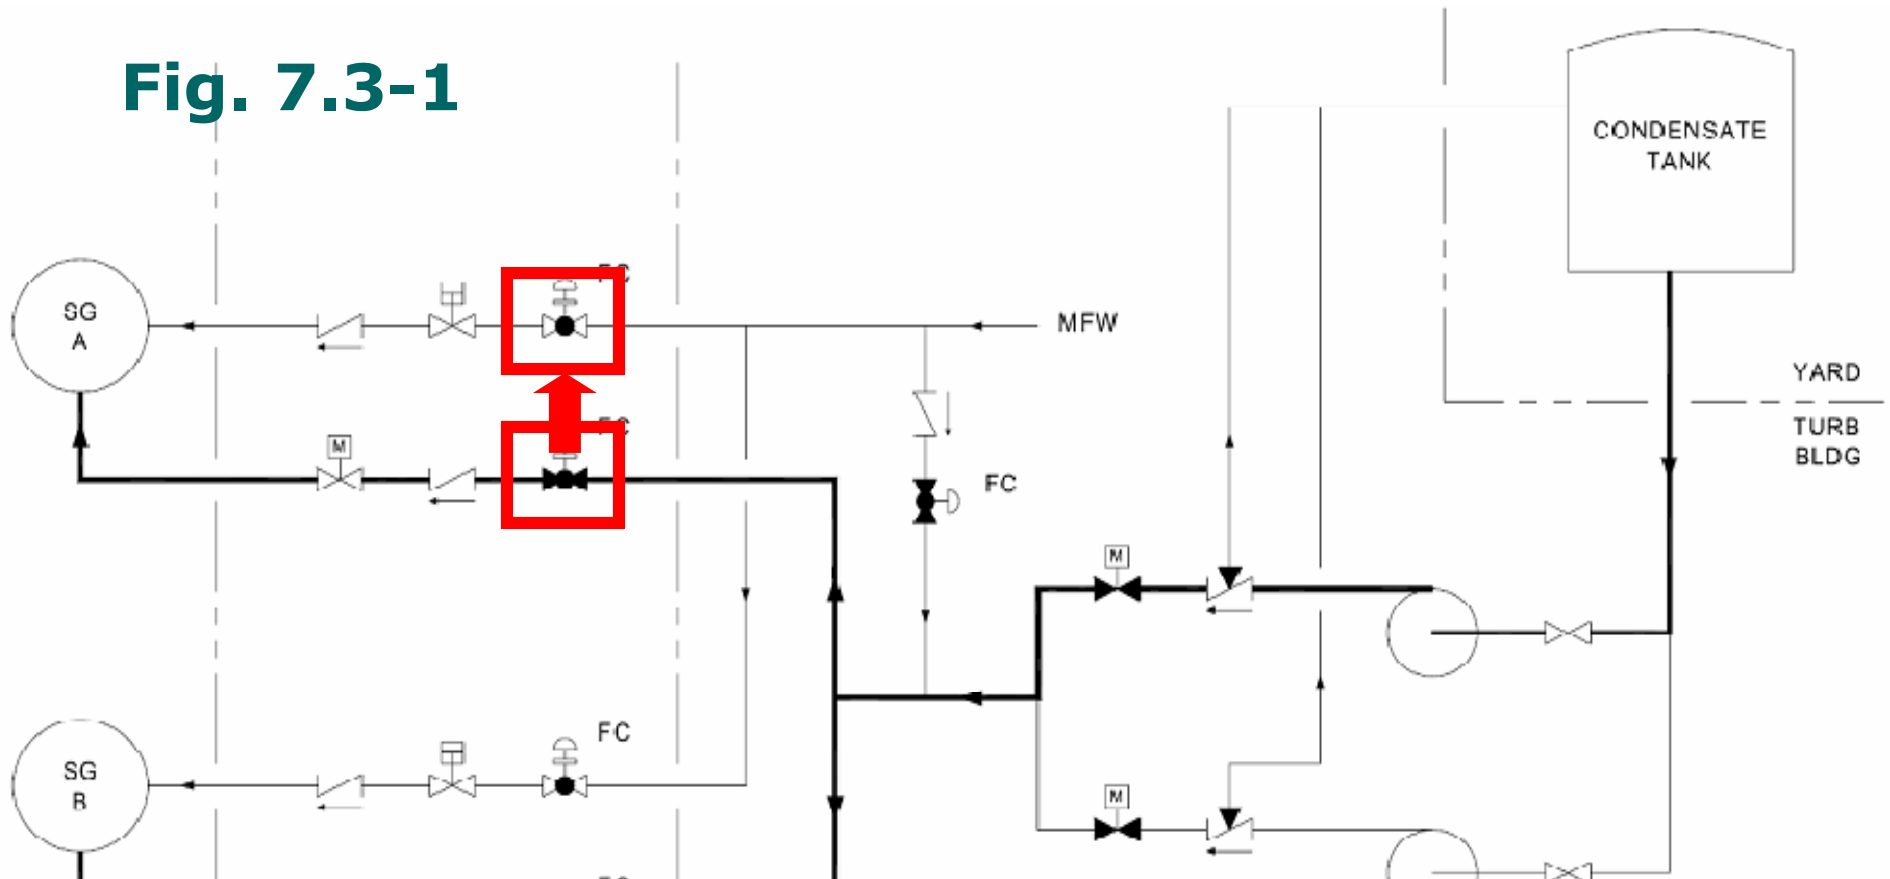

Typical operation:

Supplies flow when FW demands are low.

SUFCVs provide auto SG level control.

Flow can be provided by SUFW pump(s) or MFW pump.

Auto transfer from SUFCVs to MFCVs with increasing demand.



Auto SUFW Pump Start Signals

- 1. Low MFW flow + low SG level**
- 2. Low-low SG level**

SUFW pumps start when there is insufficient MFW flow (quasi-AFW function).

SUFW should be available during normal reactor shutdowns for decay heat removal.



7.4 Balance of Plant Systems Objectives

- 1. State the purposes of the major components of the balance of plant systems.**
- 2. Describe the major differences between the balance of plant systems of the AP1000 & currently operating Westinghouse plants.**



7.4.1

Main Condenser

- **Purpose: secondary-cycle heat sink; receives exhaust steam from main turbine**
- **3-shell unit, 1 for each LP turbine**
- **No. 1 & 2 FW heaters in each shell**
- **Auto hotwell level control via makeup from & reject to CST**
- **Air-inleakage, noncondensable gases removed**



7.4.2

Main Condenser Evacuation System


- **Purpose:** remove air & noncondensable gases from condenser
- **4 vacuum pumps; 1 per condenser shell, 1 spare**
- **Pump discharge to atmosphere via monitored vent path; high radiation indicates primary-to-secondary leakage**
- **Loss of air removal system means loss of condenser vacuum**




7.4.3

Gland Seal System


- **Purpose:** supply sealing steam to glands where HP & LP turbine shafts penetrate casings
- **Steam supply from aux. boiler or main steam**
- **Air & excess seal steam drawn to gland seal condenser by exhaust blower**
- **Blower discharge to atmosphere via monitored vent path; high radiation indicates pri-to-sec leakage**

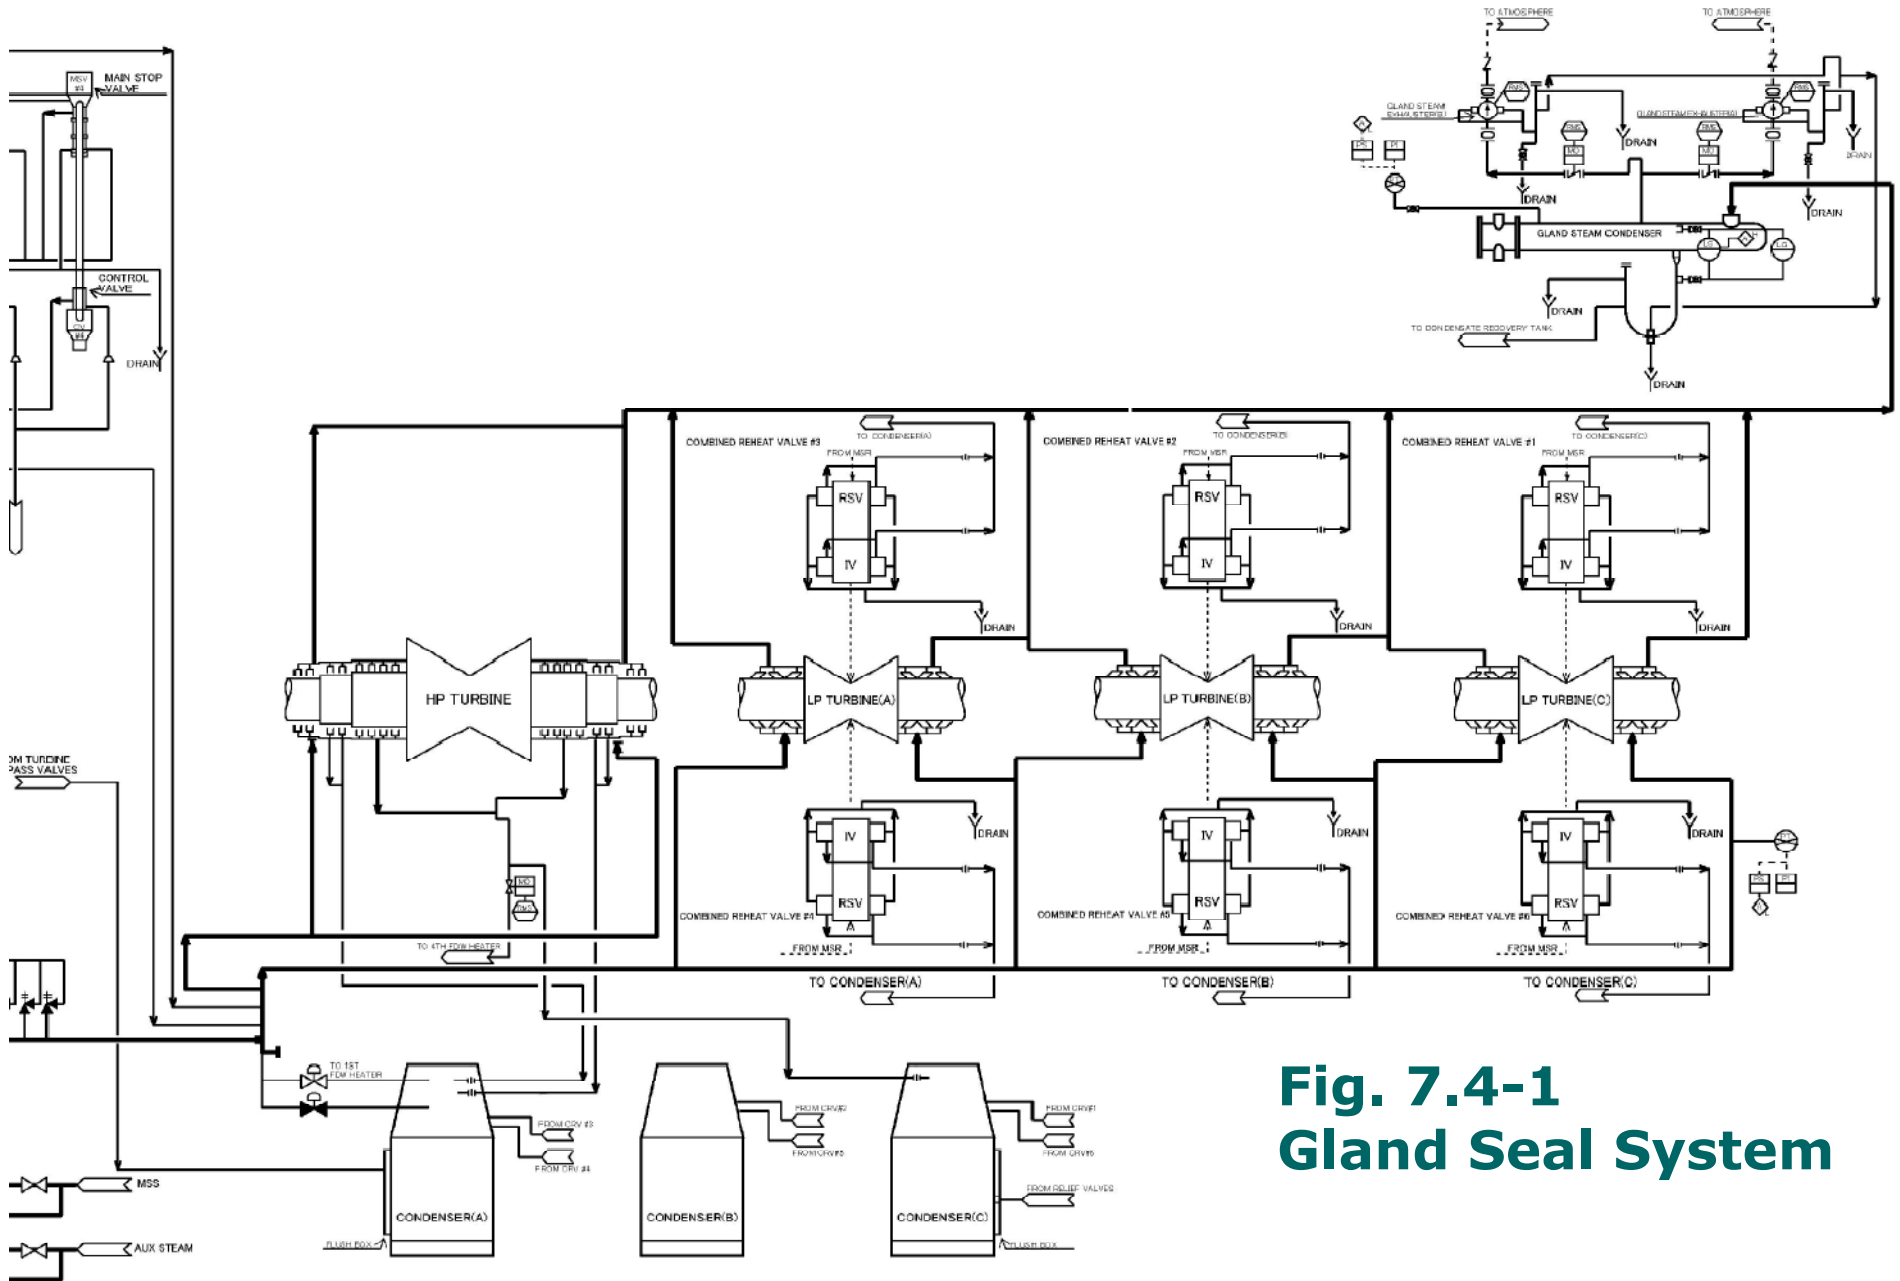

**Fig. 7.4-1
Gland Seal System**

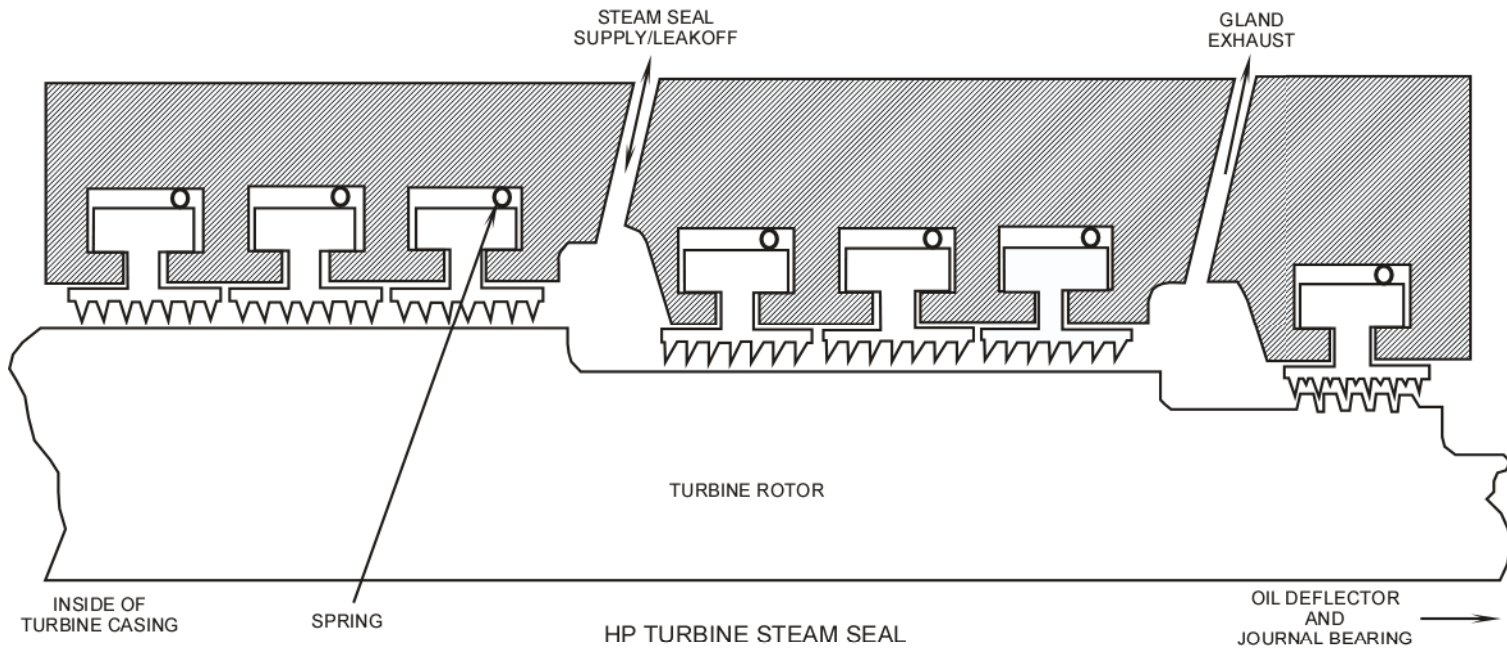

Turbine Glands

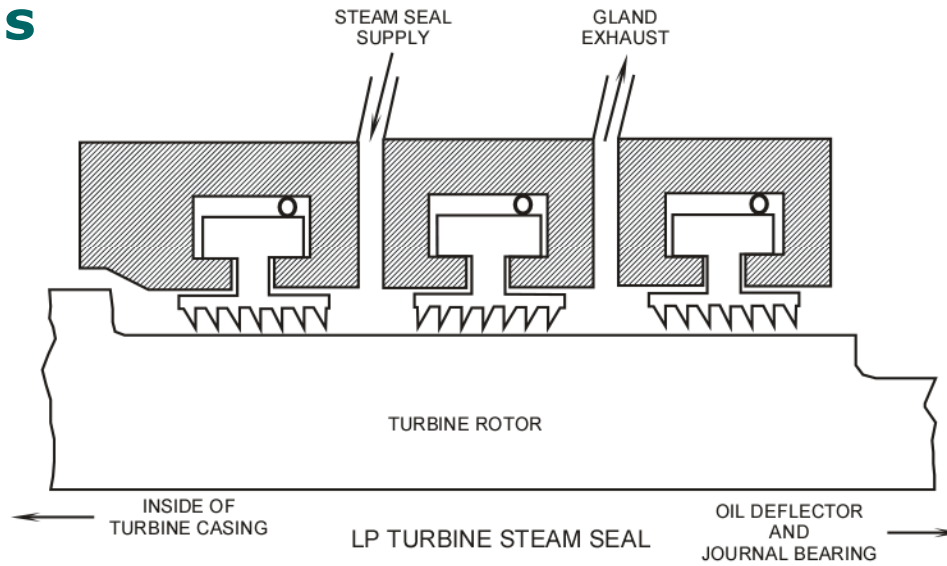



7.4.4

Turbine Bypass System

Purpose: provides capability to bypass main steam to condenser to minimize transient effects with turbine off-line & for step load reductions


- Enables avoiding reactor trips during large load rejections
- 40% of full-load capacity
- 6 AO valves in 2 3-valve banks
- Operation like that of existing Westinghouse steam dump systems



7.4.5

Turbine-Generator

- **Purpose: convert thermal energy into electrical energy**
- **1 HP element, 3 LP elements, 2 MSR**s
- **Extraction steam for FW heating & LP steam reheating**
- **DEH control system with auto & manual elements for controlling turbine speed, acceleration, load, loading rate**

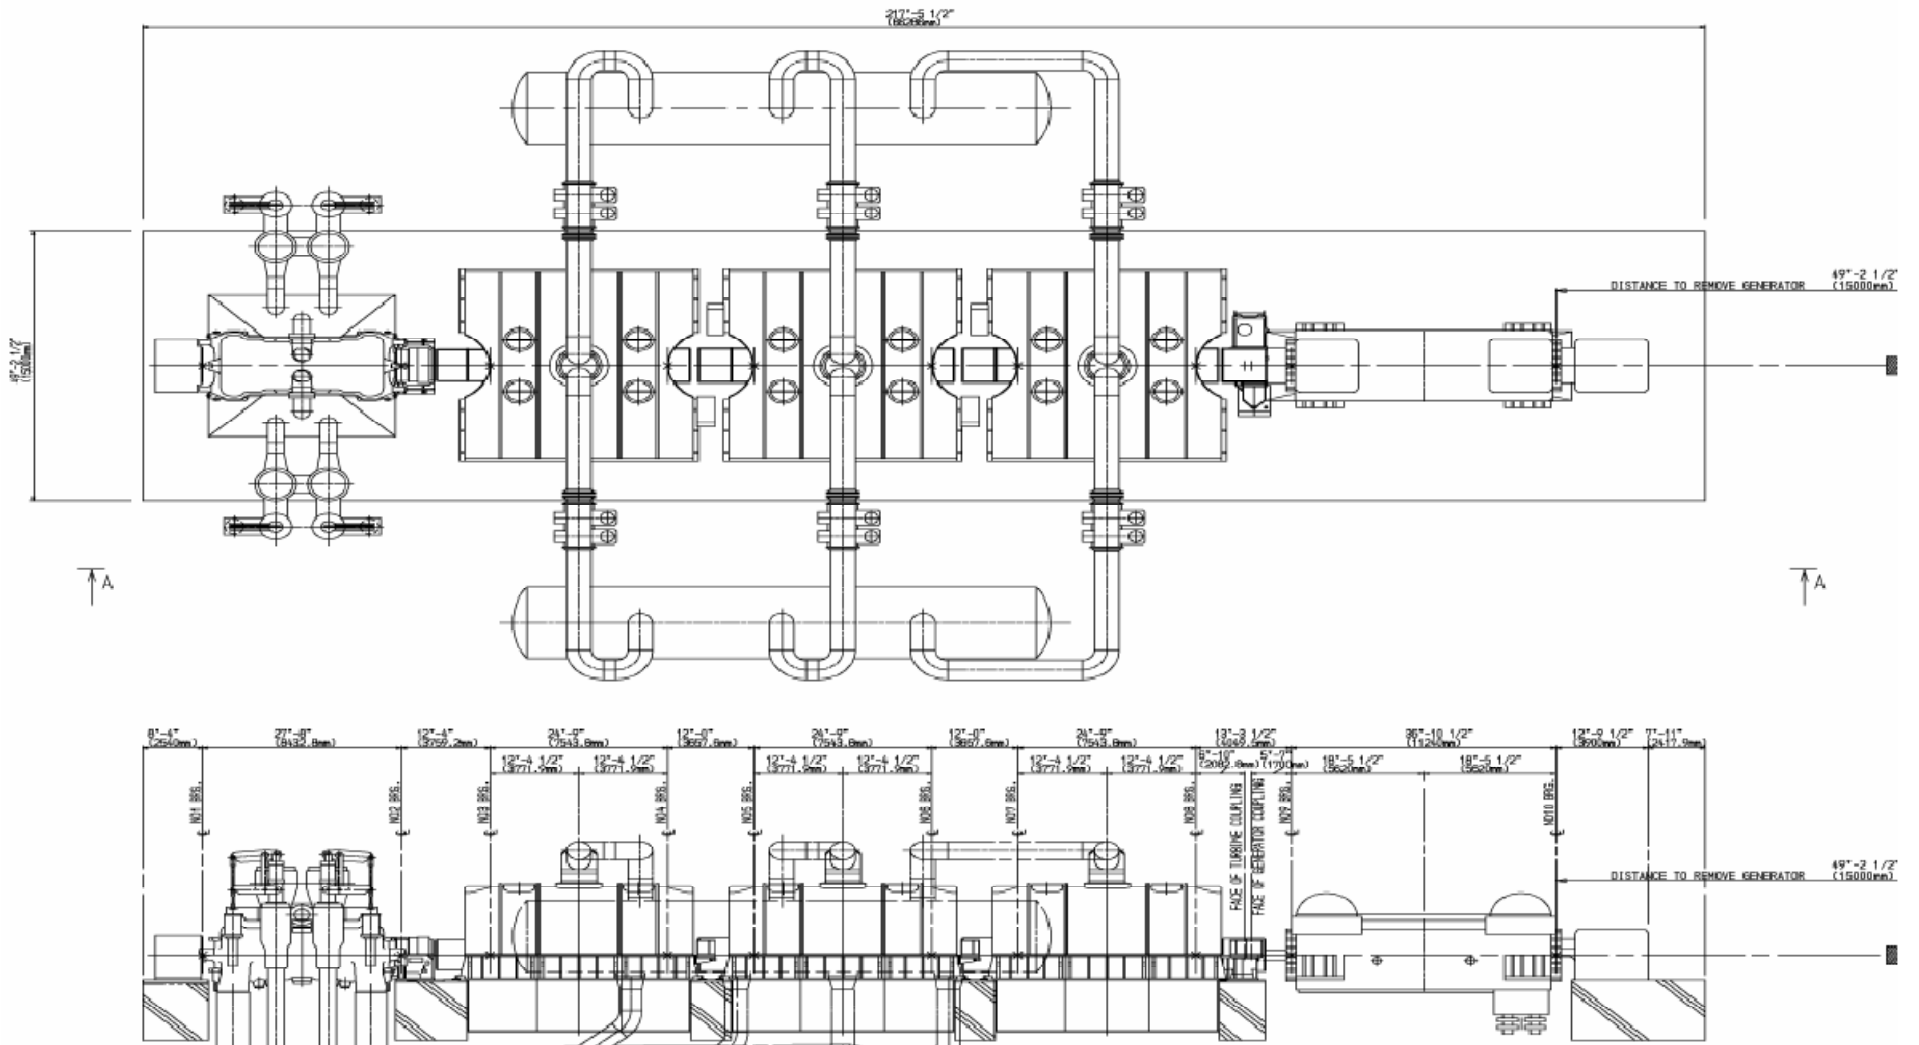

**Fig. 7.4-3
Turbine-Generator**



7.4 Balance of Plant Systems

Objective 2


Major differences?

Nothing major.

TB 1



TB 2

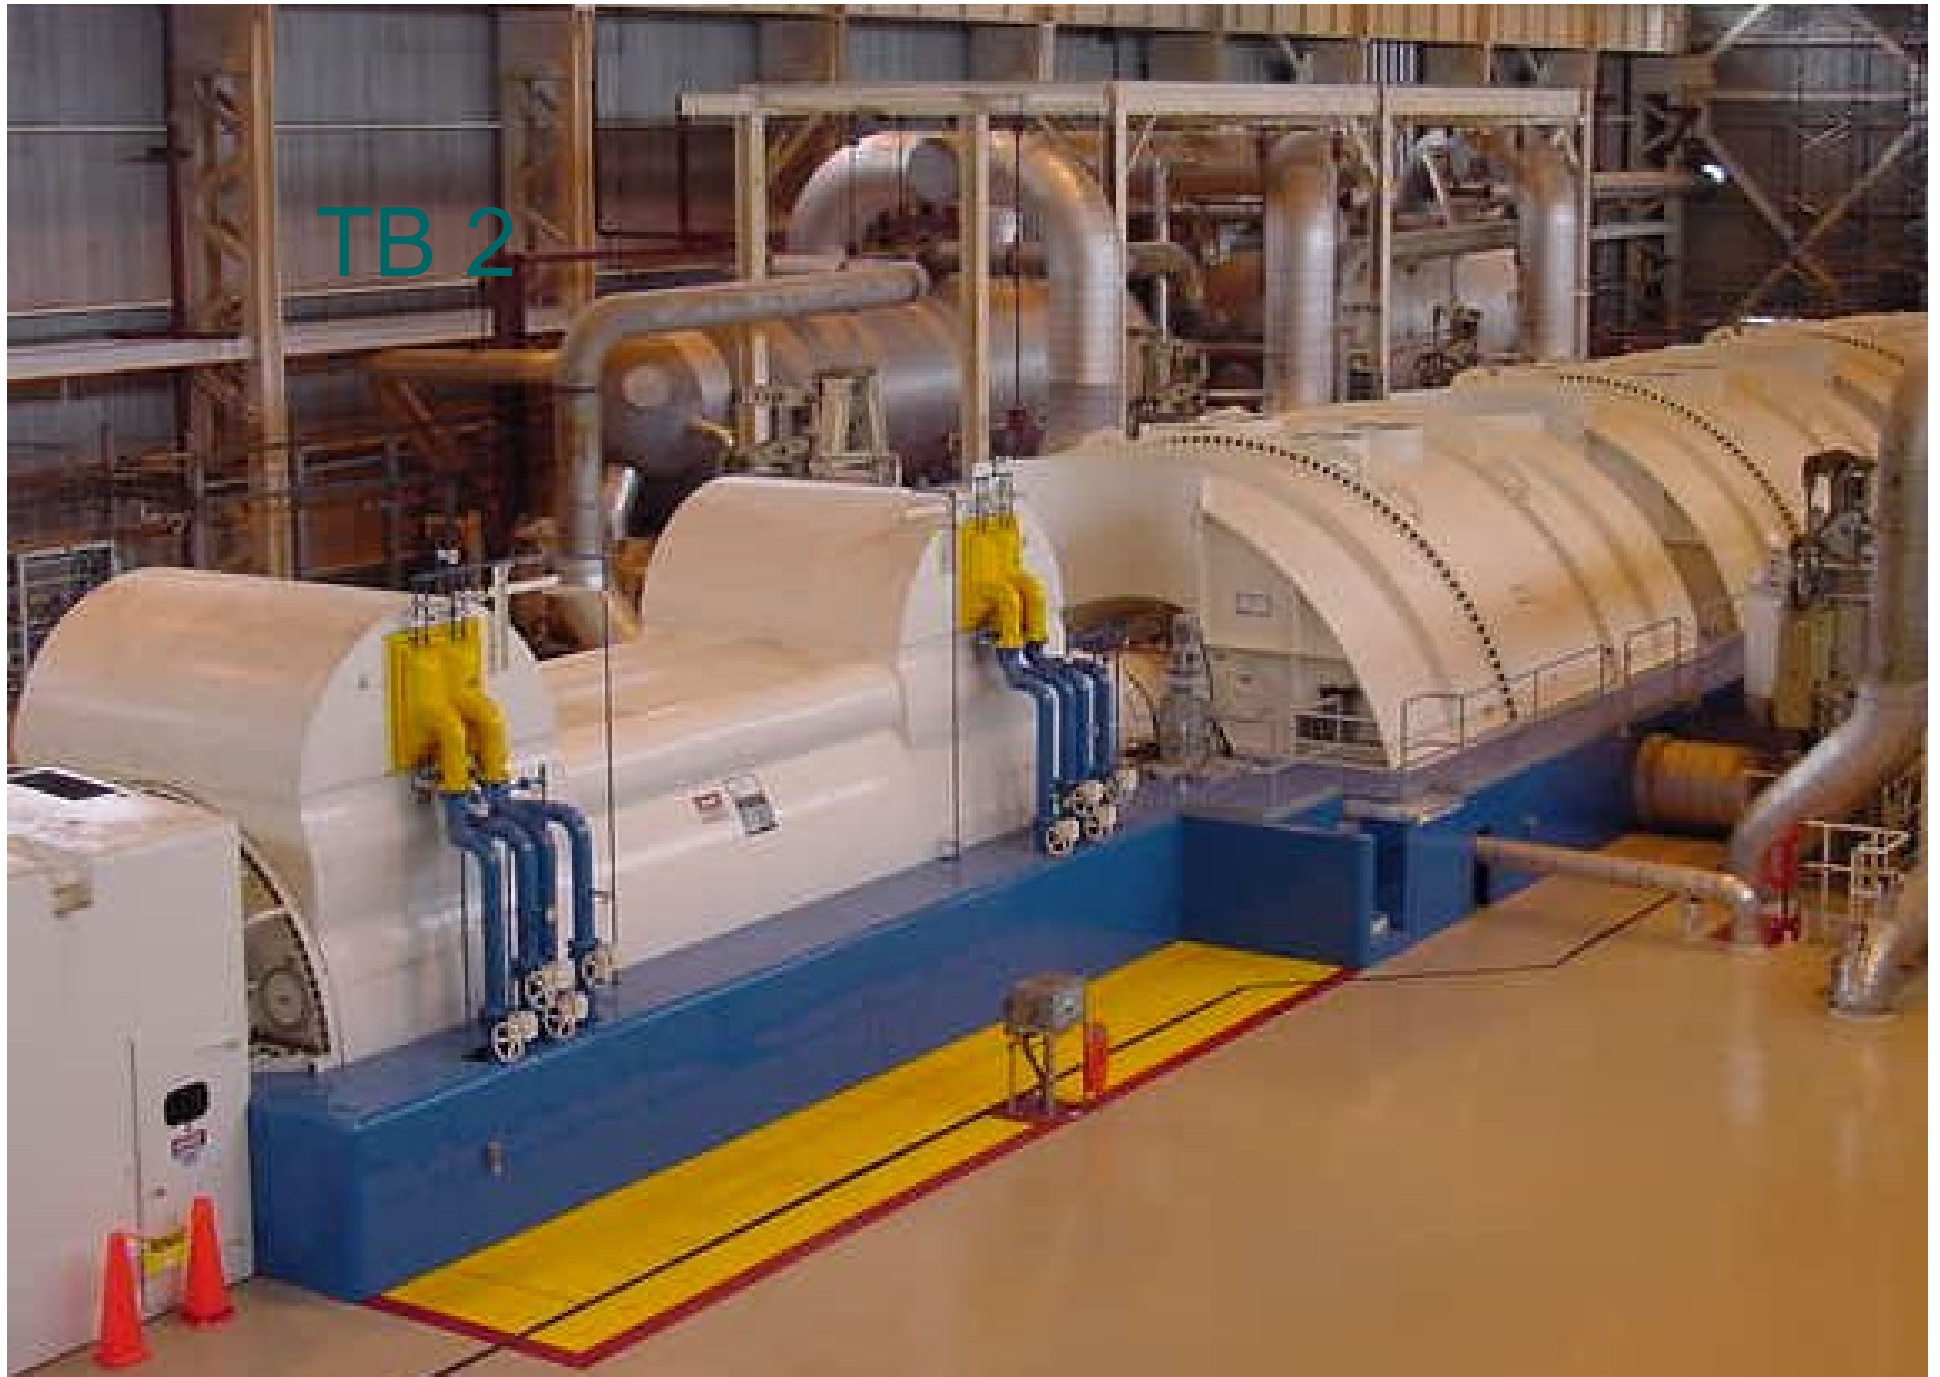




Review: Which of the following is not true concerning the deaerator & its associated storage tank?

- a. Feedwater is preheated there on its way to the steam generators.**
- b. Noncondensable gases are removed there.**
- c. It serves as a suction source for the feedwater booster/main feedwater pumps.**
- d. It is a shell-and-tube heat exchanger.**




Review: Which of the following is not true concerning the deaerator & its associated storage tank?

- a. Feedwater is preheated there on its way to the steam generators.**
- b. Noncondensable gases are removed there.**
- c. It serves as a suction source for the feedwater booster/main feedwater pumps.**
- d. It is a shell-and-tube heat exchanger.**



Review: The sources of water to the startup feedwater system are the...

- a. Condensate storage tank (CST) & deaerator storage tank (DST).**
- b. CST & in-containment refueling water storage tank (IRWST).**
- c. DST & IRWST.**
- d. CST & core makeup tanks.**



Review: The sources of water to the startup feedwater system are the...

- a. Condensate storage tank (CST) & deaerator storage tank (DST).**
- b. CST & in-containment refueling water storage tank (IRWST).**
- c. DST & IRWST.**
- d. CST & core makeup tanks.**



Review: The startup feedwater system is designed for...

- a. Providing feedwater flow to the steam generators at high powers.**
- b. Providing feedwater flow to the steam generators at low powers.**
- c. Providing decay heat removal during accidents.**
- d. Circulating coolant during refuelings.**



Review: The startup feedwater system is designed for...

- a. Providing feedwater flow to the steam generators at high powers.**
- b. Providing feedwater flow to the steam generators at low powers.**
- c. Providing decay heat removal during accidents.**
- d. Circulating coolant during refuelings.**



Review: The startup feedwater pumps would ALWAYS be expected to start...

- a. In response to a safeguards actuation signal.**
- b. When a LOCA is in progress.**
- c. When steam generator levels are trending toward overfill.**
- d. When secondary heat sinks are degrading.**



Review: The startup feedwater pumps would ALWAYS be expected to start...

- a. In response to a safeguards actuation signal.**
- b. When a LOCA is in progress.**
- c. When steam generator levels are trending toward overfill.**
- d. When secondary heat sinks are degrading.**



Review: A design feature of the AP1000 plant which is significantly different from its counterpart in existing plants is...

- a. The use of extraction steam for feedwater heating.**
- b. The use of moisture separator/reheaters for treating low pressure steam.**
- c. Supplying steam to seal turbine glands.**
- d. None of the above.**



Review: A design feature of the AP1000 plant which is significantly different from its counterpart in existing plants is...

- a. The use of extraction steam for feedwater heating.**
- b. The use of moisture separator/reheaters for treating low pressure steam.**
- c. Supplying steam to seal turbine glands.**
- d. None of the above.**



Review: The main steam supply system DOES NOT...

- a. Transfer steam to the turbine-generator.**
- b. Provide overpressure protection for the steam generators.**
- c. Provide the driving force for safety-related pumps.**
- d. Provide a path for decay heat removal.**



Review: The main steam supply system DOES NOT...

- a. Transfer steam to the turbine-generator.**
- b. Provide overpressure protection for the steam generators.**
- c. Provide the driving force for safety-related pumps.**
- d. Provide a path for decay heat removal.**



The End