

Table 2.5-44 WBNP - Bearing Capacity - Category I Soil-Supported Structures
Adopted Soil Properties For Bearing Capacity Determination

Material	Unit Weight (PCF)				Strength Tests							
	Moist	Sat.	Sub	Q φ (DEG)	R		R		R or S			
					C (PSF)	φ (DEG)	C (PSF)	φ (DEG)	C (PSF)	φ (DEG)	C (PSF)	
Granular fill	133	142	80	39	1400	38 ^a	0 ^a	38	700			
In-situ gravel (N450)	125	143	72	39 ^a	0 ^a	39 ^a	0 ^a	39	0			
In-situ gravel (N = 16, 17)	120 ^a	130 ^a	68 ^a	30 ^a	0 ^a	30 ^a	0 ^a	30 ^a	0 ^a			
Weathered shale	-	127	64	0	1600	18	300	27	0			

^a Properties assumed.

**Table 2.5-45 Watts Bar Nuclear Plant
ERCW Liquefaction
Trench A
Summary of Laboratory Test Data
Borrow Soil Classes**

Class	I	II	III
Symbol	SM-SC	SC	CL
Mechanical and Hydrometer Analysis			
Gravel, percent	0	0	0
Sand, percent	70	51	40
Silt, percent	15	24	29
Clay, percent	15	25	31
Atterberg Limits			
Liquid limit, percent	24	28	34
Plastic limit, percent	19	17	19
Plasticity index, percent	5	11	15
Shrinkage limit, percent	--	--	--
Standard Proctor Compaction			
Optimum moisture, percent	13.1	14.1	15.9
Maximum density, pcf	116.6	114.4	110.8
Penetration resistance, psi	910	840	760
Shear Strength at 3% Dry of Optimum Moisture and at 95% of Maximum Unit Weight			
Triaxial R: ϕ , degrees	15.0	14.8	18.0
c, tsf	0.29	0.11	0.03
Shear Strength at 3% Dry of Optimum Moisture and at 100% of Maximum Unit Weight			
Triaxial R: ϕ , degrees	--	15.7	16.8
c, tsf	--	0.19	0.10
Percent of class in area	8	61	31
Natural moisture content, percent	18.5	19.4	20.7

**Table 2.5-45a Watts Bar Nuclear Plant ERCW Liquefaction, Trench A Supplemental Borrow
Summary of Laboratory Test Data Borrow Soil Classes**

Group	1	2	3
Symbol	ML	SM	ML
Mechanical and Hydrometer Analysis			
Gravel, percent	0	0	0
Sand, percent	16	54	43
Silt, percent	44	31	15
Clay, percent	40	15	22
Atterberg Limits			
Liquid limit, percent	47	26	34
Plastic limit, percent	29	25	26
Plasticity index, percent	18	1	8
Shrinkage limit, percent	--	--	—
Standard Proctor Compaction			
Optimum moisture, percent	21.4	17.3	18.8
Maximum density, pcf	99.7	108.4	105.3
Penetration resistance, psi	1180	860	800
Shear Strength at 3% Dry of Optimum Moisture and at 100% of Maximum Unit Weight*			
Triaxial R: ϕ , degrees	13.0	11.6	12.9
c, tsf	0.43	0.46	0.69
Percent of class in area	--	--	--
Natural moisture content, percent	--	--	--

* Group 2 tested at 95 percent of maximum unit weight.

**Table 2.5-46 Watts Bar Nuclear Plant
ERCW Liquefaction
Trench B
Summary of Laboratory Test Data
Borrow Soil Classes**

Class	I	II	III
Symbol	SM	SM-SC	CL
Mechanical and Hydrometer Analysis			
Gravel, percent	0	0	0
Sand, percent	66	55	43
Silt, percent	22	24	28
Clay, percent	12	21	29
Atterberg Limits			
Liquid limit, percent	NP	28	30
Plastic limit, percent	NP	22	19
Plasticity index, percent	NP	6	11
Shrinkage limit, percent	--	--	--
Standard Proctor Compaction			
Optimum moisture, percent	15.3	15.6	15.8
Maximum density, pcf	110.7	110.3	109.8
Penetration resistance, psi	770	1025	1425
Shear Strength at 3% Dry of Optimum Moisture and at 95% of Maximum Unit Weight			
Triaxial R: ϕ , degrees	7.6	5.5	10.4
c, tsf	1.67	1.05	0.32
Percent of class in area	26	22	52
Natural moisture content, percent	25.0	28.4	22.2

**Table 2.5-47 Watts Bar Nuclear Plant
ERCW Liquefaction
Borrow Area 9
Summary of Laboratory Test Data
Borrow Soil Classes**

Class	I	II
Symbol	CL	CL-ML
Mechanical and Hydrometer Analysis		
Gravel, percent	0	0
Sand, percent	24	32
Silt, percent	40	27
Clay, percent	36	41
Atterberg Limits		
Liquid limit, percent	31	40
Plastic limit, percent	15	25
Plasticity index, percent	16	15
Shrinkage limit, percent	--	--
Standard Proctor Compaction		
Optimum moisture, percent	16.4	19.6
Maximum density, pcf	110.3	104.0
Penetration resistance, psi	350	680
Shear Strength at 3% Dry of Optimum Moisture and at 95% of Maximum Unit Weight		
Triaxial R: ϕ , degrees	12.3	8.0
c, tsf	0.11	0.57
Shear Strength at 3% Dry of Optimum Moisture and at 100% of Maximum Unit Weight		
Triaxial R: ϕ , degrees	11.6	--
c, tsf	0.28	--
Percent of class in area	50	50
Natural moisture content, percent	18.1	21.7

**Table 2.5-48 Watts Bar Nuclear Plant
ERCW Liquefaction
Borrow Area 10
Summary of Laboratory Test Data
Borrow Soil Classes**

Class	I	II
Symbol	CL	CL-ML
Mechanical and Hydrometer Analysis		
Gravel, percent	0	0
Sand, percent	33	19
Silt, percent	31	33
Clay, percent	36	48
Atterberg Limits		
Liquid limit, percent	39	45
Plastic limit, percent	23	26
Plasticity index, percent	16	19
Shrinkage limit, percent	--	--
Standard Proctor Compaction		
Optimum moisture, percent	20.6	25.4
Maximum density, pcf	103.0	93.3
Penetration resistance, psi	620	860
Shear Strength at 3% Dry of Optimum Moisture and at 95% of Maximum Unit Weight*		
Triaxial R: ϕ , degrees	11.9	15.2
c, tsf	0.21	0.09
Shear Strength at 3% Dry of Optimum Moisture and at 100% of Maximum Unit Weight		
Triaxial R: ϕ , degrees	--	15.0
c, tsf	--	0.12
Percent of class in area	86	14
Natural moisture content, percent	23.9	27.6

*At a density of 90 pcf on class II.

**Table 2.5-49 Watts Bar Nuclear Plant
ERCW Liquefaction
Borrow Area 11
Summary of Laboratory Test Data
Borrow Soil Classes**

Class	I
Symbol	ML
Mechanical and Hydrometer Analysis	
Gravel, percent	0
Sand, percent	21
Silt, percent	35
Clay, percent	44
Atterberg Limits	
Liquid limit, percent	44
Plastic limit, percent	29
Plasticity index, percent	15
Shrinkage limit, percent	--
Standard Proctor Compaction	
Optimum moisture, percent	22.2
Maximum density, pcf	99.8
Penetration resistance, psi	850
Shear Strength at 3% Dry of Optimum Moisture and at 95% of Maximum Unit Weight*	
Triaxial R: ϕ , degrees	13.2
c, tsf	0.21
Percent of class in area	100
Natural moisture content, percent	26.9

**Table 2.5-50 Watts Bar Nuclear Plant
ERCW Liquefaction
Borrow Area 12
Summary of Laboratory Test Data
Borrow Soil Classes**

Class	I	II	III
Symbol	SM	CL-ML	CL-ML
Mechanical and Hydrometer Analysis			
Gravel, percent	0	0	0
Sand, percent	50	22	22
Silt, percent	26	39	40
Clay, percent	24	39	38
Atterberg Limits			
Liquid limit, percent	32	40	42
Plastic limit, percent	25	25	26
Plasticity index, percent	7	15	16
Shrinkage limit, percent	--	--	--
Standard Proctor Compaction			
Optimum moisture, percent	16.8	17.8	19.2
Maximum density, pcf	108.8	106.5	103.7
Penetration resistance, psi	1165	1150	1140
Shear Strength at 3% Dry of Optimum Moisture and at 95% of Maximum Unit Weight			
Triaxial R: ϕ , degrees	9.5	12.0	16.4
c, tsf	0.57	0.29	0.04
Shear Strength at 3% Dry of Optimum Moisture and at 100% of Maximum Unit Weight			
Triaxial R: ϕ , degrees	--	--	12.5
c, tsf	--	--	0.39
Percent of class in area			
Natural moisture content, percent	21.6	24.9	25.2

**Table 2.5-51 Watts Bar Nuclear Plant
ERCW Liquefaction
Borrow Area 13
Summary of Laboratory Test Data
Borrow Soil Classes**

Class	I	II	III
Symbol	ML	ML	MH
Mechanical and Hydrometer Analysis			
Gravel, percent	0	0	0
Sand, percent	24	23	12
Silt, percent	42	39	41
Clay, percent	34	38	47
Atterberg Limits			
Liquid limit, percent	37	41	52
Plastic limit, percent	26	27	35
Plasticity index, percent	11	14	17
Shrinkage limit, percent	--	--	--
Standard Proctor Compaction			
Optimum moisture, percent	19.2	20.0	23.3
Maximum density, pcf	106.6	105.1	98.8
Penetration resistance, psi	650	800	740
Shear Strength at 3% Dry of Optimum Moisture and at 95% of Maximum Unit Weight			
Triaxial R: ϕ , degrees	15.6	14.5	18.3
c, tsf	0.15	0.14	0.02
Shear Strength at 3% Dry of Optimum Moisture and at 100% of Maximum Unit Weight			
Triaxial R: ϕ , degrees	11.7	14.5	14.7
c, tsf	0.66	0.51	0.44
Percent of class in area	45	50	5
Natural moisture content, percent	19.6	22.7	27.6

**Table 2.5-52 Watts Bar Nuclear Plant
ERCW Liquefaction
Borrow Area 2c
Summary of Laboratory Test Data
Borrow Soil Classes**

Class	I	II	III	IV	V	VI
Symbol	ML	SM-SC	CL	CL	CL-ML	MH
Mechanical and Hydrometer Analysis						
Gravel, percent	0	0	0	0	0	0
Sand, percent	48	65	48	30	23	5
Silt, percent	40	16	23	34	39	40
Clay, percent	12	19	29	36	38	55
Atterberg Limits						
Liquid limit, percent	NP	25	36	41	44	62
Plastic limit, percent	NP	19	22	24	27	35
Plasticity index, percent	NP	6	14	17	17	27
Shrinkage limit, percent	--	--	--	--	--	--
Standard Proctor Compaction						
Optimum moisture, percent	12.1	13.9	16.6	18.1	19.5	26.8
Maximum density, pcf	117.7	114.0	109.0	106.2	103.5	90.8
Penetration resistance, psi	1000	1125	1050	760	840	950
Shear Strength at 3% Dry of Optimum Moisture and at 95% of Maximum Unit Weight*						
Triaxial R: ϕ , degrees	17.5	**	13.4	9.0	18.1	19.0
c, tsf	0.63	**	0.11	0.33	0.00	0.00
Shear Strength at 3% Dry of Optimum Moisture and at 100% of Maximum Unit Weight***						
Triaxial R: ϕ , degrees	--	--	13.0	--	15.3	17.4
c, tsf	--	--	0.58	--	0.22	0.24
Percent of class in area						
Natural moisture content, percent	1	1	3	31	63	1
	21.7	20.5	26.4	22.9	23.6	31.6

* Class VI tested at 90.0 pcf

** Class II is less than 1% of total borrow and no shear tests were conducted on this class.

*** Class VI tested at 105% of maximum unit weight.

**Table 2.5-53 Watts Bar Nuclear Plant
ERCW Liquefaction
Borrow Area 2c Extension
Summary of Laboratory Test Data
Borrow Soil Groups**

Group	1	2	3	4	5	6	7	8	9	
Symbol	CL	CL	CL	CL	CL-ML	MH	CL	CL-ML	SM	
Mechanical and Hydrometer Analysis										
Gravel, percent	0	0	0	0	0	0	0	0	1	
Sand, percent	23	30	24	20	23	15	36	42	55	
Silt, percent	48	42	43	40	36	27	36	33	30	
Clay, percent	29	28	33	40	41	58	28	25	14	
Atterberg Limits										
Liquid limit, percent	34	34	40	41	47	58	37	35	32	
Plastic limit, percent	21	22	24	24	28	32	23	23	20	
Plasticity index, percent	13	12	16	17	19	26	14	12	1	
Shrinkage limit, percent	--	--	--	--	--	--	--	--	--	
Standard Proctor Compaction										
Optimum moisture, percent*	16.6	17.3	18.8	20.2	21.7	28.1	16.6	16.6	14.8	
Maximum density, pcf	109.0	107.7	104.8	102.3	99.6	88.0	109.0	109.0	112.8	
Penetration resistance, psi	--	--	--	--	--	--	--	--	--	
Percent of group in area	3	24	11	13	11	3	33	3	1	
Natural moisture content, percent	21.5	16.4	21.5	21.8	26.5	27.2	14.0	16.6	10.1	

*Standard proctor compaction results are based on borrow area 2C family of curves.

Note: Shear strength tests were not conducted on the extension of borrow area 2C.

Table 2.5-54 Summary of Laboratory Test Data

	Maximum Fines Gradation		Average Fines Gradation		Minimum Fines Gradation	
	Ø	C	Ø	C	Ø	C
	(tsf)		(tsf)		(tsf)	
Minimum density, pcf	107.1		103.1		108.7	
Maximum density, pcf	143.1		139.5		143.9	
Triaxial Shear (Q)						
At 80% R _d	38.7	0.73	38.3	1.46	40.5	1.91
At 70% R _d	38.5	0.50	42.5	0.80	42.0	1.64
Triaxial Shear (R)						
At 80% R _d	39.3	1.93	41.8	0.99	43.7	0.34
Direct Shear (S)						
At 80% R _d	39.4	0.30	42.0	0.52	44.2	0.63
At 70% R _d	36.0	0.35	44.0	0.24	42.5	0.52

R_d = Relative density

**Table 2.5-55 Granular Material Design Values
Section 1032 Material**

Relative Density	Unit Weight		Shear Strength Values			
	Ym	Ysat	Q		R&S*	
	(pcf)	(pcf)	0	C	0	C
				(tsf)		(tsf)
80%	135	143	39*	1.0	40*	0.5
70%	133	142	39*	0.7	38*	0.35

* For an analysis where pore pressure buildup has to be considered, estimated pore pressure should be incremented (suggest 10% increments) to a reasonable maximum level to check the effect of pore pressure buildup.

Ym = Moist unit weight

Ysat = Saturated unit weight

Q = Unconsolidated - undrained triaxial shear test

R = Consolidated - undrained triaxial shear test (effective)

S = Direct shear test

**Table 2.5-56 Watts Bar Nuclear Plant
Relative Density Test Results on Engineered
Granular Fill Beneath the Diesel Generator Building
(Sheet 1 of 2)**

Sample	Max. Dry Density (pcf)	Min. Dry Density (pcf)	Field Density (pcf)	Relative Density (pcf)
158	144.6	100.4	132.0	78
159	144.6	100.4	133.0	80
160	144.6	100.4	135.0	84
162	144.6	100.4	137.75	82
163	144.6	100.4	136.5	87
164	144.6	100.4	131.25	77
167	144.6	100.4	135.50	85
168	144.6	100.4	138.00	89
169	144.6	100.4	135.75	85
170	144.6	100.4	131.50	77
171	144.6	100.4	136.75	87
172	144.6	100.4	133.25	81
178	144.6	100.4	130.25	75
179	144.6	100.4	131.5	77
180	144.6	100.4	131.0	76
184	144.6	100.4	130.75	78
185	144.6	100.4	137.5	88
186	144.6	100.4	130.5	76
190	144.6	100.4	138.5	90
191	144.6	100.4	136.25	86
192	144.6	100.4	134.75	83
194	144.6	100.4	128.75	72
195	144.6	100.4	132.0	78
196	144.6	100.4	131.5	77
199	144.6	100.4	129.5	76
200	144.6	100.4	137.25	88
201	144.6	100.4	130.75	77
204	144.6	100.4	125.75	66

**Table 2.5-56 Watts Bar Nuclear Plant
Relative Density Test Results on Engineered
Granular Fill Beneath the Diesel Generator Building
(Sheet 2 of 2)**

205	144.6	100.4	127.75	70
206	144.6	100.4	127.75	70
210	144.6	100.4	128.25	71
211	144.6	100.4	137.0	87
212	138.8	109.9	133.5	83
213	138.8	109.9	137.0	96
214	138.8	109.9	136.5	93
217	138.8	109.9	133.75	86.5
218	138.8	109.9	136.5	94.5

Table 2.5-57 Watts Bar Nuclear Plant
 Sieve Analysis of 1032 Gravel
 Tennessee Valley Authority
 (Sheet 1 of 5)

SCREEN SIZE		1-1/4 in	1 in	3/4 in	3/8 in	#4	#10	#16	#40	#100	#200	
SPECIFICATION LIMITS 1032.02		100	95-100	70-100	50-85	36-65	20-45	NA	8-25	NA	0-10	
DATE	TIME	SAMPLE SOURCE	SAMPLE WT(LBS)	PERCENT PASSING								
3-21-75	12:10 PM	TVA Stockpile	16.7	100.0	100.0	91.1	66.6	44.5	26.2	NA	10.4	4.1
3-25-75	1:00 PM	TVA Stockpile	15.0	100.0	100.0	91.1	76.7	54.2	32.1	NA	10.2	3.9
3-26-75	11:15 AM	TVA Stockpile	16.7	100.0	97.2	87.2	62.4	43.7	26.8	NA	5.7	NA
3-27-75	2:30 PM	TVA Stockpile	16.7	100.0	93.6	85.8	65.3	47.1	24.4	NA	11.2	4.8
3-28-75	9:15 AM	TVA Stockpile	16.6	100.0	100.0	93.0	79.3	58.2	38.0	NA	14.4	4.4
3-31-75	9:40 AM	TVA Stockpile	16.7	100.0	100.0	92.9	66.6	42.2	23.9	NA	9.5	4.2
4-1-75	10:30 AM	TVA Stockpile	15.0	100.0	96.2	93.7	78.4	56.9	34.1	NA	13.4	5.1
4-2-75	12:00 PM	TVA Stockpile	16.4	100.0	100.0	91.6	64.6	42.6	24.5	NA	9.0	3.9
4-3-75	10:45 AM	TVA Stockpile	16.3	100.0	98.1	90.1	74.3	55.8	31.6	NA	5.3	1.6
4-4-75	9:30 AM	TVA Stockpile	17.0	100.0	97.8	92.1	77.2	59.6	38.7	NA	13.5	4.2
4-7-75	12:30 PM	TVA Stockpile	16.7	100.0	98.7	95.6	77.2	57.6	34.3	NA	10.3	4.4
4-8-75	12:15 PM	TVA Stockpile	16.7	100.0	95.7	88.3	61.9	39.9	25.1	NA	10.1	3.4
4-9-75	12:10 PM	TVA Stockpile	16.7	100.0	100.0	95.8	77.5	53.2	32.1	NA	11.7	3.4
4-10-75	1:00 PM	TVA Stockpile	16.7	100.0	100.0	87.2	49.9	32.2	20.0	NA	8.9	3.9
4-11-75	10:00 AM	TVA Stockpile	20.0	100.0	98.6	90.5	63.6	44.0	26.5	NA	8.8	3.0
4-14-75	10:00 AM	TVA Stockpile	20.0	100.0	98.5	91.6	64.0	40.8	33.5	NA	8.6	4.8
4-15-75	10:15 AM	TVA Stockpile	20.0	100.0	100.0	91.2	67.7	41.3	23.4	NA	8.1	2.7
4-16-75	12:05 AM	TVA Stockpile	16.7	100.0	100.0	88.9	63.9	43.1	26.4	NA	9.7	3.8

Table 2.5-57 Watts Bar Nuclear Plant
Sieve Analysis of 1032 Gravel
Tennessee Valley Authority
(Sheet 2 of 5)

SCREEN SIZE	1-1/4 in	1 in	3/4 in	3/8 in	#4	#10	#16	#40	#100	#200				
	100	95-100	70-100	50-85	36-65	20-45	NA	8-25	NA	0-10				
PERCENT PASSING														
SPECIFICATION LIMITS 1032.02														
DATE	TIME	SAMPLE SOURCE	SAMPLE WT(LBS)											
4-17-75	2:00 PM	TVA Stockpile	16.5	100.0	100.0	91.7	64.6	42.8	24.5	NA	9.2	NA	NA	4.0
4-18-75	1:35 PM	TVA Stockpile	16.8	100.0	99.0	94.2	73.7	54.4	33.9	NA	11.5	NA	NA	4.8
4-21-75	3:30 PM	TVA Stockpile	16.7	100.0	100.0	91.3	54.5	33.4	19.8	NA	8.5	NA	NA	3.6
4-22-75	3:30 PM	TVA Stockpile	16.6	100.0	100.0	87.6	55.0	34.1	19.3	NA	7.9	NA	NA	3.4
4-23-75	12:05	TVA Stockpile Diesel	20.0	100.0	99.0	92.9	64.5	25.7	19.3	NA	10.1	NA	NA	2.1
4-24-75	10:00 AM	Generator Fds	20.0	100.0	100.0	95.7	81.2	59.1	32.9	NA	9.5	NA	NA	4.2
4-25-75	10:50 AM	TVA Stockpile	16.7	100.0	97.1	86.3	56.9	37.8	24.1	NA	9.1	NA	NA	3.8
4-28-75	9:30 AM	TVA Stockpile	16.8	100.0	100.0	95.7	81.0	60.1	38.8	NA	14.5	NA	NA	4.6
4-29-75	12:30 PM	TVA Stockpile	16.7	100.0	100.0	90.2	72.6	54.7	35.3	NA	12.8	NA	NA	3.9
4-30-75	1:00 PM	TVA Stockpile	16.9	100.0	100.0	95.3	72.2	49.8	30.3	NA	11.1	NA	NA	3.5
5-1-75	10:00 AM	TVA Stockpile	15.0	100.0	100.0	94.2	73.9	48.3	31.1	NA	16.3	NA	NA	8.9
5-2-75	10:00 AM	TVA Stockpile	16.7	100.0	100.0	94.7	77.9	56.3	35.9	NA	13.9	NA	NA	4.5
5-5-75	1:00 PM	TVA Stockpile	16.8	100.0	100.0	94.1	81.0	63.4	42.8	NA	17.2	NA	NA	5.6
5-6-75	9:00 AM	TVA Stockpile	17.0	100.0	100.0	97.5	78.5	57.0	35.7	NA	11.6	NA	NA	3.8
5-7-75	8:30 AM	TVA Stockpile	16.9	100.0	98.9	91.6	64.4	44.3	27.1	NA	10.3	NA	NA	3.6
5-8-75	12:45 PM	TVA Stockpile	16.8	100.0	100.0	92.2	74.8	53.9	34.3	NA	12.3	NA	NA	3.9
5-9-75	1:01 PM	TVA Stockpile	16.8	100.0	100.0	98.2	74.5	51.5	31.7	NA	11.9	NA	NA	3.7

Table 2.5-57 Watts Bar Nuclear Plant
 Sieve Analysis of 1032 Gravel
 Tennessee Valley Authority
 (Sheet 3 of 5)

SCREEN SIZE	1-1/4 in	1 in	3/4 in	3/8 in	#4	#10	#16	#40	#100	#200		
	100	95-100	70-100	50-85	36-65	20-45	NA	8-25	NA	0-10		
SPECIFICATION LIMITS 1032.02												
DATE	TIME	SAMPLE SOURCE	SAMPLE WT(LBS)	PERCENT PASSING								
5-12-75	10:00 AM	TVA Stockpile	16.7	100.0	100.0	95.7	77.4	53.2	NA	11.7	NA	3.4
5-13-75	1:00 PM	TVA Stockpile	16.7	100.0	98.1	91.9	75.4	55.5	NA	12.5	NA	4.0
5-14-75	9:45 AM	TVA Stockpile	16.9	100.0	100.0	89.3	65.7	43.1	NA	10.1	NA	4.3
5-15-75	9:45 AM	TVA Stockpile	17.0	100.0	100.0	93.2	73.4	52.4	NA	13.0	NA	4.5
5-16-75	10:30 AM	TVA Stockpile	16.6	100.0	100.0	91.4	71.3	49.4	NA	10.1	NA	4.3
5-19-75	9:45 AM	TVA Stockpile	16.7	100.0	100.0	97.7	76.1	54.9	NA	10.2	NA	3.5
5-20-75	1:30 PM	TVA Stockpile	16.1	100.0	100.0	86.9	52.2	30.0	NA	6.6	NA	8.3
5-21-75	9:30 AM	TVA Stockpile	16.8	100.0	100.0	95.6	80.9	60.0	NA	14.5	NA	4.6
5-22-75	10:00 AM	TVA Stockpile	16.7	100.0	100.0	87.3	49.9	32.2	NA	8.9	NA	3.9
5-23-75	9:30 AM	TVA Stockpile	16.6	100.0	100.0	91.7	71.4	49.4	NA	10.2	NA	4.3
5-27-75	9:30 AM	TVA Stockpile	16.7	100.0	100.0	87.2	49.8	32.3	NA	8.9	NA	3.8
5-28-75	9:30 AM	TVA Stockpile	16.8	100.0	100.0	96.3	72.6	54.8	NA	12.8	NA	3.8
5-29-75	9:30 AM	TVA Stockpile	16.7	100.0	98.6	86.4	64.4	43.3	NA	8.6	NA	3.5
5-30-75	9:30 AM	TVA Stockpile	16.3	100.0	97.3	95.4	73.4	56.0	NA	13.7	NA	4.5
6-2-75	9:15 PM	TVA Stockpile	16.7	100.0	100.0	87.2	49.8	32.2	NA	8.9	NA	3.8
6-3-75	1:00 PM	TVA Stockpile	15.4	100.0	100.0	81.3	54.0	30.2	NA	14.5	NA	4.8
6-4-75	10:30 AM	TVA Stockpile	16.6	100.0	100.0	91.7	66.9	43.7	NA	9.5	NA	3.2
6-5-75	5:00 PM	TVA Stockpile	16.8	100.0	98.1	91.2	73.3	53.1	NA	11.2	NA	4.5

Table 2.5-57 Watts Bar Nuclear Plant
 Sieve Analysis of 1032 Gravel
 Tennessee Valley Authority
 (Sheet 4 of 5)

SCREEN SIZE	1-1/4 in	1 in	3/4 in	3/8 in	#4	#10	#16	#40	#100	#200		
	100	95-100	70-100	50-85	36-65	20-45	NA	8-25	NA	0-10		
PERCENT PASSING												
SPECIFICATION LIMITS 1032.02												
DATE	TIME	SAMPLE SOURCE	SAMPLE WT(LBS)									
6-6-75	9:30 AM	TVA Stockpile	15.3	100.0	97.3	95.2	73.3	55.9	NA	13.5	NA	3.7
6-9-75	10:00 AM	TVA Stockpile	16.6	100.0	100.0	95.6	77.7	58.0	NA	10.5	NA	3.5
6-10-75	10:00 AM	TVA Stockpile	16.5	100.0	100.0	91.5	71.1	49.1	NA	9.0	NA	2.8
6-12-75	7:30 AM	TVA Stockpile	16.6	100.0	99.5	95.8	77.5	57.6	NA	10.3	NA	3.5
6-13-75	9:30 AM	TVA Stockpile	16.6	100.0	100.0	97.7	82.2	63.5	NA	16.7	NA	5.9
6-16-75	9:30 AM	TVA Stockpile	16.6	100.0	99.6	95.7	77.5	57.9	NA	10.3	NA	3.4
6-17-75	12:30 PM	TVA Stockpile	16.7	100.0	97.2	91.9	77.4	57.4	NA	12.0	NA	2.5
6-18-75	9:30 AM	TVA Stockpile	16.7	100.0	100.0	93.8	76.8	56.5	NA	11.6	NA	2.8
6-19-75	9:30 AM	TVA Stockpile	16.7	100.0	100.0	*	67.1	48.6	NA	9.6	NA	3.4
6-20-75	1:00 PM	TVA Stockpile	15.1	100.0	100.0	99.9	75.6	51.5	NA	7.1	NA	1.5
6-23-75	9:30 AM	TVA Stockpile	16.6	100.0	97.8	90.4	69.8	46.9	NA	11.3	NA	4.2
6-24-75	9:30 AM	TVA Stockpile	16.7	100.0	99.8	93.3	64.1	38.0	NA	8.3	NA	3.2
6-25-75	9:30 AM	TVA Stockpile	15.6	100.0	100.0	95.2	77.0	58.2	NA	8.7	NA	1.6
6-26-75	9:30 PM	TVA Stockpile	16.7	100.0	99.6	95.5	77.9	57.8	NA	11.0	NA	4.2
6-27-75	10:00 AM	TVA Stockpile	15.8	100.0	100.0	92.0	56.1	37.1	NA	9.4	NA	3.3
6-30-75	9:30 AM	TVA Stockpile	16.7	100.0	100.0	89.4	67.4	48.6	NA	9.8	NA	3.1
7-1-75	12:30 PM	TVA Stockpile	16.2	100.0	99.2	90.1	75.6	57.8	NA	4.8	NA	1.7
7-2-75	10:30 AM	TVA Stockpile	16.5	100.0	100.0	91.8	64.7	42.7	NA	9.0	NA	4.0

Table 2.5-57 Watts Bar Nuclear Plant
 Sieve Analysis of 1032 Gravel
 Tennessee Valley Authority
 (Sheet 5 of 5)

SCREEN SIZE	1-1/4 in	1 in	3/4 in	3/8 in	#4	#10	#16	#40	#100	#200			
	100	95-100	70-100	50-85	36-65	20-45	NA	8-25	NA	0-10			
PERCENT PASSING													
SPECIFICATION LIMITS 1032.02													
DATE	TIME	SAMPLE SOURCE	SAMPLE WT(LBS)										
7-3-75	9:30 AM	TVA Stockpile	16.5	100.0	97.4	94.7	73.1	52.5	30.7	NA	8.3	NA	2.5
7-9-75	5:30 PM	TVA Stockpile	16.7	100.0	100.0	93.2	68.3	96.7	27.5	NA	8.7	NA	3.1
7-10-75	10:00 AM	TVA Stockpile	16.8	100.0	97.7	89.7	73.3	53.7	34.3	NA	12.9	NA	3.6
7-11-75	9:30 AM	TVA Stockpile	15.7	100.0	100.0	89.2	61.7	41.9	23.9	NA	7.0	NA	2.6
7-14-75	9:30 AM	TVA Stockpile	15.8	100.0	100.0	91.8	56.4	37.6	22.7	NA	9.5	NA	3.5
7-15-75	2:00 PM	TVA Stockpile	16.7	100.0	100.0	97.6	75.9	54.8	34.2	NA	10.2	NA	3.4
7-16-75	1:00 PM	TVA Stockpile	15.8	100.0	100.0	96.5	79.6	58.4	34.0	NA	9.9	NA	0.0
7-17-75	2:00 PM	TVA Stockpile	16.4	100.0	100.0	98.0	77.0	57.7	35.0	NA	9.2	NA	1.6
7-18-75	2:00 PM	TVA Stockpile	15.2	100.0	100.0	99.4	76.0	51.4	27.2	NA	7.5	NA	0.0
7-21-75	1:00 PM	TVA Stockpile	16.8	100.0	100.0	96.1	75.5	52.8	31.3	NA	10.1	NA	3.2
7-22-75	1:30 PM	TVA Stockpile	16.5	100.0	100.0	97.5	77.0	51.9	28.7	NA	9.7	NA	4.0
7-23-75		TVA Stockpile	16.8	100.0	100.0	95.6	80.4	64.8	43.3	NA	16.6	NA	6.5
7-24-75	10:30 PM	TVA Stockpile	16.7	100.0	100.0	97.5	64.9	40.2	21.7	NA	6.8	NA	1.2
7-25-75		TVA Stockpile	16.8	100.0	100.0	92.2	74.8	53.9	34.3	NA	12.3	NA	3.9
7-28-75	9:30 AM	TVA Stockpile	16.9	100.0	100.0	95.3	63.4	46.5	28.6	NA	8.6	NA	2.4
7-29-75	7:10 AM	TVA Stockpile	16.2	100.0	99.1	90.2	75.3	57.8	31.1	NA	4.9	NA	1.1
7-30-75	10:30 AM	TVA Stockpile	16.8	100.0	100.0	85.6	68.8	43.2	26.1	NA	8.9	NA	3.6

*Omitted by mistake

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 1 of 20)**

Date 1982		P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
MAR	1	698.6	712.9	713.5	711.2	703.4	713.2	716.3	--	680.61
	2	--	--	--	--	--	--	--	0.00	--
	3	--	--	--	--	--	--	--	0.00	--
	4	698.9	713.0	713.6	711.4	703.0	713.0	716.1	0.00	681.83
	5	--	--	--	--	--	--	--	--	--
	6	--	--	--	--	--	--	--	1.20	--
	7	--	--	--	--	--	--	--	--	--
	8	698.6	713.0	713.2	711.4	703.6	713.2	716.3	0.00	681.99
	9	--	--	--	--	--	--	--	0.00	--
	10	699.0	713.3	714.0	711.5	703.2	713.3	717.3	0.00	682.04
	11	--	--	--	--	--	--	--	--	--
	12	--	--	--	--	--	--	--	--	--
	13	--	--	--	--	--	--	--	0.93	--
	14	--	--	--	--	--	--	--	--	--
	15	698.8	713.3	714.0	711.5	702.9	712.7	717.1	--	681.87
	16	--	--	--	--	--	--	--	0.25	--
	17	--	--	--	--	--	--	--	0.30	--
	18	699.1	713.4	714.1	711.6	703.4	713.3	717.1	0.20	681.95
	19	--	--	--	--	--	--	--	0.00	--
	20	--	--	--	--	--	--	--	0.00	--
	21	--	--	--	--	--	--	--	--	--
	22	699.3	713.2	713.6	711.6	703.1	713.1	716.9	0.47	680.90
	23	--	--	--	--	--	--	--	0.00	--
	24	699.4	713.3	713.5	711.4	703.0	713.1	*	0.00	679.45
	25	--	--	--	--	--	--	--	0.00	--
	26	--	--	--	--	--	--	--	0.00	--
	27	--	--	--	--	--	--	--	0.00	--
	28	--	--	--	--	--	--	--	0.00	--
	29	698.9	712.9	712.9	710.8	702.7	712.3	*	0.00	681.38

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 2 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level	
30	--	--	--	--	--	--	--	0.00	--	
31	--	--	--	--	--	--	--	0.41	--	
*Destroyed										
APR	1	698.9	712.7	712.8	710.6	702.7	709.9 ¹	*	0.00	680.74
	2	--	--	--	--	--	--	--	0.00	--
	3	--	--	--	--	--	--	--	0.00	--
	4	--	--	--	--	--	--	--	0.00	--
	5	698.7	712.7	712.3	709.9	702.6	707.3	--	0.21	679.45
	6	--	--	--	--	--	--	--	0.00	--
	7	--	--	--	--	--	--	--	0.00	--
	8	698.5	712.6	712.1	709.0	702.6	707.3	--	0.54	680.31
	9	--	--	--	--	--	--	--	0.00	--
	10	--	--	--	--	--	--	--	0.00	--
	11	--	--	--	--	--	--	--	0.00	--
	12	698.4	712.5	712.1	707.7	702.8	707.4	--	0.00	680.41
	13	--	--	--	--	--	--	--	0.00	--
	14	--	--	--	--	--	--	--	0.00	--
	15	698.4	712.3	711.4	707.3	702.7	707.2	707.7**	0.00	680.04
	16	--	--	--	--	--	--	--	0.00	--
	17	--	--	--	--	--	--	--	0.49	--
	18	--	--	--	--	--	--	--	0.00	--
	19	698.5	712.7	713.1	709.0	702.8	707.3	716.5	0.00	680.5
	20	--	--	--	--	--	--	--	0.00	--
	21	698.6	712.1	710.7	706.8	702.6	707.1	716.4	0.00	680.54
	22	--	--	--	--	--	--	--	0.00	--
	23	--	--	--	--	--	--	--	0.00	--
	24	--	--	--	--	--	--	--	0.00	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 3 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
25	--	--	--	--	--	--	--	0.66	--
26	698.6	711.9	710.1	706.3	702.7	707.0	716.8	0.18	680.96
27	--	--	--	--	--	--	--	0.11	--
28	698.5	711.9	710.0	706.2	702.6	707.1	716.9	0.00	681.32
29	--	--	--	--	--	--	--	0.00	--
30	--	--	--	--	--	--	--	0.00	--
* Destroyed									
** Repaired									
¹ Dropping due to nearby excavation for CML									
MAY	1	--	--	--	--	--	--	0.02	--
	2	--	--	--	--	--	--	0.00	--
	3	698.2	711.9	709.8	705.9	702.6	707.2	0.00	682.18
	4	--	--	--	--	--	--	0.00	--
	5	--	--	--	--	--	--	0.00	--
	6	--	--	--	--	--	--	0.00	--
	7	698.8	711.7	709.5	705.7	702.5	707.2	0.41	682.35
	8	--	--	--	--	--	--	0.00	--
	9	--	--	--	--	--	--	0.00	--
	10	698.7	711.8	710.7	705.6	702.5	707.3	0.00	682.57
	11	--	--	--	--	--	--	0.00	--
	12	698.7	711.9	711.0	705.6	702.5	707.2	0.00	682.40
	13	--	--	--	--	--	--	0.00	--
	14	--	--	--	--	--	--	0.00	--
	15	--	--	--	--	--	--	0.00	--
	16	--	--	--	--	--	--	0.00	--
	17	698.6	712.0	711.0	705.8	702.5	707.2	0.00	682.17
	18	--	--	--	--	--	--	0.00	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 4 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level	
	19	--	--	--	--	--	--	0.00	--	
	20	698.5	712.1	710.9	705.9	702.5	707.2	716.8	0.00	682.16
	21	--	--	--	--	--	--	0.00	--	
	22	--	--	--	--	--	--	1.78	--	
	23	--	--	--	--	--	--	0.00	--	
	24	698.9	712.3	711.7	705.9	702.5	707.4	716.9	0.00	682.13
	25	--	--	--	--	--	--	0.00	--	
	26	--	--	--	--	--	--	0.38	--	
	27	699.0	712.5	711.9	706.1	702.5	707.3	716.9	0.00	682.60
	28	--	--	--	--	--	--	0.70	--	
	29	--	--	--	--	--	--	0.00	--	
	30	--	--	--	--	--	--	0.00	--	
	31	--	--	--	--	--	--	0.00	--	
JUNE	1	699.4	712.6	712.1	706.2	702.5	707.4	716.9	0.00	682.77
	2	--	--	--	--	--	--	0.00	--	
	3	699.3	712.6	712.0	706.4	702.5	707.5	716.9	0.00	682.35
	4	--	--	--	--	--	--	0.00	--	
	5	--	--	--	--	--	--	0.00	--	
	6	--	--	--	--	--	--	0.00	--	
	7	699.1	712.6	712.2	706.5	702.4	707.4	716.9	0.00	682.31
	8	--	--	--	--	--	--	0.00	--	
	9	699.0	712.6	712.3	706.5	702.5	707.4	716.8	0.00	682.11
	10	--	--	--	--	--	--	0.00	--	
	11	--	--	--	--	--	--	0.00	--	
	12	--	--	--	--	--	--	0.00	--	
	13	--	--	--	--	--	--	0.00	--	
	14	698.9	712.5	713.0	706.7	702.5	707.3	716.7	0.00	682.41
	15	--	--	--	--	--	--	0.00	--	
	16	699.3	712.6	713.0	706.6	702.5	707.3	716.7	0.00	682.45

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 5 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
17	--	--	--	--	--	--	--	0.00	--
18	--	--	--	--	--	--	--	0.00	--
19	--	--	--	--	--	--	--	0.00	--
20	--	--	--	--	--	--	--	0.00	--
21	699.7	712.6	712.9	706.6	702.5	707.3	716.6	0.00	683.01
22	--	--	--	--	--	--	--	0.00	--
23	699.7	712.4	712.5	706.8	702.4	707.3	716.5	0.00	682.57
24	--	--	--	--	--	--	--	0.02	--
25	--	--	--	--	--	--	--	0.01	--
26	--	--	--	--	--	--	--	1.83	--
27	--	--	--	--	--	--	--	0.16	--
28	700.0	712.6	712.8	706.8	702.5	707.4	716.6	0.00	682.87
29	--	--	--	--	--	--	--	0.00	--
30	700.0	712.5	712.7	706.8	702.4	707.4	717.1	0.00	682.64
JULY 1	--	--	--	--	--	--	--	0.00	--
2	--	--	--	--	--	--	--	0.00	--
3	--	--	--	--	--	--	--	0.00	--
4	--	--	--	--	--	--	--	0.00	--
5	--	--	--	--	--	--	--	0.00	--
6	700.0	712.6	712.8	706.7	702.4	707.3	717.0	0.00	682.77
7	--	--	--	--	--	--	--	0.00	--
8	700.1	712.6	712.7	706.9	702.5	707.3	716.9	0.03	681.93
9	--	--	--	--	--	--	--	0.22	--
10	--	--	--	--	--	--	--	0.00	--
11	--	--	--	--	--	--	--	0.00	--
12	700.0	712.6	712.8	706.9	702.4	707.4	716.9	0.00	683.50
13	--	--	--	--	--	--	--	0.00	--
14	700.1	712.5	712.8	706.8	702.4	707.4	716.9	0.00	682.7
15	--	--	--	--	--	--	--	0.00	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 6 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
16	--	--	--	--	--	--	--	0.00	--
17	--	--	--	--	--	--	--	0.00	--
18	--	--	--	--	--	--	--	0.00	--
19	700.0	712.5	712.8	706.8	702.3	707.3	717.0	0.00	682.26
20	--	--	--	--	--	--	--	0.00	--
21	--	--	--	--	--	--	--	0.42	--
22	700.1	712.5	712.7	706.8	702.3	706.7	716.8	0.02	683.46
23	--	--	--	--	--	--	--	0.01	--
24	--	--	--	--	--	--	--	0.00	--
25	--	--	--	--	--	--	--	0.00	--
26	700.0	712.3	712.7	706.7	702.4	706.4	716.2	0.00	682.57
27	--	--	--	--	--	--	--	0.29	--
28	--	--	--	--	--	--	--	0.03	--
29	700.0	712.7	712.7	706.9	702.3	706.4	716.7	0.00	682.05
30	--	--	--	--	--	--	--	0.12	--
31	--	--	--	--	--	--	--	0.97	--
AUG 1	--	--	--	--	--	--	--	0.00	--
2	700.2	712.7	712.7	706.8	702.5	706.5	716.8	0.00	683.99
3	--	--	--	--	--	--	--	0.00	--
4	700.1	712.7	712.7	706.7	702.4	706.4	716.8	0.00	683.70
5	--	--	--	--	--	--	--	0.00	--
6	--	--	--	--	--	--	--	0.00	--
7	--	--	--	--	--	--	--	0.21	--
8	--	--	--	--	--	--	--	0.50	--
9	700.2	712.7	712.7	706.7	702.4	707.4	716.7	0.63	682.83
10	--	--	--	--	--	--	--	0.35	--
11	700.1	712.7	712.6	706.7	702.5	708.0	716.7	0.13	682.90
12	--	--	--	--	--	--	--	0.00	--
13	--	--	--	--	--	--	--	0.00	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 7 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level	
14	--	--	--	--	--	--	--	0.00	--	
15	--	--	--	--	--	--	--	0.00	--	
16	699.9	711.9	712.5	706.7	702.4	708.9	716.9	0.33	681.23	
17	--	--	--	--	--	--	--	1.26	--	
18	700.2	712.8	712.7	706.7	702.5	707.1	717.0	0.02	682.40	
19	--	--	--	--	--	--	--	0.00	--	
20	--	--	--	--	--	--	--	0.00	--	
21	--	--	--	--	--	--	--	0.00	--	
22	--	--	--	--	--	--	--	0.00	--	
23	699.9	712.6	712.7	706.7	702.5	709.7*	717.0	0.52	682.63	
24	--	--	--	--	--	--	--	0.00	--	
25	700.0	712.7	712.7	706.7	702.5	710.0	716.9	0.00	682.68	
26	--	--	--	--	--	--	--	0.10	--	
27	--	--	--	--	--	--	--	0.00	--	
28	--	--	--	--	--	--	--	0.00	--	
29	--	--	--	--	--	--	--	0.00	--	
30	699.9	712.6	712.5	706.7	702.4	709.6	716.8	0.17	682.40	
31	--	--	--	--	--	--	--	0.53	--	
* Changed 2.6 since 18th.										
SEPT	1	699.9	712.5	712.6	706.7	702.5	709.8	716.8	0.03	682.50
	2	--	--	--	--	--	--	--	0.25	--
	3	--	--	--	--	--	--	--	0.02	--
	4	--	--	--	--	--	--	--	0.00	--
	5	--	--	--	--	--	--	--	0.00	--
	6	699.9	712.5	712.3	706.5	702.4	710.4	717.0	0.00	681.8
	7	--	--	--	--	--	--	--	0.00	--
	8	699.8	712.5	712.5	706.6	702.5	710.5	717.2	0.00	681.19

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 8 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
9	--	--	--	--	--	--	--	0.00	--
10	--	--	--	--	--	--	--	0.00	--
11	--	--	--	--	--	--	--	0.22	--
12	--	--	--	--	--	--	--	0.00	--
13	699.6	712.3	712.3	706.6	702.5	710.5	717.1	0.08	680.86
14	--	--	--	--	--	--	--	0.11	--
15	699.7	712.5	712.4	706.6	702.5	710.6	717.1	0.00	682.10
16	--	--	--	--	--	--	--	0.00	--
17	--	--	--	--	--	--	--	0.00	--
18	--	--	--	--	--	--	--	0.00	--
19	--	--	--	--	--	--	--	0.00	--
20	699.8	712.3	712.3	708.3	702.4	710.4	717.0	0.00	681.70
21	--	--	--	--	--	--	--	0.00	--
22	699.2	712.3	713.1	708.7	702.5	710.3	716.9	0.00	682.04
23	--	--	--	--	--	--	--	0.00	--
24	--	--	--	--	--	--	--	0.00	--
25	--	--	--	--	--	--	--	0.44	--
26	--	--	--	--	--	--	--	0.09	--
27	698.9	712.4	713.3	709.4	702.4	710.5	716.9	0.00	681.55
28	--	--	--	--	--	--	--	0.00	--
29	698.9	712.4	713.2	709.6	702.4	710.5	716.9	0.00	682.33
30	--	--	--	--	--	--	--	0.00	--
OCT									
1	--	--	--	--	--	--	--	0.00	--
2	--	--	--	--	--	--	--	0.00	--
3	--	--	--	--	--	--	--	0.00	--
4	698.4	712.5	713.6	709.9	702.4	710.3	716.9	0.00	682.14
5	--	--	--	--	--	--	--	0.00	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 9 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
6	698.8	712.3	713.0	710.2	702.4	710.2	716.9	0.00	681.92
7	--	--	--	--	--	--	--	1.38	--
8	--	--	--	--	--	--	--	0.04	--
9	--	--	--	--	--	--	--	0.00	--
10	--	--	--	--	--	--	--	0.77	--
11	--	--	--	--	--	--	--	0.00	--
12	699.4	712.6	713.9	710.5	702.6	711.1	717.3	0.69	681.34
13	--	--	--	--	--	--	--	0.35	--
14	--	--	--	--	--	--	--	0.00	--
15	--	--	--	--	--	--	--	0.00	--
16	--	--	--	--	--	--	--	0.00	--
17	--	--	--	--	--	--	--	0.00	--
18	699.7	713.2	714.4	710.7	702.6	711.3	717.1	0.00	680.74
19	--	--	--	--	--	--	--	0.00	--
20	--	--	--	--	--	--	--	0.00	--
21	--	--	--	--	--	--	--	0.00	--
22	--	--	--	--	--	--	--	0.00	--
23	--	--	--	--	--	--	--	0.00	--
24	--	--	--	--	--	--	--	0.00	--
25	698.8	713.2	714.3	710.9	702.5	711.0	717.1	0.00	681.43
26	--	--	--	--	--	--	--	0.00	--
27	--	--	--	--	--	--	--	0.00	--
28	--	--	--	--	--	--	--	0.00	--
29	--	--	--	--	--	--	--	0.00	--
30	--	--	--	--	--	--	--	0.00	--
31	--	--	--	--	--	--	--	0.00	--
NOV									
1	698.2	712.8	713.3	710.7	702.5	711.0	711.1	0.00	679.77
2	--	--	--	--	--	--	--	0.00	--
3	--	--	--	--	--	--	--	2.32	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 10 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
4	--	--	--	--	--	--	--	0.05	--
5	--	--	--	--	--	--	--	0.00	--
6	--	--	--	--	--	--	--	0.00	--
7	--	--	--	--	--	--	--	0.00	--
8	698.1	712.6	712.8	710.2	702.7	711.6	717.2	0.00	680.29
9	--	--	--	--	--	--	--	0.00	--
10	--	--	--	--	--	--	--	0.00	--
11	--	--	--	--	--	--	--	0.00	--
12	--	--	--	--	--	--	--	0.60	--
13	--	--	--	--	--	--	--	0.00	--
14	--	--	--	--	--	--	--	0.00	--
15	697.8	712.5	712.5	709.9	702.7	711.6	717.1	0.00	680.60
16	--	--	--	--	--	--	--	0.00	--
17	--	--	--	--	--	--	--	1.48	--
18	--	--	--	--	--	--	--	0.41	--
19	--	--	--	--	--	--	--	0.08	--
20	--	--	--	--	--	--	--	0.00	--
21	--	--	--	--	--	--	--	0.78	--
22	698.7	712.8	712.9	710.1	702.7	712.3	717.5	0.16	680.00
23	--	--	--	--	--	--	--	0.00	--
24	--	--	--	--	--	--	--	0.00	--
25	--	--	--	--	--	--	--	0.00	--
26	--	--	--	--	--	--	--	0.00	--
27	--	--	--	--	--	--	--	0.19	--
28	--	--	--	--	--	--	--	1.53	--
29	699.5	712.8	712.7	710.0	703.8	712.8	717.7	0.00	680.32
30	--	--	--	--	--	--	--	1.03	--
DEC									
1	--	--	--	--	--	--	--	2.79	--
2	--	--	--	--	--	--	--	0.00	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 11 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
3	--	--	--	--	--	--	--	0.00	--
4	--	--	--	--	--	--	--	0.08	--
5	--	--	--	--	--	--	--	0.69	--
6	700.2	713.1	713.5	710.4	703.5	713.4	718.2	0.00	682.32
7	--	--	--	--	--	--	--	0.00	--
8	--	--	--	--	--	--	--	0.00	--
9	--	--	--	--	--	--	--	0.00	--
10	--	--	--	--	--	--	--	0.00	--
11	--	--	--	--	--	--	--	0.88	--
12	--	--	--	--	--	--	--	0.15	--
13	699.9	713.2	714.1	710.8	703.4	713.2	718.2	0.00	681.1
14	--	--	--	--	--	--	--	0.00	--
15	--	--	--	--	--	--	--	1.59	--
16	--	--	--	--	--	--	--	0.00	--
17	--	--	--	--	--	--	--	0.00	--
18	--	--	--	--	--	--	--	0.00	--
19	--	--	--	--	--	--	--	0.08	--
20	700.3	713.6	714.4	711.4	703.0	713.4	718.5	0.00	683.0
21	--	--	--	--	--	--	--	0.00	--
22	--	--	--	--	--	--	--	0.03	--
23	--	--	--	--	--	--	--	0.05	--
24	--	--	--	--	--	--	--	0.04	--
25	--	--	--	--	--	--	--	0.16	--
26	--	--	--	--	--	--	--	0.60	--
27	700.1	713.8	714.5	711.2	702.7	712.5	717.8	0.00	681.31
28	--	--	--	--	--	--	--	0.72	--
29	--	--	--	--	--	--	--	0.00	--
30	--	--	--	--	--	--	--	0.11	--
31	--	--	--	--	--	--	--	0.00	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 12 of 20)**

Date 1982		P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
JAN	1	--	--	--	--	--	--	--	0.00	--
	2	--	--	--	--	--	--	--	1.13	--
	3	700.0	713.6	714.6	711.7	703.0	713.1	718.2	0.00	681.02
	4	--	--	--	--	--	--	--	0.00	--
	5	--	--	--	--	--	--	--	0.00	--
	6	--	--	--	--	--	--	--	0.00	--
	7	--	--	--	--	--	--	--	0.00	--
	8	--	--	--	--	--	--	--	0.00	--
	9	--	--	--	--	--	--	--	0.26	--
	10	699.8	713.4	714.3	711.5	702.8	712.8	718.5	0.10	679.00
	11	--	--	--	--	--	--	--	0.04	--
	12	--	--	--	--	--	--	--	0.00	--
	13	--	--	--	--	--	--	--	0.00	--
	14	--	--	--	--	--	--	--	0.00	--
	15	--	--	--	--	--	--	--	0.00	--
	16	--	--	--	--	--	--	--	0.00	--
	17	699.5	713.2	713.9	711.0	702.7	712.5	718.3	0.00	680.30
	18	--	--	--	--	--	--	--	0.00	--
	19	--	--	--	--	--	--	--	0.00	--
	20	--	--	--	--	--	--	--	0.26	--
	21	--	--	--	--	--	--	--	0.33	--
	22	--	--	--	--	--	--	--	0.00	--
	23	--	--	--	--	--	--	--	0.00	--
	24	699.3	713.3	713.9	711.1	702.9	712.6	718.3	0.00	680.10
	25	--	--	--	--	--	--	--	0.00	--
	26	--	--	--	--	--	--	--	0.00	--
	27	--	--	--	--	--	--	--	0.00	--
	28	--	--	--	--	--	--	--	0.00	--
	29	--	--	--	--	--	--	--	0.08	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 13 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level	
	30	--	--	--	--	--	--	0.06	--	
	31	699.0	713.3	713.8	711.0	702.7	712.4	718.6	0.00	678.42
FEB	1	--	--	--	--	--	--	1.87	--	
	2	--	--	--	--	--	--	0.08	--	
	3	--	--	--	--	--	--	0.00	--	
	4	--	--	--	--	--	--	0.00	--	
	5	--	--	--	--	--	--	0.11	--	
	6	--	--	--	--	--	--	0.35	--	
	7	699.3	713.3	713.9	711.2	702.7	713.4	718.8	0.00	680.64
	8	--	--	--	--	--	--	0.00	--	
	9	--	--	--	--	--	--	0.03	--	
	10	--	--	--	--	--	--	1.34	--	
	11	--	--	--	--	--	--	0.16	--	
	12	--	--	--	--	--	--	0.00	--	
	13	--	--	--	--	--	--	0.00	--	
	14	700.0	713.5	713.7	711.0	703.2	713.7	718.7	0.00	681.00
	15	--	--	--	--	--	--	0.00	--	
	16	--	--	--	--	--	--	0.00	--	
	17	--	--	--	--	--	--	0.00	--	
	18	--	--	--	--	--	--	0.00	--	
	19	--	--	--	--	--	--	0.00	--	
	20	--	--	--	--	--	--	0.00	--	
	21	699.5	713.3	713.2	710.7	702.7	712.7	718.3	0.48	680.11
	22	--	--	--	--	--	--	0.00	--	
	23	--	--	--	--	--	--	0.00	--	
	24	--	--	--	--	--	--	0.00	--	
	25	--	--	--	--	--	--	0.00	--	
	26	--	--	--	--	--	--	0.00	--	
	27	--	--	--	--	--	--	0.00	--	

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 14 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level	
	28	699.4	713.1	712.9	710.4	702.7	712.7	719.0	0.00	677.46
MAR	1	--	--	--	--	--	--	--	0.00	--
	2	--	--	--	--	--	--	--	0.00	--
	3	--	--	--	--	--	--	--	0.00	--
	4	--	--	--	--	--	--	--	0.00	--
	5	--	--	--	--	--	--	--	0.63	--
	6	--	--	--	--	--	--	--	0.41	--
	7	699.0	713.4	713.9	710.8	703.2	712.8	718.8	0.00	678.77
	8	--	--	--	--	--	--	--	0.00	--
	9	--	--	--	--	--	--	--	0.00	--
	10	--	--	--	--	--	--	--	0.00	--
	11	--	--	--	--	--	--	--	0.03	--
	12	--	--	--	--	--	--	--	0.00	--
	13	--	--	--	--	--	--	--	0.00	--
	14	698.9	713.5	714.5	710.6	702.8	712.6	718.9	0.00	679.64
	15	--	--	--	--	--	--	--	0.00	--
	16	--	--	--	--	--	--	--	0.00	--
	17	--	--	--	--	--	--	--	0.00	--
	18	--	--	--	--	--	--	--	0.00	--
	19	--	--	--	--	--	--	--	0.00	--
	20	--	--	--	--	--	--	--	1.31	--
	21	698.5	713.5	713.9	711.0	702.9	712.5	718.6	0.00	678.32
	22	--	--	--	--	--	--	--	0.00	--
	23	--	--	--	--	--	--	--	0.00	--
	24	--	--	--	--	--	--	--	0.27	--
	25	--	--	--	--	--	--	--	0.02	--
	26	--	--	--	--	--	--	--	0.43	--
	27	--	--	--	--	--	--	--	0.53	--
	28	698.3	713.2	713.9	710.7	702.9	712.1	718.4	0.00	676.98

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 15 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level	
	29	--	--	--	--	--	--	0.37	--	
	30	--	--	--	--	--	--	0.06	--	
	31	--	--	--	--	--	--	0.45	--	
APR	1	--	--	--	--	--	--	0.13	--	
	2	--	--	--	--	--	--	0.61	--	
	3	--	--	--	--	--	--	0.00	--	
	4	698.2	713.0	713.7	710.9	702.9	712.8	718.6	0.00	677.21
	5	--	--	--	--	--	--	3.71	--	
	6	--	--	--	--	--	--	0.03	--	
	7	--	--	--	--	--	--	0.00	--	
	8	--	--	--	--	--	--	0.50	--	
	9	--	--	--	--	--	--	1.02	--	
	10	--	--	--	--	--	--	0.00	--	
	11	700.0	713.5	714.3	711.2	703.5	714.3	719.0	0.04	684.35
	12	--	--	--	--	--	--	0.00	--	
	13	--	--	--	--	--	--	0.12	--	
	14	--	--	--	--	--	--	0.98	--	
	15	--	--	--	--	--	--	0.00	00	
	16	--	--	--	--	--	--	0.00	--	
	17	--	--	--	--	--	--	0.00	--	
	18	700.2	714.0	715.4	711.6	702.8	713.1	719.2	0.13	683.78
	19	--	--	--	--	--	--	0.00	--	
	20	--	--	--	--	--	--	0.00	--	
	21	--	--	--	--	--	--	0.00	--	
	22	--	--	--	--	--	--	0.00	--	
	23	--	--	--	--	--	--	0.90	--	
	24	--	--	--	--	--	--	0.53	--	
	25	699.9	714.3	715.7	712.1	703.0	713.0	719.1	0.00	683.84
	26	--	--	--	--	--	--	0.00	--	

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 16 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level	
	27	--	--	--	--	--	--	0.00	--	
	28	--	--	--	--	--	--	0.00	--	
	29	--	--	--	--	--	--	0.00	--	
	30	--	--	--	--	--	--	0.00	--	
MAY	1	--	--	--	--	--	--	0.00	--	
	2	700.1	714.1	715.2	712.1	702.7	712.5	719.1	0.00	683.44
	3	--	--	--	--	--	--	0.75	--	
	4	--	--	--	--	--	--	0.00	--	
	5	--	--	--	--	--	--	0.00	--	
	6	--	--	--	--	--	--	0.00	--	
	7	--	--	--	--	--	--	0.00	--	
	8	--	--	--	--	--	--	0.62	--	
	9	699.9	713.8	714.8	711.8	702.6	712.2	718.9	0.00	684.15
	10	--	--	--	--	--	--	0.00	--	
	11	--	--	--	--	--	--	0.00	--	
	12	--	--	--	--	--	--	0.00	--	
	13	--	--	--	--	--	--	0.00	--	
	14	--	--	--	--	--	--	0.00	--	
	15	--	--	--	--	--	--	0.29	--	
	16	699.8	713.8	714.9	711.7	702.6	712.1	718.9	0.16	683.74
	17	--	--	--	--	--	--	0.00	--	
	18	--	--	--	--	--	--	0.00	--	
	19	--	--	--	--	--	--	1.47	--	
	20	--	--	--	--	--	--	0.77	--	
	21	--	--	--	--	--	--	0.53	--	
	22	--	--	--	--	--	--	0.78	--	
	23	700.3	714.0	714.6	711.5	703.7	713.5	719.0	0.58	687.77
	24	--	--	--	--	--	--	0.00	--	
	25	--	--	--	--	--	--	0.00	--	

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 17 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
26	--	--	--	--	--	--	--	0.00	--
27	--	--	--	--	--	--	--	0.00	--
28	--	--	--	--	--	--	--	0.00	--
29	--	--	--	--	--	--	--	0.22	--
30	--	--	--	--	--	--	--	0.00	--
31	700.2	713.6	714.5	711.2	702.7	712.5	719.1	0.00	683.62
JUNE									
1	--	--	--	--	--	--	--	0.00	--
2	--	--	--	--	--	--	--	0.00	--
3	--	--	--	--	--	--	--	0.00	--
4	--	--	--	--	--	--	--	0.34	--
5	--	--	--	--	--	--	--	0.00	--
6	700.2	713.3	714.5	711.2	702.6	712.1	718.9	0.50	684.83
7	--	--	--	--	--	--	--	0.00	--
8	--	--	--	--	--	--	--	0.00	--
9	--	--	--	--	--	--	--	0.00	--
10	--	--	--	--	--	--	--	0.00	--
11	--	--	--	--	--	--	--	0.00	--
12	--	--	--	--	--	--	--	0.00	--
13	700.1	713.2	713.6	710.4	702.5	711.8	718.7	0.00	684.28
14	--	--	--	--	--	--	--	0.00	--
15	--	--	--	--	--	--	--	0.00	--
16	--	--	--	--	--	--	--	0.07	--
17	--	--	--	--	--	--	--	0.75	--
18	--	--	--	--	--	--	--	2.08	--
19	--	--	--	--	--	--	--	1.42	--
20	699.8	713.1	713.9	711.0	702.5	711.4	718.8	0.00	684.09
21	--	--	--	--	--	--	--	0.00	--
22	--	--	--	--	--	--	--	0.20	--
23	--	--	--	--	--	--	--	0.18	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 18 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
	24	--	--	--	--	--	--	0.00	--
	25	--	--	--	--	--	--	0.00	--
	26	--	--	--	--	--	--	0.00	--
	27	698.9	712.6	712.9	710.4	702.5	711.7	0.19	683.94
	28	--	--	--	--	--	--	0.00	--
	29	--	--	--	--	--	--	0.00	--
	30	--	--	--	--	--	--	0.16	--
JULY	1	--	--	--	--	--	--	0.00	--
	2	--	--	--	--	--	--	0.00	--
	3	--	--	--	--	--	--	0.00	--
	4	--	--	--	--	--	--	0.05	--
	5	698.6	712.3	712.4	710.1	702.5	711.5	0.14	683.89
	6	--	--	--	--	--	--	0.00	--
	7	--	--	--	--	--	--	0.00	--
	8	--	--	--	--	--	--	0.00	--
	9	--	--	--	--	--	--	0.00	--
	10	--	--	--	--	--	--	0.00	--
	11	698.3	712.0	712.0	709.8	702.5	711.1	0.00	683.47
	12	--	--	--	--	--	--	0.00	--
	13	--	--	--	--	--	--	0.00	--
	14	--	--	--	--	--	--	0.00	--
	15	--	--	--	--	--	--	0.00	--
	16	--	--	--	--	--	--	0.00	--
	17	--	--	--	--	--	--	0.00	--
	18	698.2	711.9	711.6	709.7	702.5	710.4	0.00	682.78
	19	--	--	--	--	--	--	--	--
	20	--	--	--	--	--	--	--	--
	21	--	--	--	--	--	--	--	--
	22	--	--	--	--	--	--	--	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 19 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
23	--	--	--	--	--	--	--	--	--
24								0.04	--
25	696.2	711.7	711.5	709.4	702.5	711.5	718.1	--	683.35
26	--	--	--	--	--	--	--	0.00	--
27	--	--	--	--	--	--	--	0.00	--
28	--	--	--	--	--	--	--	0.00	--
29	--	--	--	--	--	--	--	0.00	--
30	--	--	--	--	--	--	--	0.00	--
31	--	--	--	--	--	--	--	0.16	--
AUG 1	697.0	711.3	711.7	709.6	702.5	710.9	718.3	0.01	683.17
2	--	--	--	--	--	--	--	0.00	--
3	--	--	--	--	--	--	--	0.00	--
4	--	--	--	--	--	--	--	0.00	--
5	--	--	--	--	--	--	--	0.00	--
6	--	--	--	--	--	--	--	0.00	--
7	--	--	--	--	--	--	--	0.00	--
8	695.0	711.3	711.0	709.2	702.5	710.5	717.8	0.00	682.95
9	--	--	--	--	--	--	--	0.01	--
10	--	--	--	--	--	--	--	0.00	--
11	--	--	--	--	--	--	--	0.79	--
12	--	--	--	--	--	--	--	0.01	--
13	--	--	--	--	--	--	--	0.00	--
14	--	--	--	--	--	--	--	0.00	--
15	695.2	711.3	711.5	708.9	702.4	710.5	719.6	0.00	682.86
16	--	--	--	--	--	--	--	0.00	--
17	--	--	--	--	--	--	--	0.00	--
18	--	--	--	--	--	--	--	0.00	--
19	--	--	--	--	--	--	--	0.00	--
20	--	--	--	--	--	--	--	0.00	--

**Table 2.5-58 Watts Bar Nuclear Plant
ERCW – Piezometers
Water Level Readings
(Sheet 20 of 20)**

Date 1982	P-1	P-2	P-3	P-4	P-6	P-7	P-8	Rainfall in.	Lake Level
21	--	--	--	--	--	--	--	0.00	--
22	693.8	711.4	710.7	708.9	702.4	710.2	717.5	0.00	682.73
23	--	--	--	--	--	--	--	0.00	--
24	--	--	--	--	--	--	--	0.00	--
25	--	--	--	--	--	--	--	0.00	--
26	--	--	--	--	--	--	--	0.00	--
27	--	--	--	--	--	--	--	0.00	--
28	--	--	--	--	--	--	--	0.00	--
29	693.7	711.4	710.6	708.8	702.4	709.4	717.4	0.00	683.10
30	--	--	--	--	--	--	--	0.00	--
31	--	--	--	--	--	--	--	0.00	--

**Table 2.5-59 ERCW Route Liquefaction Evaluation
Maximum and Average Element Stresses and Peak Acceleration
at the Top of Each Layer
(Sheet 1 of 2)**

Layer	Depth (Feet)	Top of Ground				Top of Rock	
		0.25g 5Hz	0.18g 5 Hz	0.225g 5 Hz	0.25g 25 Hz	0.18g 25 Hz	
Max Element Stresses (psf)							
1	1.5	44	32	39	50	80	
2	4.5	132	95	118	149	239	
3	7.5	220	159	196	244	395	
4	10.5	308	221	275	339	549	
5	13.5	396	283	351	433	692	
6	16.6	484**	344	429	520	814	
7	19.5	566**	407	502	600	942	
8	22.5	645	466	574	671	1044	
9	25.5	720	522	643	734	1130	
10	28.5	790	575	709	793	1198	
Average Element Stresses* (psf)							
1	1.5	29	21	25	33	52	
2	4.5	86	62	77	97	155	
3	7.5	143	103	127	159	257	
4	10.5	200	144	179	220	357	
5	13.5	257	184	228	281	449	
6	16.5	315	224	279	338	536	
7	19.5	368	265	326	390	612	
8	22.5	419	303	373	436	679	
9	25.5	468	339	418	477	735	
10	28.5	514	374	461	515	779	
Top of Layer Accelerations (g)							
1	0	.24	.17	.22	.28	.44	
2	3	.24	.17	.22	.28	.44	
3	6	.24	.17	.22	.27	.44	
4	9	.24	.17	.21	.26	.43	
5	12	.24	.17	.21	.25	.41	
6	15	.23	.17	.21	.25	.39	

**Table 2.5-59 ERCW Route Liquefaction Evaluation
Maximum and Average Element Stresses and Peak Acceleration
at the Top of Each Layer
(Sheet 2 of 2)**

Layer	Depth (Feet)	Top of Ground				Top of Rock
		0.25g 5Hz	0.18g 5 Hz	0.225g 5 Hz	0.25g 25 Hz	0.18g 25 Hz
7	18	.23	.16	.20	.24	.36
8	21	.22	.16	.20	.22	.32
9	24	.21	.15	.19	.22	.27
10	27	.20	.15	.18	.22	.22
11	30	.20	.14	.18	.23	.20

* Average element stress - 0.65* max element stress

** Assume 500 psf at 17.5 feet

Table 2.5-60 Factors of Safety with Depth When the Water Table is not Considered

<u>Layer</u>	<u>Depth (Feet)</u>	$\bar{\sigma}_v$ (psf)	$\bar{\sigma}_h$ (psf)	τ/σ_3	τ_f	τ_{avg}	$FS = \tau_f/t_{avg}$
For Sample 3 - Reconstituted							
1	1.5	180	90	0.34	31	29	1.07
2	4.5	540	270	0.34	92	86	1.07
3	7.5	900	450	0.34	153	143	1.07
4	10.5	1260	630	0.34	214	200	1.07
5	13.5	1620	810	0.34	275	257	1.07
6	16.5	1980	990	0.34	337	315	1.07
7	19.5	2340	1170	0.34	398	368	1.08
8	22.5	2700	1350	0.34	459	419	1.10
9	25.5	3060	1530	0.34	520	468	1.11
10	28.5	3420	1710	0.34	581	514	1.13
For Sample 2 - In situ							
1	1.5	180	90	0.60	54	29	1.86
2	4.5	540	270	0.60	162	86	1.88
3	7.5	900	450	0.60	270	143	1.89
4	10.5	1260	630	0.60	378	200	1.89
5	13.5	1620	810	0.60	486	257	1.89
6	16.5	1980	990	0.60	594	315	1.89
7	19.5	2340	1170	0.60	702	368	1.91
8	22.5	2700	1350	0.60	810	419	1.93
9	25.5	3060	1530	0.60	918	468	1.96
10	28.5	3420	1710	0.60	1026	514	2.00

Notation:

 $\bar{\sigma}_v$ = effective vertical stress $\bar{\sigma}_h$ = effective horizontal stress τ/σ_3 = cyclic stress ration τ_f = cyclic shear stress corresponding to 5% strain τ_{avg} = average on effective shear stress

FS = Factor of Safety against 5% cyclic strain potential

**Table 2.5-61 Factors of Safety with Depth Assuming the Water Table
is 16.5 feet Below Ground Surface**

Layer	Depth (Feet)	$\bar{\sigma}_v$ (psf)	$\bar{\sigma}_h$ (psf)	τ/σ_3	τ_f	τ_{avg}	FS= τ_f/t_{avg}
For Sample 3 - Reconstituted							
1	1.5	180	90	0.34	31	29	1.07
2	4.5	540	270	0.34	92	86	1.07
3	7.5	900	450	0.34	153	143	1.07
4	10.5	1260	630	0.34	214	200	1.07
5	13.5	1620	810	0.34	275	257	1.07
6	16.5	1980	990	0.34	337	315	1.07
7	19.5	2160	1080	0.34	367	368	1.00
8	22.5	2340	1170	0.34	398	419	.95
9	25.5	2520	1260	0.34	428	468	.91
10	28.5	2700	1350	0.34	459	514	.89
For Sample 2 - In situ							
1	1.5	180	90	0.60	54	29	1.86
2	4.5	540	270	0.60	162	86	1.88
3	7.5	900	450	0.60	270	143	1.89
4	10.5	1260	630	0.60	378	200	1.89
5	13.5	1620	810	0.60	486	257	1.89
6	16.5	1980	990	0.60	594	315	1.89
7	19.5	2160	1080	0.60	648	368	1.76
8	22.5	2340	1170	0.60	702	419	1.68
9	25.5	2520	1260	0.60	756	468	1.62
10	28.5	2700	1350	0.60	810	514	1.58

Notation:

$\bar{\sigma}_v$ = effective vertical stress

$\bar{\sigma}_h$ = effective horizontal stress

τ/σ_3 = cyclic stress ration

τ_f = cyclic shear stress corresponding to 5% strain

τ_{avg} = average on effective shear stress

FS = Factor of Safety against 5% cyclic strain potential

Table 2.5-62 SUMMARY OF SPT SAMPLES OF SILTY SANDS (SM) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 1 of 8)

Boring No.	Ellev. (ft)	SPT Blow Counts	Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D ₅₀ (mm)	Fines Content (%)	Remarks
SS-49	700.9	13	SM-SC	28.3	6.5	25.1	0.074	49.0	
SS-49A	700.7	5	SM	NP	NP	26.5	0.110	31.0	same sample
	700.7	5	SM	23.0	1.0	29.0	0.990	42.0	
	698.7	6	SM	23.0	1.0	29.9	0.990	41.0	
SS-131	696.7	5	SM	NP	NP	31.8	0.120	29.0	same sample
	696.7	5	SM	29.0	4.0	32.4	0.080	47.0	
	692.7	5	SM	23.0	1.0	28.7	0.080	47.0	
SS-50A	690.7	6	SM	NP	NP	30.0	0.120	31.0	same sample
	688.7	17	SM	NP	NP	31.2	0.120	38.0	
	688.7	17	SM	NP	NP	21.2	0.650	19.4	
	699.9	4	SM	30.8	6.9	28.1	0.080	48.0	
	697.9	5	SM	25.9	3.3	30.1	0.080	45.0	
	695.9	5	SM	25.9	3.3	29.7	0.080	45.0	
	693.9	7	SM	NP	NP	26.2	0.085	45.0	
SS-50A	691.9	7	SM	NP	NP	24.0	0.085	45.0	same sample
	702.2	14	SM	NP	NP	25.5	0.010	35.0	
	700.2	11	SM	27.0	2.0	28.8	0.100	37.0	
	700.2	11	SM	NP	NP	26.9	0.173	22.0	

Table 2.5-62 SUMMARY OF SPT SAMPLES OF SILTY SANDS (SM) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 2 of 8)

Boring No.	Ellev. (ft)	SPT Blow Counts	Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D 50 (mm)	Fines Content (%)	Remarks
	698.2	13	SM	26.0	2.0	27.4	0.100	38.0	same sample
	698.2	13	SM	NP	NP	28.8	0.120	29.0	
	696.2	9	SM	NP	NP	33.5	0.130	26.0	same sample
	696.2	9	SM	NP	NP	33.5	0.120	26.0	
	694.2	5	SM	NP	NP	38.4	0.090	39.0	
SS-50	701.8	10	SM	34.1	7.6	22.4	0.084	47.0	
	697.8	5	SM	NP	NP	28.2	0.098	43.0	
	695.8	8	SM	NP	NP	29.1	0.093	43.0	
	693.8	2	SM	NP	NP	31.5	0.087	47.0	
	691.8	10	G-SM	NP	NP	23.7	0.190	33.9	
SS-133	704.0	19	G-SM	NP	NP	17.3	0.250	29.0	
SS-134	710.5	3	SM	NP	NP	29.3	0.148	26.0	
	708.5	8	SM	NP	NP	27.5	0.141	31.0	
SS-134A	709.5	4	SM	23.0	1.0	30.0	0.105	35.0	same sample
	709.5	4	SM	NP	NP	29.1	0.110	30.0	
	707.5	9	SM	24.0	2.0	27.9	0.100	27.0	
	707.5	9	SM	24.0	1.0	28.9	0.090	43.0	same sample
SS-135	712.0	11	SM	34.1	8.7	23.6	-	-	
	710.9	12	SM	30.0	4.4	20.1	-	-	
	708.9	8	SM	NP	NP	-	-	-	

Table 2.5-62 SUMMARY OF SPT SAMPLES OF SILTY SANDS (SM) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 3 of 8)

Boring No.	Ellev. (ft)	SPT Blow Counts	Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D 50 (mm)	Fines Content (%)	Remarks
	706.9	8	SM	NP	NP	-	-	-	
	704.9	8	SM	NP	NP	25.3	-	-	
SS-135A	714.5	13	SM	31.0	3.0	24.3	0.078	48.0	
	712.5	7	SM	NP	NP	22.8	0.105	33.0	
	710.5	7	SM	NP	NP	24.3	0.120	29.0	
	708.5	5	SM	NP	NP	34.2	0.120	29.0	
	706.5	8	SM	22.0	1.0	27.0	0.120	33.0	
	704.5	7	SM	NP	NP	30.9	0.100	35.0	
SS-65B	713.2	9	SM	29.0	2.0	25.7	0.085	43.0	
	711.2	6	SM	25.0	1.0	27.5	0.090	41.0	
	709.2	3	SM	25.0	1.0	33.1	0.100	38.0	same sample
	709.2	3	SM	NP	NP	32.9	0.110	31.0	
	707.2	5	SM	25.0	1.0	32.5	0.100	34.0	
	705.2	7	SM	26.0	2.0	27.1	0.075	50.0	same sample
	705.2	7	SM	25.0	1.0	30.8	0.100	35.0	
SS-65	712.0	12	SM	33.1	6.6	21.5	0.077	48.0	
	710.0	10	SM	NP	NP	15.7	0.132	32.5	
	708.0	7	SM	30.1	5.1	23.7	0.091	43.0	
	706.0	5	SM	28.9	3.5	28.2	0.140	34.0	
	704.0	8	-	-	-	-	-	-	no sample

Table 2.5-62 SUMMARY OF SPT SAMPLES OF SILTY SANDS (SM) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 4 of 8)

Boring No.	Ellev. (ft)	SPT Blow Counts	Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D 50 (mm)	Fines Content (%)	Remarks
SS-136	710.9	5	SM	NP	NP	26.3	0.100	40.0	
	708.9	8	SM	NP	NP	28.5	0.122	35.0	
	706.9	12	SM	NP	NP	21.9	0.145	33.0	
SS-137	712.9	9	SM	25.9	1.8	20.7	-	-	
	713.2	6	SM	28.1	2.5	23.4	0.079	49.0	
SS-138	711.2	7	SM	28.1	2.5	24.5	0.79	49.0	
	705.2	13	SM	26.4	2.3	15.0	-	-	
	713.2	8	SM	29.0	3.0	25.1	0.073	50.0	
SS-138A	711.2	8	SM	NP	NP	22.1	0.100	36.0	
	709.2	12	SM	29.0	1.0	27.1	0.073	49.0	
	707.2	4	SM	28.0	2.0	35.6	0.090	41.0	
	705.2	9	SM	22.0	1.0	27.8	0.140	31.0	
SS-138B	705.2	9	SM	NP	NP	29.1	0.180	21.0	same sample
	710.6	8	SM	27.0	3.0	24.7	0.090	42.0	
	708.6	9	SM	34.0	5.0	36.2	0.080	46.0	
SS-138C	706.6	8	SM-SC	27.0	5.0	30.0	0.105	35.0	
	704.6	7	SM-SC	26.0	5.0	32.5	0.110	35.0	
SS-138C	710.6	8	SM-SC	27.0	4.0	27.5	0.095	38.0	

Table 2.5-62 SUMMARY OF SPT SAMPLES OF SILTY SANDS (SM) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 5 of 8)

Boring No.	Ellev. (ft)	SPT Blow Counts	Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D ₅₀ (mm)	Fines Content (%)	Remarks
SS-139	711.5	8	SM	NP	NP	15.5	0.110	35.0	
	709.5	9	SM	NP	NP	18.2	0.110	35.0	
	705.5	14	SM	NP	NP	22.1	0.375	13.0	
SS-140	706.7	4	SM	NP	NP	38.7	0.110	36.0	
SS-87	707.6	12	SM	31.6	6.2	27.5	0.078	48.0	
SS-141	704.6	17	G-SM	NP	NP	7.8	0.79	19.0	
SS-143	695.1	7	-	-	-	-	-	-	no sample
	693.1	9	G-SP-SM	NP	NP	13.5	1.80	12.0	
SS-143A	701.0	3	SM-SC	21.0	5.0	21.2	0.093	45.0	
	697.0	8	SM	37.0	11.0	43.1	0.130	41.0	
SS-143B	696.3	21	SM	37.0	7.0	27.7	0.300	34.0	
SS-146	702.4	13	G-SM	21.6	1.9	14.6	0.200	25.0	
SS-147	701.7	18	G-SM	NP	NP	17.1	0.460	14.0	
SS-153	707.7	15	G-SW-SM	NP	NP	10.8	2.500	10.0	
SS-158	711.5	2	SM	22.9	2.5	32.2	0.088	44.0	
SS-159	712.0	20	G-SM	NP	NP	13.7	0.430	21.0	

Table 2.5-62 SUMMARY OF SPT SAMPLES OF SILTY SANDS (SM) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 6 of 8)

Boring No.	Ellev. (ft)	SPT Blow Counts	Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D 50 (mm)	Fines Content (%)	Remarks
SS-160	720.9	15	SM	NP	NP	22.5	0.134	39.0	
	718.9	7	SM	24.2	1.7	23.8	0.173	34.0	
	716.9	12	SM	27.0	3.0	25.8	0.153	33.0	
	714.9	5	SM-SC	32.1	8.5	30.2	0.105	46.0	
	710.9	5	GM	26.2	2.2	24.3	0.210	37.0	
SS-161A	720.9	10	SM	26.0	2.0	23.8	0.120	32.0	
	718.9	13	SM	NP	NP	17.8	0.230	17.0	same sample
SS-161	718.9	13	SM	NP	NP	17.0	0.180	20.0	
	718.4	9	SM	NP	NP	18.4	0.230	24.0	
	716.4	10	SM	NP	NP	21.5	0.220	24.0	
	708.4	19	G-SM	NP	NP	12.7	0.220	32.0	
SS-162	717.8	20	SM	28.3	1.6	27.7	0.090	47.0	
	715.8	19	SM	27.6	3.0	30.2	0.122	39.0	
	713.8	5	SM	NP	NP	34.3	0.155	36.0	
SS-163	711.8	11	G-SW-SM	NP	NP	20.4	2.000	11.0	
	721.0	5	SM-SC	30.4	7.1	28.4	0.084	47.0	
	719.0	6	SM-SC	30.4	7.1	26.9	0.084	47.0	
	717.0	3	SM	27.2	3.3	31.1	0.097	45.0	
	715.0	4	SM	29.7	4.7	33.5	0.090	43.0	
	713.0	17	G-SM	28.7	3.8	27.8	0.190	26.0	

Table 2.5-62 SUMMARY OF SPT SAMPLES OF SILTY SANDS (SM) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 7 of 8)

Boring No.	Ellev. (ft)	SPT Blow Counts	Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D 50 (mm)	Fines Content (%)	Remarks
SS-163A	721.5	7	SM	31.0	7.0	28.9	0.080	48.0	
	719.5	11	SP-SM	NP	NP	28.2	0.220	8.0	
	717.5	4	SM	30.0	3.0	36.3	0.080	45.0	
	715.5	5	SM	31.0	5.0	34.3	0.098	43.0	
SS-80	721.2	3	SM	41.6	14.6	29.1	0.120	44.0	
	715.2	7	SM	24.5	0.7	25.4	0.061	29.0	
SS-164	719.0	9	SM-SC	31.5	8.6	27.4	0.240	33.0	
	717.0	15	G-SP-SM	NP	NP	16.2	0.750	12.0	
	715.0	20	G-SP-SM	NP	NP	20.9	0.340	10.0	
	713.0	11	SM	31.1	5.7	26.6	0.174	33.0	
SS-165	716.7	3	SM-SC	30.7	8.1	23.3	-	-	
	714.7	2	SM-SC	30.7	8.1	34.4	-	-	
SS-84	713.4	2	SM	24.8	2.2	30.1	0.110	41.0	
SS-130	715.7	10	SM	NP	NP	17.8	0.240	22.0	
	713.7	9	SM	NP	NP	15.5	0.290	15.0	
SS-128	712.7	2	SM	NP	NP	23.7	0.280	16.0	
SS-127	712.2	0	SM-SC	23.3	4.4	36.1	0.079	48.0	
SS-125	714.4	2	SM	NP	NP	29.0	0.130	8.0	
	708.4	16	G-SP-SM	NP	NP	21.7	0.660	8.0	
	706.4	17	G-SP-SM	NP	NP	12.8	3.00	10.0	

Table 2.5-62 SUMMARY OF SPT SAMPLES OF SILTY SANDS (SM) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 8 of 8)

Boring No.	Ellev. (ft)	SPT Blow Counts	Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D 50 (mm)	Fines Content (%)	Remarks
SS-25	715.6	2	SM	NP	NP	29.2	0.076	48.0	
SS-28	713.4	10	SM	NP	NP	31.0	0.18	27.5	
SS-170	719.2	4	G-SM-SC	34.8	11.5	29.1	0.125	42.0	
	717.2	17	G-SM-SC	34.8	11.5	23.6	0.125	42.0	
	715.2	18	G-SM-SC	NP	NP	19.2	0.450	11.0	

Table 2.5-63 SUMMARY OF SPT SAMPLES OF SILTS (ML) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 1 of 3)

Boring No.	Ellev. (ft)	SPT Blow Counts	Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D 50 (mm)	Fines Content (%)	Remarks
SS-49	698.9	14	ML	28.8	5.3	26.1	0.070	53.0	
	696.9	12	ML	28.8	5.3	26.8	0.064	53.0	
SS-49A	694.7	6	ML	22.0	1.0	28.3	0.070	53.0	same sample
	694.7	6	ML	22.0	3.0	28.0	0.070	54.0	
	692.7	5	ML	NP	NP	27.8	0.070	56.0	
SS-50A	694.2	5	ML	29.0	3.0	34.8	0.070	55.0	
SS-50	703.8	10	ML	37.5	11.3	22.1	0.050	54.0	
SS-132	702.1	13	ML	43.1	15.2	25.7	-	-	
	700.1	15	ML	45.8	17.5	23.4	-	-	
SS-135	714.9	12	ML	42.2	13.8	26.3	0.074	69.0	
SS-135A	706.5	8	ML	27.0	2.0	32.1	0.073	51.0	same sample
	706.5	8	ML	29.0	7.0	-	-	-	
	704.5	7	ML	25.0	2.0	32.1	0.073	50.0	
SS-65B	715.2	14	ML	35.0	6.0	26.7	0.060	60.0	
SS-65	714.0	16	ML	46.1	15.6	29.2	0.030	72.0	
SS-136	712.9	9	ML	32.8	5.7	25.0	0.070	53.0	
SS-137	714.9	11	ML	35.6	9.6	24.2	0.058	62.0	
	710.9	7	ML	31.7	5.6	25.0	0.070	52.0	
	708.9	8	ML	31.7	5.6	25.3	0.070	52.0	
SS-138	709.2	7	ML	32.7	5.9	28.4	0.070	53.0	
	707.2	5	ML-CL	27.0	5.1	29.6	0.067	52.0	

Table 2.5-63 SUMMARY OF SPT SAMPLES OF SILTS (ML) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION
(Sheet 2 of 3)

SS-139	707.5	7	ML	31.0	3.9	32.8	0.056	63.0
SS-140	710.7	12	ML	34.1	6.2	25.0	0.061	54.0
	708.7	3	ML	-	-	17.4	0.073	50.0
SS-87	711.6	13	ML	37.4	12.9	43.9	0.038	62.0
SS-143C	696.6	3	CL-ML	32.0	10.0	46.5	<0.074	72.0
SS-101	712.5	3	ML	24.7	2.0	31.9	0.072	53.0
SS-159	718.0	6	CL-ML	26.8	4.2	29.4	0.064	59.0
SS-161A	714.9	5	ML	38.0	12.0	35.7	0.055	58.0
SS-161	714.4	3	CL-ML	36.8	13.2	35.8	-	-
	712.4	5	ML	25.7	2.3	30.9	0.076	51.0
SS-80	719.2	5	ML	24.6	2.4	28.1	0.075	51.0
SS-164	721.0	6	CL-ML	36.0	12.1	28.2	0.059	53.0
SS-165	720.7	5	ML	37.4	11.5	31.9	0.060	58.0
	718.7	6	CL-ML	39.0	14.2	31.2	0.015	63.0
SS-166	720.5	13	ML	48.8	19.8	13.0	0.011	87.0
	718.5	11	ML	48.8	19.8	11.0	0.011	87.0
	716.5	6	CL-ML	31.4	9.1	28.4	0.056	63.0
SS-84	711.4	3	ML	24.5	1.3	31.4	0.070	52.0
SS-130	717.7	7	ML	35.7	11.3	20.8	-	-
SS-26	718.0	3	ML	24.4	0.6	29.7	0.051	61.0
	716.0	4	ML	NP	NP	31.0	0.074	51.0
SS-27	713.1	3	ML	23.1	2.9	24.5	0.072	51.0
SS-169	119.1	8	CL-ML	43.0	17.0	31.8	0.021	78.0

Table 2.5-63 SUMMARY OF SPT SAMPLES OF SILTS (ML) BELOW ERCW PIPELINES HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION (Sheet 3 of 3)

117.1	6	ML	41.4	13.7	34.3	0.043	68.0
115.1	6	ML	41.4	13.7	32.3	0.043	68.0
113.1	5	ML	40.8	13.7	33.1	0.043	65.0

Table 2.5-64 SUMMARY OF SPT SAMPLES OF SILTY SANDS (SM) BELOW ELECTRICAL CONDUITS HAVING FACTOR OF SAFETY LESS THAN UNITY FOR 0.4 G PEAK GROUND SURFACE ACCELERATION

Boring No.	Ellev. (ft)	Blow Counts	SPT Soil Type	Liquid Limit	Plasticity Index	Water Content (%)	D 50 (mm)	Fines Content (%)	Remarks
SS-171	708.2	6	SM	NP	NP	26.7	0.20	13.0	
	706.2	9	SP-SM	NP	NP	26.5	0.26	7.0	
	704.2	9	SP-SM	NP	NP	24.1	0.27	9.0	
	702.2	12	SP-SM	NP	NP	30.9	0.27	8.0	
SS-53	708.0	18	SM	27.1	3.1	19.6	0.15	40.0	
SS-173	709.0	20	SM-SC	37.0	12.0	20.6	0.086	47.0	
SS-63	713.1	17	SM	36.0	10.0	21.6	0.078	48.0	
	711.1	10	SM	36.0	10.0	20.7	0.078	48.0	
SS-57	709.1	10	SM	36.0	10.0	27.0	0.078	48.0	
	715.0	14	SP-SM	NP	NP	6.4	0.75	9.0	

Table 2.5-65 Strain Criteria for Determining Potential Settlement Of Soils Subject to Earthquake With Peak Top-Of-Ground Acceleration of 0.40g At Watts Bar Nuclear Plant

MATERIAL CLASSIFICATION	PERCENT VERTICAL STRAIN (%Ev)	
	BELOW WATER TABLE	ABOVE/BELOW WATER TABLE
SP (<12% fines)	6 ¹	3 ²
SM or ML (clean)	3 ¹	1.5 ²
SC	1 ¹	0.5 ²
CL or ML-CL	0.75 ¹	0.5 ³

Notes:

- 1 If potentially liquefiable
- 2 If loose $N \leq 15$ but not potentially liquefiable
- 3 If soft $N \leq 5$ but not potentially liquefiable
- 4 Classification of SP-SM will be treated as SP for criteria
- 5 Classification of G-SM or SM-SC will be treated as SM for criteria

Table 2.5-66
Soil Bearing Capacities and Factors of Safety for Soil-Supported Category I Structures

Structures	Sustained Loads			Dynamic Loads		
	Ultimate Soil Bearing Capacity (KSF)	Actual Soil Bearing Maximum (KSF)	Factor of Safety	Actual Soil Bearing Maximum (KSF)	Factor of Safety	Factor of Safety
Diesel Generator Building	20.0	3.5	5.7	5.5	3.6	3.6
Refueling Water Storage Tanks I and II	20.0	2.3	8.7	8.6	2.3	2.3
ERCW Standpipe Structure I	20.0	1.7	11.8	4.5	4.4	4.4
ERCW Standpipe Structure II	20.0	1.9	10.5	4.7	4.3	4.3
Discharge Overflow Structure	20.0	1.9	10.5	5.3	3.8	3.8
Refueling Water Storage Pipe Tunnels A and B	20.0	2.5	8.0	3.3	6.1	6.1
Waste Packaging Area	20.0	1.4	14.0+	6.7	3.0+	3.0+

Added by Amendment 50

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
SETTLEMENT MONITORING PROGRAM DIESEL GENERATOR BUILDING TABLE 2.5-67 SHEET 1

SETTLEMENT POINTS										
	^{SE} SS - 1		^{SW} SS - 2		^{NE} SS - 3		^{NW} SS - 4			
DATE	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	BY	CHKD
10-31-75			742.015	-			742.033	-	FRH 12-30-81	BTB 1-26-92
11-24-75	742.047	-	742.017	.002	742.044	-	742.038	.005	↓	↓
12-16-75	742.046	-.001	742.018	.003	742.044	.000	742.038	.005		
1-14-76	742.045	-.002	742.017	.002	742.041	-.003	742.036	.003		
2-11-76	742.043	-.004	742.015	.000	742.038	-.006	742.034	.001		
3-13-76	742.035	-.012	742.006	-.009	742.031	-.013	Not Run			
4-15-76	742.037	-.010	742.009	-.006	742.032	-.012	"			
5-11-76	742.041	-.006	742.011	-.004	742.037	-.007	"			
6-11-76	742.035	-.012	742.005	-.010	742.030	-.014	742.021	-.012		
7-14-76	742.032	-.015	742.004	-.011	742.028	-.016	742.023	-.010		
8-10-76	742.040	-.007	742.010	-.005	742.034	-.010	742.030	-.003		
9-14-76	742.035	-.012	742.006	-.009	742.031	-.013	742.025	-.008		
10-13-76	742.038	-.009	742.008	-.007	742.026	-.018	742.031	-.002		
11-9-76	Poor Closure		Not Used							
12-9-76	742.027	-.020	741.996	-.019	742.026	-.018	742.018	-.015		
1-12-77	742.032	-.015	742.001	-.014	742.033	-.011	742.024	-.009		
2-10-77	742.033	-.014	742.004	-.011	742.032	-.012	742.026	-.007		
3-15-77	742.032	-.015	742.002	-.013	742.028	-.014	742.023	-.010		
4-11-77	742.030	-.017	742.000	-.015	742.026	-.018	742.021	-.012		
5-10-77	742.028	-.019	741.997	-.018	742.023	-.021	742.017	-.016		
6-6-77	742.027	-.020	741.997	-.018	742.022	-.022	742.017	-.016		
7-6-77	742.032	-.015	742.000	-.015	742.025	-.019	742.021	-.012		
8-3-77	742.021	-.026	741.989	-.026	742.015	-.029	742.011	-.022		
9-12-77	742.024	-.023	741.992	-.023	742.023	-.021	742.018	-.015		

i → initial reading + ↑ up - ↓ down

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

**SETTLEMENT MONITORING PROGRAM
DIESEL GENERATOR BUILDING
TABLE 2.5-67
SHEET 2**

Added by Amendment 50

SETTLEMENT POINTS										
	SS-1 ^{SE}		SS-2 ^{SW}		SS-3 ^{NE}		SS-4 ^{NW}			
DATE	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	BY	CHKD
10-11-77	742.024	-0.023	741.991	-0.024	742.023	-0.021	742.017	-0.016	FRH 12-31-81	STB 1-25-82
11-7-77	742.021	-0.026	741.990	-0.025	742.021	-0.023	742.017	-0.016	↓	↓
12-15-77	742.026	-0.021	741.995	-0.020	742.027	-0.017	742.022	-0.011		
1-9-78	742.021	-0.026	741.990	-0.025	742.020	-0.024	742.017	-0.016		
2-2-78	742.022	-0.025	741.992	-0.023	742.023	-0.021	742.020	-0.013		
3-3-78	742.017	-0.030	741.985	-0.030	742.018	-0.026	742.011	-0.022		
4-3-78	742.015	-0.032	741.984	-0.031	742.016	-0.028	742.008	-0.025		
5-4-78	742.015	-0.032	741.984	-0.031	742.015	-0.029	742.010	-0.023		
6-5-78	742.013	-0.034	741.982	-0.033	742.013	-0.031	742.008	-0.025		
7-10-78	742.012	-0.035	741.982	-0.033	742.011	-0.033	742.009	-0.024		
8-4-78	742.010	-0.037	741.979	-0.036	742.010	-0.034	742.006	-0.027		
9-29-78	742.013	-0.034	741.983	-0.032	742.013	-0.031	742.010	-0.023		
1-21-79	742.019	-0.028	741.989	-0.026	742.020	-0.024	742.015	-0.018		
4-11-79	742.009	-0.038	741.977	-0.038	742.010	-0.034	742.004	-0.029		
7-26-79	742.006	-0.041	741.976	-0.039	742.010	-0.034	742.003	-0.030		
10-23-79	742.009	-0.038	741.977	-0.038	742.012	-0.032	742.005	-0.028		
1-20-80	742.003	-0.044	741.972	-0.043	742.004	-0.040	742.000	-0.033		
4-29-80	742.003	-0.044	741.971	-0.044	742.004	-0.040	741.998	-0.035		
10-9-80	742.009	-0.038	741.976	-0.039	742.011	-0.033	742.005	-0.026		
4-10-81	741.998	-0.049	741.966	-0.049	741.999	-0.045	741.993	-0.040		
4-10-81	* 743.744	-	* 743.454	-	* 744.010	-	* 744.544	-		
10-7-81	743.757	+0.013	743.467	+0.013	744.023	+0.013	744.058	+0.014		
12-22-81	743.752	+0.008	Not Run	-	744.019	+0.009	744.056	+0.012		STB 1-26-82
1-20-82	743.744	0.0	NR	-	744.013	+0.003	744.048	+0.004	JAD 2-11-82	STB 2-17-82

* Monument moved from inside to outside of building. Initial elev. result.

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
DIESEL GENERATOR BUILDING
TABLE 2.5-67
SHEET 3

Added by Amendment 50

SETTLEMENT POINTS										
		SE	SS-2		SS-3	SS-4				
DATE	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	BY	CHKD
1-29-82	743.752	+0.008	743.963	+0.009	744.020	+0.010	744.055	+0.011	JAD	LTP
									J-17-82	LTP
AVG *	743.749	+0.005	-	-	744.017	+0.007	744.053	+0.009	JAD	LTP
									J-22-82	LTP

* 1 SET TABLE READINGS

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
WASTE MANAGEMENT BUILDING
TABLE 2.5-68
SHEET 1

Added by Amendment 50

SETTLEMENT POINTS										
	SS-45		SS-46		SS-47		SS-48			
DATE	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	BY	CHKD
3-15-77	728.962	i	728.981	i	728.996	i	728.975	i	JAD 12/30/81	2773 1-27-82
4-11-77	728.950	-002	728.977	-004	728.992	-002	728.970	-005		↓
5-10-77	728.976	-006	728.973	-008	728.998	-008	728.966	-009		
6-6-77	728.960	-002	728.976	-005	728.991	-005	728.970	-005		
7-6-77	728.982	0	728.976	-005	728.991	-005	728.972	-003		
8-3-77	728.962	-020	728.957	-024	728.973	-023	728.953	-022		
8-12-77	728.974	-008	728.970	-011	728.935	-011	728.965	-010		
10-11-77	728.976	-006	Not Run	-	728.959	-007	728.968	-007		
11-7-77	Not Run	-	728.961	-020	728.973	-018	728.956	-019		
12-15-77	N.R.	-	728.976	-005	728.993	-003	728.970	-005		
1-9-78	N.R.	-	728.974	-007	728.990	-006	728.965	-007		
2-2-78	728.973	-009	NR	-	728.979	-017	728.995	-020		
3-3-78	728.971	-011	728.969	-012	728.985	-011	728.963	-012		
4-3-78	728.963	-014	728.965	-016	728.981	-015	728.959	-016		
5-4-78	728.974	-008	728.971	-010	728.986	-010	728.963	-012		
6-5-78	728.963	-019	728.960	-021	728.977	-019	728.955	-020		
7-10-78	728.961	-021	728.957	-024	728.975	-021	728.955	-020		
8-4-78	728.955	-027	728.951	-030	728.963	-028	728.952	-023		
9-29-78	728.963	-014	NR	-	728.983	-013	728.962	-013		
1-21-79	728.969	-013	NR	-	728.972	-004	728.963	-007		
2-11-79	728.950	-032	728.951	-030	728.973	-023	728.949	-026		
7-25-79	728.959	-023	728.961	-020	728.980	-016	728.958	-017		
10-22-79	Not Run	-	728.955	-026	728.976	-020	728.953	-022		
1-19-80	728.945	-037	728.946	-035	728.968	-028	Not Run	-		

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**
**SETTLEMENT MONITORING PROGRAM
WASTE MANAGEMENT BUILDING
TABLE 2.5-68
SHEET 2**

Added by Amendment 50

SETTLEMENT POINTS										
DATE	SS-45		SS-46		SS-47		SS-48		BY	CHKD
	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF		
4-28-80	728.939	-0.043	728.940	-0.041	728.962	-0.034	Not Run	-	JAD 1-25-82	JTB 1-27-82
10-9-80	728.955	-0.027	728.953	-0.028	728.974	-0.022	Not Run	-		↓
4-10-81	Not Run	-	728.947	-0.034	728.970	-0.026	NR	-		
10-7-81	NR	-	728.957	-0.024	728.981	-0.015	NR	-		
12-22-81	728.943	-0.039	728.947	-0.034	728.973	-0.023	NR	-		JTB 1-27-82
1-18-82	728.940	-0.042	728.946	-0.035	728.970	-0.026	NR	-	JAD 2-11-82	JTB 2-17-82
1-27-82	728.942	-0.040	728.947	-0.034	728.972	-0.024	728.946	-0.029	JAS 1-27-82	JTB 2-17-82
2-11-82	-	-	-	-	-	-	728.944	-0.031	JMH 2-25-82	JTB 2-25-82
AVG	*728.942	-0.040	*728.947	-0.034	*728.972	-0.024	*728.945	-0.030	JMH 2-25-82	JTB 2-25-82

* 1 set THREE READINGS ** 1 set TWO READINGS

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM:
INTAKE PUMPING STATION
TABLE 2.5-69
SHEET 1

Added by Amendment 50

SETTLEMENT POINTS										
	SS-1		SS-2		SS-3		SS-4		BY	CHKD
DATE	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF		
10-17-74	652.031	i	652.009	i					JAD 1-12-82	JTB 1-27-82
11-25-74	Inaccessible	-	652.008	-0.01					↓	↓
12-19-74	652.039	+0.08	Not READ	-	652.051	i				
1-23-75	652.037	+0.06	NR	-	652.049	-0.02				
2-24-75	652.036	+0.05	NR	-	652.046	-0.05				
3-21-75	No DATA	-	NR	-	652.033	-0.18				
5-9-75	652.049	+0.18	652.021	+0.12	652.062	+0.11				
6-4-75	652.037	+0.06	652.011	+0.02	652.050	-0.01				
7-2-75	Not READ	-	NR		Not READ	-				
7-21-75	NR	-	NR		NR	-				
8-22-75	NR	-	NR		NR	-				
9-10-75	NR	-	NR		NR	-				
10-31-75	652.036	+0.05	652.006	-0.03	652.049	-0.02				
11-24-75	652.038	+0.07	652.008	-0.01	652.050	-0.01				
12-16-75	652.040	+0.09	652.007	-0.02	652.053	+0.02				
1-14-76	652.040	+0.09	652.009	0.0	652.051	0.0				
2-11-76	652.041	+0.10	652.008	-0.01	652.052	+0.01				
3-13-76	652.046	+0.15	652.016	+0.07	652.057	+0.06				
4-15-76	652.050	+0.19	652.017	+0.08	652.059	+0.08				
5-11-76	652.067	+0.36	652.014	+0.05	652.047	-0.04				
6-11-76	652.042	+0.11	652.010	+0.01	652.054	+0.03				
7-14-76	652.038	+0.07	652.007	-0.02	652.052	+0.01				
8-10-76	652.036	+0.05	652.001	-0.08	652.052	+0.01				
9-14-76	652.030	-0.01	652.000	-0.09	652.048	-0.03				

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
INTAKE PUMPING STATION
TABLE 2.5-69
SHEET 2

SETTLEMENT MONITORING PROGRAM

WATTS BAR NUCLEAR PLANT

INTAKE PUMPING STATION

Added by Amendment 50

DATE	SS-1		SS-1f		SS-2		SS-2		SS-2		SS-3M		SS-4		DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	BY	CHKD
	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF										
10-13-76	652.034	1.003			652.004	-0.005	652.048	-0.003																
11-9-76	Not Used	-			Not Used	-	Not Used	-																
12-9-76	Not Row	-			Not Row	-	Not Row	-																
1-12-77	NR	-			NR	-	NR	-																
2-10-77	NR	-			NR	-	NR	-																
3-15-77	652.036	1.005	741.128	i	652.022	-0.013	652.052	-0.001					727.829	i										
4-11-77	652.022	-0.002	Not Row	-	651.997	-0.012	652.049	-0.002					727.826	-0.003										
5-10-77	652.022	-0.003	741.121	-0.007	651.991	-0.018	652.046	-0.005					727.827	-0.002										
6-6-77	652.027	-0.004	741.131	-0.003	651.999	-0.010	652.052	-0.001					727.833	-0.004										
7-6-77	NR	-	NR	-	NR	-	NR	-					727.833	-0.004										
8-3-77	NR	-	741.128	0.0	NR	-	NR	-					741.418	i										
9-12-77	NR	-	741.114	-0.014	NR	-	NR	-					741.402	-0.016										
10-11-77	NR	-	741.117	-0.011	NR	-	NR	-					741.404	-0.014										
11-7-77	NR	-	741.103	-0.012	NR	-	NR	-					741.396	-0.022										
12-15-77	Not Used	-	741.124	-0.004	Not Used	-	Not Used	-					741.412	-0.006										
1-7-78	741.109	-0.019											741.397	-0.021										
2-2-78	741.105	-0.023											741.391	-0.027										
3-3-78	741.111	-0.017											741.396	-0.022										
4-3-78	741.120	-0.008											741.405	-0.013										
5-4-78	741.125	-0.003											741.412	-0.006										
6-5-78	741.118	-0.010											741.407	-0.011										
7-10-78	741.135	-0.007											741.421	-0.003										
8-4-78	741.129	-0.001											741.416	-0.002										
9-20-78	741.112	-0.002											741.410	-0.005										

SETTLEMENT MONITORING PROGRAM

WATTS BAR NUCLEAR PLANT

INTAKE PUMPING STATION

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
INTAKE PUMPING STATION
TABLE 2.5-69
SHEET 3

Added by Amendment 50

DATE	SS-1				SS-1A				SS-2				SS-3				SS-3A				SS-4				ELEV	DIFF	BY	CHKD
	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF								
2-2-79			741.102	-0.026													741.286	-0.032	727.810	-0.012							JAD	2/28
4-7-79			741.109	-0.019									741.378	-0.020	727.820	-0.005												
7-19-79			741.123	-0.005									741.414	-0.004	727.834	-0.005												
10-17-79			741.115	-0.013									741.404	-0.014	727.824	-0.005												
1-21-80			741.107	-0.021									741.397	-0.021	727.815	-0.014												
4-23-80			741.116	-0.010									741.407	-0.011	727.827	-0.002												
12-18-81			N/A	-									N/A	-	727.807	-0.022												
1-7-82			N/A	-									N/A	-	727.820	-0.009											JAD	2/27
1-21-82			N/A	-									N/A	-	717.814	-0.015												
AVG *			-	-									-	-	717.814	-0.015												

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-70
SHEET 1

SETTLEMENT MONITORING PROGRAM

WATTS BAR NUCLEAR PLANT

POWERHOUSE

Added by Amendment 50

DATE	SETTLEMENT POINTS										BY	CHKD					
	SS-1	SS-1A	SS-1B	SS-2	SS-2A	SS-3	SS-4	SS-5	SS-6	SS-7							
	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF			
10-16-73																	
11-19-73																	
12-17-73	676.536	i															
1-16-74	Alt. Read	-															
2-20-74	656.534	-0.002															
3-18-74	Inacc.		672.176	i													
4-15-74			672.173	-0.003													
4-15-74			672.175	-0.01													
5-13-74			672.171	-0.005													
6-11-74			675.693	-													
7-15-74			675.695	+0.002													
8-13-74			675.688	-0.005													
9-16-74			675.691	-0.002													
10-17-74			675.693	0													
11-18-74			675.682	-0.011													
12-18-74			675.691	-0.002	692.017	i											
1-20-75			675.690	-0.003	692.012	-0.005											
2-19-75			675.686	-0.007	692.014	-0.002											
3-17-75			676.014	i	692.014	-0.002											
5-6-75			676.020	+0.006	692.015	-0.002											
6-2-75			676.015	+0.001	692.015	-0.002											
7-7-75			676.012	-0.002	692.015	-0.012											
7-21-75			676.020	+0.006	692.019	+0.002											
8-18-75			676.012	-0.002	692.015	-0.002											
9-10-75			676.018	+0.004	692.012	-0.001											

* RS Point Reset to NEW LOCATION
 * R S Initial Reading
 ** Reset to 694.126 on 8/23/74
 * R Reset to 705.292 on 5-6-75
 * R Reset to 705.318 on 5/15/75
 * R Reset to 705.324 on 5/15/75
 * R Reset to 705.313 on 5/15/75
 * R Reset to 705.331 on 5/15/75
 * R Reset to 705.313 on 5/15/75
 * R Reset to 705.313 on 5/15/75

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-70
SHEET 2

SETTLEMENT MONITORING PROGRAM

Watts Bar Nuclear Plant

POWERHOUSE

Added by Amendment 50

DATE	SS-1		SS-1A		SS-1B		SS-2		SS-2A		SS-3		SS-4		SS-5		SS-6		SS-7	
	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF
10-31-75			676.012	-.002	692.008		675.685	-.008	692.009	-.008	694.116	-.010			Not Run		Not Run		Not Run	
1-14-76			676.021	+.007	692.017	+.009	675.695	+.002	692.021	+.004	694.125	-.001			NR		NR		NR	
2-18-76			676.003	-.011	691.999	-.009	675.675	-.018	692.000	-.017	694.107	-.019								
1-14-76			676.016	+.002	692.012	+.004	675.688	-.005	692.014	-.003	694.124	-.002								
2-11-76			676.018	+.004	692.016	+.008	675.684	-.005	692.014	-.003	694.124	-.002								
3-18-76			676.022	+.008	692.020	+.012	675.693	0	692.019	+.002	694.126	0								
4-15-76			676.016	+.002	692.014	+.006	675.684	-.009	692.011	-.006	694.120	-.006								
5-11-76			676.019	+.005	692.020	+.012	675.683	-.004	692.017	0	694.126	0								
6-11-76			676.014	0	692.010	+.002	675.685	-.013	692.004	-.013	694.115	-.011								
7-14-76			676.012	-.002	692.016	+.008	675.677	-.016	692.009	-.008	694.121	-.005								
8-10-76			676.023	+.009	692.023	+.015	675.688	-.005	692.015	-.002	694.129	+.003								
9-14-76			676.006	-.008	692.003	-.005	675.670	-.023	691.996	-.021	694.110	-.016								
10-13-76			676.014	0	692.010	+.002	675.671	-.016	692.004	-.013	694.117	-.009								
11-9-76			Not Closed Not Used		Not Closed Not Used		Not Closed Not Used		Not Closed Not Used		Not Closed Not Used									
12-9-76			675.994	-.020	691.992	-.016	675.658	-.035	691.984	-.033	694.099	-.027								
1-12-77			676.002	-.012	692.000	-.008	675.664	-.029	691.993	-.024	694.109	-.017								
2-10-77			676.009	-.005	692.011	+.003	675.673	-.020	692.002	-.015	694.119	-.007								
3-15-77			676.012	+.002	692.016	+.008	675.673	-.020	692.004	-.011	694.123	-.003								
4-11-77			676.010	-.004	Not Run		675.673	-.020	692.001	-.016	694.115	-.011								
5-10-77			676.005	-.009	691.996	-.012	675.666	-.027	691.986	-.031	694.102	-.024								
6-6-77			676.026	+.012	692.018	+.010	675.685	-.008	692.010	-.007	694.123	-.003								
7-6-77			676.018	+.004	692.017	+.009	675.677	-.016	692.007	-.010	694.118	-.008								
8-3-77			675.989	-.025	691.993	-.015	675.645	-.045	691.182	-.035	694.098	-.028								
9-12-77			676.009	+.005	692.006	+.002	675.669	-.024	691.995	-.022	694.111	-.015								

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-70
SHEET 3

SETTLEMENT MONITORING PROGRAM
WATTS BAR NUCLEAR PLANT
POWERHOUSE

Added by Amendment 50

DATE	SETTLEMENT POINTS																	
	SS-1	SS-1A	SS-1B	SS-2	SS-2A	SS-3	SS-4	SS-5	SS-6	SS-7	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	BY	CHKD
10-11-77		676.018	672.015	675.677	672.002	674.124	729.026	705.282	705.312	705.314	-0.01	705.314	-0.01	705.314	-0.01	705.314	JAB	JAB
11-7-77		675.995	671.997	675.656	671.986	674.104	729.010	705.268	705.296	705.299	-0.026	705.299	-0.026	705.299	-0.026	705.299	JAB	JAB
12-15-77		676.019	672.014	675.680	672.005	674.124	729.022	705.281	705.311	705.311	-0.014	705.311	-0.014	705.311	-0.014	705.311	JAB	JAB
1-9-78		676.010	672.010	675.669	672.008	674.120	729.022	Not Run	Not Run	Not Run	-	Not Run	-	Not Run	-	Not Run	JAB	JAB
2-2-78		676.016	672.016	675.676	672.008	674.126	729.022	NR	NR	NR	-	NR	-	NR	-	NR	JAB	JAB
3-3-78		676.016	672.016	675.667	671.994	674.113	729.017	705.280	705.310	705.310	-0.015	705.310	-0.015	705.310	-0.015	705.310	JAB	JAB
4-3-78		Not Run	672.004	675.664	671.994	674.112	729.017	705.274	705.304	705.304	-0.014	705.304	-0.014	705.304	-0.014	705.304	JAB	JAB
5-4-78		NR	Not Run	675.670	671.998	674.117	729.017	NR	NR	NR	-	NR	-	NR	-	NR	JAB	JAB
6-5-78		REMARKS UNACCESSIBLE	NR	675.672	672.000	674.116	729.014	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
7-10-78		672.006	672.006	675.662	671.992	674.110	729.015	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
8-4-78		671.996	671.996	Not Run	671.984	674.101	729.010	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
9-29-78		672.011	672.011	675.656	671.999	674.115	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
1-19-79		672.012	672.012	675.659	671.999	674.115	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
4-11-79		672.004	672.004	675.659	671.999	674.115	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
7-20-79		672.013	672.013	NR	NR	NR	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
10-18-79		672.012	672.012	675.673	671.999	674.117	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
1-12-80		671.999	671.999	675.656	671.999	674.105	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
4-29-80		671.994	671.994	675.655	671.999	674.098	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
10-4-80																	JAB	JAB
4-8-81																	JAB	JAB
10-6-81																	JAB	JAB
12-18-81		671.981	671.981	675.643	671.981	674.091	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
1-8-82		672.007	672.007	675.653	671.999	674.113	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB
1-22-82		672.001	672.001	675.650	671.999	674.110	729.020	705.271	705.300	705.301	-0.024	705.301	-0.024	705.301	-0.024	705.301	JAB	JAB

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-70
SHEET 4

SETTLEMENT MONITORING PROGRAM

WATTS BAR NUCLEAR PLANT

POWERHOUSE

Added by Amendment 50

DATE	SETTLEMENT POINTS															BY	CHKD							
	SS-1		SS-1A		SS-1B		SS-2		SS-2A		SS-3		SS-4		SS-5			SS-6		SS-7				
	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV			DIFF	ELEV	DIFF	ELEV	DIFF		
2-12-82																						JNH	JNH	
AUG			691.996	-0.12	675.655	-0.38					694.105	-0.21	728.994	-0.39	705.265	-0.27	705.295	-0.25	705.296	-0.21			JNH 2-15-82	JNH 2-15-82
													728.994	-0.38	705.265	-0.27	705.295	-0.25	705.296	-0.21			JNH	JNH

* LAST THREE READING ** LAST TWO READING

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-76
SHEET 5

SETTLEMENT MONITORING PROGRAM

WATTS BAR NUCLEAR PLANT

POWERHOUSE

Added by Amendment 50

DATE	SETTLEMENT POINTS										SS-17						
	SS-B	SS-9	SS-10	SS-11	SS-12	SS-13	SS-14	SS-15	SS-16	SS-17							
	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	BY	CHKD	
3-18-74																	
4-15-74			610.032	i										690.091	i	1-8-75	1-22-82
5-13-74			690.033	+0.001										690.088	-0.003		
6-11-74			690.031	-0.001										690.086	-0.005		
7-15-74			690.035	+0.003										690.090	-0.001		
8-13-74			690.035	+0.003										690.081	-0.010		
8-23-74			690.027	-0.005										694.098	RS		
9-16-74			694.217	RS										694.091	-0.007		
10-17-74			694.220	+0.003										694.092	-0.003		
11-18-74			694.212	-0.005										694.095	-0.003		
12-18-74			694.212	-0.005										694.097	-0.003		
1-20-75			694.214	-0.003										694.097	-0.001		
2-19-75			694.213	-0.004										694.097	-0.001		
3-17-75			694.211	-0.006										694.097	-0.001		
5-6-75			694.210	-0.007										694.100	+0.002		
6-2-75			694.208	-0.009										694.097	-0.001		
7-7-75			694.193	-0.024										694.093	-0.005		
7-21-75			694.207	-0.010										694.101	+0.003		
8-18-75			694.208	-0.009										694.089	-0.010		
9-10-75			694.203	-0.014										694.096	-0.002		
10-31-75			694.202	-0.015										694.091	-0.007		
11-24-75			694.198	-0.019										694.103	+0.005		
12-17-75			694.212	-0.005										694.082	-0.012		
1-14-76			694.190	-0.027										694.082	-0.012		
			694.206	-0.011										694.082	+0.001		

RS - POINT RESET

* POINT RESET TO 704.764 ON 11-18-74

** POINT RESET TO 704.767 ON 11-18-74

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-70
SHEET 6

Added by Amendment 50

SETTLEMENT MONITORING PROGRAM
WATTS BAR NUCLEAR PLANT
POWERHOUSE

DATE	SS-8		SS-9		SS-10		SS-11		SS-12		SS-13		SS-14		SS-15		SS-16		SS-17			
	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF		
2-11-76			728.953	-.010	694.207	-.010	729.033															
3-18-76			728.942	-.011	694.205	-.012	729.023	-.010														
4-15-76			728.946	-.007	694.201	-.016	729.027	-.006														
5-11-76			728.946	-.007	694.205	-.012	729.028	-.005														
6-11-76			728.934	-.019	694.192	-.025	729.016	-.017														
7-14-76			728.936	-.017	694.195	-.022	729.019	-.014	728.995													
8-10-76			728.940	-.013	694.200	-.017	729.023	-.010	729.002													
9-14-76			728.934	-.019	694.183	-.024	729.020	-.013	728.997													
10-13-76			728.942	-.011	694.191	-.026	729.024	-.007	729.001													
11-9-76			Not Closure Not Used		Not Closure Not Used		Not Closure Not Used		Not Closure Not Used													
12-9-76			728.932	-.021	694.174	-.043	729.013	-.020	728.987													
1-12-77			728.937	-.016	694.184	-.033	Not Run		728.991													
2-10-77			728.951	-.002	694.193	-.024	729.027	-.006	728.991													
3-15-77			Not Run		694.195	-.022	729.018	-.015	728.991													
4-11-77			728.933	-.020	694.189	-.028	729.015	-.018	728.988													
5-10-77			728.926	-.027	694.174	-.043	729.013	-.020	728.984													
6-6-77			728.932	-.021	694.196	-.021	729.011	-.022	728.987													
7-6-77			728.935	-.001	694.190	-.027	729.015	-.018	728.997													
8-3-77			728.916	-.018	694.165	-.052	729.000	-.033	728.976													
9-12-77			Not Run		694.178	-.039	729.007	-.026	728.988													
10-11-77			NR		694.188	-.029	729.013	-.020	728.984													
11-7-77			729.015	-.019	694.172	-.045	729.012	-.021	728.975													
12-15-77			Not Run Inaccessible		694.194	-.023	729.018	-.015	Not Run Inacc.													
1-9-78			729.025	-.009	694.187	-.030	729.012	-.021	728.985													

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-70
SHEET 7

SETTLEMENT MONITORING PROGRAM
WATTS BAR NUCLEAR PLANT
POWERHOUSE

Added by Amendment 50

DATE	SETTLEMENT POINTS												BY	CHKD		
	SS-8	SS-9	SS-10	SS-11	SS-12	SS-13	SS-14	SS-15	SS-16	SS-17	DIFF	ELEV				
2-2-78	729.033	728.940	694.193	729.016	728.982	704.771	704.768	704.733	728.965	694.098	728.965	694.098	694.098	694.098	JAN 14 1978	2-2-78
3-3-78	Not Run	728.928	694.183	729.007	728.982	704.771	704.768	704.733	728.965	694.086	728.965	694.086	694.086	694.086	JAN 14 1978	3-3-78
4-3-78	729.022	728.925	694.178	729.003	728.980	704.771	704.768	704.733	728.965	694.084	728.965	694.084	694.084	694.084	JAN 14 1978	4-3-78
5-4-78	729.025	728.933	694.176	729.007	728.984	704.771	704.768	704.733	728.965	694.090	728.965	694.090	694.090	694.090	JAN 14 1978	5-4-78
6-5-78	729.019	728.922	694.182	729.003	728.978	704.771	704.768	704.733	728.965	694.089	728.965	694.089	694.089	694.089	JAN 14 1978	6-5-78
7-10-78	729.015	728.921	694.174	729.002	728.980	704.771	704.768	704.733	728.965	694.082	728.965	694.082	694.082	694.082	JAN 14 1978	7-10-78
8-4-78	729.015	728.913	694.168	728.995	728.976	704.771	704.768	704.733	728.965	694.073	728.965	694.073	694.073	694.073	JAN 14 1978	8-4-78
9-29-78		728.929	694.183	729.008						Not Run		Not Run	Not Run		JAN 14 1978	9-29-78
1-19-79		728.934	694.184	729.016						NR		NR	NR		JAN 14 1978	1-19-79
4-9-79		728.916	694.175	729.000						NR		NR	NR		JAN 14 1978	4-9-79
7-24-79	NR	728.926	694.182	728.999						NR		NR	NR		JAN 14 1978	7-24-79
10-23-79	NR	728.920	694.178	NR						NR		NR	NR		JAN 14 1978	10-23-79
1-19-80	NR	728.913	694.168	728.991						NR		NR	NR		JAN 14 1978	1-19-80
4-29-80	NR	728.909	694.161	728.993						NR		NR	NR		JAN 14 1978	4-29-80
12-22-81	729.010	728.917	694.157	729.000						NR		NR	NR		JAN 14 1978	12-22-81
1-18-82	729.006	728.914	694.181	728.995						NR		NR	NR		JAN 14 1978	1-18-82
1-27-82	729.009	728.917	694.175	729.000						NR		NR	NR		JAN 14 1978	1-27-82
2-11-82	729.010	728.910	694.170	729.000						NR		NR	NR		JAN 14 1978	2-11-82
ANG.	729.009	728.916	694.171	729.000						NR		NR	NR		JAN 14 1978	ANG.

* LAST THREE READINGS ** LAST TWO READINGS *** LAST FOUR READINGS

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
SETTLEMENT MONITORING PROGRAM POWERHOUSE TABLE 2.5-70 SHEET 8

Added by Amendment 50

SETTLEMENT POINTS									
	SS-18		SS-19		SS-20				
DATE	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	BY
10-16-73	689.531	i			689.502	i			JAD 1-4-82
11-13-73	689.542	+ .011	689.505	i	689.505	+ .003			↓
12-17-73	689.538	+ .007	689.512	+ .007	INAC.	-			↓
1-6-74	689.538	+ .007	689.500	- .005	INAC.	-			
2-20-74	689.541	+ .010	689.502	- .003	INAC.	-			
3-10-74	689.540	+ .009	689.501	- .004	689.509	+ .007			
4-18-74	689.538	+ .007	689.501	- .004	689.508	+ .006			
5-13-74	689.540	+ .009	689.504	- .001	689.511	+ .009			
6-11-74	689.535	+ .004	689.504	- .001	689.510	+ .008			
6-11-74	694.039	RS	694.046	RS	693.972	RS			
7-15-74	694.033	- .006	694.043	- .003	693.971	- .001			
8-13-74	694.037	- .002	694.042	- .004	693.972	0.0			
9-16-74	694.032	- .007	694.039	- .007	693.973	+ .001			
10-17-74	READING ERROR	-	694.037	- .009	693.972	0.0			
11-18-74	694.027	- .012	694.020	- .026	693.959	- .013			
12-18-74	694.043	+ .004	694.036	- .010	693.976	+ .004			
1-20-75	694.042	+ .003	694.033	- .013	693.971	- .001			
2-19-75	694.043	+ .004	694.037	- .009	693.975	+ .003			
3-17-75	694.042	+ .003	694.033	- .013	693.972	0.0			
5-6-75	694.031	- .008	694.032	- .014	693.964	- .008			
6-2-75	694.037	- .002	694.041	- .005	693.971	- .001			
7-7-75	694.033	- .006	694.037	- .009	693.966	- .006			
7-21-75	694.039	0.0	694.043	- .003	693.975	+ .003			
8-18-75	694.021	- .018	694.027	- .019	693.957	- .015			

RS POINT RESET

INAC - INACCESSIBLE

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

**SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-70
SHEET 9**

Added by Amendment 50

SETTLEMENT POINTS										
	SS-18		SS-19		SS-20					
DATE	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF	BY	CHKD
9-10-75	694.035	-0.004	694.036	-0.010	693.972	0.0			JAB 1-4-82	STB 1-26-82
10-31-75	694.039	0.0	694.035	-0.011	693.972	0.0				↓
11-24-75	694.046	+0.007	694.037	-0.009	693.976	+0.004				
12-17-75	694.052	+0.013	694.043	-0.003	693.983	+0.011				
1-14-76	694.053	+0.014	694.043	-0.003	693.984	+0.012				
2-11-76	694.052	+0.013	694.043	-0.003	693.982	+0.010				
3-18-76	694.041	+0.002	694.036	-0.010	693.972	0.0				
4-15-76	694.047	+0.008	694.045	-0.001	693.978	+0.006				
5-11-76	694.052	+0.013	694.049	+0.003	693.983	+0.011				
6-11-76	694.022	-0.017	694.026	-0.020	693.757	-0.015				
7-14-76	694.038	-0.001	694.043	-0.003	693.973	+0.001				
8-10-76	694.033	-0.006	694.038	-0.008	693.970	-0.002				
9-14-76	694.024	-0.015	694.027	-0.019	693.959	-0.013				
10-13-76	694.042	+0.003	694.042	-0.004	693.978	+0.006				
11-9-76	Pool Closure Not Used	-	Pool Closure Not Used	-	Pool Closure Not Used	-				
12-9-76	694.037	-0.002	694.033	-0.013	693.971	-0.001				
1-12-77	694.043	+0.004	694.038	-0.008	693.975	+0.003				
2-10-77	694.051	+0.012	694.049	+0.003	693.985	+0.013				
3-15-77	694.046	+0.007	694.046	0.0	693.980	+0.008				
4-11-77	694.033	-0.006	694.032	-0.014	693.965	-0.007				
5-10-77	694.034	+0.005	694.035	-0.011	693.968	-0.004				
6-6-77	694.045	+0.006	694.048	+0.002	693.979	+0.007				
7-6-77	694.034	-0.005	694.042	-0.004	693.972	0.0				
8-3-77	693.999	-0.040	694.006	-0.040	693.935	-0.037				

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
SETTLEMENT MONITORING PROGRAM POWERHOUSE TABLE 2.5-70 SHEET 12

Added by Amendment 50

SETTLEMENT POINTS						
	SS-21		SS-22		SS-23	
DATE	ELEV	DIFF	ELEV	DIFF	ELEV.	DIFF
6-11-76	709.976	-.030	709.994	-.005	709.867	+.027
7-14-76	709.993	-.013	710.012	+.013	709.868	+.028
8-10-76	709.990	-.016	710.010	+.011	709.862	+.022
9-14-76	709.978	-.028	709.996	-.003	709.868	+.028
10-13-76	709.996	-.010	710.011	+.012	709.870	+.030
11-9-76	Pool Closure Not Used	-	Pool Closure Not Used	-	Pool Closure Not Used	-
12-9-76	709.986	-.020	710.003	+.004	Not Run	-
1-12-77	710.000	-.006	710.014	+.015	709.871	+.031
2-10-77	710.005	-.001	710.018	+.019	709.885	+.045
3-15-77	709.999	-.007	710.016	+.017	709.868	+.028
4-11-77	709.990	-.016	710.007	+.008	709.873	+.033
5-10-77	709.986	-.020	710.004	+.005	709.869	+.029
6-6-77	710.000	-.006	710.019	+.020	709.867	+.027
7-6-77	709.992	-.014	710.010	+.011	709.860	+.020
8-3-77	709.953	-.053	709.976	-.023	709.867	+.027
9-12-77	709.984	-.022	710.003	+.004	709.859	+.019
10-11-77	710.002	-.004	710.019	+.020	709.864	+.024
11-7-77	709.987	-.019	710.004	+.005	709.869	+.029
12-15-77	709.987	-.019	710.008	+.009	709.866	+.026
1-9-78	710.002	-.004	710.020	+.021	709.872	+.032
2-2-78	709.998	-.008	710.021	+.022	709.871	+.031
3-3-78	709.989	-.017	710.006	+.007	709.865	+.025
4-3-78	709.978	-.028	710.000	+.001	709.864	+.024
5-4-78	709.989	-.017	710.011	+.012	709.863	+.023

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-70
SHEET 13

Added by Amendment 50

SETTLEMENT POINTS						
DATE	SS-21		SS-22		SS-23	
	ELEV	DIFF	ELEV	DIFF	ELEV	DIFF
6-5-78	709.978	-.028	710.002	+.003	709.858	+.018
7-10-78	709.978	-.028	709.997	-.002	709.854	+.014
8-4-78	709.987	-.019	710.006	+.007	709.854	+.014
9-29-78	709.989	-.017	710.011	+.012	709.857	+.017
1-5-79	709.996	-.010	710.012	+.013	709.858	+.018
4-9-79	709.979	-.027	710.000	+.001	709.868	+.028
7-20-79	709.978	-.028	710.002	+.003	709.851	+.011
10-19-79	709.981	-.025	710.007	+.008	709.855	+.015
1-18-80	709.983	-.023	710.005	+.006	709.854	+.014
4-28-80	709.978	-.028	709.999	0.0	709.861	+.021
12-18-81	709.976	-.028	709.997	-.002	709.855	+.015
1-7-82	709.986	-.020	710.009	+.010	709.862	+.022
1-22-82	709.979	-.027	710.003	+.004	709.864	+.024
Avg *	709.981	-.025	710.003	+.004	709.860	+.020

* LAST THREE READINGS

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

**SETTLEMENT MONITORING PROGRAM
POWERHOUSE
TABLE 2.5-70
SHEET 11**

Added by Amendment 50

SETTLEMENT POINTS						
	SS-21		SS-22		SS-23	
DATE	ELEV	DIFF	ELEV	DIFF	ELEV.	DIFF
6-11-74						
7-15-74						
8-13-74						
9-16-74					709.840	i
10-17-74	710.006	i			709.869	+ .029
11-18-74	Not Run	-			709.870	+ .030
12-18-74	710.004	-.002			709.874	+ .034
1-20-75	709.997	-.009			709.871	+ .031
2-19-75	710.000	-.006			709.869	+ .029
3-17-75	709.996	-.010			709.869	+ .029
5-6-75	709.991	-.015			709.863	+ .023
6-2-75	709.989	-.017			709.861	+ .021
7-7-75	709.992	-.014			709.861	+ .021
7-21-75	709.995	-.011			709.859	+ .019
8-18-75	709.984	-.022	709.999	i	709.858	+ .018
9-10-75	709.996	-.010	710.008	+ .009	709.861	+ .021
10-31-75	Not Run	-	710.008	+ .009	709.870	+ .030
11-24-75	709.997	-.009	710.008	+ .009	709.871	+ .031
12-16-75	710.005	-.001	710.017	+ .018	709.881	+ .041
1-14-76	710.002	-.004	710.014	+ .015	709.869	+ .029
2-11-76	710.004	-.002	710.017	+ .018	709.875	+ .035
3-18-76	709.995	-.011	710.010	+ .011	709.871	+ .031
4-15-76	709.998	-.008	710.014	+ .015	709.872	+ .032
5-11-76	710.003	-.003	710.018	+ .019	709.874	+ .034

TABLE 2.5-71
DIFFERENTIAL SETTLEMENT BETWEEN ROCK SUPPORTED STRUCTURES

Settlement Station	Initial Reading		Maximum Differential Settlement		Most Recent Differential Settlement		ΔS (Feet)
	Date	Elevation (Feet)	Date	Elevation (Feet)	Date	Elevation (Feet)	
Auxiliary Control Building and Turbine Building Settlement Stations (The turbine building is noncategory I.)	10-17-74	693.972	04-25-80	693.975	01-22-82	693.968 ⁽¹⁾	0.021
	10-17-74	710.006	04-25-80	709.978	01-22-82	709.981 ⁽¹⁾	-0.025
	08-18-75	694.027	08-04-78	694.042	01-22-82	694.032 ⁽¹⁾	0.001
	08-18-75	709.999	08-04-78	710.006	01-22-82	710.003 ⁽¹⁾	+0.004
SS18	09-16-74	694.032	06-11-76	694.022	01-22-82	694.031 ⁽¹⁾	0.001
	09-16-74	709.840	06-11-76	709.867	01-22-82	709.860 ⁽¹⁾	+0.020
SS15	01-14-76	704.764	08-03-77	704.726	02-12-82	704.732 ⁽²⁾	0.001
	01-14-76	728.980	08-03-77	728.980	02-12-82	728.949 ⁽²⁾	-0.031
SS12	07-14-76	728.995	01-12-77	728.991	03-03-78	728.982 ⁽³⁾	0.003
	07-14-76	704.787	01-12-77	704.770	03-03-78	704.771 ⁽³⁾	-0.016
SS4	01-14-76	729.033	07-14-76	729.031	02-12-82	728.994 ⁽²⁾	0.020
	01-14-76	705.284	07-14-76	705.311	02-12-82	705.265 ⁽²⁾	-0.019
SS7	07-14-76	705.336	12-09-76	705.300	02-12-82	705.296 ⁽²⁾	0.015
	07-14-76	729.034	12-09-76	729.026	02-12-82	729.009 ⁽⁴⁾	-0.025

*This is the second highest differential settlement for SS18 and SS23, the highest is peculiarly high in August of 1977.

S=Settlement ΔS=Differential Settlement

- (1) Average of three readings from December 22, 1981, January 18, 1982, and January 27, 1982.
- (2) Average of two readings from January 27, 1982 and February 12, 1982, difficult conditions.
- (3) Single reading of March 3, 1978.
- (4) Average of four readings from December 22, 1981, January 18, 1982, January 27, 1982, and February 12, 1982.

Added by Amendment 50

B61187.10

TABLE 2.5-72
SETTLEMENT MONITORING PROGRAM OF CATEGORY I STRUCTURES

Structure	Foundation Material	Design Total Settlement	Design Differential Settlement	Maximum Measured Total Settlement (inches)	Updated Measured Total Settlement (inches)	Date	Settlement Station
Unit 1 R.B.	Rock	1 to 2 inches	1 inch	0.60	0.55 ⁽¹⁾	2-12-82	SS-13
Unit 2 R.B.	Rock	1 to 2 inches	1 inch	0.37	0.35 ⁽¹⁾	2-12-82	SS-7
Aux. & Control Building	Rock	1 to 2 inches	1 inch	0.67	0.55 ⁽²⁾	2-12-82	SS-10
Intake Pumping Station	Rock	1 to 2 inches	1 inch	0.38	0.13 ⁽³⁾	4-23-80	SS-3A
Diesel Generator Building	Compacted Granular Backfill on In Situ Gravel on Rock	NEGLIGIBLE	NEGLIGIBLE	0.59	0.53 ^(4&5)	4-10-81	SS-1
Waste Packaging Area	Compacted Granular Backfill on Rock	NEGLIGIBLE	NEGLIGIBLE	0.52	0.48 ⁽⁴⁾	4-28-80	SS-45

(1) Average of two readings from January 27, 1982, and February 12, 1982; difficult conditions.

(2) Average of four readings from December 22, 1981; January 18, 1982; January 27, 1982; and February 12, 1982.

(3) Single reading on April 23, 1980.

(4) Average of three readings from December 22, 1981; January 18, 1982; and January 27, 1982.

(5) Corrected to reset value on April 30, 1981.

Added by Amendment 50

TABLE 2.5-73

Summary of Ground-Water Level Estimates

<u>ERCW Piezometer</u>	<u>25-Year Ground-Water Estimate</u>	<u>Previous Estimate</u>
P1	702.9	701
P2	717.6	716
P3	716.8	715
P4	714.4	713
P5	712.5	705
P6	710.2	709
P7	718.4	717
P8	723.4	722

Revised by Amendment 50

THIS PAGE IS INTENTIONALLY LEFT BLANK

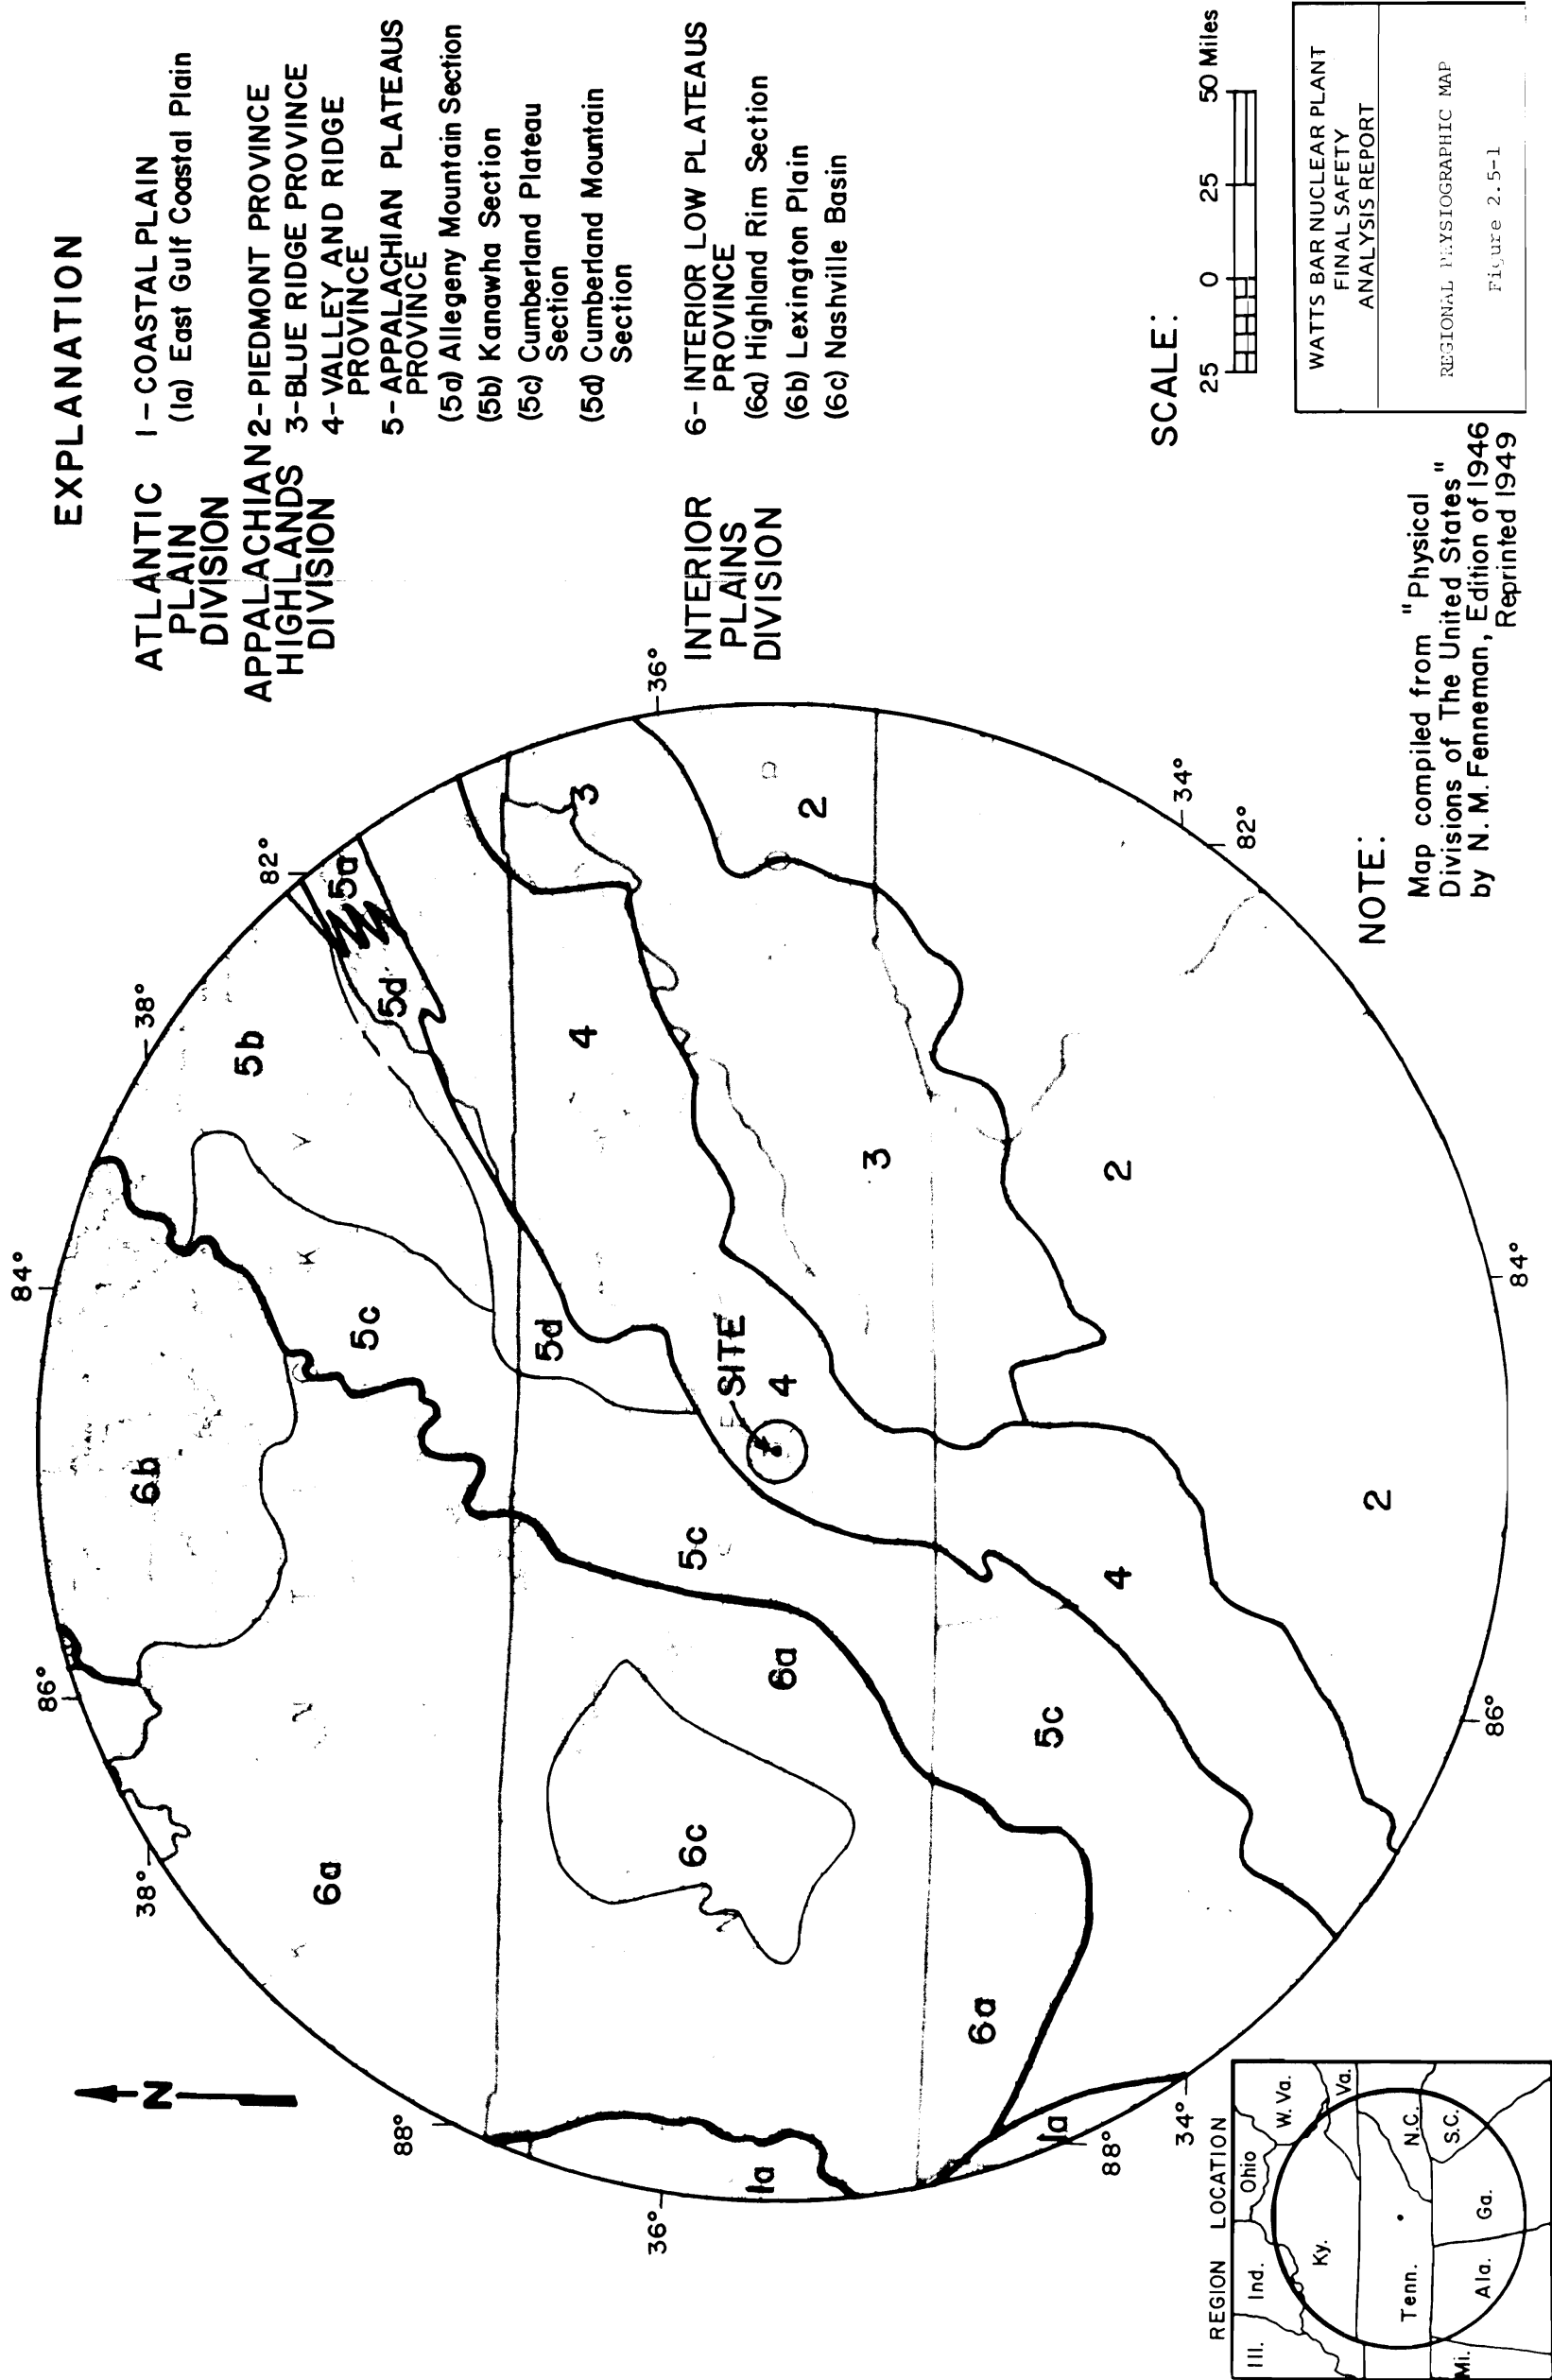


Figure 2.5-1 Regional Physiographic Map

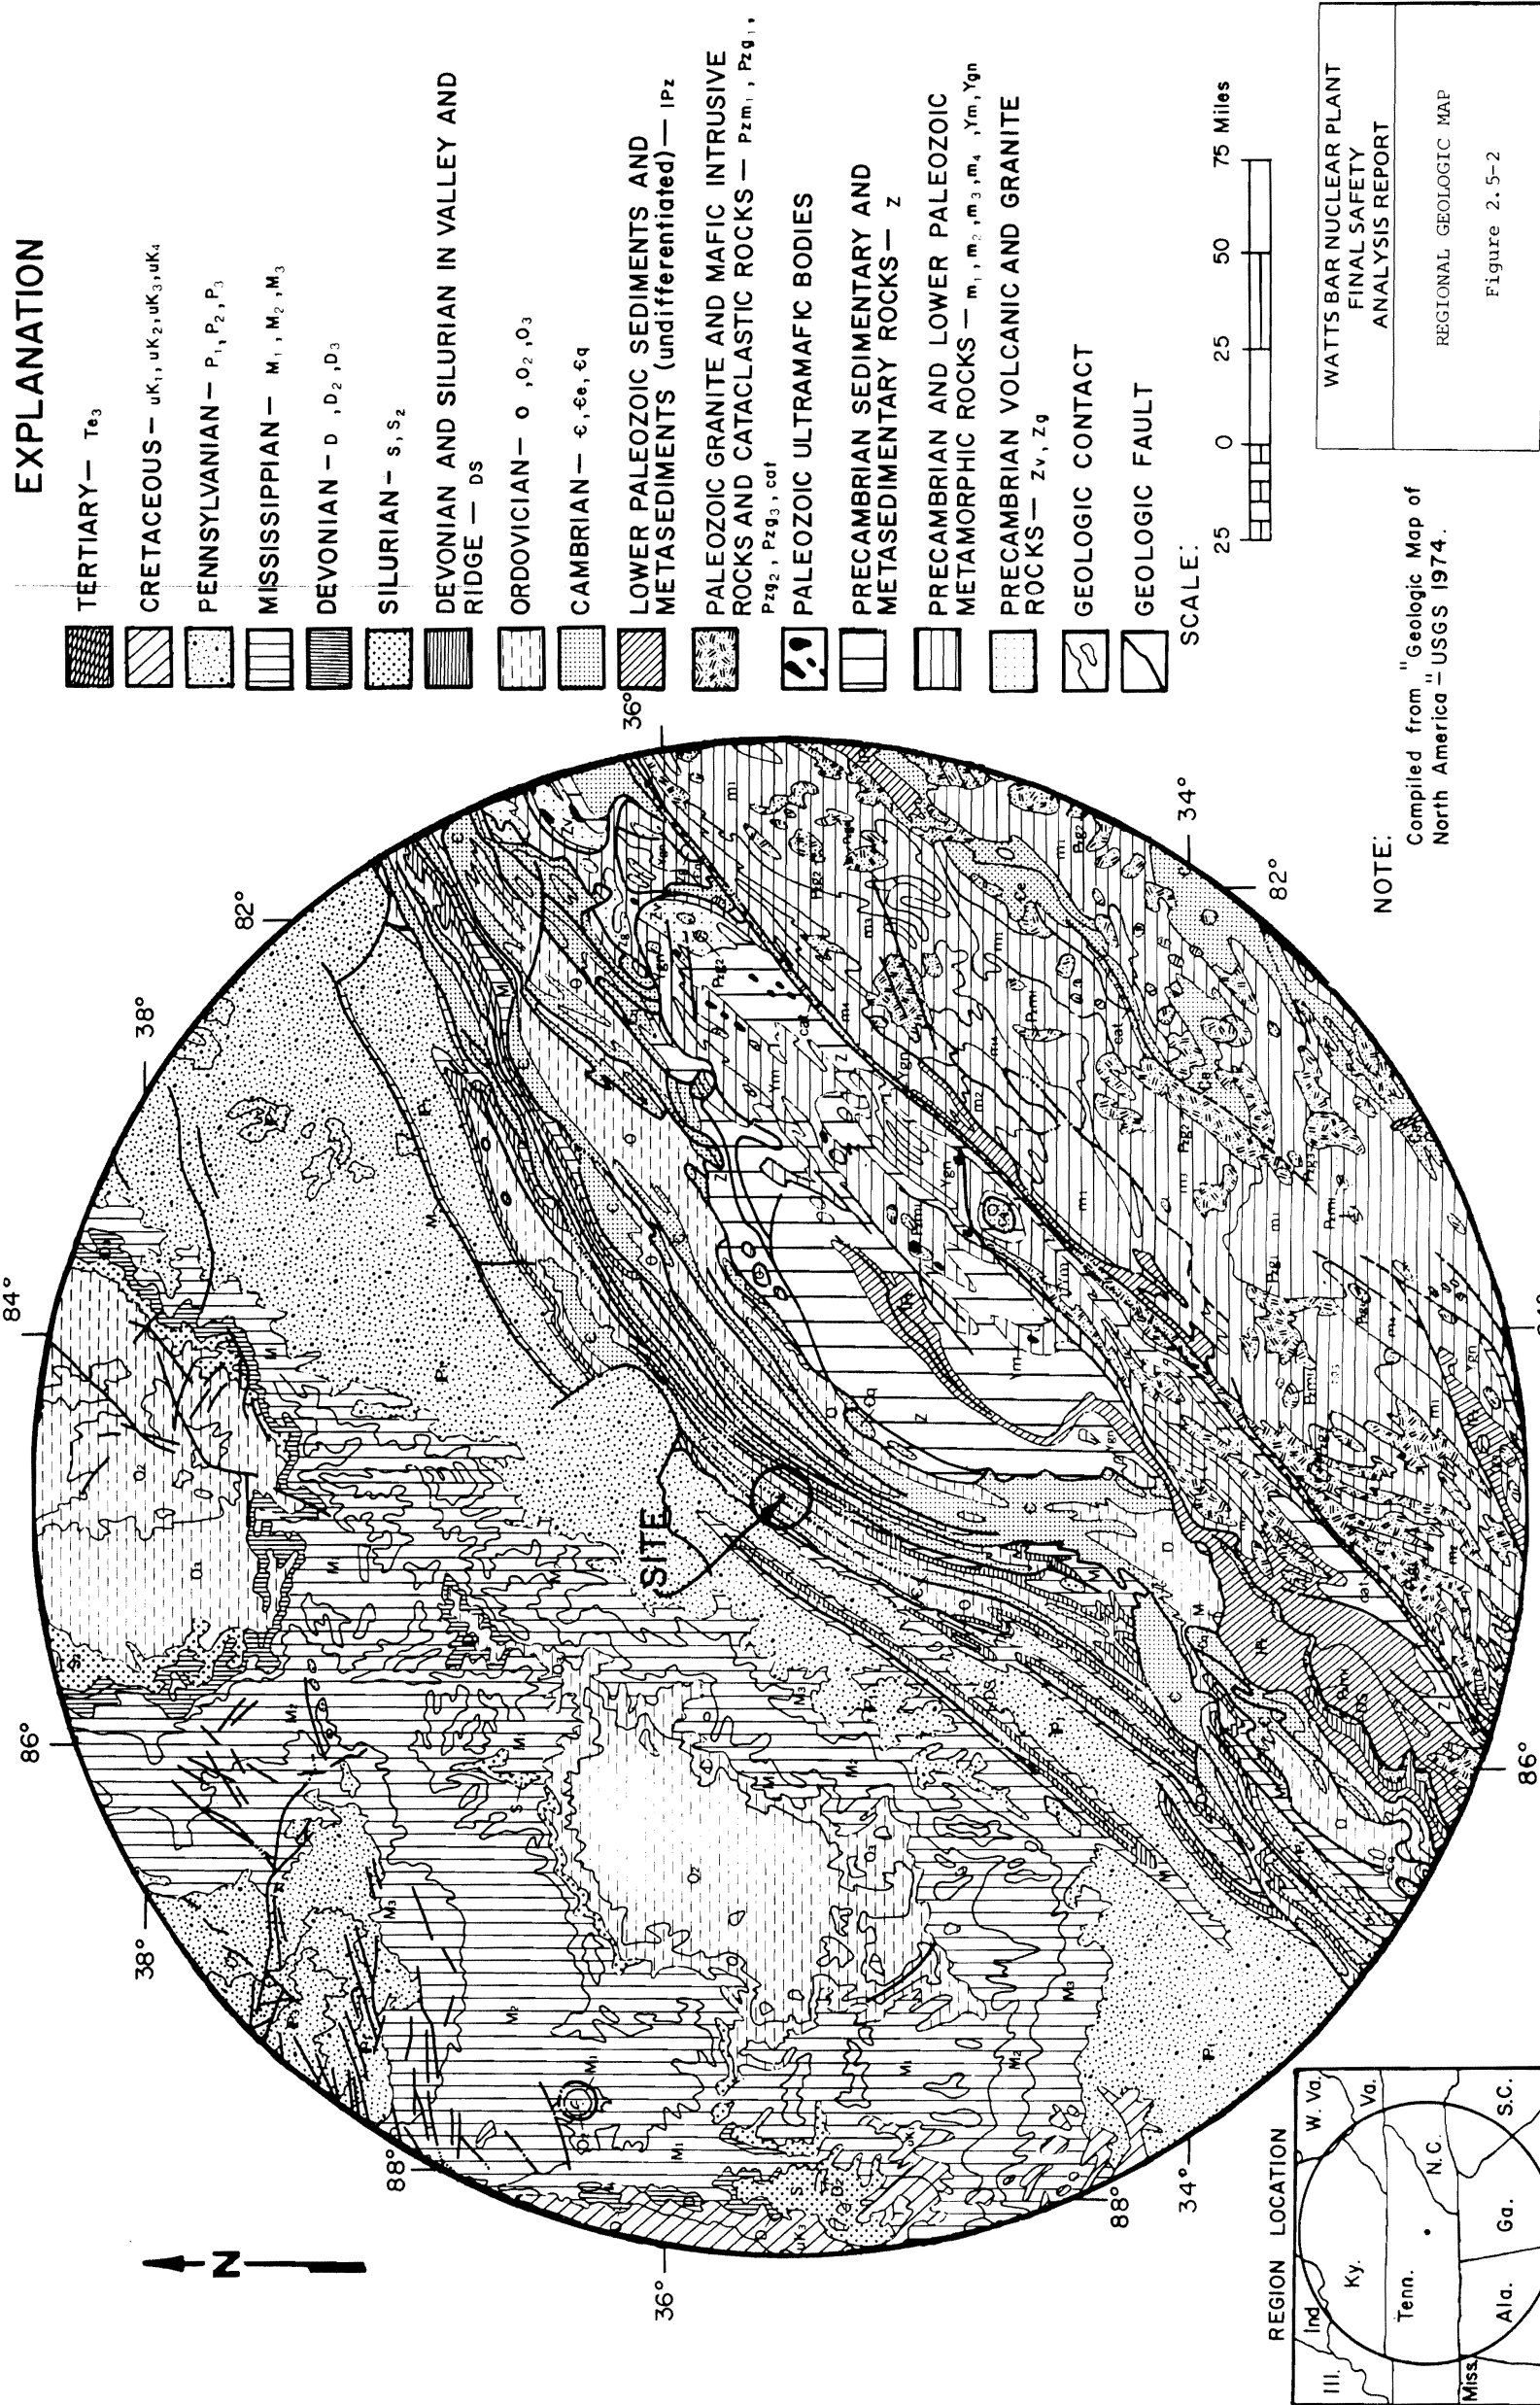


Figure 2.5-2 Regional Geologic Map

Figure 2.5-3 Subregional Geologic Setting (Actual Figure Located in Oversized Figures File)


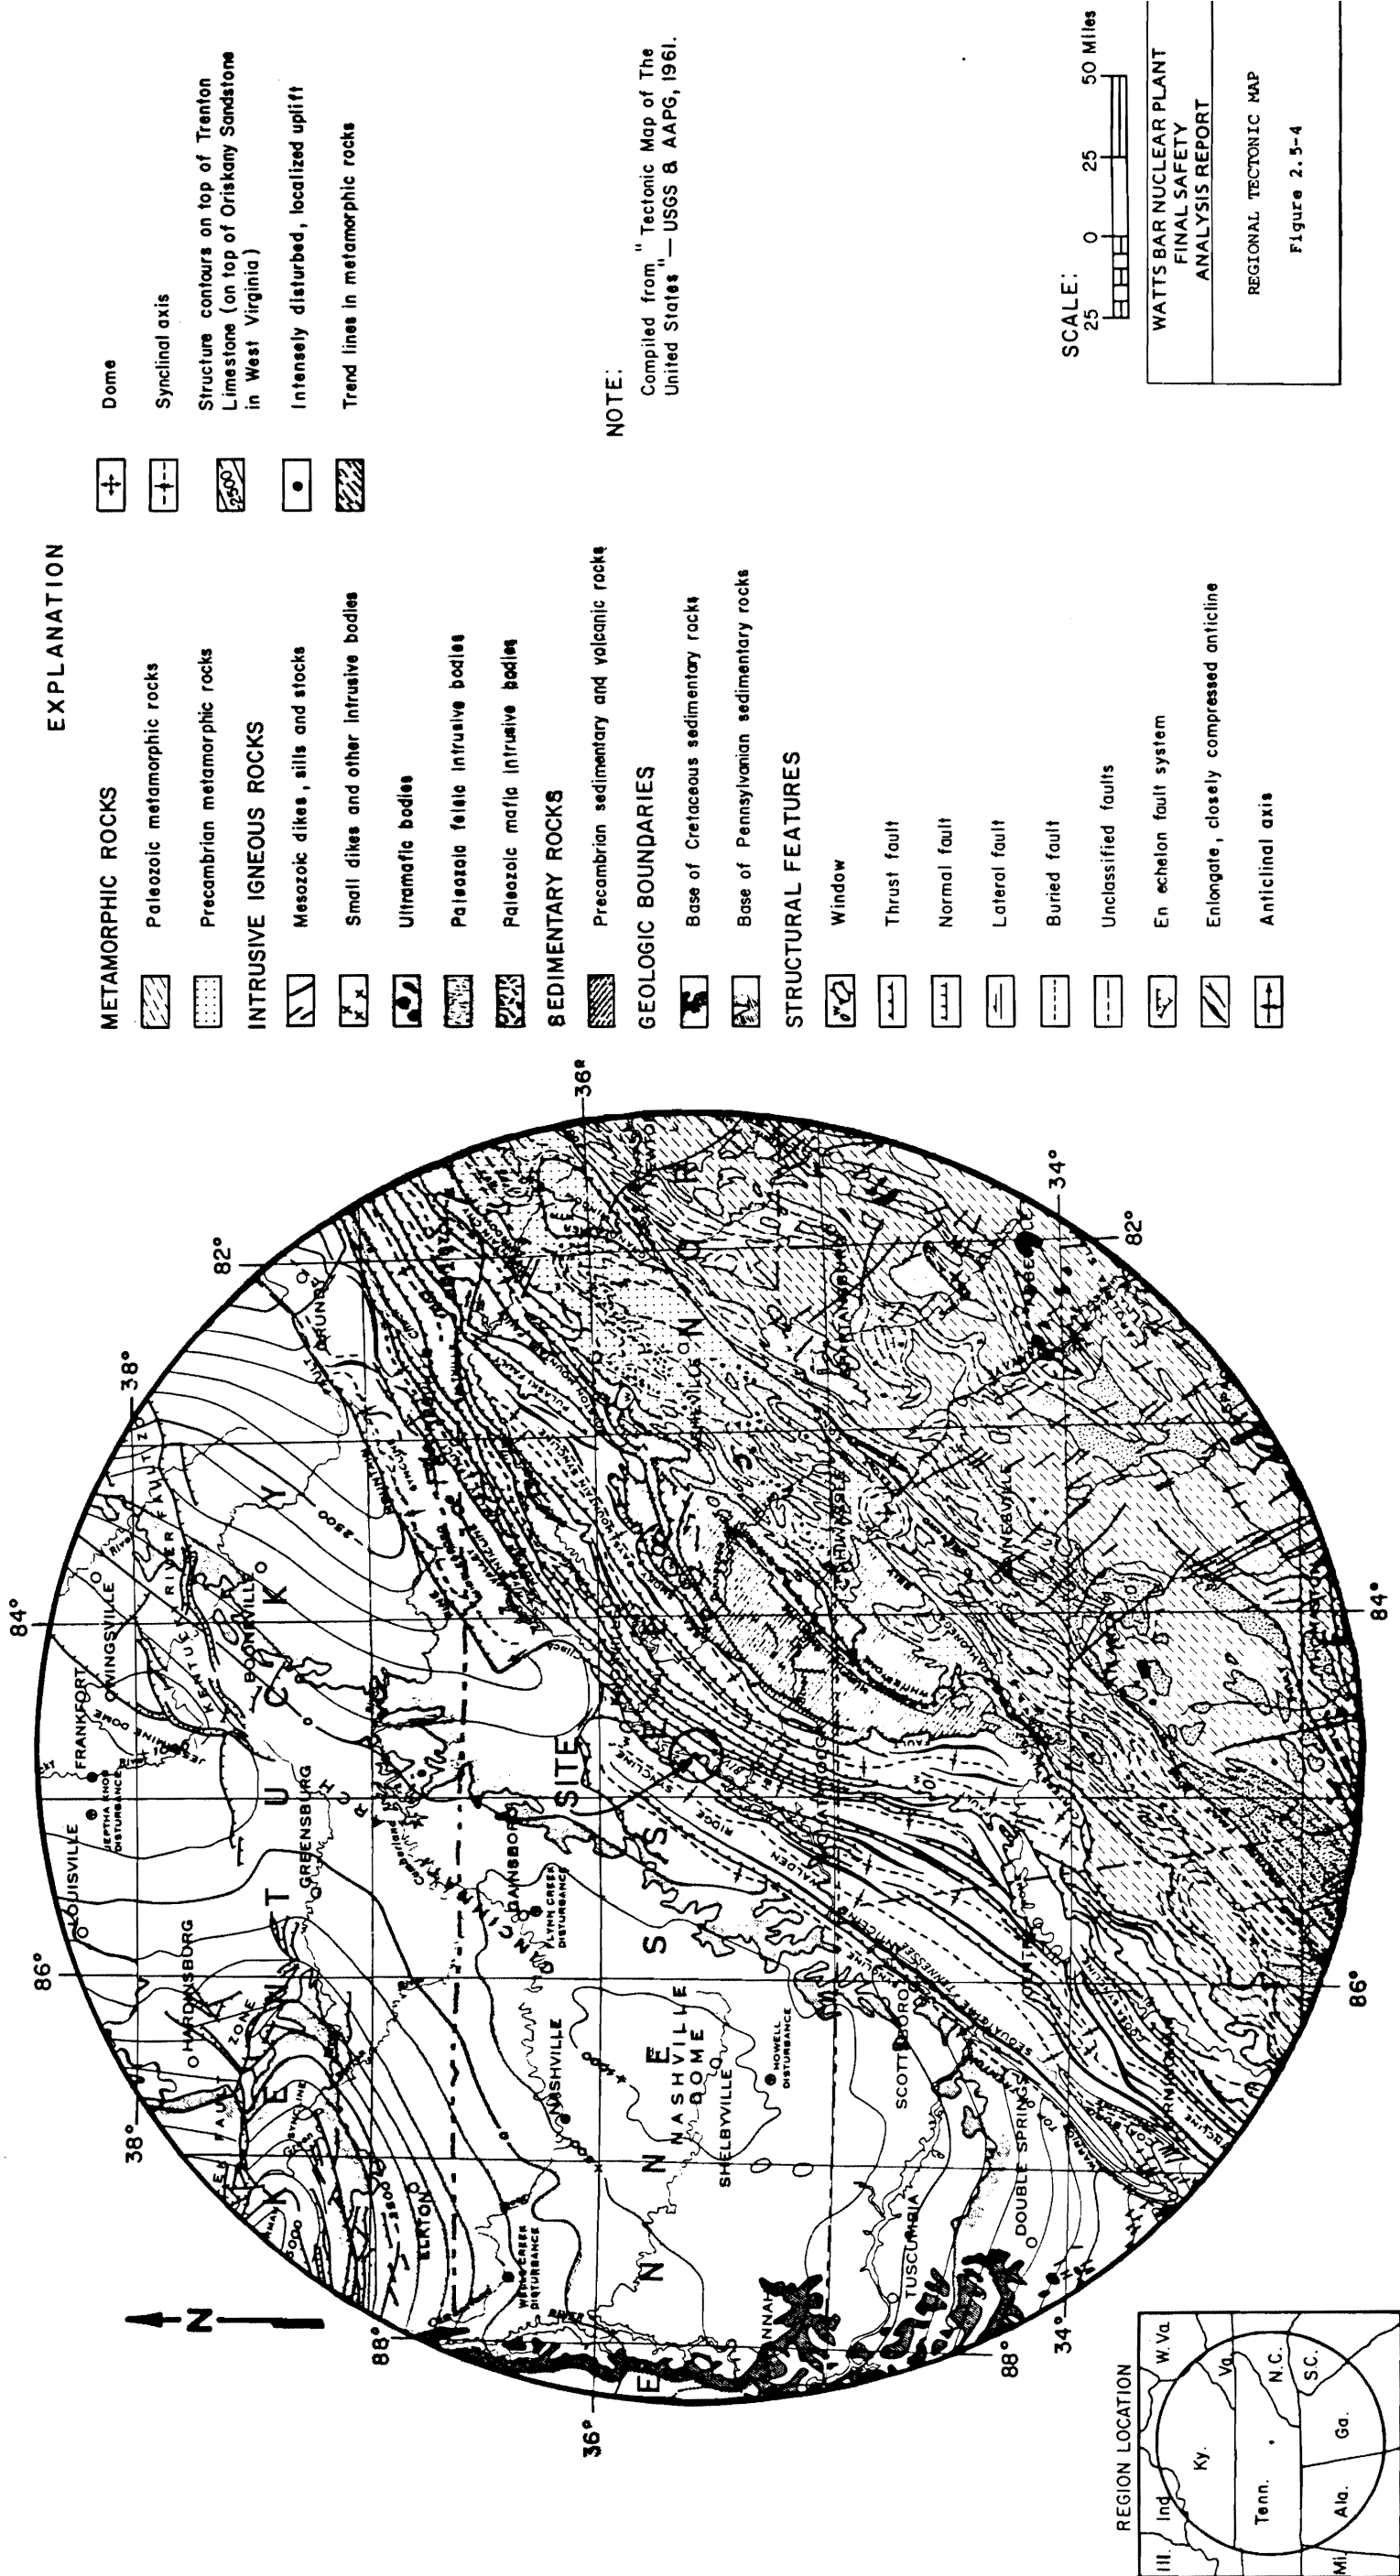


Figure 2.5-4 Regional Tectonic Map

By the
AMERICAN GEOPHYSICAL UNION
 Special Committee for the Geophysical
 and Geological Study of the Continents
 G. P. Woollard, Chairman
 and the
U.S. GEOLOGICAL SURVEY
 H. R. Joesting, Coordinator

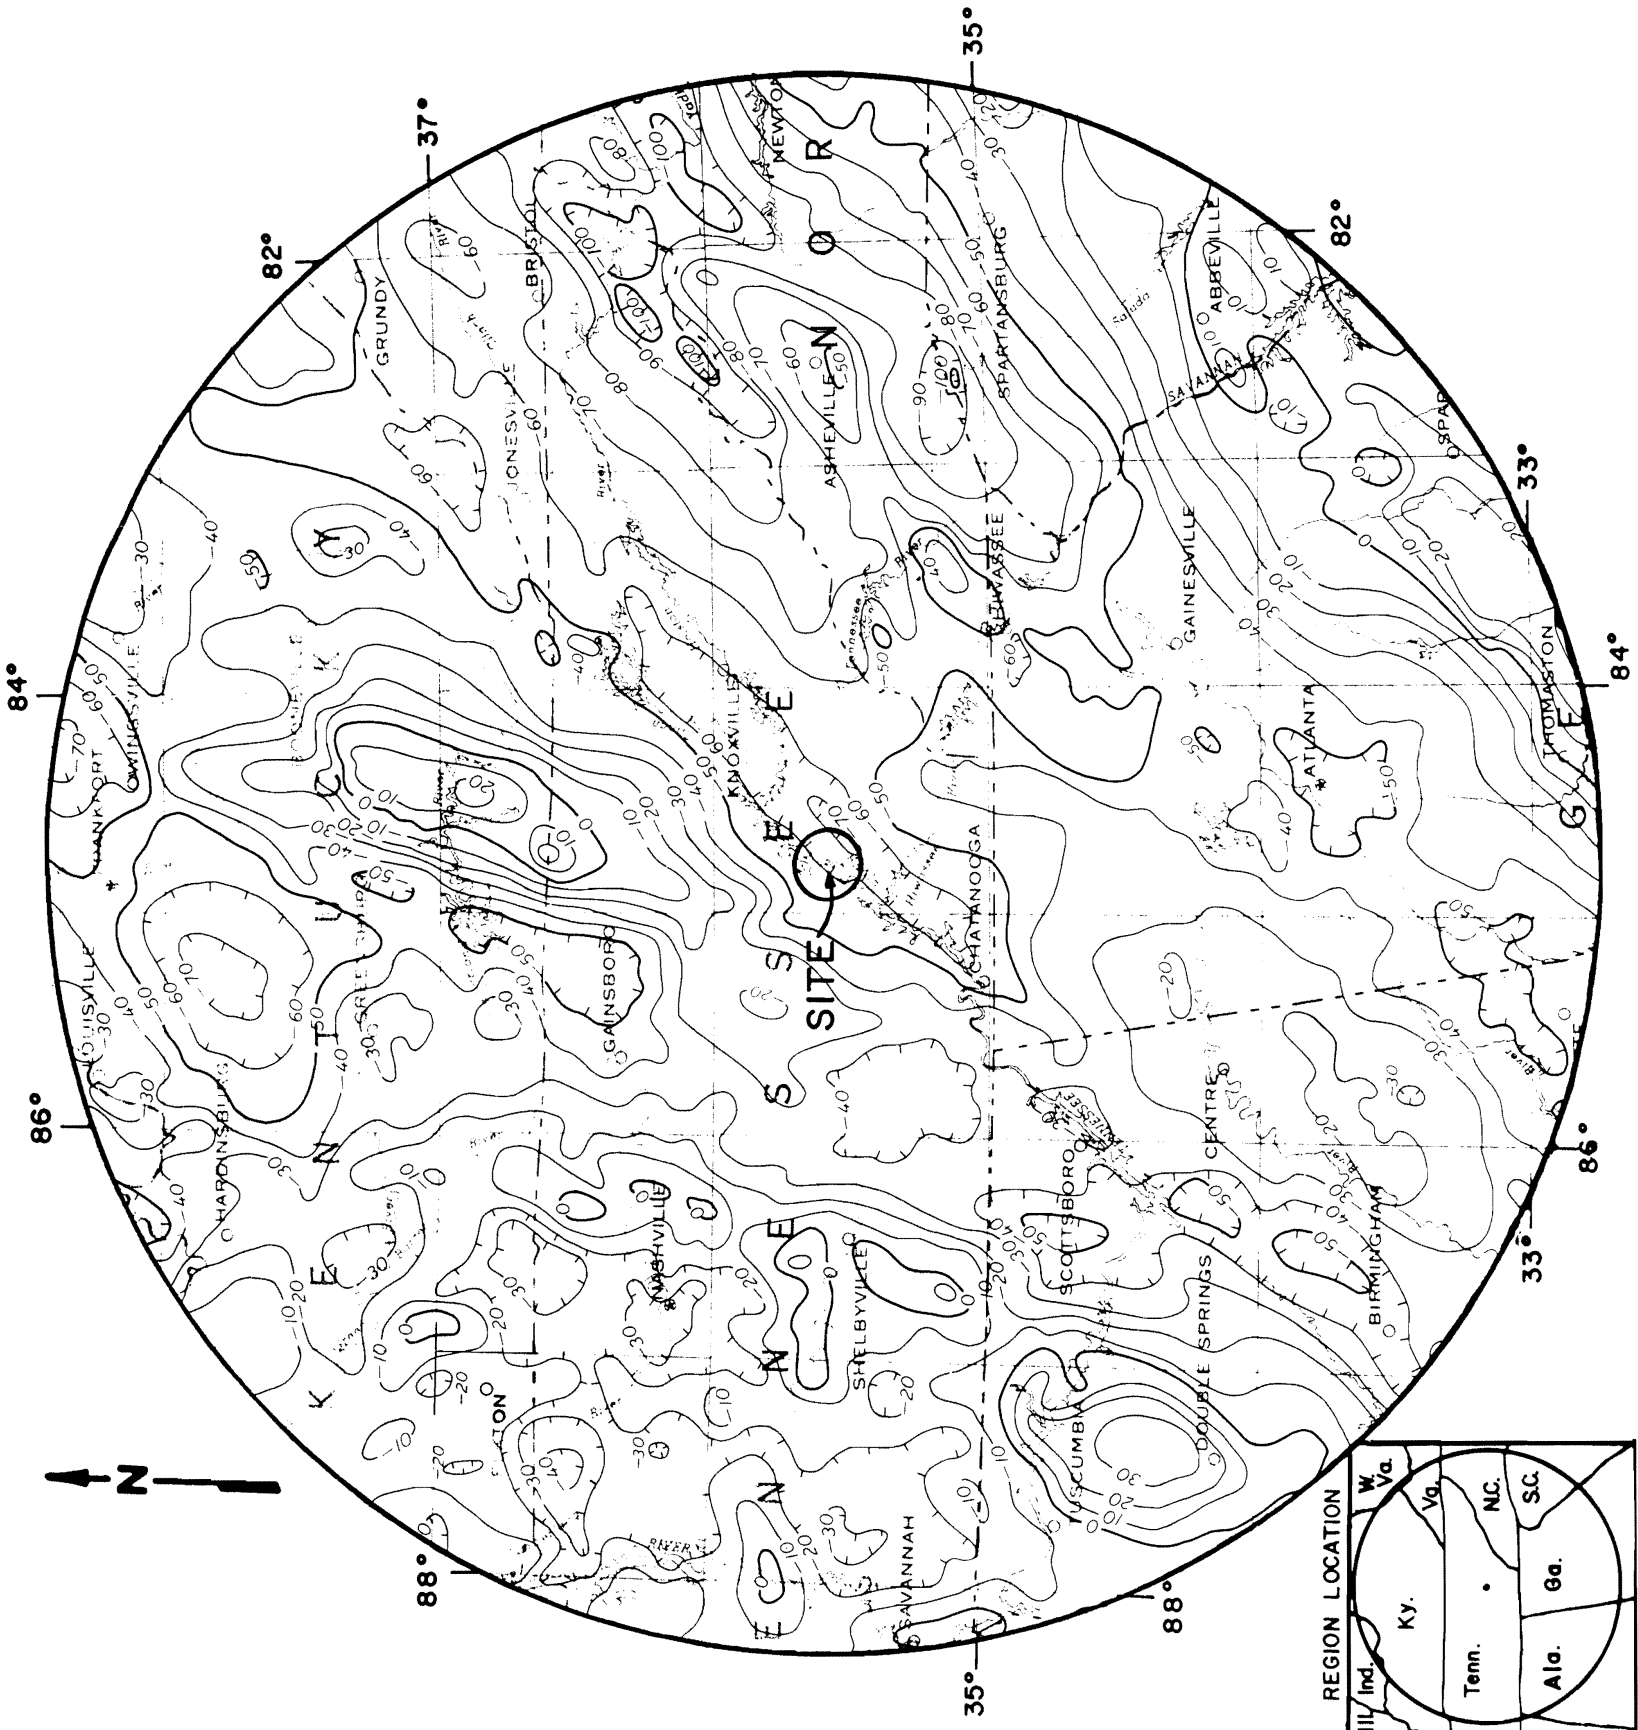

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
REGIONAL BOUGUER GRAVITY ANOMALY MAP Figure 2.5-5

Figure 2.5-5 Regional Bouguer Gravity Anomaly Map

COMPILED FROM
 USGS Misc. Geologic Investigations Map I-535-A
 TRANSCONTINENTAL GEOPHYSICAL SURVEY (35°-39°N)

By
 Isidore Zietz, H. P. Stockard, and John R. Kirby
 A CONTRIBUTION TO THE UPPER MANTLE PROJECT


EXPLANATION

Magnetic contours
 In hundreds of gamma. Dashed where incomplete, contour interval 700 gamma. Datum arbitrary. Note magnetic field of Earth's crust is based on Epoch 1955. No. have been removed from all aeromagnetic data.



Magnetic contours showing areas of lower magnetic intensity

Flight path
 Shows up locations of individual flight lines and direction of magnetic observation.



WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
REGIONAL MAGNETIC MAP Figure 2.5-6

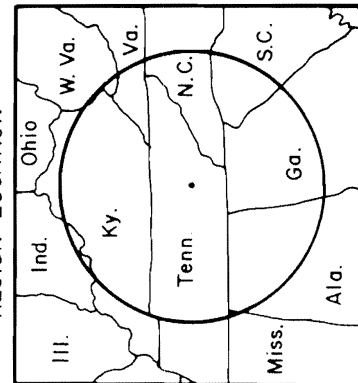
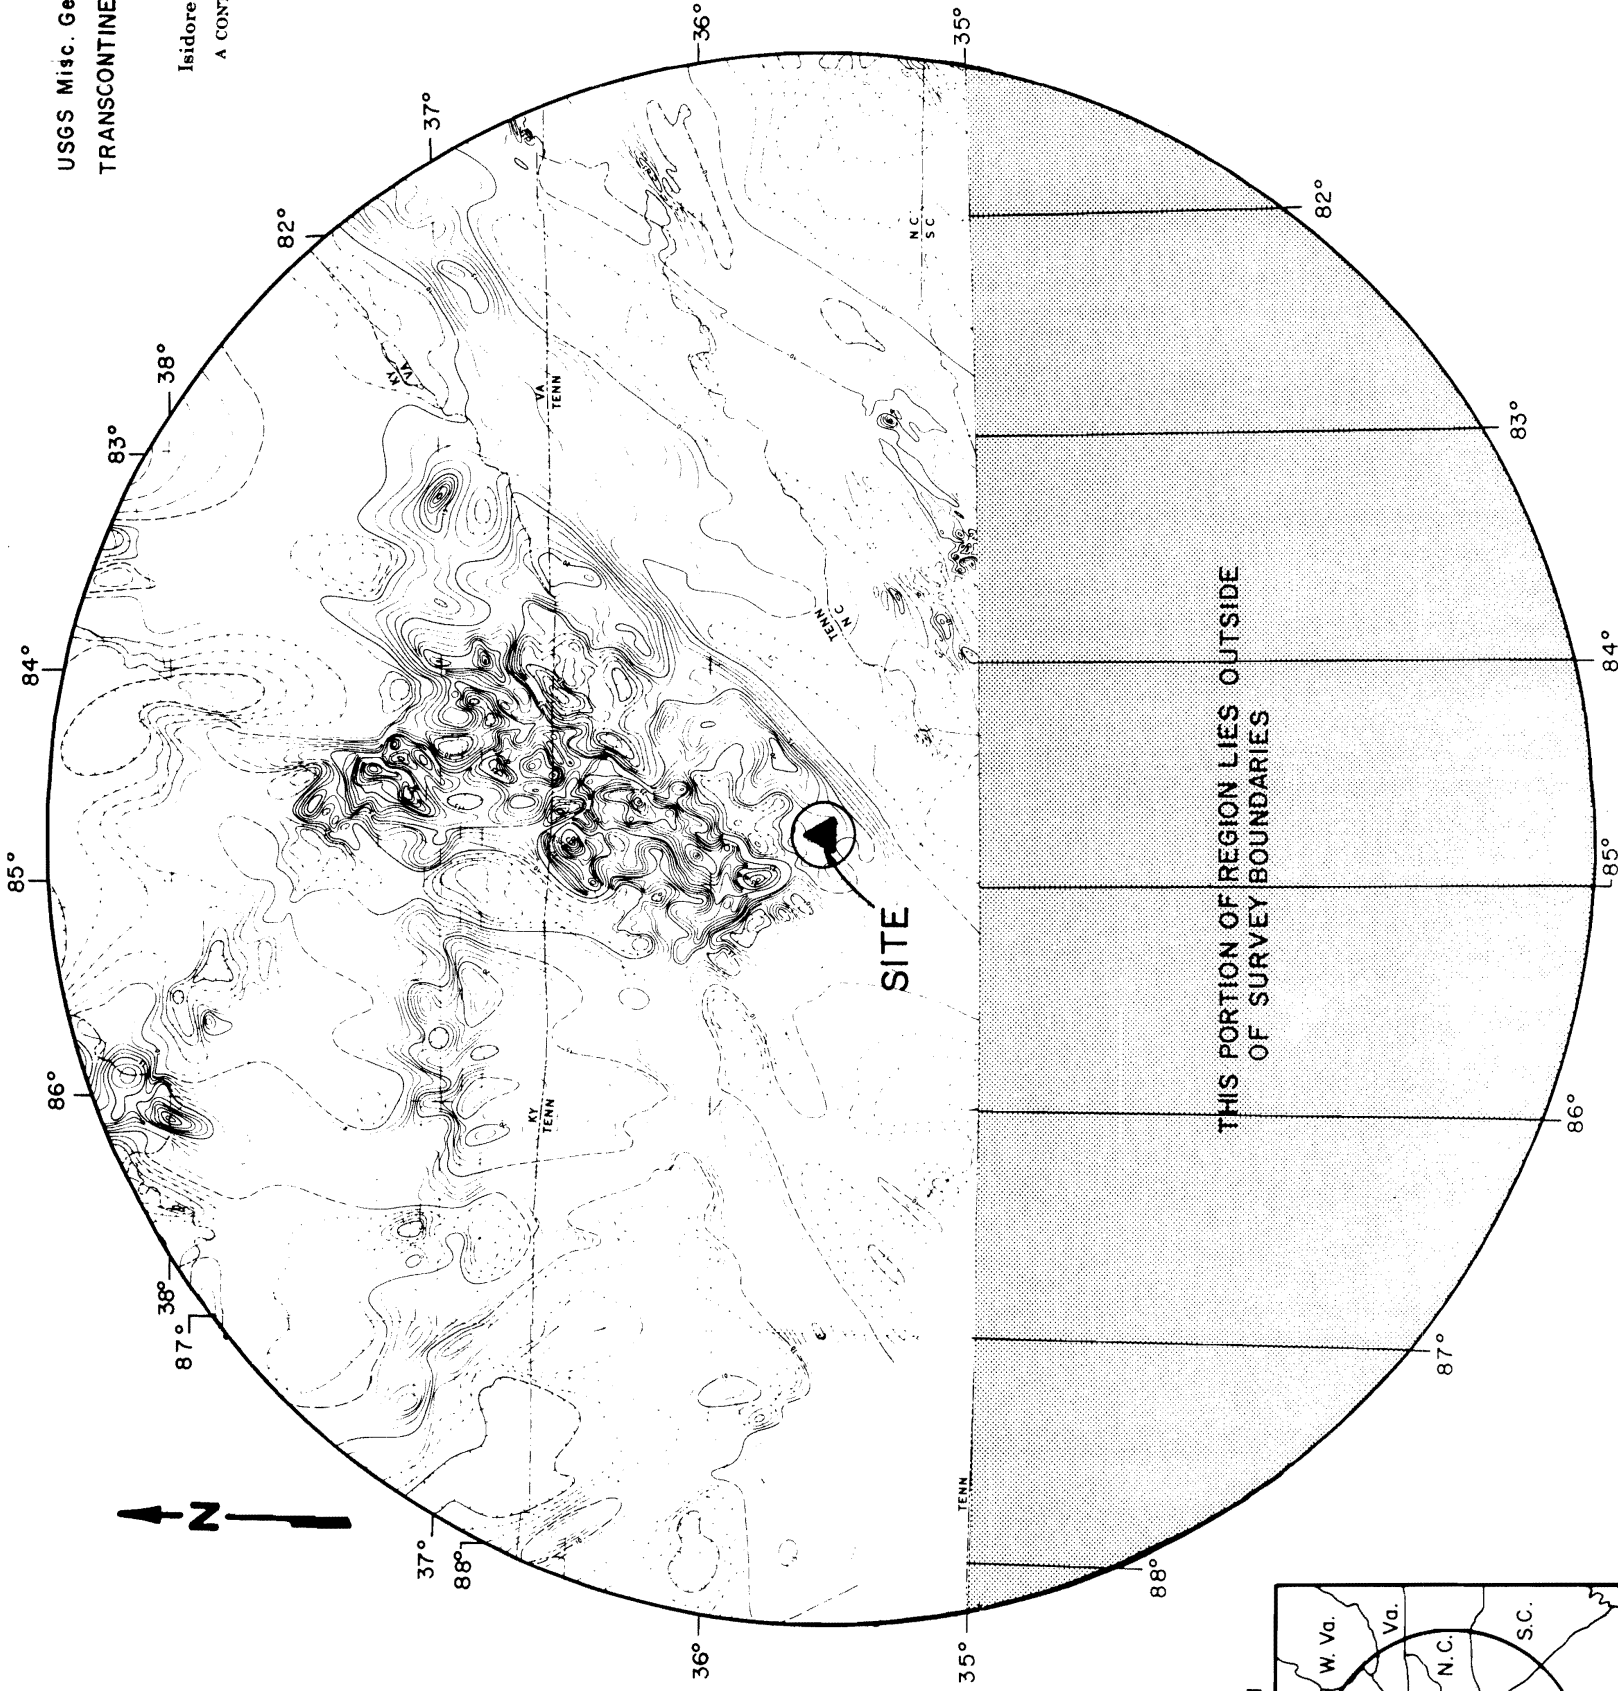


Figure 2.5-6 Regional Magnetic Map

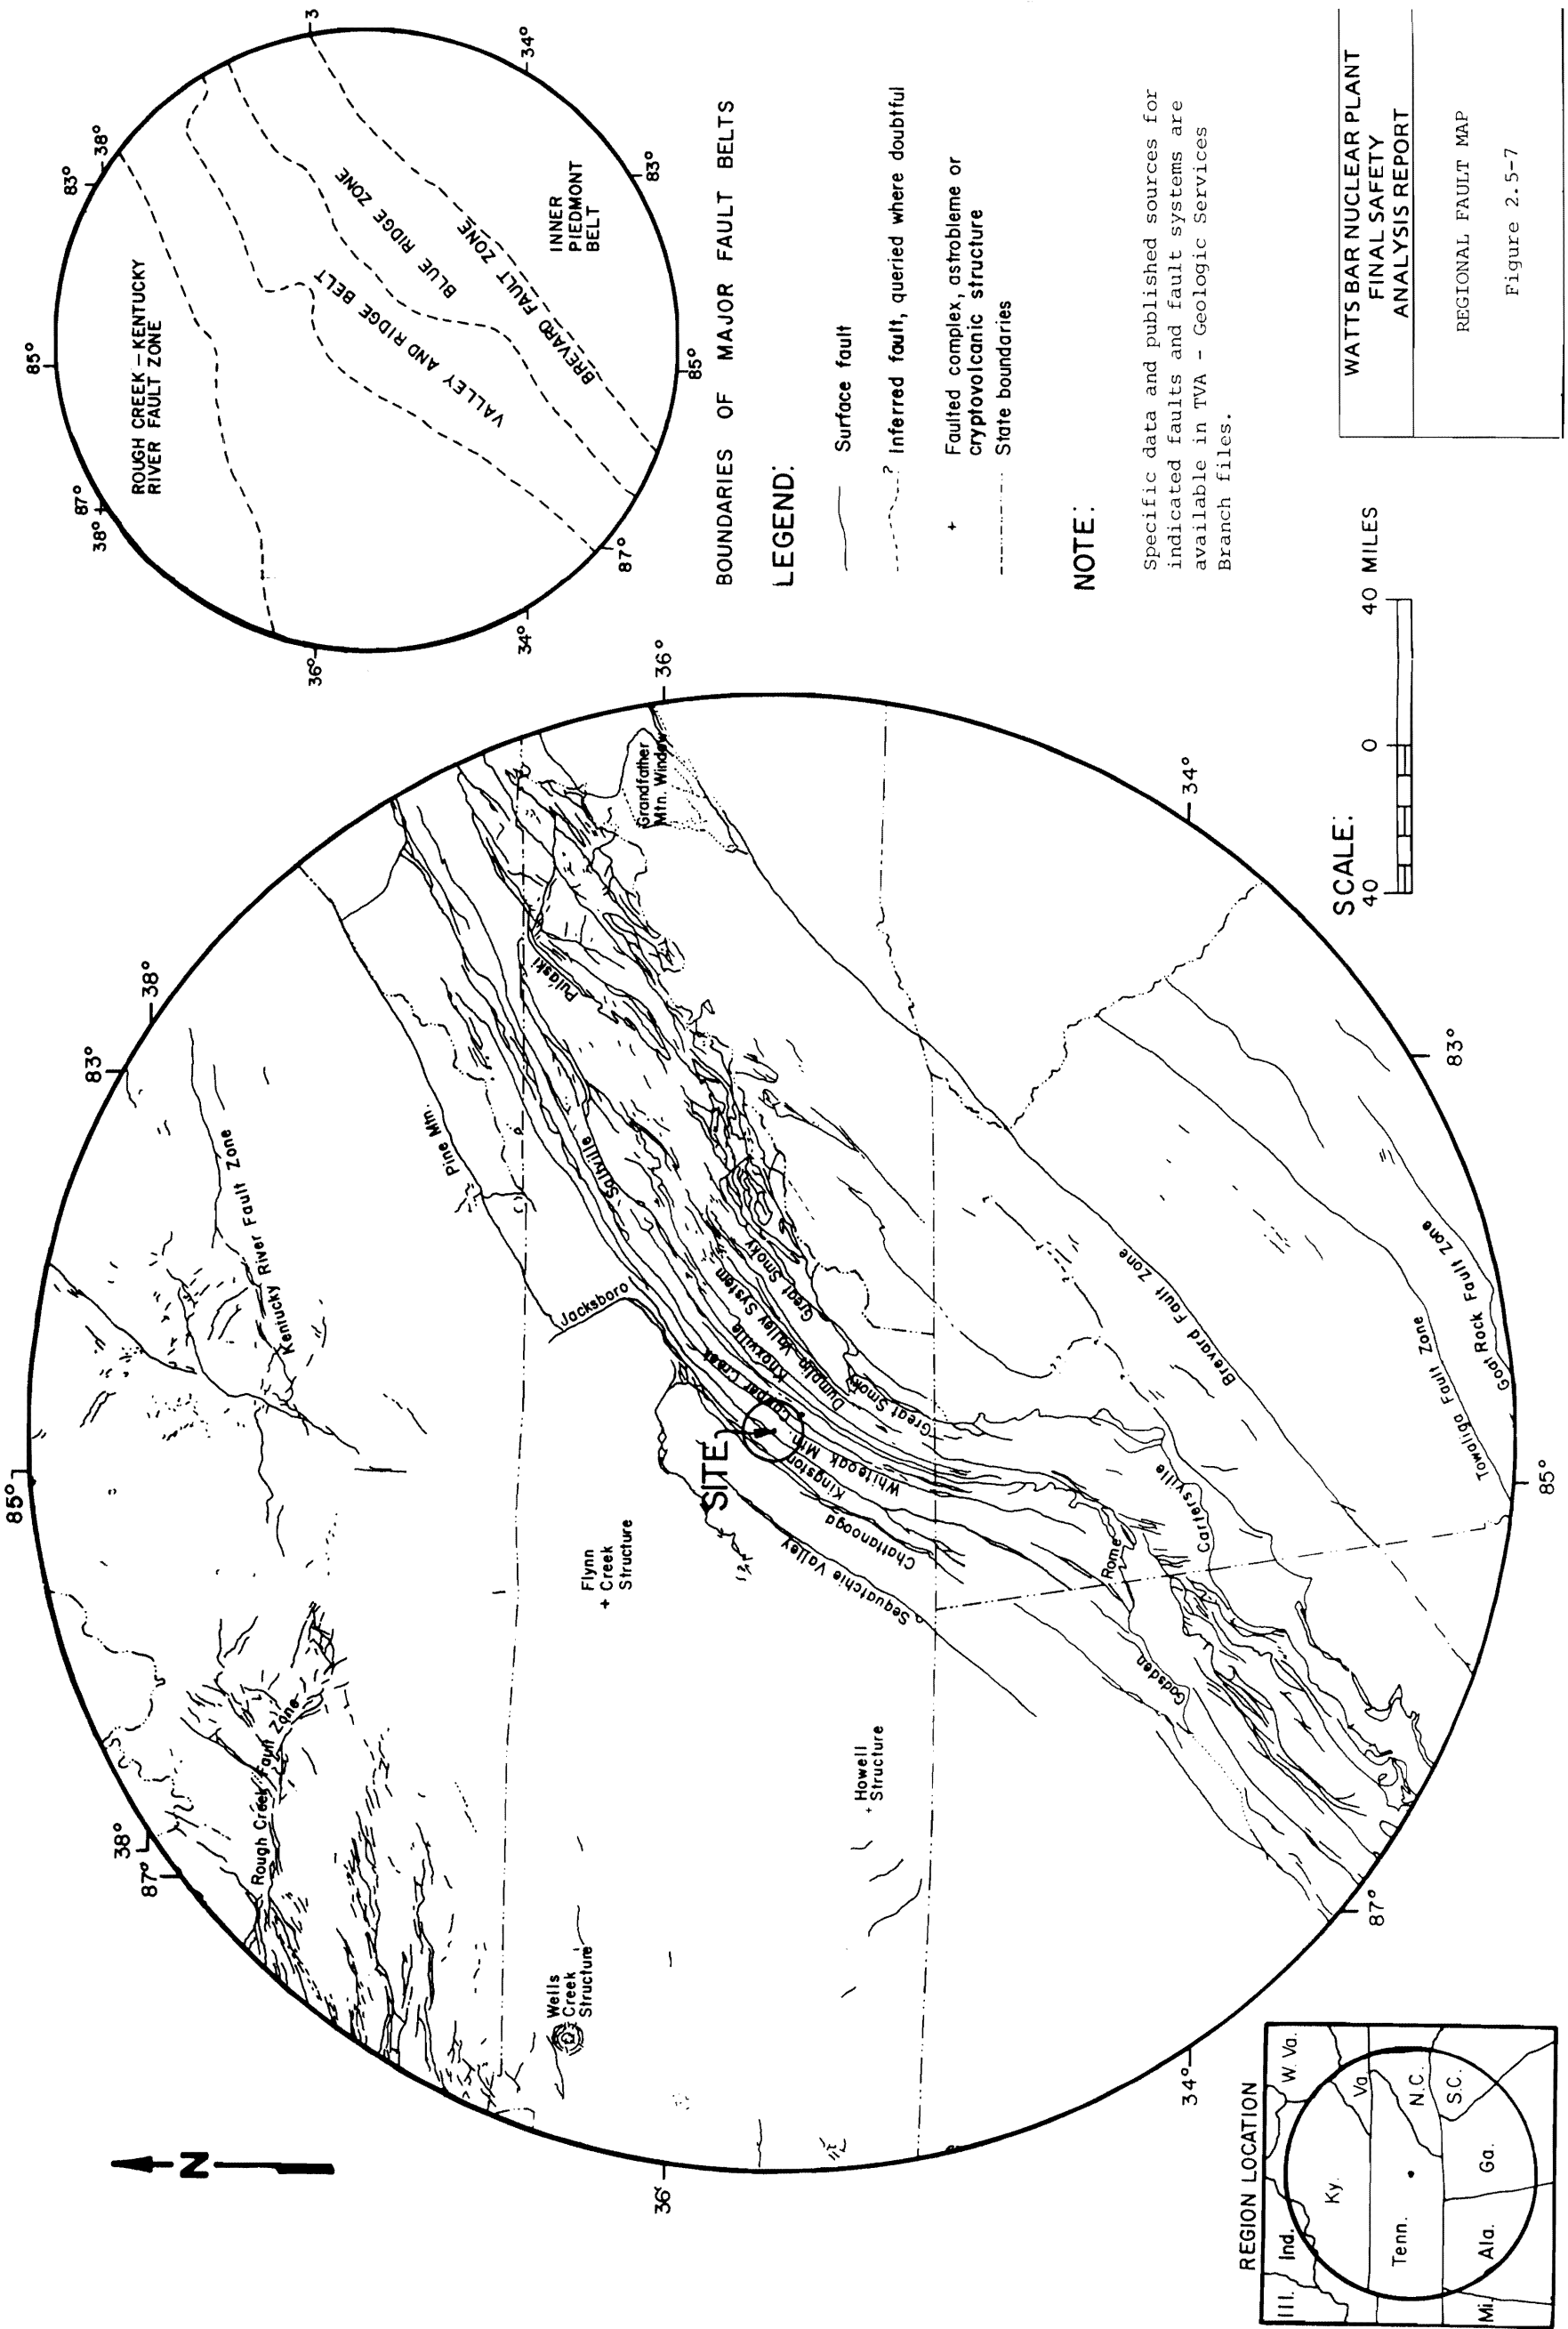


Figure 2.5-7 Regional Fault Map

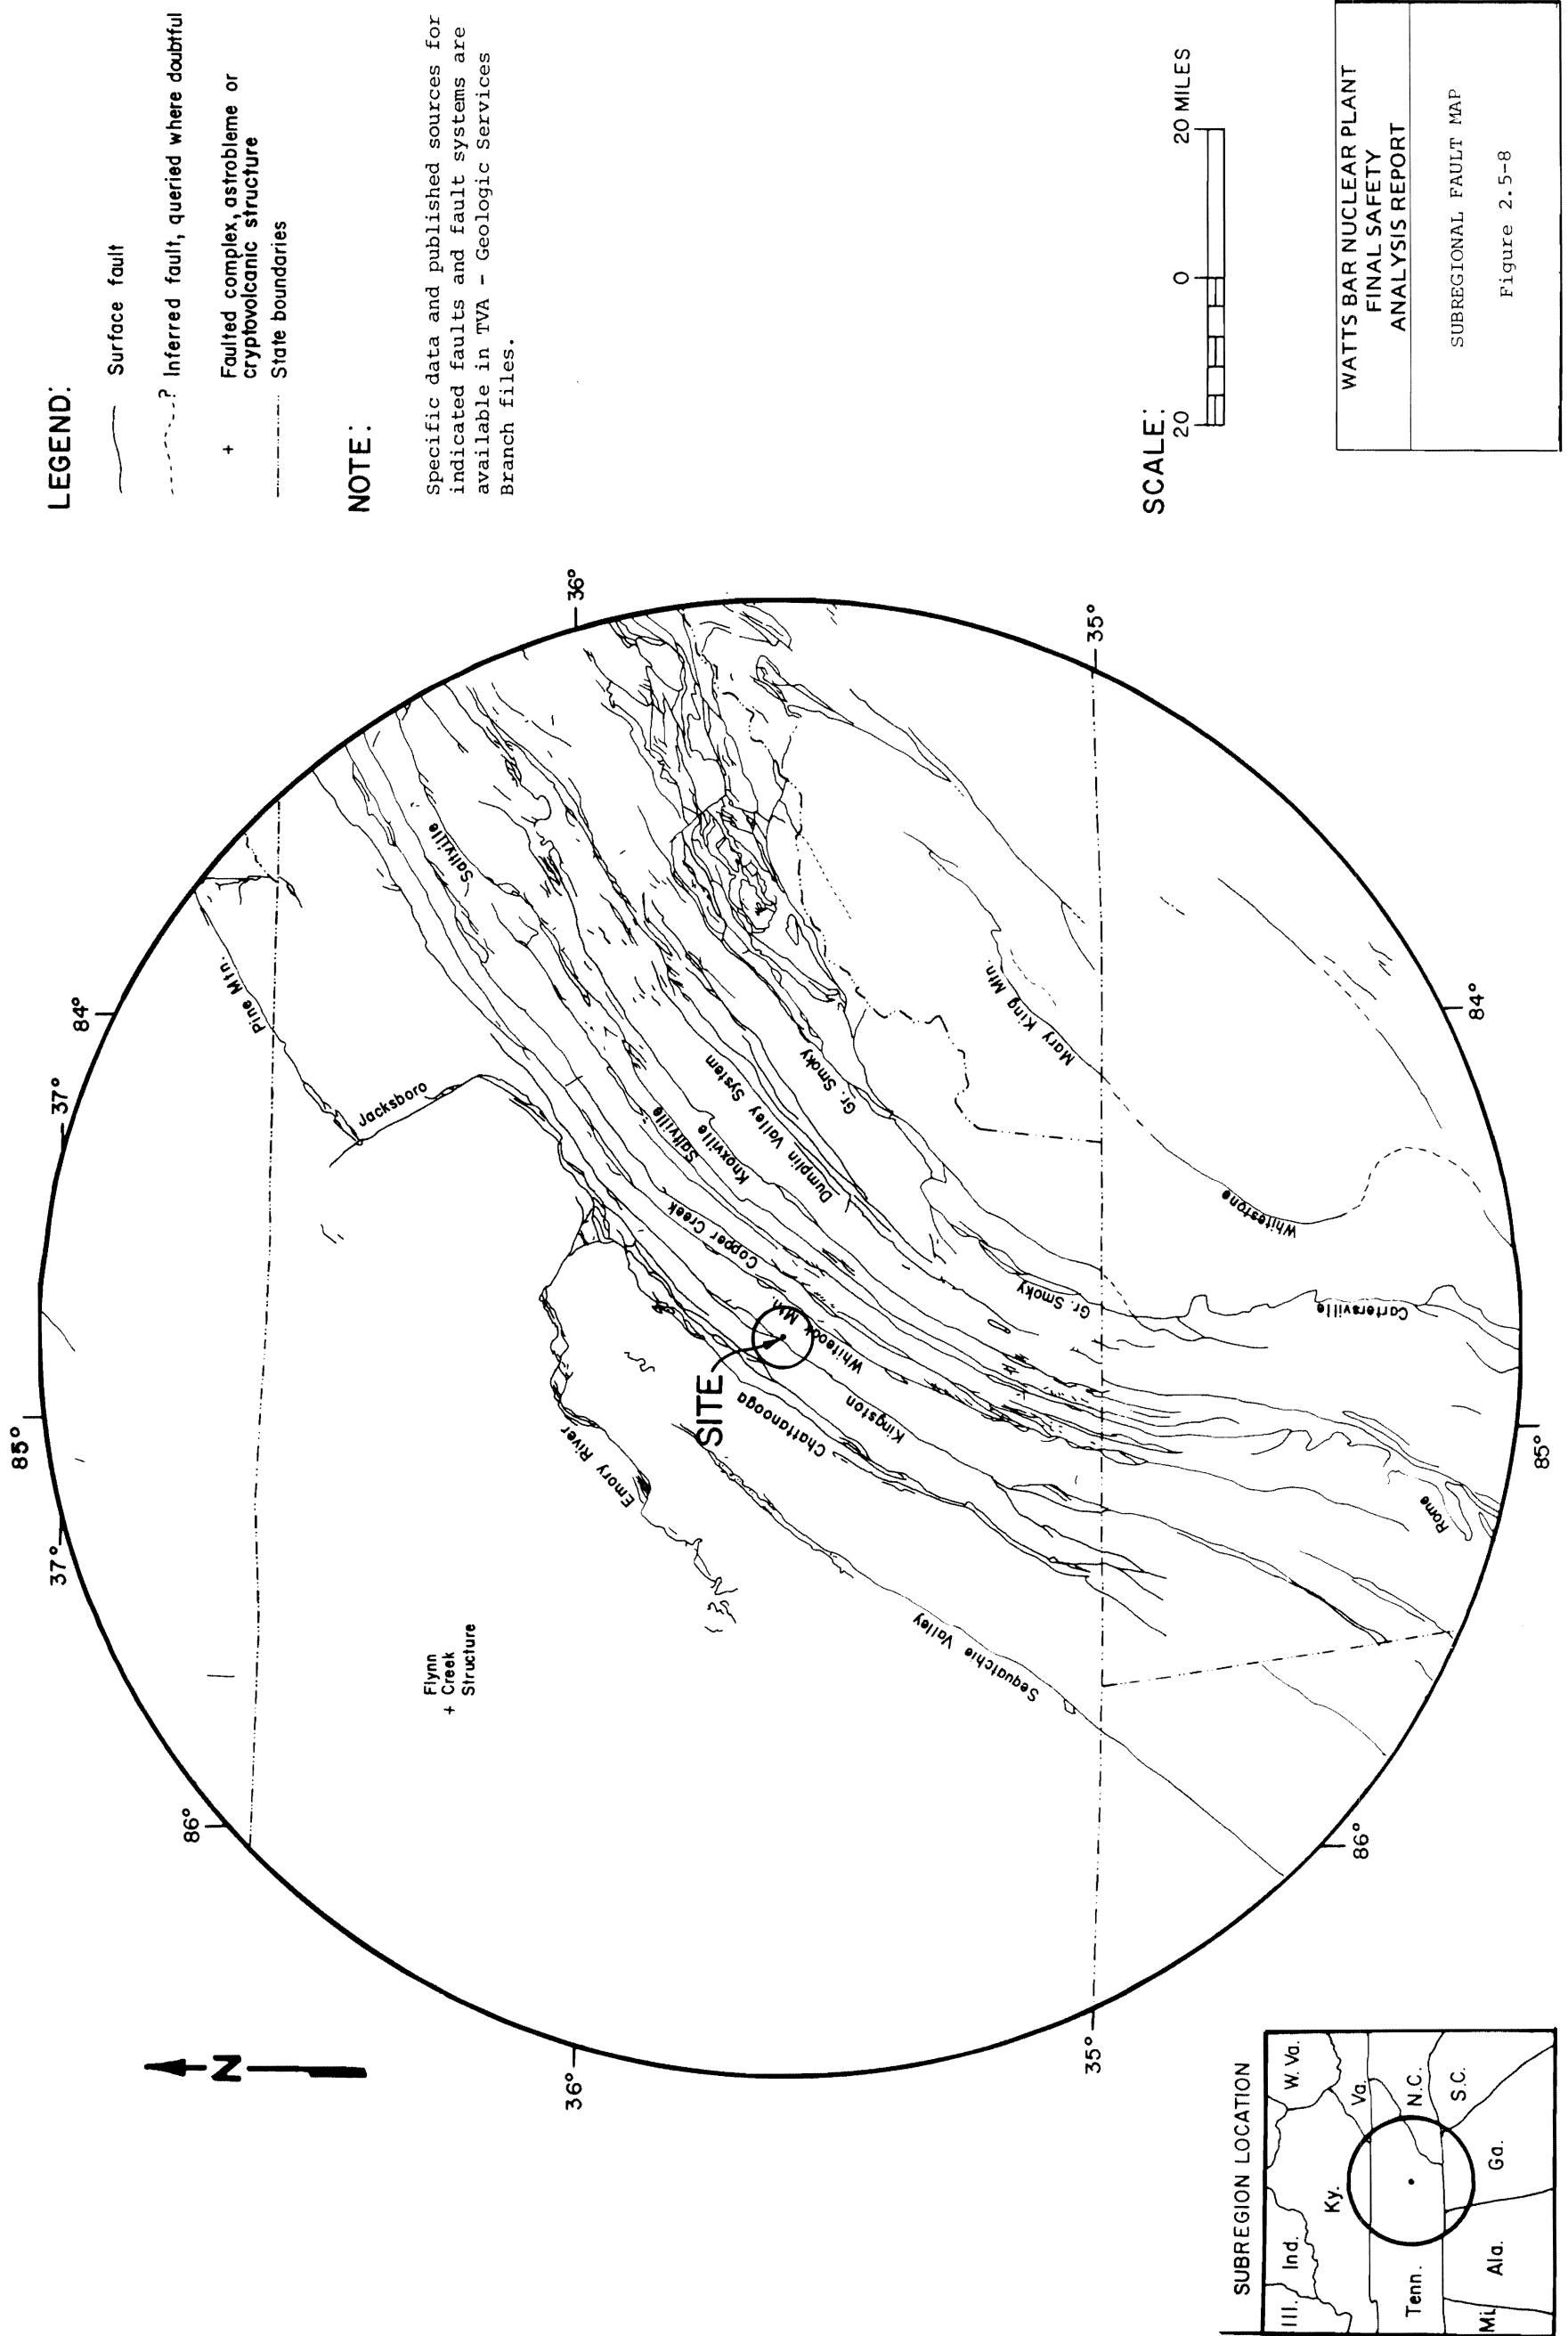


Figure 2.5-8 Subregional Fault Map

DESCRIPTION OF MAP UNITS

QUATERNARY
Qol ALLUVIUM--SOIL, SHALY TO SANDY, CONTAINS ABUNDANT PEBBLES AND CONCHES OF VARIOUS LITHOLOGIES AND TEXTURES, GENERALLY WATERBORN. MAPPED ONLY IN FLOOD PLAIN OF THE TENNESSEE RIVER.
Ql TERRAZE DEPOSITS--SOIL, SHALY TO SANDY, WITH ROUNDED PEBBLES AND CONCHES, GENERALLY STRATIFIED. REPRESENTS AT LEAST TWO EARLIER FLOOD PLAIN LEVELS OF THE TENNESSEE RIVER.
Sr ROCKWOOD FORMATION--SHALES, YELLOWISH-BROWN TO REDDISH WITH NUMEROUS THIN LAYERS OF YELLOW-SANDY TO GRAY SILTSTONE, AND A FEW THIN BEDS OF FINE-MAINED GRAY SANDSTONE. THICKNESS ABOUT 200 FEET.
Och OUCHAWAGA LIMESTONE--LIMESTONE, LIGHT- TO MEDIUM-GRAY, SLABBY TO MEDIUM-BEDDED; SHALE LIMESTONE ABUNDANT. ESTIMATED THICKNESS 1000 FEET.
Ock ROCK GROUP--DOLMITE, LIGHT- TO DARK-GRAY, FINE- TO COARSE-MAINED; AND LIMESTONE, MEDIUM-TO BULKY-GRAY, GENERALLY FINE-MAINED. THIN- TO THICK-BEDDED. WEATHERS TO CHERRY RUBBLE. THICKNESS ABOUT 2600 FEET.
Ec COMAUGA GROUP--SHALES, CALCAREOUS IN UPPER PART, BECOMING ARGILLACEOUS AND SILTY TOWARD BASE; ZONES OF SHALY GRAY LIMESTONE, AS MUCH AS 100 FEET THICK, SCATTERED THROUGHOUT BUT CONCENTRATED IN UPPER HALF. ESTIMATED THICKNESS AS HIGH AS 2000 FEET.
Cr ROCK FORMATION--SHALES, SILTSTONE, AND SANDSTONE WITH LOCAL BEDS OF GRAY LIMESTONE NEAR BASE. SHALES VARIATED, REDDISH AND GREENISH, MICACEOUS, AND ARGILLACEOUS. NUMEROUS THIN SILTSTONE LAYERS. SANDSTONE BEDS GENERALLY FINE-MAINED, THIN- TO MEDIUM-BEDDED. BASE NOT EXPOSED; ESTIMATED THICKNESS 1000 FEET.

GEOLOGIC SYMBOLS

--- CONTACT, APPROXIMATELY LOCATED, DOTTED WHERE CONCEALED
 - - - - - FAULT, APPROXIMATELY LOCATED, DOTTED WHERE CONCEALED, — ON HANGING WALL OF THRUST FAULT
 STRIKE AND DIP OF BEDS
 + SYMCLING, SHOWING STRIKE OF AXIAL PLANE
 + RIGID ANTICLINE, SHOWING STRIKE OF AXIAL PLANE

NOTES:
 (1) MAP CONSISTS OF TWO SLIGHTLY OVERLAPPING NORTH AND SOUTH SEGMENTS THAT MATCH ALONG THE INDICATED LINE. CROSS SECTION A-A EXTENDS ACROSS BOTH SEGMENTS. SEE PROFILE AS GEOLOGIC SECTION THROUGH PLANT AREA (PLATE 2.5-10).
 (2) GEOLOGIC MAP BY TNA BASED ON FIELD DATA FROM THE SPRING CITY (GR 118-HE) AND THE WATTS BAR (GR 120-HE) SHEETS OF THE GEOLOGIC MAP OF EAST TENNESSEE (ROBBERSON, 1953).
 (3) RECONSTRUCTION OF MAP UNITS AND GEOLOGIC SYMBOLS REPRESENT A COMPOSITE LEGEND FOR BOTH NORTH AND SOUTH SEGMENTS.



WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 GEOLOGIC MAP OF PLANT AREA
 (NORTH SEGMENT)
 Figure 2.5-9


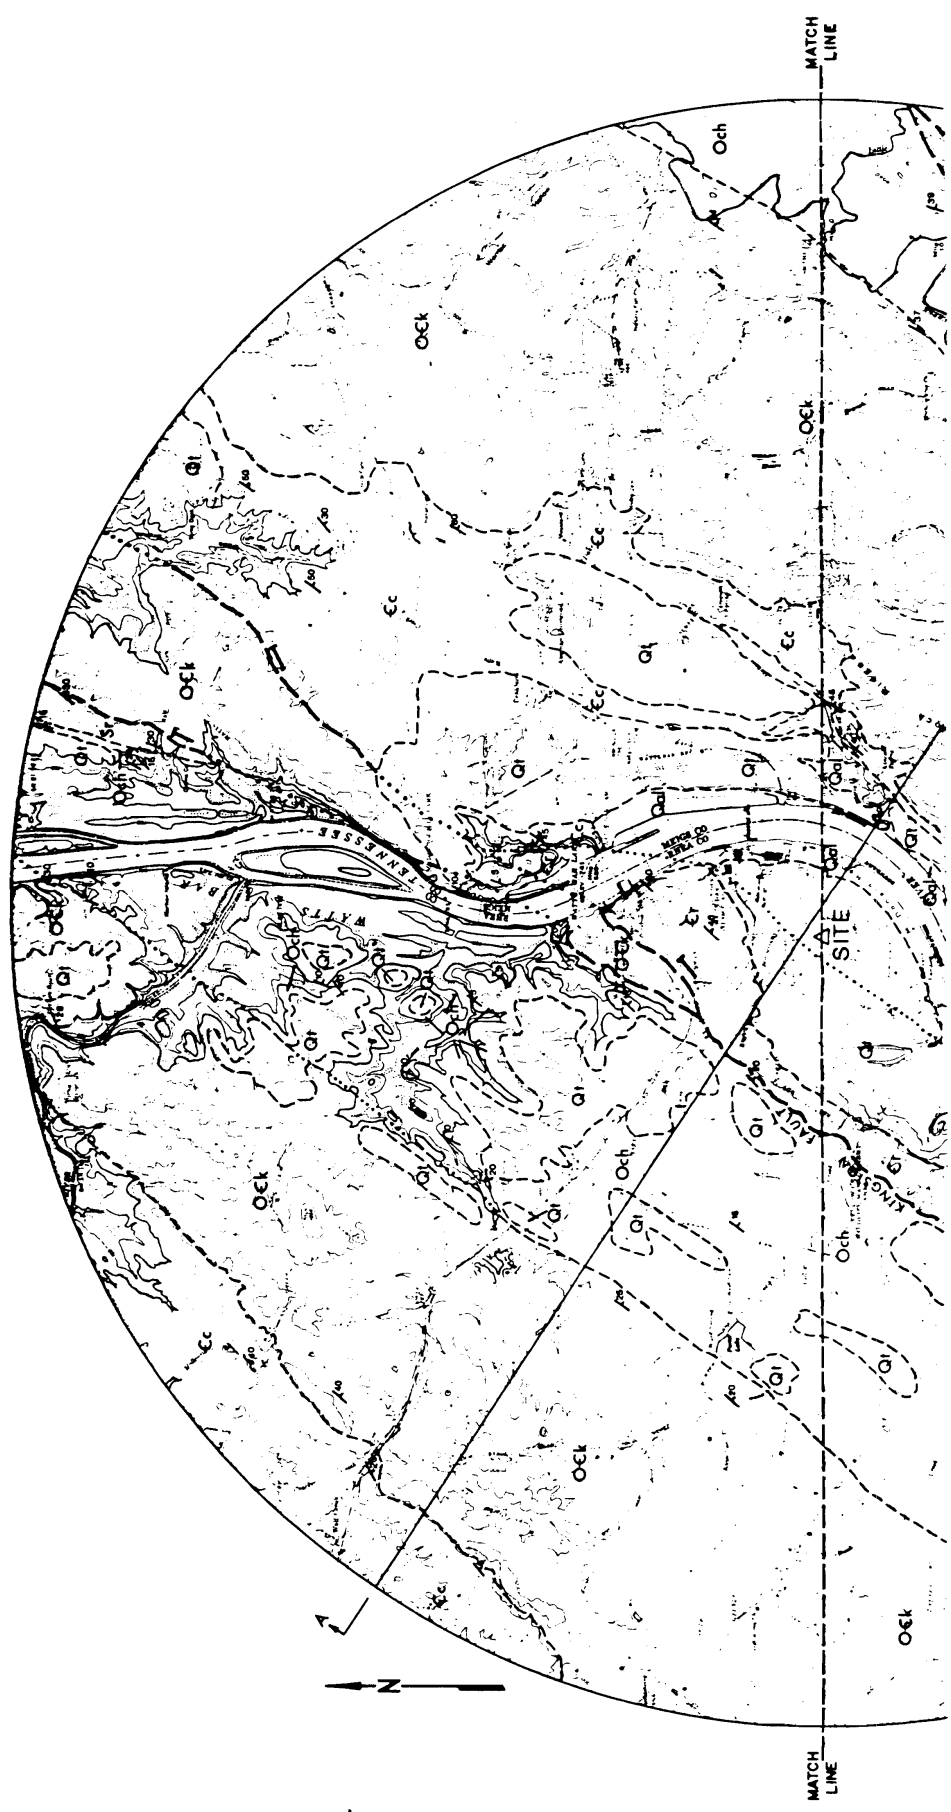


Figure 2.5-9 Geologic Map Of Plant Area (North Segment)

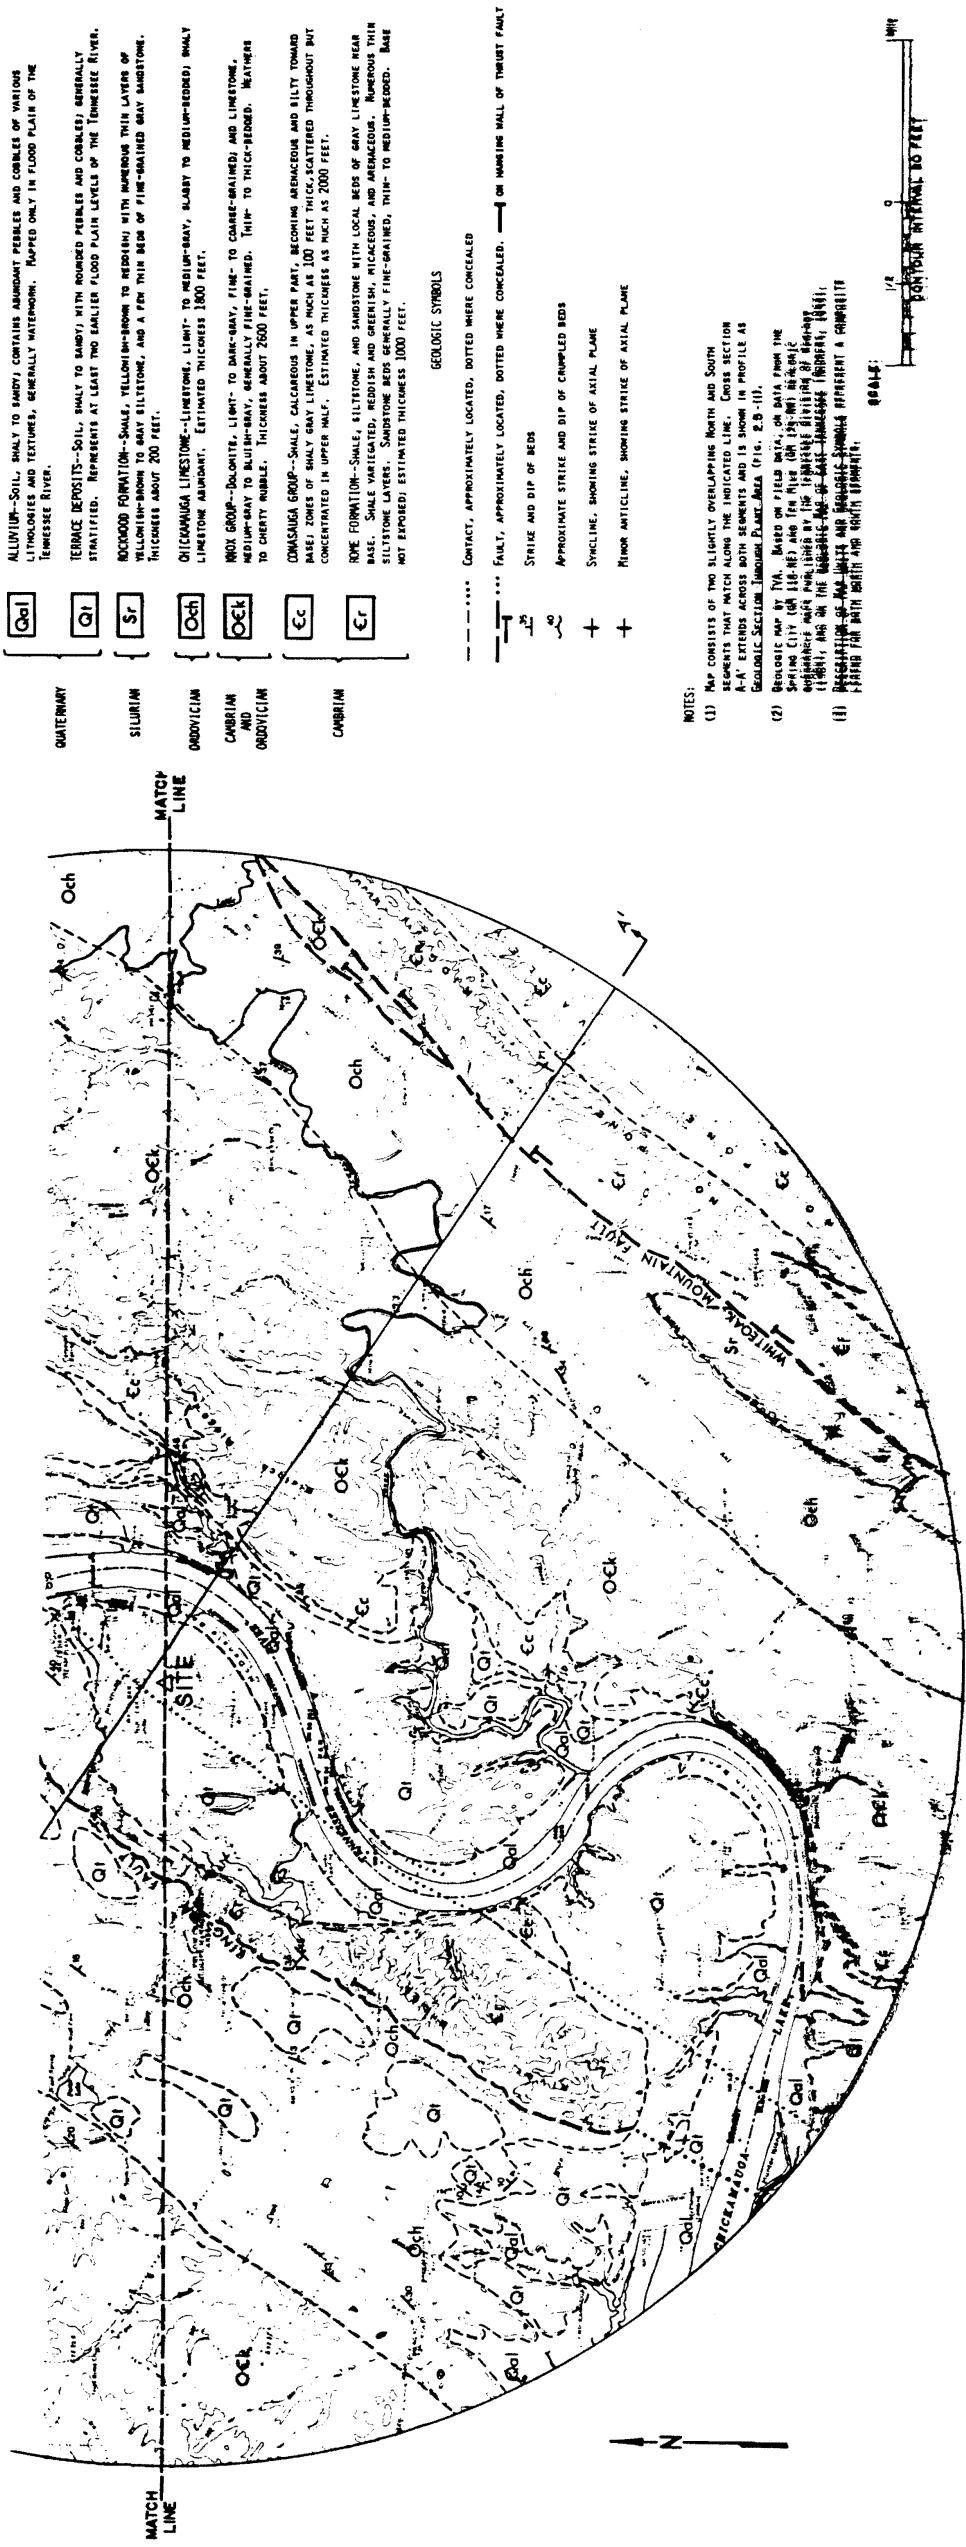

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 GEOLOGIC MAP OF PLANT AREA
 (SOUTH SEGMENT)
 Figure 2.5-10

Figure 2.5-10 Geologic Map of Plant Area (South Segment)

Figure 2.5-11 Geologic Section Through Plant Area (Actual Figure Located in Oversized Figures File)

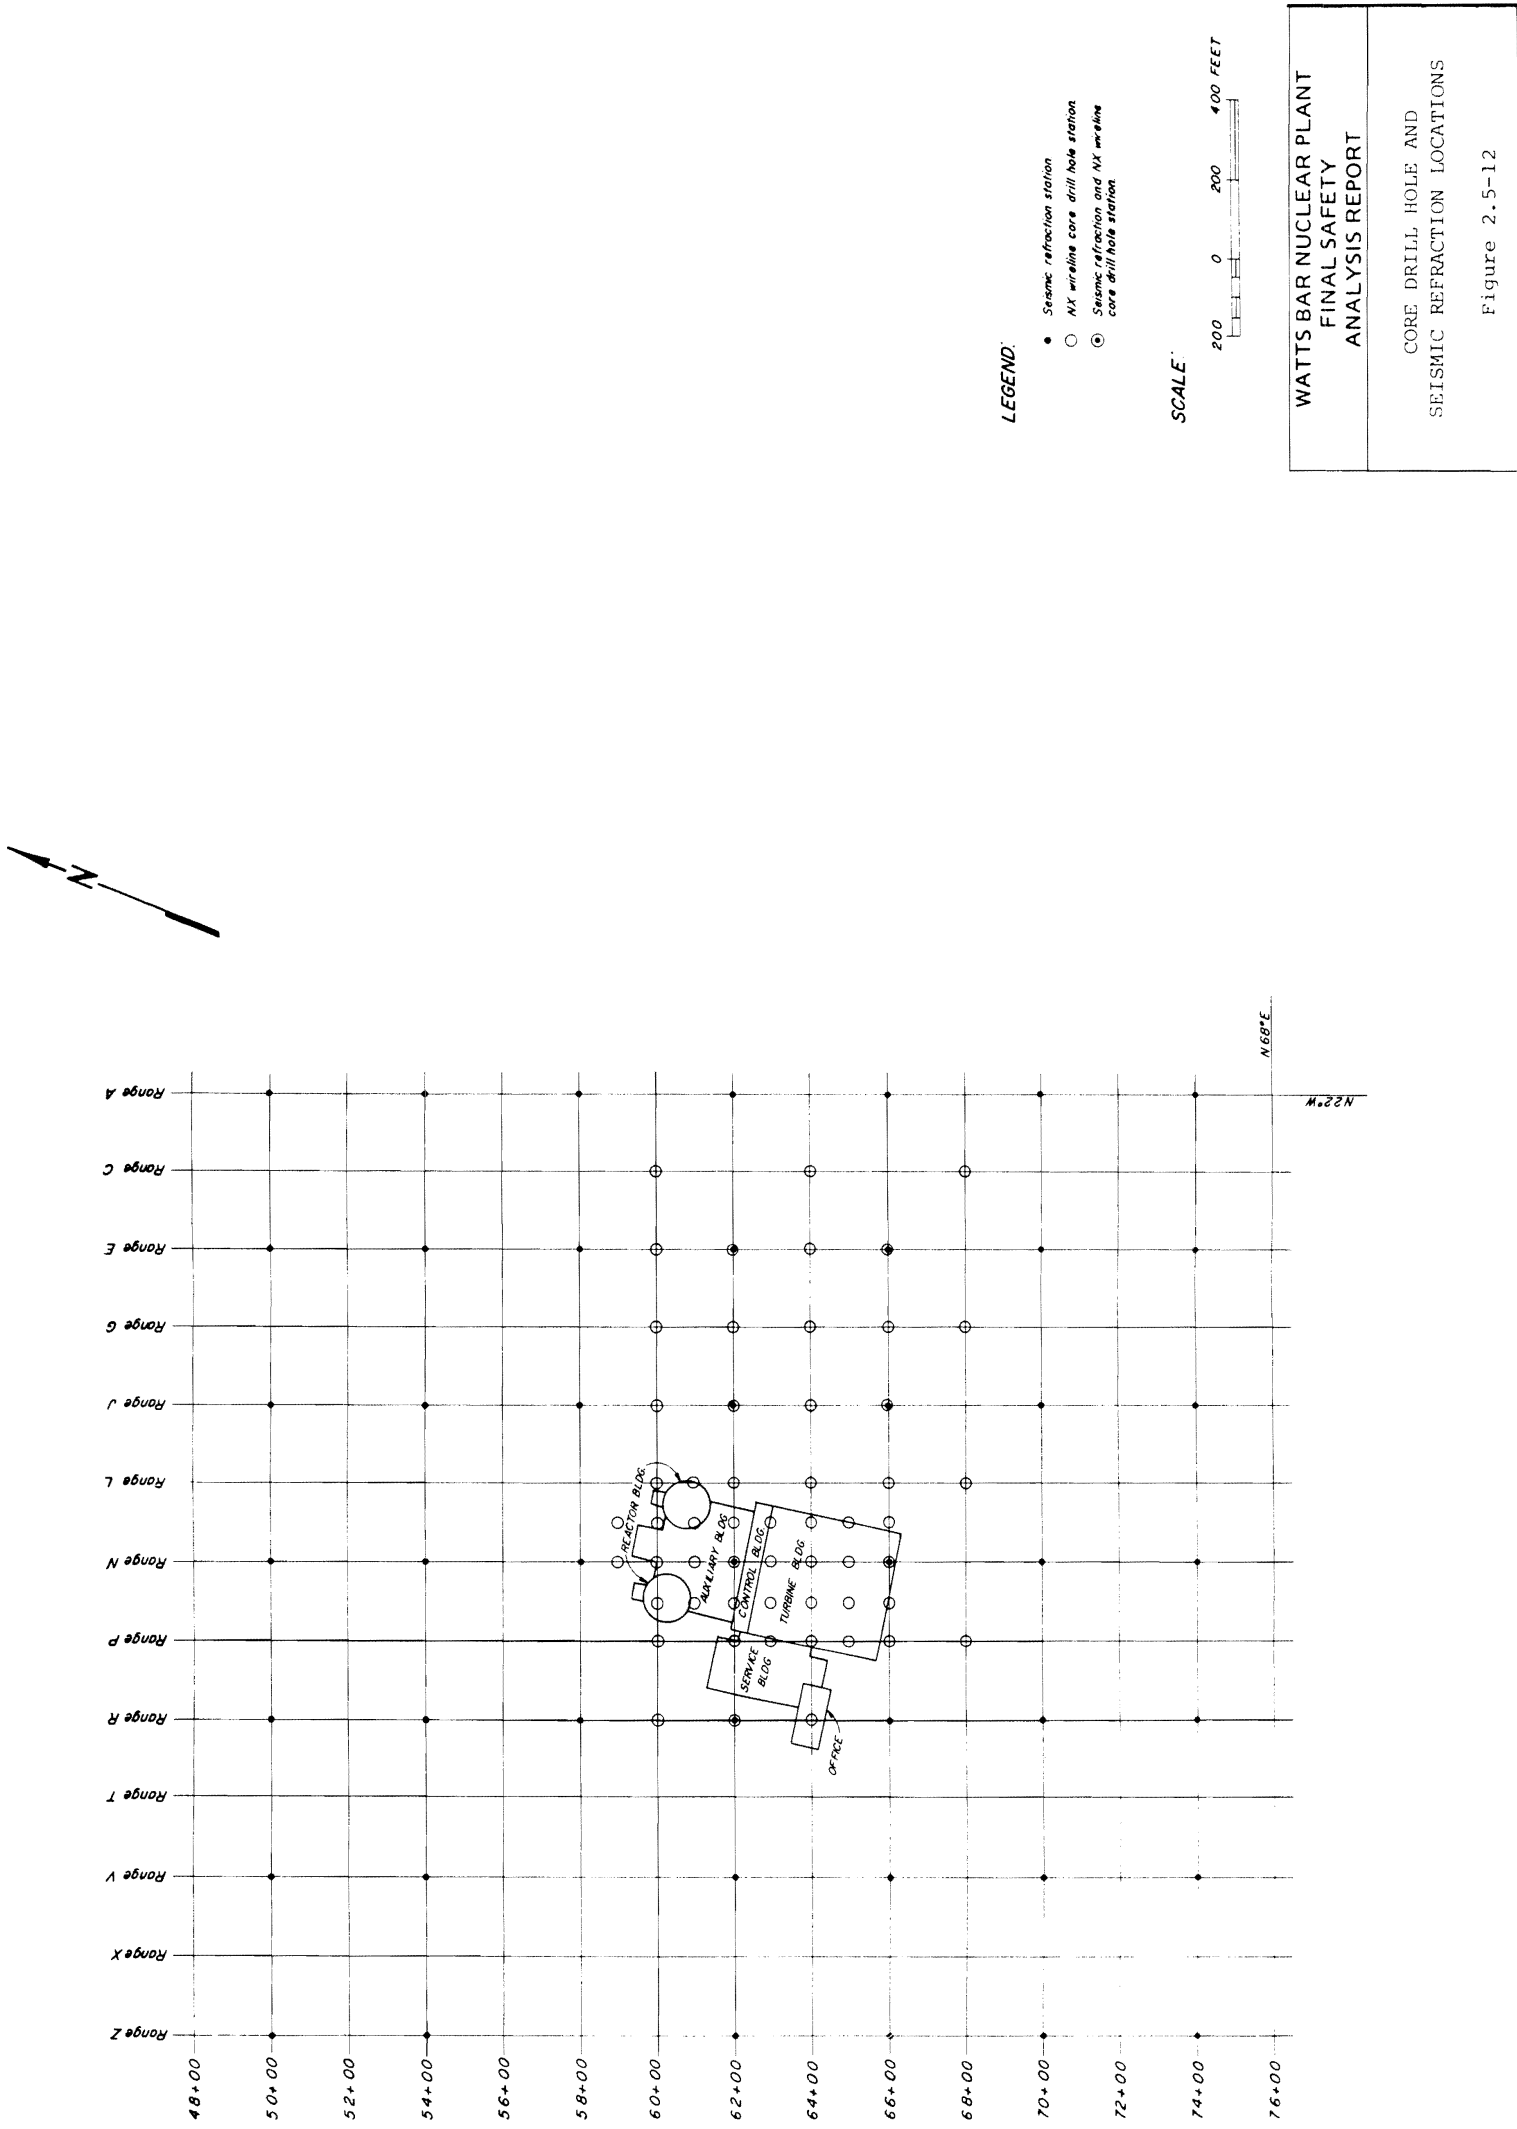


Figure 2.5-12 Core Drill Hole and Seismic Refraction Locations

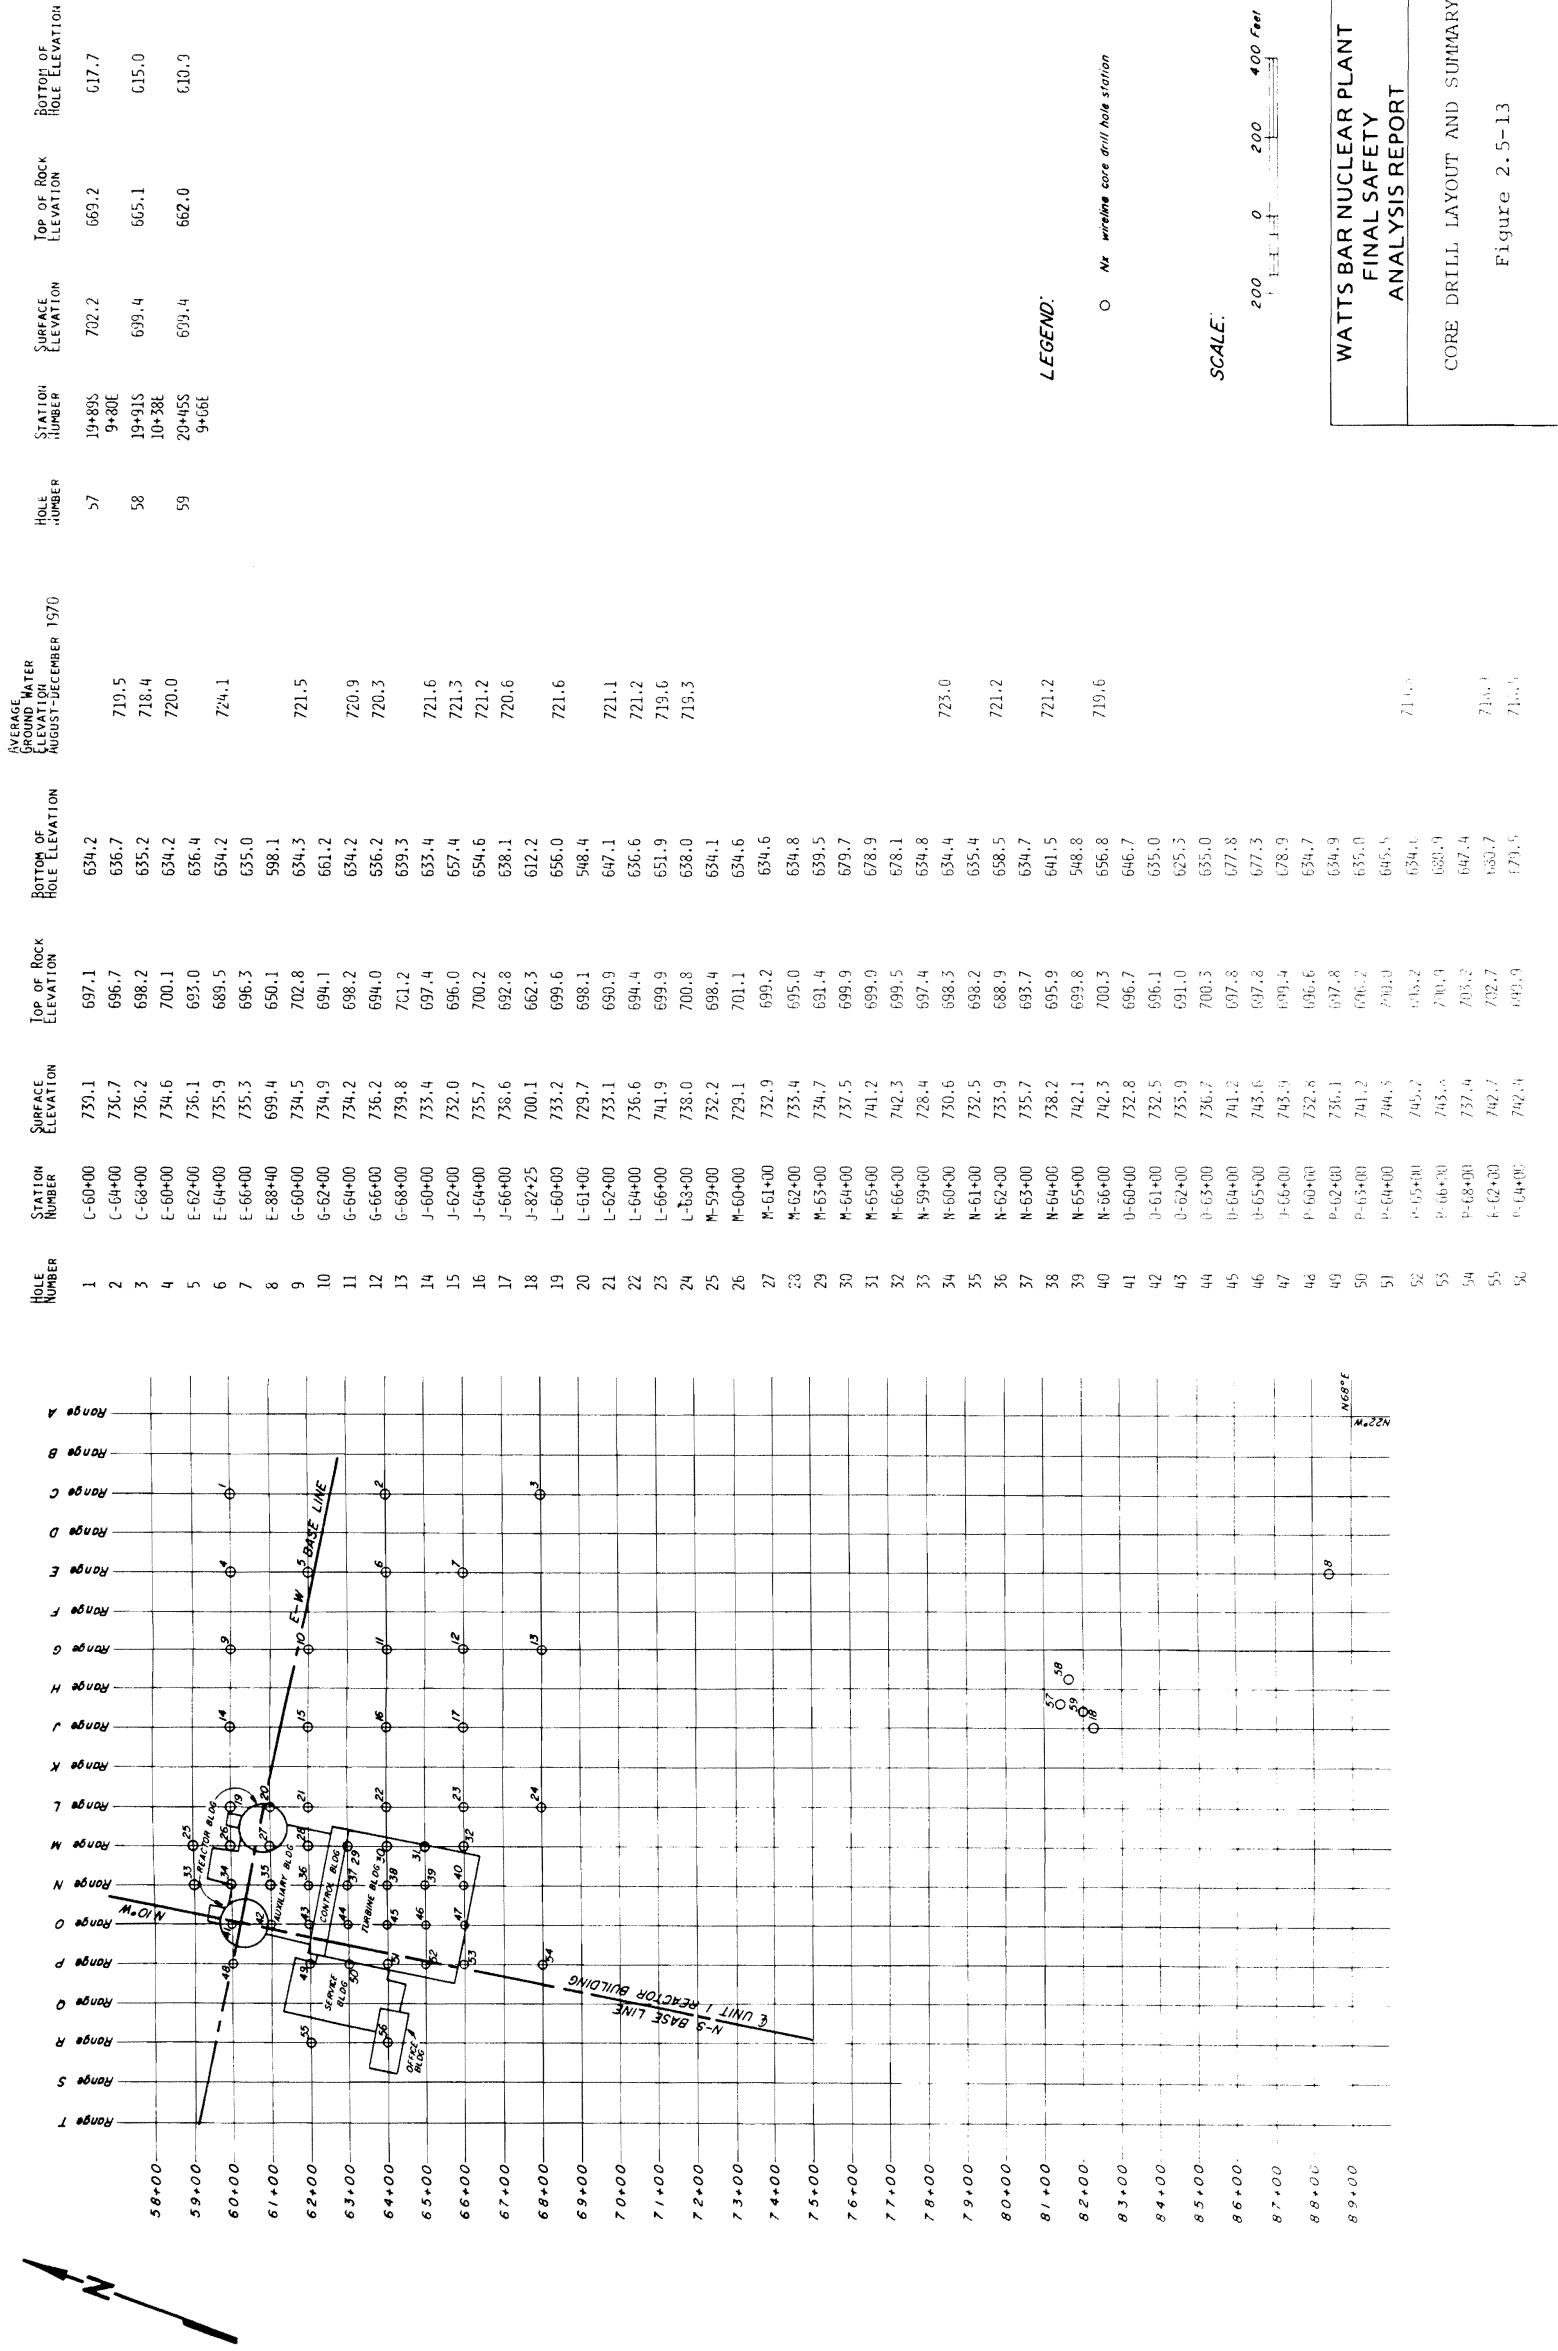


Figure 2.5-13 Core Drill Layout and Summary


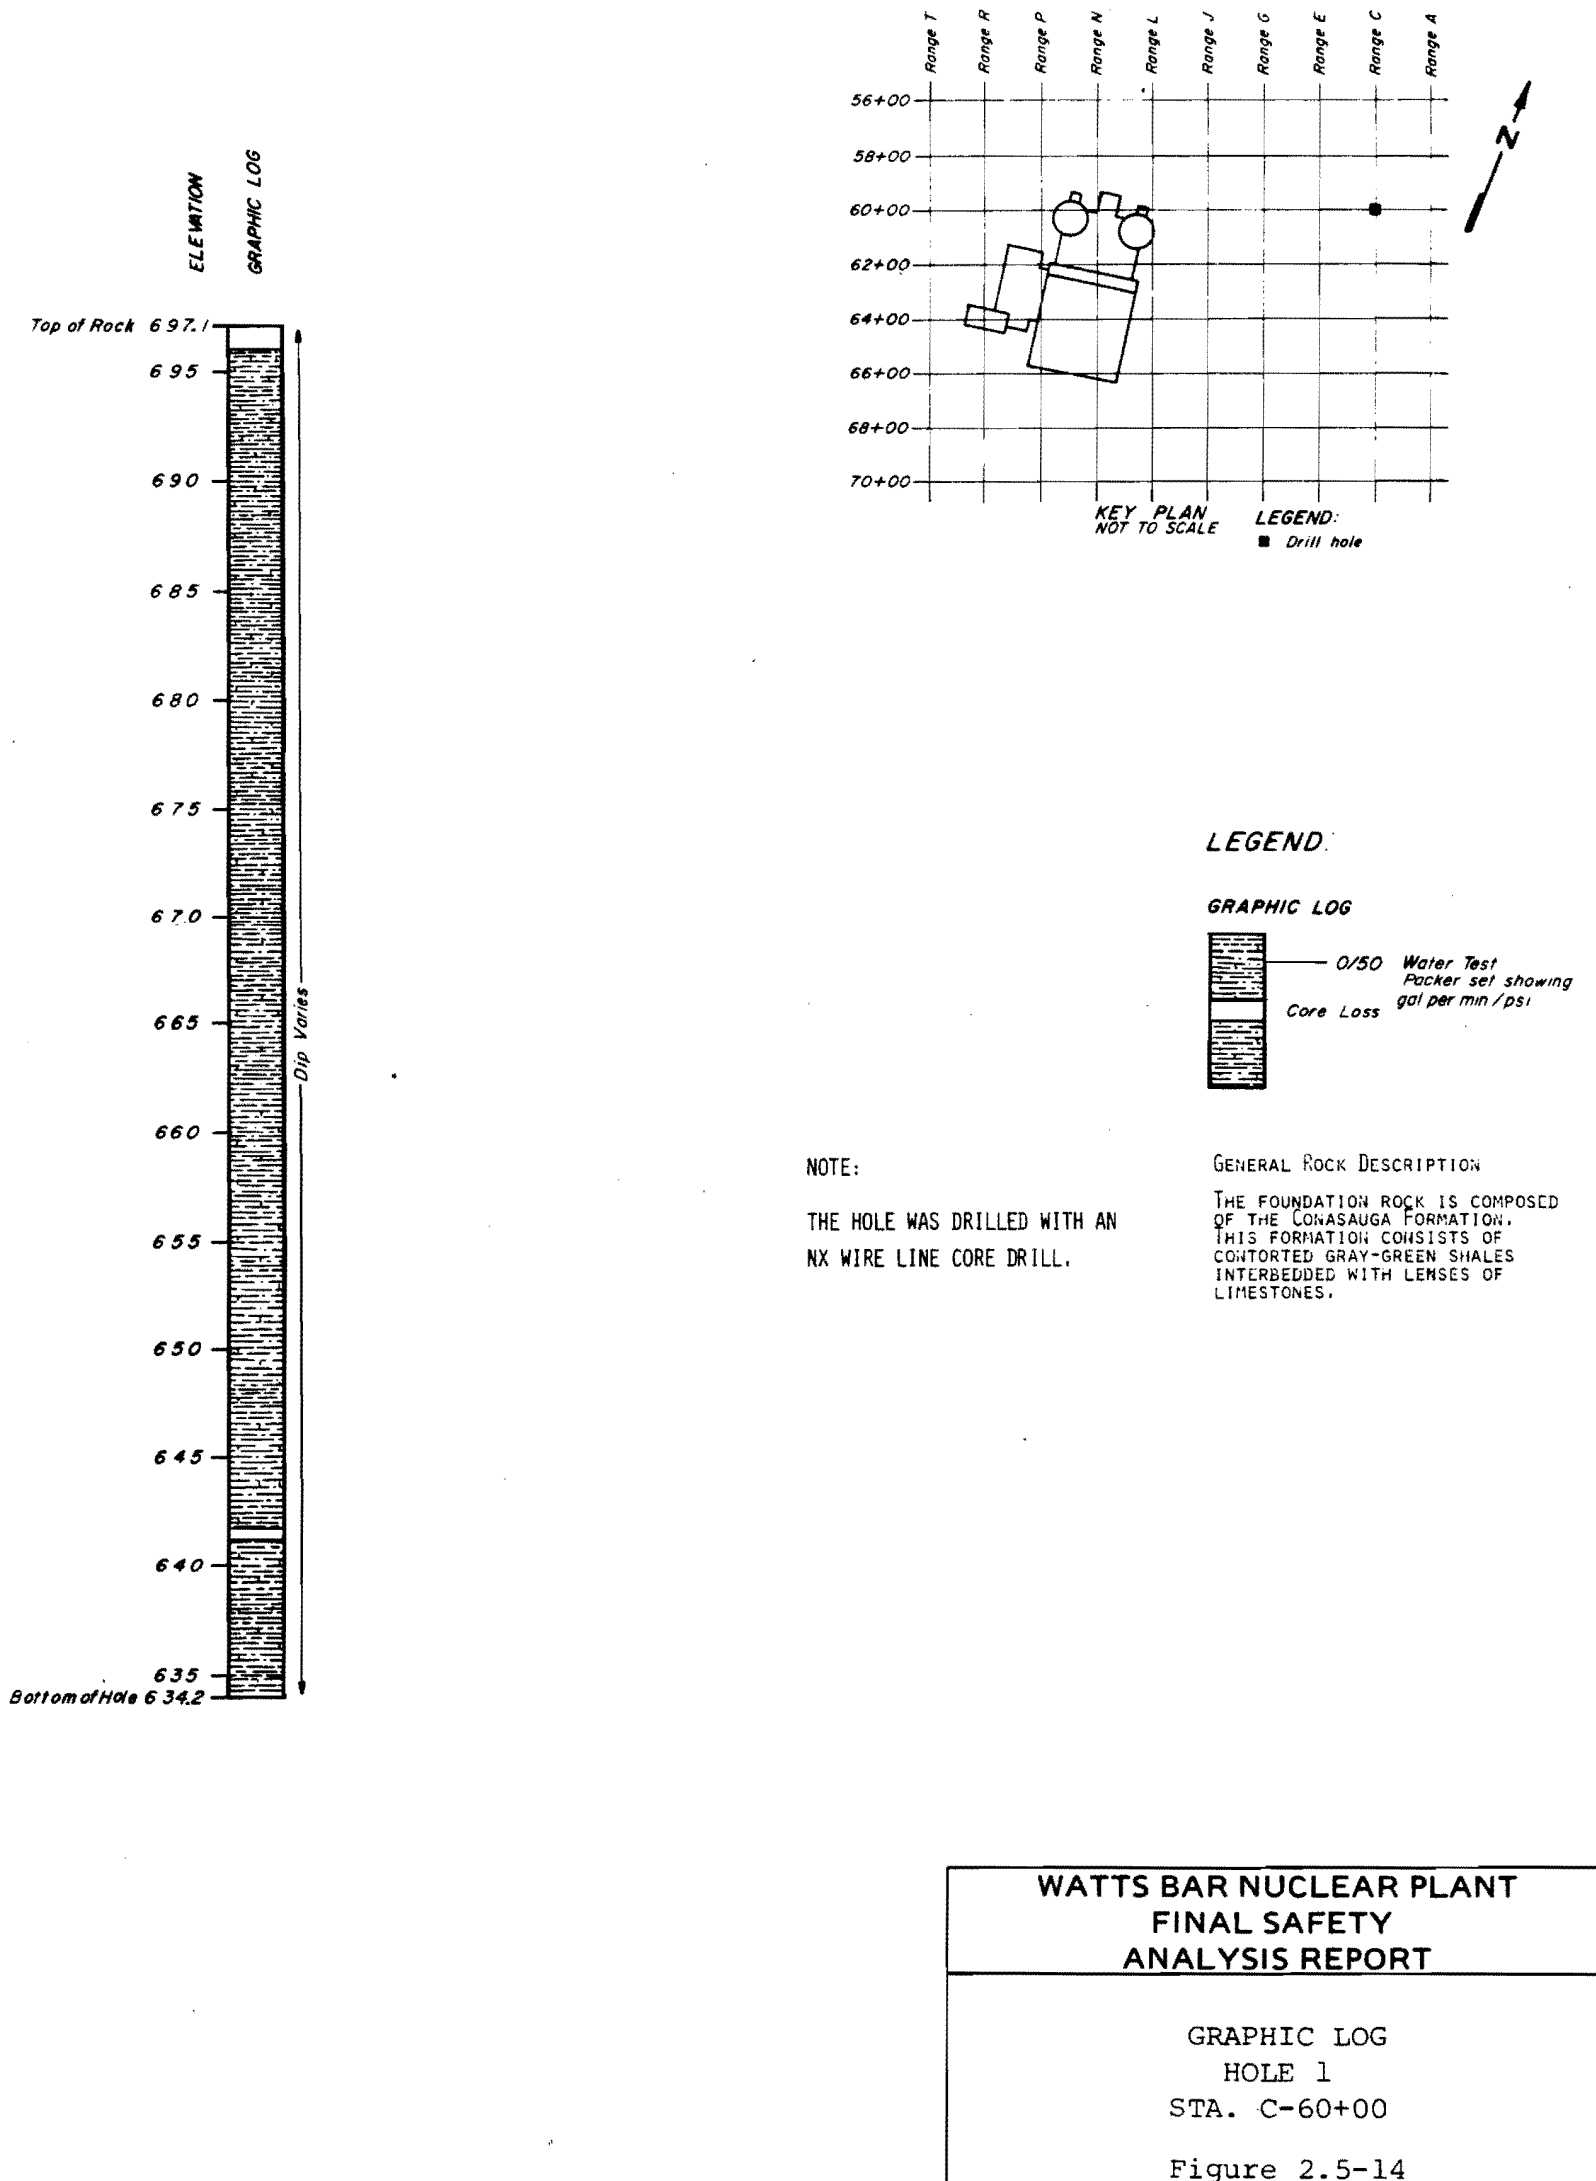


Figure 2.5-14 Graphic Log Hole 1 Sta. C-60+00

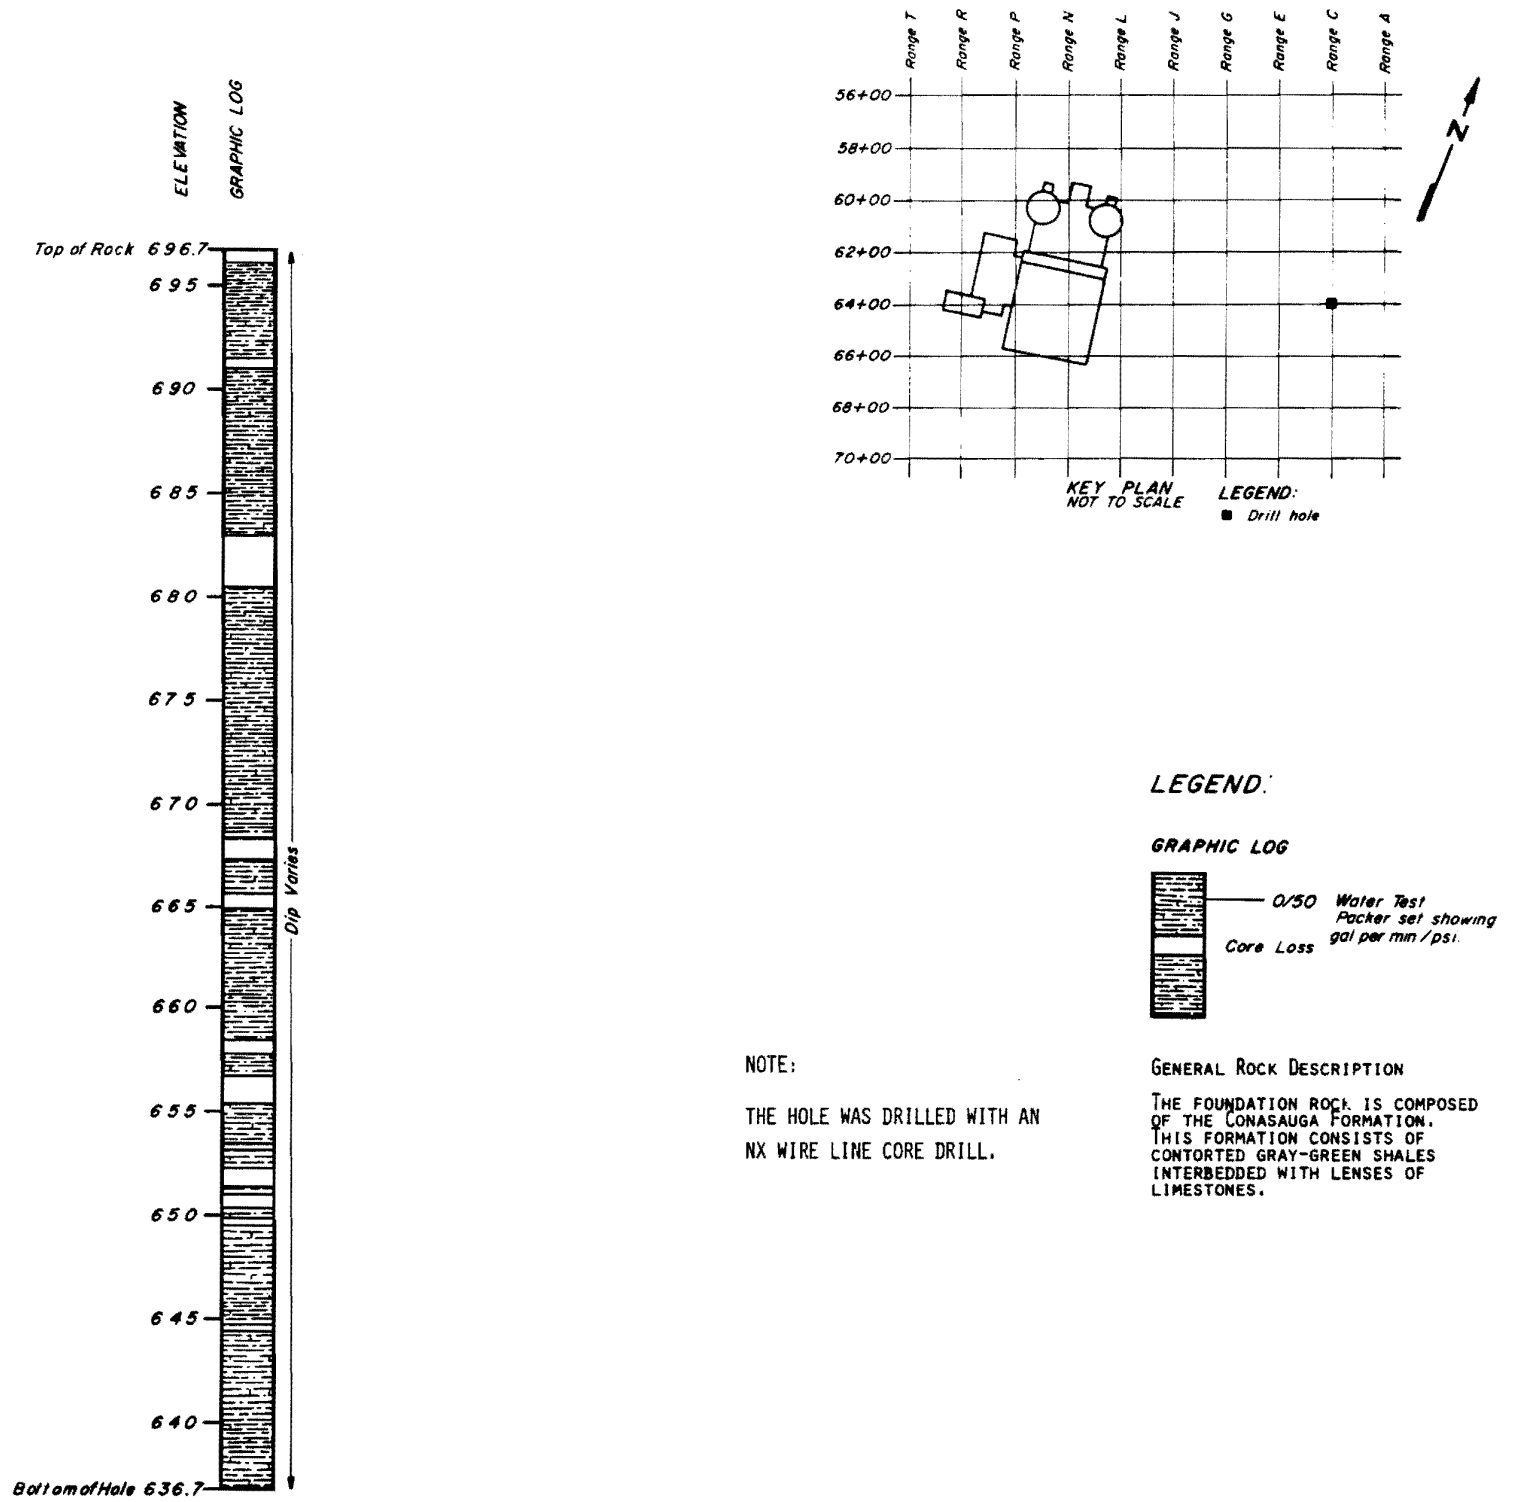


**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 2
STA. C-64+00

Figure 2.5-15

Figure 2.5-15 Graphic Log Hole 2 Sta. C-64+00

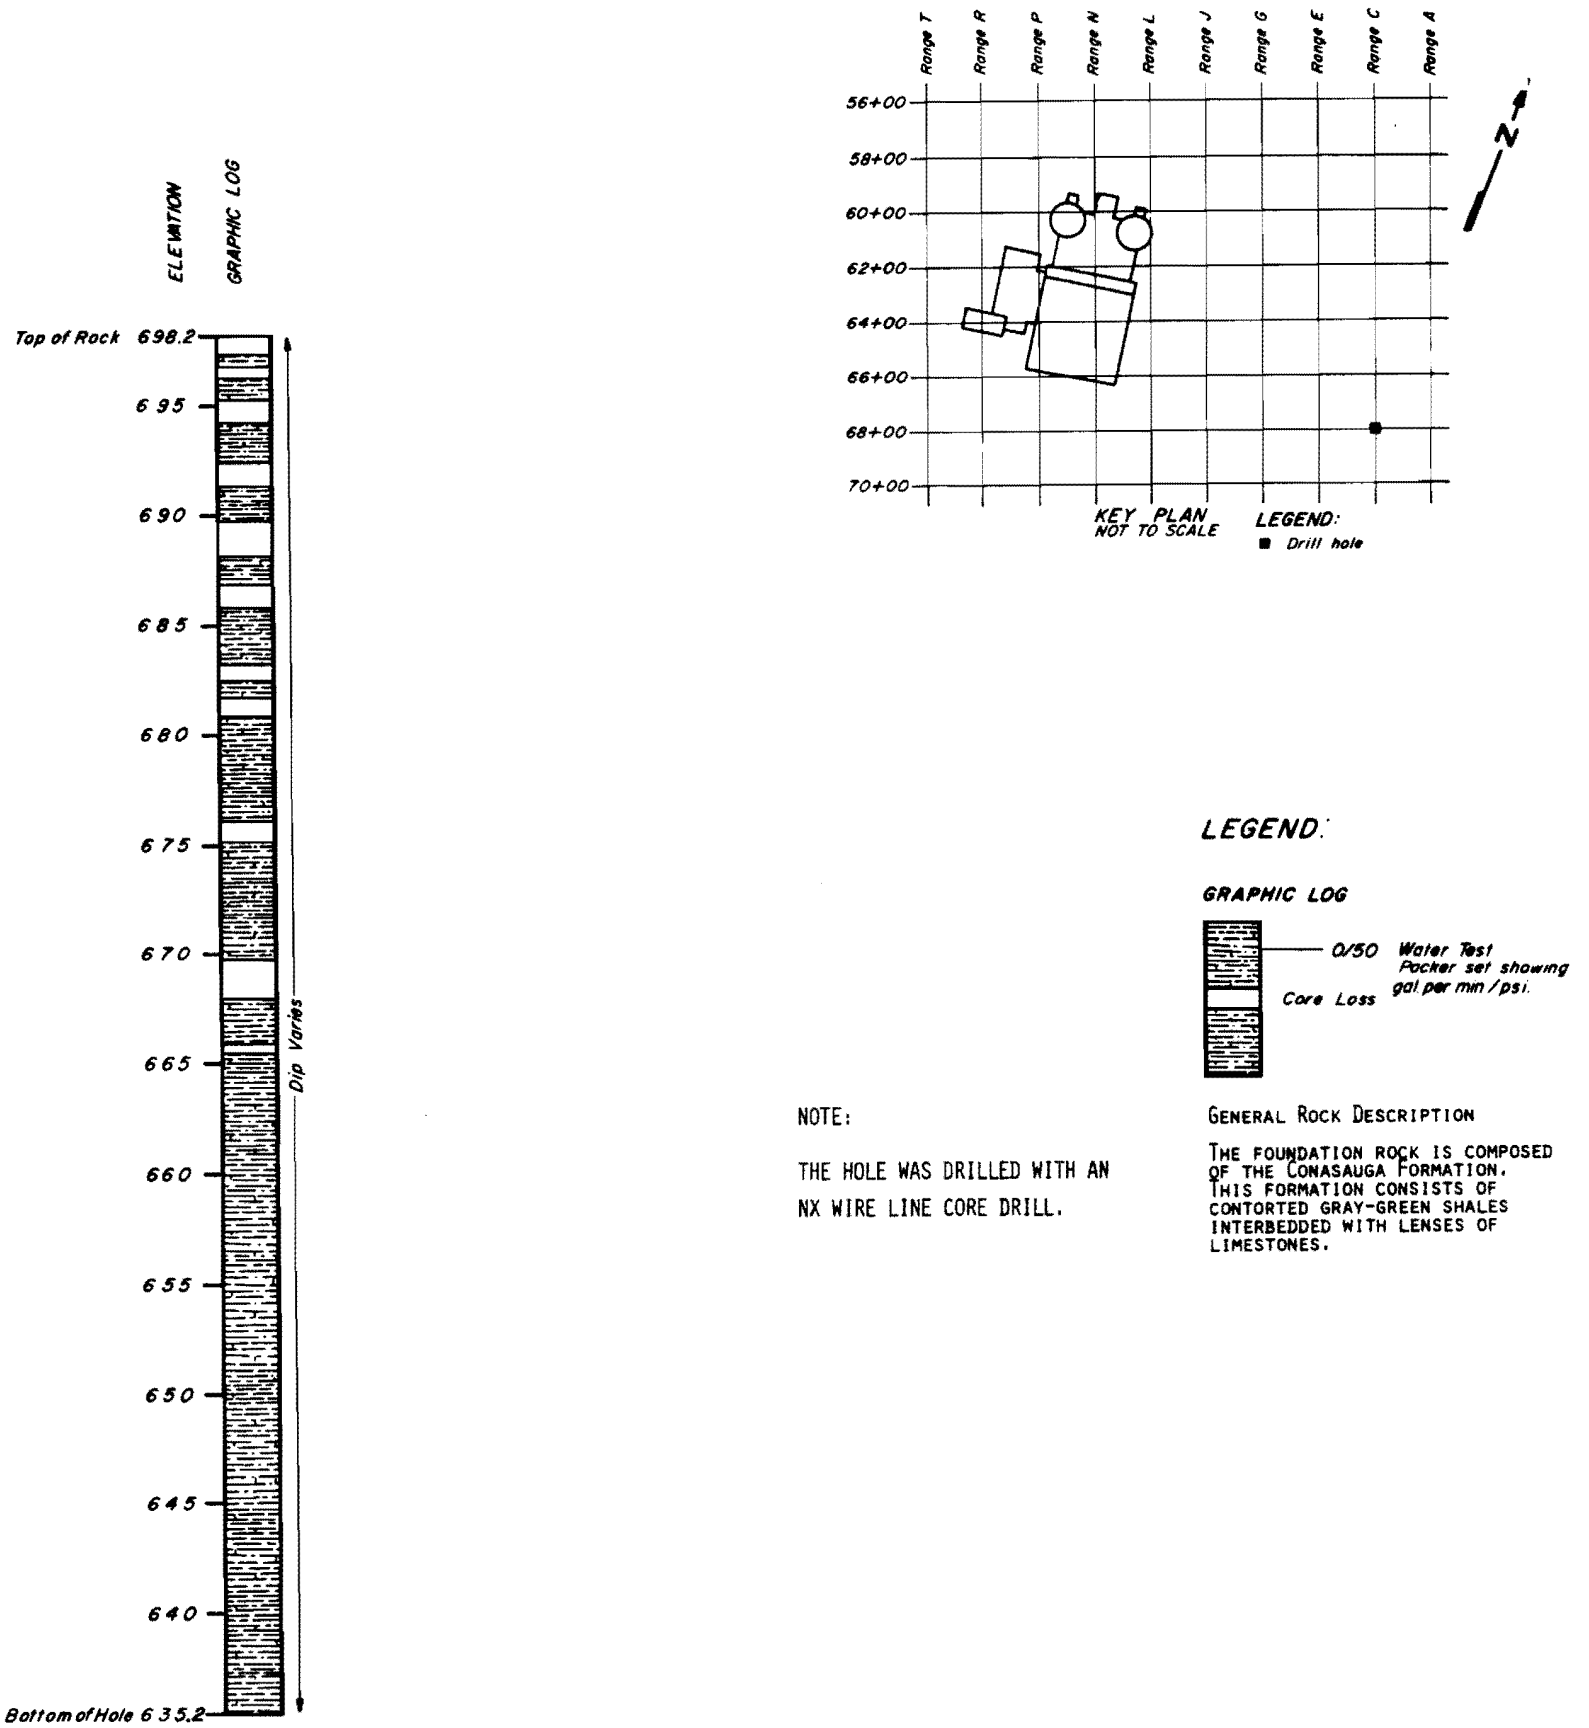


**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 3
STA. C-68+00

Figure 2.5-16


Figure 2.5-16 Graphic Log Hole 3 Sta. C-68+00

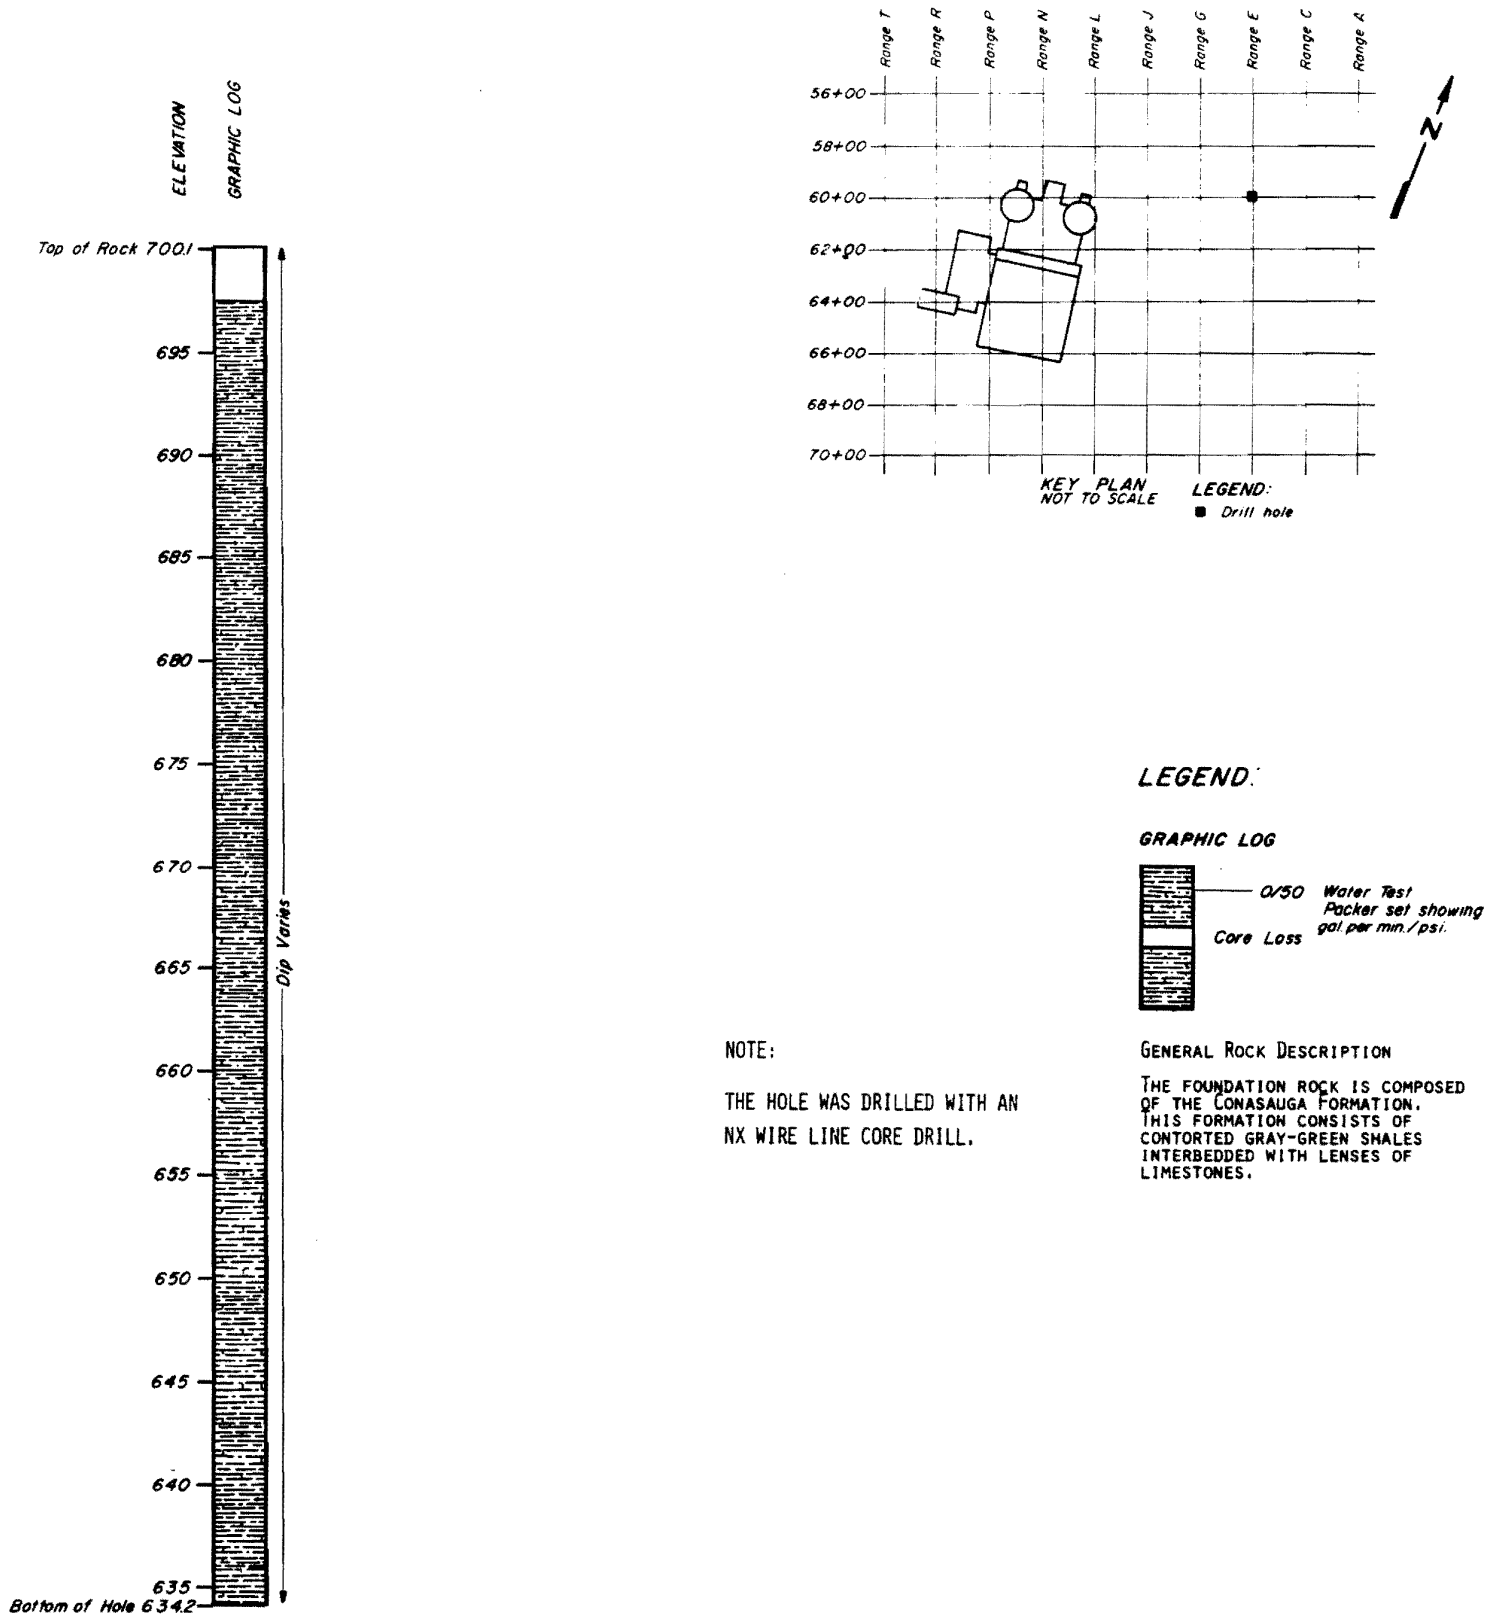

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 4
STA. E-60+00
Figure 2.5-17


Figure 2.5-17 Graphic Log Hole 4 Sta. E-60+00

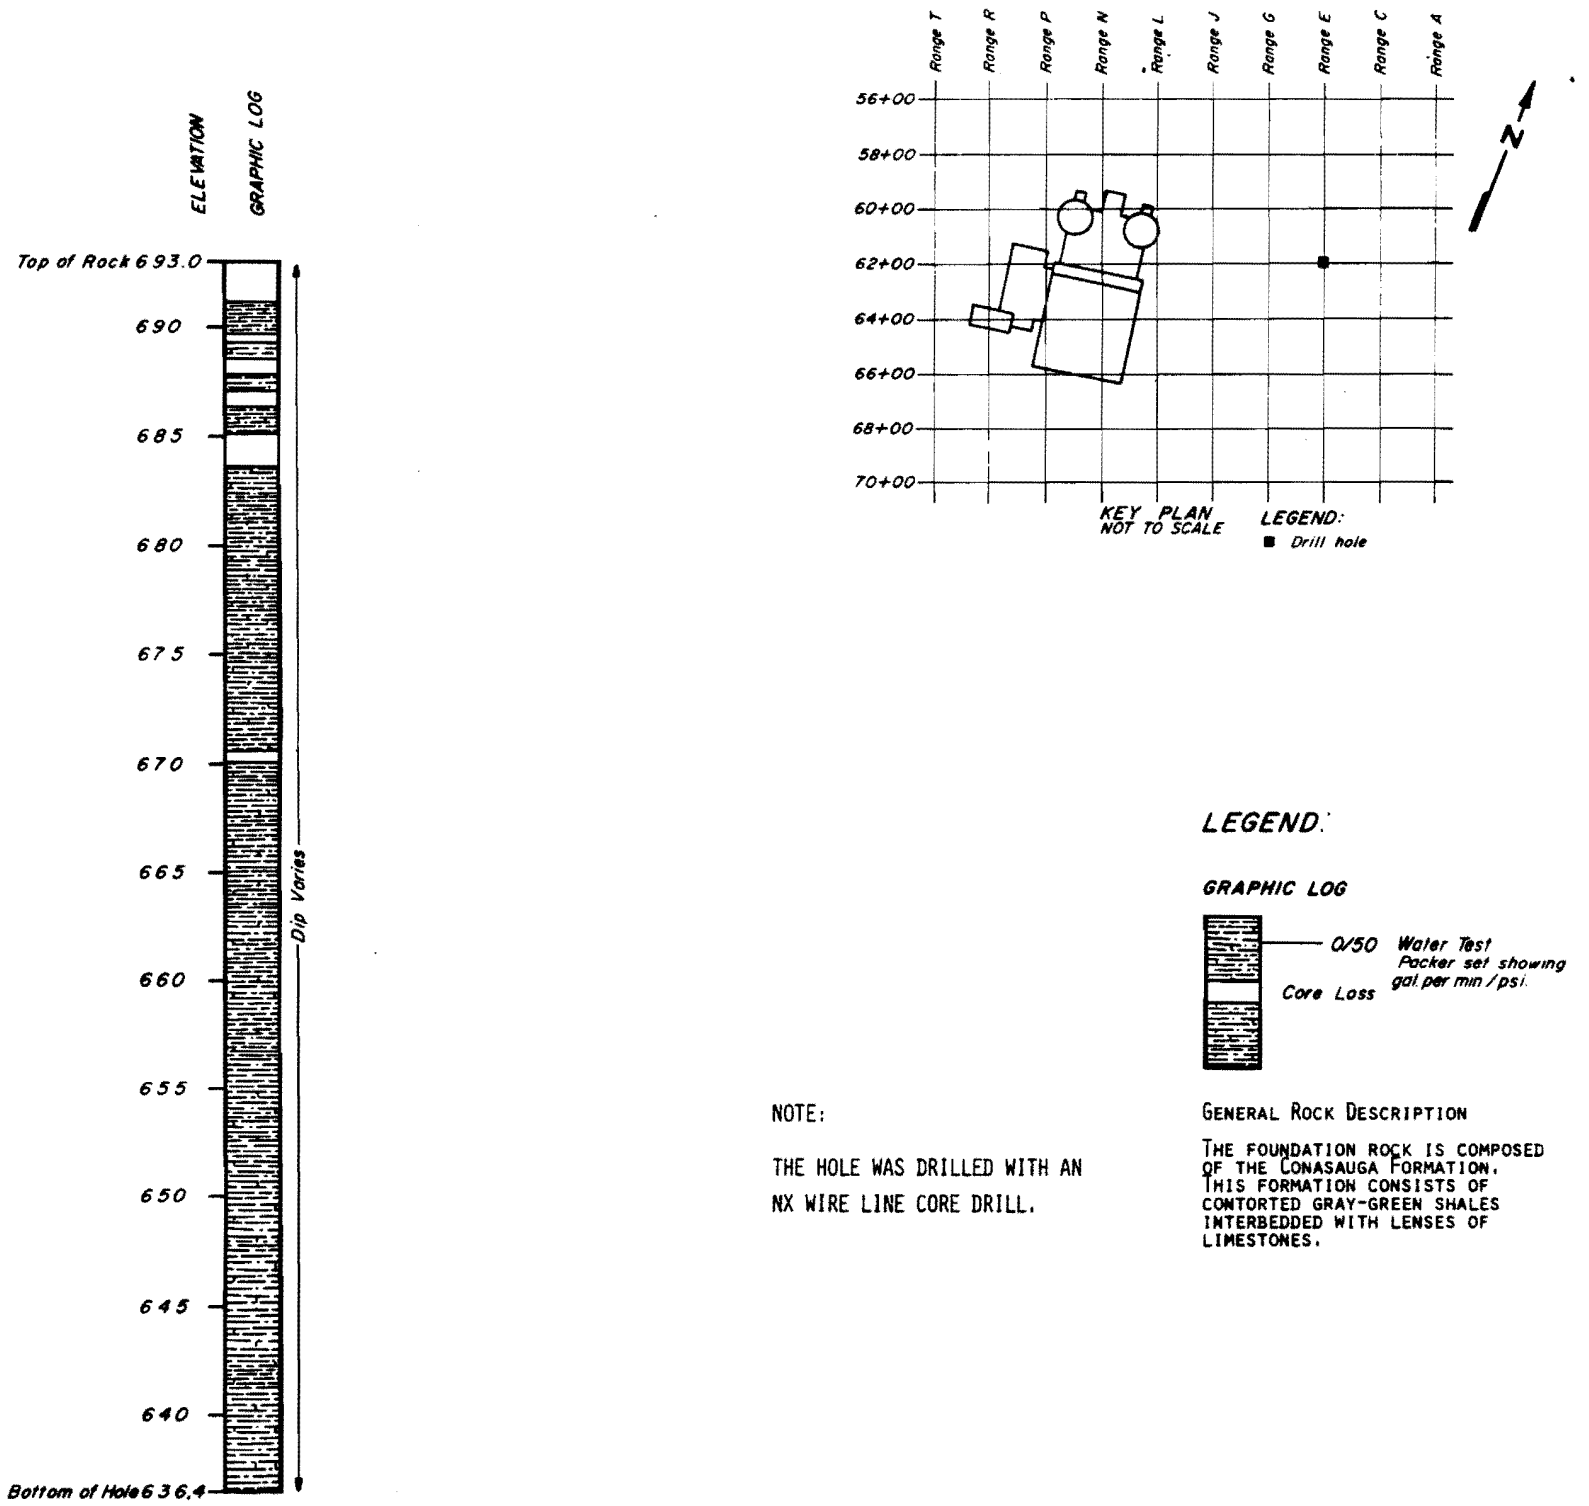

**WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT**

GRAPHIC LOG
 HOLE 5
 STA. E-62+00
 Figure 2.5-18


Figure 2.5-18 Graphic Log Hole 5 Sta. E-62+00

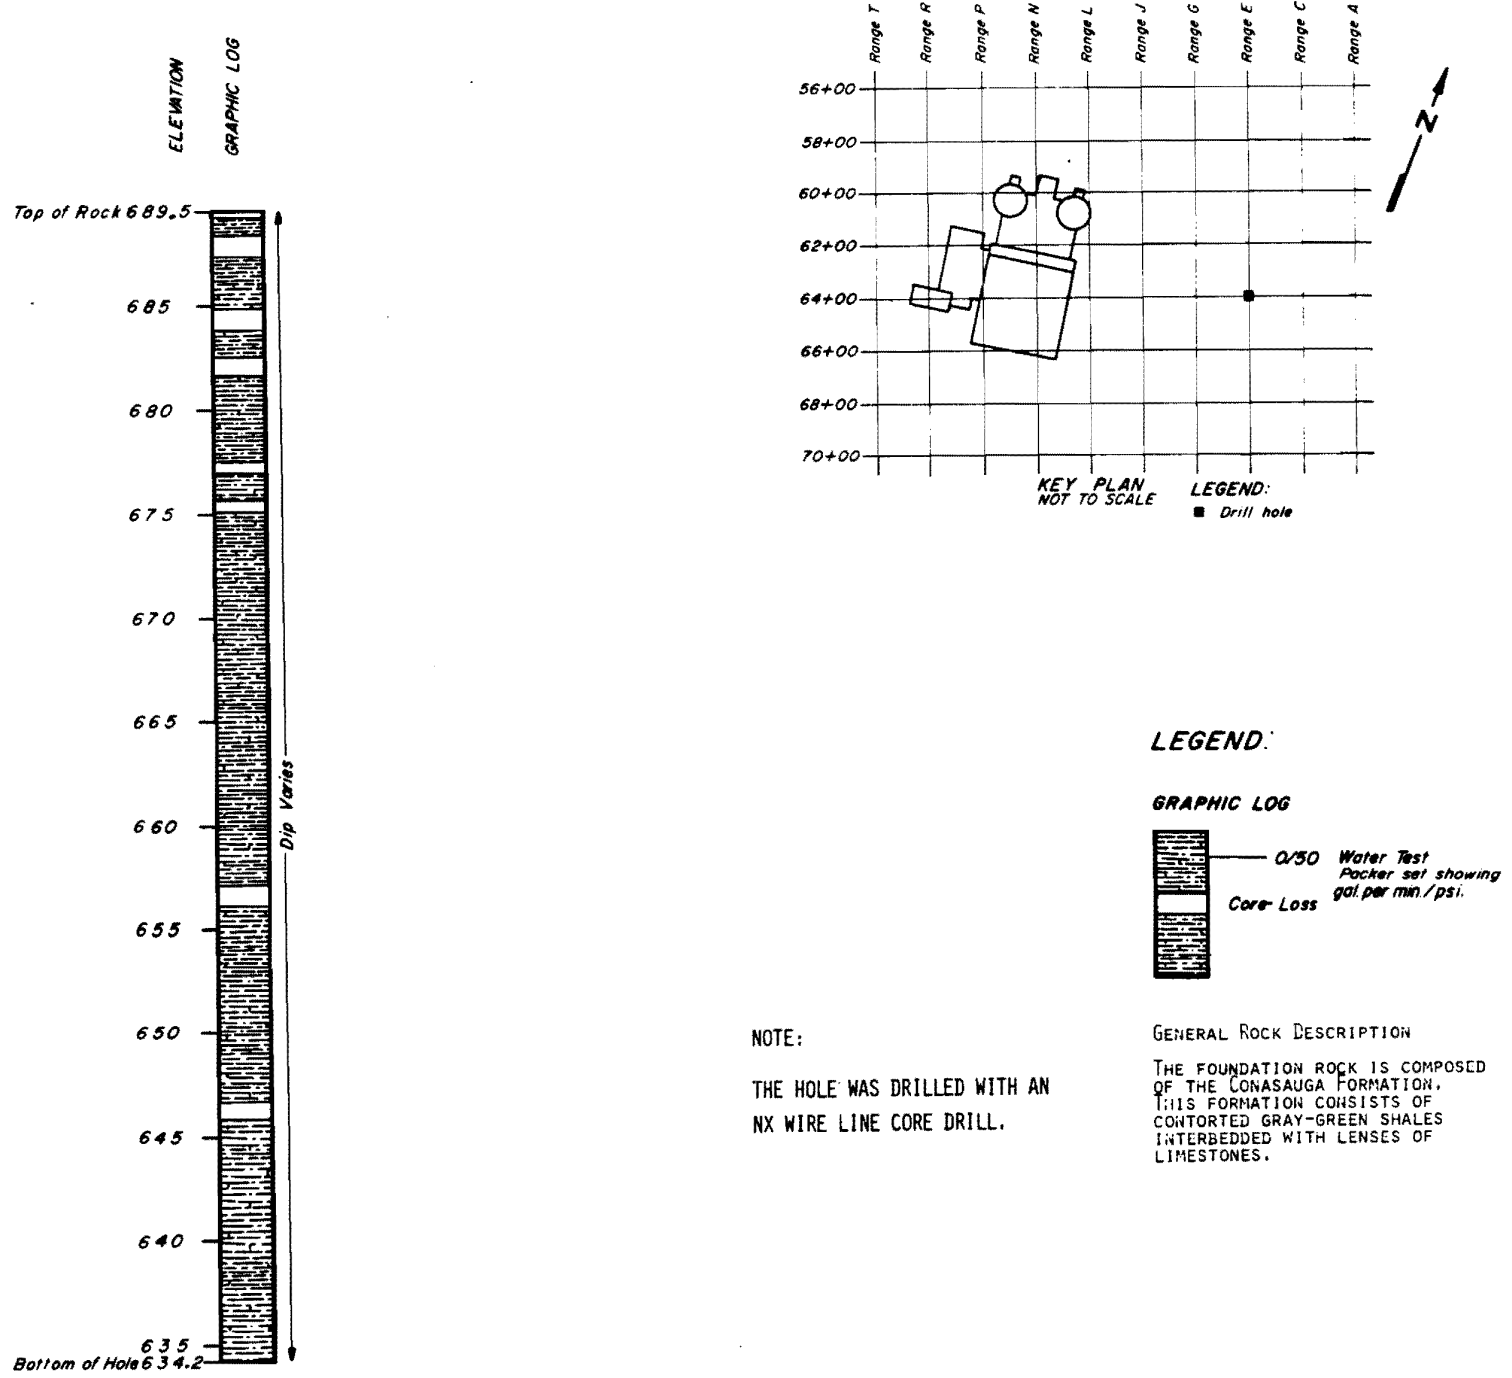

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 6
STA. E-64+00
Figure 2.5-19


Figure 2.5-19 Graphic Log Hole 6 Sta. E-64+00

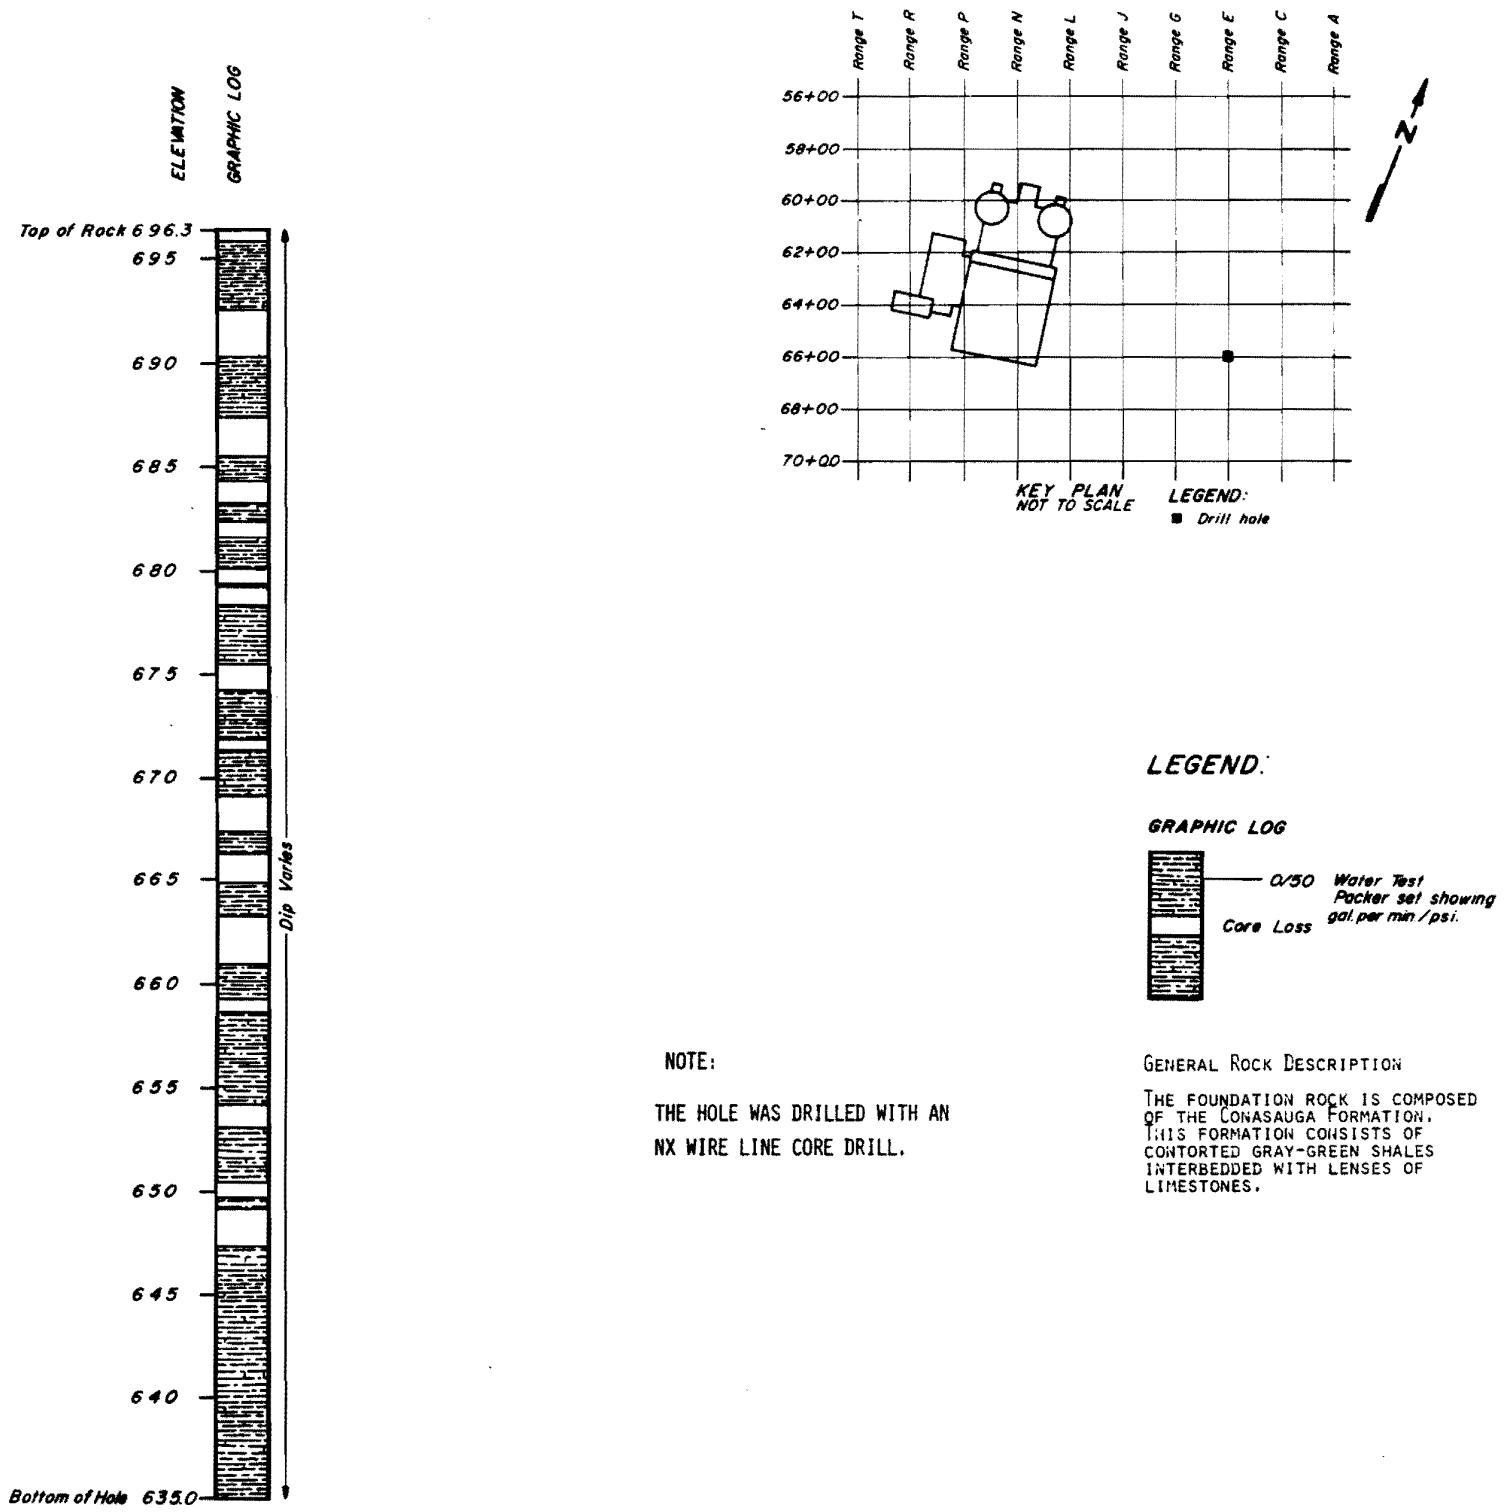

**WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT**

GRAPHIC LOG
 HOLE 7
 STA. E-66+00
 Figure 2.5-20

Figure 2.5-20 Graphic Log Hole 7 Sta. E-66+00

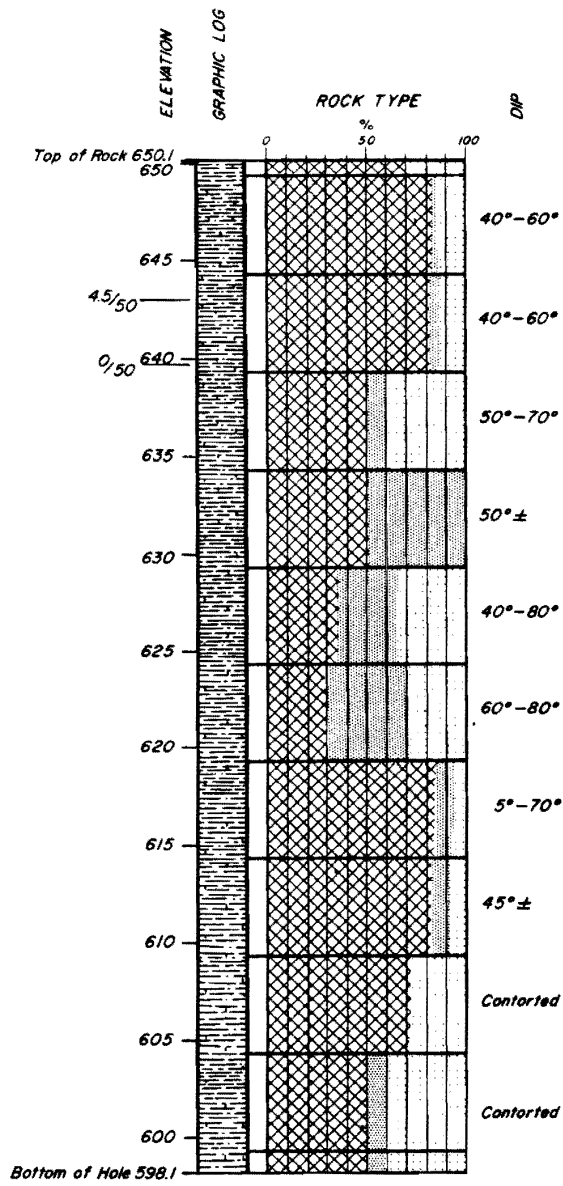


NOTES:

1. THE HOLE WAS DRILLED WITH AN NX WIRE LINE CORE DRILL.
2. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.
3. FOR CORE DRILL HOLE LOCATION SEE DRAWING 85 GE 1 822K1825.

LEGEND:

GRAPHIC LOG

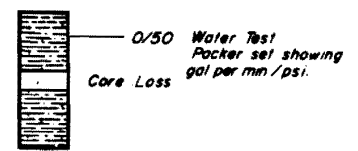

GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.

ROCK TYPE

Given graphically in % and showing ranges of test values for deformation modulus (psi x 10⁴)

- Type 0 - Core loss
- Type 1 - Soft shale. 1 to 10
- Type 2 - Hard shale. 5 to 60
- Type 3 - Limestone. 100+


THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

GRAPHIC LOG
HOLE 8
STA. E-88+40

Figure 2.5-21


Figure 2.5-21 Graphic Log Hole 8 Sta. E-88+40

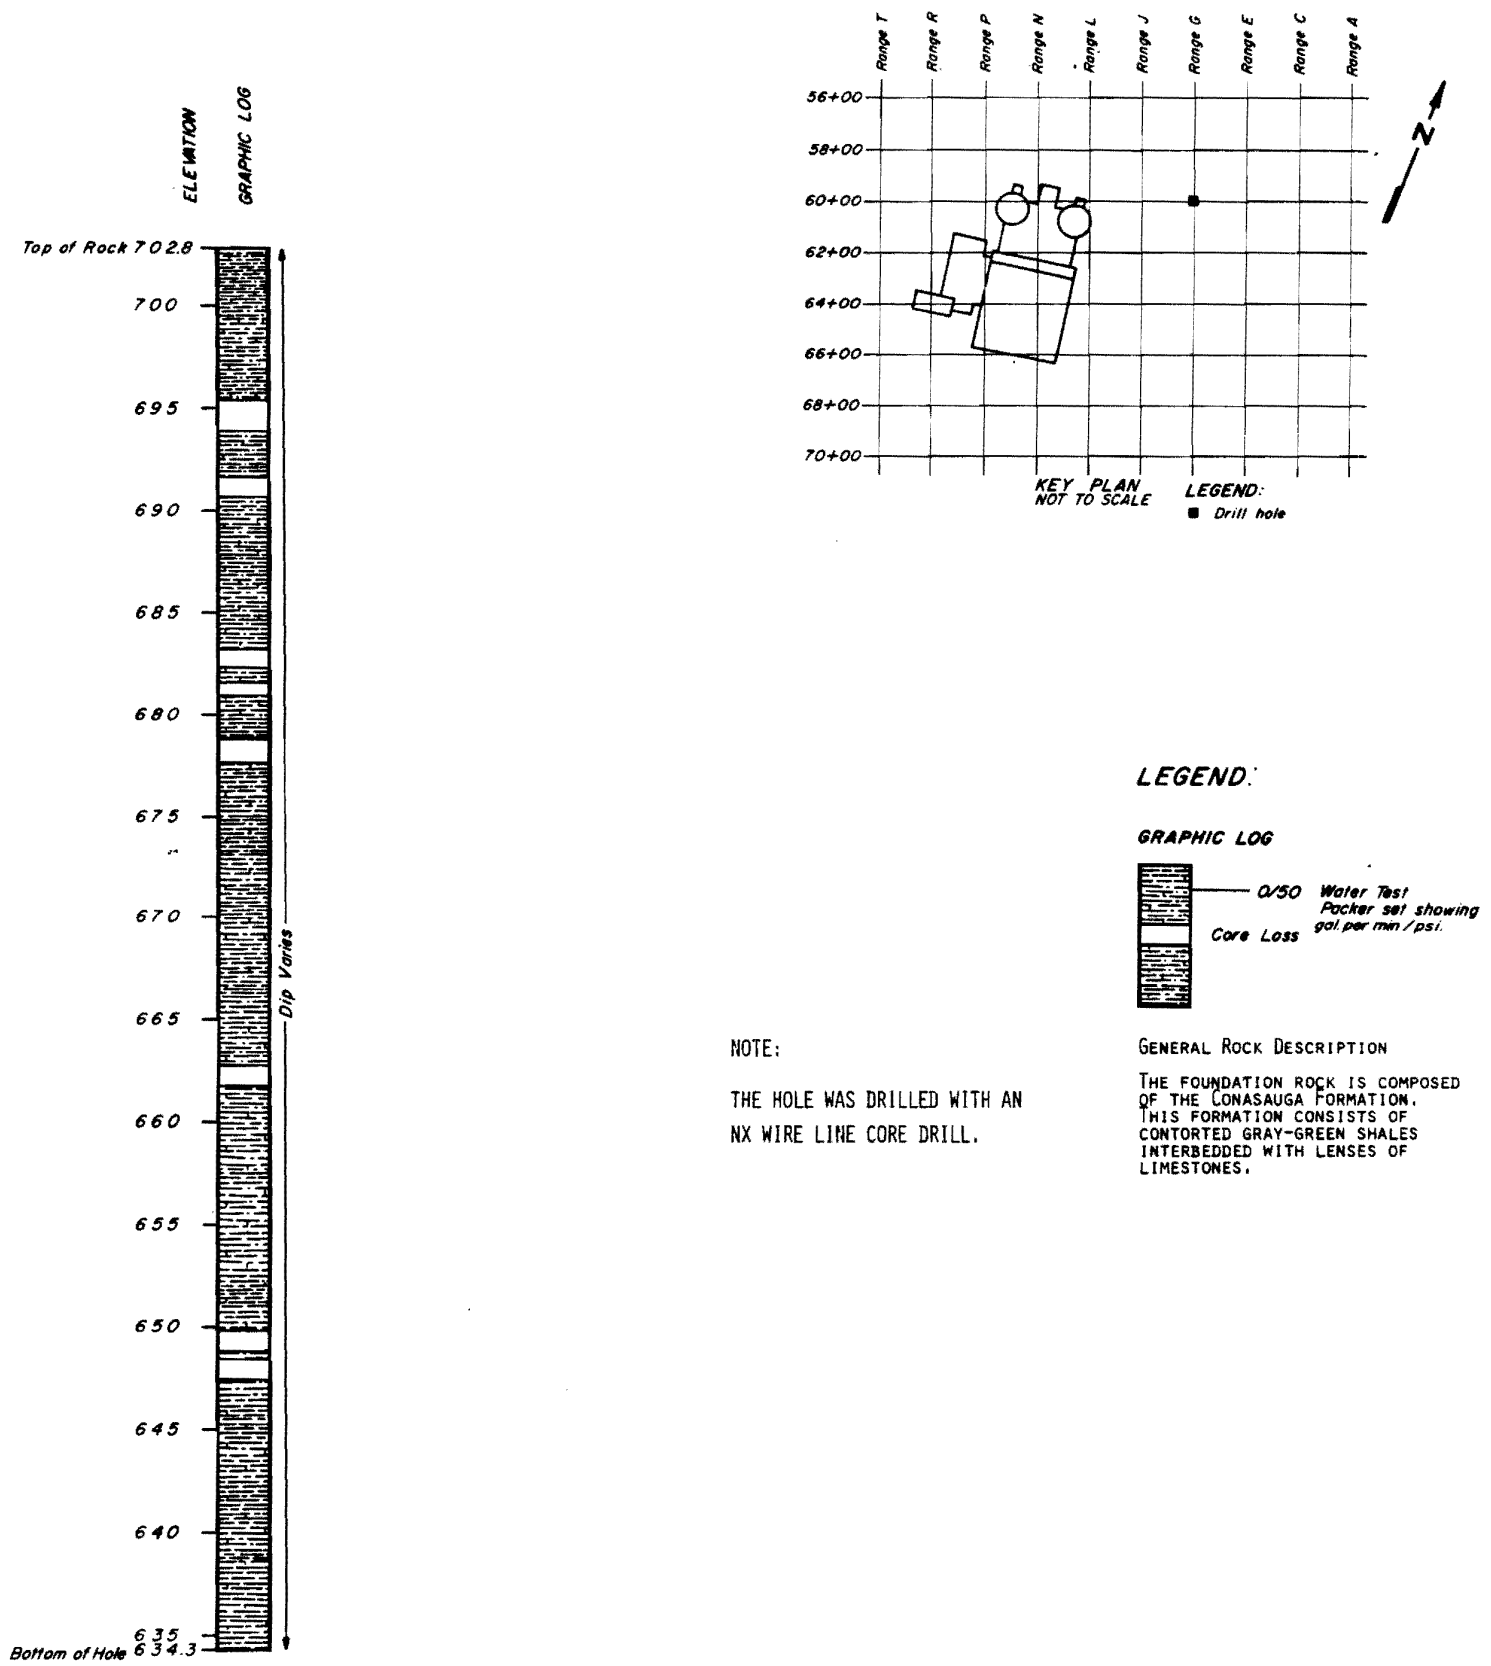

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 9
STA. G-60+00
Figure 2.5-22


Figure 2.5-22 Graphic Log Hole 9 Sta. G-60+00

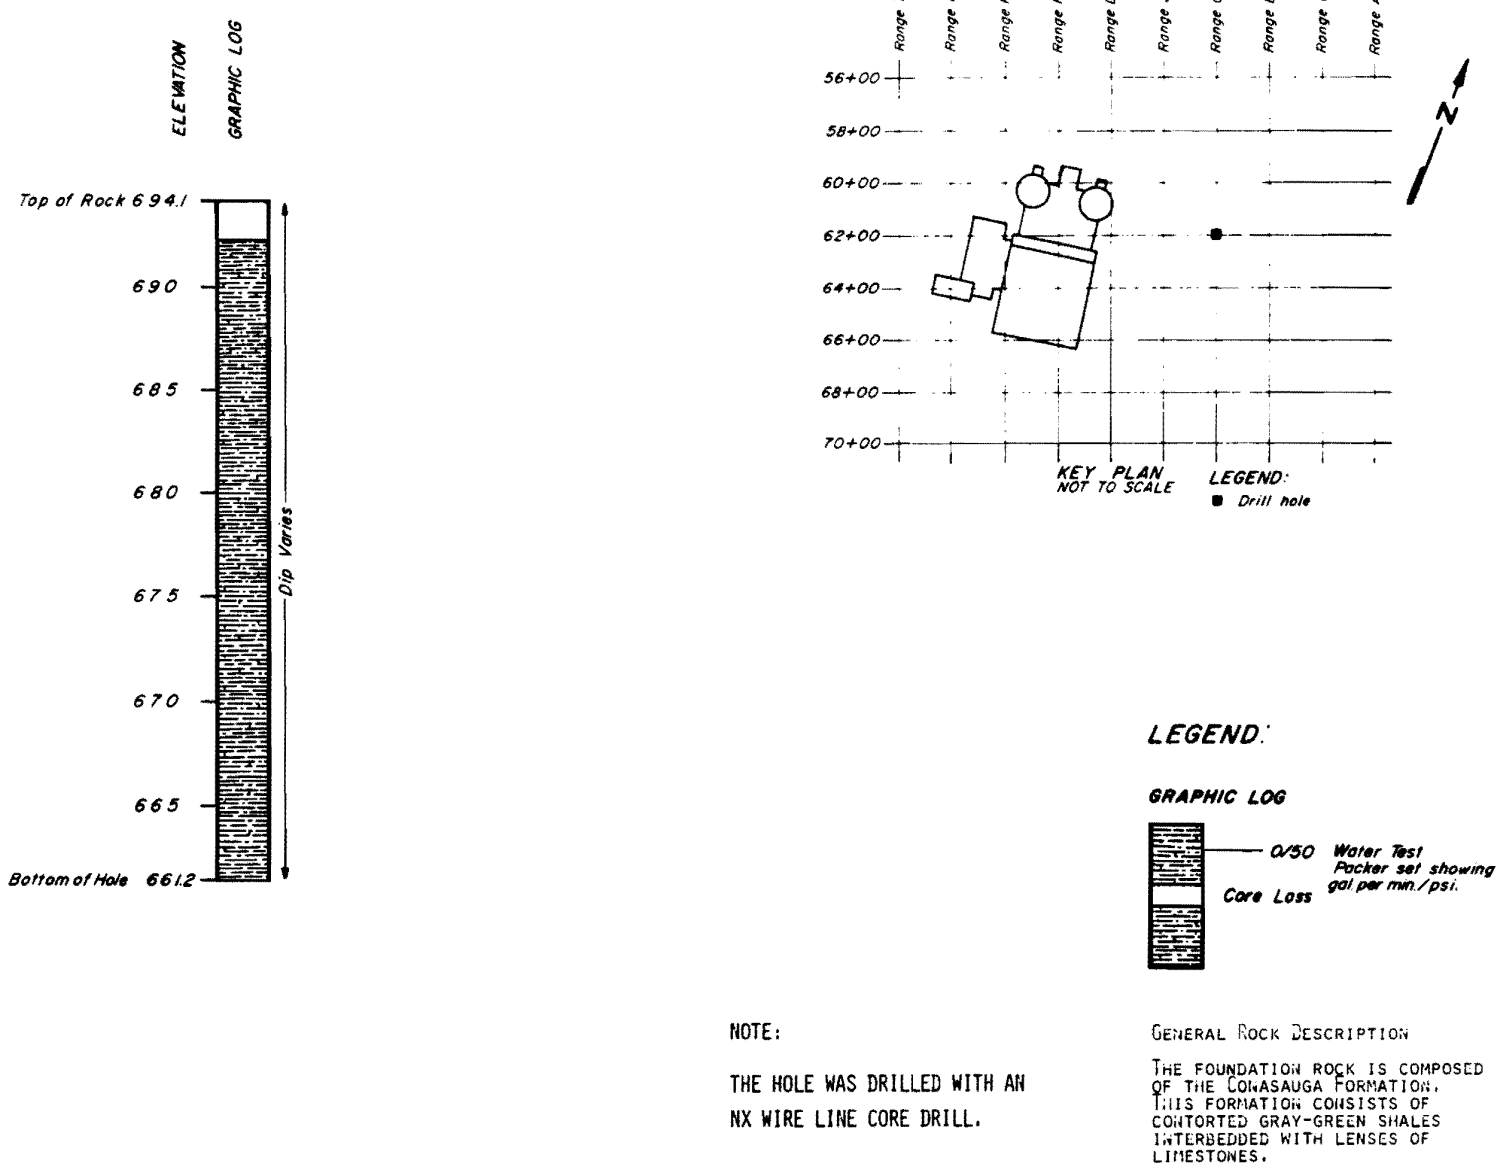

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 10
STA. G-62+00
Figure 2.5-23



Figure 2.5-23 Graphic Log Hole 10 Sta. G-62+00

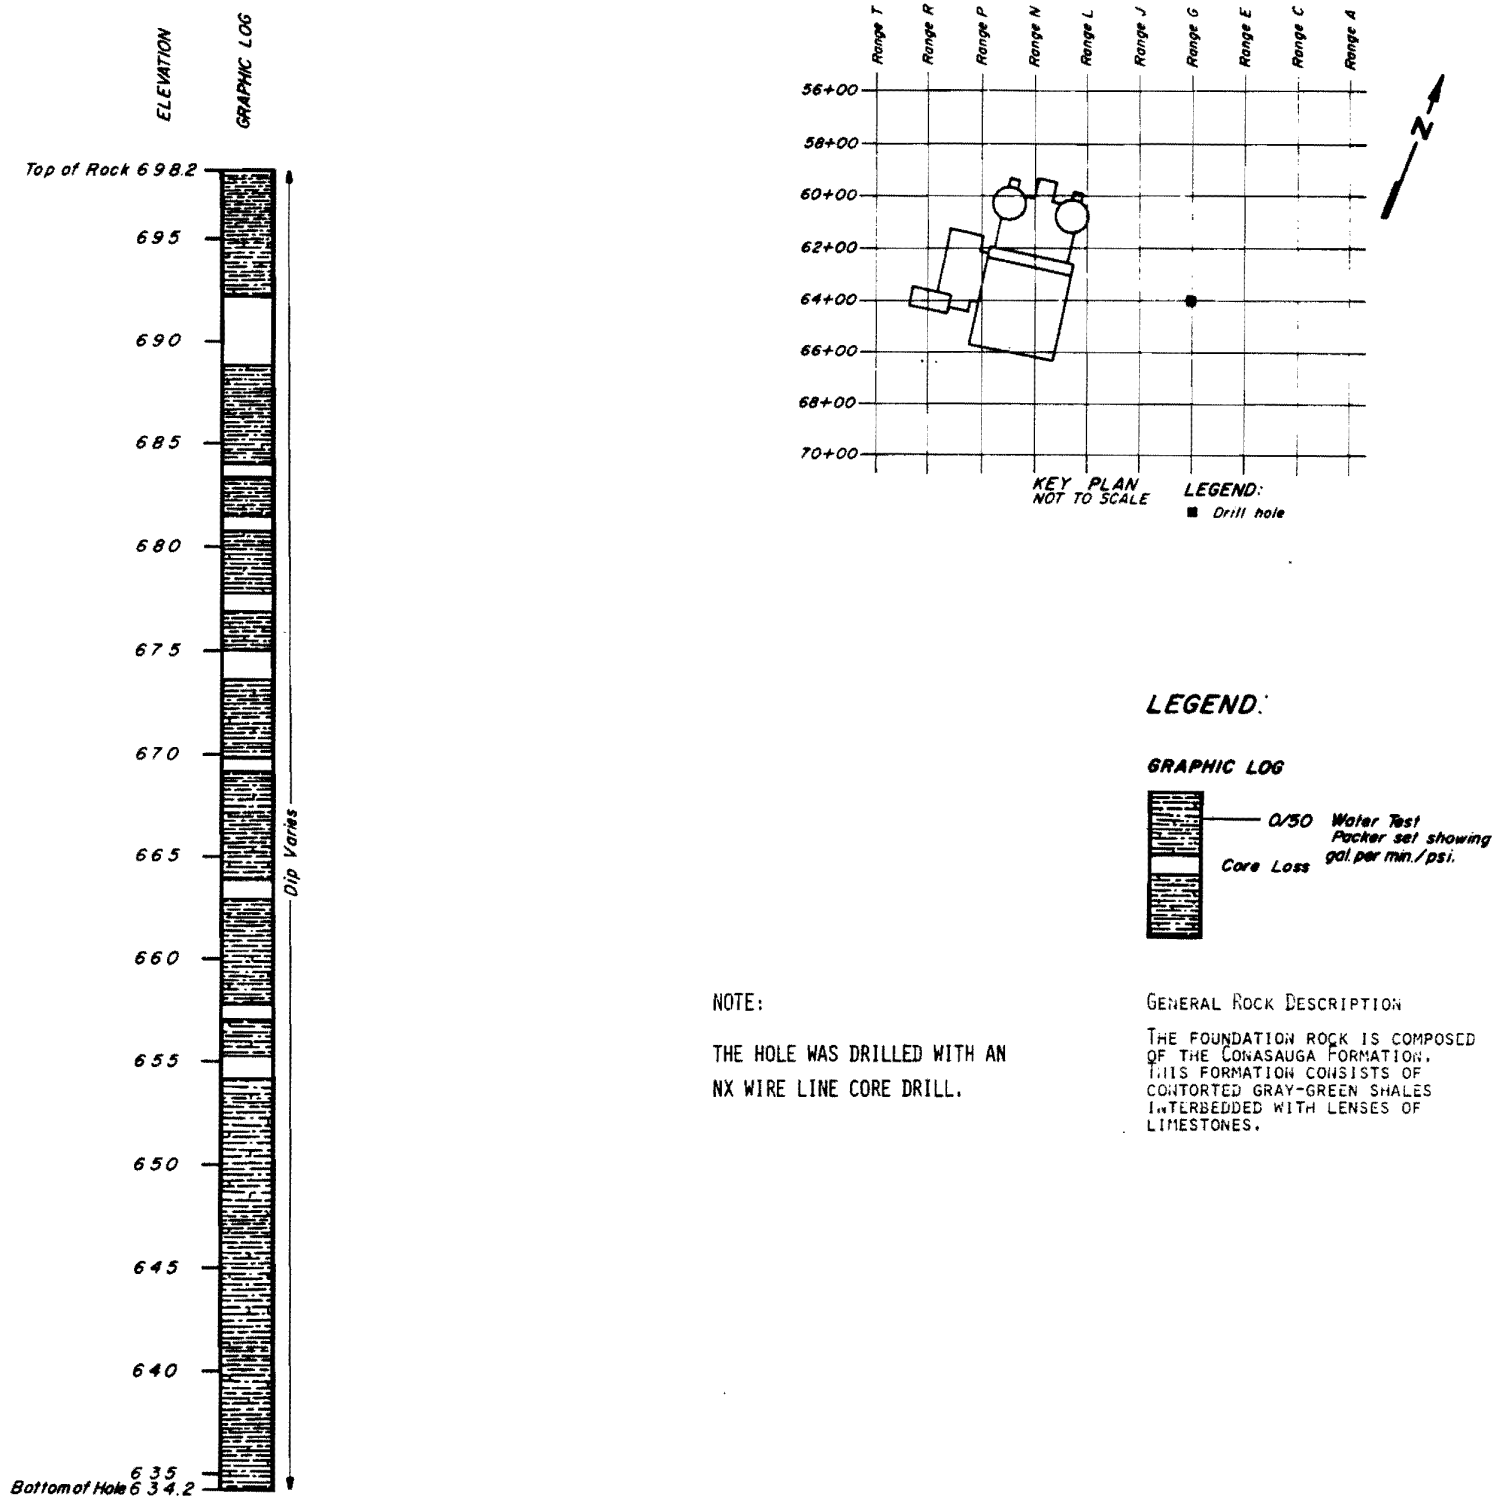

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**


GRAPHIC LOG
HOLE 11
STA. G-64+00
Fig. 2.5-24

Figure 2.5-24 Graphic Log Hole 11 Sta. G-64+00

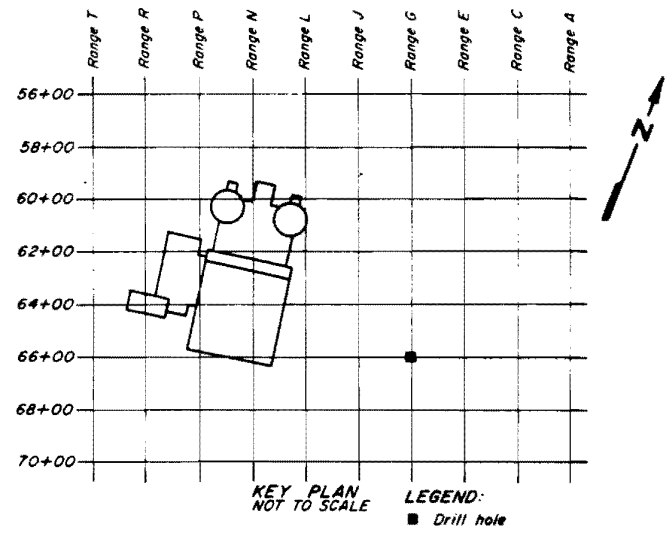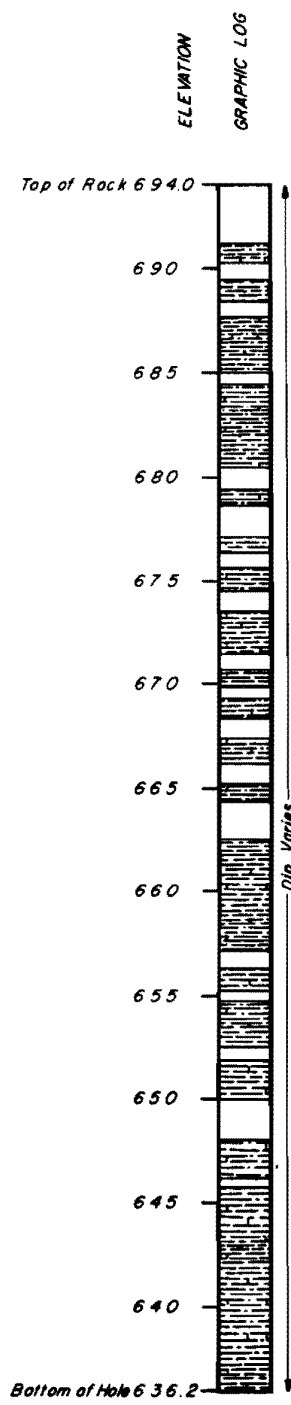

LEGEND:

GRAPHIC LOG

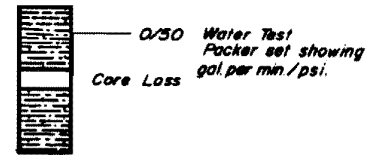

NOTE:


THE HOLE WAS DRILLED WITH AN NX WIRE LINE CORE DRILL.

GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>GRAPHIC LOG HOLE 12 STA. G-66+00 Figure 2.5-25</p>

Figure 2.5-25 Graphic Log Hole 12 Sta. G-66+00

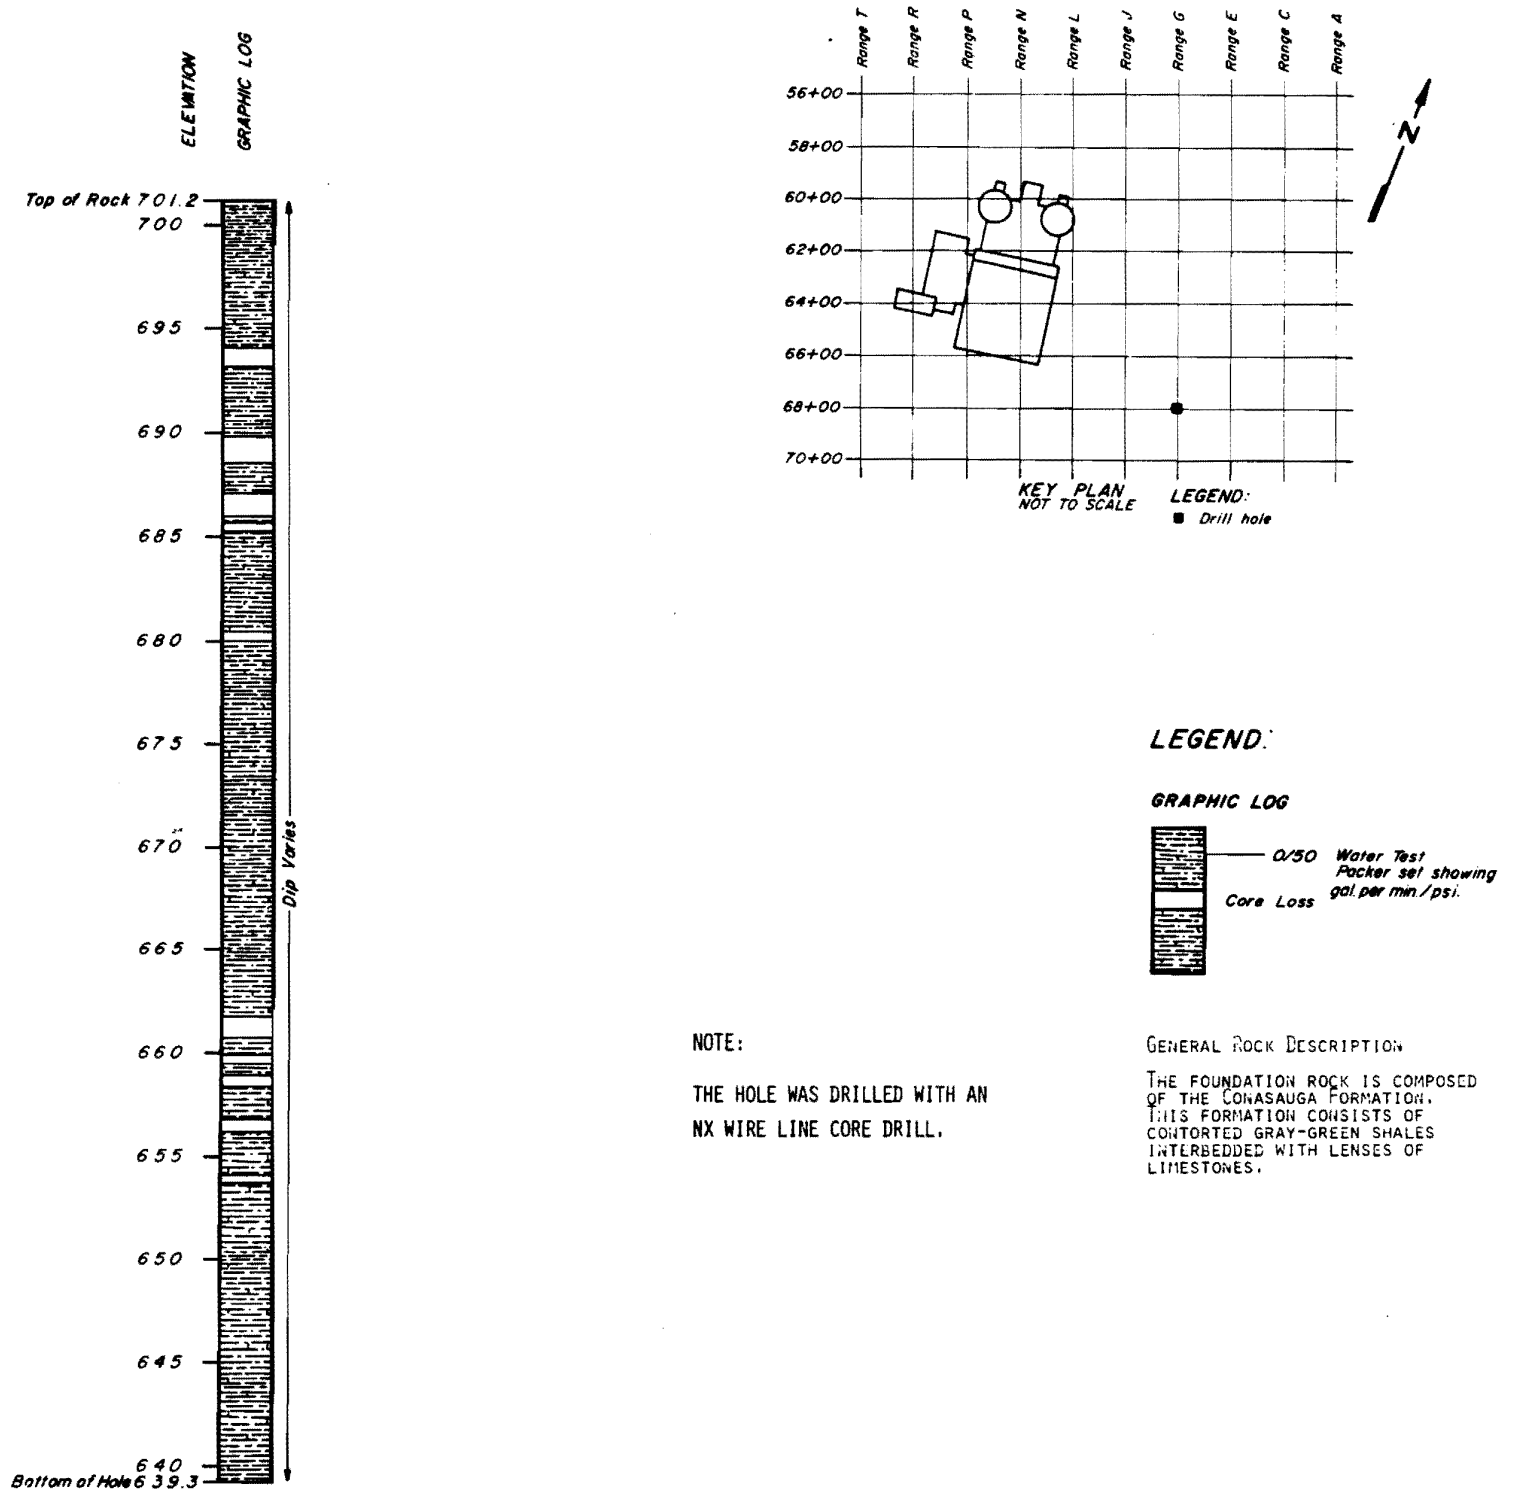

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 13
STA. G-68+00
Figure 2.5-26

Figure 2.5-26 Graphic Log Hole 13 Sta. G-68+00


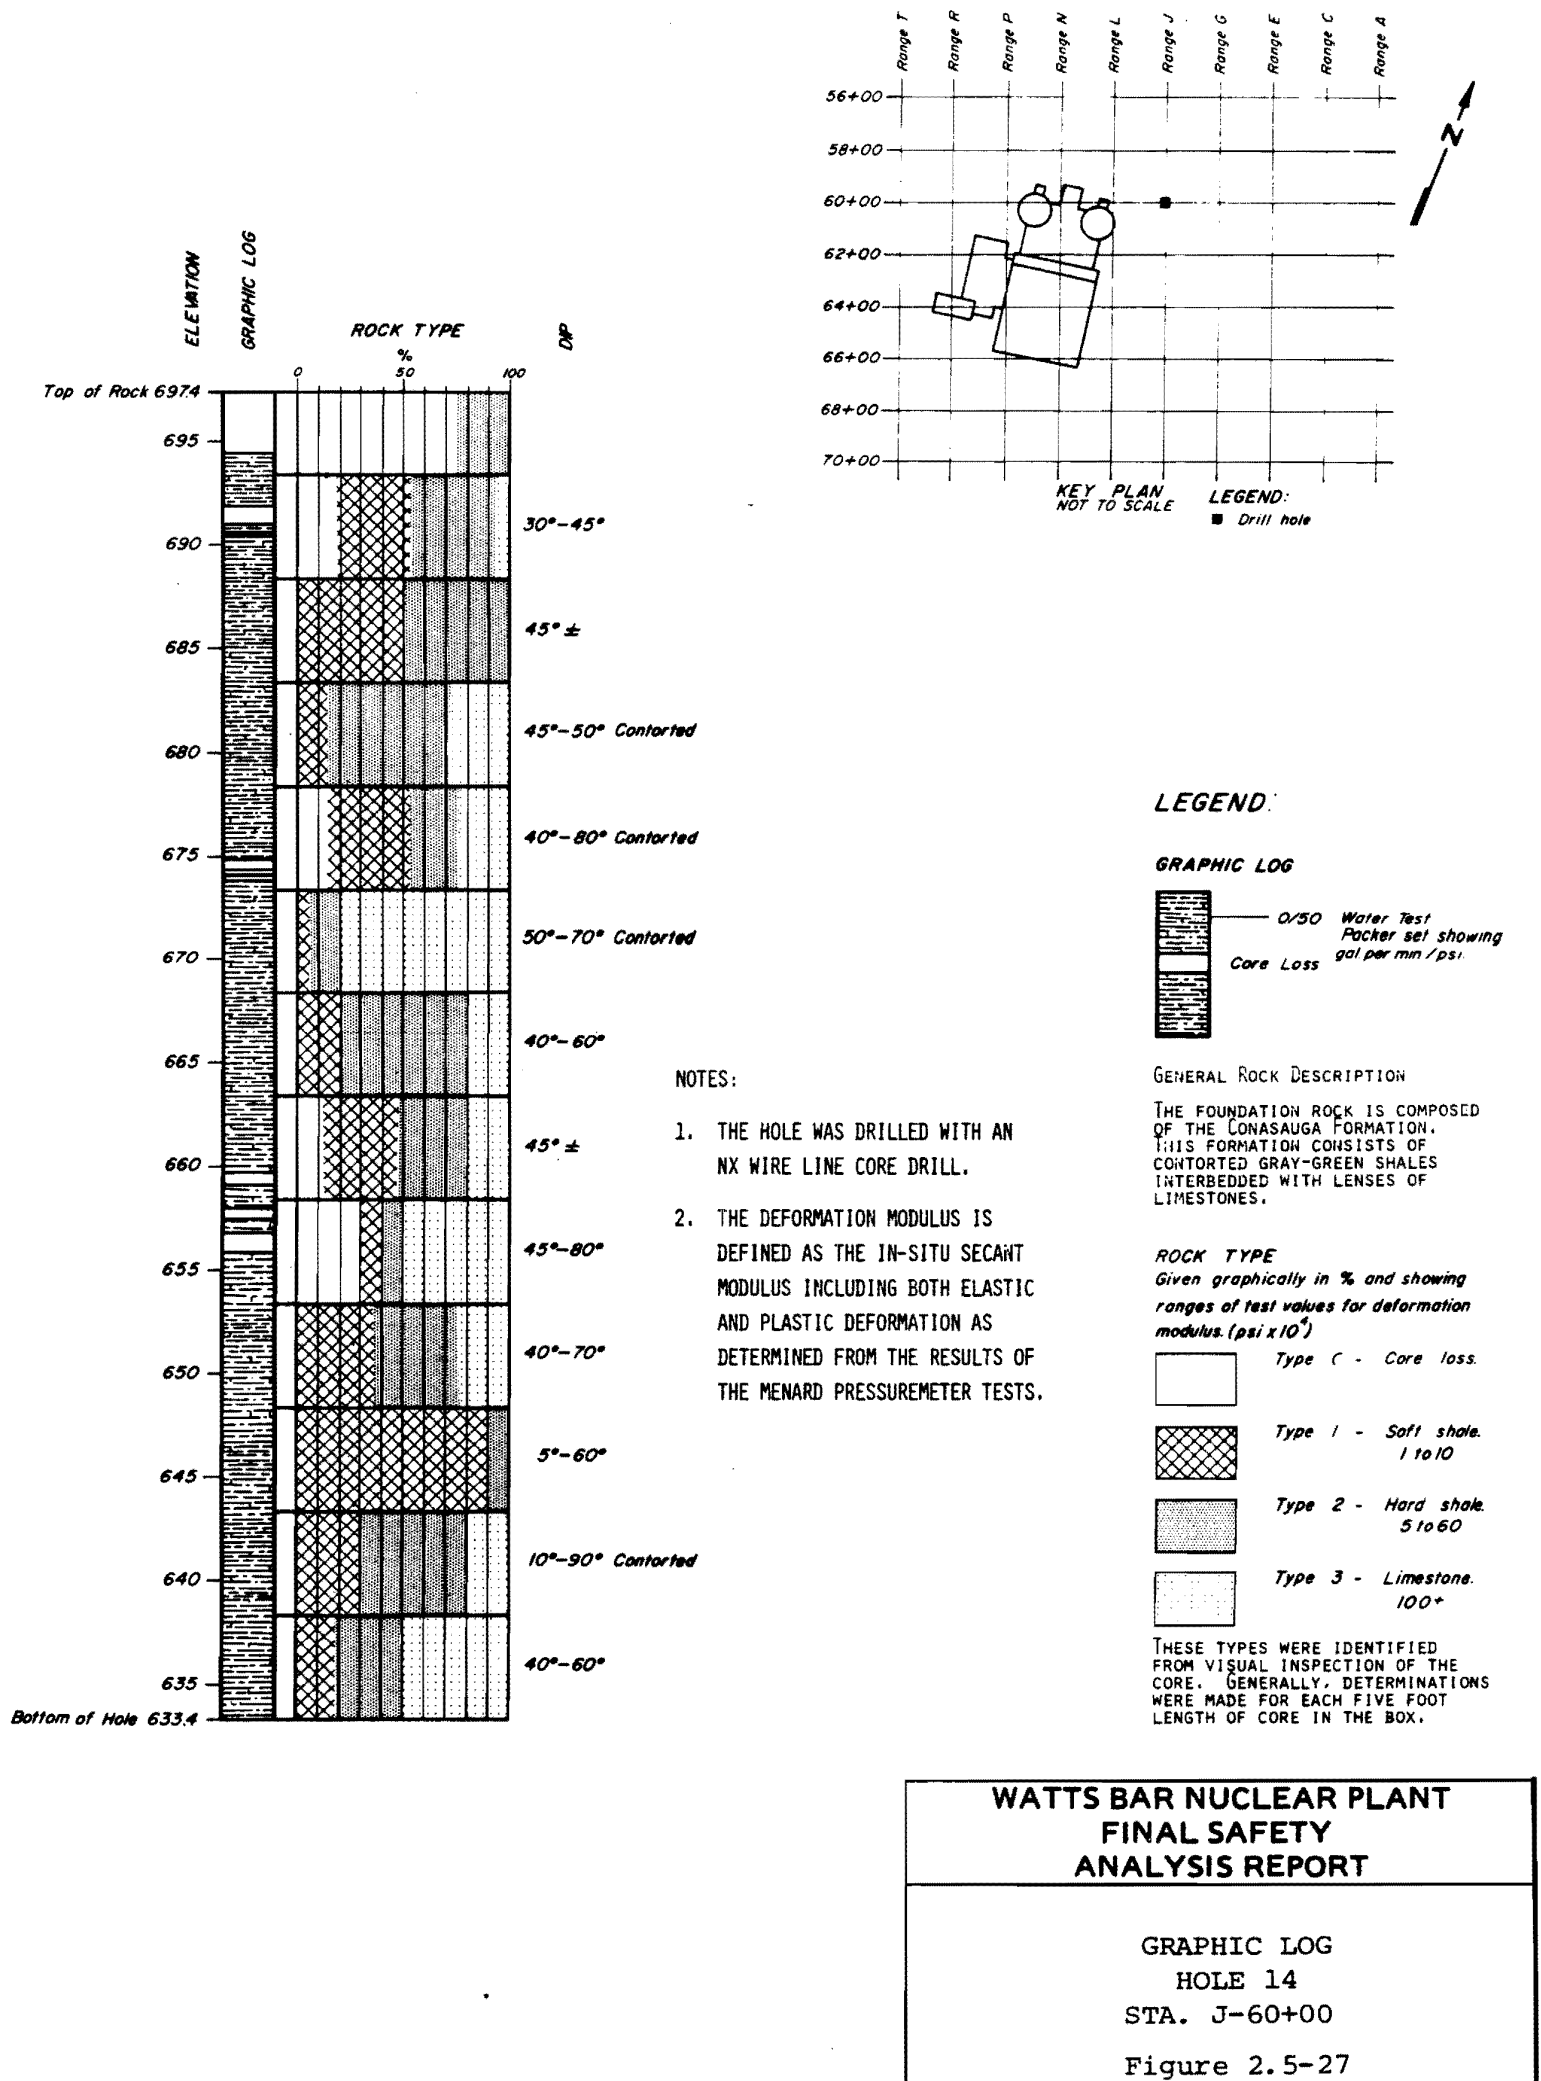



Figure 2.5-27 Graphic Log Hole 14 Sta. J-60+00

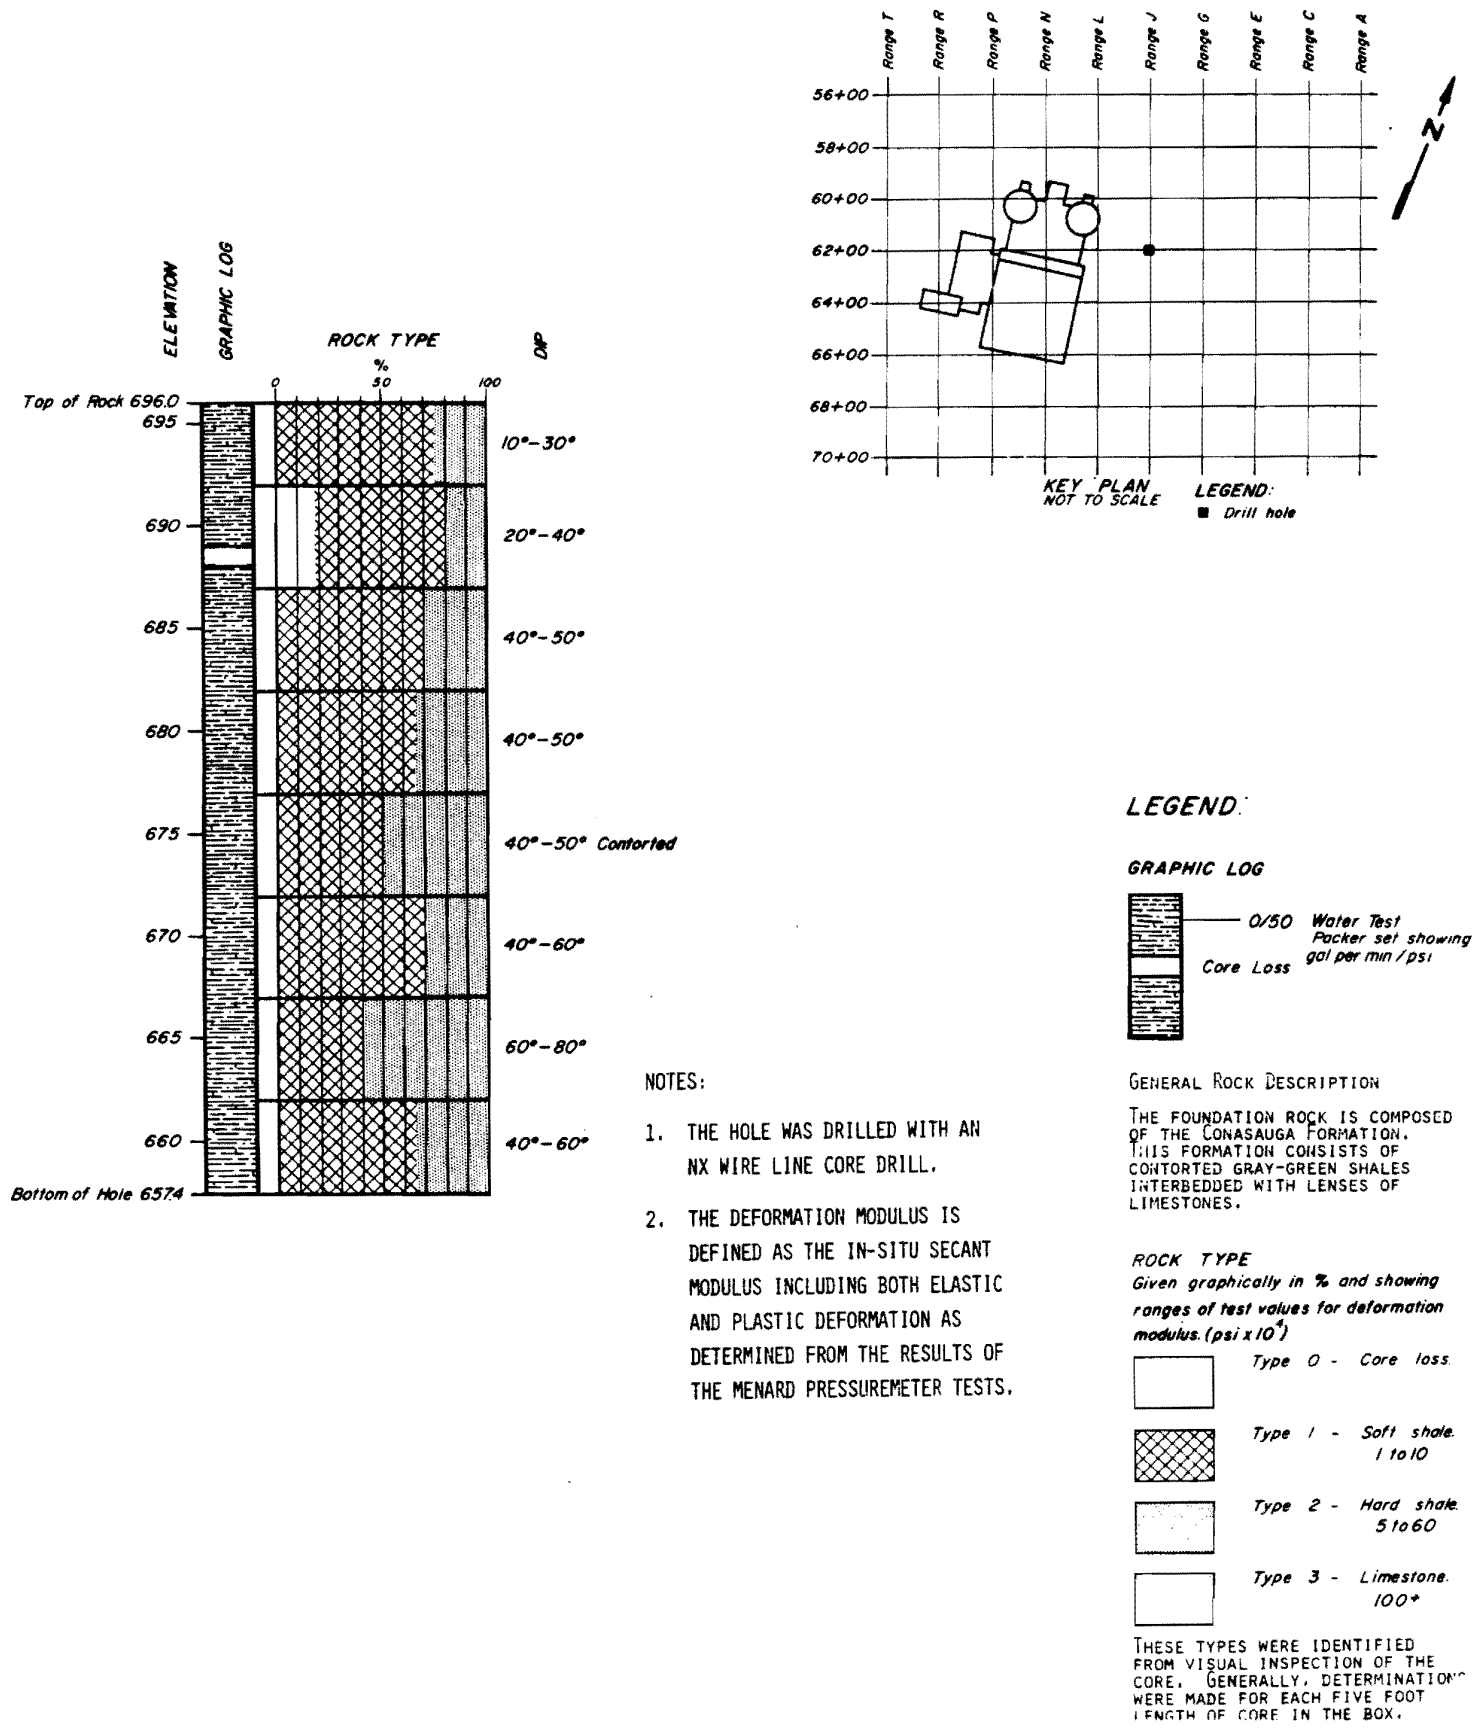

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 15
STA. J-62+00
Figure 2.5-28


Figure 2.5-28 Graphic Log Hole 15 Sta. J-62+00

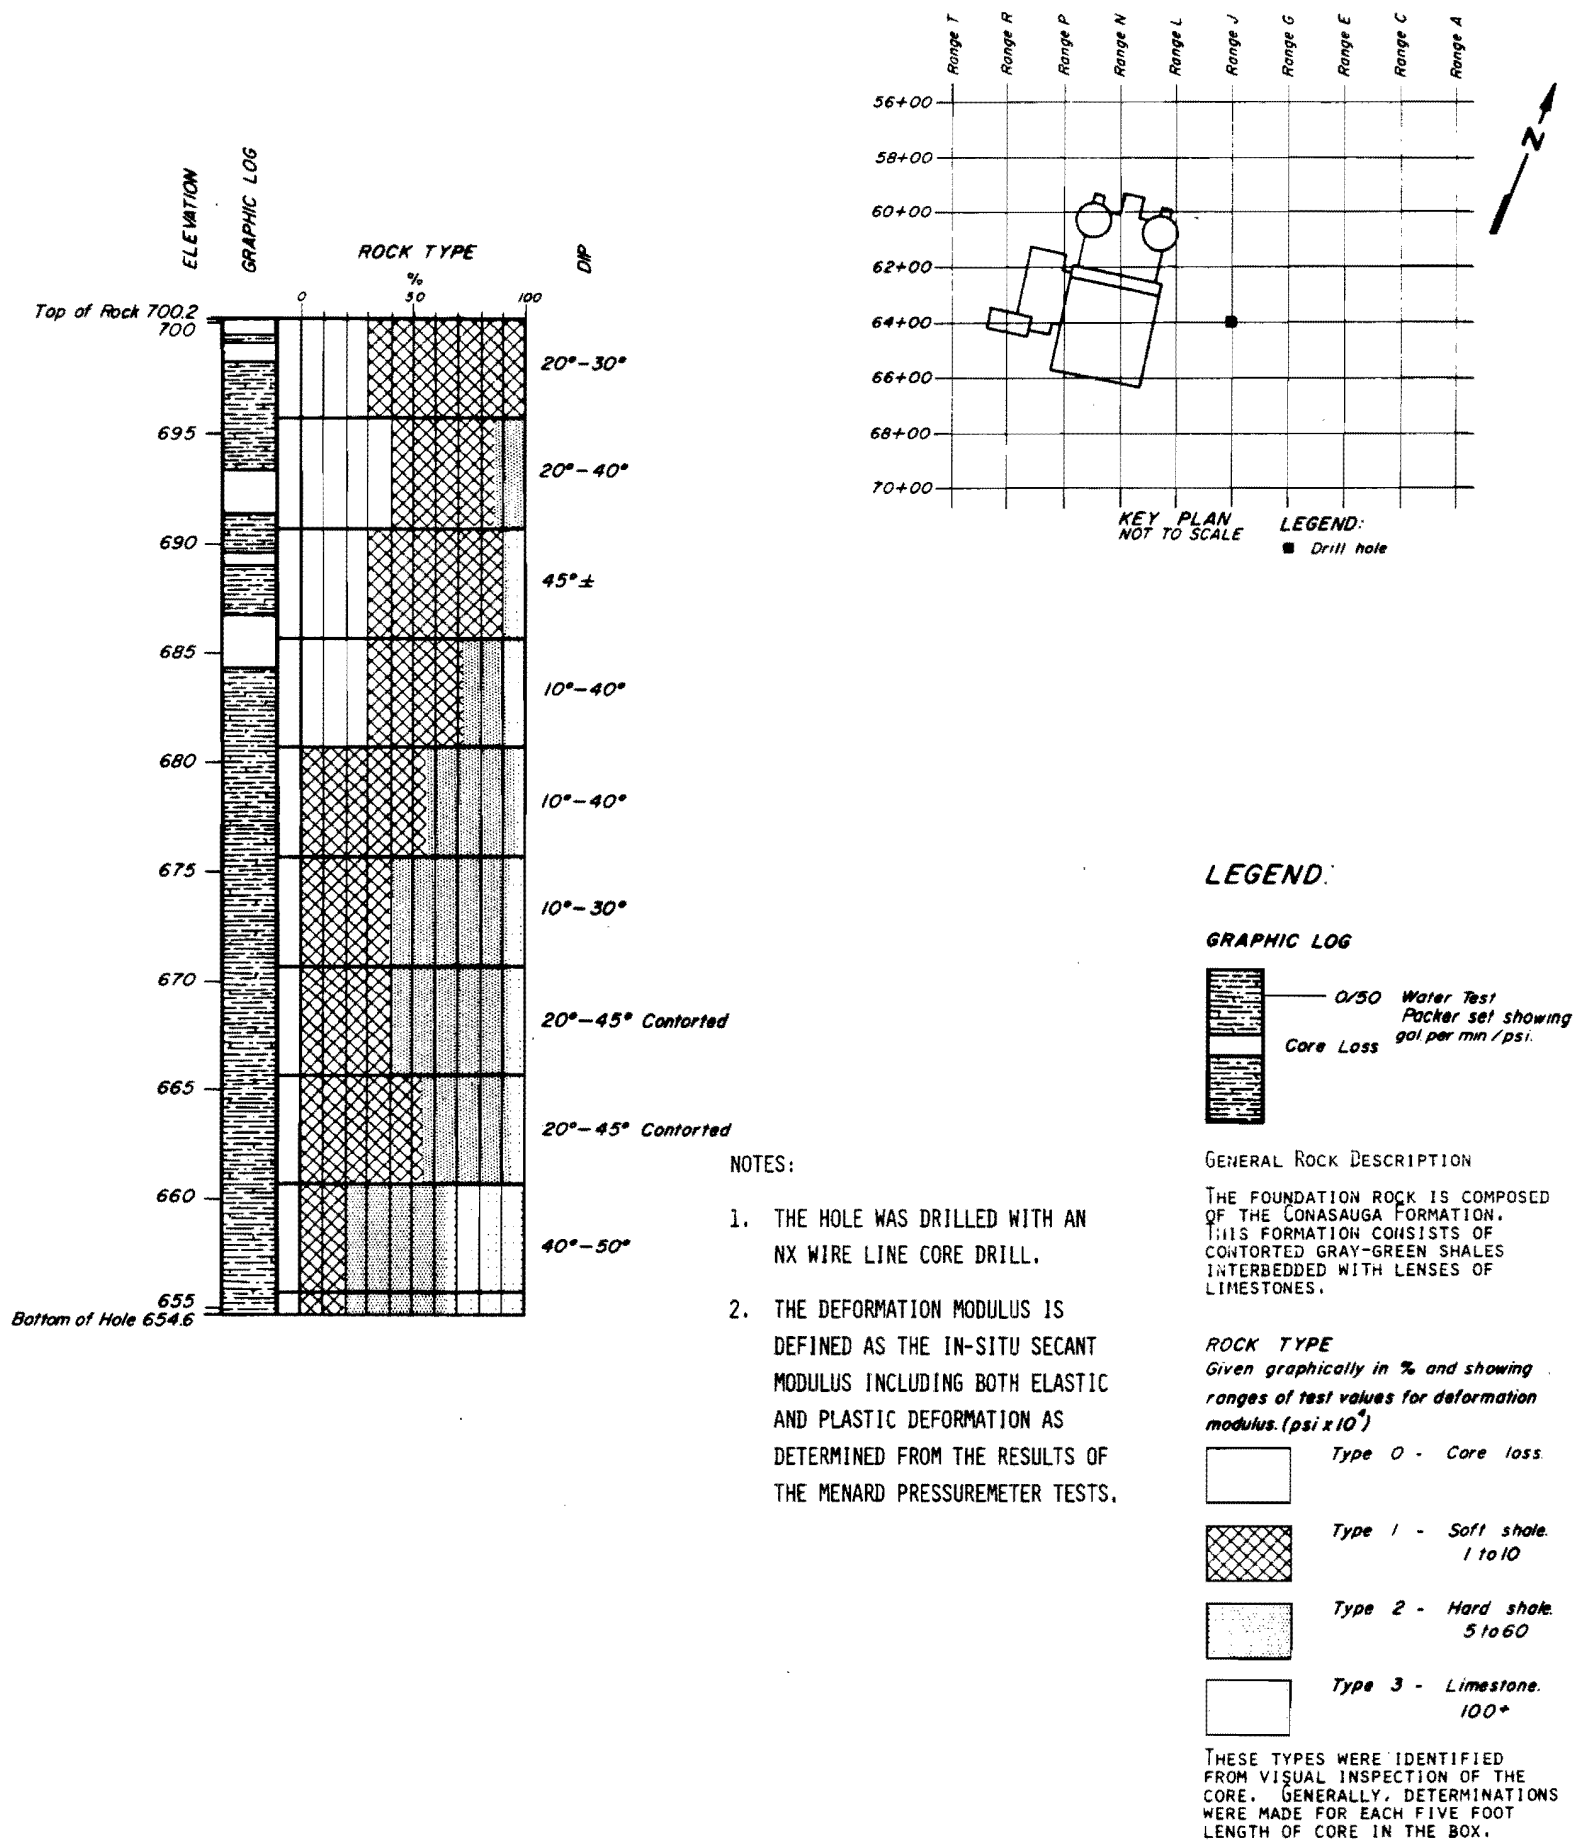

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 16
STA. J-64+00
Figure 2.5-29


Figure 2.5-29 Graphic Log Hole 16 Sta. J-64+00

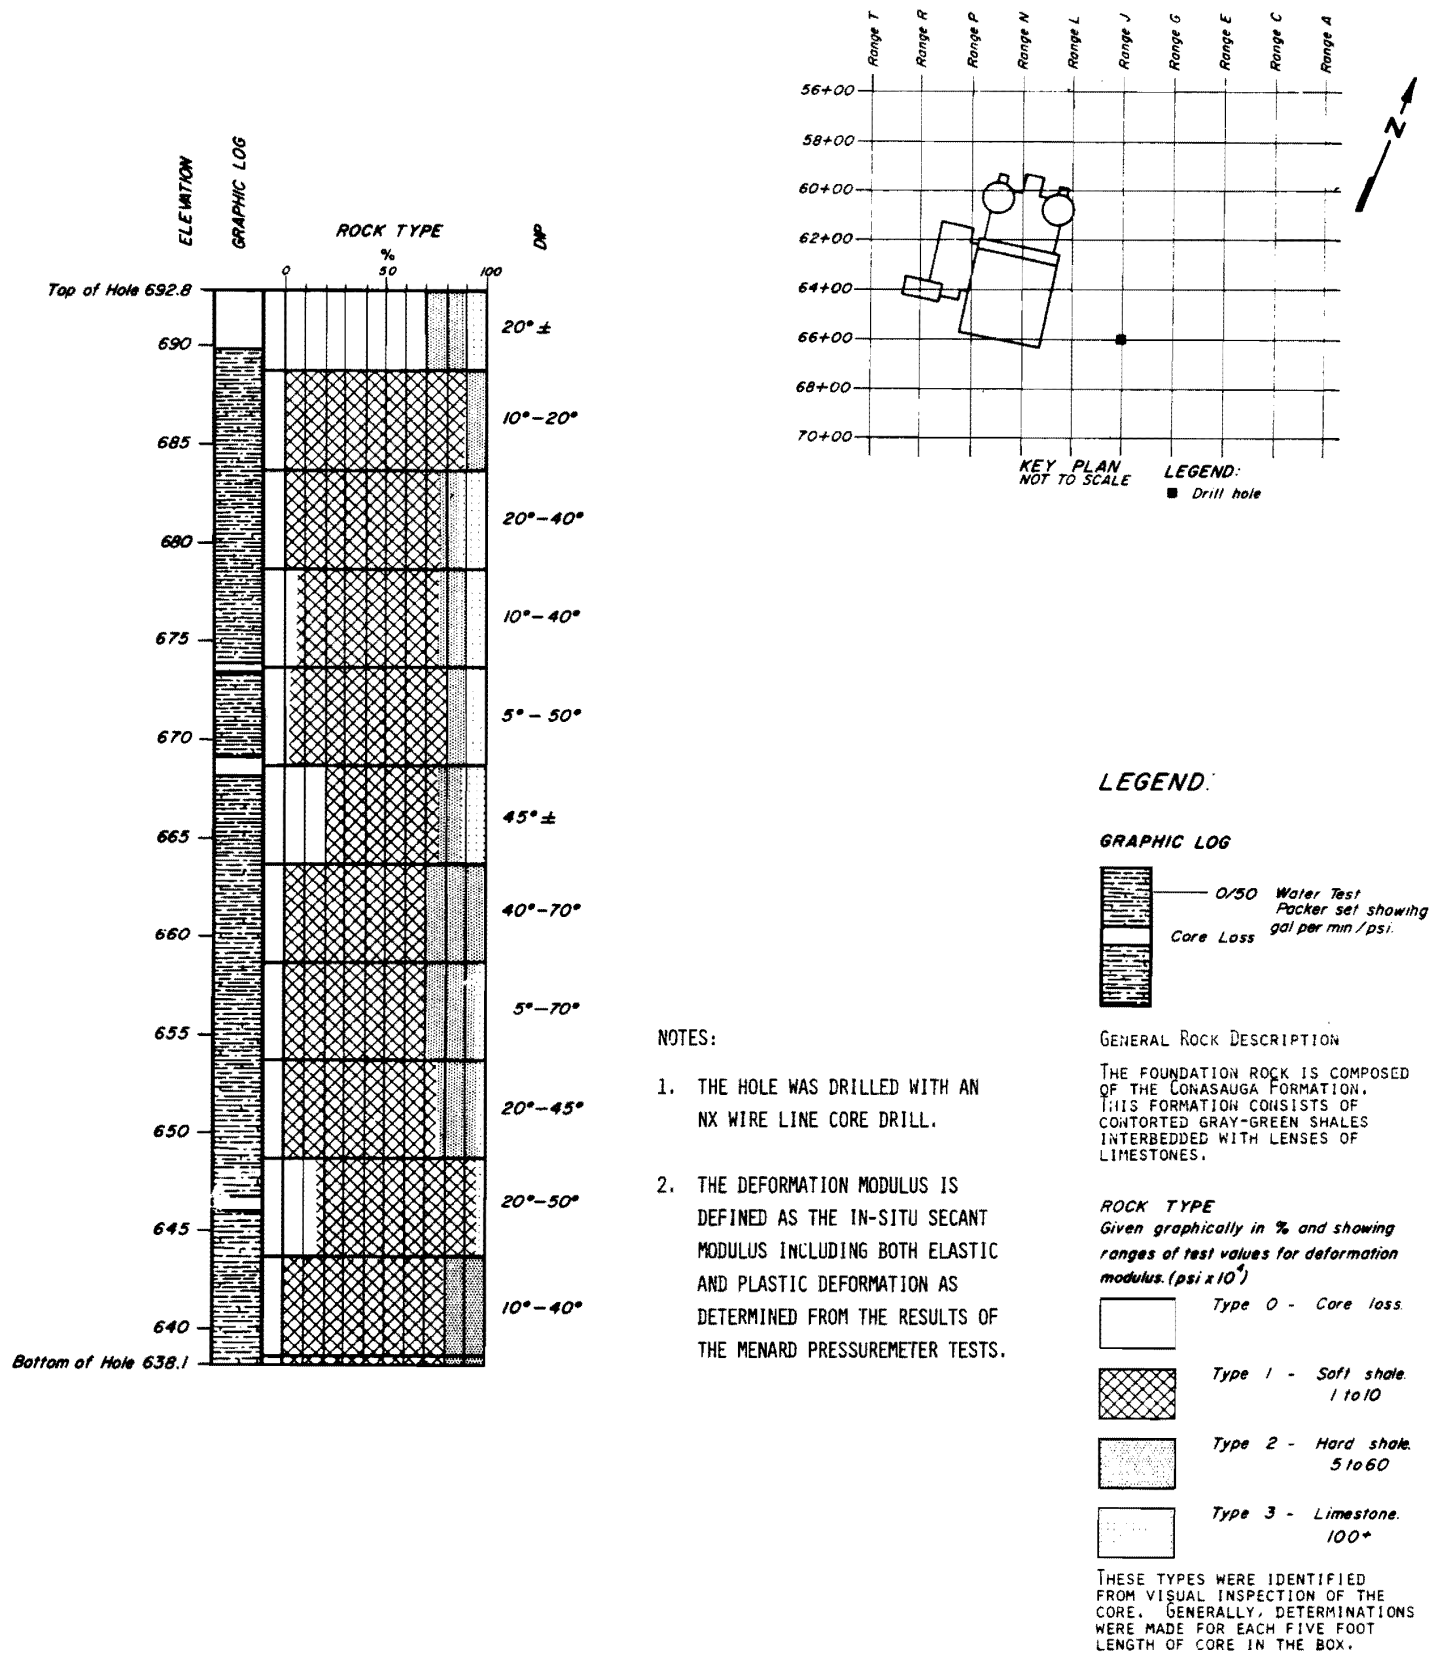

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 17
STA. J-66+00
Figure 2.5-30

Figure 2.5-30 Graphic Log Hole 17 Sta. J-66+00

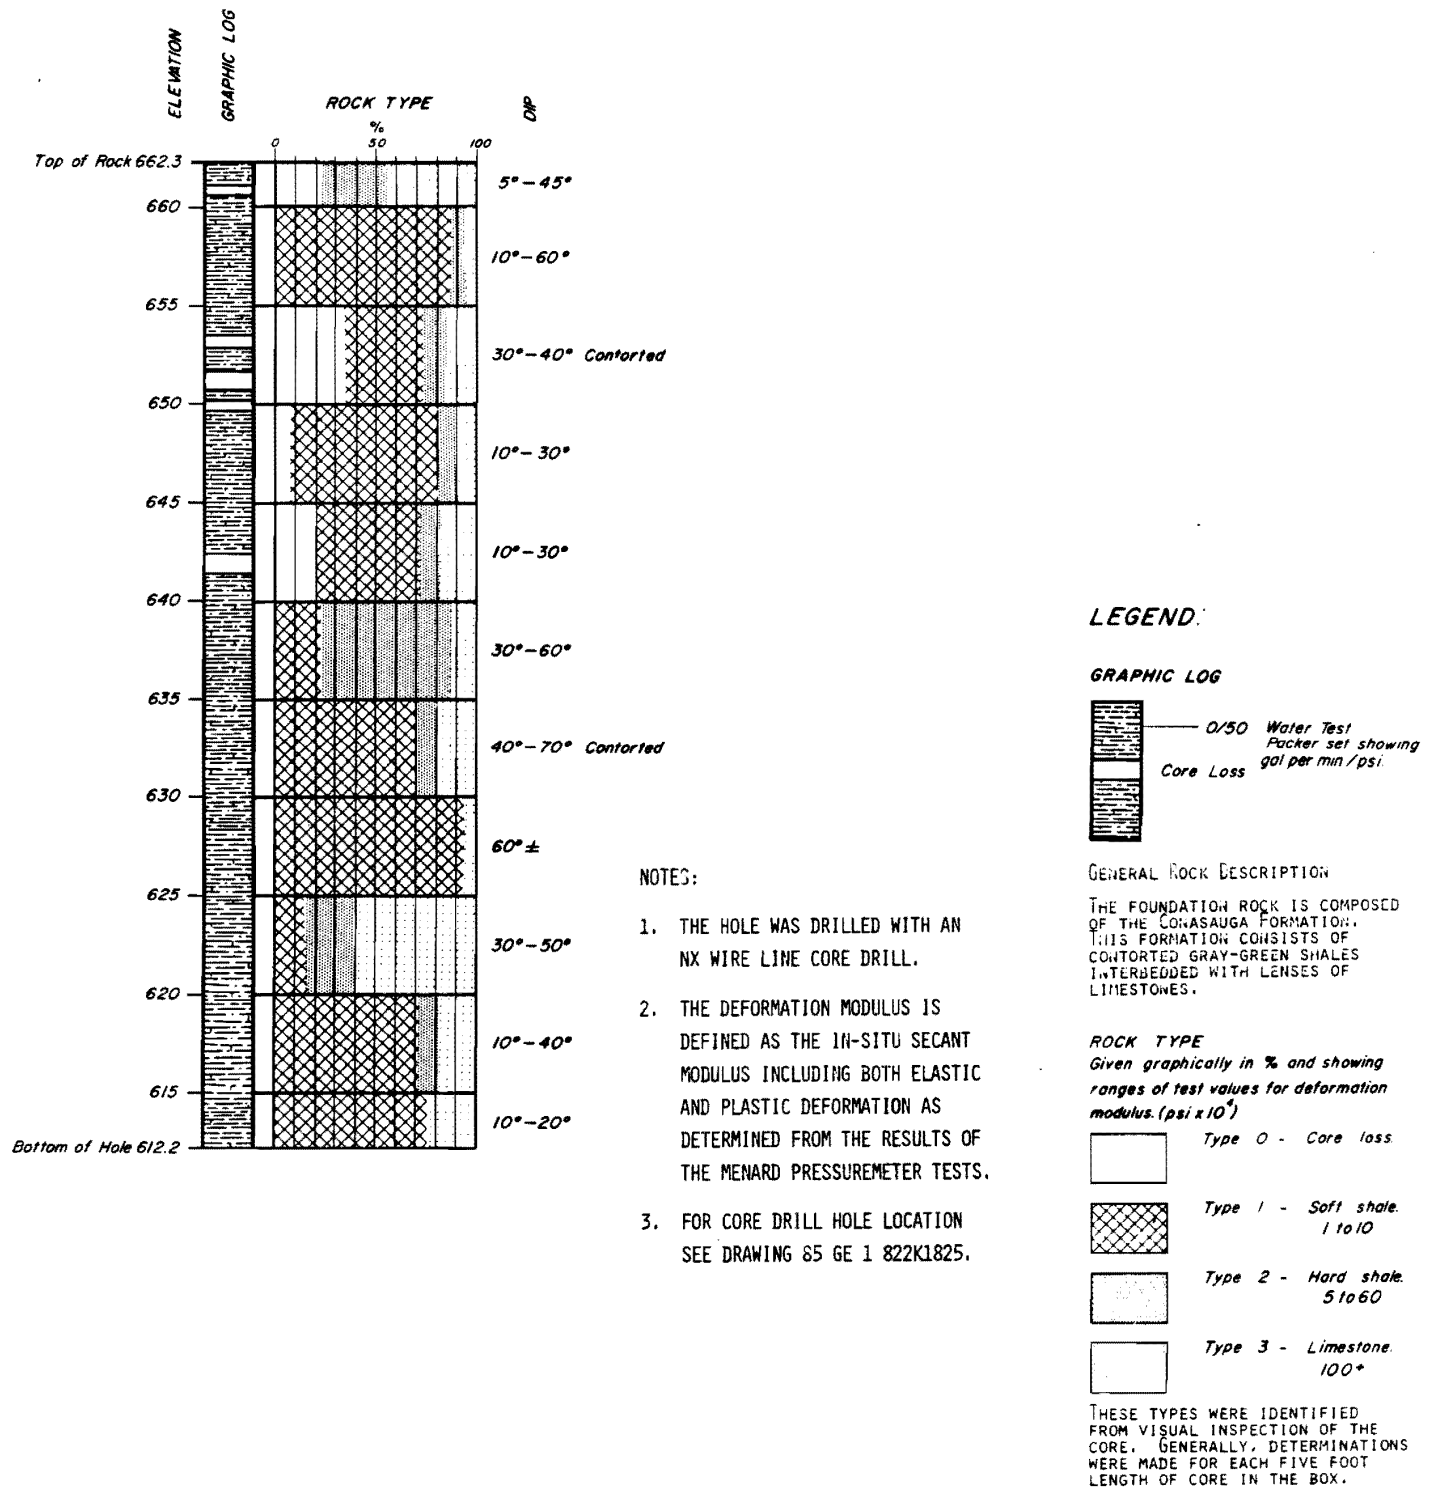

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 18
STA. J-82+25
Figure 2.5-31

Figure 2.5-31 Graphic Log Hole 18 Sta. J-82+25

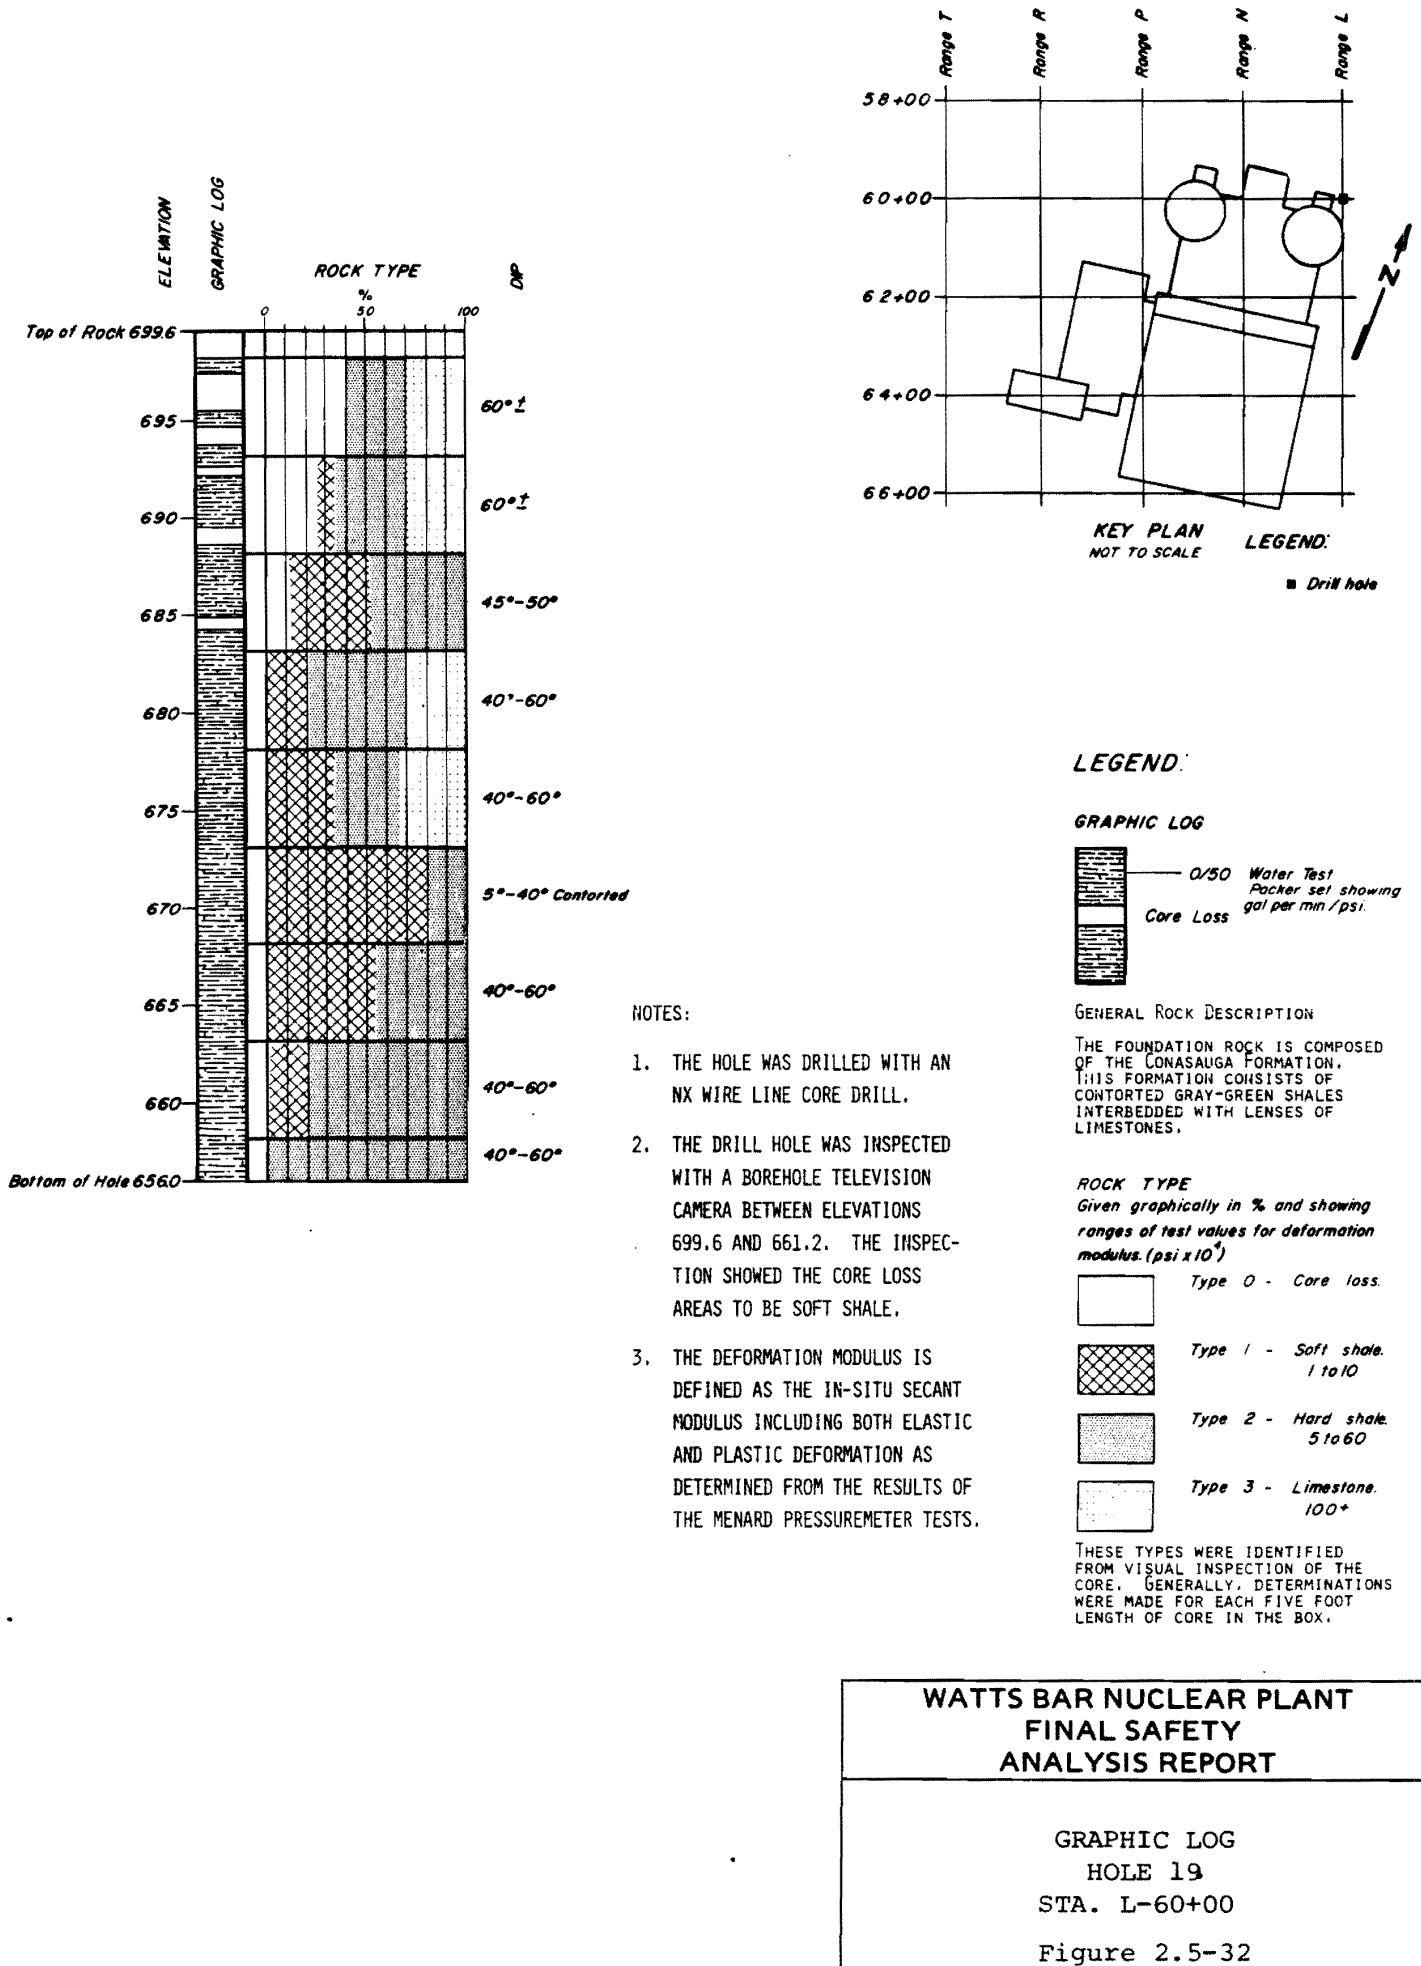


Figure 2.5-32 Graphic Log Hole 19 Sta. L-60+00


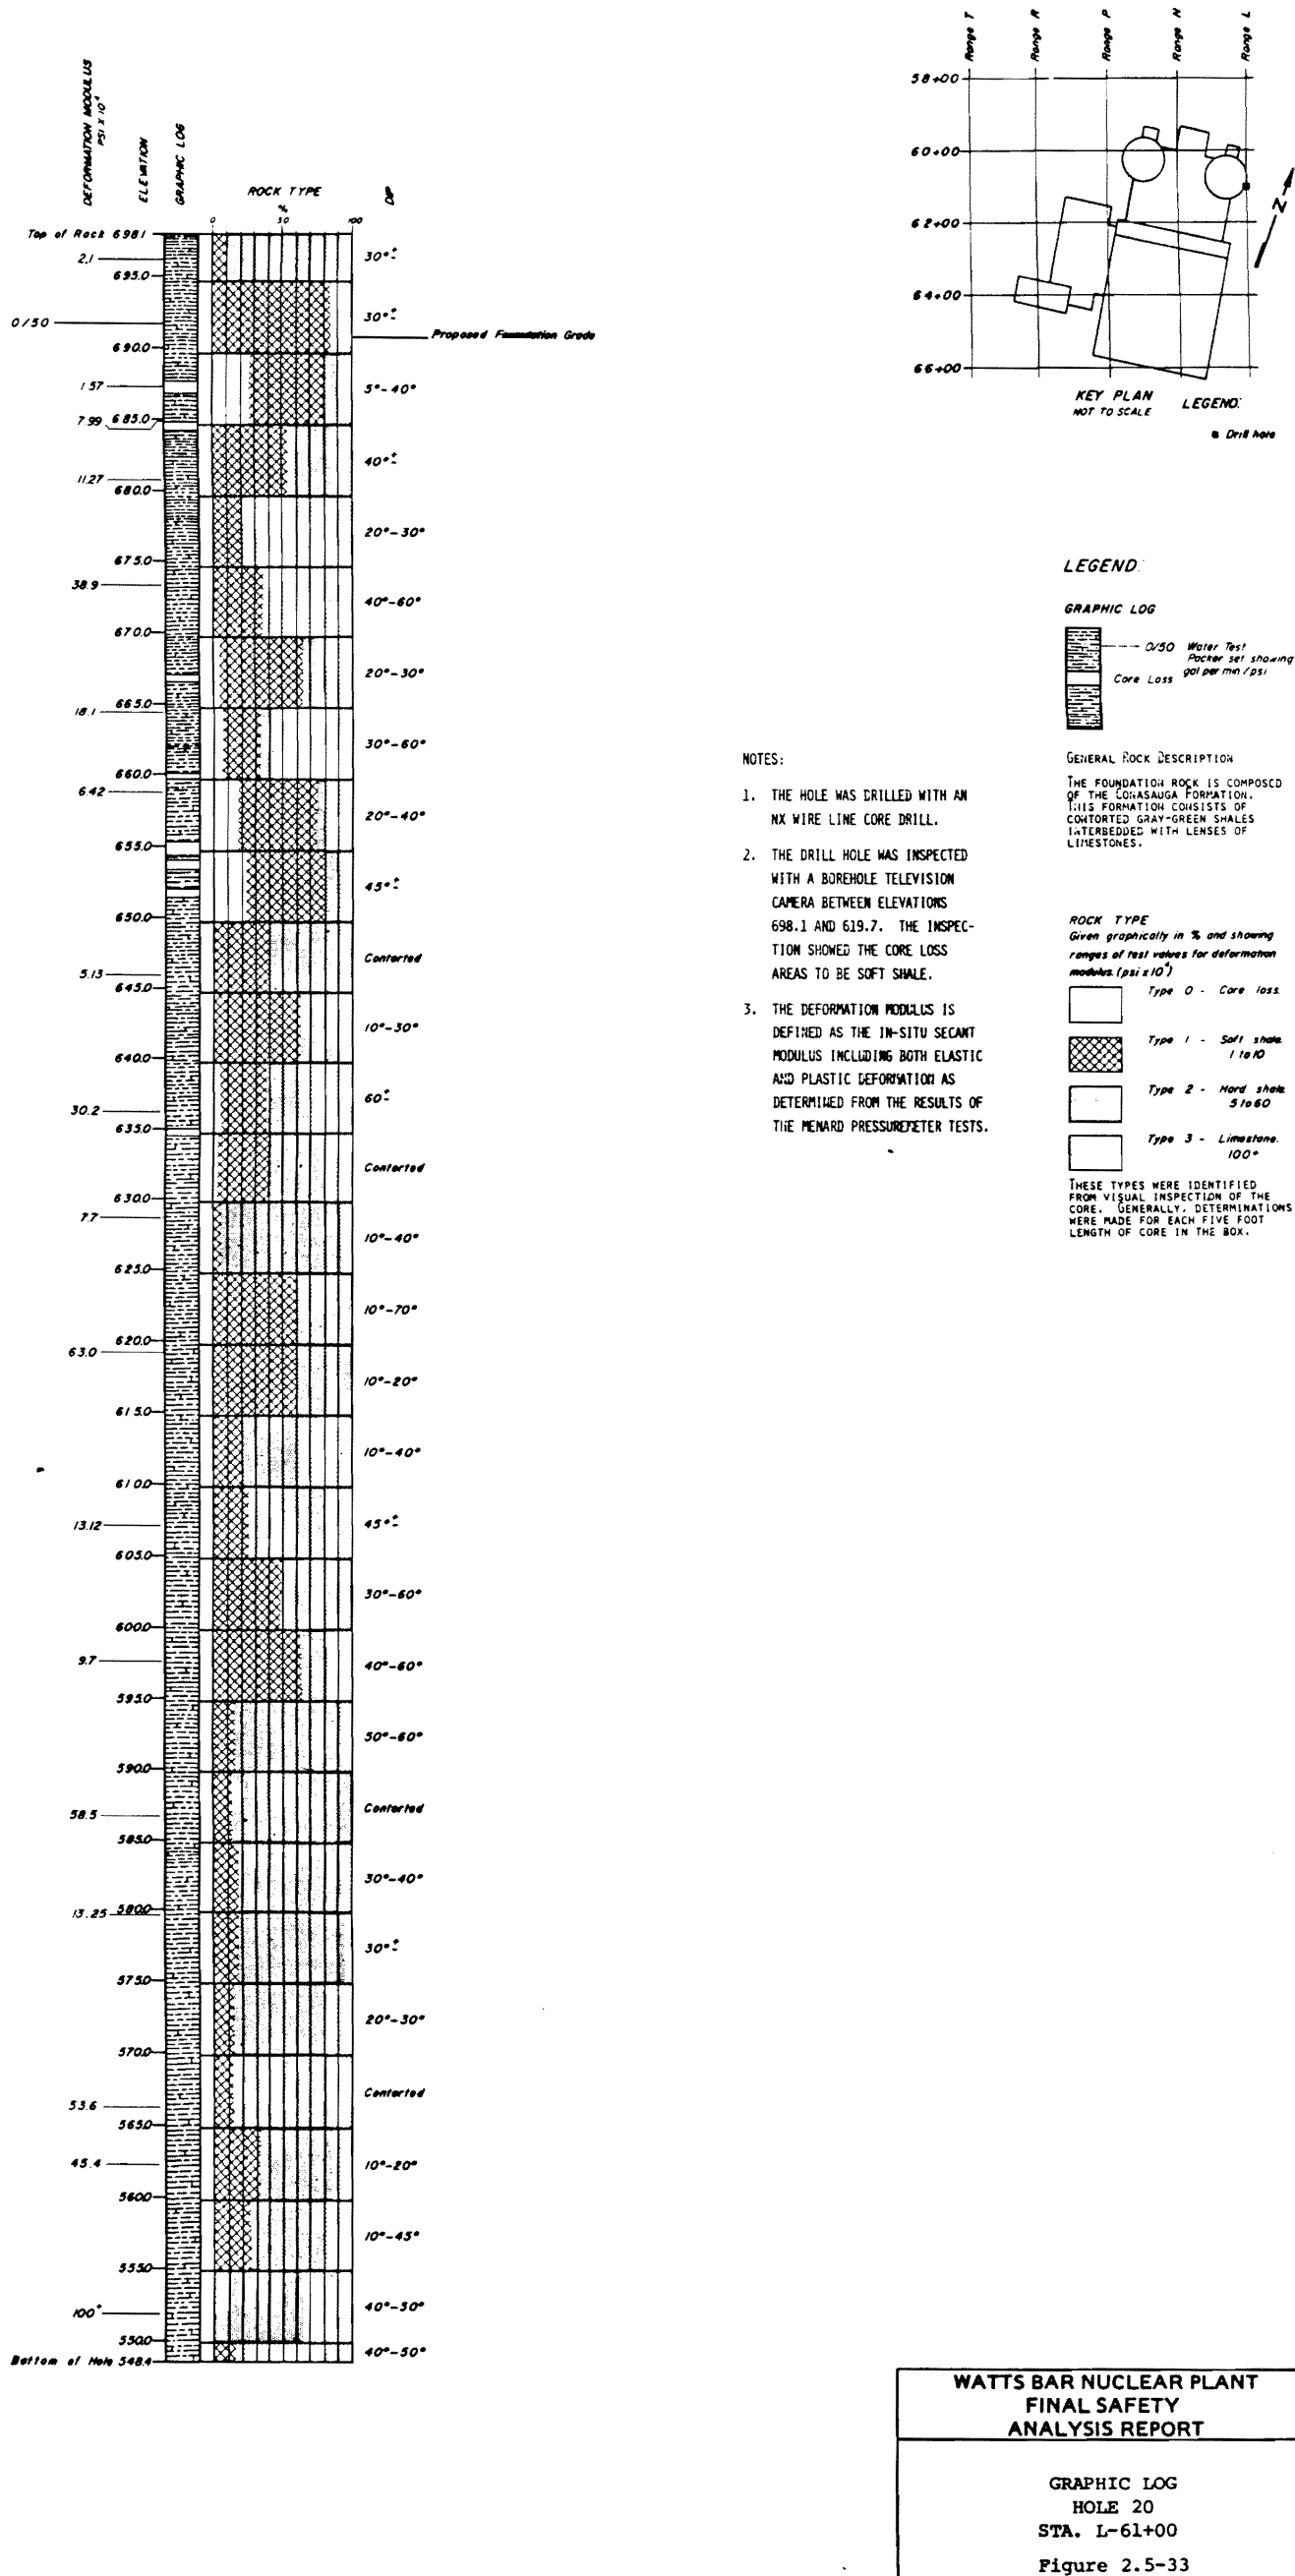



Figure 2.5-33 Graphic Log Hole 20 Sta. L-61+00

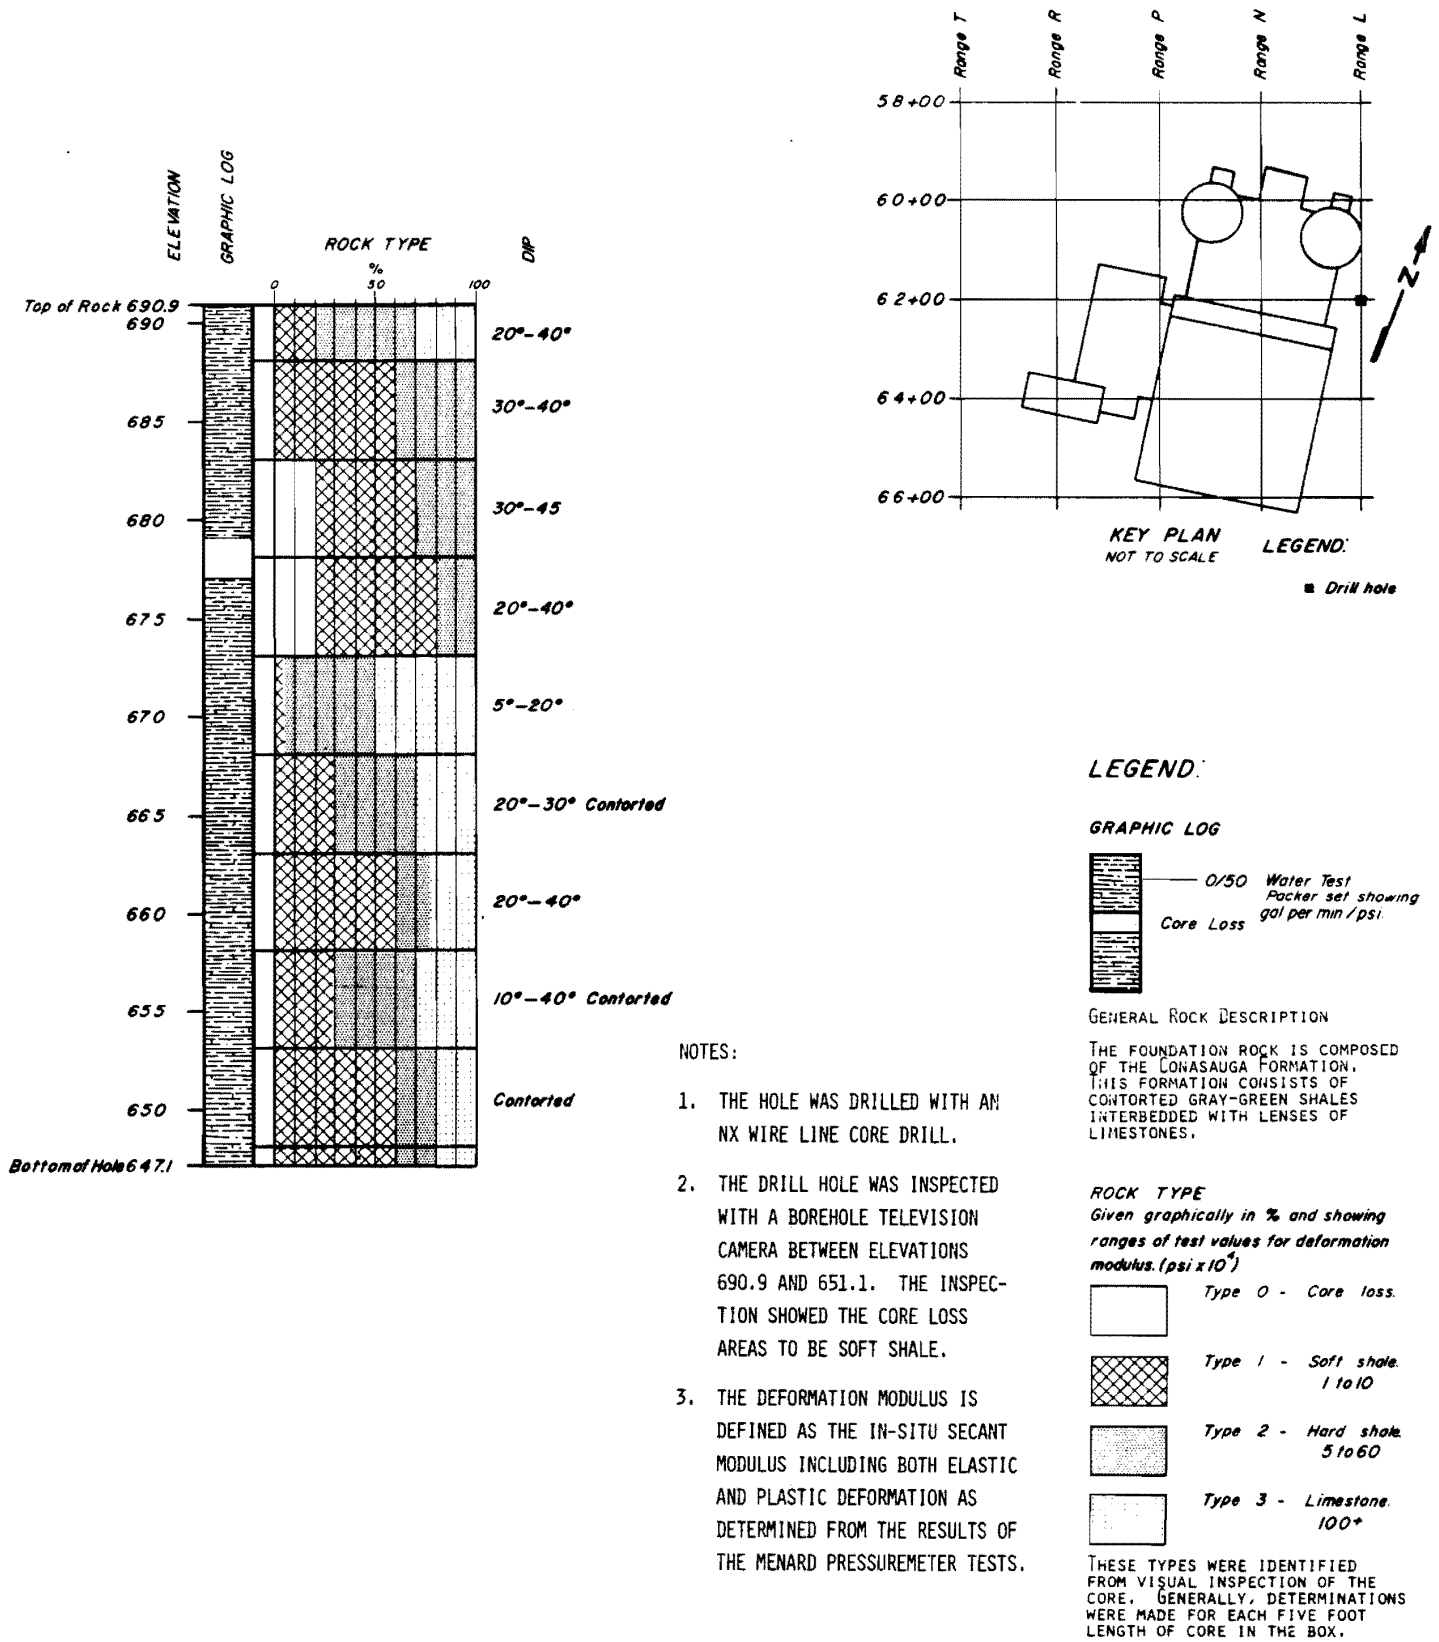

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 21
STA. L-62+00
Figure 2.5-34

Figure 2.5-34 Graphic Log Hole 21 Sta. L-62+00

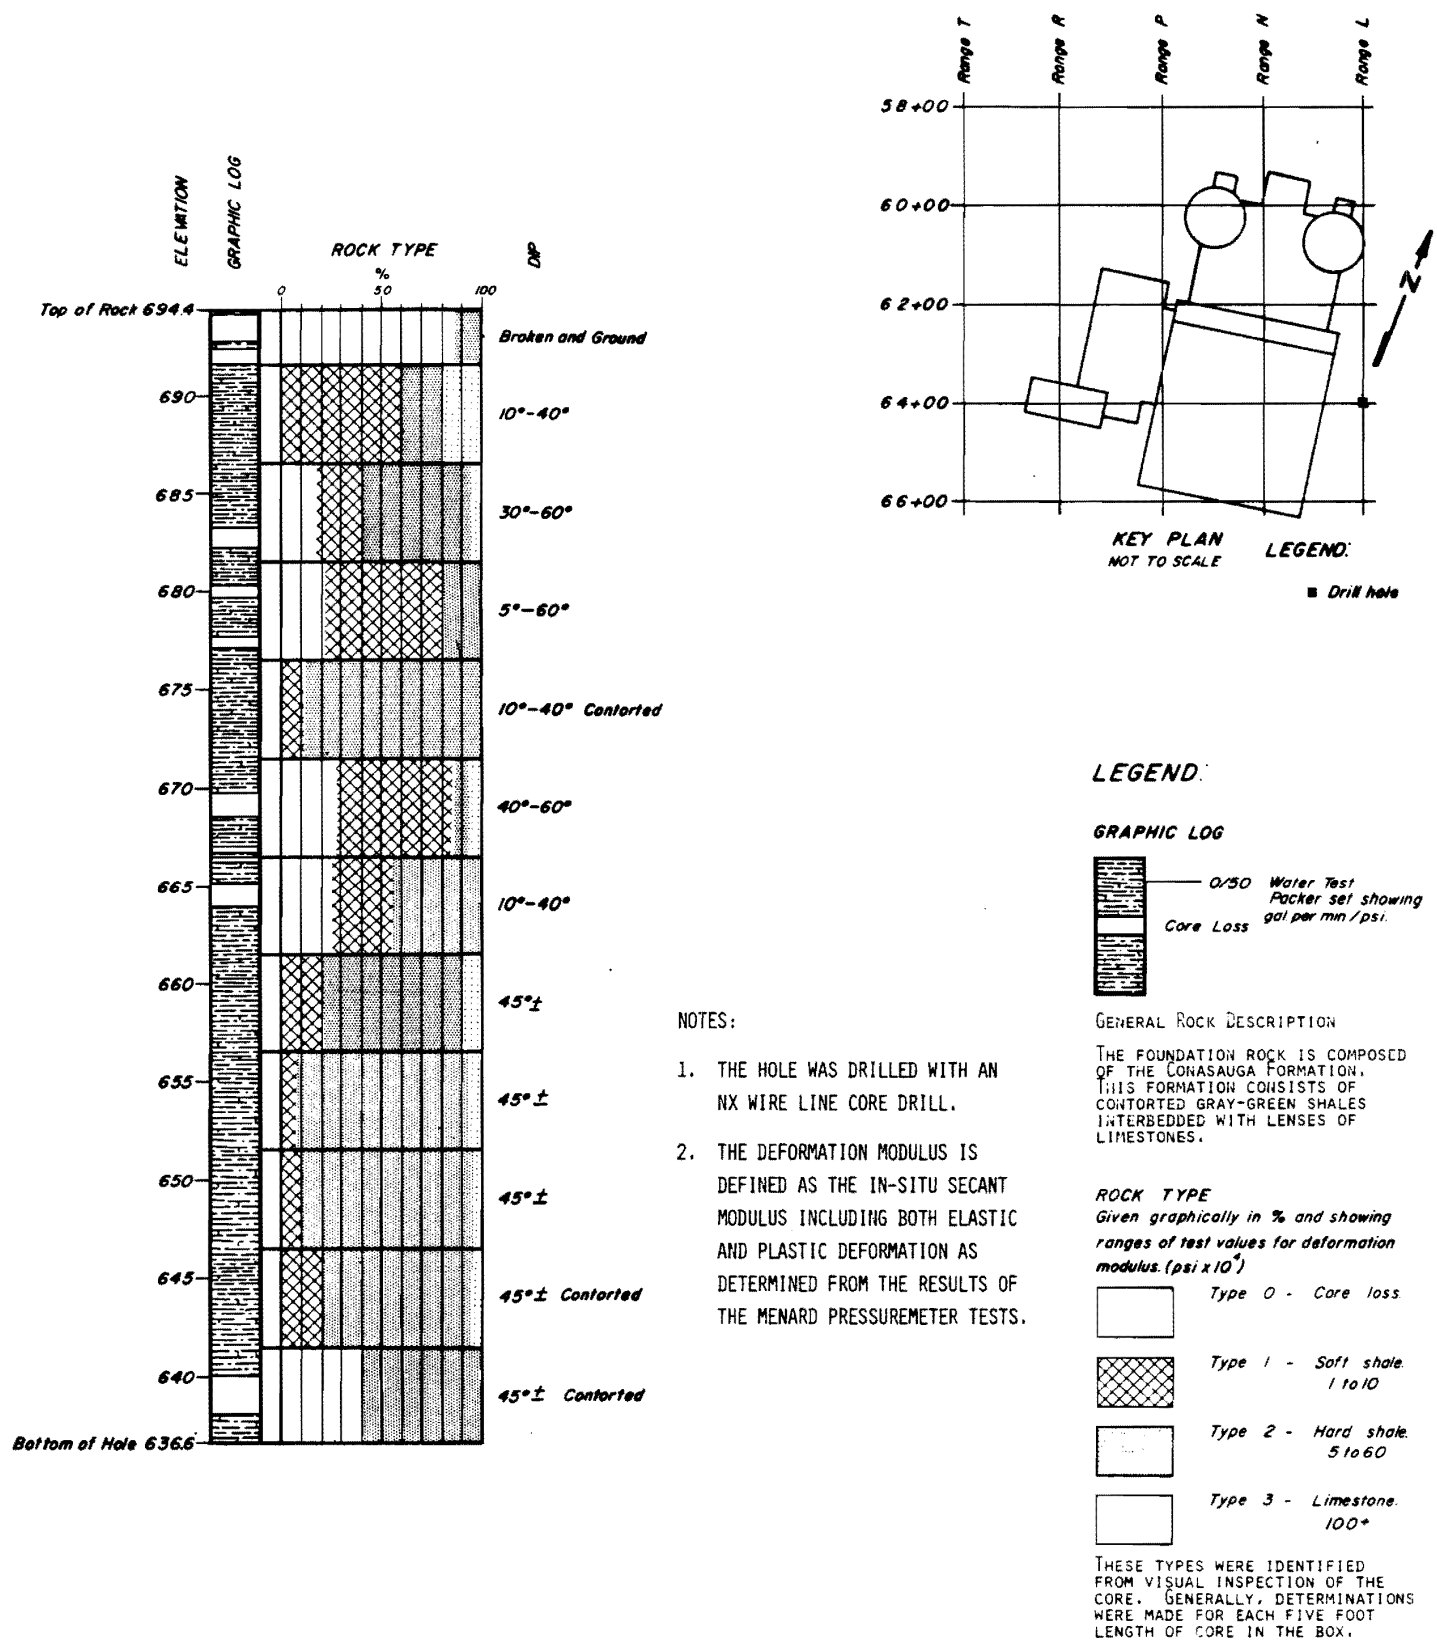

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 22
STA. L-64+00
Figure 2.5-35

Figure 2.5-35 Graphic Log Hole 22 Sta. L-64+00


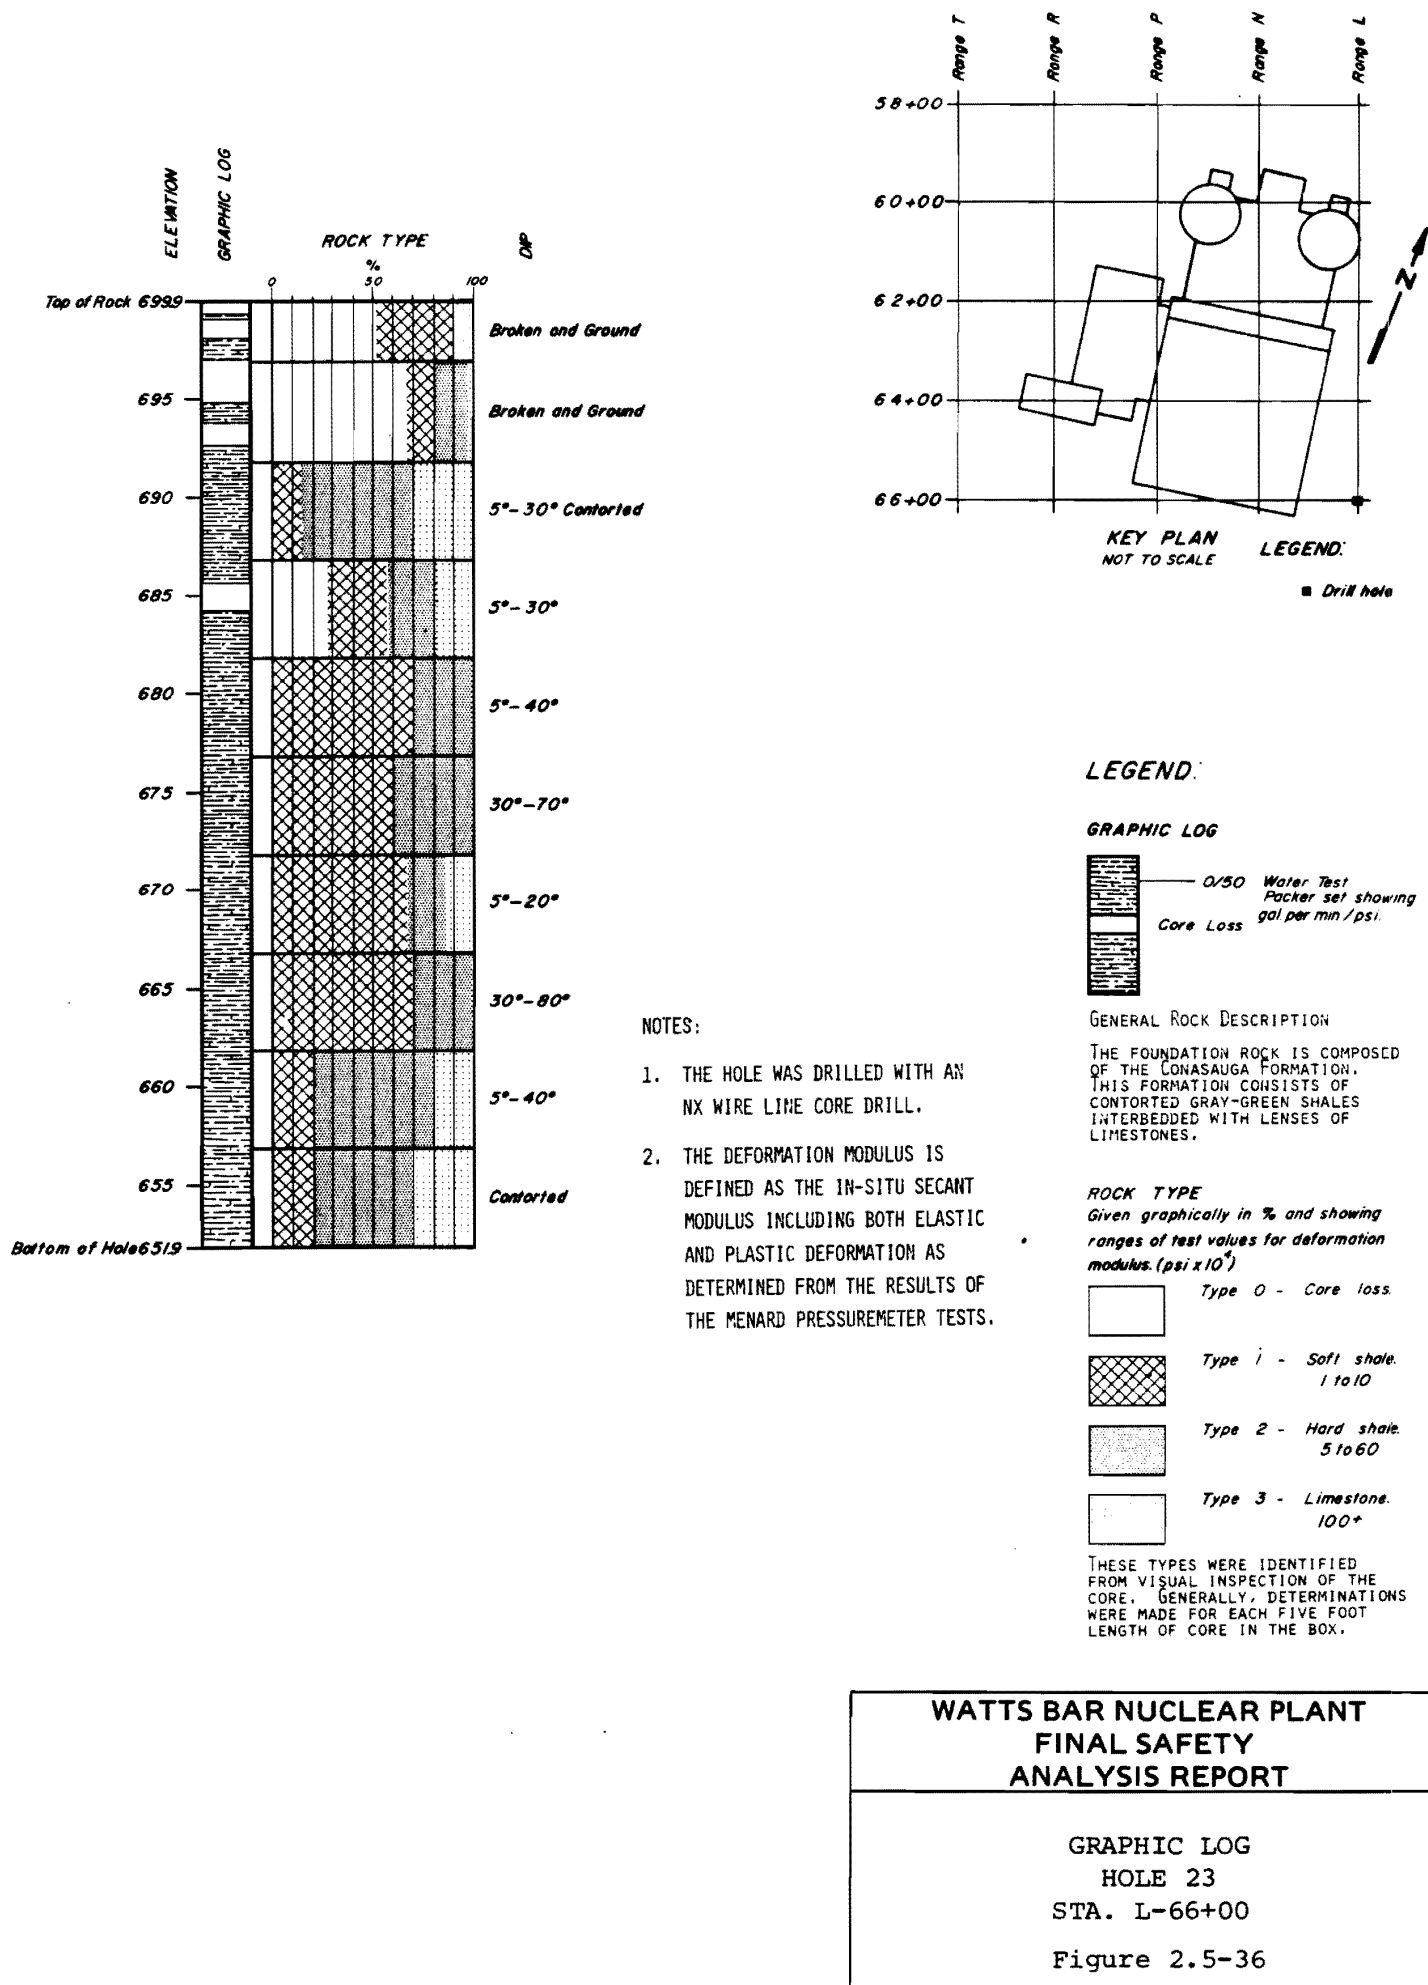



Figure 2.5-36 Graphic Log Hole 23 Sta. L-66+00

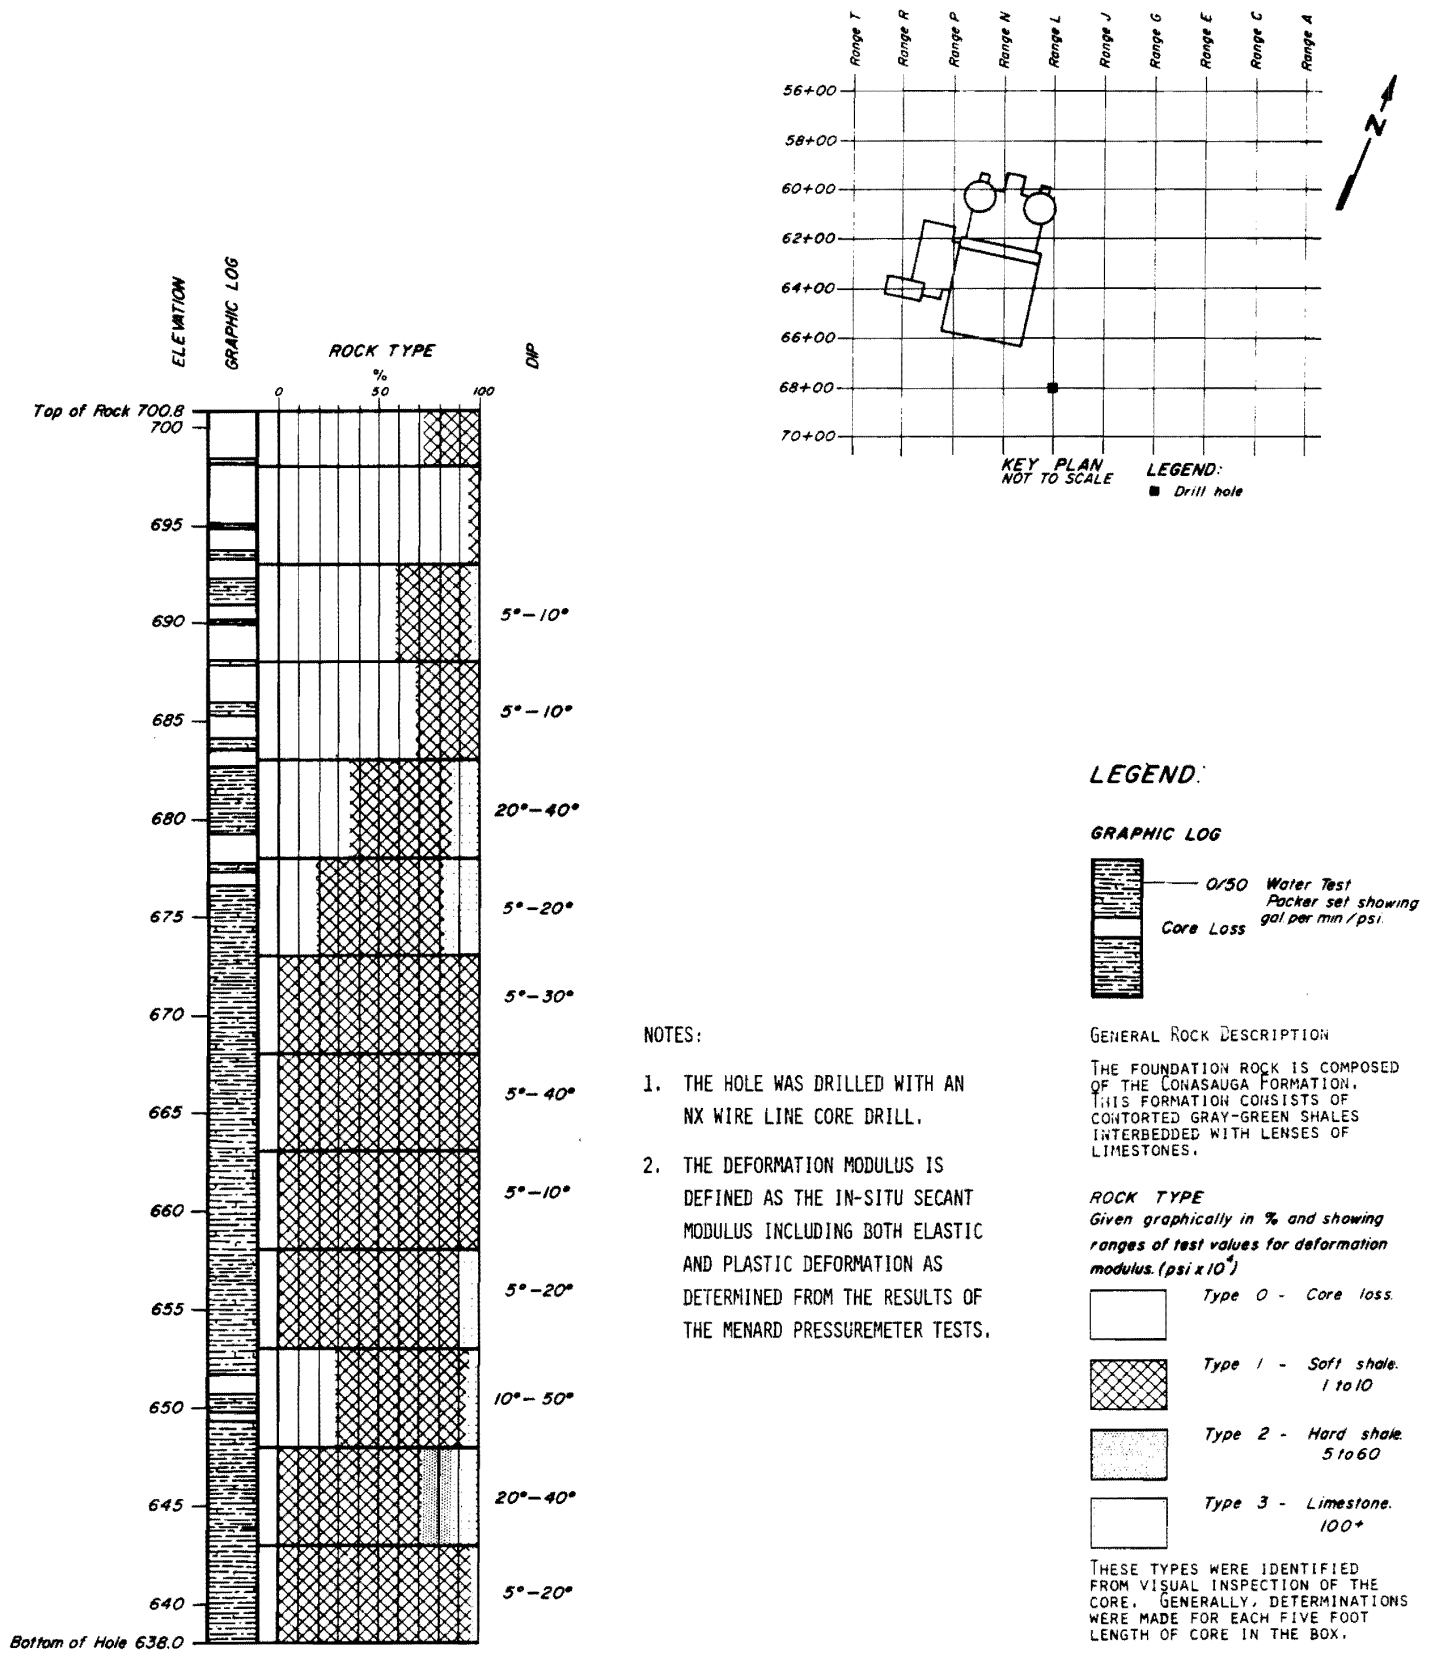

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 24
STA. L-68+00
Figure 2.5-37


Figure 2.5-37 Graphic Log Hole 24 Sta. L-68+00

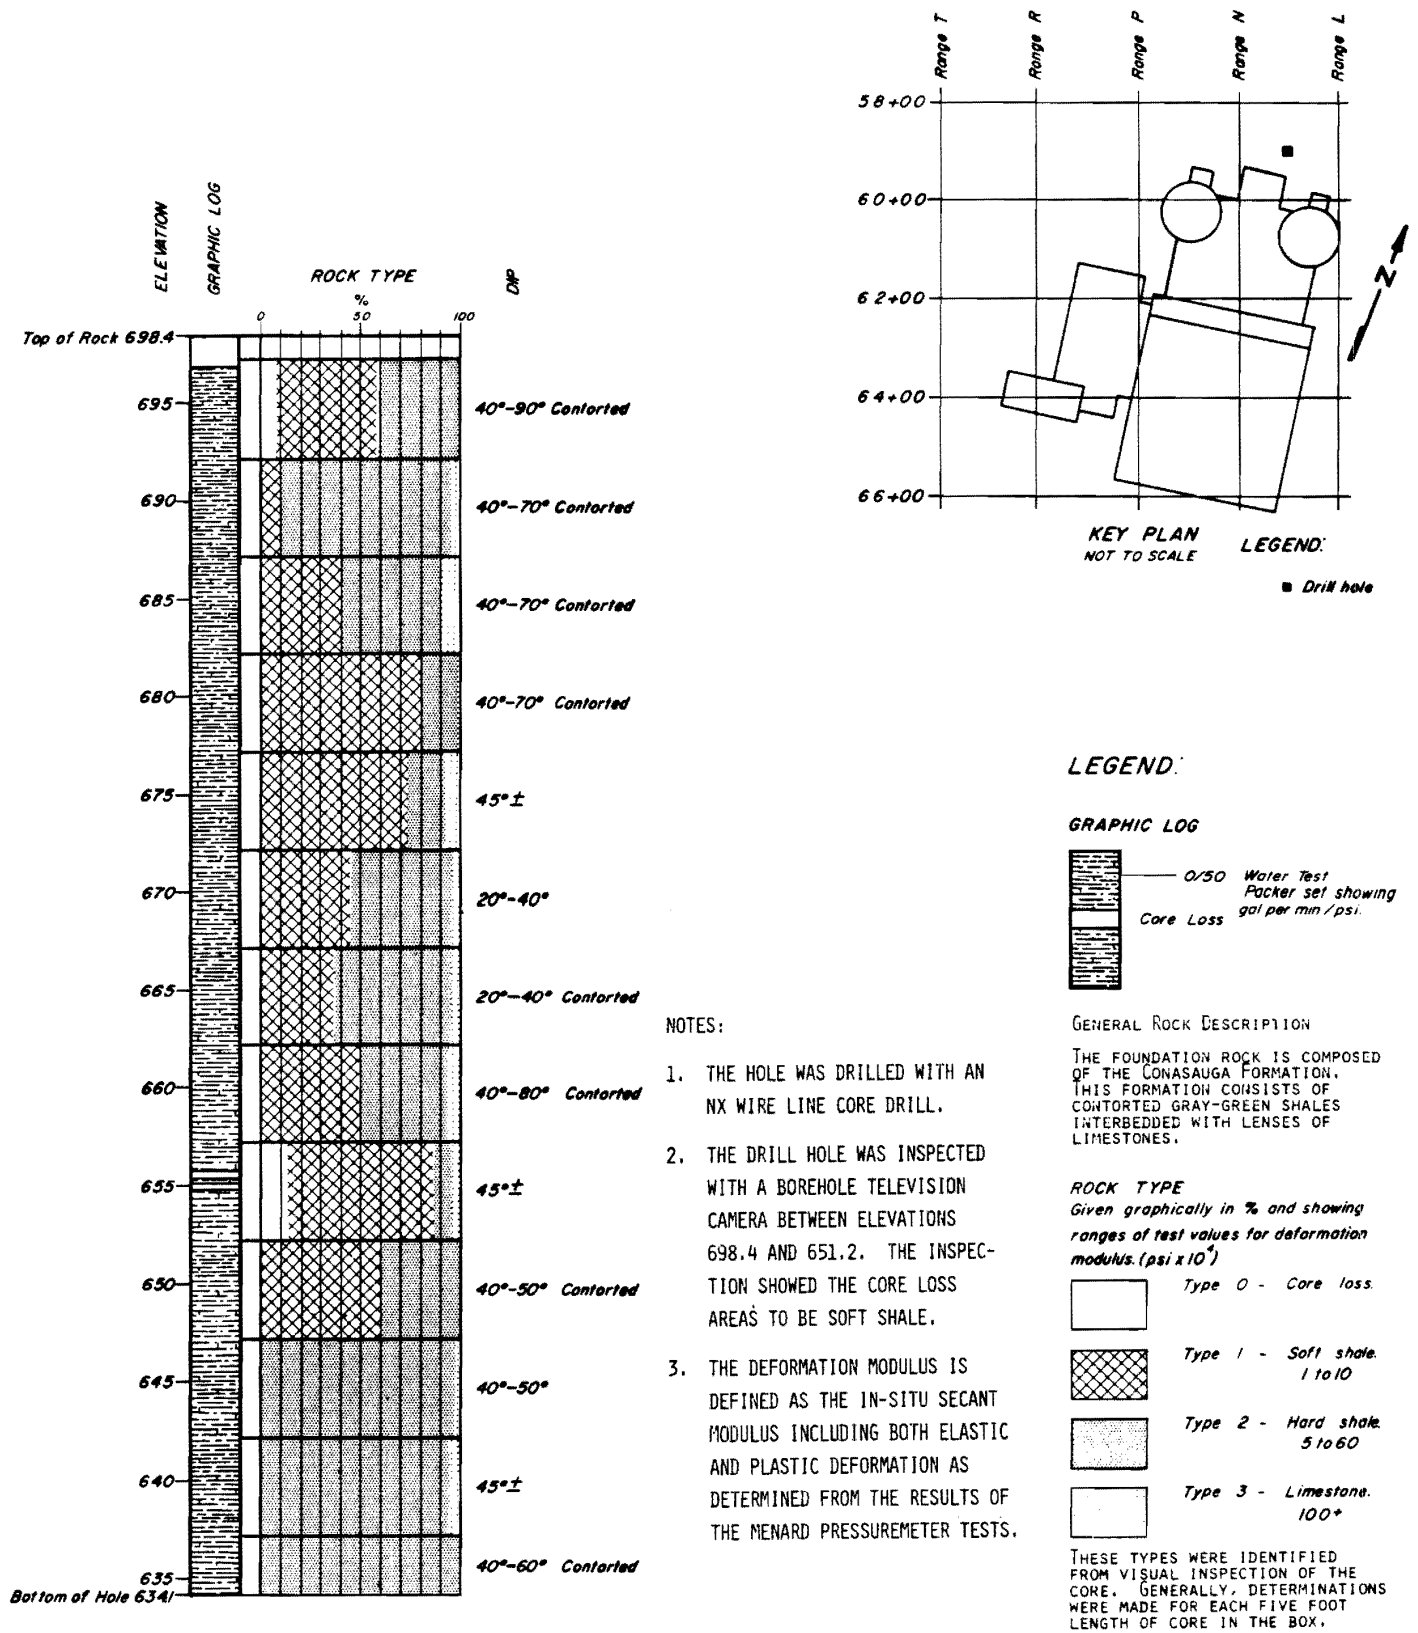

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 25
STA. M-59+00
Figure 2.5-38

Figure 2.5-38 Graphic Log Hole M-59+00

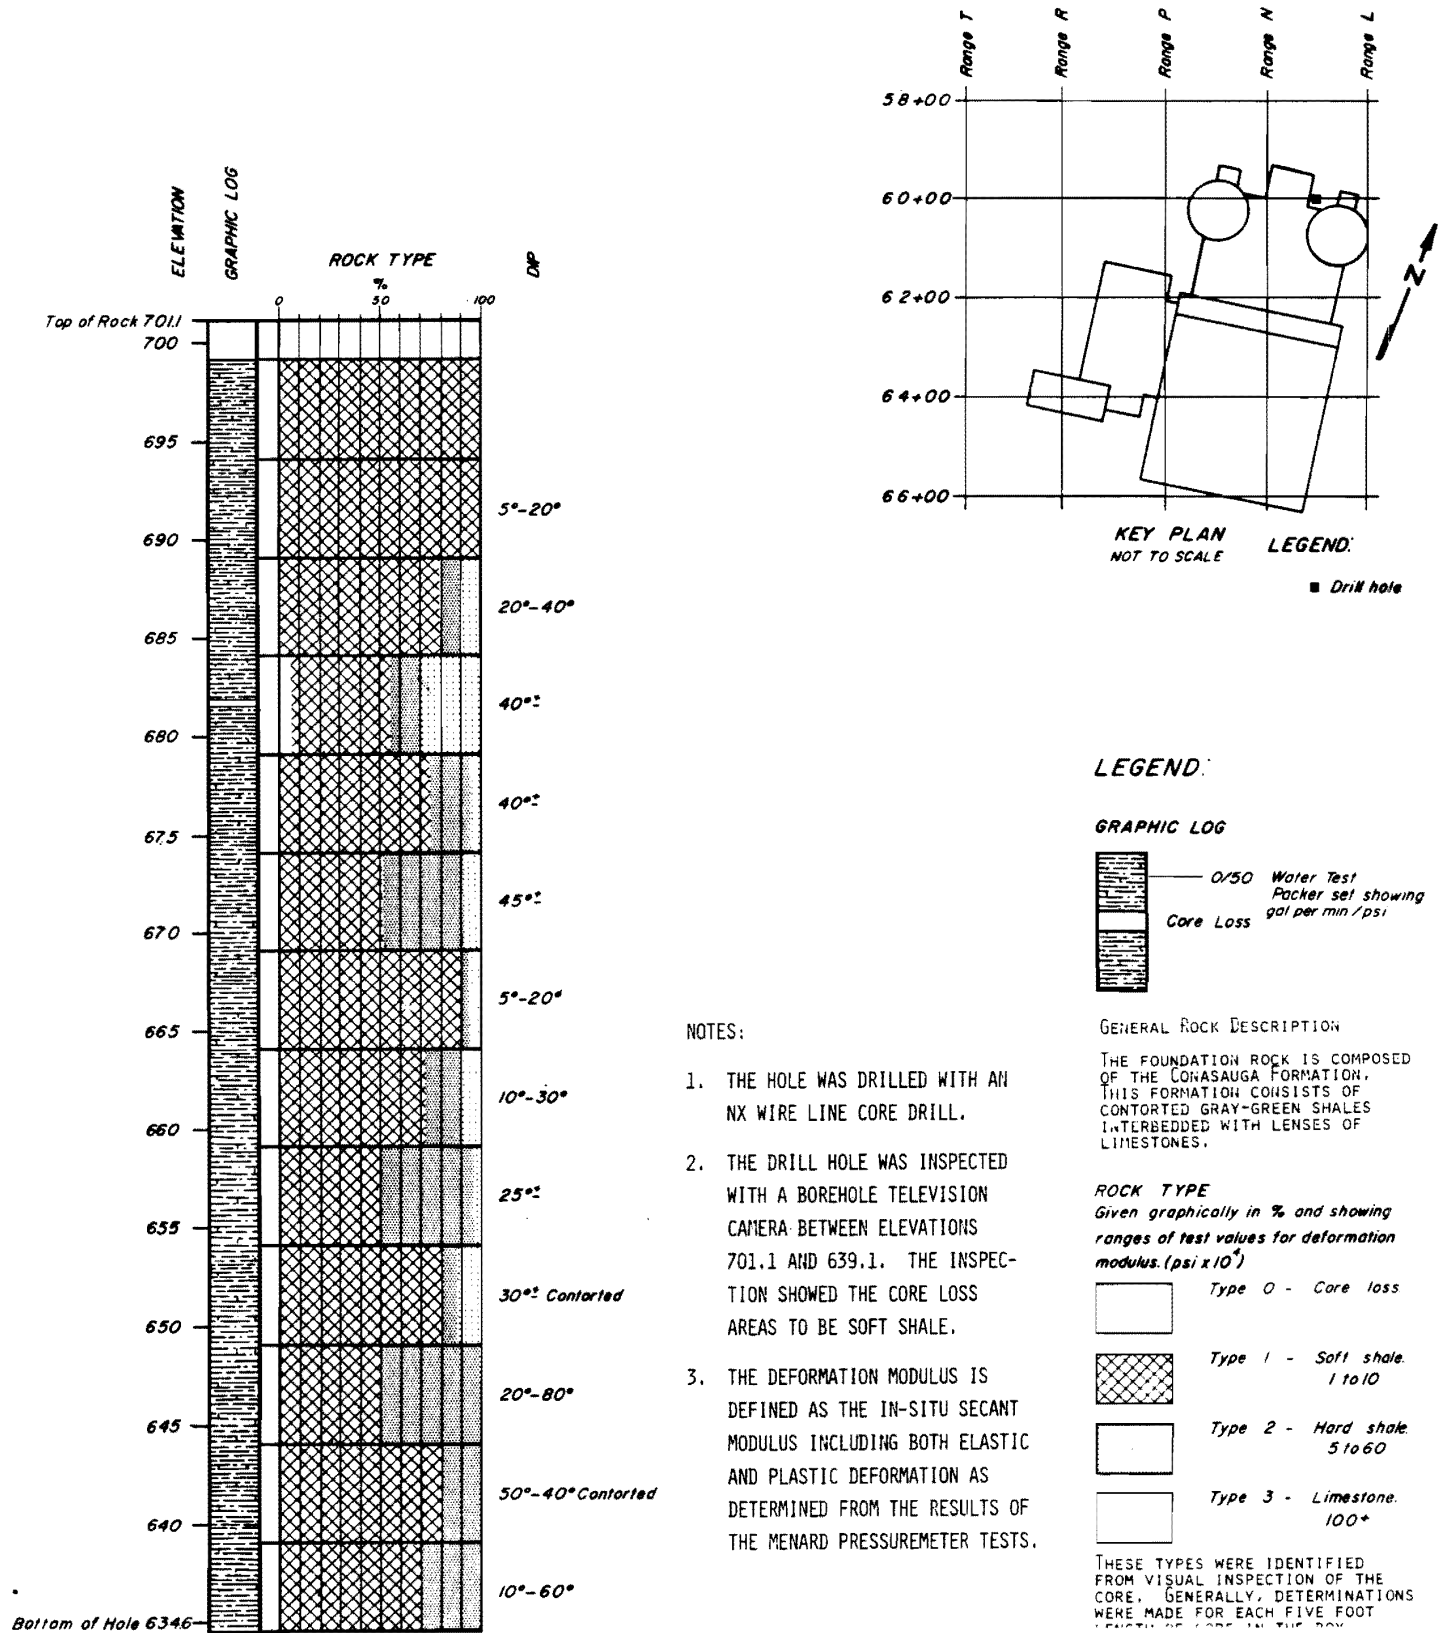


**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 26
STA. M-60+00
Figure 2.5-39

Figure 2.5-39 Graphic Log Hole 26M-60+00


Sta.

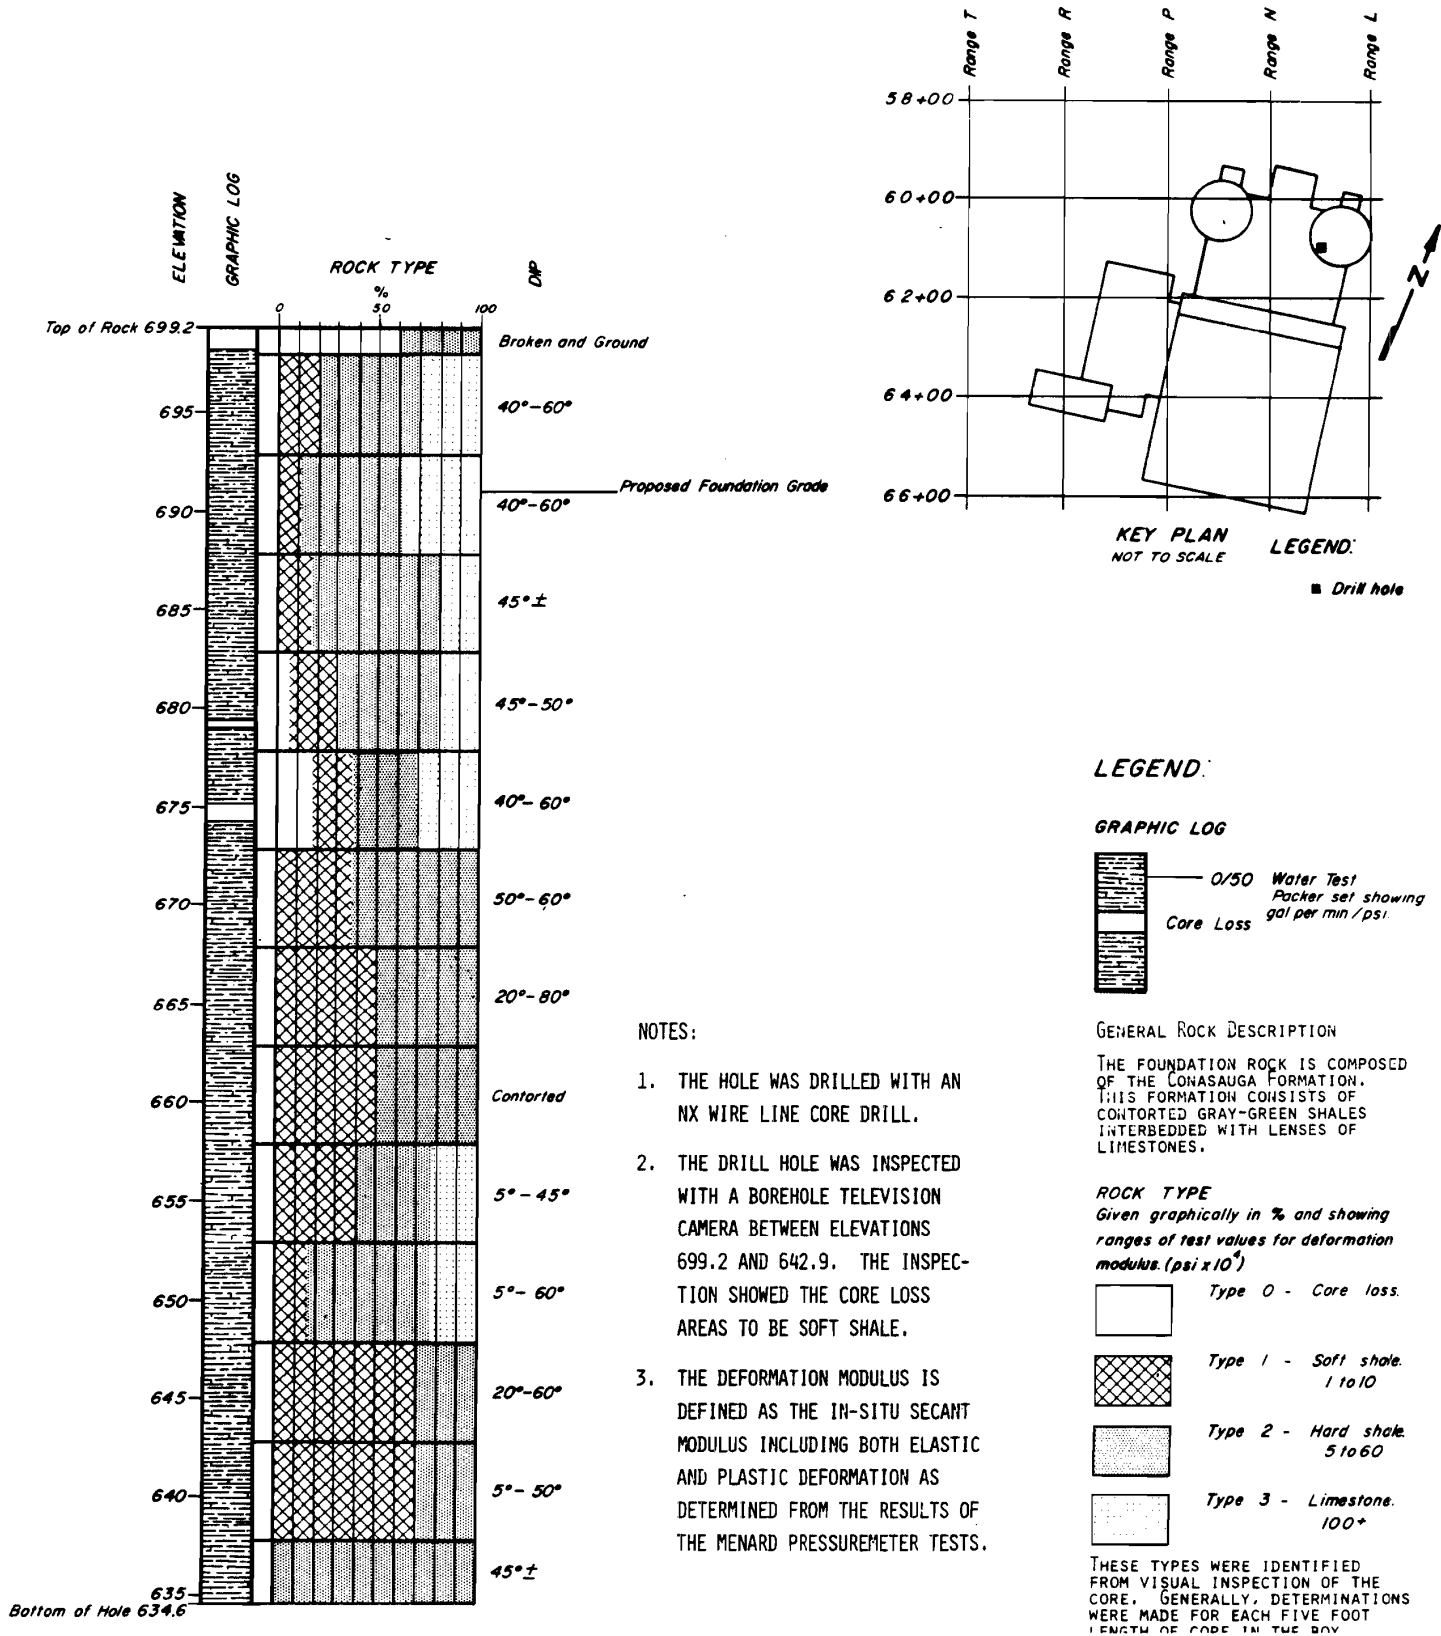

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 27
STA. M-61+00
Figure 2.5-40


Figure 2.5-40 Graphic Log Hole 27 Sta. M-61+00

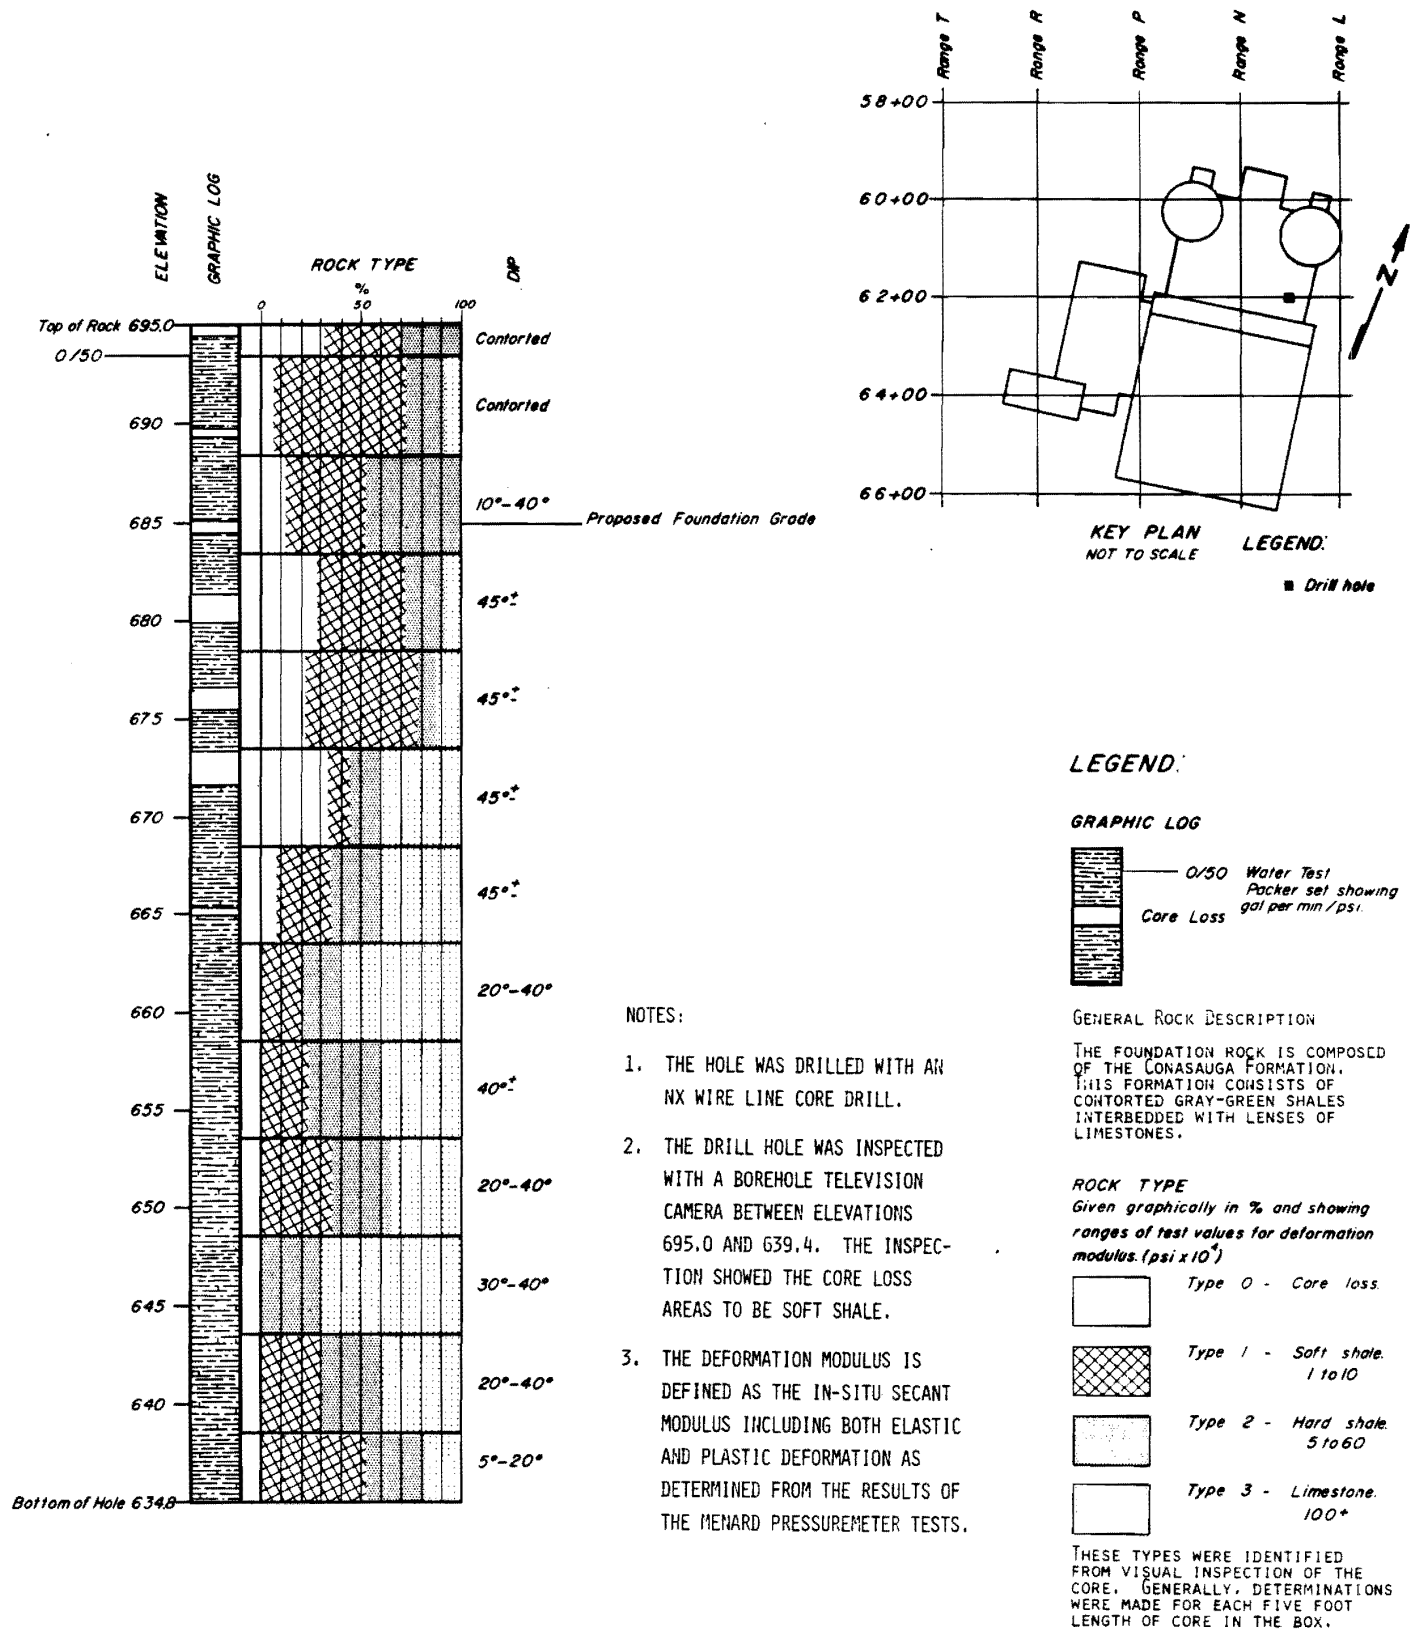

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 28
STA. M-62+00
Figure 2.5-41




Figure 2.5-41 Graphic Log Hole 28 Sta.M-62+00

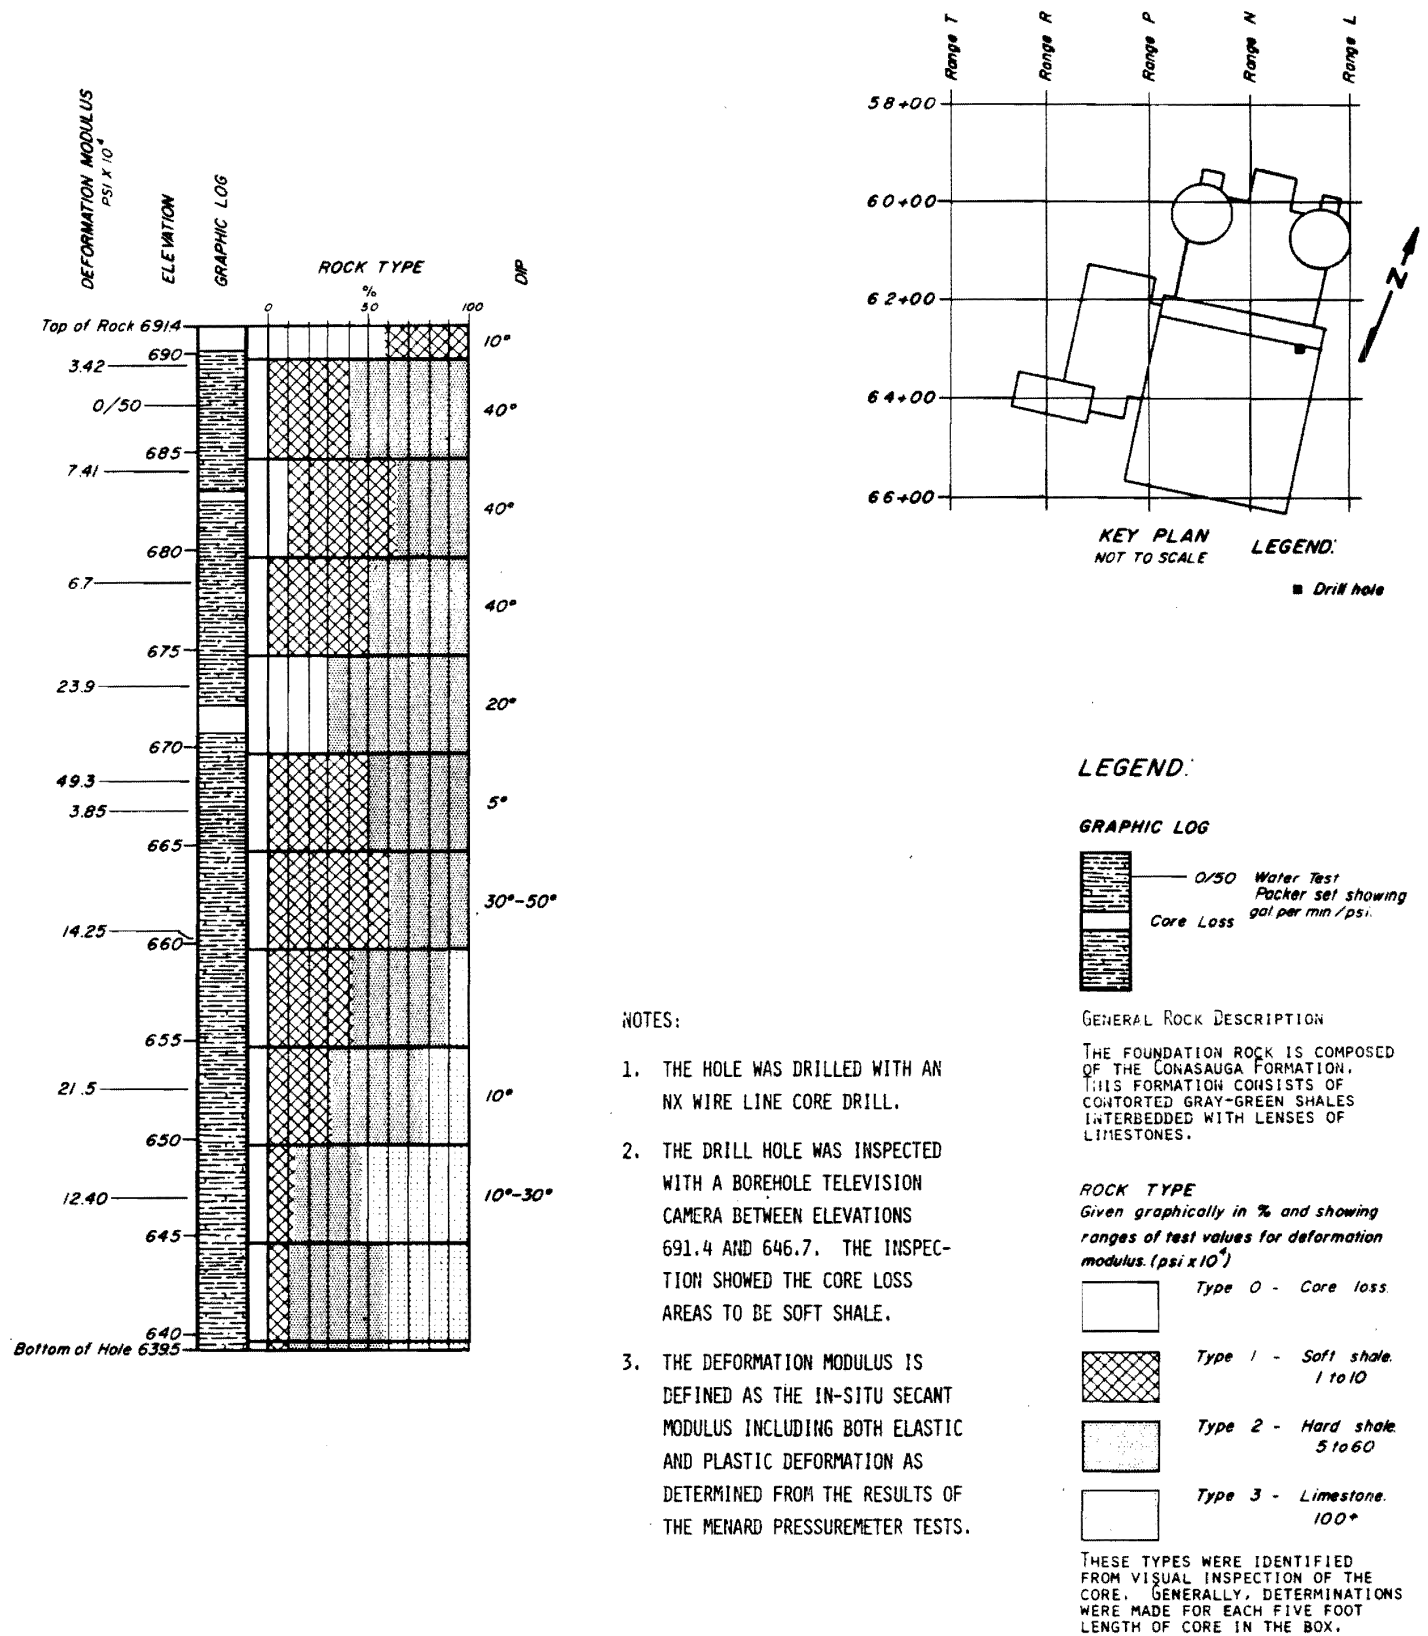

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 29
STA. M-63+00
Figure 2.5-42

Figure 2.5-42 Graphic Log Hole 29 Sta. M-63+00

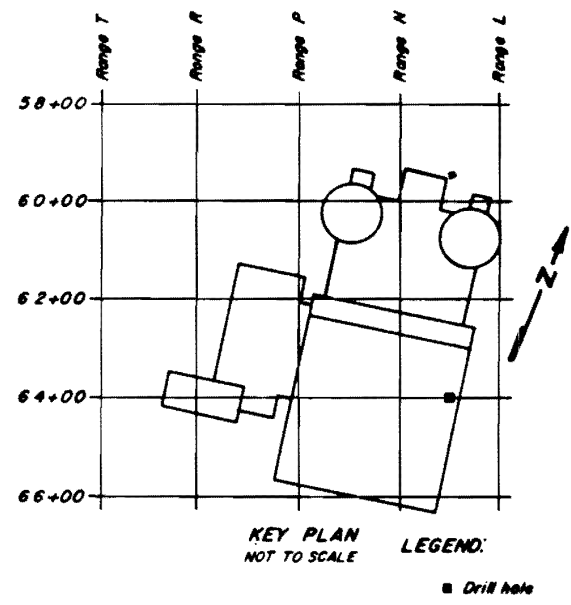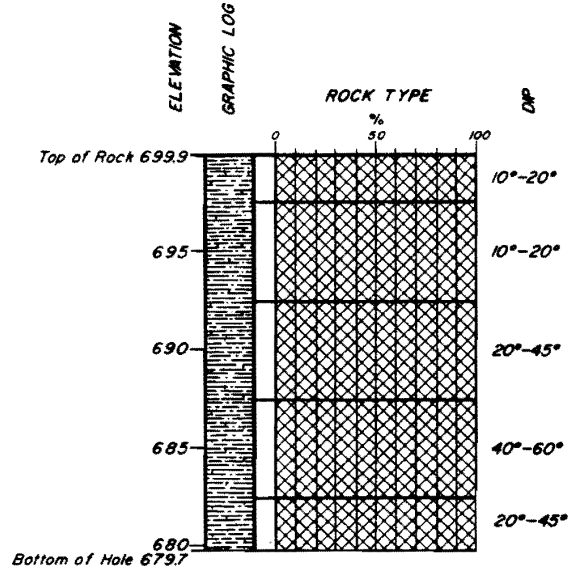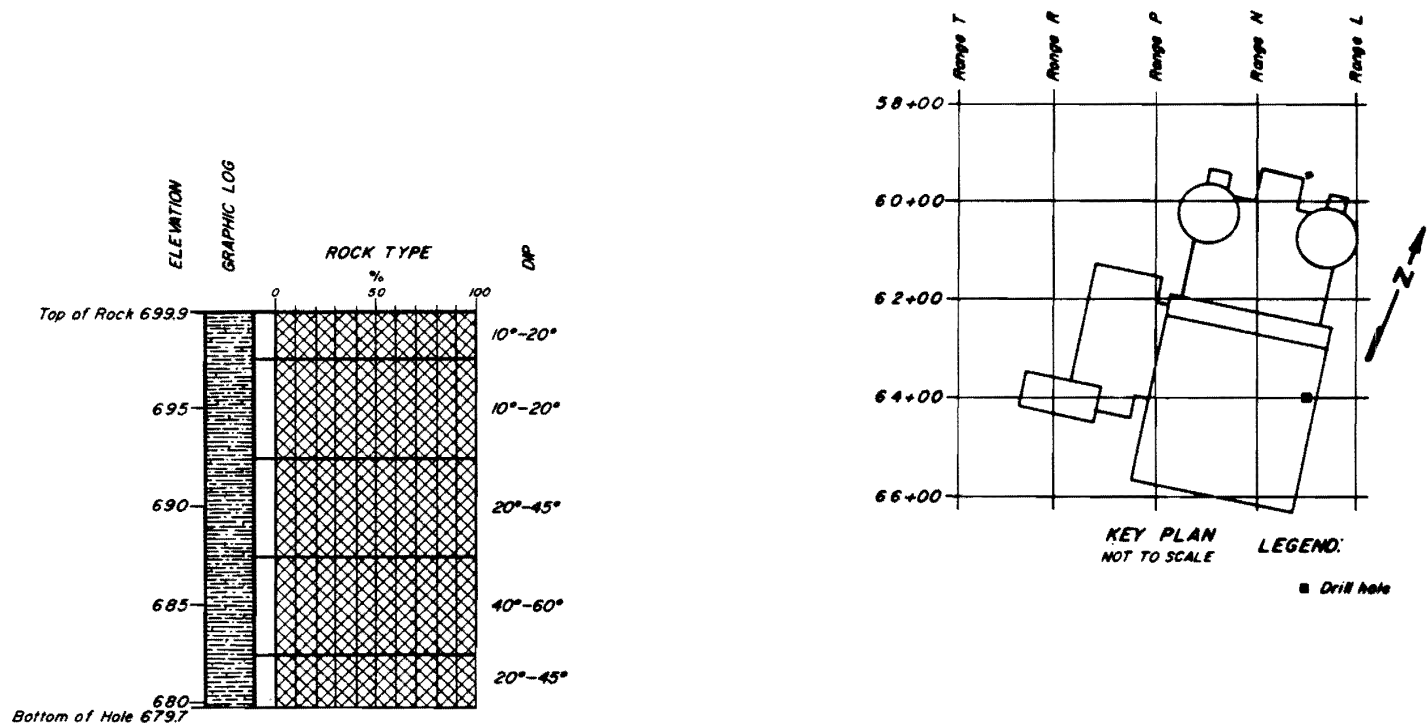


NOTES:

1. THE HOLE WAS DRILLED WITH AN NX WIRE LINE CORE DRILL.
2. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.

LEGEND:

GRAPHIC LOG

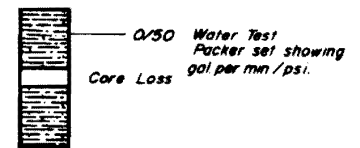

GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.

ROCK TYPE

Given graphically in % and showing ranges of test values for deformation modulus. (psi x 10³)




- Type 0 - Core loss.
- Type 1 - Soft shale. 1 to 10
- Type 2 - Hard shale. 5 to 60
- Type 3 - Limestone. 100+

THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.

**WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT**

GRAPHIC LOG
 HOLE 30
 STA. M-64+00
 Figure 2.5-43


Figure 2.5-43 Graphic Log Hole 30 Sta. M-64+00

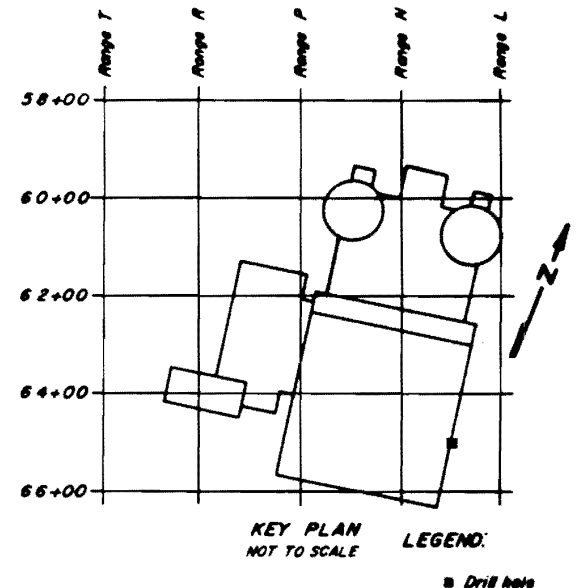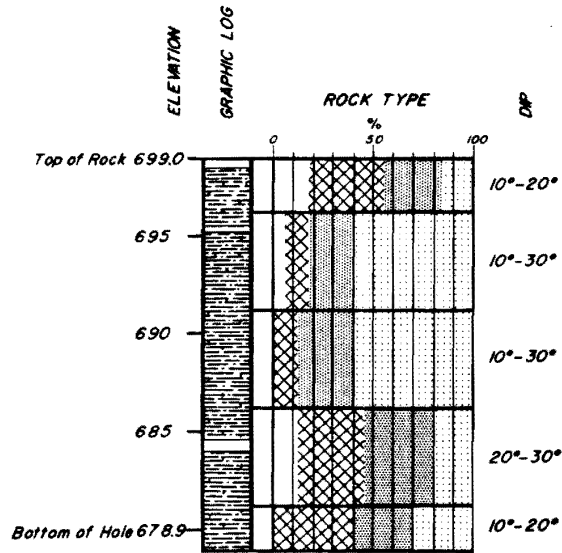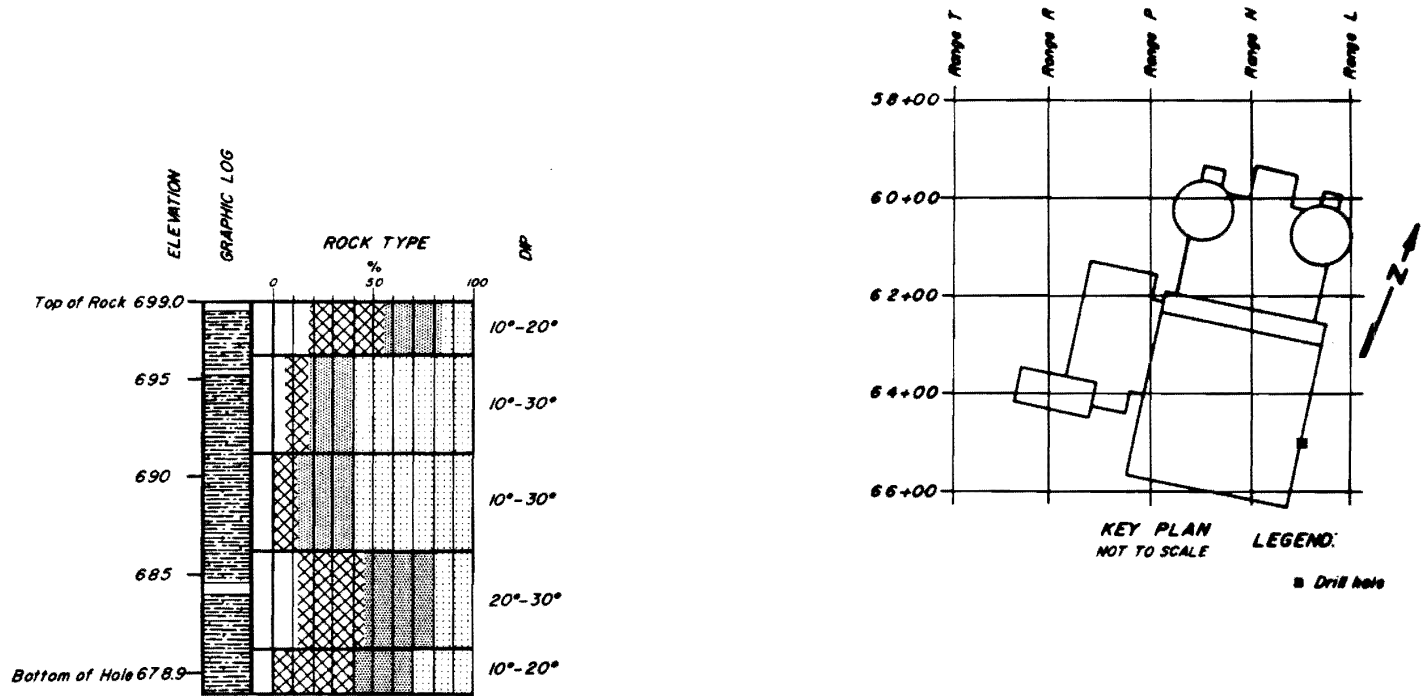

NOTES:

1. THE HOLE WAS DRILLED WITH AN NX WIRE LINE CORE DRILL.
2. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.

LEGEND:

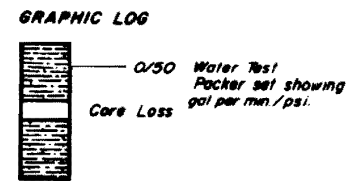

GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.


ROCK TYPE
Given graphically in % and showing ranges of test values for deformation modulus. (psi x 10⁴)

- Type 0 - Core loss.
- Type 1 - Soft shale. 1 to 10
- Type 2 - Hard shale. 5 to 60
- Type 3 - Limestone. 100+

THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>GRAPHIC LOG HOLE 31 STA. M-65+00 Figure 2.5-44</p>

Figure 2.5-44 Graphic Log Hole 31 Sta. M-65+00

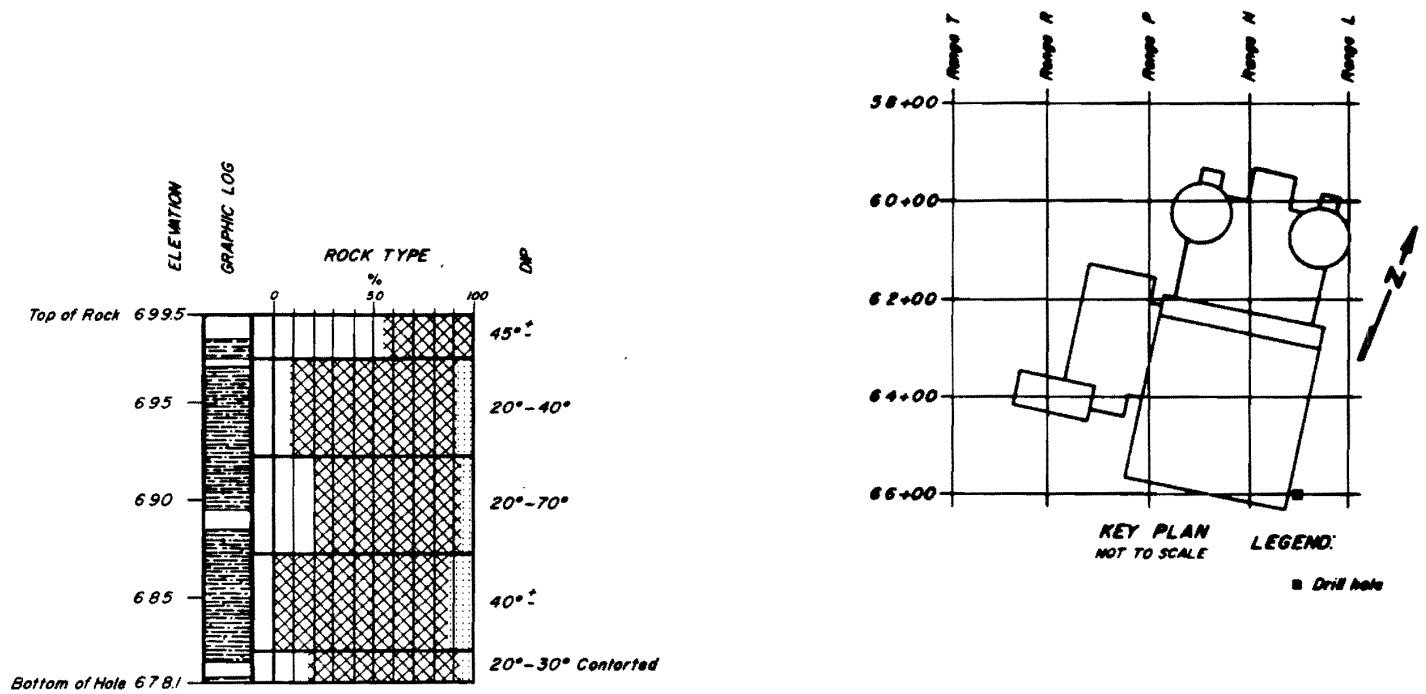

LEGEND:

GRAPHIC LOG

— O/SO Water Test
Packer set showing
Core Loss gal per min / psi.

GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.

ROCK TYPE
Given graphically in % and showing ranges of test values for deformation modulus. (psi x 10⁴)


□	Type 0 - Core loss.
▨	Type 1 - Soft shale. 1 to 10
▩	Type 2 - Hard shale. 5 to 60
□	Type 3 - Limestone. 100+

THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.

- NOTES:**
1. THE HOLE WAS DRILLED WITH AN NX WIRE LINE CORE DRILL.
 2. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>GRAPHIC LOG HOLE 32 STA. M-66+00 Figure 2.5-45</p>


Figure 2.5-45 Graphic Log Hole 32 Sta. M-66+00

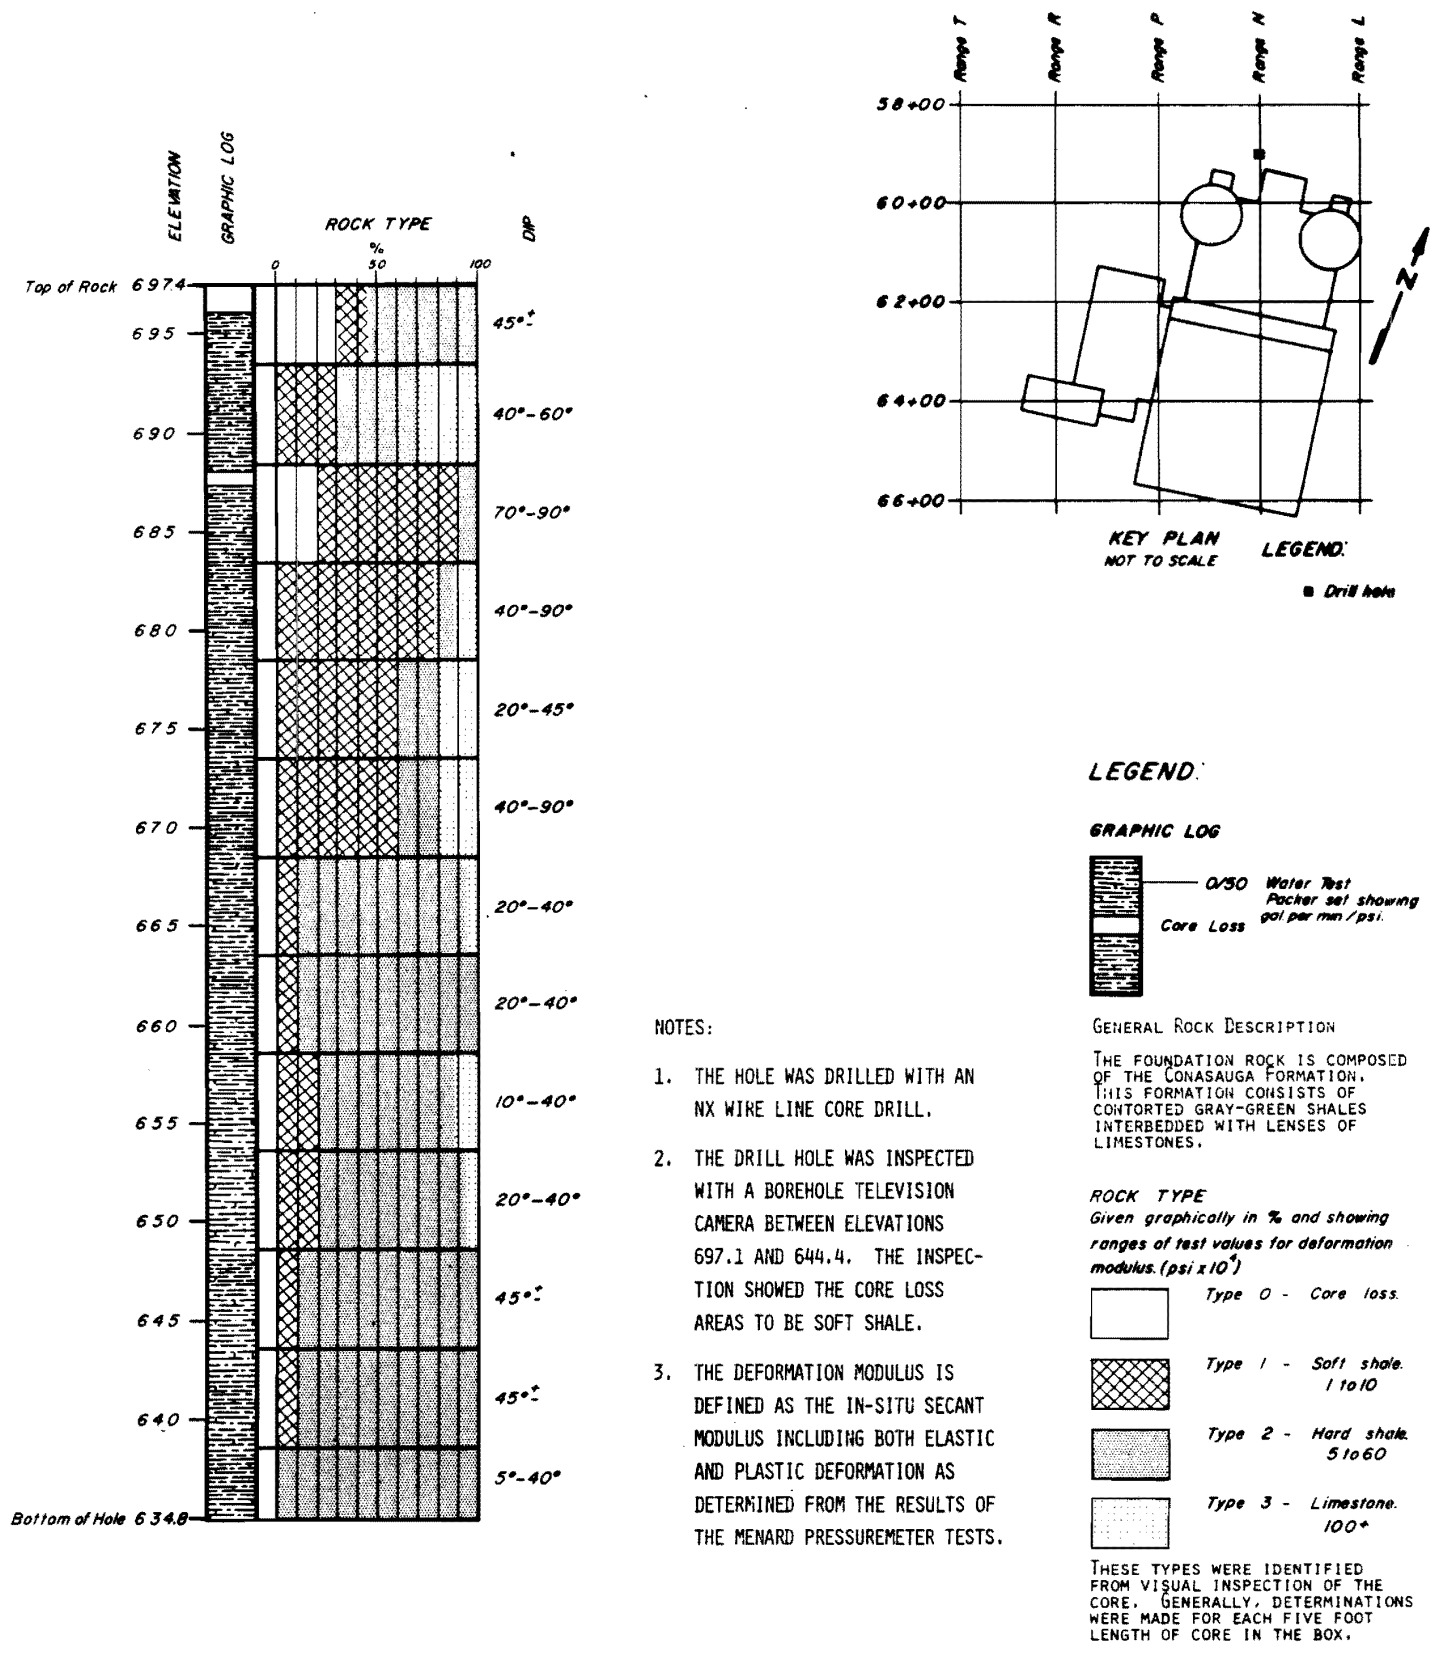

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 33
STA. N-59+00
Figure 2.5-46

Figure 2.5-46 Graphic Log Hole 33 Sta. N-59+00

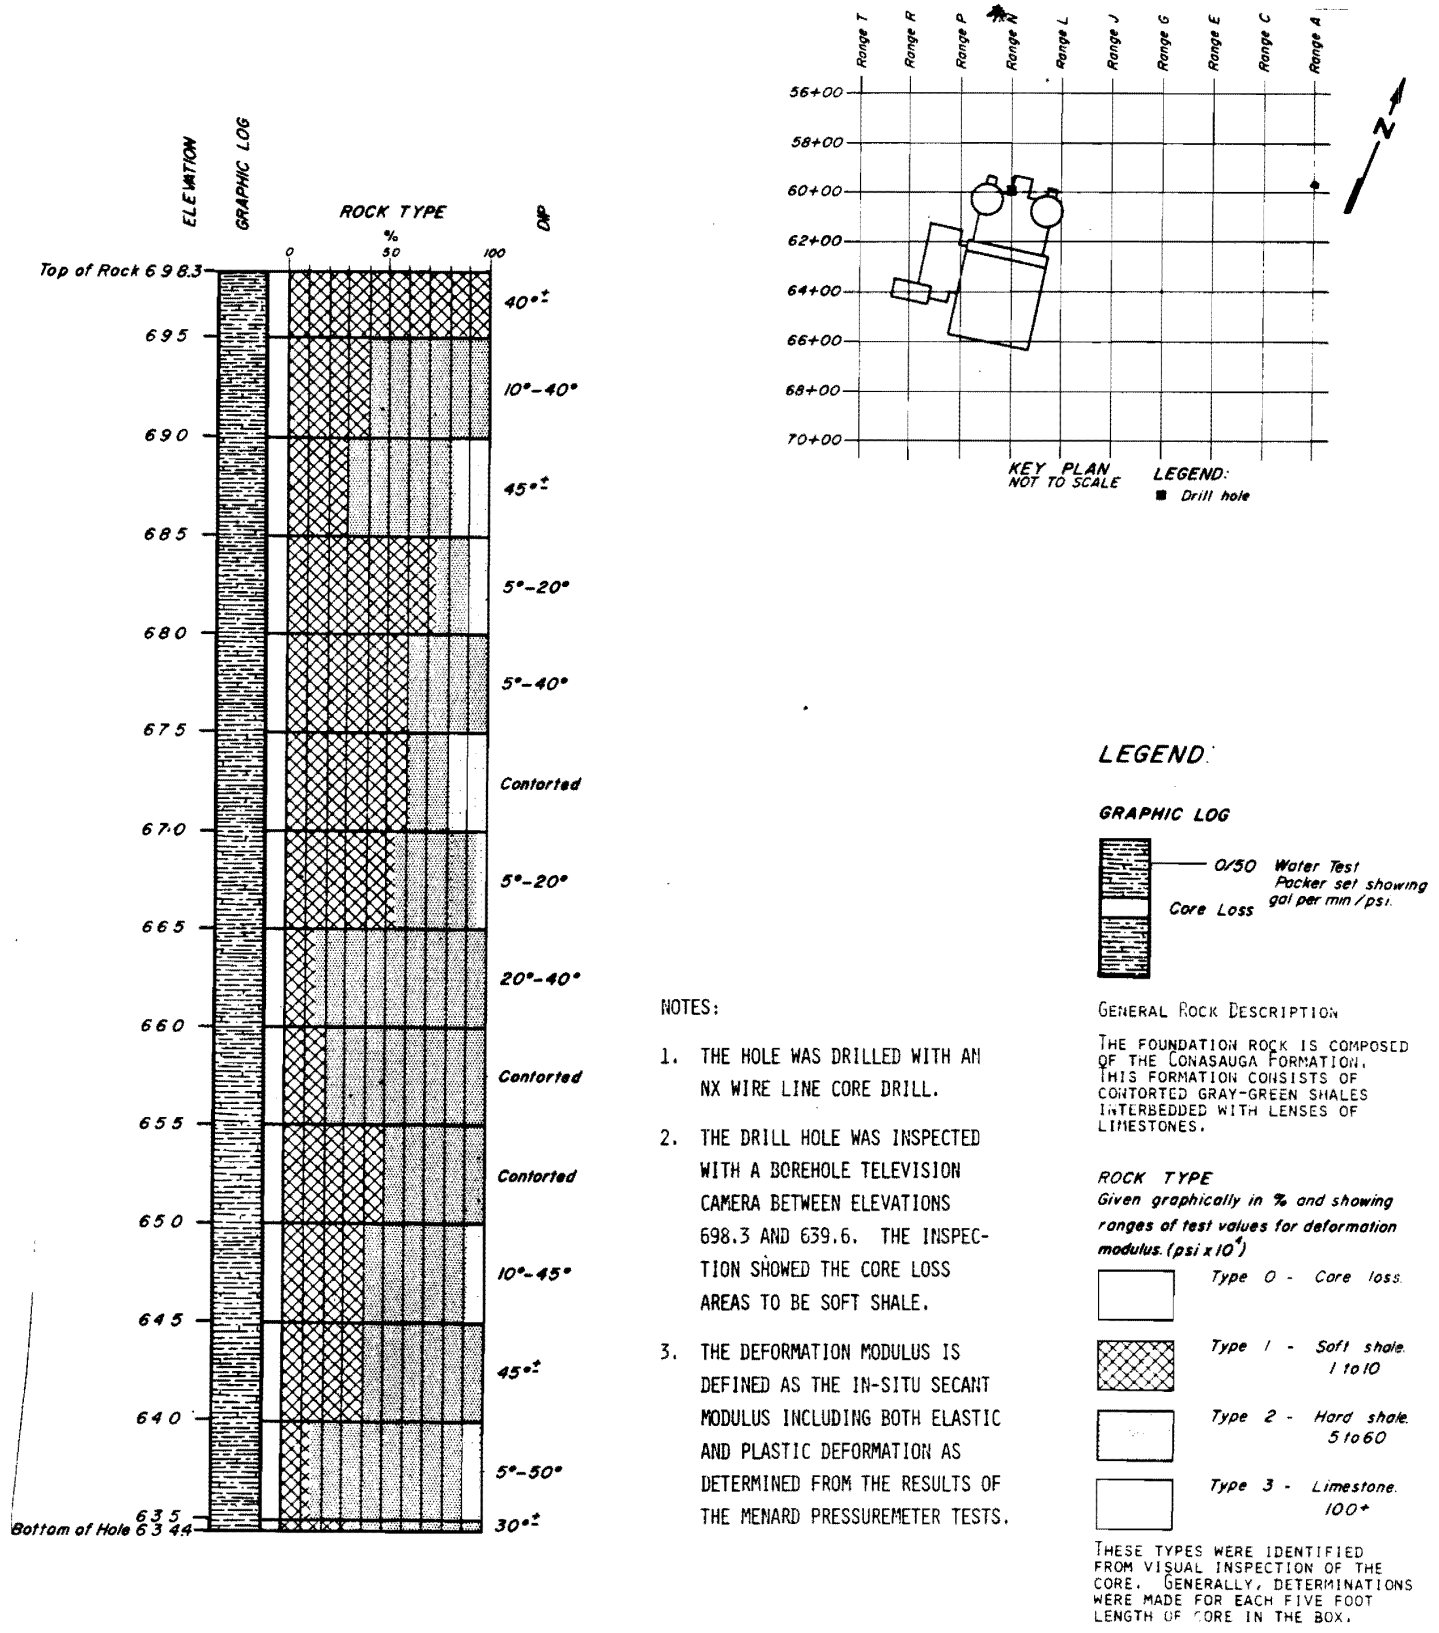

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 34
STA. N-60+00
Figure 2.5-47

Figure 2.5-47 Graphic Log Hole 34 Sta. N-60+00


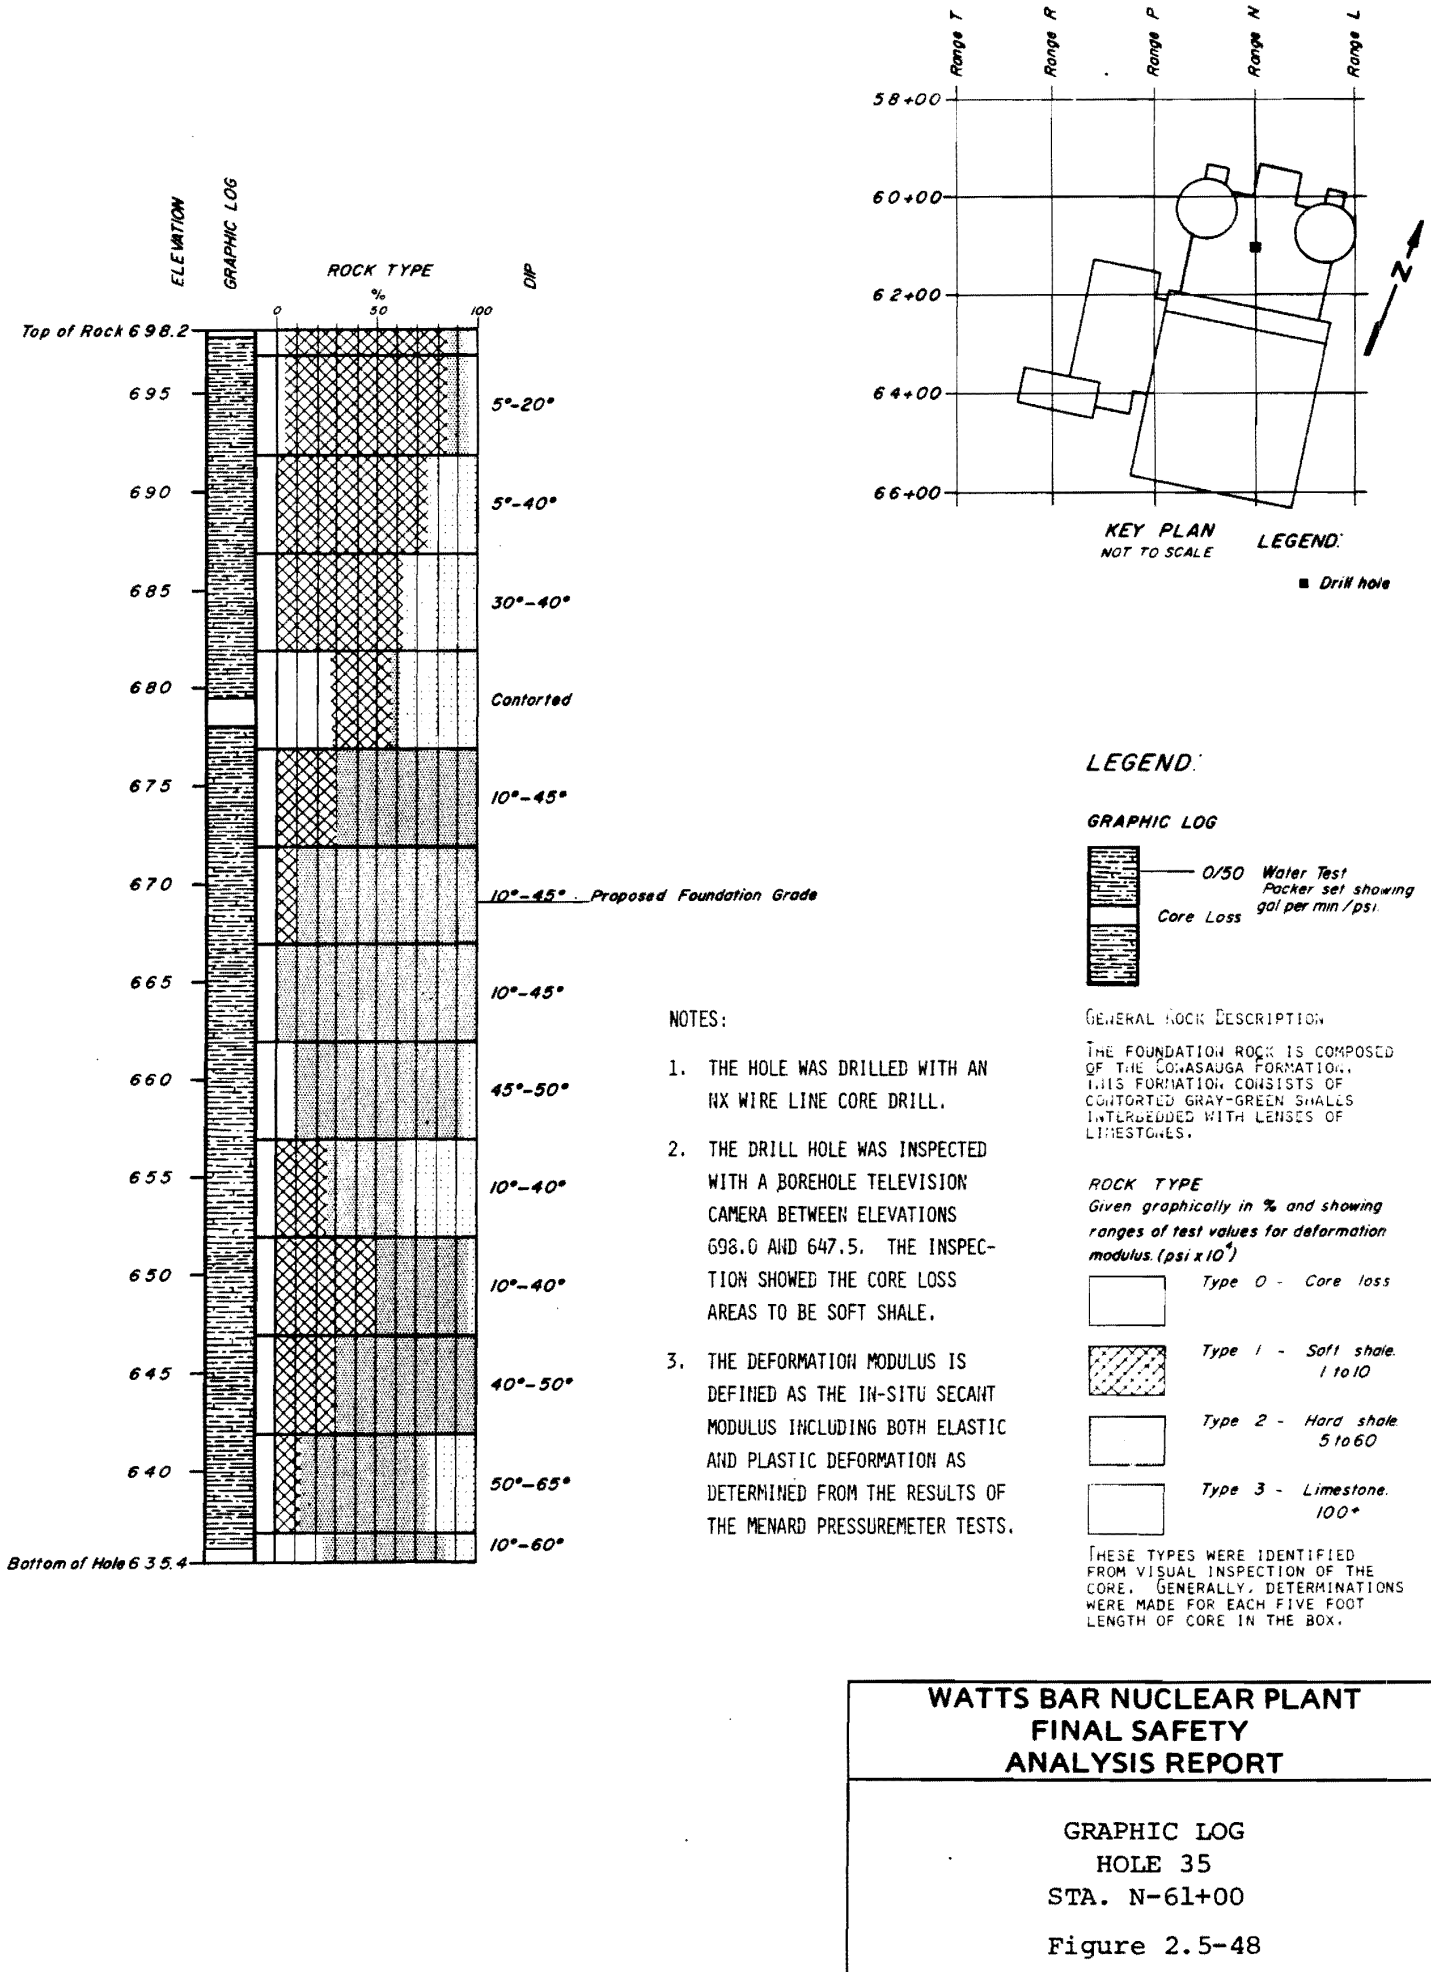


Figure 2.5-48 Graphic Log Hole 35 Sta. N-61+00

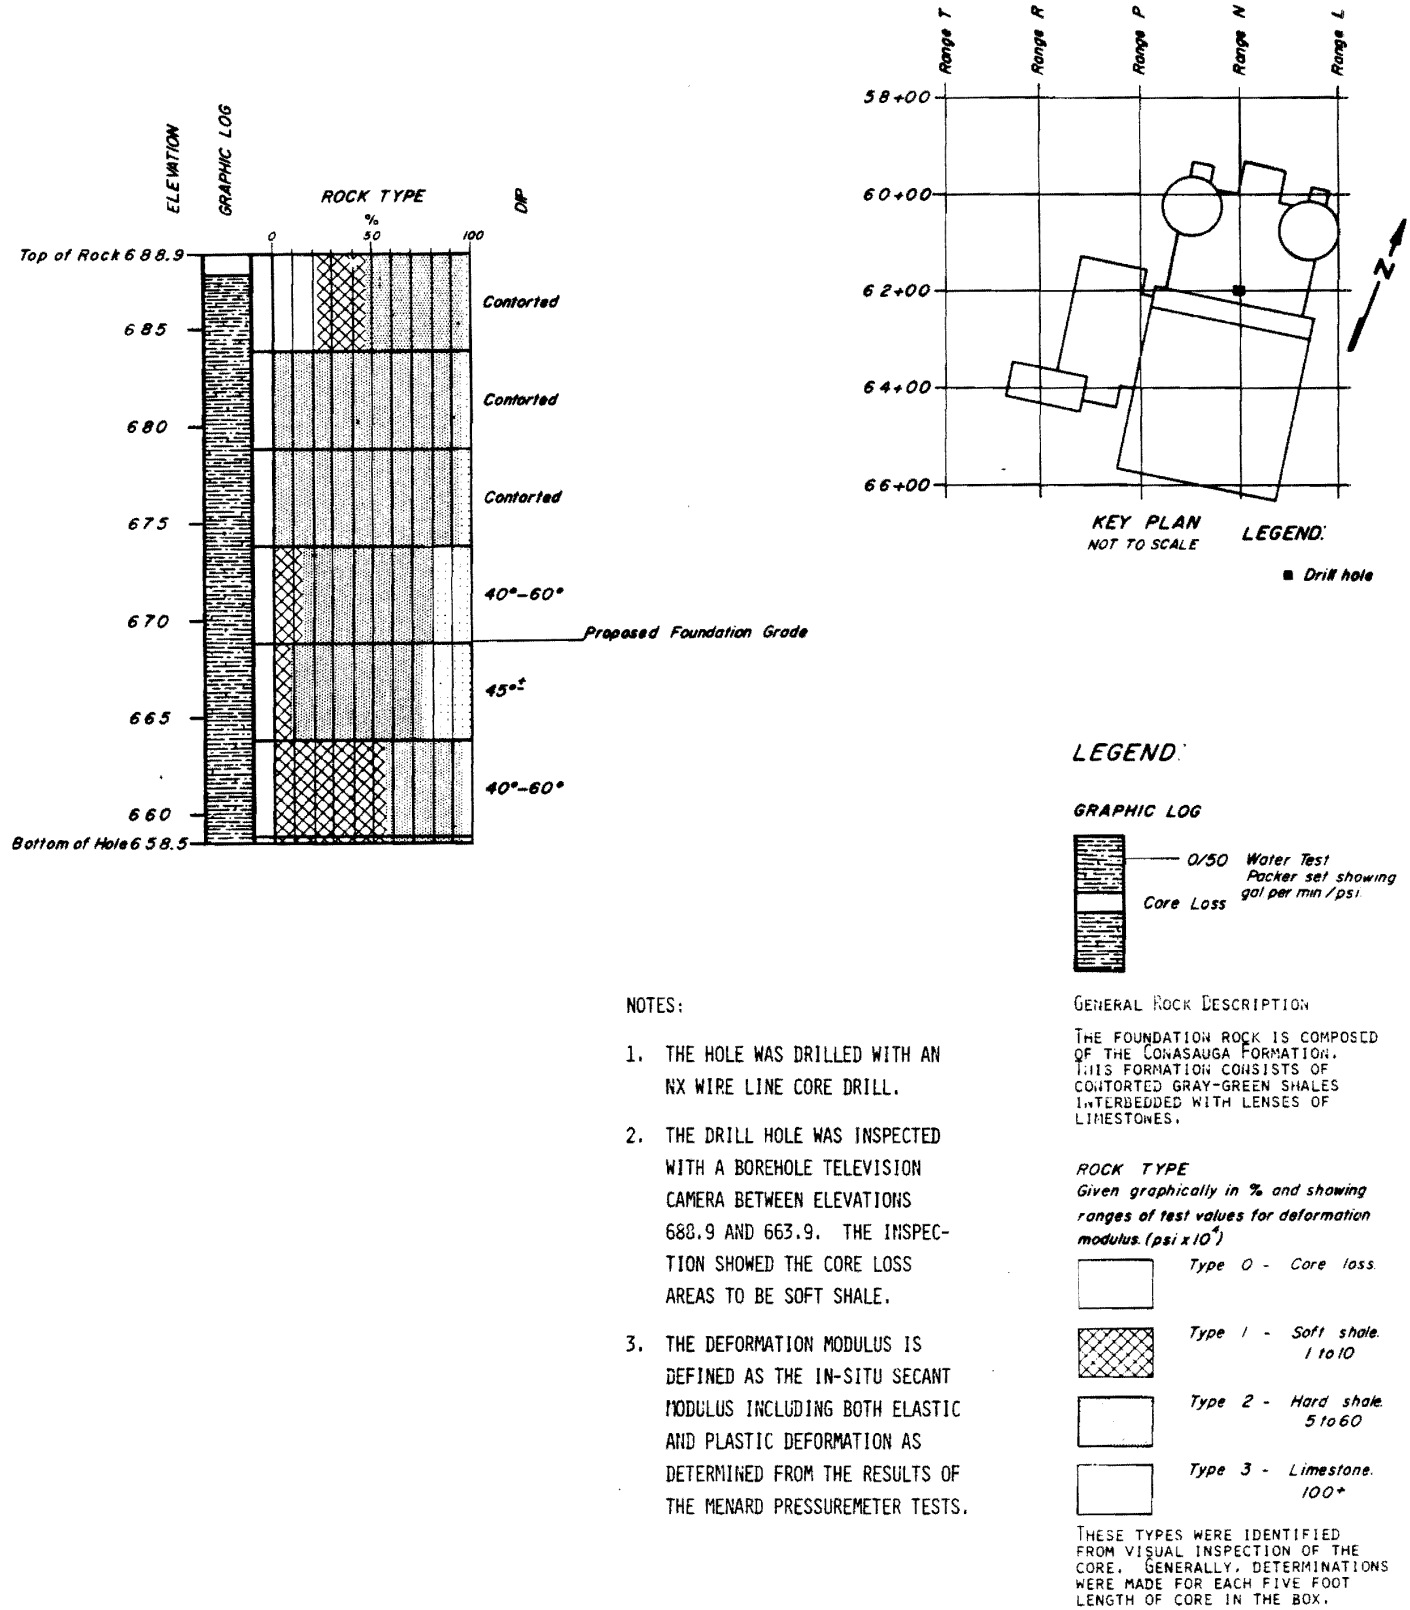


NOTES:

1. THE HOLE WAS DRILLED WITH AN NX WIRE LINE CORE DRILL.
2. THE DRILL HOLE WAS INSPECTED WITH A BOREHOLE TELEVISION CAMERA BETWEEN ELEVATIONS 688.9 AND 663.9. THE INSPECTION SHOWED THE CORE LOSS AREAS TO BE SOFT SHALE.
3. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>GRAPHIC LOG HOLE 36 STA. N-62+00 Figure 2.5-49</p>


Figure 2.5-49 Graphic Log Hole 36 Sta. N-62+00

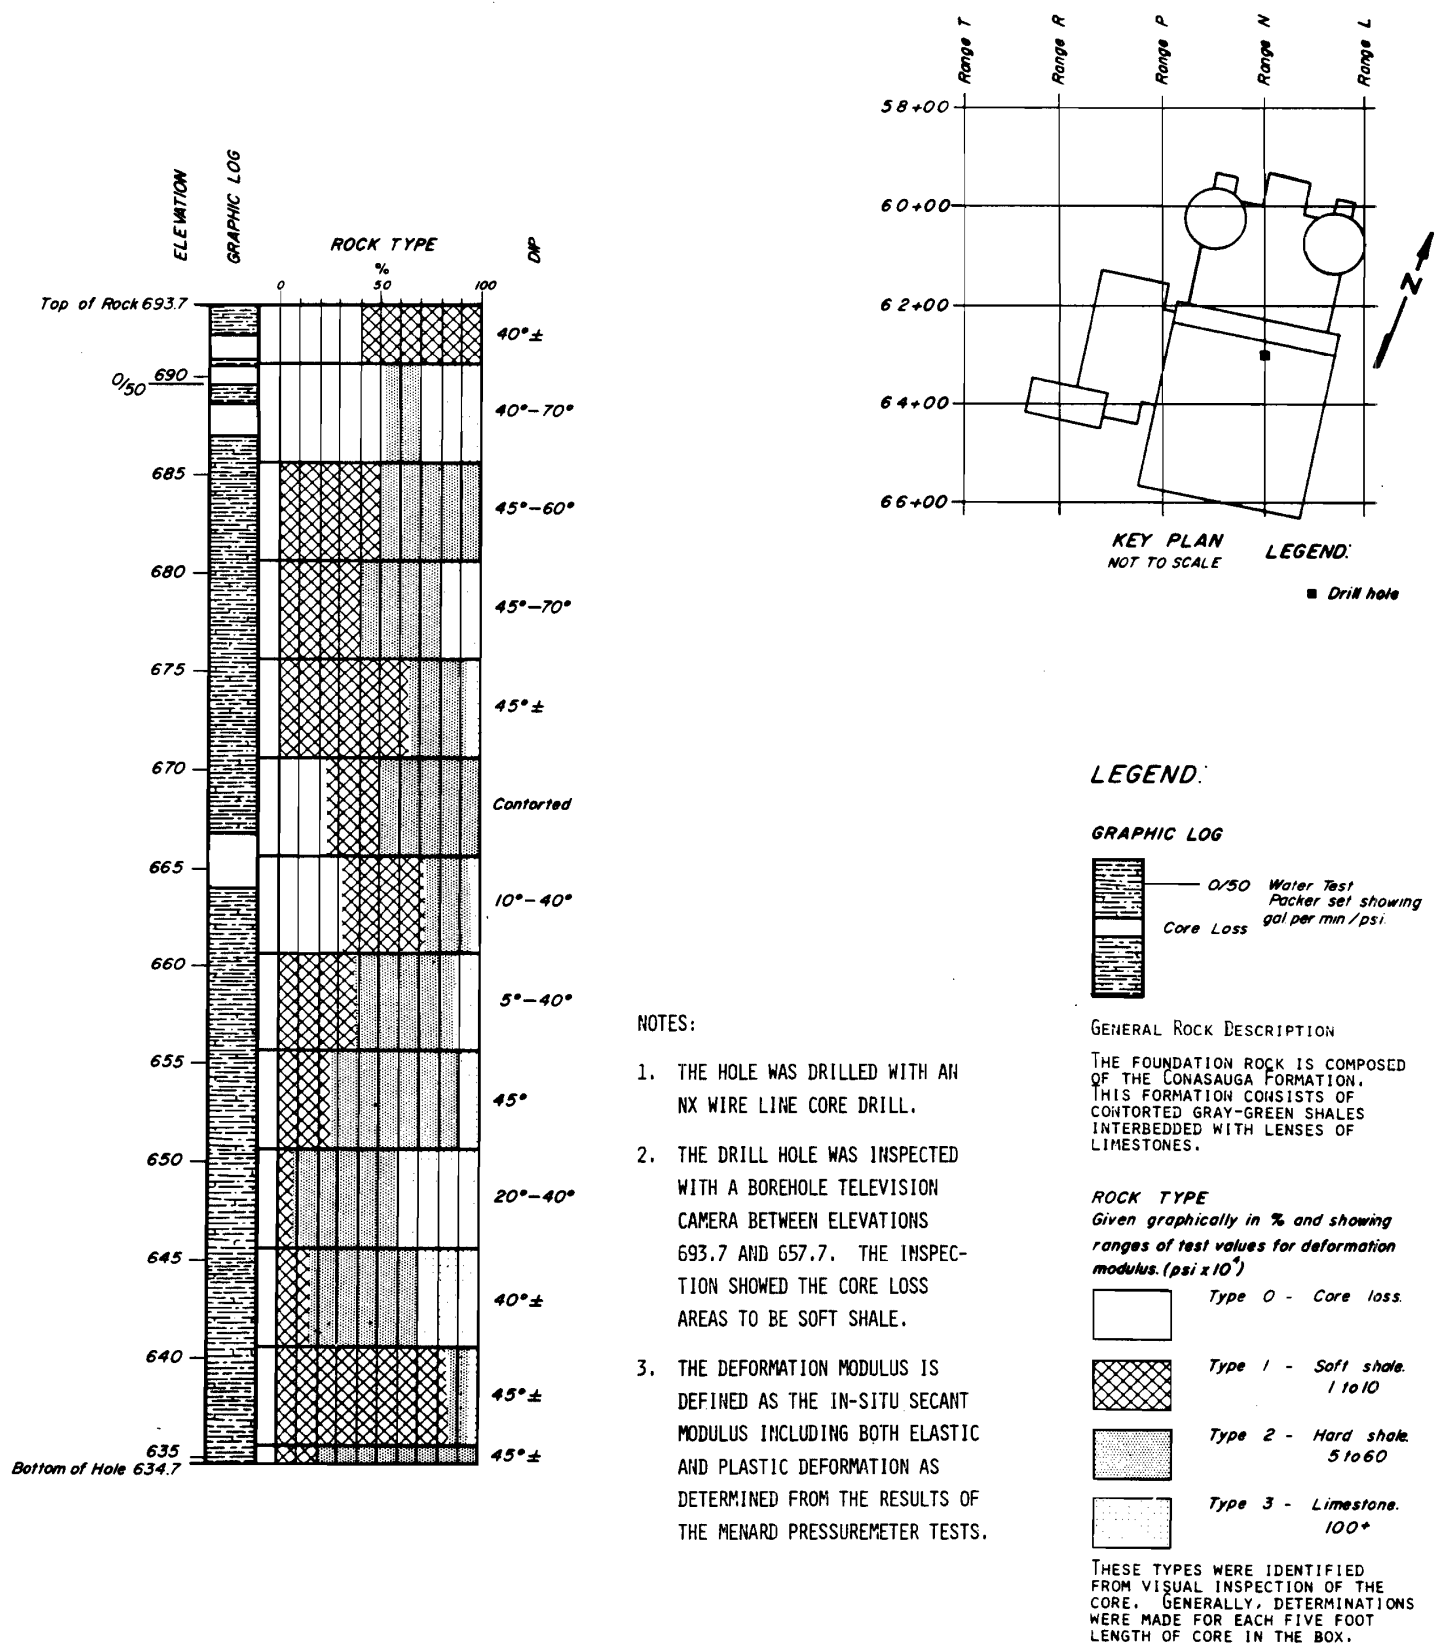

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 37
STA. N-63+00
Figure 2.5-50

Figure 2.5-50 Graphic Log Hole 37 Sta. N-63+00

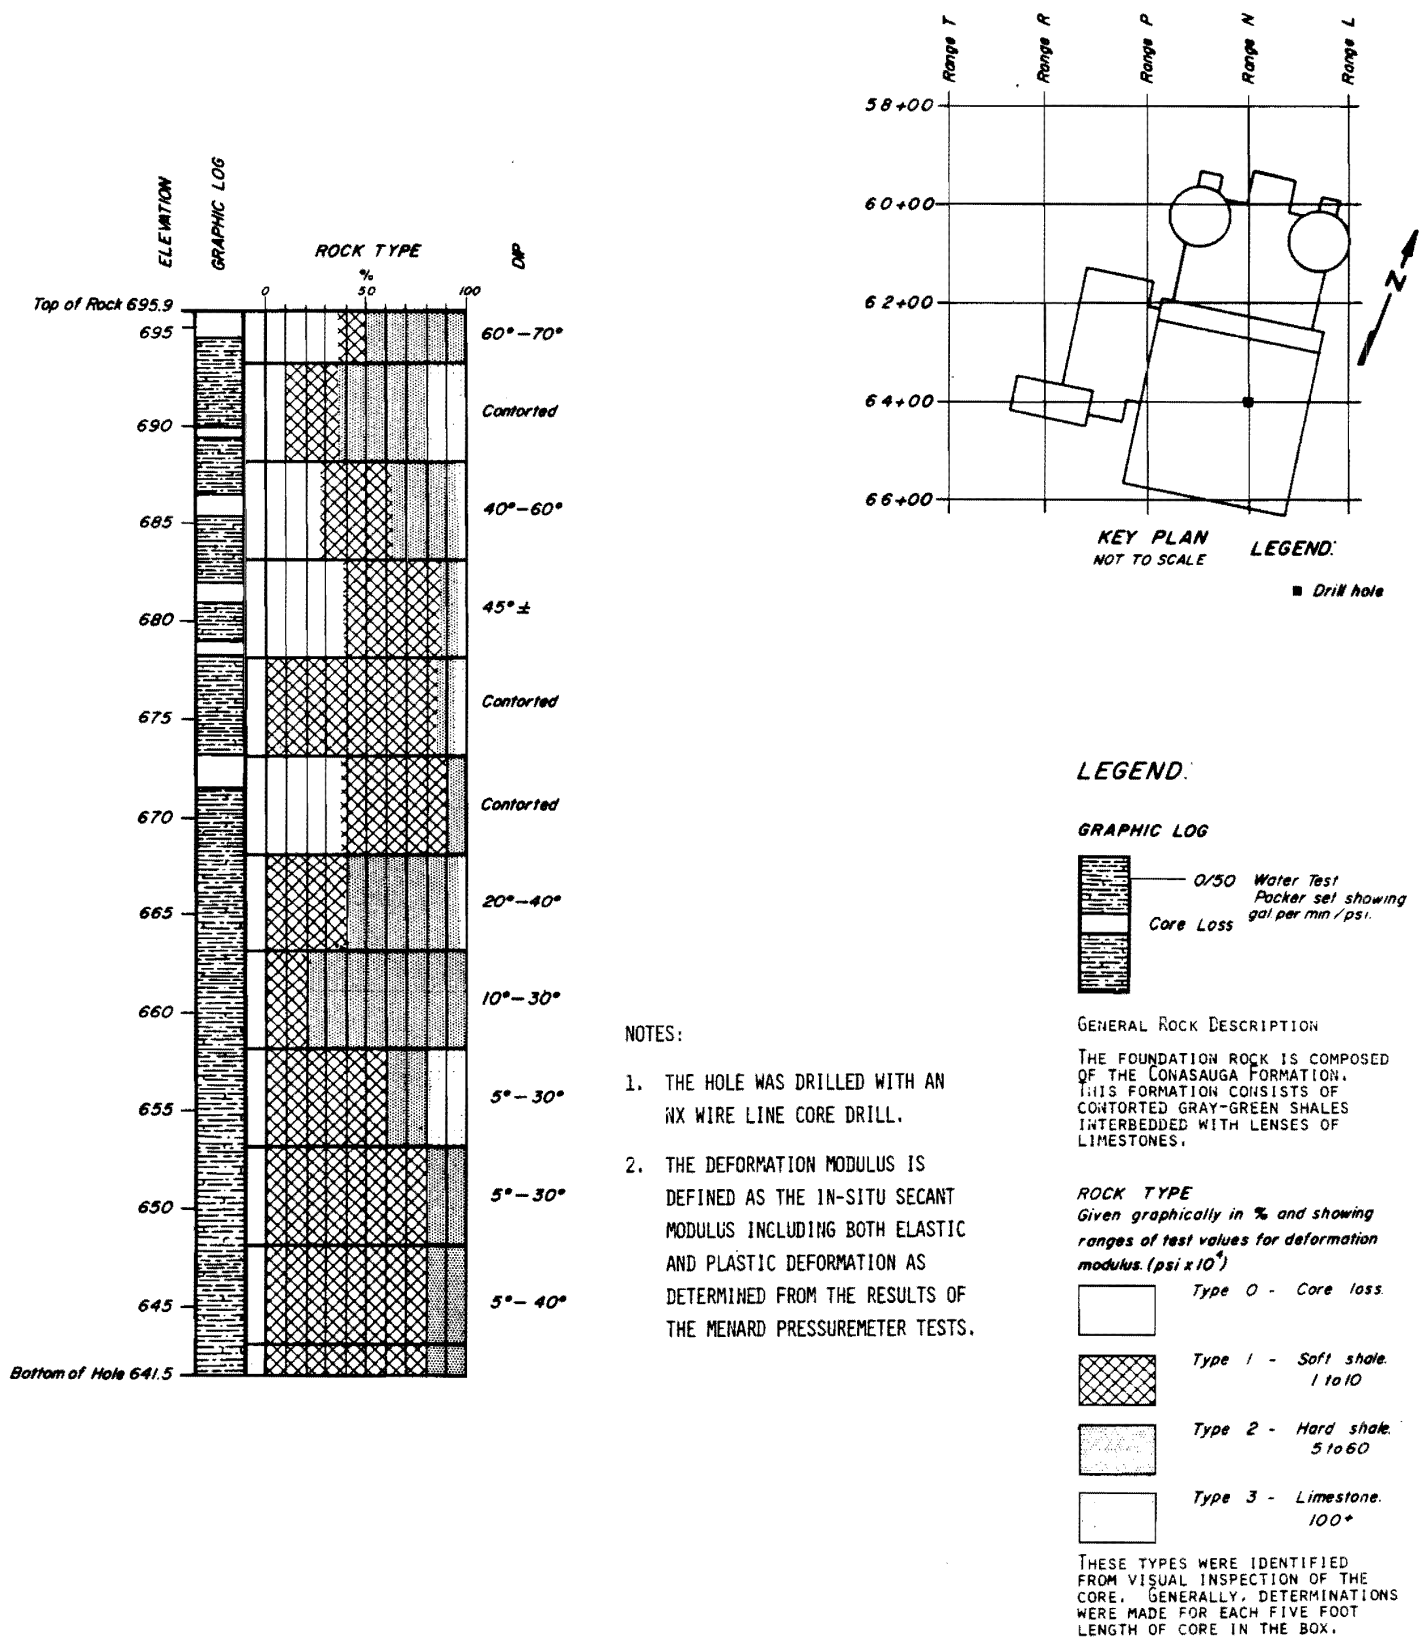

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 38
STA. N-64+00
Figure 2.5-51

Figure 2.5-51 Graphic Log Hole 38 Sta. N-64+00


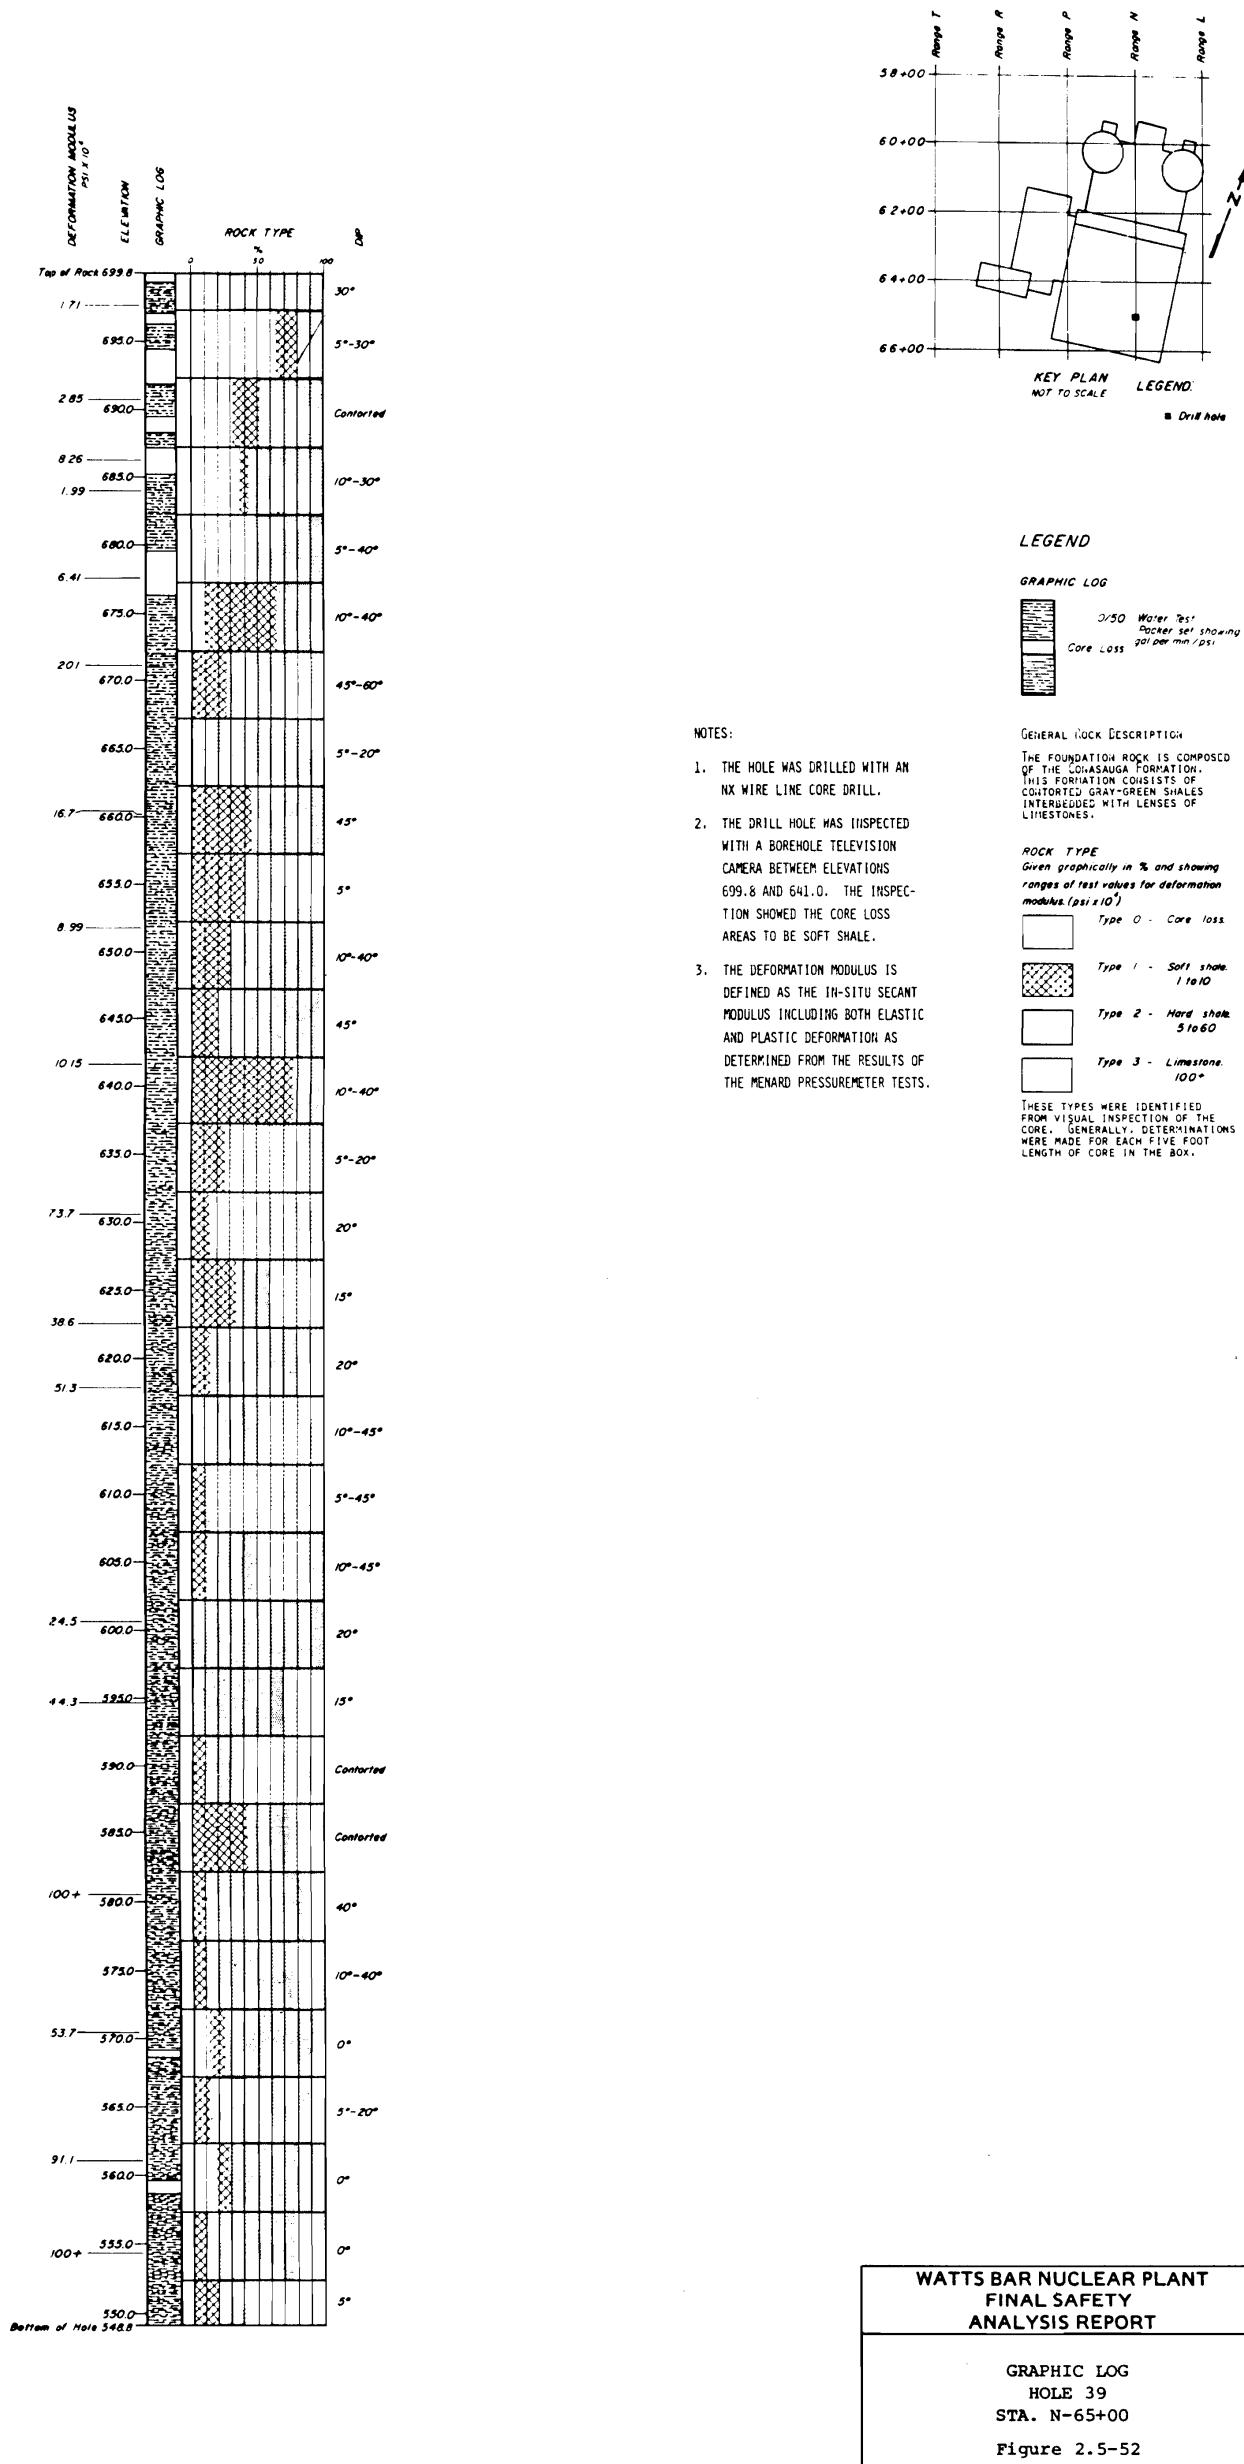



Figure 2.5-52 Graphic Log Hole 39 Sta. N-65+00

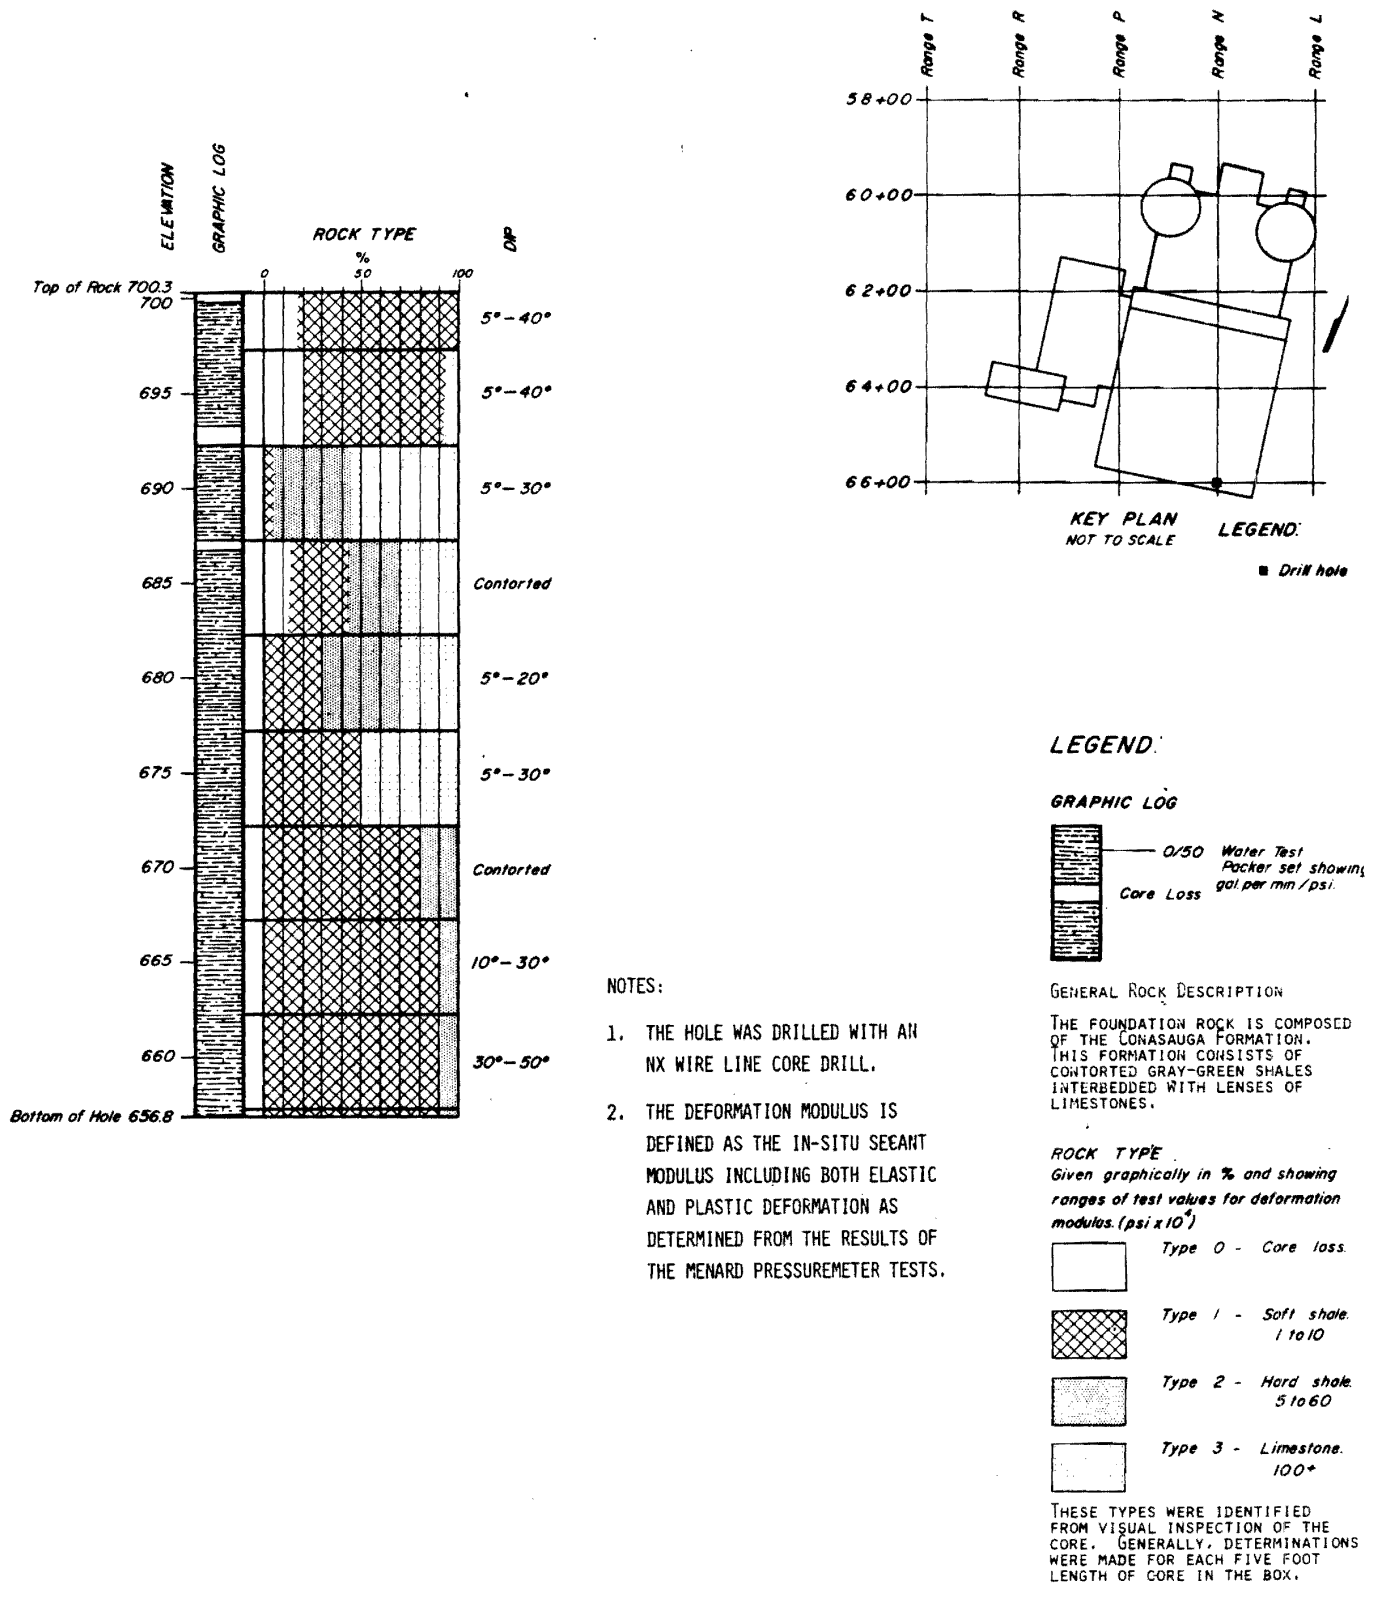

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 40
STA. N-66+00
Figure 2.5-53


Figure 2.5-53 Graphic Log Hole 40 Sta. N-66+00

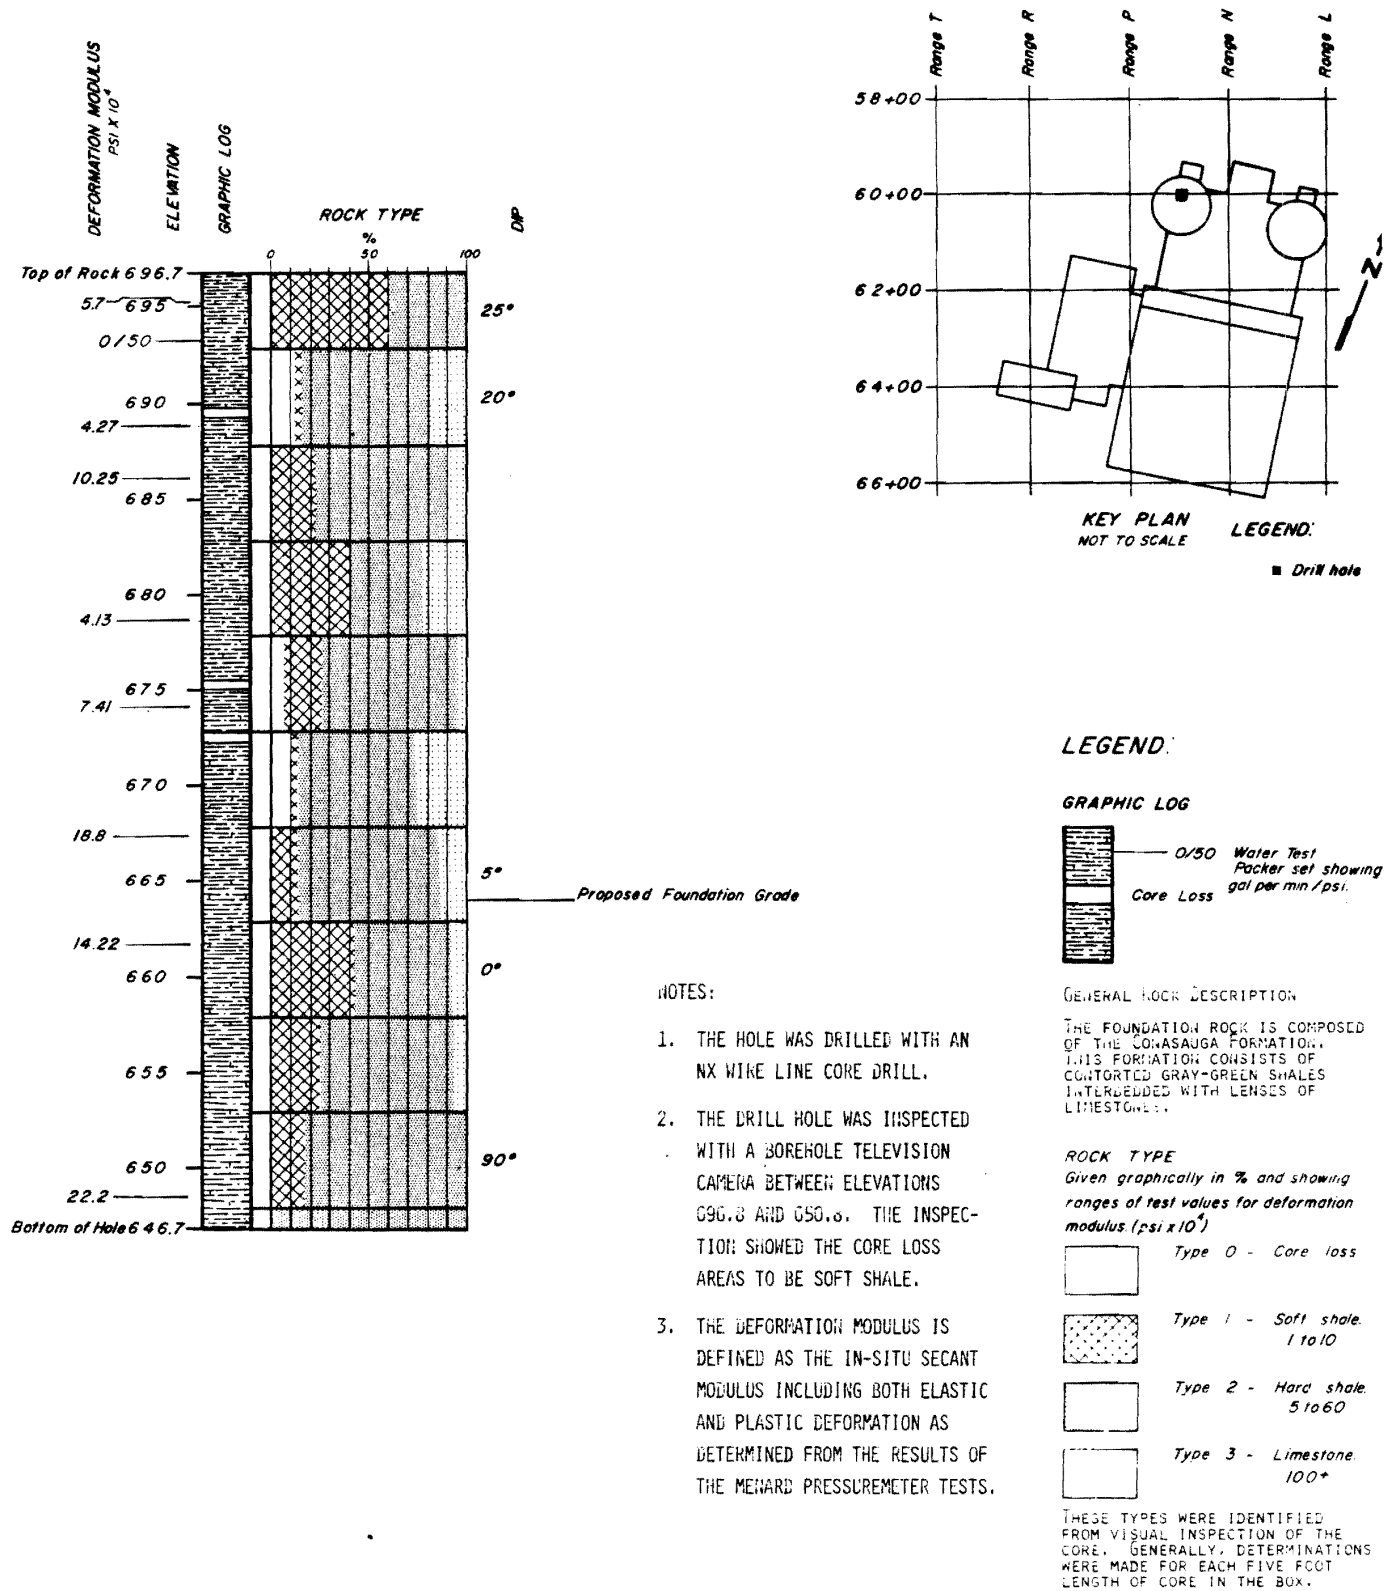

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 41
STA. 0-60+00
Figure 2.5-54


Figure 2.5-54 Graphic Log Hole 41 Sta. 0-60+00

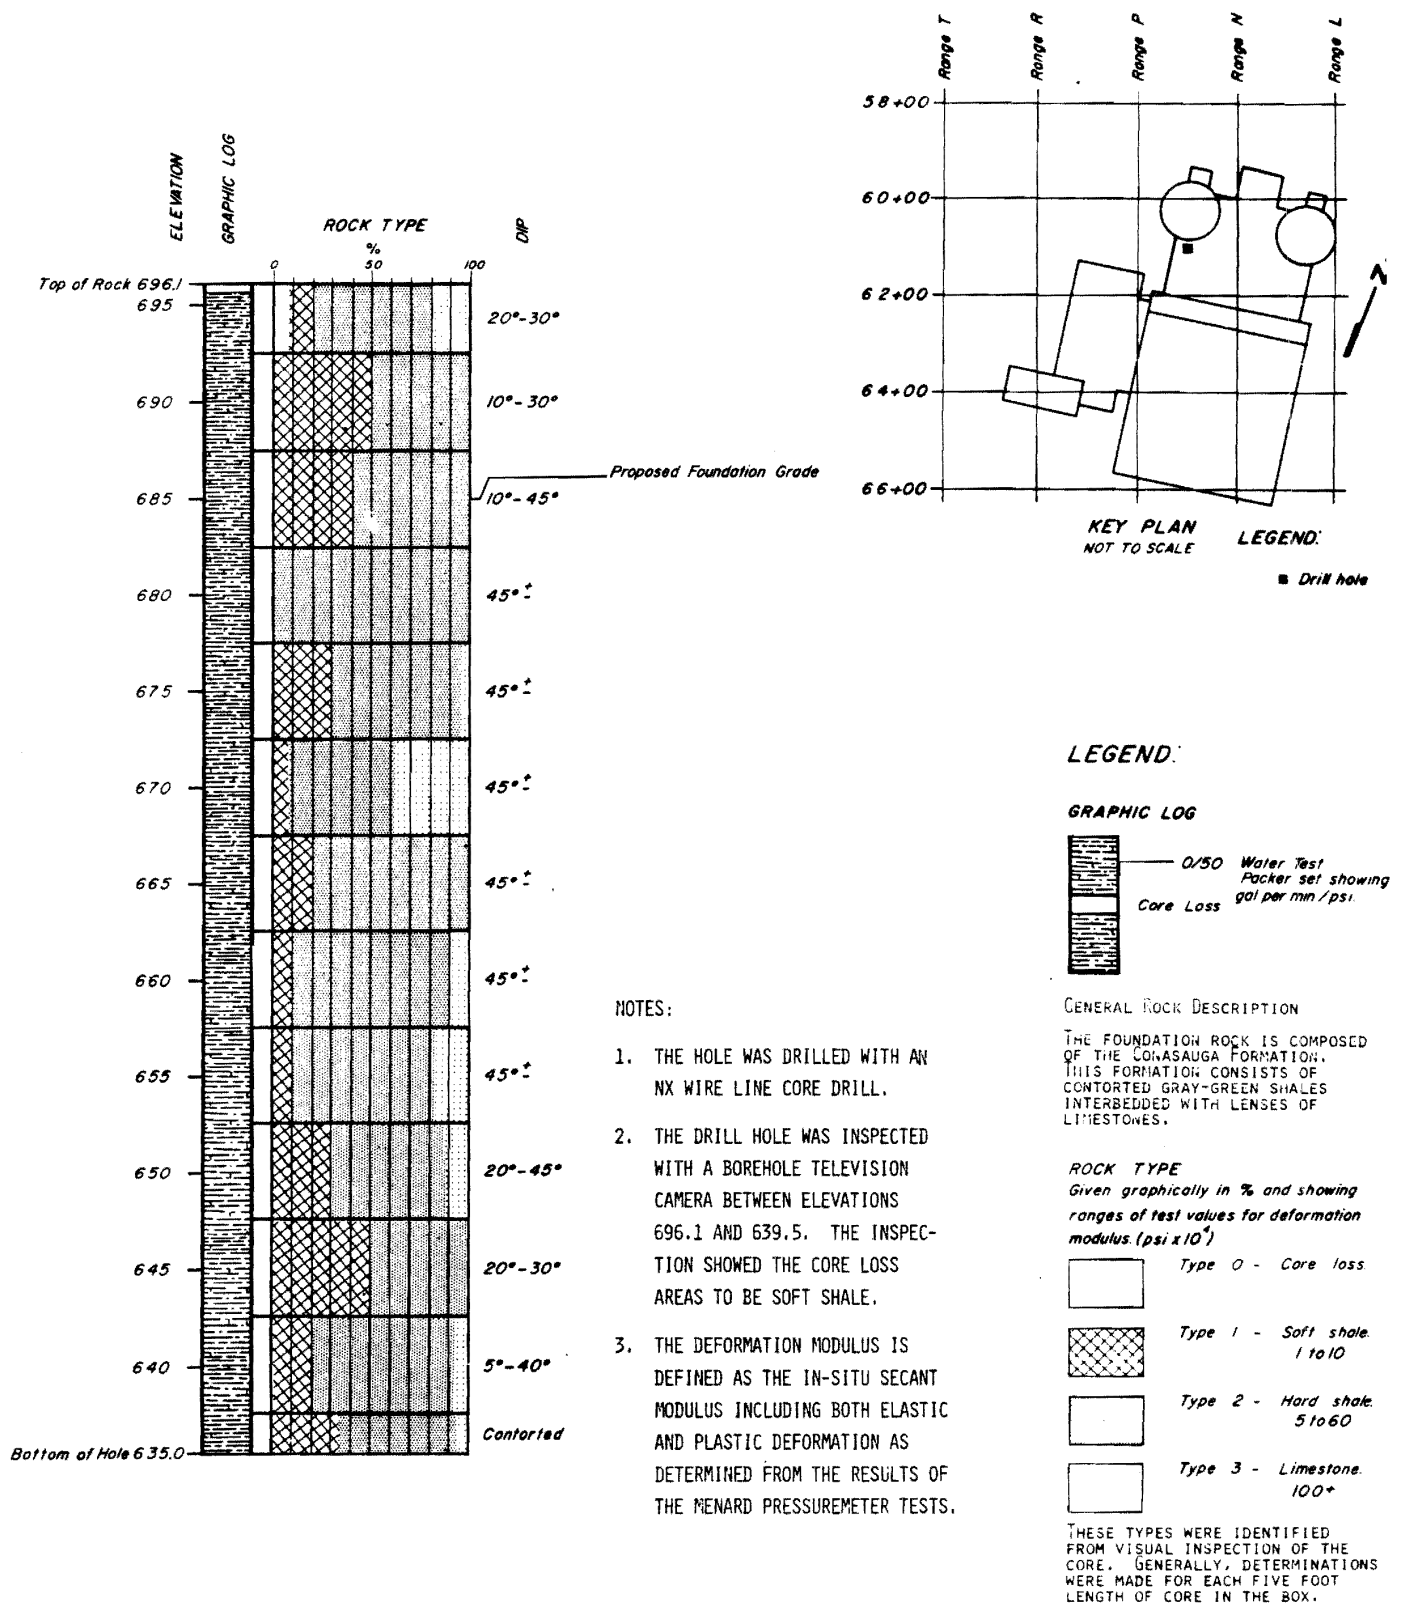

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 42
STA. 0-61+00
Figure 2.5-55


Figure 2.5-55 Graphic Log Hole 42 Sta. 0-61+00

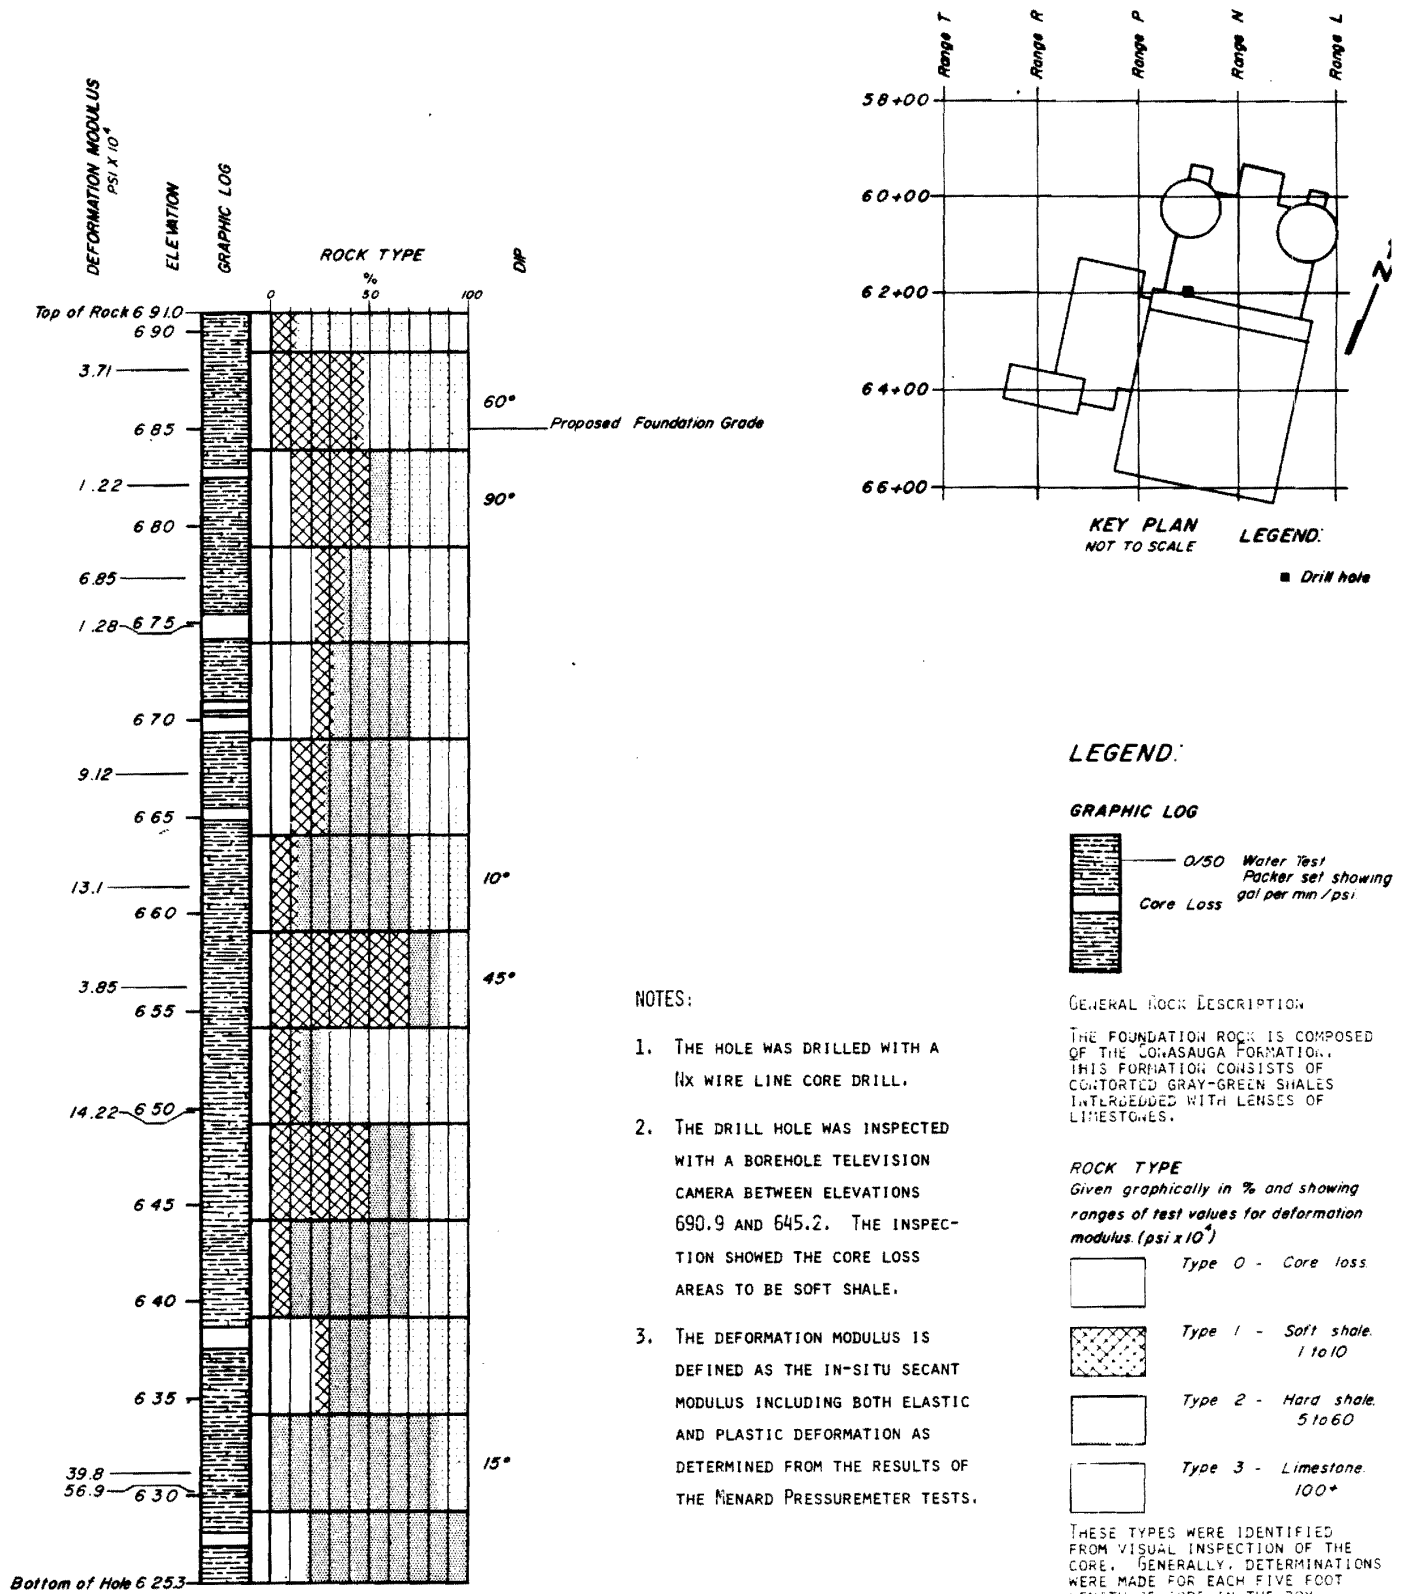

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 43
STA. 0-62+00
Figure 2.5-56




Figure 2.5-56 Graphic Log Hole 43 Sta. 0-62+00

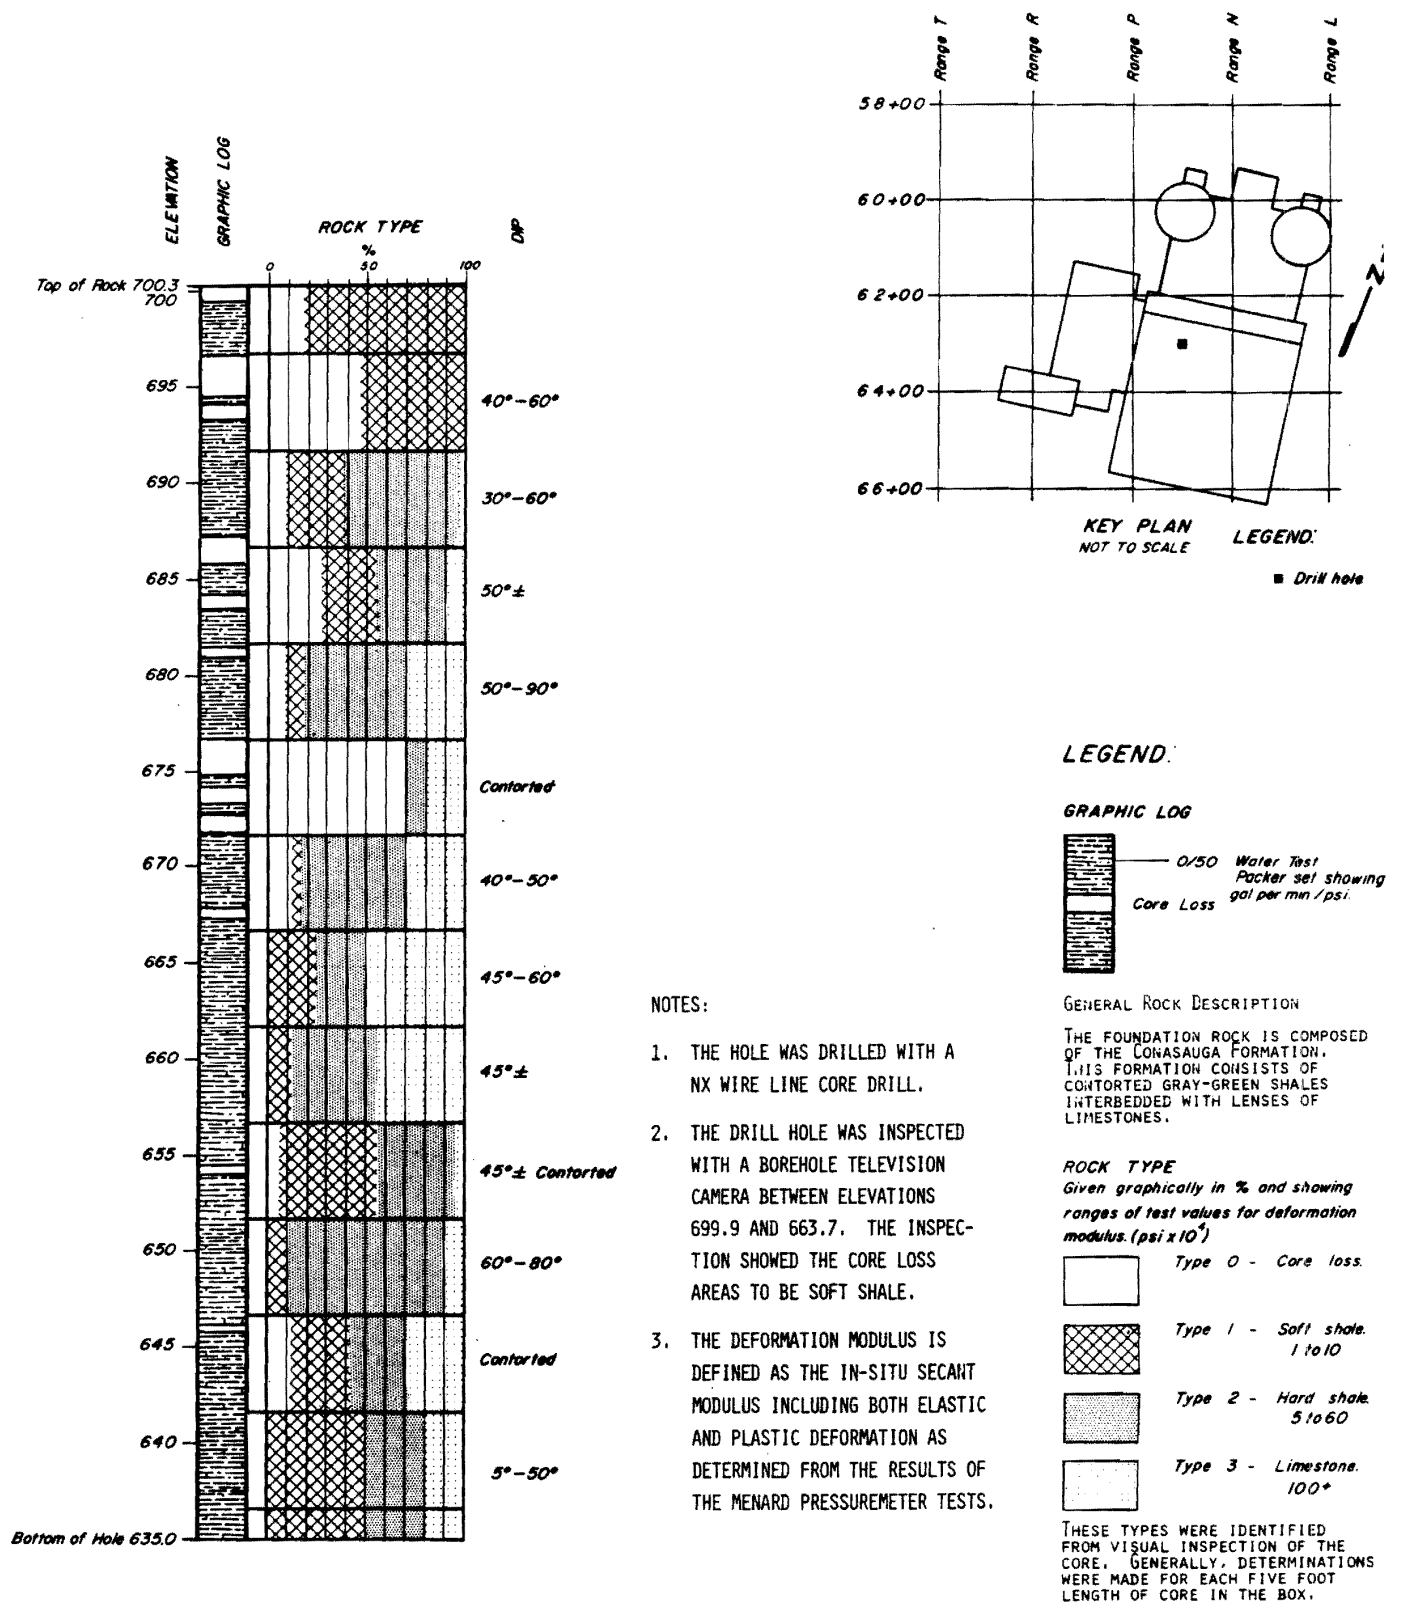

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 44
STA. 0-63+00
Figure 2.5-57


Figure 2.5-57 Graphic Log Hole 44 Sta. 0-63+00

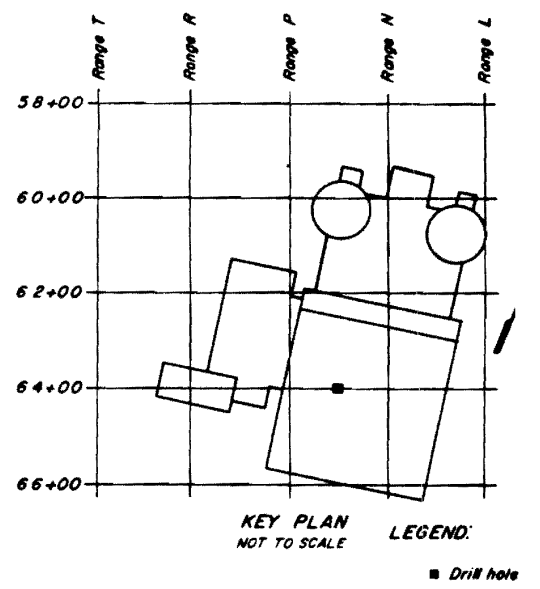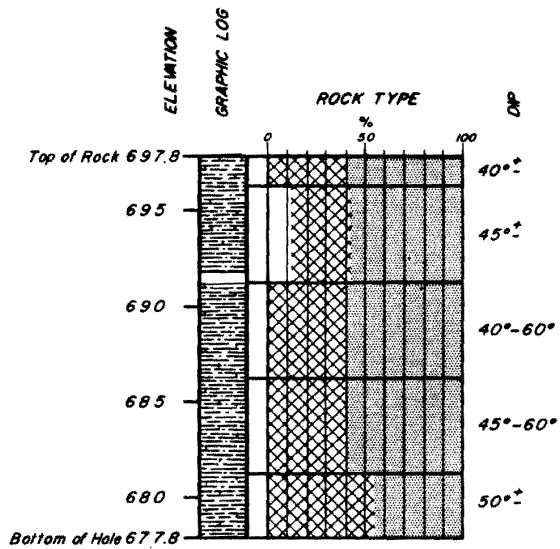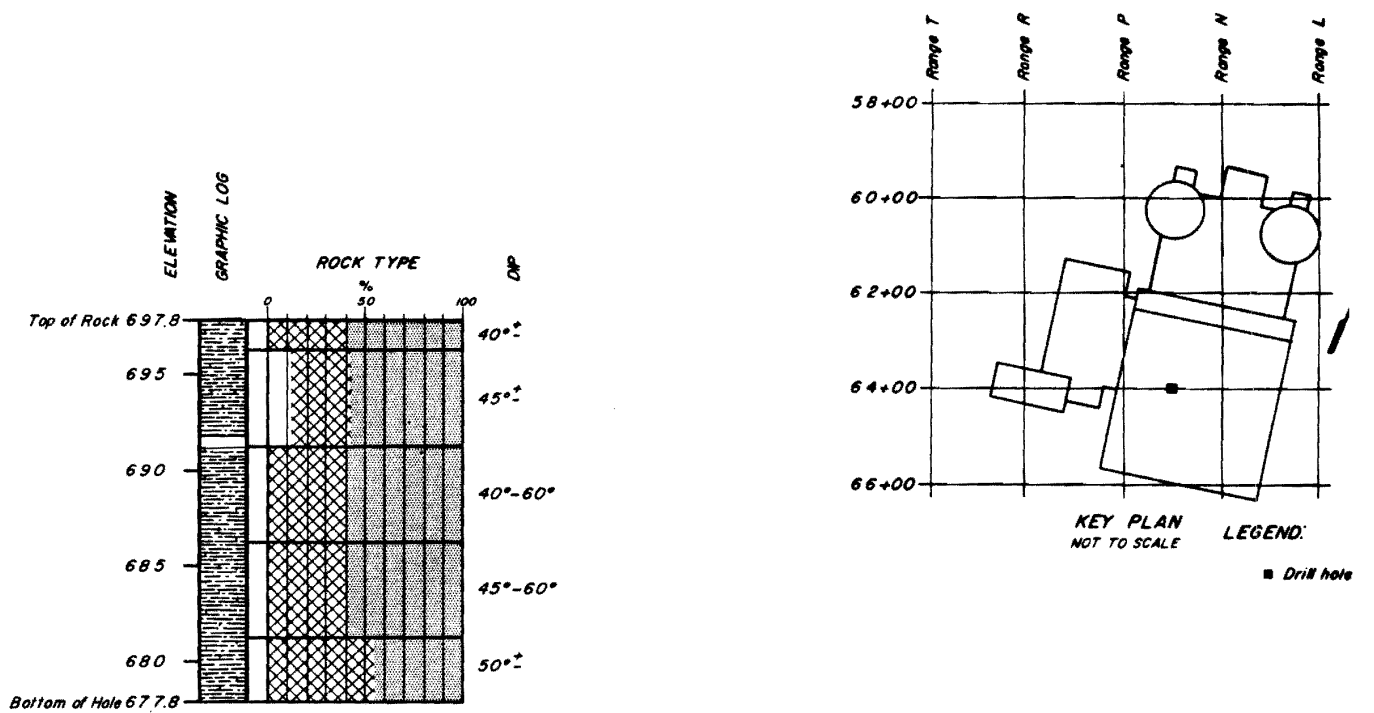

NOTES:

1. THE HOLE WAS DRILLED WITH A NX WIRE LINE CORE DRILL.
2. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.

LEGEND:

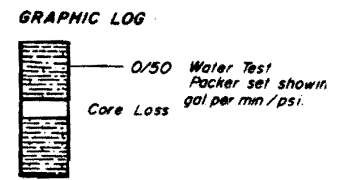

GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.


- ROCK TYPE**
Given graphically in % and showing ranges of test values for deformation modulus. (psi x 10⁴)
- Type 0 - Core loss.
 - Type 1 - Soft shale. 1 to 10
 - Type 2 - Hard shale. 5 to 60
 - Type 3 - Limestone. 100+

THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.


**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 45
STA. 0-64+00
Figure 2.5-58

Figure 2.5-58 Graphic Log Hole 45 Sta. 0-64+00

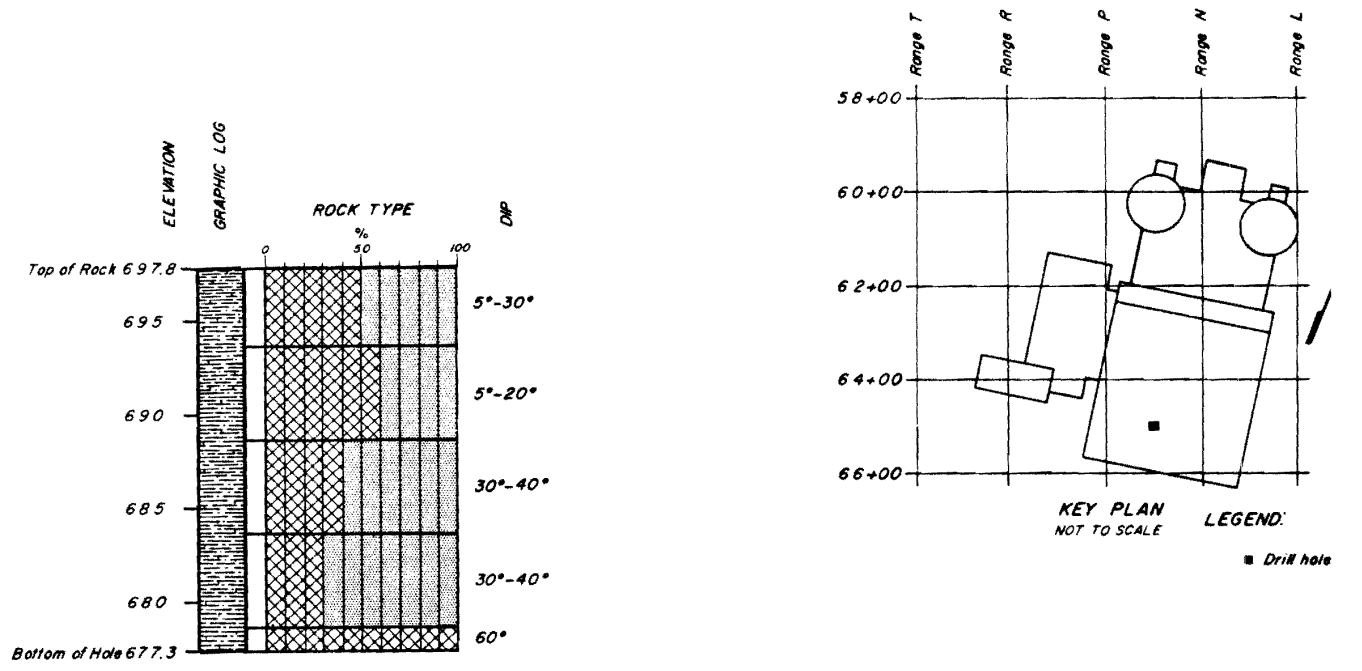

LEGEND:

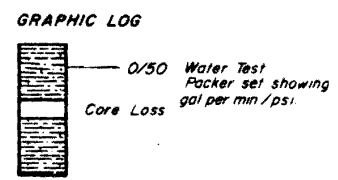

NOTES:

1. THE HOLE WAS DRILLED WITH A NX WIRE LINE CORE DRILL.
2. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.

GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.

ROCK TYPE
Given graphically in % and showing ranges of test values for deformation modulus. (psi x 10³)

- Type 0 - Core loss.
- Type 1 - Soft shale. 1 to 10
- Type 2 - Hard shale. 5 to 60
- Type 3 - Limestone. 100+

THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 46
STA. 0-65+00
Figure 2.5-59

Figure 2.5-59 Graphic Log Hole 46 Sta. 0-65+00


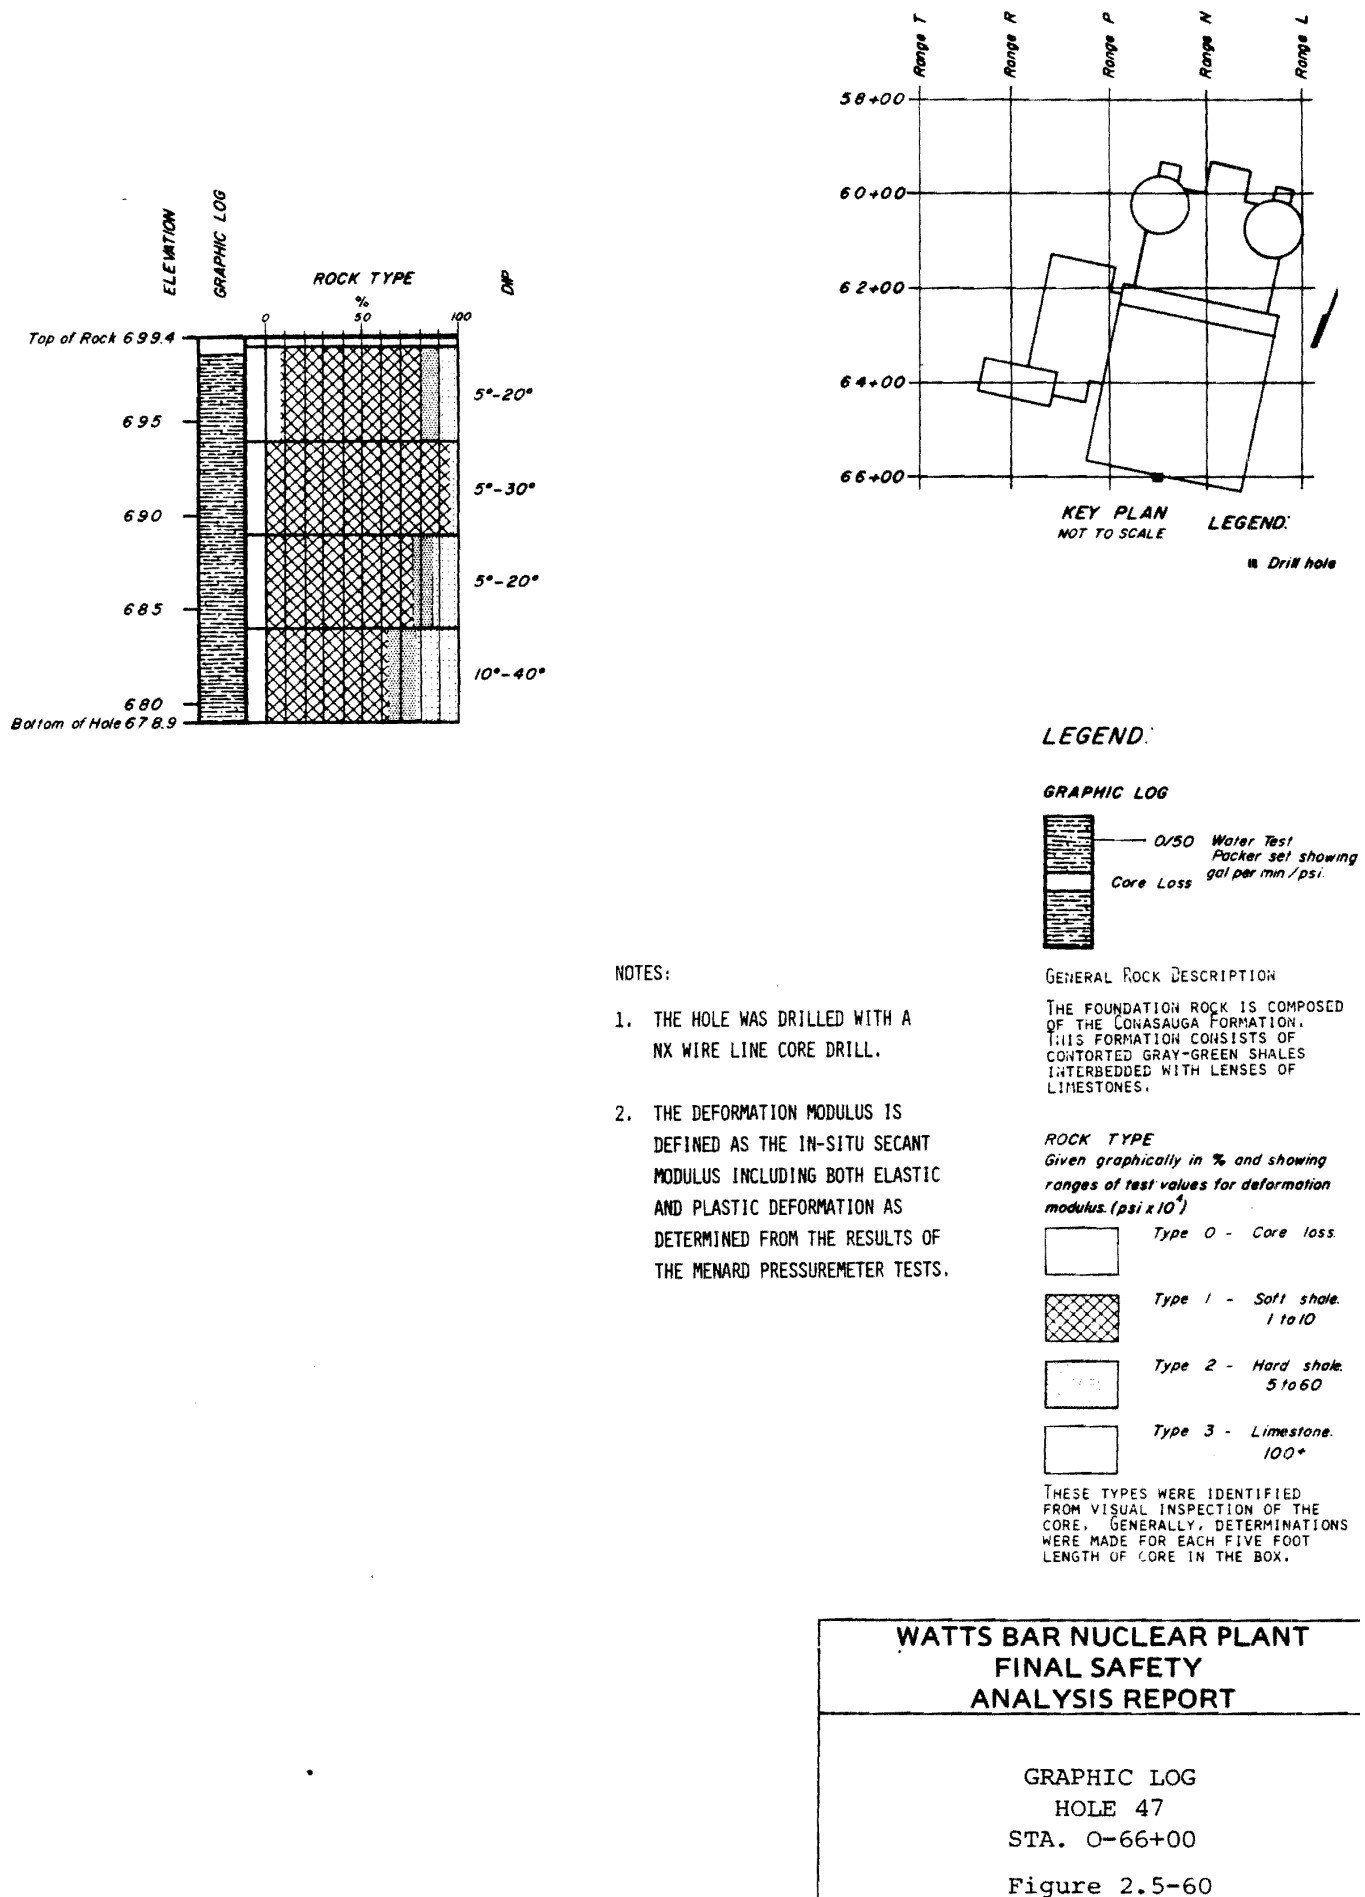



Figure 2.5-60 Graphic Log Hole 47 Sta. 0-66+00

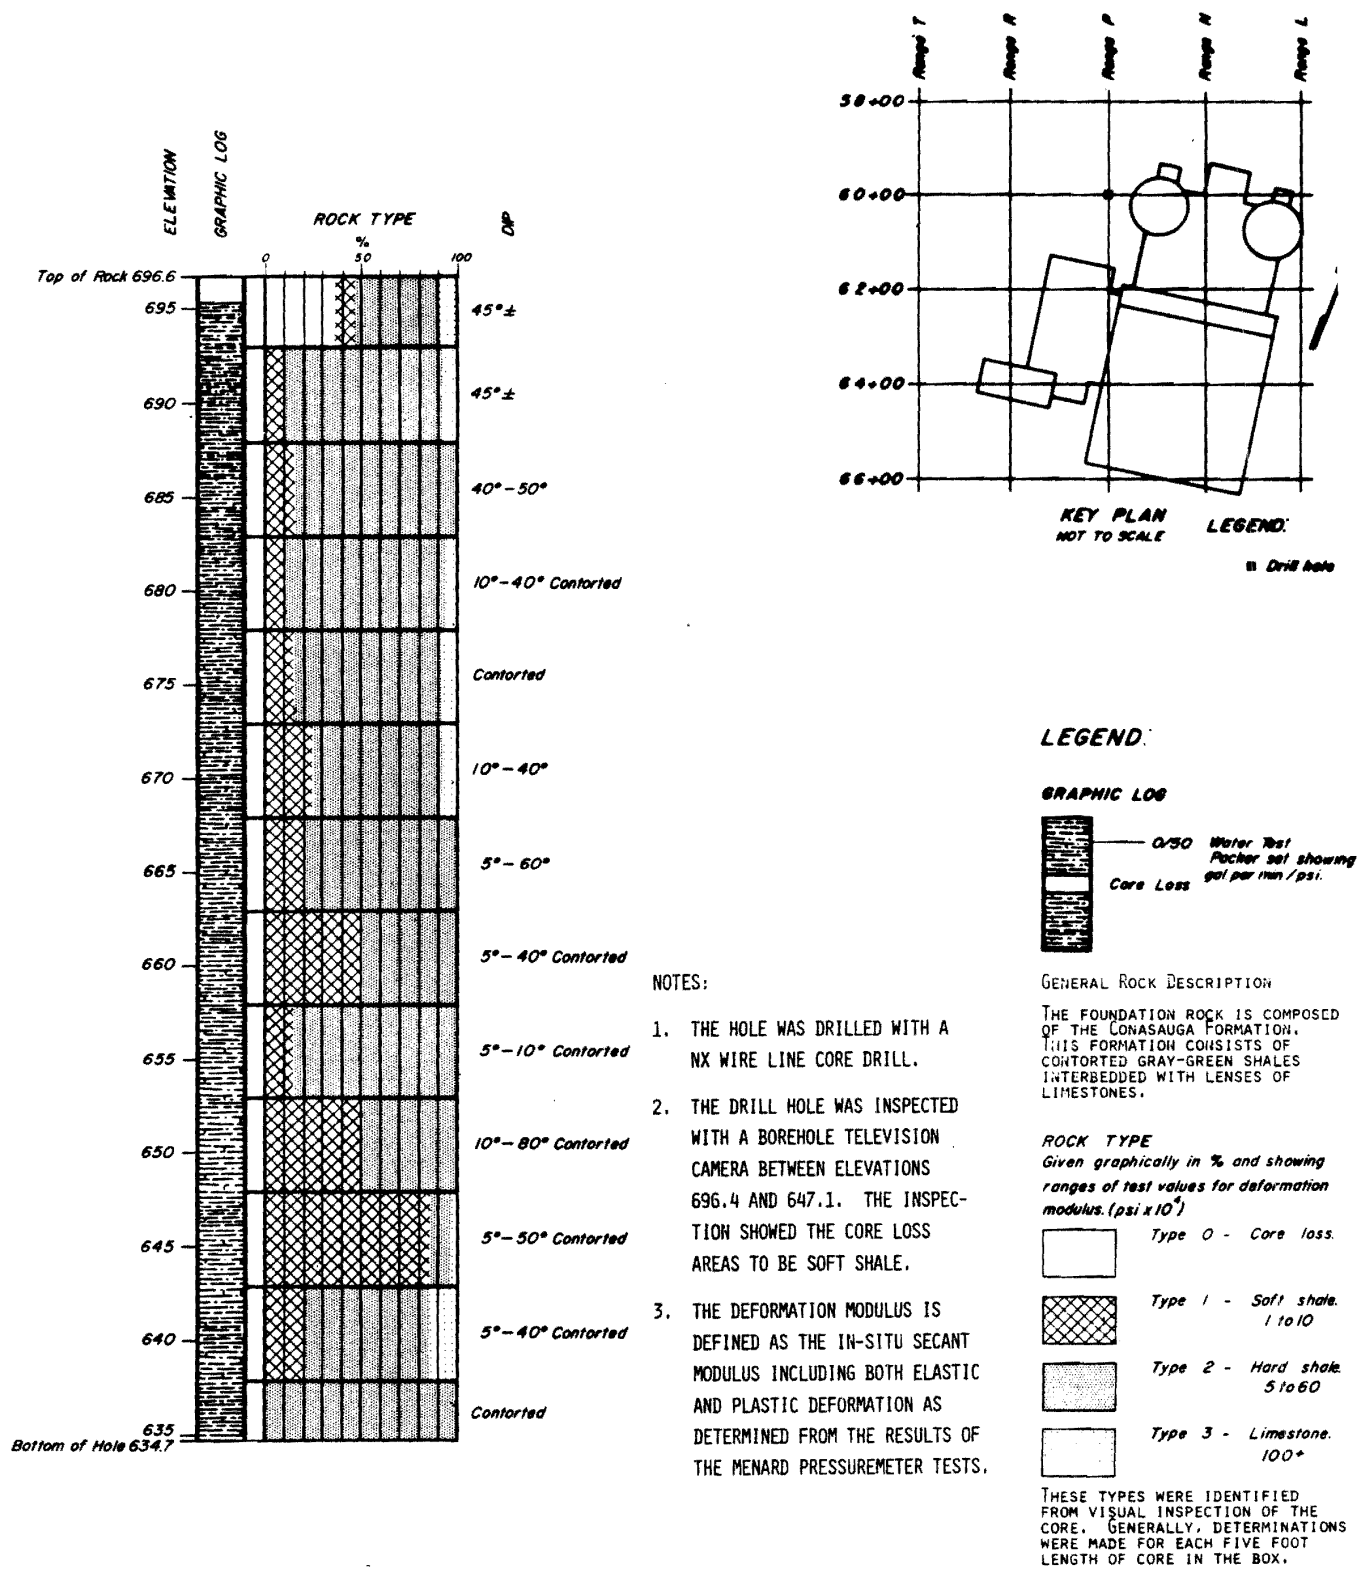

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 48
STA. P-60+00
Figure 2.5-61


Figure 2.5-61 Graphic Log Hole 48 Sta. P-60+00

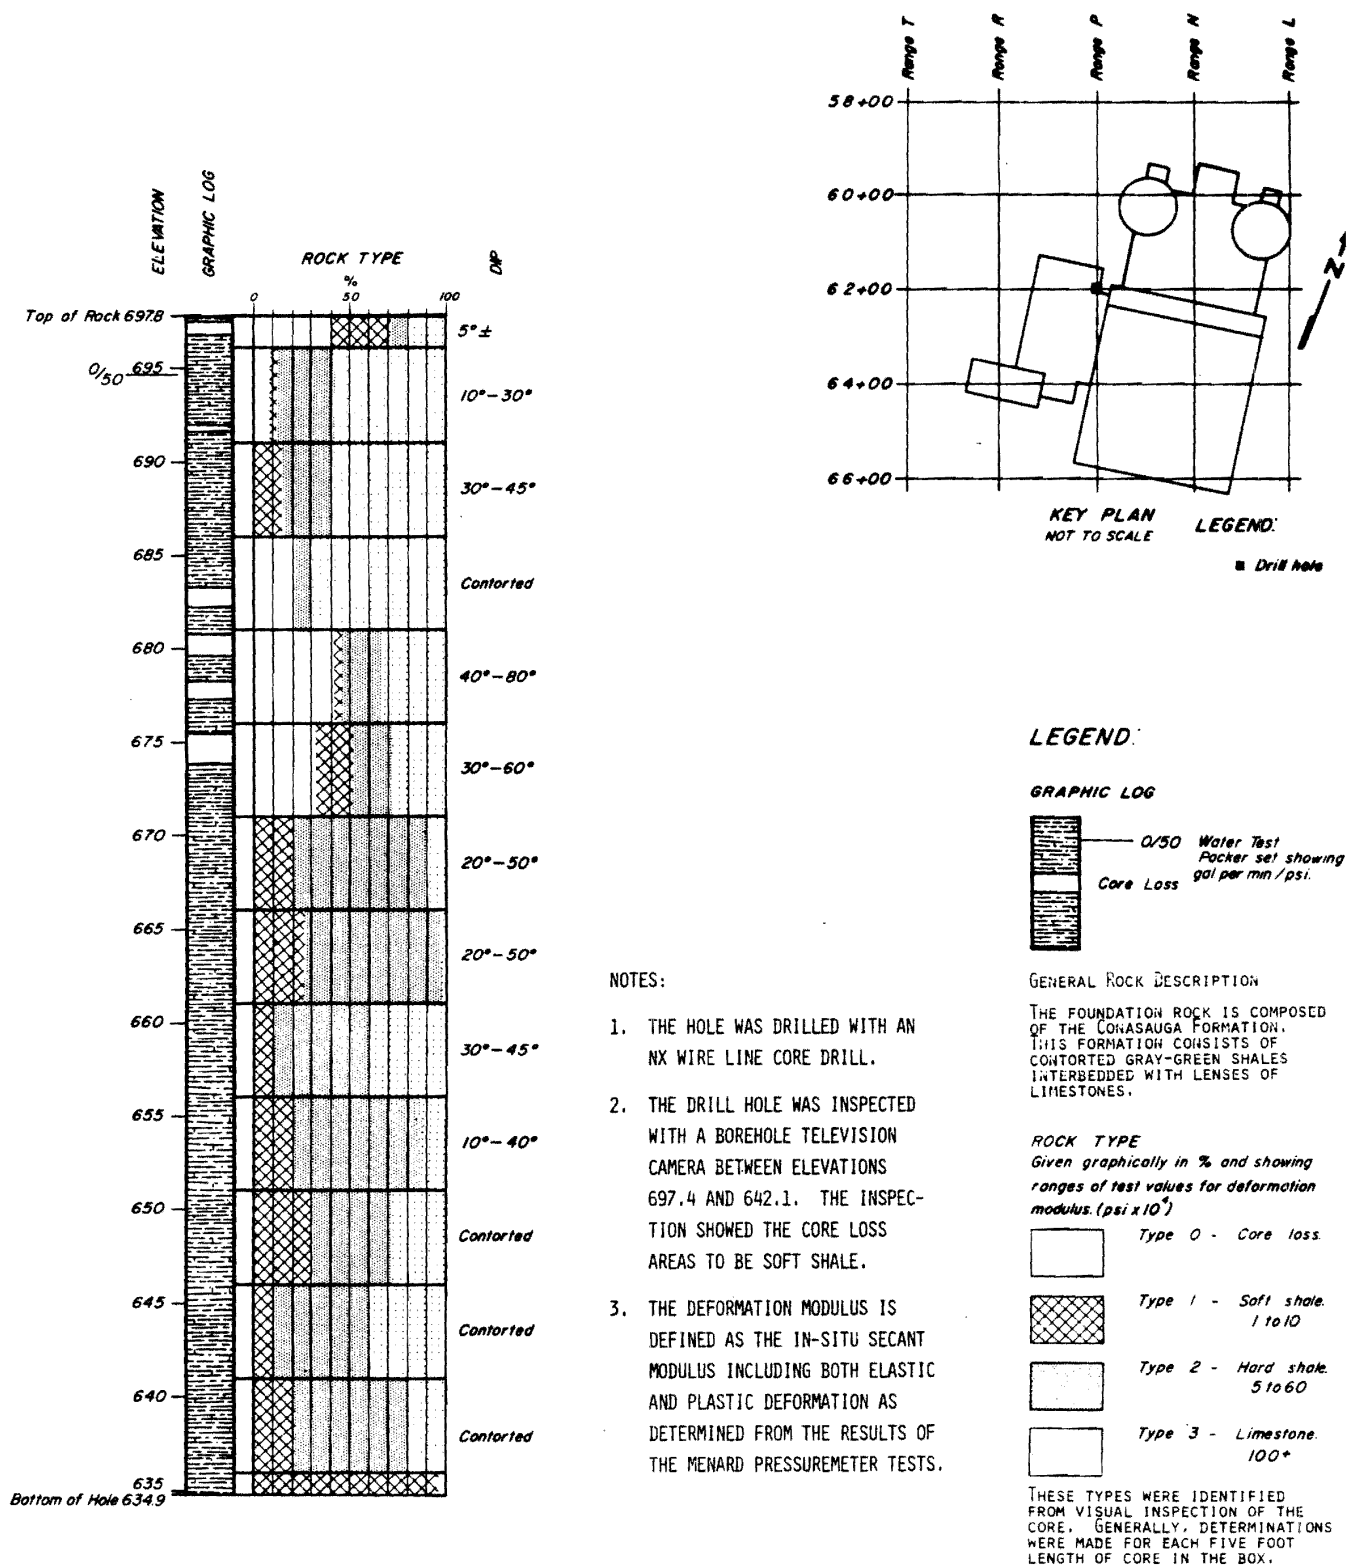

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 49
STA. P-62+00
Figure 2.5-62


Figure 2.5-62 Graphic Log Hole 49 Sta. P-62+00 (Sheet 1 of 4)

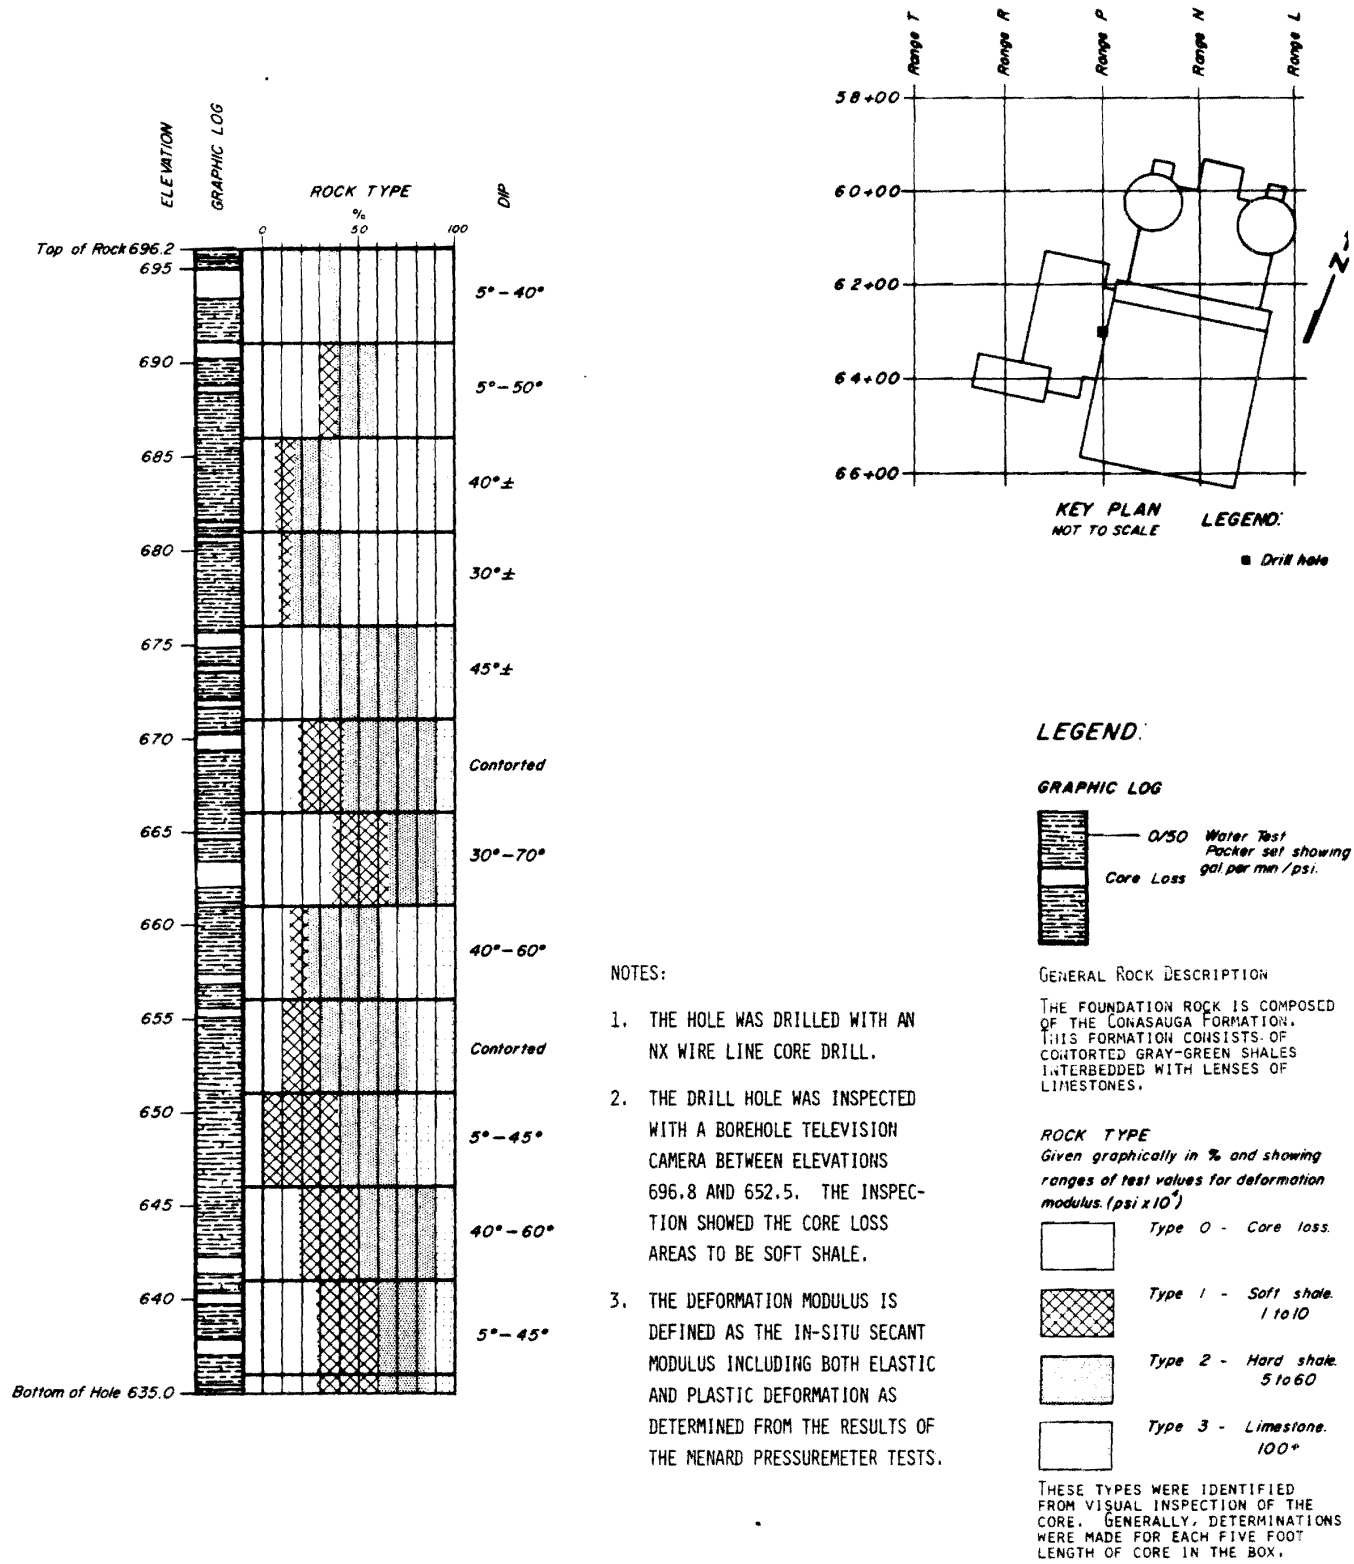

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 50
STA. P-63+00
Figure 2.5-63


Figure 2.5-63 Graphic Log Hole 50 Sta. P-63+00

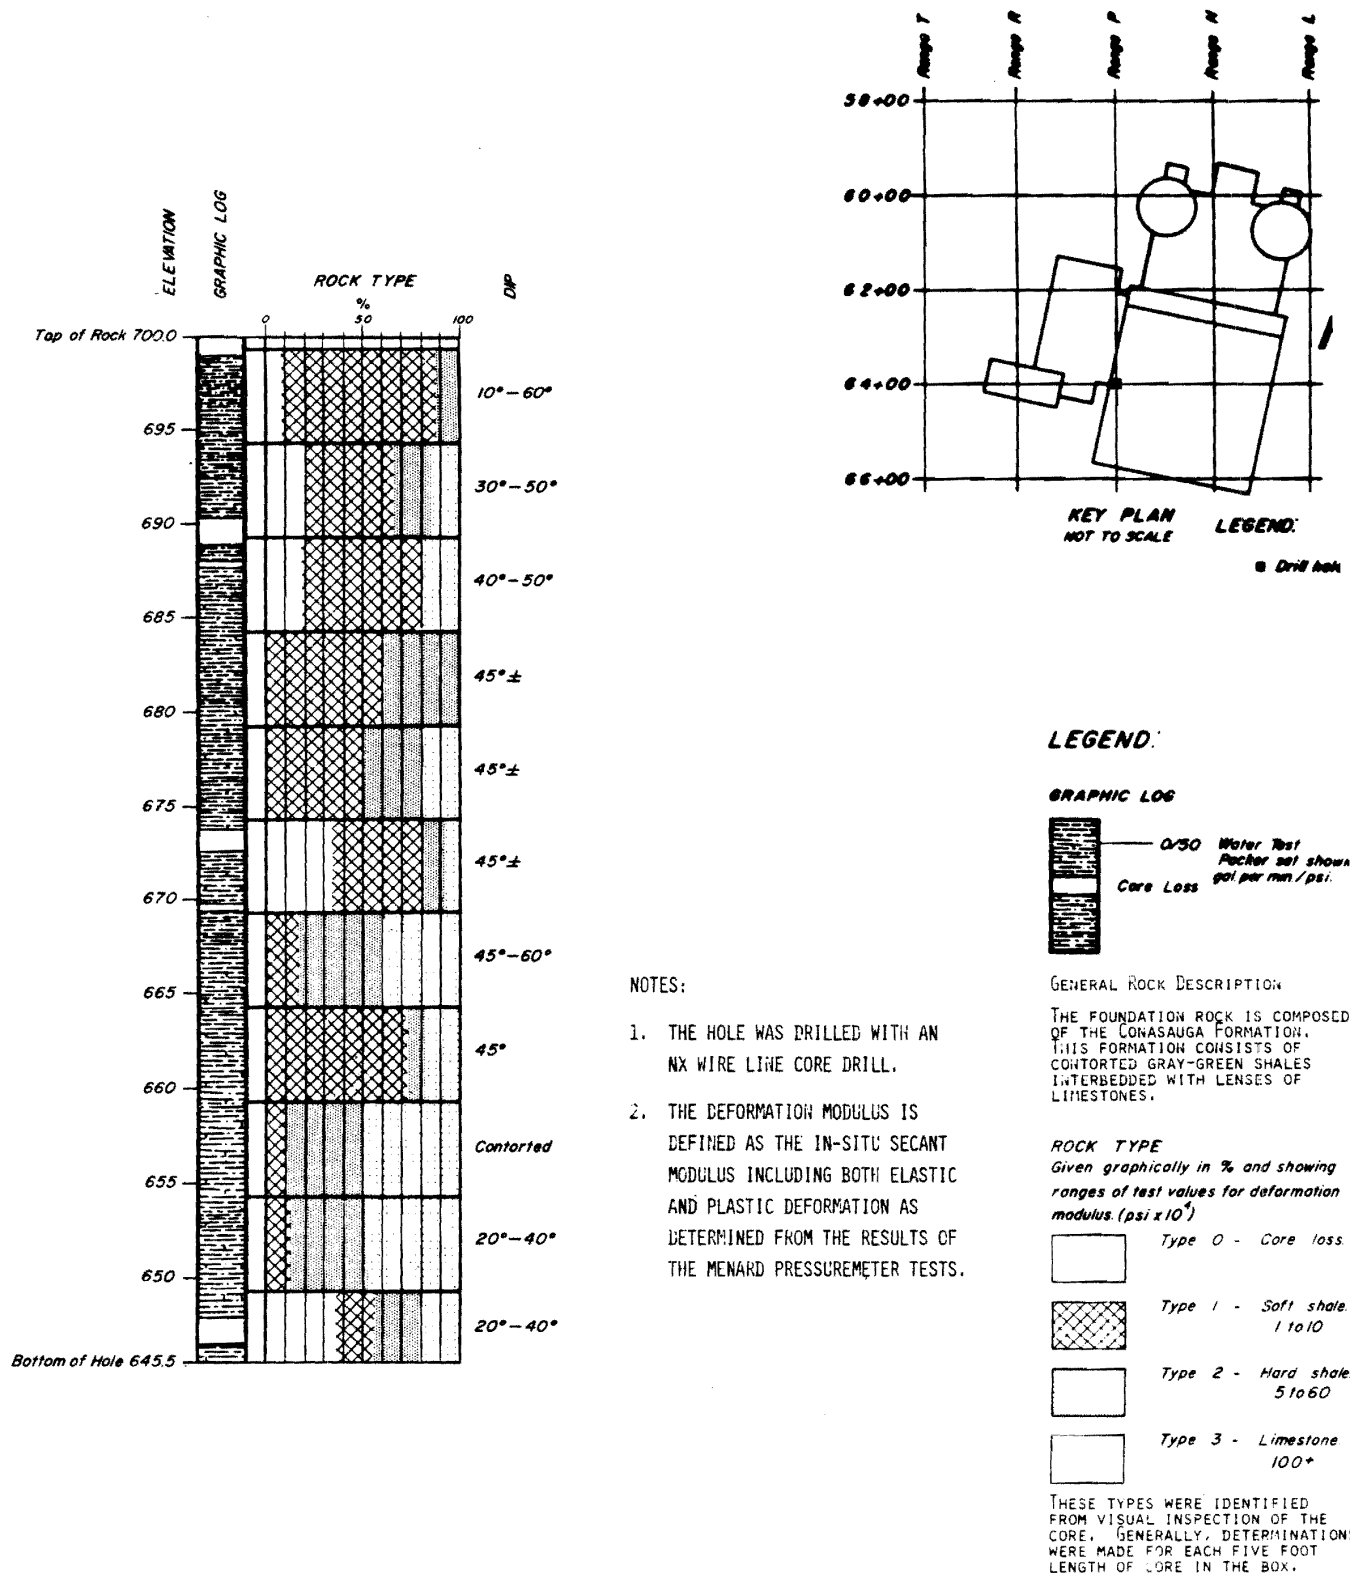

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 51
STA. P-64+00
Figure 2.5-64


Figure 2.5-64 Graphic Log Hole 51 Sta. P-64+00

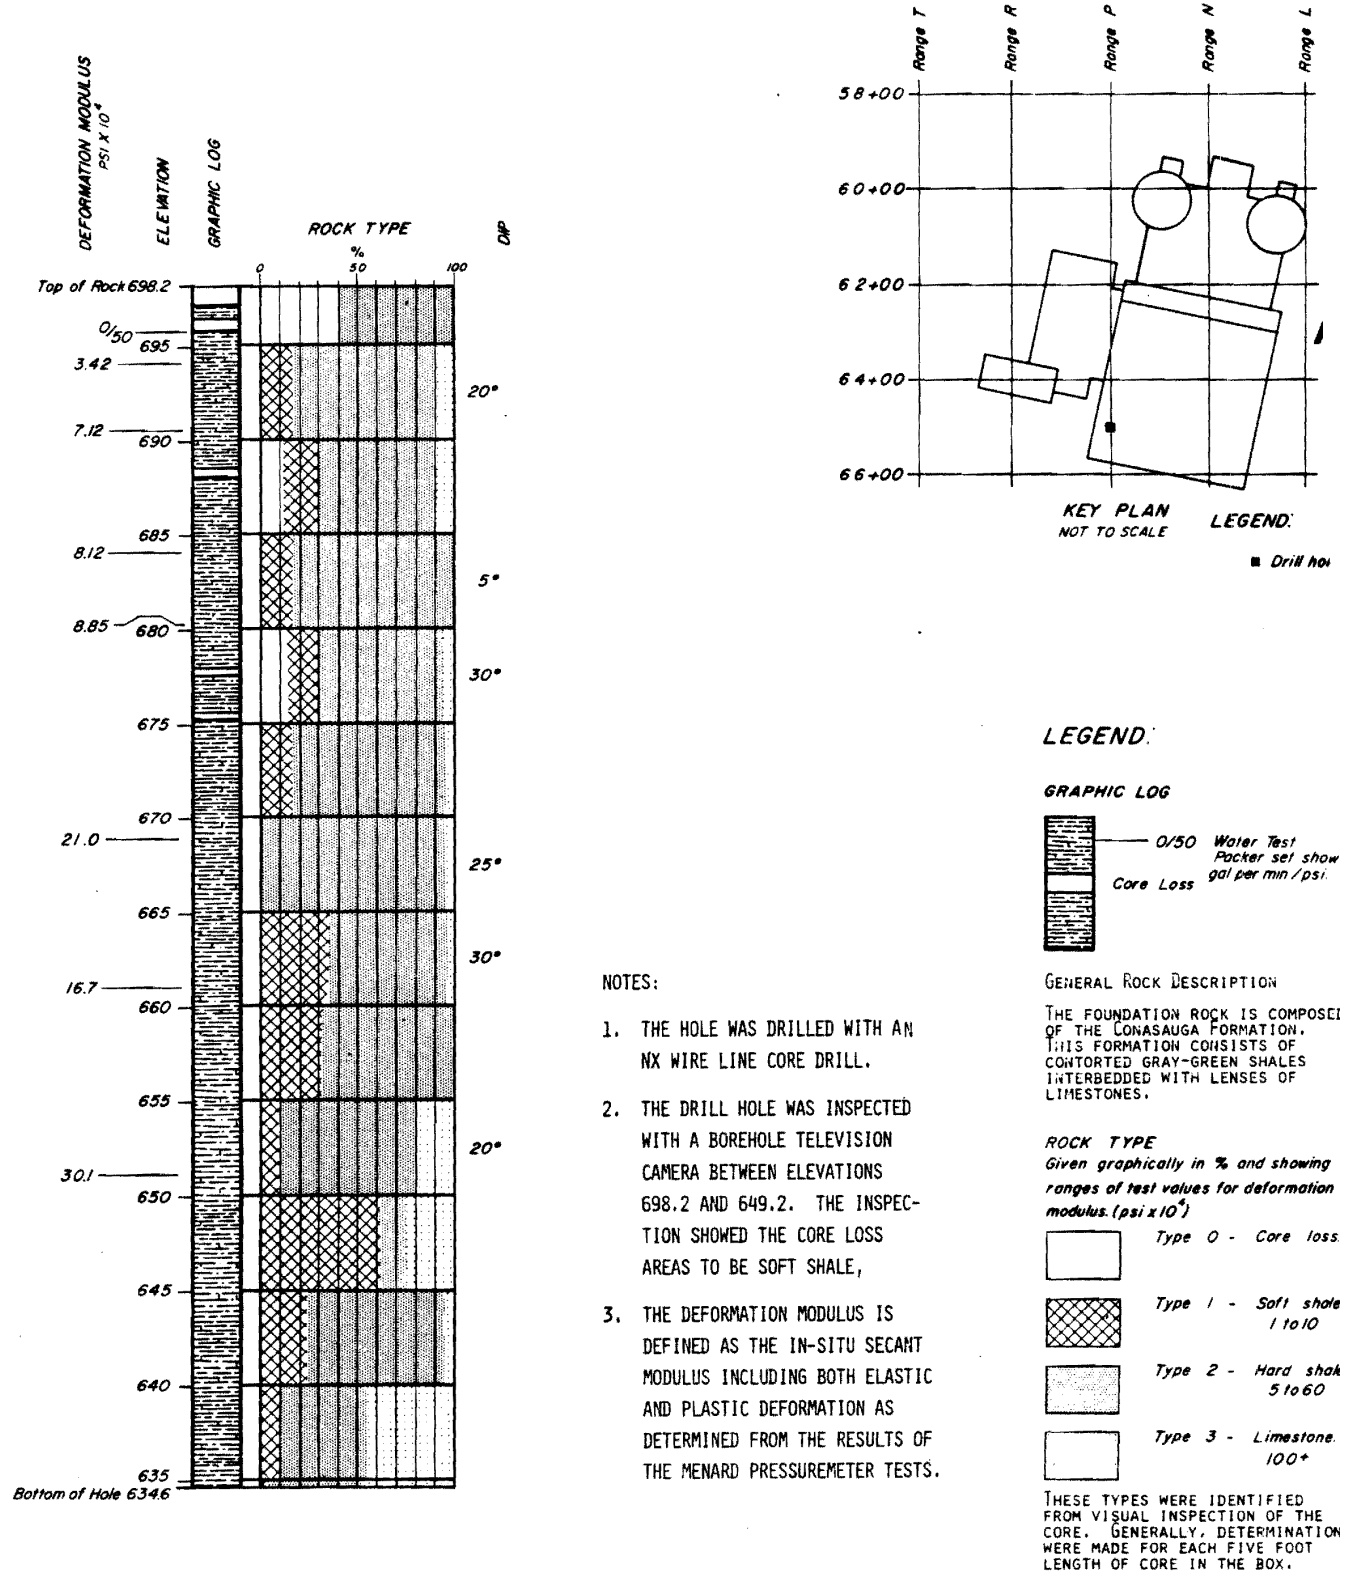

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

GRAPHIC LOG
HOLE 52
STA. P-65+00
Figure 2.5-65


Figure 2.5-65 Graphic Log Hole 52 Sta. P-65+00

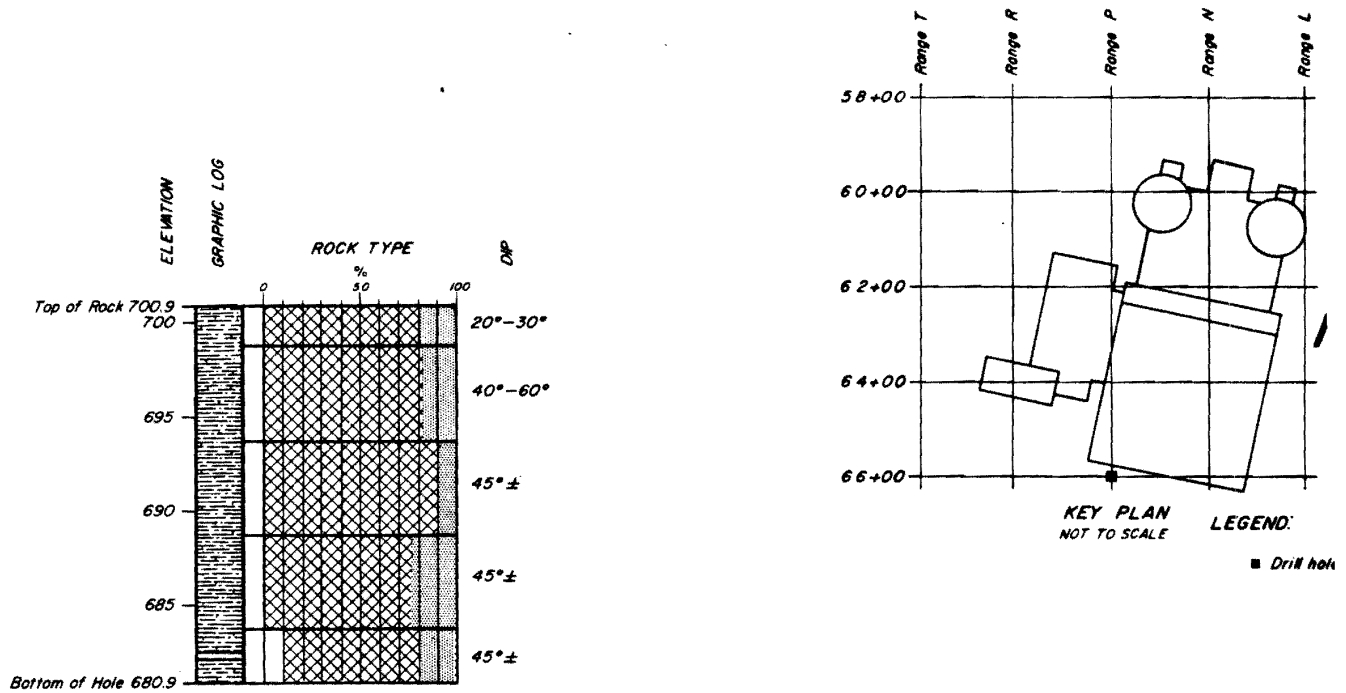

NOTES:

1. THE HOLE WAS DRILLED WITH A NX WIRE LINE CORE DRILL.
2. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.

LEGEND:

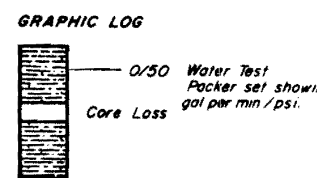

GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.


- ROCK TYPE**
Given graphically in % and showing ranges of test values for deformation modulus. (psi x 10³)
- Type 0 - Core loss
 - Type 1 - Soft shale 1 to 10
 - Type 2 - Hard shale 5 to 60
 - Type 3 - Limestone 100+

THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATION WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 53
STA. P-66+00
Figure 2.5-66


Figure 2.5-66 Graphic Log Hole 53 Sta. P-66+00

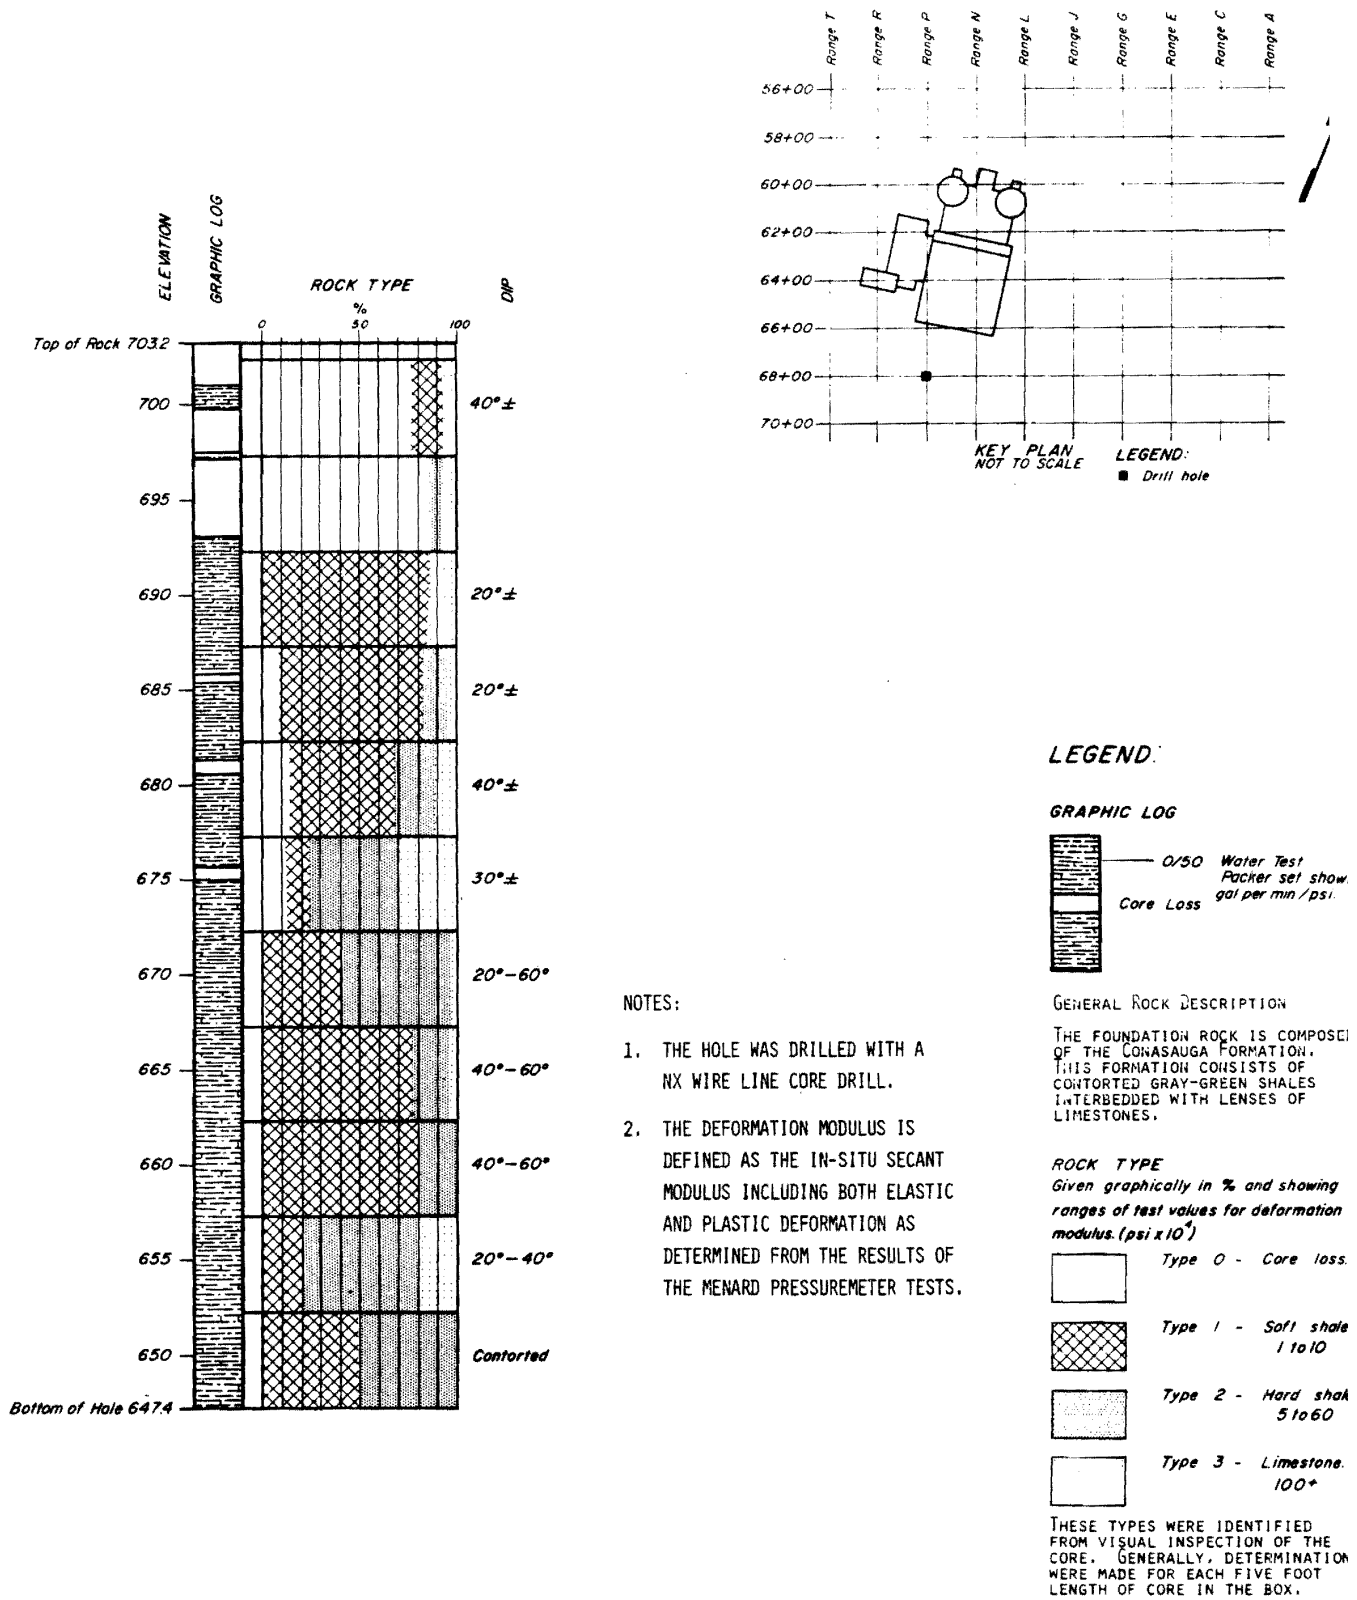

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**


GRAPHIC LOG
HOLE 54
STA. P-68+00
Figure 2.5-67

Figure 2.5-67 Graphic Log Hole 54 Sta. P-68+00

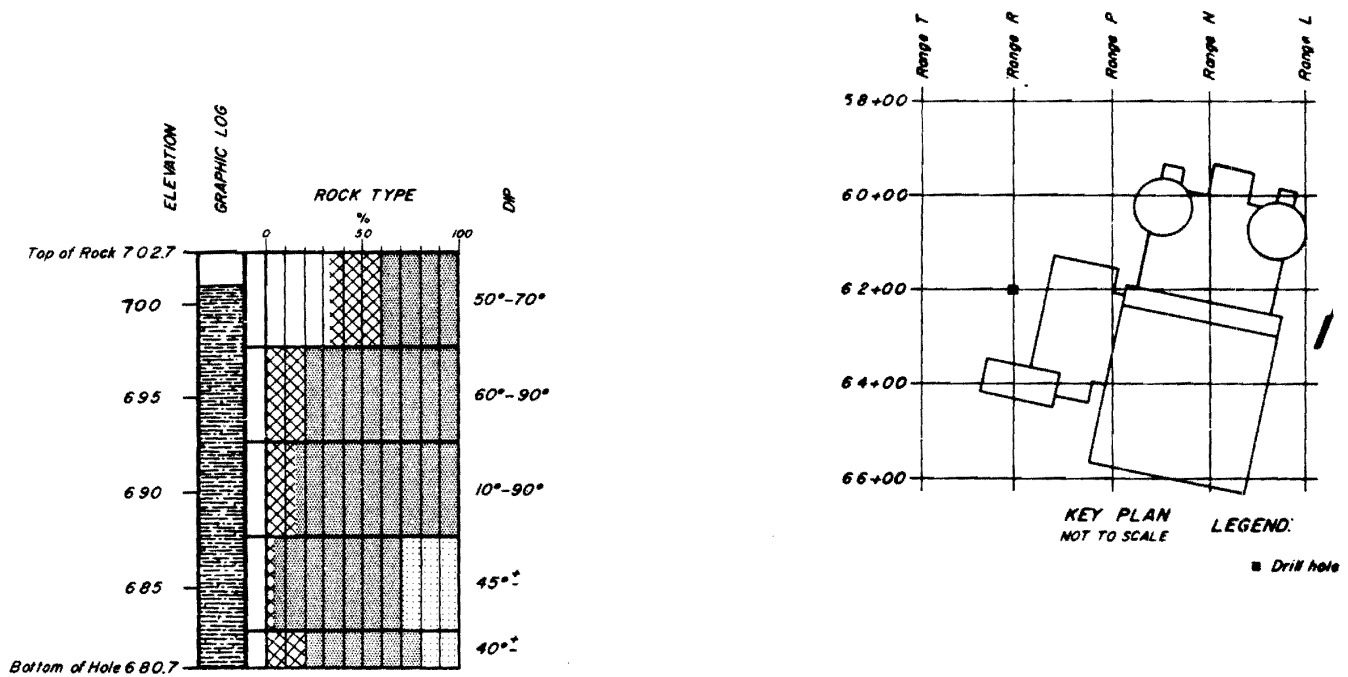

LEGEND:

GRAPHIC LOG

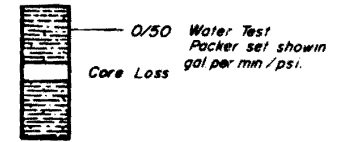

GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.

ROCK TYPE

Given graphically in % and showing ranges of test values for deformation modulus (psi x 10⁴)

- Type 0 - Core loss
- Type 1 - Soft shale 1 to 10
- Type 2 - Hard shale 5 to 60
- Type 3 - Limestone 100+

THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.


NOTES:

1. THE HOLE WAS DRILLED WITH A NX WIRE LINE CORE DRILL.
2. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

GRAPHIC LOG
HOLE 55
STA. R-62+00
Figure 2.5-68

Figure 2.5-68 Graphic Log Hole 55 Sta. R-62+00

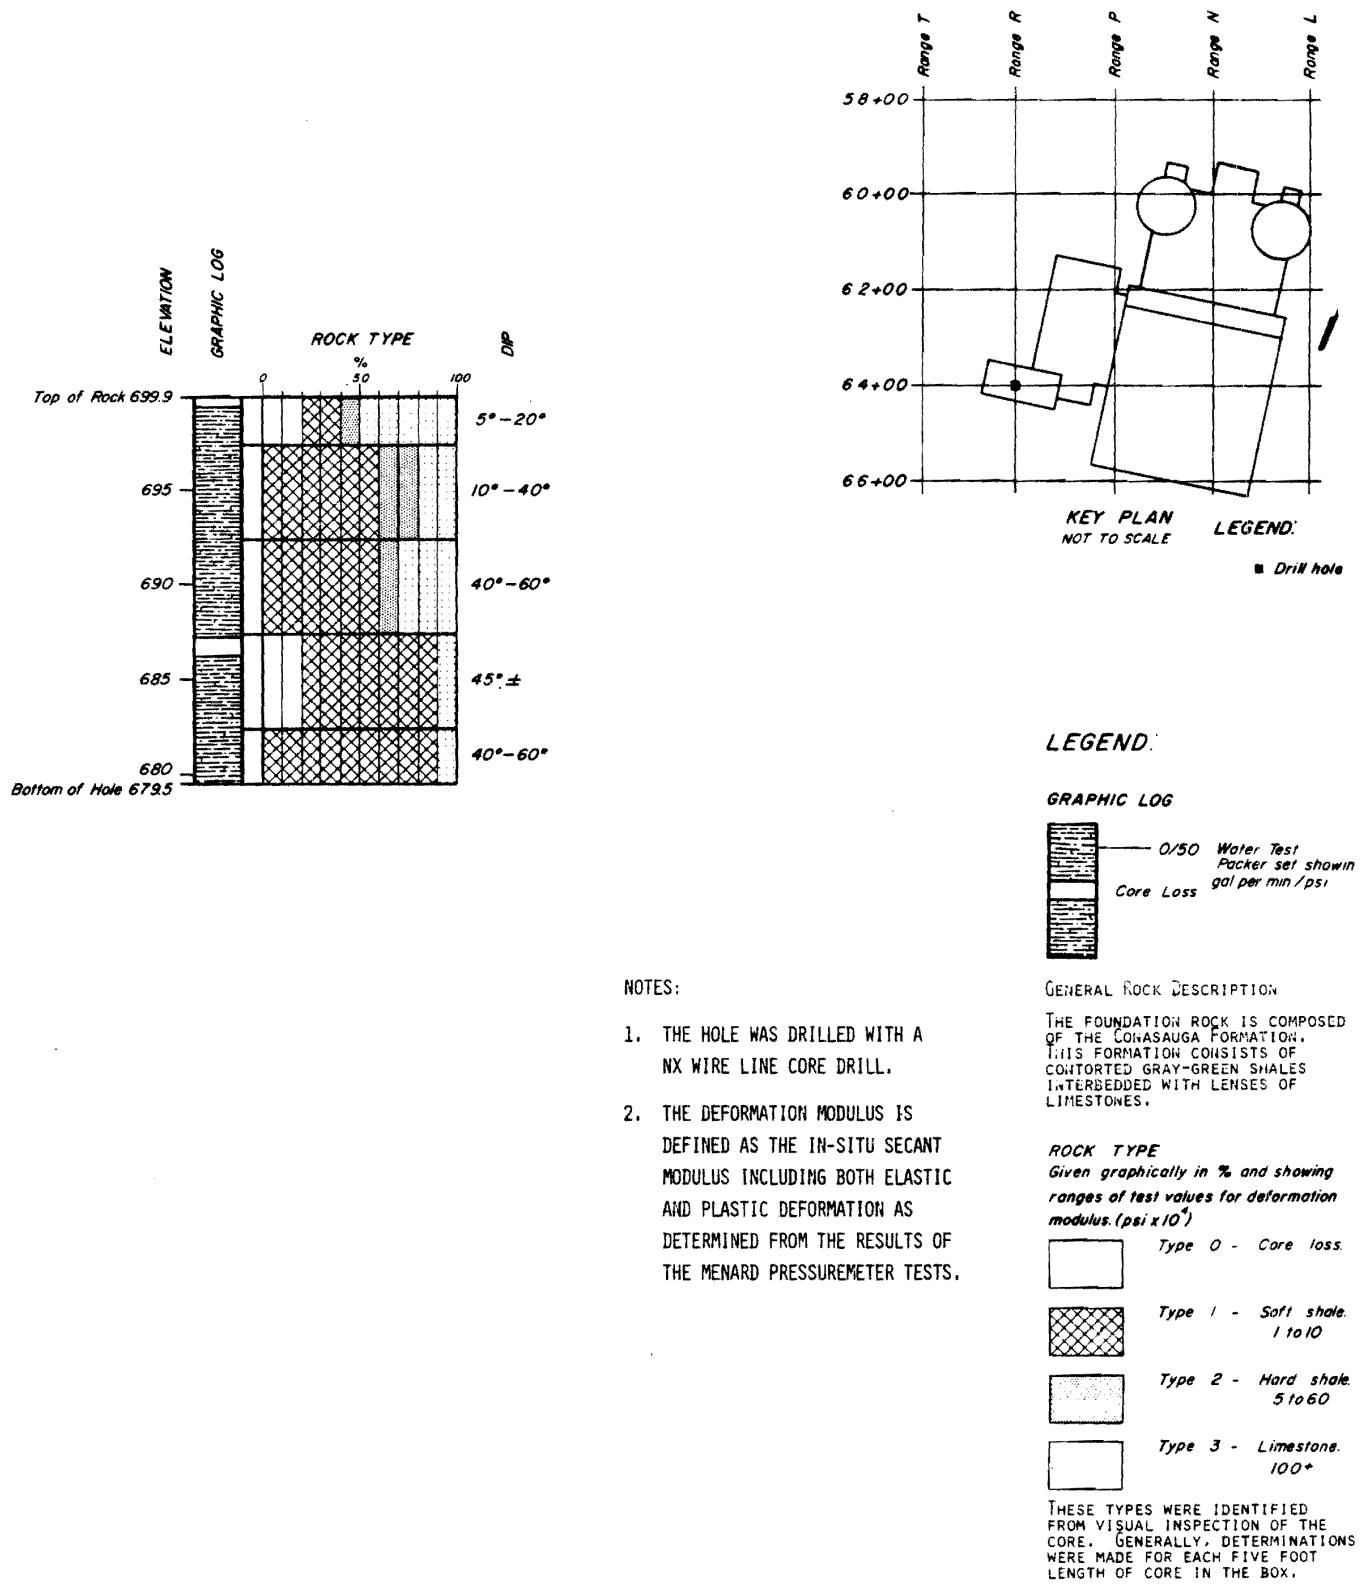

NOTES:

1. THE HOLE WAS DRILLED WITH A NX WIRE LINE CORE DRILL.
2. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG
HOLE 56
STA. R-64+00
Figure 2.5-69

Figure 2.5-69 Graphic Log Hole 56 Sta. R-64+00

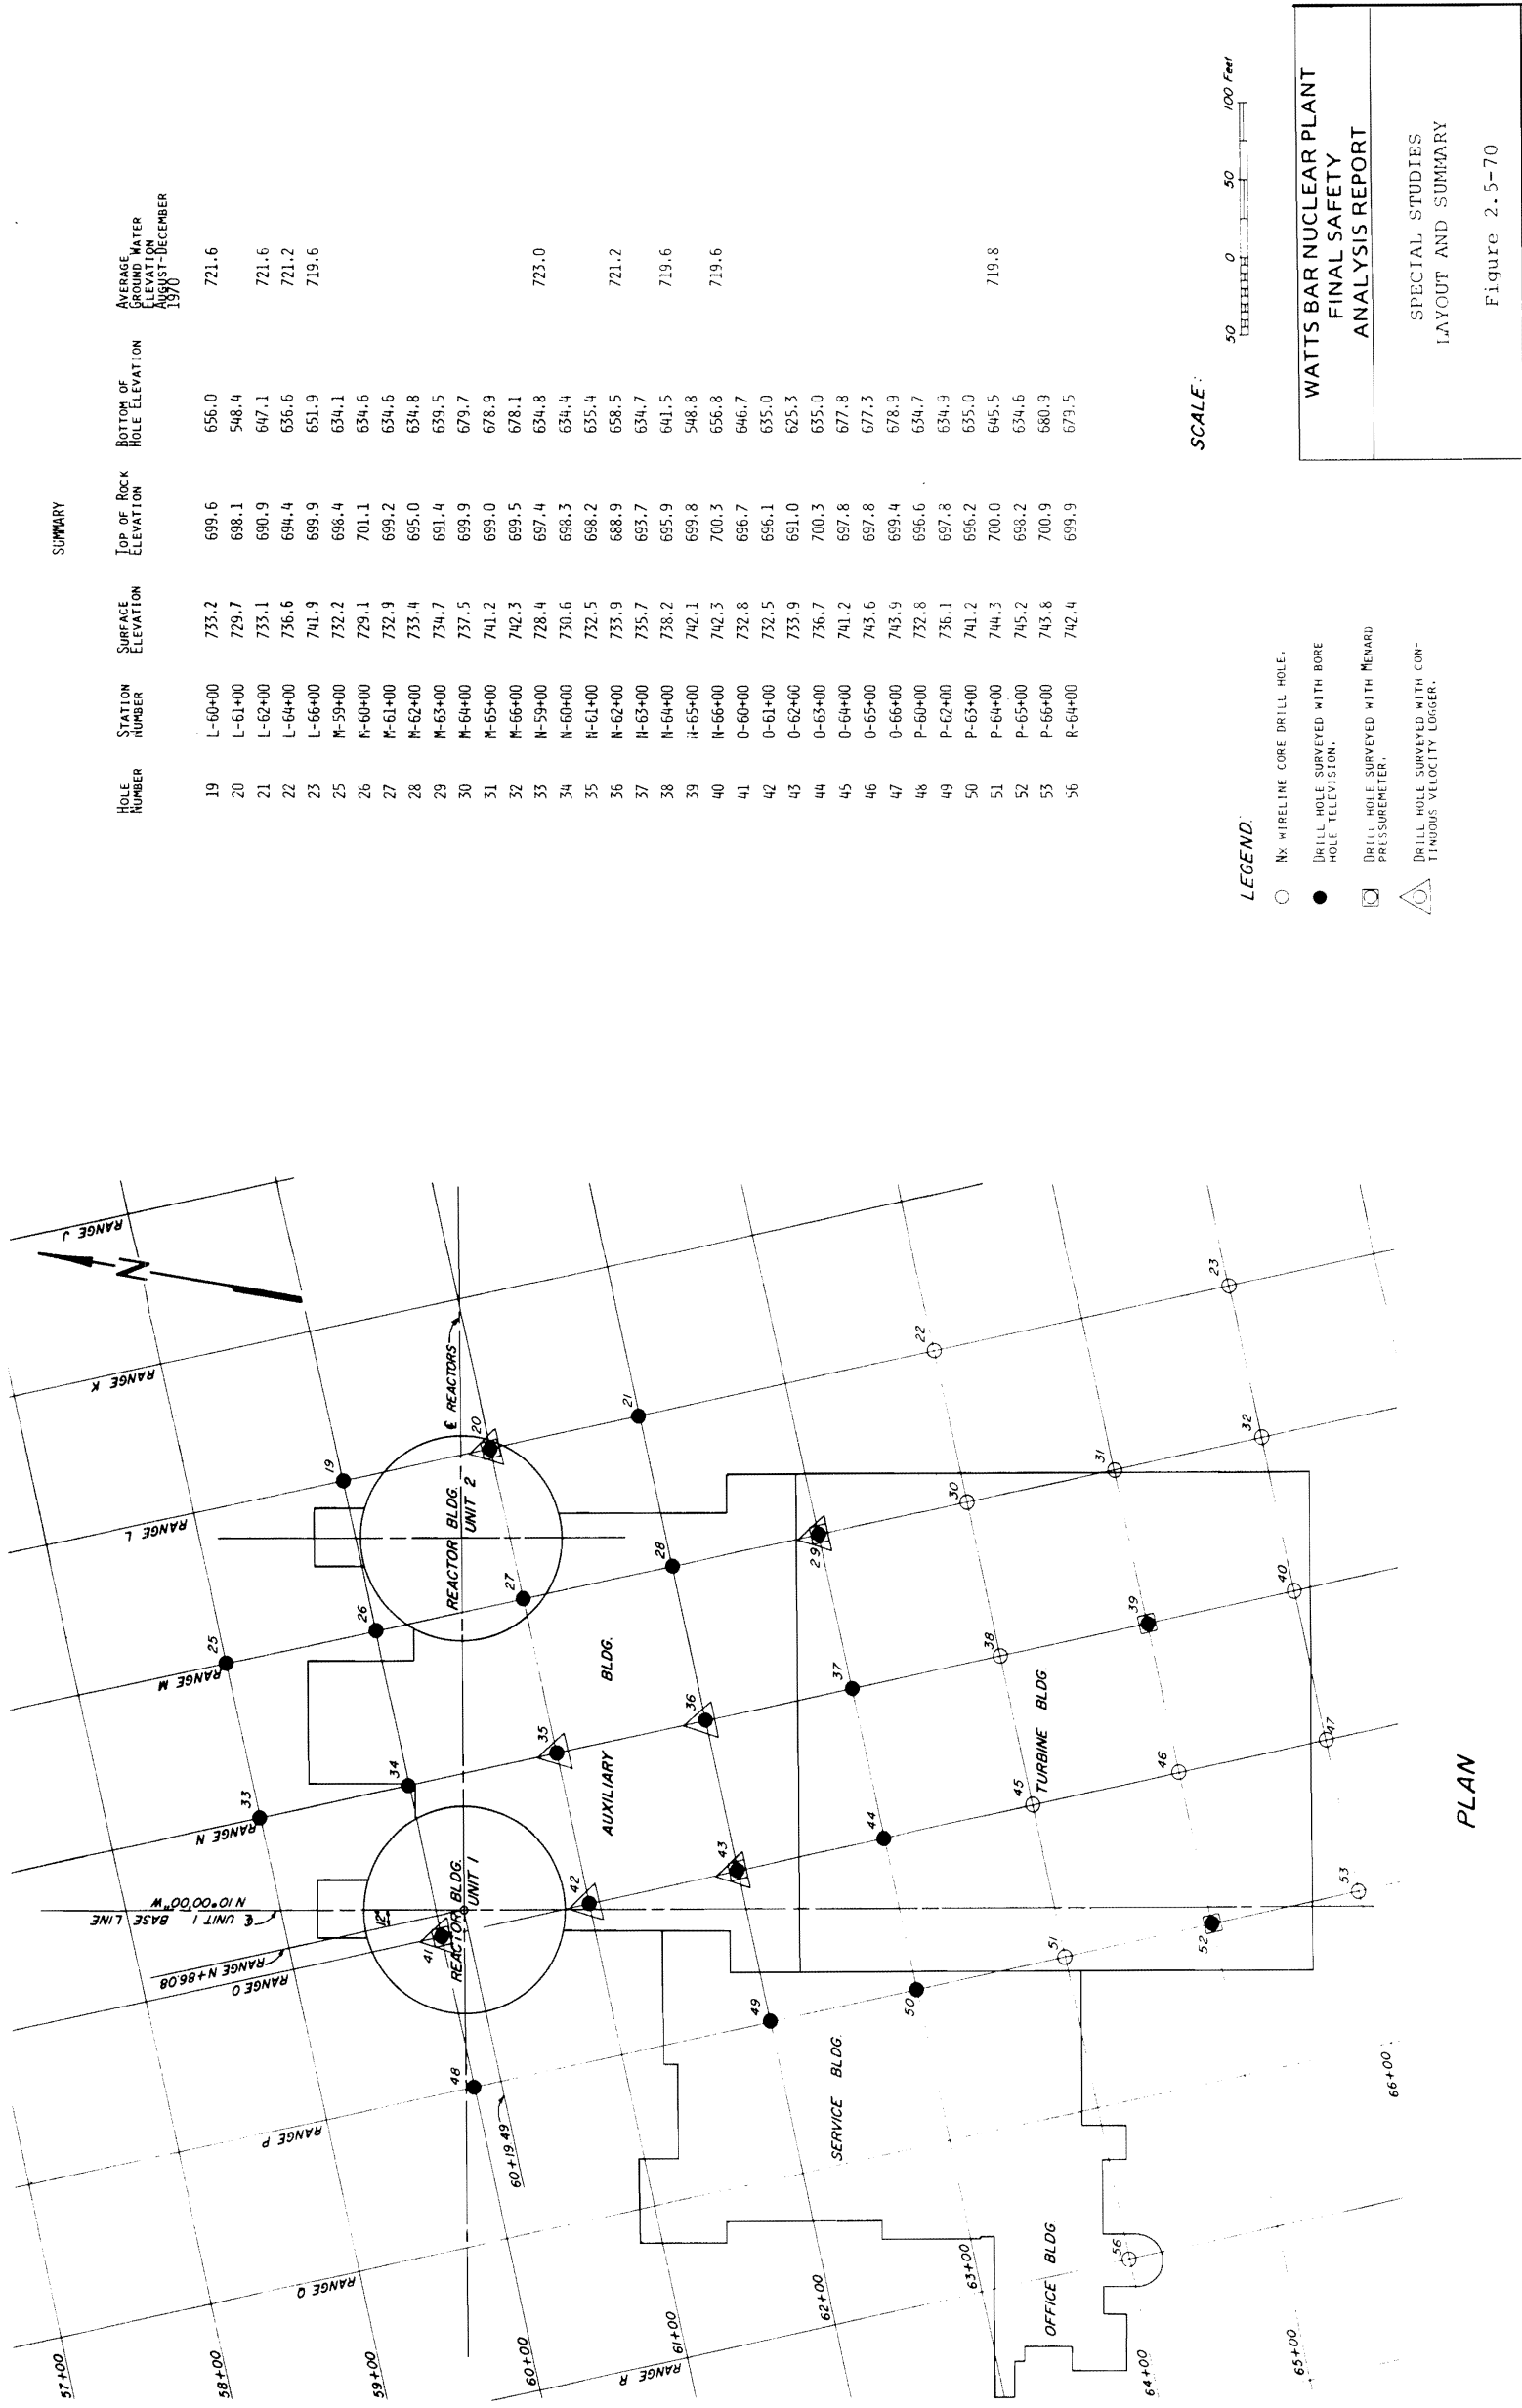


Figure 2.5-70 Special Studies Layout And Summary

Figure 2.5-71 (Please see Figures DVD for Actual Figure)

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 729.70 181.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
32.0	8625.	4804.	87.	165.	223.	34.	175.5	0.275	2.763
32.5	8766.	4828.	87.	170.	222.	33.	172.4	0.282	2.713
33.0	8937.	4841.	85.	176.	219.	32.	168.0	0.292	2.642
33.5	9173.	4907.	86.	185.	223.	31.	164.9	0.300	2.592
34.0	9183.	4809.	80.	185.	209.	31.	159.9	0.311	2.511
34.5	8940.	4589.	71.	174.	187.	33.	155.5	0.321	2.441
35.0	9055.	4675.	74.	179.	195.	32.	156.7	0.318	2.461
35.5	8905.	4788.	82.	175.	213.	32.	166.1	0.297	2.612
36.0	8711.	4915.	93.	169.	237.	33.	179.2	0.266	2.823
36.5	8329.	4758.	89.	155.	225.	36.	183.0	0.258	2.884
37.0	8421.	4859.	95.	158.	237.	35.	186.1	0.251	2.934
37.5	8373.	4877.	97.	157.	241.	36.	189.2	0.243	2.984
38.0	8883.	5145.	107.	176.	267.	32.	187.3	0.248	2.954
38.5	8994.	5053.	98.	180.	249.	32.	178.0	0.269	2.803
39.0	9040.	4908.	88.	180.	226.	32.	168.6	0.291	2.652
39.5	9101.	4893.	86.	182.	222.	31.	166.1	0.297	2.612
40.0	9279.	4976.	88.	190.	230.	30.	165.5	0.298	2.602
40.5	9386.	5121.	96.	195.	248.	30.	169.9	0.288	2.672
41.0	9535.	5202.	99.	201.	255.	29.	169.9	0.288	2.672
41.5	9719.	5315.	104.	209.	267.	28.	170.5	0.287	2.682
42.0	10233.	5597.	115.	232.	296.	26.	170.5	0.287	2.682
42.5	10364.	5681.	119.	238.	306.	25.	171.1	0.285	2.692
43.0	10614.	5805.	124.	249.	319.	24.	170.5	0.287	2.682
43.5	10887.	5883.	125.	261.	323.	23.	167.4	0.294	2.632
44.0	11048.	5999.	131.	269.	338.	22.	168.6	0.291	2.652
44.5	11232.	6099.	135.	278.	349.	22.	168.6	0.291	2.652
45.0	11187.	6045.	132.	276.	341.	22.	167.4	0.294	2.632
45.5	11130.	6028.	132.	273.	340.	22.	168.0	0.292	2.642
46.0	10942.	5942.	128.	264.	332.	23.	168.6	0.291	2.652
46.5	10518.	5697.	118.	244.	304.	24.	168.0	0.292	2.642

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 32.0 - 46.5
 Figure 2.5-72

Figure 2.5-72 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 32.0 - 46.5

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 729.70 181.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RMEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
47.0	10569.	5739.	120.	247.	309.	24.	168.6	0.291	2.652
47.5	10417.	5670.	117.	240.	303.	25.	169.2	0.290	2.662
48.0	10875.	5919.	128.	261.	330.	23.	169.2	0.290	2.662
48.5	10750.	5851.	125.	255.	322.	23.	169.2	0.290	2.662
49.0	10869.	5916.	128.	261.	330.	23.	169.2	0.290	2.662
49.5	11396.	6217.	142.	287.	365.	21.	169.9	0.288	2.672
50.0	11199.	6096.	136.	277.	350.	22.	169.2	0.290	2.662
50.5	10650.	5783.	122.	250.	314.	24.	168.6	0.291	2.652
51.0	10512.	5722.	120.	244.	308.	24.	169.2	0.290	2.662
51.5	10809.	5898.	127.	258.	328.	23.	169.9	0.288	2.672
52.0	11010.	6007.	132.	268.	341.	22.	169.9	0.288	2.672
52.5	11482.	6280.	145.	291.	379.	21.	170.5	0.287	2.682
53.0	12214.	6711.	167.	330.	428.	19.	171.7	0.284	2.702
53.5	12890.	7099.	187.	368.	481.	17.	172.4	0.282	2.713
54.0	13944.	7697.	221.	431.	566.	15.	173.0	0.281	2.723
54.5	13903.	7675.	220.	428.	563.	15.	173.0	0.281	2.723
55.0	13913.	7698.	222.	429.	568.	15.	173.6	0.279	2.733
55.5	13923.	7721.	224.	430.	573.	15.	174.2	0.278	2.743
56.0	13246.	7329.	201.	389.	515.	16.	173.6	0.279	2.733
56.5	12872.	7090.	187.	367.	479.	17.	172.4	0.282	2.713
57.0	12368.	6812.	173.	339.	442.	18.	172.4	0.282	2.713
57.5	11887.	6532.	158.	313.	406.	20.	171.7	0.284	2.702
58.0	11389.	6243.	144.	287.	370.	21.	171.1	0.285	2.692
58.5	11035.	6035.	134.	269.	345.	22.	170.5	0.287	2.682
59.0	10992.	5997.	132.	267.	339.	23.	169.9	0.288	2.672
59.5	10473.	5714.	120.	242.	308.	25.	169.9	0.288	2.672
60.0	10417.	5656.	116.	240.	300.	25.	168.6	0.291	2.652
60.5	10361.	5612.	114.	237.	295.	25.	168.0	0.292	2.642
61.0	10708.	5772.	120.	253.	310.	24.	166.7	0.295	2.622
61.5	10985.	5906.	125.	266.	324.	23.	166.1	0.297	2.612

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 47.0 - 61.5

Figure 2.5-73

Figure 2.5-73 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 47.0 - 61.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 0.0 729.70 181.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
62.0	10948.	5886.	* 124.	264.	322.	23.	166.1	0.297	2.612
62.5	11780.	6349.	* 145.	306.	376.	20.	166.7	0.295	2.622
63.0	11910.	6419.	* 148.	313.	384.	20.	166.7	0.295	2.622
63.5	11578.	6271.	* 143.	296.	368.	21.	168.0	0.292	2.642
64.0	10930.	5920.	* 127.	264.	328.	23.	168.0	0.292	2.642
64.5	11402.	6191.	* 139.	287.	360.	21.	168.6	0.291	2.652
65.0	11225.	6095.	* 135.	278.	349.	22.	168.6	0.291	2.652
65.5	11130.	6058.	* 134.	274.	346.	22.	169.2	0.290	2.662
66.0	11303.	6167.	* 139.	282.	359.	21.	169.9	0.288	2.672
66.5	11633.	6347.	* 148.	299.	380.	20.	169.9	0.288	2.672
67.0	11801.	6454.	* 153.	308.	394.	20.	170.5	0.287	2.682
67.5	12259.	6705.	* 165.	332.	425.	19.	170.5	0.287	2.682
68.0	12145.	6627.	* 161.	326.	415.	19.	169.9	0.288	2.672
68.5	13036.	7112.	* 185.	375.	477.	17.	169.9	0.288	2.672
69.0	12958.	7053.	* 182.	371.	468.	17.	169.2	0.290	2.662
69.5	12503.	6789.	* 168.	345.	433.	18.	168.6	0.291	2.652
70.0	11996.	6514.	* 154.	318.	398.	19.	168.6	0.291	2.652
70.5	11612.	6290.	* 143.	297.	371.	20.	168.0	0.292	2.642
71.0	11029.	5974.	* 129.	268.	334.	22.	168.0	0.292	2.642
71.5	11041.	5966.	* 128.	269.	333.	22.	167.4	0.294	2.632
72.0	11098.	5982.	* 129.	271.	333.	22.	166.7	0.295	2.622
72.5	11091.	5963.	* 127.	271.	330.	22.	166.1	0.297	2.612
73.0	10985.	5891.	* 124.	266.	322.	23.	165.5	0.298	2.602
73.5	10992.	5895.	* 124.	266.	322.	23.	165.5	0.298	2.602
74.0	10609.	5646.	* 112.	247.	293.	24.	163.6	0.302	2.572
74.5	10204.	5387.	* 101.	228.	265.	26.	161.7	0.307	2.541
75.0	10175.	5314.	* 97.	226.	255.	26.	159.2	0.313	2.501
75.5	9717.	5116.	* 91.	207.	238.	28.	161.1	0.308	2.531
76.0	9916.	5291.	* 99.	216.	258.	27.	164.2	0.301	2.582
76.5	9966.	5385.	* 105.	219.	271.	27.	167.4	0.294	2.632

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 62.0 - 76.5
 Figure 2.5-74

Figure 2.5-74 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 62.0 - 76.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 0.0 729.70 181.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNG'S	POROS.	DENSITY	POISSON	RHO
					MODULI IN 10 TO 4TH LBS/SQ. INCH				
77.0	9843.	5305.	101.	214.	262.	27.	166.7	0.295	2.622
77.5	9661.	5207.	98.	206.	253.	28.	166.7	0.295	2.622
78.0	9512.	5165.	97.	200.	250.	29.	168.6	0.291	2.652
78.5	9338.	5131.	98.	193.	250.	30.	171.7	0.284	2.702
79.0	8831.	4886.	89.	173.	229.	33.	173.6	0.279	2.733
79.5	8681.	4714.	81.	166.	209.	34.	168.6	0.291	2.652
80.0	8785.	4782.	83.	170.	215.	33.	169.2	0.290	2.662
80.5	9797.	5358.	106.	212.	272.	28.	170.5	0.287	2.682
81.0	10295.	5630.	117.	234.	300.	25.	170.5	0.287	2.682
81.5	10642.	5722.	117.	249.	306.	24.	166.1	0.297	2.612
82.0	10857.	5716.	114.	258.	297.	23.	161.1	0.308	2.531
82.5	10875.	5787.	118.	260.	308.	23.	163.6	0.302	2.572
83.0	10744.	5747.	117.	254.	305.	24.	164.9	0.300	2.592
83.5	10737.	5802.	122.	254.	314.	24.	167.4	0.294	2.632
84.0	10494.	5766.	123.	244.	316.	24.	171.7	0.284	2.702
84.5	11085.	6091.	137.	272.	353.	22.	171.7	0.284	2.702
85.0	10803.	5922.	129.	258.	333.	23.	171.1	0.285	2.692
85.5	10761.	5913.	130.	256.	333.	23.	171.7	0.284	2.702
86.0	10918.	6013.	134.	264.	345.	23.	172.4	0.282	2.713
86.5	10949.	6002.	133.	265.	342.	23.	171.1	0.285	2.692
87.0	10575.	5700.	117.	246.	303.	24.	166.7	0.295	2.622
87.5	10226.	5512.	109.	230.	283.	26.	166.7	0.295	2.622
88.0	10109.	5449.	107.	225.	277.	26.	166.7	0.295	2.622
88.5	10104.	5446.	107.	225.	276.	26.	166.7	0.295	2.622
89.0	10173.	5456.	106.	228.	276.	26.	165.5	0.298	2.602
89.5	10168.	5453.	106.	228.	276.	26.	165.5	0.298	2.602
90.0	10173.	5456.	106.	228.	276.	26.	165.5	0.298	2.602
90.5	10178.	5472.	107.	228.	278.	26.	166.1	0.297	2.612
91.0	10726.	5767.	119.	253.	309.	24.	166.1	0.297	2.612
91.5	11455.	6159.	136.	289.	352.	21.	166.1	0.297	2.612

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 77.0 - 91.5

Figure 2.5-75

Figure 2.5-75 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 77.0 - 91.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 729.70 181.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	YP	VS	SHEAR	BULK	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH								
92.0	11702.	6291.	142.	302.	20.	166.1	0.297	2.612
92.5	11836.	6363.	145.	309.	20.	166.1	0.297	2.612
93.0	11959.	6429.	148.	315.	19.	166.1	0.297	2.612
93.5	11455.	6159.	136.	289.	21.	166.1	0.297	2.612
94.0	11951.	6425.	148.	315.	19.	166.1	0.297	2.612
94.5	11709.	6279.	141.	302.	20.	165.5	0.298	2.602
95.0	11375.	6100.	133.	285.	21.	165.5	0.298	2.602
95.5	11475.	6170.	136.	290.	21.	166.1	0.297	2.612
96.0	11687.	6268.	140.	301.	20.	165.5	0.298	2.602
96.5	11680.	6264.	140.	300.	20.	165.5	0.298	2.602
97.0	11758.	6305.	142.	304.	20.	165.5	0.298	2.602
97.5	11605.	6239.	139.	297.	21.	166.1	0.297	2.612
98.0	11523.	6210.	139.	293.	21.	166.7	0.295	2.622
98.5	11944.	6421.	148.	314.	20.	166.1	0.297	2.612
99.0	11523.	6226.	140.	293.	21.	167.4	0.294	2.632
99.5	11322.	6133.	136.	283.	21.	168.0	0.292	2.642
100.0	10912.	5925.	128.	263.	23.	168.6	0.291	2.652
100.5	10756.	5840.	124.	255.	23.	168.6	0.291	2.652
101.0	10115.	5492.	110.	226.	26.	168.6	0.291	2.652
101.5	9895.	5373.	105.	216.	27.	168.6	0.291	2.652
102.0	10254.	5554.	112.	232.	26.	168.0	0.292	2.642
102.5	10797.	5834.	123.	257.	23.	167.4	0.294	2.632
103.0	11186.	6029.	131.	276.	22.	166.7	0.295	2.622
103.5	11098.	5981.	129.	271.	22.	166.7	0.295	2.622
104.0	10942.	5898.	125.	264.	23.	166.7	0.295	2.622
104.5	11054.	5958.	128.	269.	22.	166.7	0.295	2.622
105.0	10351.	5593.	113.	236.	25.	167.4	0.294	2.632
105.5	10100.	5457.	108.	225.	26.	167.4	0.294	2.632
106.0	9925.	5376.	105.	217.	27.	168.0	0.292	2.642
106.5	9895.	5359.	104.	216.	27.	168.0	0.292	2.642

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 92.0 - 106.5

Figure 2.5-76

Figure 2.5-76 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 92.0 - 106.5

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 0.0 729.70 181.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RMEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
107.0	10616.	5736.	119.	248.	307.	24.	167.4	0.294	2.632
107.5	10815.	5844.	123.	258.	319.	23.	167.4	0.294	2.632
108.0	10803.	5823.	122.	257.	316.	23.	166.7	0.295	2.622
108.5	10587.	5706.	117.	247.	303.	24.	166.7	0.295	2.622
109.0	10335.	5557.	111.	235.	287.	25.	166.1	0.297	2.612
109.5	9951.	5350.	103.	218.	266.	27.	166.1	0.297	2.612
110.0	9557.	5138.	95.	201.	245.	29.	166.1	0.297	2.612
110.5	9391.	5049.	91.	194.	237.	30.	166.1	0.297	2.612
111.0	9391.	5036.	91.	194.	235.	30.	165.5	0.298	2.602
111.5	9432.	5058.	91.	196.	237.	30.	165.5	0.298	2.602
112.0	9473.	5080.	92.	198.	239.	29.	165.5	0.298	2.602
112.5	9642.	5171.	95.	205.	248.	28.	165.5	0.298	2.602
113.0	9642.	5171.	95.	205.	248.	28.	165.5	0.298	2.602
113.5	9685.	5194.	96.	206.	250.	28.	165.5	0.298	2.602
114.0	9906.	5326.	102.	216.	264.	27.	166.1	0.297	2.612
114.5	9906.	5339.	103.	216.	266.	27.	166.7	0.295	2.622
115.0	9951.	5363.	103.	218.	268.	27.	166.7	0.295	2.622
115.5	10090.	5438.	106.	224.	276.	26.	166.7	0.295	2.622
116.0	10685.	5774.	120.	252.	311.	24.	167.4	0.294	2.632
116.5	11238.	6072.	133.	278.	344.	22.	167.4	0.294	2.632
117.0	11414.	6183.	139.	287.	358.	21.	168.0	0.292	2.642
117.5	12460.	6749.	165.	342.	427.	18.	168.0	0.292	2.642
118.0	12046.	6541.	156.	320.	402.	19.	168.6	0.291	2.652
118.5	12826.	6964.	176.	363.	453.	17.	168.6	0.291	2.652
119.0	12979.	7064.	182.	372.	470.	17.	169.2	0.290	2.662
119.5	13057.	7107.	184.	377.	476.	17.	169.2	0.290	2.662
120.0	13057.	7107.	184.	377.	476.	17.	169.2	0.290	2.662
120.5	12751.	6940.	176.	359.	454.	17.	169.2	0.290	2.662
121.0	12389.	6743.	166.	339.	428.	18.	169.2	0.290	2.662
121.5	11914.	6469.	152.	313.	393.	20.	168.6	0.291	2.652

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 107.0 - 121.5

Figure 2.5-77

Figure 2.5-77 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 107.0 - 121.5

B I R D W E L L 3-0 E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 729.70 161.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
122.0	11556.	6260.	* 142.	295.	367.	21.	168.0	0.292	2.642
122.5	11142.	6035.	* 132.	274.	341.	22.	168.0	0.292	2.642
123.0	10379.	5594.	* 113.	237.	292.	25.	166.7	0.295	2.622
123.5	9856.	5299.	* 101.	214.	261.	27.	166.1	0.297	2.612
124.0	10423.	5604.	* 113.	239.	292.	25.	166.1	0.297	2.612
124.5	10645.	5708.	* 116.	249.	302.	24.	165.5	0.298	2.602
125.0	10750.	5765.	* 119.	254.	308.	24.	165.5	0.298	2.602
125.5	10839.	5798.	* 120.	258.	311.	23.	164.9	0.300	2.592
126.0	10833.	5795.	* 119.	258.	310.	23.	164.9	0.300	2.592
126.5	10833.	5795.	* 119.	258.	310.	23.	164.9	0.300	2.592
127.0	10627.	5685.	* 115.	248.	299.	24.	164.9	0.300	2.592
127.5	10627.	5685.	* 115.	248.	299.	24.	164.9	0.300	2.592
128.0	10627.	5714.	* 117.	249.	303.	24.	166.1	0.297	2.612
128.5	10674.	5753.	* 119.	251.	308.	24.	166.7	0.295	2.622
129.0	10942.	5912.	* 126.	264.	327.	23.	167.4	0.294	2.632
129.5	11401.	6160.	* 137.	287.	355.	21.	167.4	0.294	2.632
130.0	11645.	6292.	* 143.	299.	370.	20.	167.4	0.294	2.632
130.5	11778.	6364.	* 146.	306.	378.	20.	167.4	0.294	2.632
131.0	11522.	6210.	* 139.	293.	359.	21.	166.7	0.295	2.622
131.5	11401.	6130.	* 135.	286.	349.	21.	166.1	0.297	2.612
132.0	11225.	6020.	* 129.	277.	336.	22.	165.5	0.298	2.602
132.5	10936.	5865.	* 123.	263.	319.	23.	165.5	0.298	2.602
133.0	10827.	5806.	* 120.	258.	312.	23.	165.5	0.298	2.602
133.5	10668.	5706.	* 116.	250.	301.	24.	164.9	0.300	2.592
134.0	10616.	5679.	* 115.	248.	298.	24.	164.9	0.300	2.592
134.5	10622.	5682.	* 115.	248.	298.	24.	164.9	0.300	2.592
135.0	10774.	5778.	* 119.	255.	309.	23.	165.5	0.298	2.602
135.5	10762.	5771.	* 119.	255.	309.	23.	165.5	0.298	2.602
136.0	10768.	5775.	* 119.	255.	309.	23.	165.5	0.298	2.602
136.5	10833.	5810.	* 120.	258.	313.	23.	165.5	0.298	2.602

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 122.0 - 136.5

Figure 2.5-78

Figure 2.5-78 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 122.0 - 136.5

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 0.0 729.70 181.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK YOUNGS	POROS.	DENSITY	POISSON	RHO	
MODULI IN 10 TO 4TH LBS/SQ. INCH									
137.0	10948.	5871.	123.	264.	320.	23.	165.5	0.298	2.602
137.5	11225.	6035.	130.	277.	338.	22.	166.1	0.297	2.612
138.0	11328.	6075.	132.	282.	342.	21.	165.5	0.298	2.602
138.5	11335.	6079.	132.	283.	342.	21.	165.5	0.298	2.602
139.0	11116.	5977.	128.	272.	332.	22.	166.1	0.297	2.612
139.5	11116.	5977.	128.	272.	332.	22.	166.1	0.297	2.612
140.0	11110.	5973.	128.	272.	332.	22.	166.1	0.297	2.612
140.5	10882.	5865.	124.	261.	321.	23.	166.7	0.295	2.622
141.0	10726.	5767.	119.	253.	309.	24.	166.1	0.297	2.612
141.5	10780.	5810.	121.	256.	315.	23.	166.7	0.295	2.622
142.0	10888.	5868.	124.	261.	321.	23.	166.7	0.295	2.622
142.5	10888.	5868.	124.	261.	321.	23.	166.7	0.295	2.622
143.0	10888.	5868.	124.	261.	321.	23.	166.7	0.295	2.622
143.5	10570.	5683.	116.	246.	300.	24.	166.1	0.297	2.612
144.0	10468.	5642.	114.	241.	297.	25.	166.7	0.295	2.622
144.5	10674.	5739.	118.	251.	306.	24.	166.1	0.297	2.612
145.0	10780.	5781.	119.	256.	310.	23.	165.5	0.298	2.602
145.5	10774.	5778.	119.	255.	309.	23.	165.5	0.298	2.602
146.0	11110.	5958.	127.	272.	329.	22.	165.5	0.298	2.602
146.5	11110.	5943.	126.	272.	326.	22.	164.9	0.300	2.592
147.0	10780.	5781.	119.	256.	310.	23.	165.5	0.298	2.602
147.5	10519.	5641.	114.	244.	295.	24.	163.5	0.298	2.602
148.0	10314.	5531.	109.	234.	284.	25.	165.5	0.298	2.602
148.5	10780.	5793.	120.	256.	312.	23.	166.1	0.297	2.612
149.0	10468.	5628.	114.	241.	294.	25.	166.1	0.297	2.612
149.5	10319.	5548.	110.	235.	286.	25.	166.1	0.297	2.612
150.0	10674.	5739.	118.	251.	306.	24.	166.1	0.297	2.612
150.5	10468.	5628.	114.	241.	294.	25.	166.1	0.297	2.612
151.0	10674.	5739.	118.	251.	306.	24.	166.1	0.297	2.612
151.5	10780.	5793.	120.	256.	312.	23.	166.1	0.297	2.612

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 137.0 - 151.5

Figure 2.5-79

Figure 2.5-79 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 137.0 - 151.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 0.0 729.70 181.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	POROS.	DENSITY	POISSON	RMO
MODULI IN 10 TO 4TH LBS/SQ. INCH								
152.0	10888.	5839.	* 122.	261.	316.	165.5	0.298	2.602
152.5	11110.	5958.	* 127.	272.	329.	165.5	0.298	2.602
153.0	10833.	5810.	* 120.	258.	313.	165.5	0.298	2.602
153.5	10418.	5587.	* 111.	239.	289.	165.5	0.298	2.602
154.0	10319.	5534.	* 109.	234.	284.	165.5	0.298	2.602
154.5	10270.	5508.	* 108.	232.	281.	165.5	0.298	2.602
155.0	10726.	5752.	* 118.	253.	307.	165.5	0.298	2.602
155.5	10524.	5644.	* 114.	244.	295.	165.5	0.298	2.602
156.0	10894.	5842.	* 122.	261.	316.	165.5	0.298	2.602
156.5	11231.	6038.	* 131.	278.	339.	166.1	0.297	2.612
157.0	11529.	6198.	* 138.	293.	357.	166.1	0.297	2.612
157.5	11529.	6214.	* 139.	293.	360.	166.7	0.295	2.622
158.0	11231.	6053.	* 132.	278.	341.	166.7	0.295	2.622
158.5	11468.	6181.	* 137.	290.	356.	166.7	0.295	2.622
159.0	11408.	6149.	* 136.	287.	352.	166.7	0.295	2.622
159.5	10839.	5857.	* 124.	259.	320.	167.4	0.294	2.632
160.0	11590.	6278.	* 143.	296.	369.	168.0	0.292	2.642
160.5	12173.	6594.	* 158.	327.	407.	168.0	0.292	2.642
161.0	12303.	6680.	* 162.	334.	419.	168.6	0.291	2.652
161.5	12234.	6659.	* 162.	331.	417.	169.2	0.290	2.662
162.0	11900.	6477.	* 153.	313.	395.	169.2	0.290	2.662
162.5	11645.	6338.	* 147.	299.	378.	169.2	0.290	2.662
163.0	11348.	6177.	* 139.	284.	359.	169.2	0.290	2.662
163.5	11060.	6020.	* 132.	270.	341.	169.2	0.290	2.662
164.0	10948.	5959.	* 130.	265.	334.	169.2	0.290	2.662
164.5	11060.	6020.	* 132.	270.	341.	169.2	0.290	2.662
165.0	11231.	6098.	* 135.	278.	349.	168.6	0.291	2.652
165.5	11414.	6183.	* 139.	287.	358.	168.0	0.292	2.642
166.0	11414.	6183.	* 139.	287.	358.	168.0	0.292	2.642
166.5	11597.	6282.	* 143.	297.	370.	168.0	0.292	2.642

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 152.0 - 166.5
 Figure 2.5-80

Figure 2.5-80 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 152.0 - 166.5


BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY
 L-61+00 0.0 729.70 181.60 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
167.0	11414.	6168.	137.	287.	355.	21.	167.4	0.294	2.632
167.5	11123.	6010.	130.	273.	337.	22.	167.4	0.294	2.632
168.0	10633.	5745.	119.	249.	308.	24.	167.4	0.294	2.632
168.5	10281.	5541.	110.	233.	286.	25.	166.7	0.295	2.622
169.0	9951.	5363.	103.	218.	268.	27.	166.7	0.295	2.622
169.5	10184.	5476.	107.	228.	279.	26.	166.1	0.297	2.612
170.0	10429.	5407.	113.	240.	292.	25.	166.1	0.297	2.612
170.5	10479.	5634.	114.	242.	295.	25.	166.1	0.297	2.612
171.0	10429.	5593.	112.	239.	290.	25.	165.5	0.298	2.602
171.5	10680.	5727.	117.	251.	304.	24.	165.5	0.298	2.602
172.0	10474.	5617.	113.	241.	292.	25.	165.5	0.298	2.602
172.5	10732.	5755.	118.	254.	307.	24.	165.5	0.298	2.602
173.0	11116.	5977.	128.	272.	332.	22.	166.1	0.297	2.612
173.5	11468.	6181.	137.	290.	356.	21.	166.7	0.295	2.622
174.0	11842.	6383.	147.	309.	380.	20.	166.7	0.295	2.622
174.5	12098.	6537.	154.	323.	399.	19.	167.4	0.294	2.632
175.0	12303.	6664.	161.	334.	416.	18.	168.0	0.292	2.642
175.5	12098.	6569.	157.	323.	405.	19.	168.6	0.291	2.652
176.0	11515.	6252.	142.	293.	367.	21.	168.6	0.291	2.652
176.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
177.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
177.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
178.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
178.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
179.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
179.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
180.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
180.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
181.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
181.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0


WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 3-D ELASTIC PROPERTIES TABULATION
 STA. L-61+00
 DEPTH 167.0 - 176.0
 Figure 2.5-81

Figure 2.5-81 3-D Elastic Properties Tabulation Sta. L-61+00 Depth 167.0 - 176.0

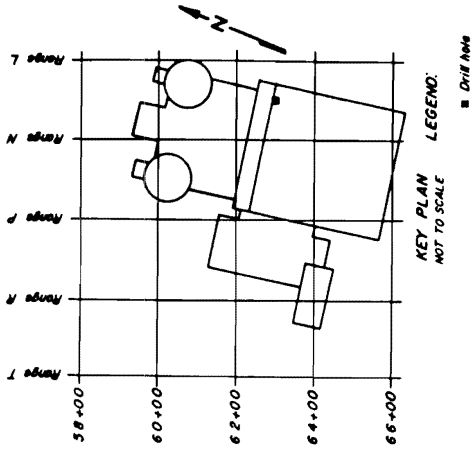


LEGEND:

GRAPHIC LOG



GENERAL ROCK DESCRIPTION
 THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.


ROCK TYPE
 Given graphically in % and showing ranges of test values for deformation modulus (psi x 10⁴)



THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.


NOTES:

1. THE HOLE WAS DRILLED WITH AN NX WIRE LINE CORE DRILL.
2. THE DRILL HOLE WAS INSPECTED WITH A BOREHOLE TELEVISION CAMERA BETWEEN ELEVATIONS 691.4 AND 646.7. THE INSPECTION SHOWED THE CORE LOSS AREAS TO BE SOFT SHALE.
3. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.
4. THE BOREHOLE SURVEY FOR THE DYNAMIC ELASTIC MODULI WAS MADE BY THE BIRDWELL DIVISION OF SEISMOGRAPH SERVICE CORPORATION.

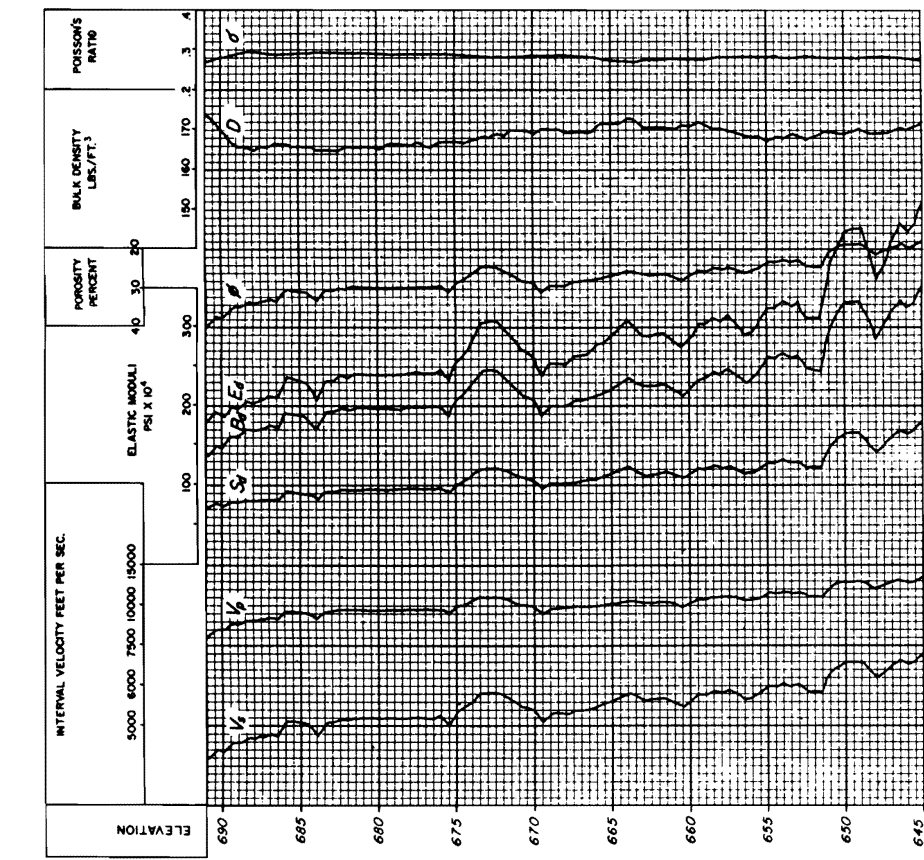

LEGEND:

- Vs = SHEAR VELOCITY.
- Vp = COMPRESSIONAL VELOCITY.
- Sh = DYNAMIC SHEAR MODULUS.
- Bd = DYNAMIC BULK MODULUS.
- Eh = DYNAMIC YOUNG'S MODULUS.
- phi = POROSITY.
- D = DENSITY.
- sigma = POISSON'S RATIO.

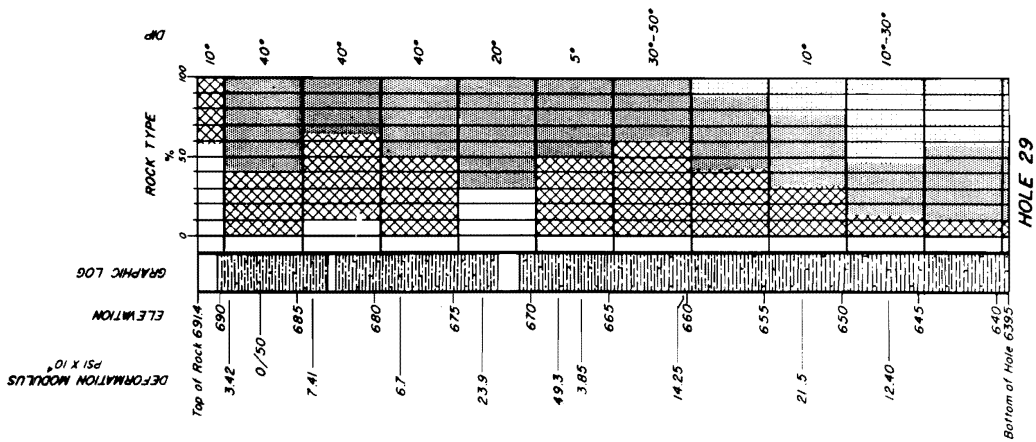

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

GRAPHIC LOG AND
 ELASTIC MODULI
 STA. M-63+00

Figure 2.5-82

Figure 2.5-82 Graphic Log and Elastic Moduli Sta. M-63+00

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY
 M-63+00 0.0 734.70 95.20 I I I
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LOG/SQ. INCH									
44.0	7813.	4333.	71.	135.	180.	40.	174.2	0.278	2.743
44.5	8160.	4484.	74.	147.	191.	37.	171.7	0.294	2.702
45.0	8099.	4419.	72.	145.	184.	38.	169.9	0.288	2.672
45.5	8492.	4589.	76.	159.	197.	35.	167.4	0.294	2.632
46.0	8527.	4585.	75.	160.	195.	35.	166.1	0.297	2.612
46.5	8703.	4679.	78.	167.	203.	34.	166.1	0.297	2.612
47.0	8696.	4664.	78.	166.	202.	34.	165.5	0.298	2.602
47.5	8770.	4715.	80.	169.	207.	33.	166.1	0.297	2.612
48.0	8845.	4755.	81.	172.	210.	33.	166.1	0.297	2.612
48.5	8766.	4725.	80.	169.	208.	33.	166.7	0.295	2.622
49.0	9319.	5023.	91.	191.	235.	30.	166.7	0.295	2.622
49.5	9314.	5008.	90.	191.	233.	30.	166.1	0.297	2.612
50.0	9273.	4985.	89.	189.	231.	30.	166.1	0.297	2.612
50.5	9190.	4919.	87.	184.	225.	31.	166.1	0.297	2.612
51.0	8763.	4699.	79.	169.	205.	33.	165.5	0.298	2.602
51.5	9277.	4975.	88.	189.	229.	30.	165.5	0.298	2.602
52.0	9314.	4995.	89.	191.	231.	30.	165.5	0.298	2.602
52.5	9442.	5063.	92.	196.	238.	29.	165.5	0.298	2.602
53.0	9356.	5030.	91.	193.	235.	30.	166.1	0.297	2.612
53.5	9442.	5076.	92.	196.	239.	29.	166.1	0.297	2.612
54.0	9450.	5081.	93.	197.	240.	29.	166.1	0.297	2.612
54.5	9408.	5058.	92.	195.	238.	30.	166.1	0.297	2.612
55.0	9403.	5055.	92.	195.	238.	30.	166.1	0.297	2.612
55.5	9399.	5066.	92.	195.	239.	30.	166.7	0.295	2.622
56.0	9395.	5064.	92.	194.	239.	30.	166.7	0.295	2.622
56.5	9399.	5066.	92.	195.	239.	30.	166.7	0.295	2.622
57.0	9446.	5091.	93.	197.	242.	29.	166.7	0.295	2.622
57.5	9446.	5104.	94.	197.	243.	29.	167.4	0.294	2.632
58.0	9437.	5087.	93.	196.	241.	29.	166.7	0.295	2.622
58.5	9446.	5091.	93.	197.	242.	29.	166.7	0.295	2.622

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 3-D ELASTIC PROPERTIES TABULATION
 STA. M-63+00
 DEPTH 44.0 - 58.5
 Figure 2.5-83

Figure 2.5-83 3-D Elastic Properties Tabulation Sta. M-63+00 Depth 44.0 - 58.5

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY
 M-63+00 0.0 0.0 734.70 95.20 1 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
59.0	9494.	5130.	95.	199.	246.	29.	167.4	0.294	2.632
59.5	9150.	4944.	88.	185.	228.	31.	167.4	0.294	2.632
60.0	9702.	5242.	99.	208.	257.	28.	167.4	0.294	2.632
60.5	9887.	5342.	103.	216.	267.	27.	167.4	0.294	2.632
61.0	10143.	5494.	109.	227.	283.	26.	168.0	0.292	2.642
61.5	10508.	5706.	118.	244.	306.	24.	168.6	0.291	2.652
62.0	10550.	5728.	119.	246.	308.	24.	168.6	0.291	2.652
62.5	10539.	5736.	120.	245.	310.	24.	169.2	0.290	2.662
63.0	10381.	5650.	117.	238.	301.	25.	169.2	0.290	2.662
63.5	10089.	5518.	112.	225.	288.	26.	170.5	0.287	2.682
64.0	9850.	5387.	107.	214.	275.	27.	170.5	0.287	2.682
64.5	9752.	5334.	105.	210.	269.	28.	170.5	0.287	2.682
65.0	9666.	5274.	102.	206.	263.	28.	169.9	0.288	2.672
65.5	9162.	5011.	92.	186.	238.	31.	170.5	0.287	2.682
66.0	9494.	5192.	99.	199.	255.	29.	170.5	0.287	2.682
66.5	9480.	5185.	99.	199.	254.	29.	170.5	0.287	2.682
67.0	9480.	5173.	98.	199.	253.	29.	169.9	0.288	2.672
67.5	9635.	5257.	101.	203.	261.	28.	169.9	0.288	2.672
68.0	9649.	5265.	102.	206.	262.	28.	169.9	0.288	2.672
68.5	9703.	5294.	103.	208.	265.	28.	169.9	0.288	2.672
69.0	9822.	5397.	108.	214.	277.	27.	171.7	0.284	2.702
69.5	9892.	5435.	109.	217.	281.	27.	171.7	0.284	2.702
70.0	10007.	5511.	113.	222.	290.	27.	172.4	0.282	2.713
70.5	10159.	5608.	117.	229.	301.	26.	173.0	0.281	2.723
71.0	10326.	5713.	122.	236.	313.	25.	173.6	0.279	2.733
71.5	10159.	5608.	117.	229.	301.	26.	173.0	0.281	2.723
72.0	10079.	5525.	113.	225.	290.	26.	171.1	0.285	2.692
72.5	10084.	5528.	113.	225.	290.	26.	171.1	0.285	2.692
73.0	10138.	5558.	114.	227.	293.	26.	171.1	0.285	2.692
73.5	10128.	5552.	114.	227.	292.	26.	171.1	0.285	2.692

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

 3-D ELASTIC PROPERTIES TABULATION
 STA. M-63+00
 DEPTH 59.0 - 73.5
 Figure 2.5-84

Figure 2.5-84 3-D Elastic Properties Tabulation Sta. M-63+00 Depth 59.0 - 73.5

BIRDWELL 3-0 ELASTIC PROPERTIES TABULATION

M-63+00 TENNESSEE VALLEY AUTHORITY 734.70 95.20 1 1 1
 0.0 0.0
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
74.0	9977.	5469.	110.	220.	284.	27.	171.1	0.285	2.692
74.5	9789.	5379.	107.	212.	275.	28.	171.7	0.284	2.702
75.0	9982.	5485.	111.	221.	286.	27.	171.7	0.284	2.702
75.5	10278.	5661.	119.	234.	306.	25.	172.4	0.282	2.713
76.0	10329.	5676.	119.	236.	306.	25.	171.7	0.284	2.702
76.5	10491.	5751.	122.	243.	314.	24.	171.1	0.285	2.692
77.0	10433.	5719.	121.	241.	310.	25.	171.1	0.285	2.692
77.5	10575.	5784.	123.	247.	317.	24.	170.5	0.287	2.682
78.0	10416.	5683.	118.	240.	305.	25.	169.9	0.288	2.672
78.5	10212.	5558.	113.	230.	291.	26.	169.2	0.290	2.662
79.0	10273.	5592.	114.	233.	294.	25.	169.2	0.290	2.662
79.5	10474.	5701.	119.	242.	306.	25.	169.2	0.290	2.662
80.0	10896.	5902.	126.	262.	326.	23.	168.0	0.292	2.642
80.5	10890.	5913.	127.	262.	328.	23.	168.6	0.291	2.652
81.0	11005.	5975.	130.	267.	335.	23.	168.6	0.291	2.652
81.5	10896.	5931.	128.	262.	321.	23.	169.2	0.290	2.662
82.0	10959.	5965.	130.	265.	335.	23.	169.2	0.290	2.662
82.5	10624.	5768.	121.	249.	312.	24.	168.6	0.291	2.652
83.0	10570.	5753.	121.	247.	312.	24.	169.2	0.290	2.662
83.5	10516.	5738.	121.	244.	311.	24.	169.9	0.288	2.672
84.0	11625.	6343.	147.	299.	380.	20.	169.9	0.288	2.672
84.5	12027.	6562.	158.	320.	406.	19.	169.9	0.288	2.672
85.0	12311.	6717.	165.	335.	426.	18.	169.9	0.288	2.672
85.5	12319.	6737.	167.	336.	430.	18.	170.5	0.287	2.682
86.0	12319.	6737.	167.	336.	430.	18.	170.5	0.287	2.682
86.5	11958.	6525.	156.	316.	402.	19.	169.9	0.288	2.672
87.0	11365.	6201.	141.	285.	363.	21.	169.9	0.288	2.672
87.5	11625.	6343.	147.	299.	380.	20.	169.9	0.288	2.672
88.0	12097.	6616.	161.	324.	414.	19.	170.5	0.287	2.682
88.5	12376.	6785.	170.	339.	437.	18.	171.1	0.285	2.692

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. M-63+00
 DEPTH 74.0 - 88.5

Figure 2.5-85

Figure 2.5-85 3-D Elastic Properties Tabulation Sta. M-63+00 Depth 74.0 - 88.5


B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

M-63+00
 TENNESSEE VALLEY AUTHORITY
 0.0 0.0 734.70 95.20 1 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
	MODULI IN 10 TO 4TH LBS/SQ. INCH								
89.0	12160.	6666. *	164.	327.	422.	19.	171.1	0.285	2.692
89.5	12303.	6760. *	169.	335.	435.	18.	171.7	0.284	2.702
90.0	12763.	7029. *	184.	361.	471.	17.	172.4	0.282	2.713
90.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
91.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
91.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
92.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
92.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
93.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
93.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0


WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
3-D ELASTIC PROPERTIES TABULATION STA. M-63+00 DEPTH 89.0 - 90.0 Figure 2.5-86

Figure 2.5-86 3-D Elastic Properties Tabulation Sta. M-63+00 Depth 89.0 - 90.0

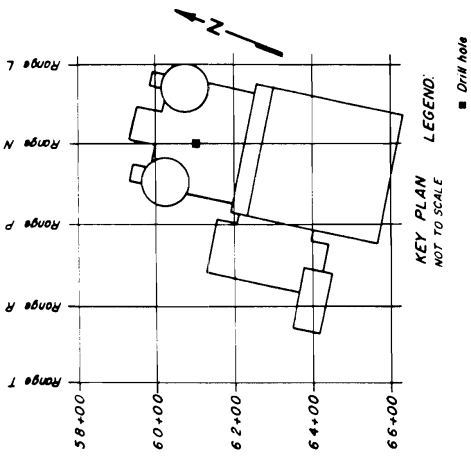

LEGEND

GRAPHIC LOG




GENERAL ROCK DESCRIPTION

THE FOUNDATION ROCK IS COMPOSED OF THE FOLLOWING STRATA: COARSELY BEDDED COARSED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.

ROCK TYPE


Given graphically in % and showing ranges of test values for deformation modulus (psi x 10³)



THREE TESTS WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.


NOTES:

1. THE HOLE WAS DRILLED WITH AN SIX WIRE LINE CORE DRILL.
2. THE DRILL HOLE WAS INSPECTED WITH A BOREHOLE TELEVISION CAMERA BETWEEN ELEVATIONS 698.0 AND 647.5. THE INSPECTION SHOWED THE CORE LOSS AREAS TO BE SOFT SHALE.
3. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.
4. THE BOREHOLE SURVEY FOR THE DYNAMIC ELASTIC MODULI WAS MADE BY THE BIRDWELL DIVISION OF SEISMOGRAPH SERVICE CORPORATION.

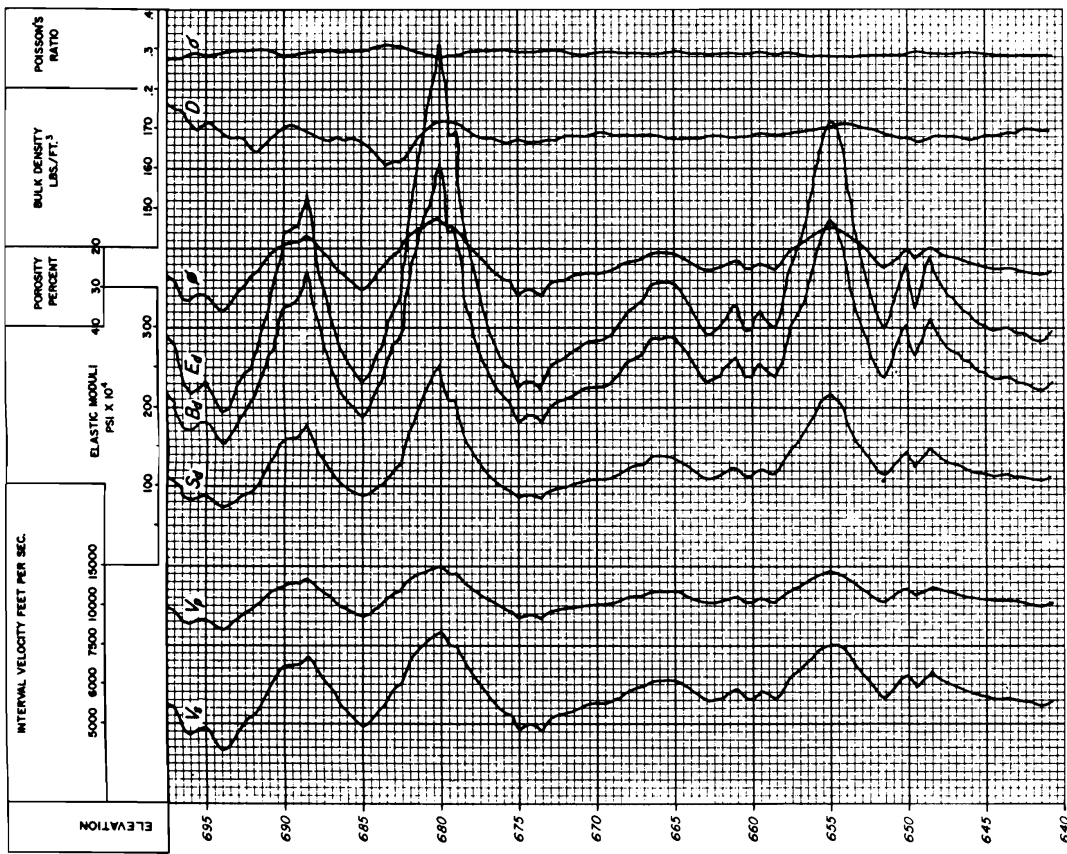

LEGEND:

- V_s = SHEAR VELOCITY.
- V_p = COMPRESSIONAL VELOCITY.
- S_H = DYNAMIC SHEAR MODULUS.
- B_H = DYNAMIC BULK MODULUS.
- E_H = DYNAMIC YOUNG'S MODULUS.
- ϕ = POROSITY.
- D = DENSITY.
- σ = POISSON'S RATIO.

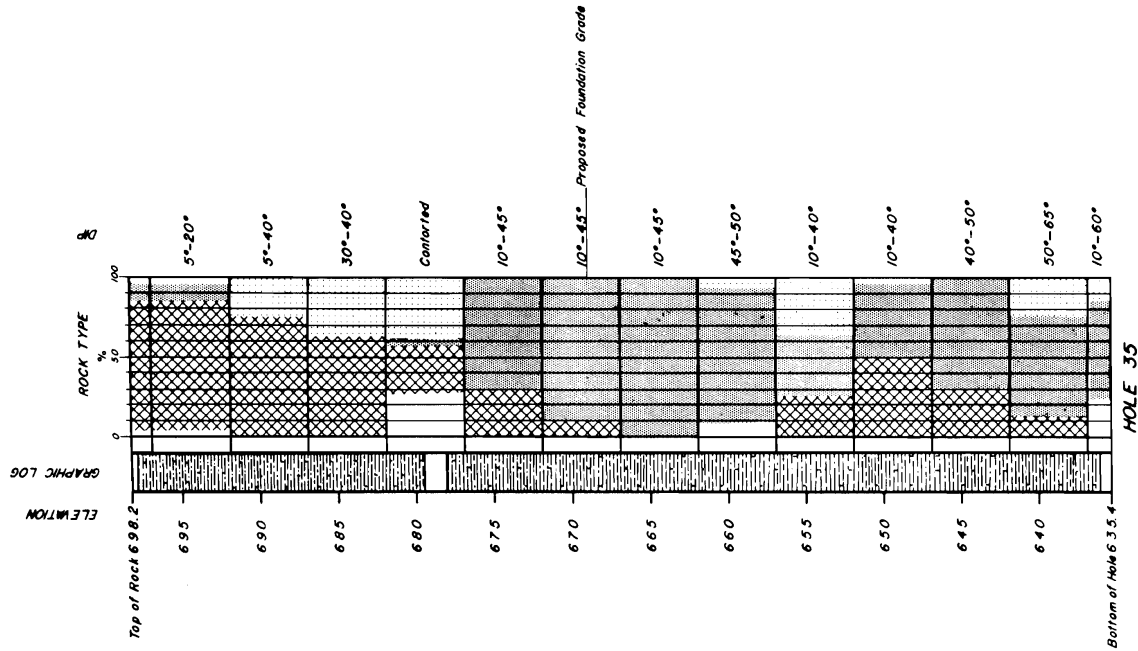

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

GRAPHIC LOG AND
ELASTIC MODULI
STA. N-61+00

Figure 2.5-87

Figure 2.5-87 Graphic Log and Elastic Moduli Sta. N-61+00

B I R D W E L L 3-0 E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 N-61+70 0.0 0.0 732.50 97.10 2 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK YOUNG'S MODULI IN 10 TO 4TH LBS/SQ. INCH	POROS.	DENSITY	POISSON	RHO	
35.0	9789.	5465.	113.	213.	289.	27.	176.1	0.274	2.773
35.5	9595.	5333.	107.	204.	274.	28.	174.9	0.277	2.753
36.0	8766.	4861.	89.	170.	227.	33.	174.2	0.278	2.743
36.5	8675.	4755.	83.	166.	215.	34.	171.1	0.285	2.692
37.0	8929.	4860.	86.	176.	222.	32.	169.2	0.290	2.662
37.5	8975.	4932.	90.	178.	231.	32.	171.7	0.284	2.702
38.0	8584.	4695.	81.	163.	209.	34.	170.5	0.287	2.682
38.5	8226.	4477.	73.	149.	189.	37.	169.2	0.290	2.662
39.0	8462.	4572.	75.	158.	195.	35.	167.4	0.294	2.632
39.5	8968.	4845.	85.	177.	219.	32.	167.4	0.294	2.632
40.0	9383.	5070.	93.	194.	240.	30.	167.4	0.294	2.632
40.5	9697.	5174.	95.	207.	247.	28.	164.2	0.301	2.582
41.0	10246.	5481.	107.	231.	278.	26.	164.9	0.300	2.592
41.5	10851.	5849.	123.	259.	319.	23.	166.7	0.295	2.622
42.0	11712.	6375.	148.	303.	383.	20.	169.2	0.290	2.662
42.5	12183.	6663.	163.	328.	420.	19.	170.5	0.287	2.682
43.0	12183.	6679.	165.	328.	423.	19.	171.1	0.285	2.692
43.5	12247.	6698.	165.	332.	425.	19.	170.5	0.287	2.682
44.0	12956.	7052.	182.	371.	468.	17.	169.2	0.290	2.662
44.5	12018.	6526.	155.	319.	400.	19.	168.6	0.291	2.652
45.0	11328.	6121.	135.	283.	350.	21.	167.4	0.294	2.632
45.5	10846.	5846.	123.	259.	318.	23.	166.7	0.295	2.622
46.0	10032.	5434.	107.	222.	277.	27.	168.0	0.292	2.642
46.5	9708.	5233.	98.	208.	255.	28.	166.7	0.295	2.622
47.0	9383.	5070.	93.	194.	240.	30.	167.4	0.294	2.632
47.5	9142.	4927.	87.	184.	226.	31.	166.7	0.295	2.622
48.0	9490.	5076.	92.	198.	238.	29.	164.9	0.300	2.592
48.5	10017.	5317.	99.	220.	259.	27.	163.0	0.304	2.562
49.0	10530.	5529.	106.	243.	277.	25.	160.5	0.310	2.521
49.5	11232.	5930.	123.	277.	321.	22.	161.7	0.307	2.541

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. N-61+00
 DEPTH 35.0 - 49.5

Figure 2.5-88

Figure 2.5-88 3-D Elastic Properties Tabulation Sta. N-61+00 Depth 35.0 - 49.5

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY
 N-61+00 0.0 0.0 732.50 97.10 2 1 1
 WATTS BAR NUCLEAR PLANT, RMEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RMO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
50.0	11517.	6080.	129.	291.	337.	21.	161.7	0.307	2.541
50.5	12912.	6889.	168.	366.	437.	17.	164.2	0.301	2.582
51.0	13505.	7297.	192.	402.	497.	16.	167.4	0.294	2.632
51.5	14134.	7712.	218.	441.	561.	14.	169.9	0.288	2.672
52.0	14526.	7982.	236.	467.	606.	14.	171.7	0.284	2.702
52.5	15145.	8341.	259.	508.	663.	13.	172.4	0.282	2.713
53.0	13772.	7567.	212.	420.	545.	15.	171.7	0.284	2.702
53.5	13874.	7605.	214.	426.	549.	15.	171.1	0.285	2.692
54.0	12450.	6793.	169.	343.	436.	18.	169.9	0.288	2.672
54.5	11815.	6416.	150.	308.	387.	20.	168.6	0.291	2.652
55.0	11135.	6031.	132.	274.	341.	22.	168.0	0.292	2.642
55.5	10516.	5682.	117.	244.	302.	24.	167.4	0.294	2.632
56.0	10097.	5456.	107.	225.	278.	26.	167.4	0.294	2.632
56.5	9710.	5234.	99.	208.	255.	28.	166.7	0.295	2.622
57.0	9580.	5164.	96.	202.	248.	29.	166.7	0.295	2.622
57.5	9007.	4887.	86.	179.	221.	32.	167.4	0.294	2.632
58.0	9248.	4984.	89.	188.	231.	30.	166.7	0.295	2.622
58.5	9239.	4980.	89.	188.	231.	31.	166.7	0.295	2.622
59.0	8999.	4850.	85.	178.	219.	32.	166.7	0.295	2.622
59.5	9493.	5129.	95.	199.	246.	29.	167.4	0.294	2.632
60.0	9670.	5225.	99.	206.	255.	28.	167.4	0.294	2.632
60.5	9715.	5262.	100.	208.	259.	28.	168.0	0.292	2.642
61.0	9806.	5325.	103.	212.	266.	28.	168.6	0.291	2.652
61.5	9995.	5427.	107.	221.	277.	27.	168.6	0.291	2.652
62.0	10087.	5477.	109.	225.	282.	26.	168.6	0.291	2.652
62.5	10087.	5490.	110.	225.	284.	26.	169.2	0.290	2.662
63.0	10087.	5490.	110.	225.	284.	26.	169.2	0.290	2.662
63.5	10236.	5558.	112.	231.	290.	26.	168.6	0.291	2.652
64.0	10441.	5669.	117.	241.	302.	25.	168.6	0.291	2.652
64.5	10759.	5842.	124.	256.	321.	23.	168.6	0.291	2.652

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 3-D ELASTIC PROPERTIES TABULATION
 STA. N-61+00
 DEPTH 50.0 - 64.5
 Figure 2.5-89

Figure 2.5-89 3-D Elastic Properties Tabulation Sta. N-61+00 Depth 50.0 - 64.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 N-61+00 0.0 732.50 97.10 2 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
65.0	10877.	5906.	* 127.	261.	328.	23.	168.6	0.291	2.652
65.5	10992.	5969.	* 130.	267.	335.	23.	168.6	0.291	2.652
66.0	11351.	6164.	* 138.	284.	357.	21.	168.6	0.291	2.652
66.5	11351.	6164.	* 138.	284.	357.	21.	168.6	0.291	2.652
67.0	11414.	6182.	* 138.	287.	358.	21.	168.0	0.292	2.642
67.5	11414.	6182.	* 138.	287.	358.	21.	168.0	0.292	2.642
68.0	11175.	6053.	* 133.	276.	343.	22.	168.0	0.292	2.642
68.5	10884.	5895.	* 126.	261.	326.	23.	168.0	0.292	2.642
69.0	10553.	5716.	* 118.	246.	306.	24.	168.0	0.292	2.642
69.5	10241.	5561.	* 112.	232.	290.	26.	168.6	0.291	2.652
70.0	10292.	5588.	* 114.	234.	293.	25.	168.6	0.291	2.652
70.5	10395.	5644.	* 116.	238.	299.	25.	168.6	0.291	2.652
71.0	10716.	5818.	* 123.	253.	318.	24.	168.6	0.291	2.652
71.5	10941.	5941.	* 128.	264.	331.	23.	168.6	0.291	2.652
72.0	10343.	5616.	* 115.	236.	296.	25.	168.6	0.291	2.652
72.5	10343.	5616.	* 115.	236.	296.	25.	168.6	0.291	2.652
73.0	10765.	5859.	* 125.	256.	323.	23.	169.2	0.290	2.662
73.5	10494.	5712.	* 119.	243.	307.	24.	169.2	0.290	2.662
74.0	10337.	5627.	* 116.	236.	298.	25.	169.2	0.290	2.662
74.5	10765.	5859.	* 125.	256.	323.	23.	169.2	0.290	2.662
75.0	11669.	6351.	* 147.	301.	380.	20.	169.2	0.290	2.662
75.5	12005.	6534.	* 156.	318.	402.	19.	169.2	0.290	2.662
76.0	12425.	6779.	* 168.	341.	434.	18.	169.9	0.288	2.672
76.5	13119.	7158.	* 188.	380.	484.	16.	169.9	0.288	2.672
77.0	13722.	7504.	* 207.	416.	533.	15.	170.5	0.287	2.682
77.5	14102.	7712.	* 219.	440.	563.	14.	170.5	0.287	2.682
78.0	13966.	7656.	* 216.	431.	556.	15.	171.1	0.285	2.692
78.5	13428.	7378.	* 202.	399.	518.	16.	171.7	0.284	2.702
79.0	12376.	6785.	* 170.	339.	437.	18.	171.1	0.285	2.692
79.5	11867.	6490.	* 155.	311.	399.	20.	170.5	0.287	2.682

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. N-61+00
 DEPTH 65.0 - 79.5

Figure 2.5-90

Figure 2.5-90 3-D Elastic Properties Tabulation Sta. N-61+00 Depth 65.0 - 79.5

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY

N-61+00 0.0 0.0 732.50 97.10 2 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE


DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
	MODULI IN 10 TO 4TH LBS/SQ. INCH								
80.0	11301.	6181.	140.	282.	362.	21.	170.5	0.287	2.682
80.5	10658.	5815.	124.	251.	319.	24.	169.9	0.288	2.672
81.0	10340.	5628.	116.	236.	298.	25.	169.2	0.290	2.662
81.5	10745.	5834.	124.	255.	320.	24.	168.6	0.291	2.652
82.0	11418.	6185.	139.	288.	358.	21.	168.0	0.292	2.642
82.5	11814.	6399.	148.	308.	384.	20.	168.0	0.292	2.642
83.0	10920.	5900.	126.	263.	325.	23.	167.4	0.294	2.632
83.5	11461.	6193.	138.	290.	358.	21.	167.4	0.294	2.632
84.0	11966.	6481.	152.	316.	393.	19.	168.0	0.292	2.642
84.5	11483.	6235.	141.	291.	365.	21.	168.6	0.291	2.652
85.0	11182.	6072.	134.	276.	346.	22.	168.6	0.291	2.652
85.5	11063.	6007.	131.	270.	339.	22.	168.6	0.291	2.652
86.0	10890.	5898.	126.	262.	326.	23.	168.0	0.292	2.642
86.5	10777.	5837.	123.	256.	319.	23.	168.0	0.292	2.642
87.0	10564.	5722.	119.	246.	307.	24.	168.0	0.292	2.642
87.5	10505.	5704.	118.	244.	306.	24.	168.6	0.291	2.652
88.0	10348.	5619.	115.	236.	296.	25.	168.6	0.291	2.652
88.5	10343.	5630.	116.	236.	298.	25.	169.2	0.290	2.662
89.0	10395.	5658.	117.	239.	301.	25.	169.2	0.290	2.662
89.5	10262.	5586.	114.	233.	294.	25.	169.2	0.290	2.662
90.0	10217.	5588.	115.	231.	295.	26.	170.5	0.287	2.682
90.5	10092.	5519.	112.	225.	288.	26.	170.5	0.287	2.682
91.0	10038.	5477.	110.	223.	283.	26.	169.9	0.288	2.672
91.5	10082.	5501.	111.	225.	286.	26.	169.9	0.288	2.672
92.0	10302.	5634.	117.	235.	300.	25.	170.5	0.287	2.682
92.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
93.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
93.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
94.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
94.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. N-61+00
 DEPTH 80.0 - 92.0


Figure 2.5-91

Figure 2.5-91 3-D Elastic Properties Tabulation Sta. N-61+00 Depth 80.0 - 92.0

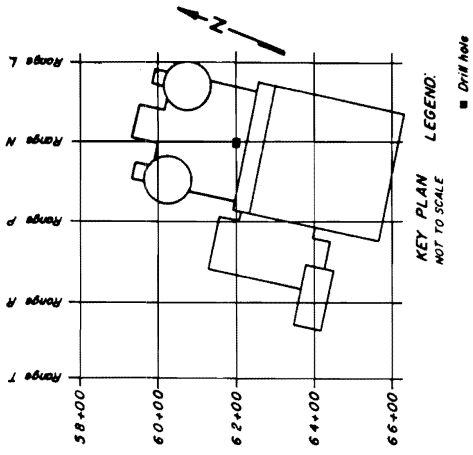


KEY PLAN
NOT TO SCALE
Legend: ■ Drill Hole

LEGEND:



GENERAL ROCK DESCRIPTION
THE FOUNDATION ROCK IS COMPOSED OF THE COHASSETTA FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.


ROCK TYPE
Given graphically in % and showing ranges of test values for deformation modulus (psi x 10³)



THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE USING A 4001 LENGTH OF CORE IN THE BUA.


NOTES:

1. THE HOLE WAS DRILLED WITH AN INK WIRE LINE CORE DRILL.
2. THE DRILL HOLE WAS INSPECTED WITH A BOREHOLE TELEVISION CAMERA BETWEEN ELEVATIONS 688.9 AND 662.9. THE INSPECTION SHOWED THE CORE LOSS AREAS TO BE SOFT SHALE.
3. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.
4. THE BOREHOLE SURVEY FOR THE DYNAMIC ELASTIC MODULI WAS MADE BY THE BIRDMELL DIVISION OF SEISMOGRAPH SERVICE CORPORATION.

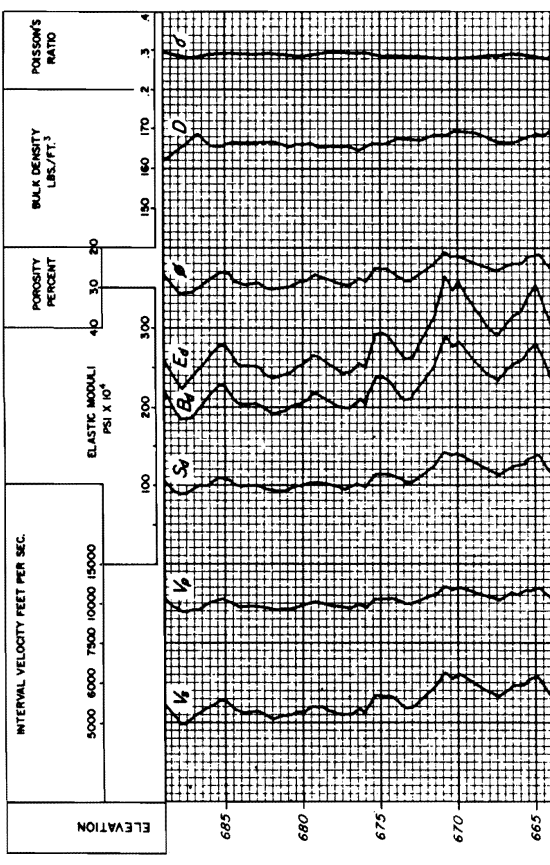

LEGEND:

- V_s = SHEAR VELOCITY.
- V_p = COMPRESSIONAL VELOCITY.
- S_d = DYNAMIC SHEAR MODULUS.
- B_d = DYNAMIC BULK MODULUS.
- E_d = DYNAMIC YOUNG'S MODULUS.
- β = POROSITY.
- D = DENSITY.
- U = POISSON'S RATIO.

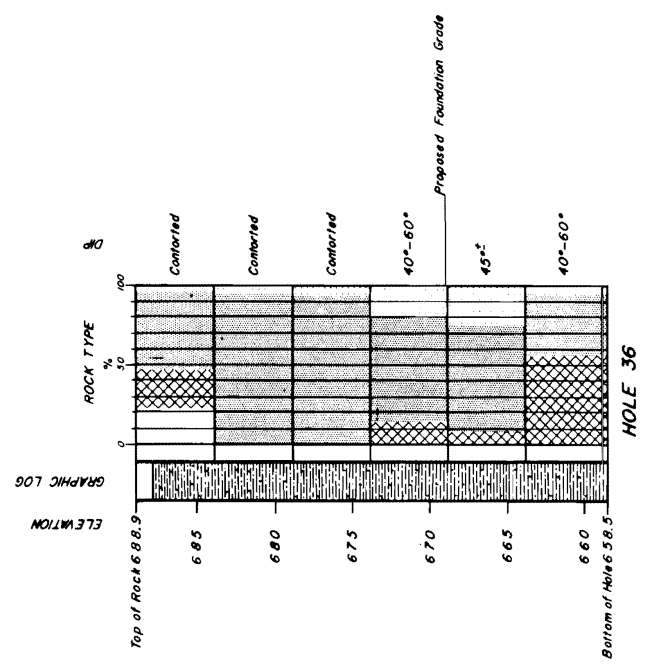

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

GRAPHIC LOG AND
ELASTIC MODULI
STA. N-62+00
Figure 2.5-92

Figure 2.5-92 Graphic Log and Elastic Moduli Sta. N-62+00

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY
 N-62+00 0.0 0.0 733.90 75.40 1 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH								
45.0	10118.	5370.	101.	225.	264.	163.0	0.304	2.562
45.5	9536.	5088.	92.	200.	239.	164.2	0.301	2.582
46.0	9146.	4905.	86.	184.	223.	165.5	0.298	2.602
46.5	9115.	4925.	88.	183.	227.	167.4	0.294	2.632
47.0	9303.	5076.	94.	191.	243.	169.9	0.288	2.672
47.5	9517.	5168.	97.	200.	251.	168.6	0.291	2.652
48.0	9885.	5315.	101.	215.	262.	166.1	0.297	2.612
48.5	10190.	5478.	108.	229.	279.	166.1	0.297	2.612
49.0	10135.	5463.	107.	226.	278.	166.7	0.295	2.622
49.5	9715.	5249.	99.	208.	257.	167.4	0.294	2.632
50.0	9539.	5154.	96.	201.	248.	167.4	0.294	2.632
50.5	9587.	5180.	97.	203.	251.	167.4	0.294	2.632
51.0	9591.	5183.	97.	203.	251.	167.4	0.294	2.632
51.5	9415.	5087.	93.	195.	242.	167.4	0.294	2.632
52.0	9319.	5035.	92.	191.	237.	167.4	0.294	2.632
52.5	9389.	5061.	92.	194.	239.	166.7	0.295	2.622
53.0	9483.	5098.	93.	198.	242.	166.1	0.297	2.612
53.5	9596.	5172.	96.	203.	249.	166.7	0.295	2.622
54.0	9689.	5222.	98.	207.	254.	166.7	0.295	2.622
54.5	9939.	5357.	103.	218.	267.	166.7	0.295	2.622
55.0	9925.	5336.	102.	217.	265.	166.1	0.297	2.612
55.5	9741.	5237.	98.	209.	255.	166.1	0.297	2.612
56.0	9622.	5173.	96.	204.	249.	166.1	0.297	2.612
56.5	9500.	5108.	93.	199.	242.	166.1	0.297	2.612
57.0	9530.	5124.	94.	200.	244.	166.1	0.297	2.612
57.5	9801.	5256.	99.	211.	256.	165.5	0.298	2.602
58.0	9626.	5175.	96.	204.	249.	166.1	0.297	2.612
58.5	10374.	5591.	112.	237.	291.	166.7	0.295	2.622
59.0	10425.	5619.	114.	240.	294.	166.7	0.295	2.622
59.5	10289.	5559.	112.	233.	289.	167.4	0.294	2.632

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. N-62+00
 DEPTH 45.0 - 59.5

Figure 2.5-93

Figure 2.5-93 3-D Elastic Properties Tabulation Sta. N-62+00 Depth 45.0 - 59.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N


TENNESSEE VALLEY AUTHORITY
 N-62+00 0.0 0.0 733.90 75.40 1 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNG'S	POROS.	DENSITY	POISSON	RHO
	MODULI IN 10 TO 4TH LBS/SQ. INCH								
60.0	10011.	5423.	107.	221.	275.	27.	168.0	0.292	2.642
60.5	9724.	5267.	101.	209.	260.	28.	168.0	0.292	2.642
61.0	9760.	5287.	101.	210.	262.	28.	168.0	0.292	2.642
61.5	10130.	5487.	109.	226.	282.	26.	168.0	0.292	2.642
62.0	10442.	5670.	117.	241.	302.	25.	168.6	0.291	2.652
62.5	10713.	5831.	124.	253.	320.	24.	169.2	0.290	2.662
63.0	11449.	6231.	142.	289.	366.	21.	169.2	0.290	2.662
63.5	11153.	6085.	136.	275.	350.	22.	169.9	0.288	2.672
64.0	11332.	6183.	140.	284.	361.	21.	169.9	0.288	2.672
64.5	11018.	6011.	132.	268.	341.	22.	169.9	0.288	2.672
65.0	10848.	5905.	127.	260.	328.	23.	169.2	0.290	2.662
65.5	10576.	5743.	120.	247.	310.	24.	168.6	0.291	2.652
66.0	10380.	5622.	115.	238.	296.	25.	168.0	0.292	2.642
66.5	10278.	5554.	111.	233.	288.	25.	167.4	0.294	2.632
67.0	10477.	5661.	116.	242.	299.	25.	167.4	0.294	2.632
67.5	10750.	5808.	122.	255.	315.	24.	167.4	0.294	2.632
68.0	10811.	5856.	124.	258.	321.	23.	168.0	0.292	2.642
68.5	11147.	6052.	133.	274.	344.	22.	168.6	0.291	2.652
69.0	11319.	6161.	139.	283.	357.	21.	169.2	0.290	2.662
69.5	10805.	5881.	126.	258.	326.	23.	169.2	0.290	2.662
70.0	10184.	5557.	113.	229.	291.	26.	169.9	0.288	2.672
70.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
71.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
71.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
72.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
72.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
73.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
73.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
74.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
74.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT


3-D ELASTIC PROPERTIES TABULATION
 STA. N-62+00
 DEPTH 60.0 - 70.0
 Figure 2.5-94

Figure 2.5-94 3-D Elastic Properties Tabulation Sta. N-62+00 Depth 60.0 - 70.0

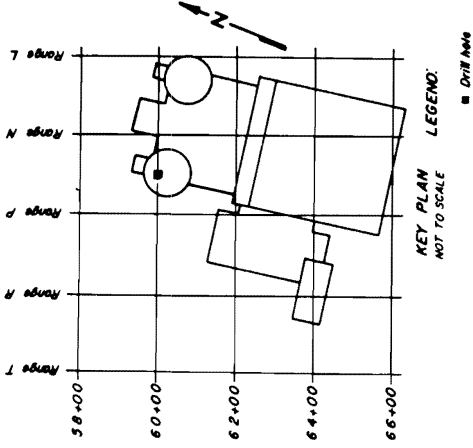


LEGEND:

GRAPHIC LOG



GENERAL ROCK DESCRIPTION
 THE FOUNDATION ROCK IS COMPOSED OF THE FORMING FORMATION. THIS FORMATION CONSISTS OF CONTORTED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONES.


ROCK TYPE
 Given graphically in % and showing ranges of test values for deformation modulus ($\text{psi} \times 10^3$)



THESE TYPES WERE IDENTIFIED FROM VISUAL INSPECTION OF THE CORE. GENERALLY, DETERMINATIONS WERE MADE FOR EACH FIVE FOOT LENGTH OF CORE IN THE BOX.


NOTES:

1. THE HOLE WAS DRILLED WITH AN IRK WIRE LINE CORE DRILL.
2. THE DRILL HOLE WAS INSPECTED WITH A BOREHOLE TELEVISION CAMERA BETWEEN ELEVATIONS 696.8 AND 650.8. THE INSPECTION SHOWED THE CORE LOSS AREAS TO BE SOFT SHALE.
3. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE REMARD PRESSUREMETER TESTS.
4. THE BOREHOLE SURVEY FOR THE DYNAMIC ELASTIC MODULI WAS MADE BY THE BIRDMELL DIVISION OF SEISMOGRAPH SERVICE CORPORATION.

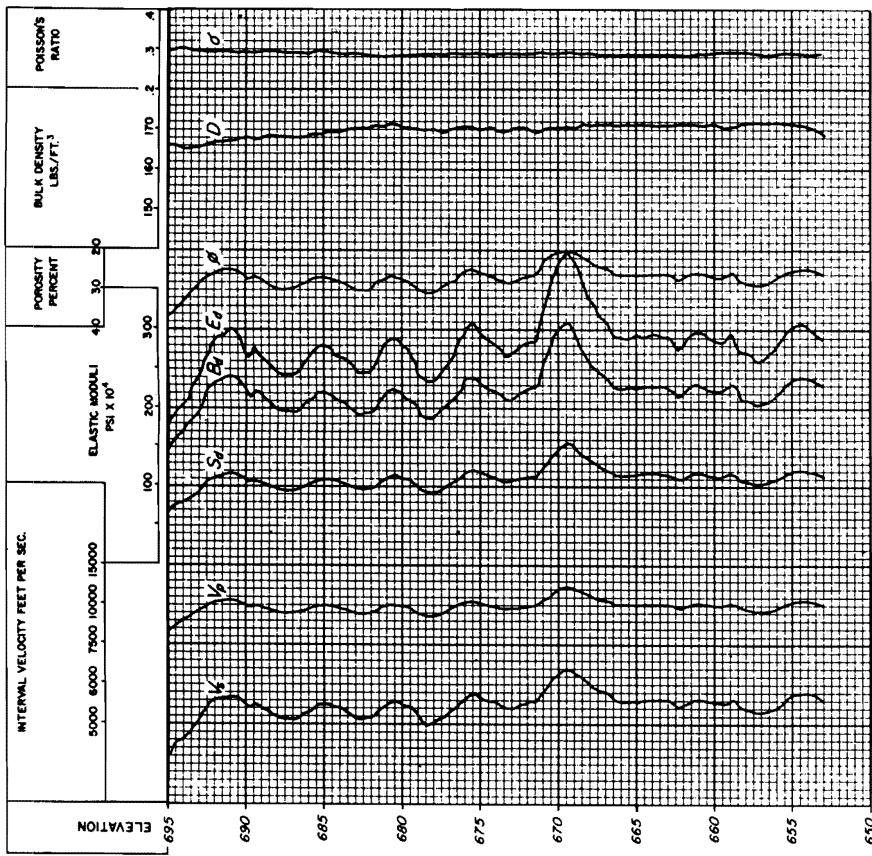

LEGEND:

- V_s = SHEAR VELOCITY.
- V_p = COMPRESSIONAL VELOCITY.
- S_d = DYNAMIC SHEAR MODULUS.
- B_d = DYNAMIC BULK MODULUS.
- E_d = DYNAMIC YOUNG'S MODULUS.
- ϕ = POROSITY.
- D = DENSITY.
- σ = POISSON'S RATIO.

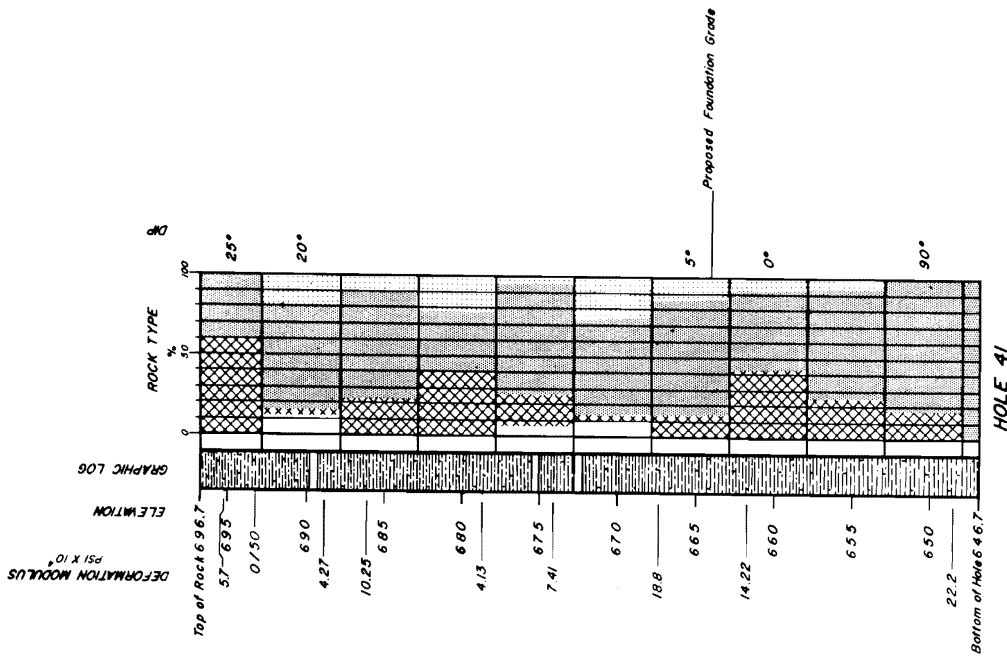

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>GRAPHIC LOG AND ELASTIC MODULI STA. 0-60+00 Figure 2.5-95</p>

Figure 2.5-95 Graphic Log and Elastic Moduli Sta. 0-60+00

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 0-60+00 0.0 732.80 86.10 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH								
38.0	8262.	4442.	* 71.	150.	183.	37.	0.297	2.612
38.5	8638.	4632.	* 77.	164.	199.	34.	0.298	2.602
39.0	8855.	4737.	* 80.	172.	207.	33.	0.300	2.592
39.5	9260.	4953.	* 87.	189.	227.	30.	0.300	2.592
40.0	9613.	5155.	* 95.	203.	246.	29.	0.298	2.602
40.5	10186.	5476.	* 107.	229.	279.	26.	0.297	2.612
41.0	10382.	5596.	* 113.	238.	292.	25.	0.295	2.622
41.5	10424.	5618.	* 114.	239.	294.	25.	0.295	2.622
42.0	10488.	5667.	* 116.	243.	300.	25.	0.294	2.632
42.5	10340.	5587.	* 113.	236.	292.	25.	0.294	2.632
43.0	9839.	5329.	* 103.	214.	266.	27.	0.292	2.642
43.5	10081.	5447.	* 107.	224.	277.	26.	0.294	2.632
44.0	9792.	5304.	* 102.	212.	263.	28.	0.292	2.642
44.5	9568.	5182.	* 97.	202.	252.	29.	0.292	2.642
45.0	9388.	5085.	* 94.	194.	242.	30.	0.292	2.642
45.5	9383.	5083.	* 94.	194.	242.	30.	0.292	2.642
46.0	9383.	5083.	* 94.	194.	242.	30.	0.292	2.642
46.5	9603.	5202.	* 98.	203.	253.	29.	0.292	2.642
47.0	9740.	5289.	* 102.	209.	263.	28.	0.291	2.652
47.5	10021.	5441.	* 108.	222.	278.	27.	0.291	2.652
48.0	10016.	5452.	* 109.	222.	280.	27.	0.290	2.662
48.5	9824.	5347.	* 104.	213.	269.	27.	0.290	2.662
49.0	9731.	5297.	* 102.	209.	264.	28.	0.290	2.662
49.5	9550.	5210.	* 99.	202.	256.	29.	0.288	2.672
50.0	9294.	5071.	* 94.	191.	243.	30.	0.288	2.672
50.5	9336.	5094.	* 95.	193.	245.	30.	0.288	2.672
51.0	9379.	5129.	* 97.	194.	249.	30.	0.287	2.682
51.5	9736.	5325.	* 104.	210.	268.	28.	0.287	2.682
52.0	10071.	5521.	* 112.	224.	289.	26.	0.285	2.692
52.5	10076.	5524.	* 113.	225.	289.	26.	0.285	2.692

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-60+00
 DEPTH 38.0 - 52.5

Figure 2.5-96

Figure 2.5-96 3-D Elastic Properties Tabulation Sta. 0-60+00 Depth 38.0 - 52.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 0-60+00 0.0 732.80 86.10 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
53.0	9881.	5404.	* 107.	216.	276.	27.	170.5	0.287	2.682
53.5	9736.	5325.	* 104.	210.	268.	28.	170.5	0.287	2.682
54.0	9252.	5048.	* 93.	189.	241.	30.	169.9	0.288	2.672
54.5	9128.	4980.	* 91.	184.	234.	31.	169.9	0.288	2.672
55.0	9132.	4982.	* 91.	184.	234.	31.	169.9	0.288	2.672
55.5	9440.	5138.	* 96.	197.	249.	29.	169.2	0.290	2.662
56.0	9663.	5272.	* 102.	206.	262.	28.	169.9	0.288	2.672
56.5	9924.	5428.	* 108.	218.	279.	27.	170.5	0.287	2.682
57.0	10376.	5675.	* 118.	238.	305.	25.	170.5	0.287	2.682
57.5	10429.	5704.	* 120.	240.	308.	25.	170.5	0.287	2.682
58.0	10191.	5561.	* 113.	230.	292.	26.	169.9	0.288	2.672
58.5	10047.	5495.	* 111.	223.	286.	26.	170.5	0.287	2.682
59.0	9983.	5434.	* 108.	220.	278.	27.	169.2	0.290	2.662
59.5	9745.	5304.	* 103.	210.	265.	28.	169.2	0.290	2.662
60.0	9787.	5340.	* 104.	212.	269.	28.	169.9	0.288	2.672
60.5	9929.	5417.	* 108.	218.	277.	27.	169.9	0.288	2.672
61.0	10076.	5497.	* 111.	224.	285.	26.	169.9	0.288	2.672
61.5	10126.	5511.	* 111.	226.	286.	26.	169.2	0.290	2.662
62.0	10707.	5842.	* 125.	253.	322.	24.	169.9	0.288	2.672
62.5	11415.	6228.	* 142.	288.	366.	21.	169.9	0.288	2.672
63.0	11734.	6417.	* 151.	304.	390.	20.	170.5	0.287	2.682
63.5	11869.	6491.	* 155.	311.	399.	20.	170.5	0.287	2.682
64.0	11601.	6345.	* 148.	298.	381.	20.	170.5	0.287	2.682
64.5	11160.	6118.	* 138.	276.	355.	22.	171.1	0.285	2.692
65.0	10808.	5925.	* 130.	258.	333.	23.	171.1	0.285	2.692
65.5	10585.	5803.	* 124.	248.	319.	24.	171.1	0.285	2.692
66.0	10424.	5714.	* 121.	240.	310.	25.	171.1	0.285	2.692
66.5	10110.	5542.	* 113.	226.	291.	26.	171.1	0.285	2.692
67.0	10061.	5515.	* 112.	224.	289.	26.	171.1	0.285	2.692
67.5	10066.	5518.	* 112.	224.	289.	26.	171.1	0.285	2.692

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-60+00
 DEPTH 53.0 - 67.5
 Figure 2.5-97

Figure 2.5-97 3-D Elastic Properties Tabulation Sta. 0-60+00 Depth 53.0 -67.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY

0-60+00 0.0 732.80 86.10 5 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE


DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
68.0	10115.	5545.	* 113.	226.	292.	26.	171.1	0.285	2.692
68.5	10115.	5545.	* 113.	226.	292.	26.	171.1	0.285	2.692
69.0	10160.	5570.	* 115.	228.	294.	26.	171.1	0.285	2.692
69.5	10110.	5542.	* 113.	226.	291.	26.	171.1	0.285	2.692
70.0	10120.	5548.	* 114.	227.	292.	26.	171.1	0.285	2.692
70.5	9829.	5388.	* 107.	214.	275.	27.	171.1	0.285	2.692
71.0	9963.	5462.	* 110.	220.	283.	27.	171.1	0.285	2.692
71.5	10160.	5570.	* 115.	228.	294.	26.	171.1	0.285	2.692
72.0	10211.	5598.	* 116.	231.	297.	26.	171.1	0.285	2.692
72.5	10071.	5521.	* 112.	224.	289.	26.	171.1	0.285	2.692
73.0	9973.	5467.	* 110.	220.	284.	27.	171.1	0.285	2.692
73.5	10055.	5499.	* 111.	224.	286.	26.	170.5	0.287	2.682
74.0	10257.	5609.	* 116.	233.	298.	25.	170.5	0.287	2.682
74.5	9815.	5380.	* 107.	213.	275.	27.	171.1	0.285	2.692
75.0	9722.	5329.	* 105.	209.	269.	28.	171.1	0.285	2.692
75.5	9585.	5255.	* 102.	203.	262.	29.	171.1	0.285	2.692
76.0	9585.	5255.	* 102.	203.	262.	29.	171.1	0.285	2.692
76.5	9722.	5329.	* 105.	209.	269.	28.	171.1	0.285	2.692
77.0	9910.	5432.	* 109.	217.	280.	27.	171.1	0.285	2.692
77.5	10206.	5595.	* 116.	230.	297.	26.	171.1	0.285	2.692
78.0	10360.	5679.	* 119.	237.	306.	25.	171.1	0.285	2.692
78.5	10407.	5705.	* 120.	240.	309.	25.	171.1	0.285	2.692
79.0	10413.	5695.	* 119.	240.	307.	25.	170.5	0.287	2.682
79.5	10308.	5624.	* 116.	235.	299.	25.	169.9	0.288	2.672
80.0	10155.	5514.	* 111.	228.	286.	26.	168.6	0.291	2.652
80.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
81.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
81.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
82.0	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0
82.5	0.	0.	0.	0.	0.	0.	0.0	0.0	0.0

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-60+00
 DEPTH 68.0 - 80.0


Figure 2.5-98

Figure 2.5-98 3-D Elastic Properties Tabulation Sta. 0-60+00 Depth 68.0 - 80.0

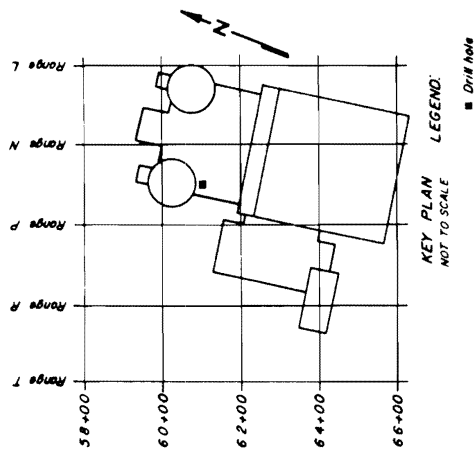

LEGEND


GRAPHIC LOG



ORIENTED IN DESCRIPTION
 THE FOUNDATION ROCK IS COMPOSED OF THE CAROLINA FORMATION, A STRATIGRAPHIC UNIT OF THE APPALACHIAN SYSTEM, WHICH IS A SUBSEQUENT OF THE CAROLINA FORMATION. THE CAROLINA FORMATION IS A SUBSEQUENT OF THE CAROLINA FORMATION.

ROCK TYPE


Given graphically in % and showing ranges of test values for deformation modulus (psi x 10⁴)



THESE TESTS WERE IDENTIFIED FROM VISUAL INSPECTION AND LABORATORY TESTING. ALL TESTS WERE MADE IN THE FIELD. ALL TESTS WERE MADE IN THE FIELD.


NOTES:

1. THE HOLE WAS DRILLED WITH AN INK WIRE LINE CORE DRILL.
2. THE DRILL HOLE WAS INSPECTED WITH A BOREHOLE TELEVISION CAMERA BETWEEN ELEVATIONS 696.1 AND 659.5. THE INSPECTION SHOWED THE CORE LOSS AREA TO BE SOFT SHALE.
3. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE MENARD PRESSUREMETER TESTS.
4. THE BOREHOLE SURVEY FOR THE DYNAMIC ELASTIC MODULUS WAS MADE BY THE BIRDWELL DIVISION OF SEISMOGRAPH SERVICE CORPORATION.

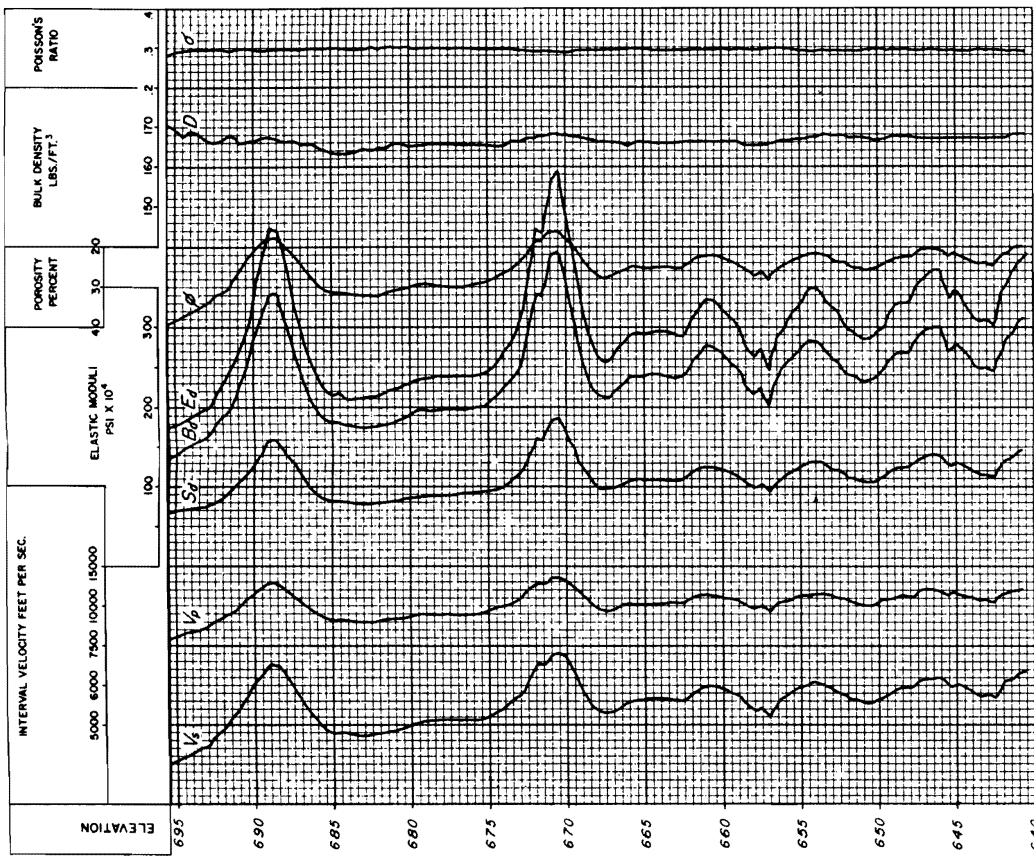

LEGEND:

- Vs = SHEAR VELOCITY.
- Vp = COMPRESSORIAL VELOCITY.
- Sv = DYNAMIC SHEAR MODULUS.
- Bu = DYNAMIC BULK MODULUS.
- Eu = DYNAMIC YOUNG'S MODULUS.
- φ = POROSITY.
- D = DENSITY.
- σ = POISSON'S RATIO.

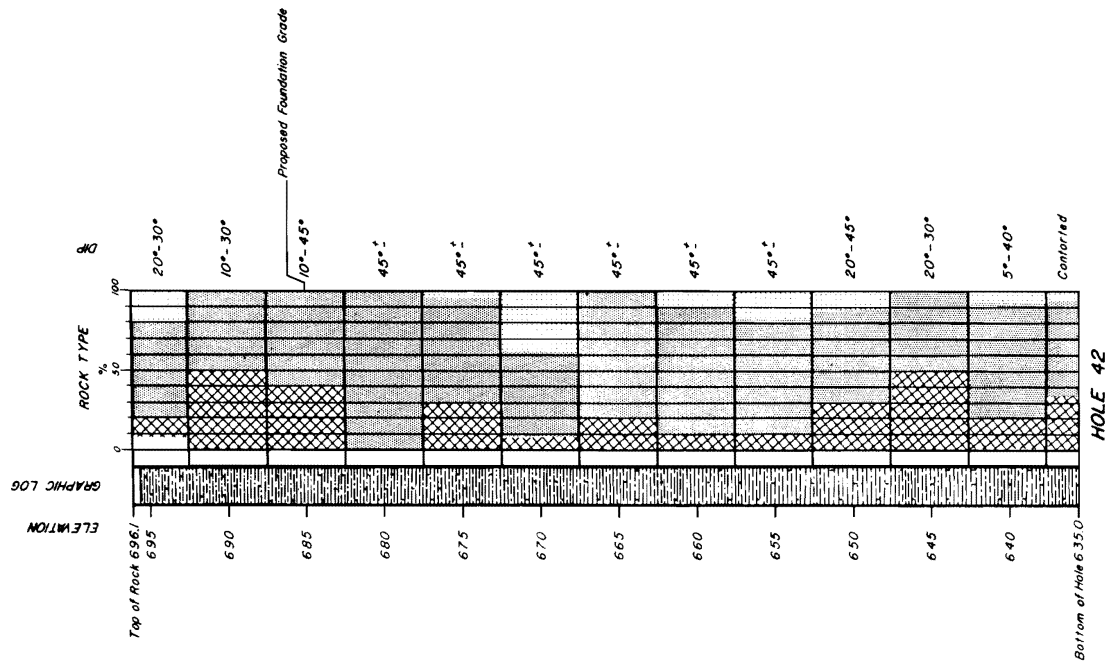

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

GRAPHIC LOG AND
 ELASTIC MODULI
 STA. 0-61+00
 Figure 2.5-99

Figure 2.5-99 Graphic Log and Elastic Moduli Sta. 0-61+00

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 0-61+00 0.0 732.50 97.50 4 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
	MODULI IN 10 TO 4TH LBS/SQ. INCH								
37.0	7834.	4285.	68.	136.	174.	40.	170.5	0.287	2.682
37.5	7988.	4338.	68.	141.	177.	39.	168.6	0.291	2.652
38.0	8140.	4398.	70.	146.	181.	38.	167.4	0.294	2.632
38.5	8234.	4471.	73.	150.	188.	37.	168.6	0.291	2.652
39.0	8407.	4543.	75.	156.	193.	36.	167.4	0.294	2.632
39.5	8539.	4591.	76.	161.	196.	35.	166.1	0.297	2.612
40.0	8902.	4786.	82.	175.	213.	33.	166.1	0.297	2.612
40.5	9126.	4919.	87.	184.	225.	31.	166.7	0.295	2.622
41.0	9455.	5121.	95.	197.	246.	29.	168.0	0.292	2.642
41.5	10067.	5398.	104.	223.	270.	26.	165.5	0.298	2.602
42.0	10632.	5716.	117.	249.	304.	24.	166.1	0.297	2.612
42.5	11380.	6134.	135.	285.	351.	21.	166.7	0.295	2.622
43.0	11960.	6446.	149.	315.	387.	19.	166.7	0.295	2.622
43.5	12467.	6736.	164.	343.	424.	18.	167.4	0.294	2.632
44.0	12467.	6720.	162.	343.	421.	18.	166.7	0.295	2.622
44.5	11824.	6357.	145.	308.	376.	20.	166.1	0.297	2.612
45.0	11131.	5984.	128.	273.	333.	22.	166.1	0.297	2.612
45.5	10408.	5582.	111.	238.	289.	25.	165.5	0.298	2.602
46.0	9871.	5293.	100.	214.	260.	27.	165.5	0.298	2.602
46.5	9385.	5020.	90.	194.	233.	30.	164.9	0.300	2.592
47.0	9174.	4895.	85.	185.	221.	31.	164.2	0.301	2.582
47.5	9054.	4818.	82.	180.	213.	32.	163.6	0.302	2.572
48.0	9058.	4820.	82.	180.	214.	32.	163.6	0.302	2.572
48.5	8983.	4780.	81.	177.	210.	32.	163.6	0.302	2.572
49.0	8983.	4780.	81.	177.	210.	32.	163.6	0.302	2.572
49.5	8983.	4793.	81.	177.	212.	32.	164.2	0.301	2.582
50.0	8983.	4793.	81.	177.	212.	32.	164.2	0.301	2.582
50.5	9026.	4828.	83.	179.	215.	32.	164.9	0.300	2.592
51.0	9066.	4849.	84.	181.	217.	32.	164.9	0.300	2.592
51.5	9142.	4902.	86.	184.	223.	31.	165.5	0.298	2.602

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-61+00
 DEPTH 37.0 - 51.5
 Figure 2.5-100

Figure 2.5-100 3-D Elastic Properties Tabulation Sta. 0-61+00 Depth 37.0 - 51.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 0-61+00 0.0 732.50 97.50 4 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
	MODULI IN 10 TO 4TH LBS/SQ. INCH								
52.0	9223.	4946.	87.	187.	227.	31.	165.5	0.298	2.602
52.5	9305.	4990.	89.	191.	231.	30.	165.5	0.298	2.602
53.0	9432.	5058.	91.	196.	237.	30.	165.5	0.298	2.602
53.5	9428.	5056.	91.	196.	237.	30.	165.5	0.298	2.602
54.0	9471.	5079.	92.	197.	239.	29.	165.5	0.298	2.602
54.5	9471.	5079.	92.	197.	239.	29.	165.5	0.298	2.602
55.0	9471.	5079.	92.	197.	239.	29.	165.5	0.298	2.602
55.5	9466.	5077.	92.	197.	239.	29.	165.5	0.298	2.602
56.0	9510.	5100.	93.	199.	241.	29.	165.5	0.298	2.602
56.5	9514.	5102.	93.	199.	241.	29.	165.5	0.298	2.602
57.0	9514.	5102.	93.	199.	241.	29.	165.5	0.298	2.602
57.5	9642.	5171.	95.	205.	248.	28.	165.5	0.298	2.602
58.0	9871.	5293.	100.	214.	260.	27.	165.5	0.298	2.602
58.5	10062.	5396.	104.	223.	270.	26.	165.5	0.298	2.602
59.0	10316.	5546.	110.	234.	286.	25.	166.1	0.297	2.612
59.5	10632.	5716.	117.	249.	304.	24.	166.1	0.297	2.612
60.0	11442.	6167.	137.	289.	354.	21.	166.7	0.295	2.622
60.5	12459.	6732.	164.	342.	423.	18.	167.4	0.294	2.632
61.0	12385.	6692.	162.	338.	418.	18.	167.4	0.294	2.632
61.5	13333.	7222.	169.	392.	489.	16.	168.0	0.292	2.642
62.0	13428.	7273.	192.	398.	496.	16.	168.0	0.292	2.642
62.5	12772.	6918.	173.	360.	448.	17.	168.0	0.292	2.642
63.0	11832.	6393.	148.	309.	382.	20.	167.4	0.294	2.632
63.5	10904.	5892.	125.	262.	324.	23.	167.4	0.294	2.632
64.0	10260.	5530.	110.	232.	285.	26.	166.7	0.295	2.622
64.5	9829.	5284.	100.	213.	259.	27.	166.1	0.297	2.612
65.0	9783.	5259.	99.	211.	257.	28.	166.1	0.297	2.612
65.5	9875.	5309.	101.	215.	262.	27.	166.1	0.297	2.612
66.0	10110.	5436.	106.	225.	275.	26.	166.1	0.297	2.612
66.5	10414.	5585.	111.	239.	289.	25.	165.5	0.298	2.602

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-61+00
 DEPTH 52.0 - 66.5
 Figure 2.5-101

Figure 2.5-101 3-D Elastic Properties Tabulation Sta. 0-61+00 Depth 52.0 - 66.5

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY

0-61+00 0.0 732.50 97.50 4 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
67.0	10362.	5571.	* 111.	236.	288.	25.	166.1	0.297	2.612
67.5	10414.	5599.	* 112.	239.	291.	25.	166.1	0.297	2.612
68.0	10466.	5627.	* 113.	241.	294.	25.	166.1	0.297	2.612
68.5	10466.	5627.	* 113.	241.	294.	25.	166.1	0.297	2.612
69.0	10414.	5599.	* 112.	239.	291.	25.	166.1	0.297	2.612
69.5	10357.	5568.	* 111.	236.	288.	25.	166.1	0.297	2.612
70.0	10408.	5596.	* 112.	239.	291.	25.	166.1	0.297	2.612
70.5	10785.	5799.	* 120.	256.	312.	23.	166.1	0.297	2.612
71.0	11013.	5921.	* 126.	267.	326.	23.	166.1	0.297	2.612
71.5	11197.	6020.	* 130.	276.	337.	22.	166.1	0.297	2.612
72.0	11137.	5988.	* 128.	273.	333.	22.	166.1	0.297	2.612
72.5	10961.	5893.	* 124.	265.	323.	23.	166.1	0.297	2.612
73.0	10785.	5799.	* 120.	256.	312.	23.	166.1	0.297	2.612
73.5	10572.	5684.	* 116.	246.	300.	24.	166.1	0.297	2.612
74.0	10160.	5448.	* 106.	227.	275.	26.	165.5	0.298	2.602
74.5	9918.	5319.	* 101.	216.	262.	27.	165.5	0.298	2.602
75.0	10116.	5425.	* 105.	225.	273.	26.	165.5	0.298	2.602
75.5	9558.	5126.	* 94.	201.	243.	29.	165.5	0.298	2.602
76.0	10367.	5574.	* 111.	237.	289.	25.	166.1	0.297	2.612
76.5	10632.	5716.	* 117.	249.	304.	24.	166.1	0.297	2.612
77.0	10853.	5850.	* 123.	260.	319.	23.	166.7	0.295	2.622
77.5	11084.	5974.	* 128.	271.	333.	22.	166.7	0.295	2.622
78.0	11332.	6123.	* 135.	283.	350.	21.	167.4	0.294	2.632
78.5	11338.	6126.	* 135.	283.	351.	21.	167.4	0.294	2.632
79.0	11156.	6043.	* 132.	275.	342.	22.	168.0	0.292	2.642
79.5	10865.	5885.	* 126.	260.	324.	23.	168.0	0.292	2.642
80.0	10753.	5825.	* 123.	255.	318.	23.	168.0	0.292	2.642
80.5	10430.	5636.	* 115.	240.	297.	25.	167.4	0.294	2.632
81.0	10378.	5608.	* 114.	237.	294.	25.	167.4	0.294	2.632
81.5	10225.	5525.	* 110.	231.	285.	26.	167.4	0.294	2.632

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-61+00
 DEPTH 67.0 - 81.5
 Figure 2.5-102

Figure 2.5-102 3-D Elastic Properties Tabulation Sta. 0-61+00 Depth 67.0 - 81.5

B I R O W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N


TENNESSEE VALLEY AUTHORITY
 0-61+00 0.0 732.50 97.50 4 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
	MODULI IN 10 TO 4TH LBS/SQ. INCH								
82.0	10281.	5541.	* 110.	233.	286.	25.	166.7	0.295	2.622
82.5	10436.	5625.	* 114.	240.	295.	25.	166.7	0.295	2.622
83.0	10638.	5734.	* 118.	249.	306.	24.	166.7	0.295	2.622
83.5	10968.	5926.	* 127.	265.	328.	23.	167.4	0.294	2.632
84.0	11026.	5957.	* 128.	268.	332.	22.	167.4	0.294	2.632
84.5	11032.	5961.	* 128.	268.	332.	22.	167.4	0.294	2.632
85.0	11456.	6190.	* 138.	289.	358.	21.	167.4	0.294	2.632
85.5	11576.	6255.	* 141.	295.	365.	21.	167.4	0.294	2.632
86.0	11699.	6321.	* 144.	302.	373.	20.	167.4	0.294	2.632
86.5	11699.	6321.	* 144.	302.	373.	20.	167.4	0.294	2.632
87.0	11072.	5982.	* 129.	270.	334.	22.	167.4	0.294	2.632
87.5	11312.	6112.	* 135.	282.	349.	21.	167.4	0.294	2.632
88.0	11072.	5982.	* 129.	270.	334.	22.	167.4	0.294	2.632
88.5	10785.	5828.	* 123.	256.	317.	23.	167.4	0.294	2.632
89.0	10620.	5738.	* 119.	249.	308.	24.	167.4	0.294	2.632
89.5	10669.	5765.	* 120.	251.	310.	24.	167.4	0.294	2.632
90.0	10508.	5678.	* 116.	243.	301.	24.	167.4	0.294	2.632
90.5	11305.	6108.	* 135.	282.	349.	22.	167.4	0.294	2.632
91.0	11492.	6225.	* 140.	291.	363.	21.	168.0	0.292	2.642
91.5	11824.	6405.	* 149.	308.	384.	20.	168.0	0.292	2.642
92.0	11960.	6494.	* 153.	316.	396.	19.	168.6	0.291	2.652
92.5	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
93.0	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
93.5	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
94.0	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
94.5	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
95.0	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
95.5	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
96.0	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
96.5	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT


3-D ELASTIC PROPERTIES TABULATION
 STA. 0-61+00
 DEPTH 82.0 - 92.0
 Figure 2.5-103

Figure 2.5-103 3-D Elastic Properties Tabulation Sta. 0-61+00 Depth 82.0 - 92.0

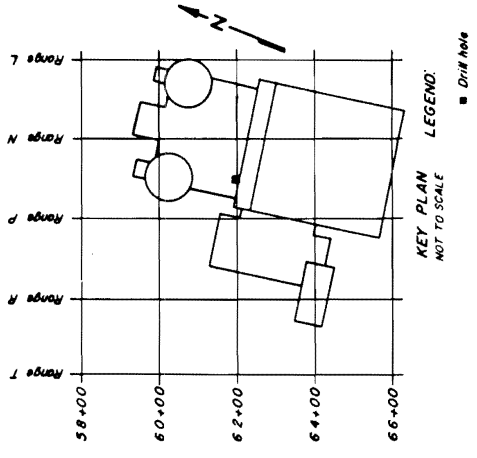


LEGEND

GRAPHIC LOG



GENERAL CHARACTERISTICS:
THE FOUNDATION ROCK IS COMPOSED OF THE FOLLOWING FORMATION:
1. Limestone
2. Hard shale
3. Soft shale
4. Limestone


ROCK TYPE
Given graphically in % and showing ranges of test values for deformation modulus (psi x 10⁴)



NOTE: THESE TESTS WERE OBTAINED FROM A BOREHOLE DRILLED TO A DEPTH OF 100 FEET. THE TESTS WERE MADE BY THE BIRDWELL DIVISION OF SEISMOGRAPH SERVICE CORPORATION.


NOTES:

1. THE HOLE WAS DRILLED WITH AN NX WIRE LINE CORE DRILL.
2. THE DRILL HOLE WAS INSPECTED WITH A BOREHOLE TELEVISION CAMERA BETWEEN ELEVATIONS 690.9 AND 645.2. THE INSPECTION SHOWED THE CORE LOSS AREAS TO BE SOFT SHALE.
3. THE DEFORMATION MODULUS IS DEFINED AS THE IN-SITU SECANT MODULUS INCLUDING BOTH ELASTIC AND PLASTIC DEFORMATION AS DETERMINED FROM THE RESULTS OF THE INWARD PRESSUREMETER TESTS.
4. THE BOREHOLE SURVEY FOR THE DYNAMIC ELASTIC MODULUS WAS MADE BY THE BIRDWELL DIVISION OF SEISMOGRAPH SERVICE CORPORATION.

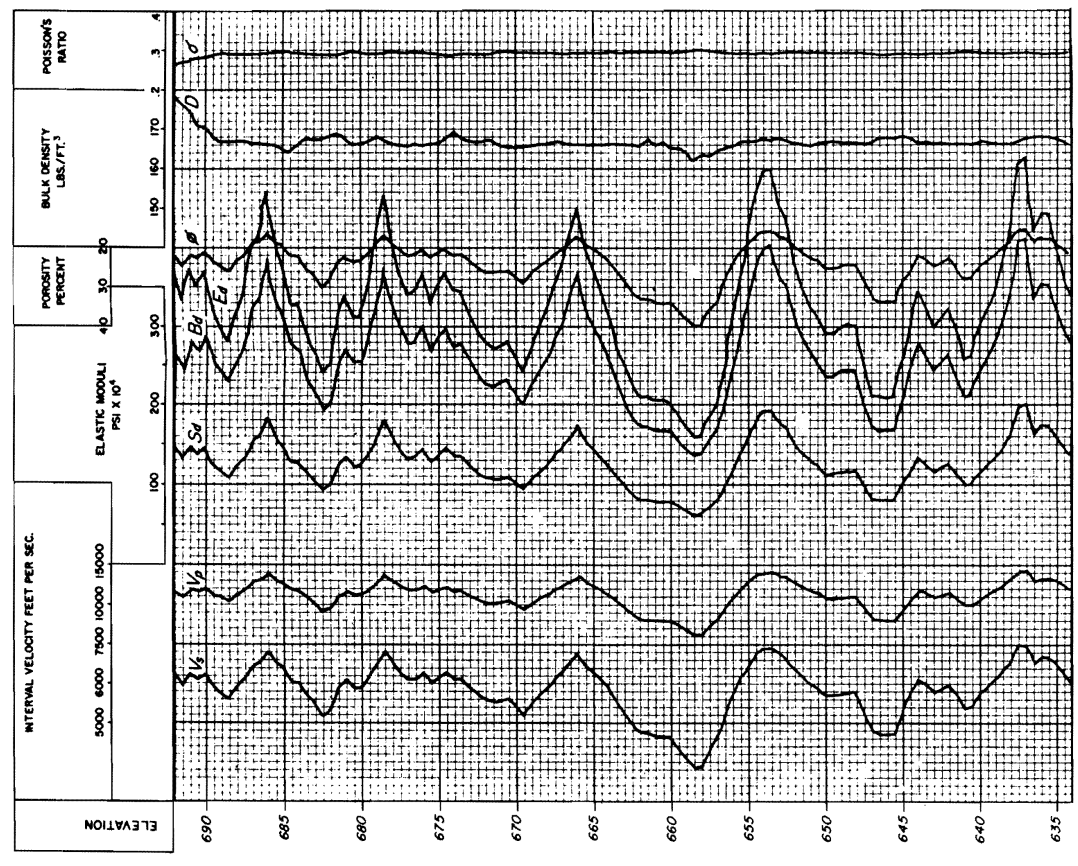

LEGEND:

- V_s = SHEAR VELOCITY.
- V_p = COMPRESSIONAL VELOCITY.
- S_u = DYNAMIC SHEAR MODULUS.
- B = DYNAMIC BULK MODULUS.
- E_d = DYNAMIC YOUNG'S MODULUS.
- σ = POISSON'S RATIO.
- D = DENSITY.
- σ' = POISSON'S RATIO.

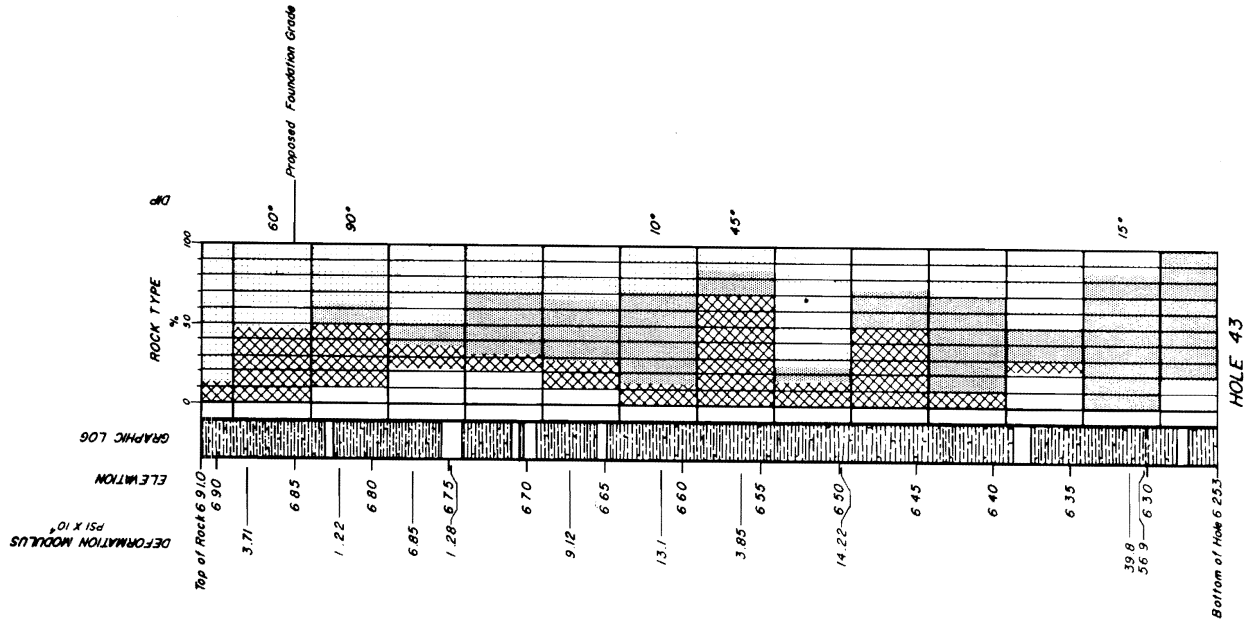

HOLE 43

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

GRAPHIC LOG AND
ELASTIC MODULI
STA. 0-62+00
Figure 2.5-104

Figure 2.5-104 Graphic Log And Elastic Moduli Sta. 0-62+00

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION

TENNESSEE VALLEY AUTHORITY

0-62+00 0.0 733.90 108.60 3 I I
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO	
	MODULI IN 10 TO 4TH LBS/SQ. INCH									
43.0	11024.	6208.	*	148.	270.	376.	22.	178.6	0.268	2.813
43.5	10458.	5851.	*	130.	243.	332.	25.	176.7	0.272	2.783
44.0	11230.	6241.	*	147.	280.	375.	22.	174.9	0.277	2.753
44.5	11074.	6085.	*	137.	271.	352.	22.	171.7	0.284	2.702
45.0	11436.	6269.	*	145.	289.	373.	21.	171.1	0.285	2.692
45.5	10716.	5819.	*	123.	253.	318.	24.	168.6	0.291	2.652
46.0	10436.	5639.	*	115.	240.	297.	25.	167.4	0.294	2.632
46.5	10159.	5489.	*	109.	228.	281.	26.	167.4	0.294	2.632
47.0	10786.	5828.	*	123.	256.	317.	23.	167.4	0.294	2.632
47.5	11154.	6027.	*	131.	274.	339.	22.	167.4	0.294	2.632
48.0	12151.	6549.	*	154.	325.	400.	19.	166.7	0.295	2.622
48.5	12368.	6666.	*	160.	337.	414.	18.	166.7	0.295	2.622
49.0	13252.	7143.	*	184.	387.	475.	16.	166.7	0.295	2.622
49.5	12360.	6645.	*	158.	336.	410.	18.	166.1	0.297	2.612
50.0	11933.	6399.	*	146.	313.	380.	20.	165.5	0.298	2.602
50.5	11199.	5975.	*	126.	276.	329.	22.	164.2	0.301	2.582
51.0	11076.	5955.	*	127.	270.	330.	22.	166.1	0.297	2.612
51.5	10317.	5588.	*	113.	235.	293.	25.	168.0	0.292	2.642
52.0	9906.	5366.	*	104.	216.	270.	27.	168.0	0.292	2.642
52.5	9356.	5068.	*	93.	193.	241.	30.	168.0	0.292	2.642
53.0	9539.	5180.	*	98.	201.	252.	29.	168.6	0.291	2.652
53.5	10701.	5825.	*	124.	253.	319.	24.	169.2	0.290	2.662
54.0	11112.	6034.	*	132.	273.	342.	22.	168.6	0.291	2.652
54.5	10762.	5801.	*	121.	255.	314.	23.	166.7	0.295	2.622
55.0	10774.	5807.	*	121.	256.	314.	23.	166.7	0.295	2.622
55.5	11300.	6106.	*	135.	282.	348.	22.	167.4	0.294	2.632
56.0	12154.	6599.	*	158.	326.	409.	19.	168.6	0.291	2.652
56.5	13075.	7082.	*	182.	377.	470.	17.	168.0	0.292	2.642
57.0	12360.	6662.	*	160.	337.	414.	18.	166.7	0.295	2.622
57.5	11737.	6310.	*	143.	303.	370.	20.	166.1	0.297	2.612

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-62+00
 DEPTH 43.0 - 57.5

Figure 2.5-105

Figure 2.5-105 3-D Elastic Properties Tabulation Sta. 0-62+00 Depth 43.0 - 57.5

B I R D W E L L 3-0 E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 0-62+00 0.0 733.90 108.60 3 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK YOUNGS	POROS.	DENSITY	POISSON	RHO	
MODULI IN 10 TO 4TH LBS/SQ. INCH									
58.0	11244.	6045.	* 131.	278.	340.	22.	166.1	0.297	2.612
58.5	11321.	6102.	* 134.	282.	347.	21.	166.7	0.295	2.622
59.0	11697.	6289.	* 142.	301.	368.	20.	166.1	0.297	2.612
59.5	10999.	5928.	* 126.	267.	327.	23.	166.7	0.295	2.622
60.0	11422.	6156.	* 136.	288.	353.	21.	166.7	0.295	2.622
60.5	11599.	6283.	* 143.	297.	370.	21.	168.0	0.292	2.642
61.0	11138.	6077.	* 135.	274.	349.	22.	169.9	0.288	2.672
61.5	11230.	6083.	* 134.	278.	347.	22.	168.0	0.292	2.642
62.0	10820.	5847.	* 123.	258.	319.	23.	167.4	0.294	2.632
62.5	10398.	5618.	* 114.	238.	295.	25.	167.4	0.294	2.632
63.0	10123.	5483.	* 109.	226.	282.	26.	168.0	0.292	2.642
63.5	10036.	5423.	* 106.	222.	275.	26.	167.4	0.294	2.632
64.0	10154.	5459.	* 107.	227.	277.	26.	166.1	0.297	2.612
64.5	10258.	5515.	* 109.	232.	283.	26.	166.1	0.297	2.612
65.0	9852.	5297.	* 101.	214.	261.	27.	166.1	0.297	2.612
65.5	9482.	5098.	* 93.	198.	241.	29.	166.1	0.297	2.612
66.0	10056.	5407.	* 105.	223.	272.	26.	166.1	0.297	2.612
66.5	10468.	5642.	* 115.	241.	297.	25.	166.7	0.295	2.622
67.0	10803.	5822.	* 122.	257.	316.	23.	166.7	0.295	2.622
67.5	11355.	6136.	* 136.	284.	352.	21.	167.4	0.294	2.632
68.0	11687.	6315.	* 144.	301.	373.	20.	167.4	0.294	2.632
68.5	12413.	6690.	* 161.	340.	417.	18.	166.7	0.295	2.622
69.0	12967.	6989.	* 176.	371.	455.	17.	166.7	0.295	2.622
69.5	12105.	6524.	* 153.	323.	397.	19.	166.7	0.295	2.622
70.0	11756.	6336.	* 144.	305.	374.	20.	166.7	0.295	2.622
70.5	11285.	6082.	* 133.	281.	345.	22.	166.7	0.295	2.622
71.0	10861.	5854.	* 123.	260.	319.	23.	166.7	0.295	2.622
71.5	10195.	5495.	* 109.	229.	281.	26.	166.7	0.295	2.622
72.0	9610.	5180.	* 96.	204.	250.	29.	166.7	0.295	2.622
72.5	9125.	4918.	* 87.	183.	225.	31.	166.7	0.295	2.622

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-62+00
 DEPTH 58.0 - 72.5

Figure 2.5-106

Figure 2.5-106 3-D Elastic Properties Tabulation Sta. 0-62+00 Depth 58.0 - 72.5

B I R D W E L L 3-D E L A S T I C P R O P E R T I E S T A B U L A T I O N

TENNESSEE VALLEY AUTHORITY
 0-62+00 0.0 733.90 108.60 3 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
			IN 10	IN 10	TO 4TH	LBS/SQ.	INCH		
73.0	8832.	4748.	81.	172.	210.	33.	166.1	0.297	2.612
73.5	8796.	4753.	82.	171.	211.	33.	167.4	0.294	2.632
74.0	8697.	4688.	79.	167.	205.	34.	166.7	0.295	2.622
74.5	8697.	4688.	79.	167.	205.	34.	166.7	0.295	2.622
75.0	8693.	4662.	78.	166.	201.	34.	165.5	0.298	2.602
75.5	8393.	4501.	72.	155.	188.	36.	165.5	0.298	2.602
76.0	8051.	4307.	66.	143.	171.	38.	164.9	0.300	2.592
76.5	7859.	4160.	61.	136.	158.	40.	162.4	0.305	2.551
77.0	7876.	4191.	62.	136.	161.	40.	163.6	0.302	2.572
77.5	8406.	4473.	71.	155.	184.	36.	163.6	0.302	2.572
78.0	8733.	4671.	78.	168.	202.	34.	164.9	0.300	2.592
78.5	9549.	5121.	94.	201.	243.	29.	165.5	0.298	2.602
79.0	10513.	5652.	114.	243.	297.	24.	166.1	0.297	2.612
79.5	11443.	6183.	138.	289.	357.	21.	167.4	0.294	2.632
80.0	12116.	6546.	155.	324.	400.	19.	167.4	0.294	2.632
80.5	13039.	7045.	179.	375.	464.	17.	167.4	0.294	2.632
81.0	13430.	7275.	192.	398.	496.	16.	168.0	0.292	2.642
81.5	13554.	7323.	194.	405.	501.	15.	167.4	0.294	2.632
82.0	12923.	7000.	178.	368.	459.	17.	168.0	0.292	2.642
82.5	12678.	6850.	169.	354.	438.	17.	167.4	0.294	2.632
83.0	11938.	6434.	149.	314.	386.	20.	166.7	0.295	2.622
83.5	11414.	6152.	136.	287.	353.	21.	166.7	0.295	2.622
84.0	11054.	5943.	127.	269.	328.	22.	166.1	0.297	2.612
84.5	10814.	5829.	122.	258.	317.	23.	166.7	0.295	2.622
85.0	10349.	5592.	113.	236.	292.	25.	167.4	0.294	2.632
85.5	10359.	5597.	113.	237.	293.	25.	167.4	0.294	2.632
86.0	10485.	5665.	116.	242.	300.	25.	167.4	0.294	2.632
86.5	10552.	5701.	117.	245.	304.	24.	167.4	0.294	2.632
87.0	10530.	5689.	117.	244.	302.	24.	167.4	0.294	2.632
87.5	9689.	5235.	99.	207.	256.	28.	167.4	0.294	2.632

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-62+00
 DEPTH 73.0 - 87.5
 Figure 2.5-107

Figure 2.5-107 3-D Elastic Properties Tabulation Sta. 0-62+00 Depth 73.0 - 87.5

BIRDWELL 3-D ELASTIC PROPERTIES TABULATION


TENNESSEE VALLEY AUTHORITY
 0-62+00 0-0 733.90 108.60 3 1 1
 WATTS BAR NUCLEAR PLANT, RHEA COUNTY, TENNESSEE

DEPTH	VP	VS	SHEAR	BULK	YOUNGS	POROS.	DENSITY	POISSON	RHO
MODULI IN 10 TO 4TH LBS/SQ. INCH									
88.0	8809.	4760.	* 82.	171.	212.	33.	167.4	0.294	2.632
88.5	8690.	4707.	* 80.	167.	208.	34.	168.0	0.292	2.642
89.0	8683.	4703.	* 80.	166.	207.	34.	168.0	0.292	2.642
89.5	8711.	4719.	* 81.	167.	209.	34.	168.0	0.292	2.642
90.0	9600.	5213.	* 99.	203.	255.	29.	168.6	0.291	2.652
90.5	10408.	5638.	* 115.	239.	298.	25.	168.0	0.292	2.642
91.0	11285.	6097.	* 134.	281.	347.	22.	167.4	0.294	2.632
91.5	10968.	5927.	* 127.	265.	328.	23.	167.4	0.294	2.632
92.0	10518.	5669.	* 116.	244.	299.	24.	166.7	0.295	2.622
92.5	10693.	5763.	* 119.	252.	309.	24.	166.7	0.295	2.622
93.0	10968.	5912.	* 126.	265.	326.	23.	166.7	0.295	2.622
93.5	10452.	5633.	* 114.	241.	296.	25.	166.7	0.295	2.622
94.0	9737.	5248.	* 99.	209.	257.	28.	166.7	0.295	2.622
94.5	9848.	5308.	* 101.	214.	262.	27.	166.7	0.295	2.622
95.0	10479.	5662.	* 116.	242.	300.	25.	167.4	0.294	2.632
95.5	10861.	5869.	* 124.	260.	322.	23.	167.4	0.294	2.632
96.0	11221.	6048.	* 132.	277.	341.	22.	166.7	0.295	2.622
96.5	11811.	6366.	* 146.	307.	378.	20.	166.7	0.295	2.622
97.0	12413.	6690.	* 161.	340.	417.	18.	166.7	0.295	2.622
97.5	13623.	7361.	* 196.	409.	506.	15.	167.4	0.294	2.632
98.0	13696.	7418.	* 199.	414.	515.	15.	168.0	0.292	2.642
98.5	12321.	6690.	* 163.	335.	420.	18.	168.6	0.291	2.652
99.0	12703.	6898.	* 173.	356.	447.	17.	168.6	0.291	2.652
99.5	12695.	6893.	* 173.	356.	446.	17.	168.6	0.291	2.652
100.0	12163.	6588.	* 157.	326.	407.	19.	168.0	0.292	2.642
100.5	11728.	6337.	* 145.	303.	375.	20.	167.4	0.294	2.632
101.0	11010.	5920.	* 126.	267.	326.	23.	166.1	0.297	2.612
101.5	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
102.0	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0
102.5	0.	0.	* 0.	0.	0.	0.	0.0	0.0	0.0

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

3-D ELASTIC PROPERTIES TABULATION
 STA. 0-62+00
 DEPTH 88.0 - 101.0
 Figure 2.5-108

Figure 2.5-108 3-D Elastic Properties Tabulation Sta. 0-62+00 Depth 88.0 - 101.0

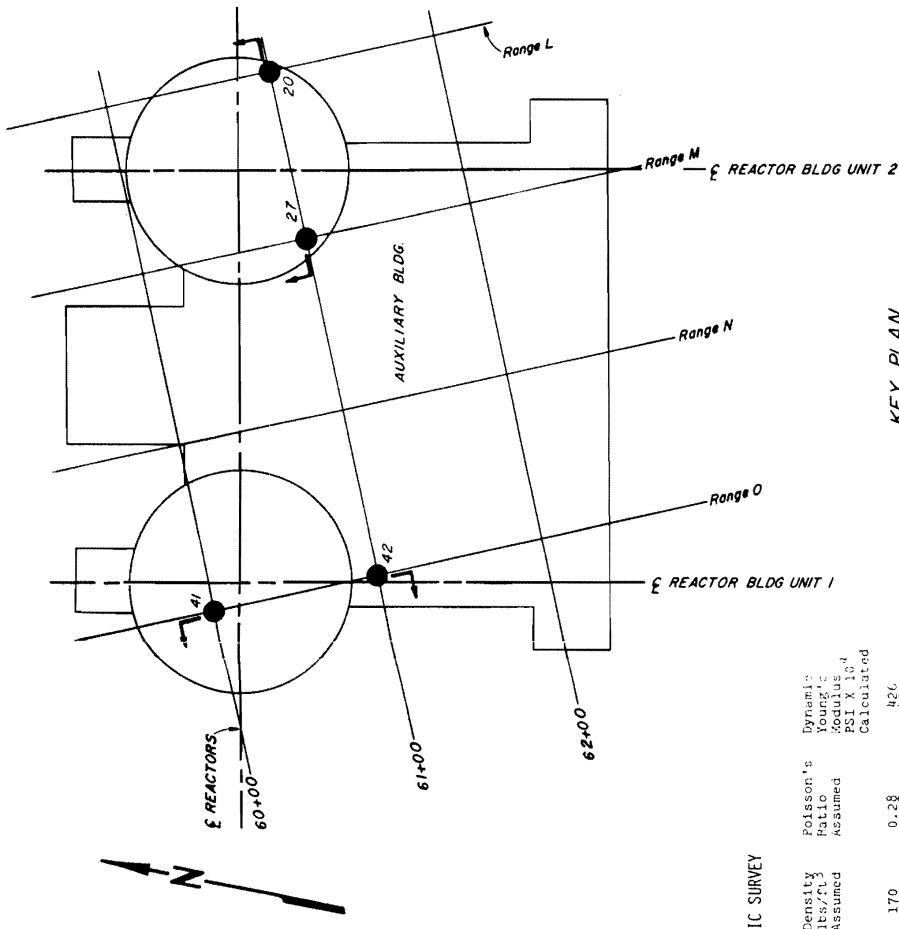


KEY PLAN

LEGEND:

- NX WIRELINE CORE DRILL HOLE
- TR - TOP OF ROCK ELEVATION.
- GEOPHONE SETTING.
- SHOT LOCATION.


SCALE:



WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

CROSS-HOLE DYNAMIC
SECTIONS AND SUMMARY

Figure 2.5-109

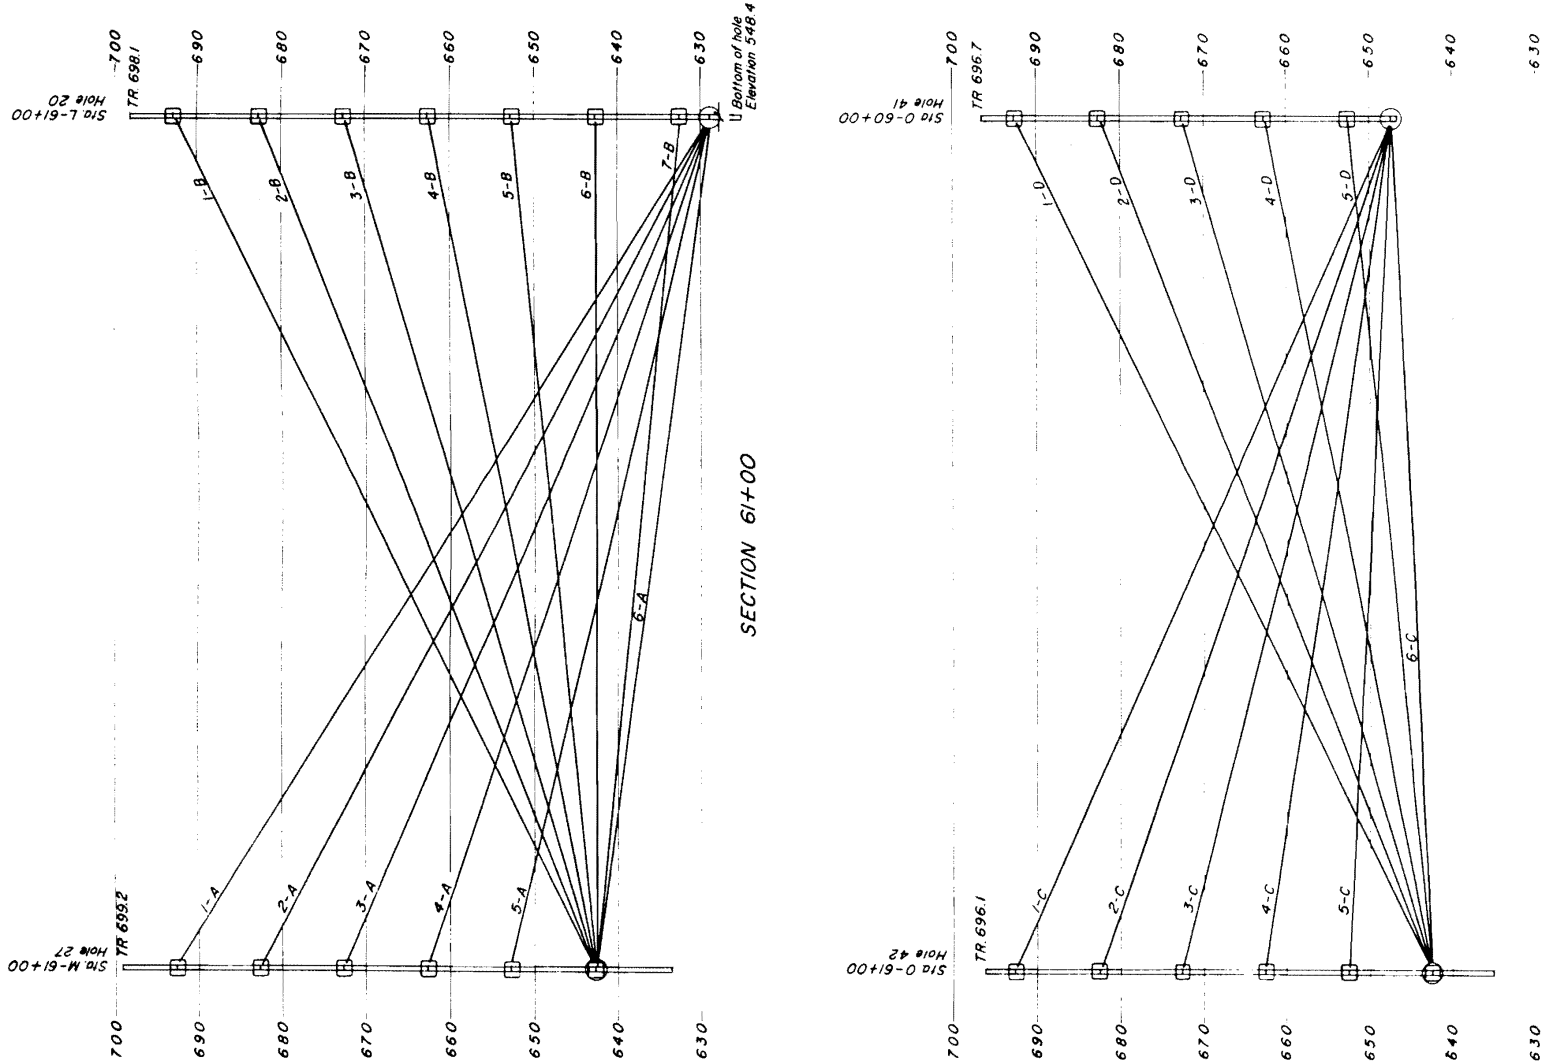

SUMMARY
CROSS-HOLE DYNAMIC SURVEY

Line Number	Compressional Velocity measured ft./sec.	Shear Velocity Calculated ft./sec.	Density lbs./cu. ft. Assumed	Poisson's Ratio Assumed	Dynamic Young's Modulus Calculated 10^4 PSI X 10^4
1-A	12182	6734	170	0.28	426
2-A	12114	6696	170	0.28	421
3-A	13063	7232	170	0.28	491
4-A	12718	7030	170	0.28	464
5-A	12953	7169	170	0.28	487
1-B	14636	7918	165	0.28	561
2-B	10560	5743	170	0.29	315
3-B	10686	5811	170	0.28	351
4-B	11222	6203	170	0.28	381
5-B	11111	6142	170	0.28	374
6-B	11568	6401	170	0.28	401
7-B	12251	6798	170	0.28	435
1-C	11070	6110	170	0.28	351
2-C	10729	5920	170	0.28	343
3-C	10141	5606	170	0.28	295
4-C	11122	6148	170	0.28	355
5-C	11209	6196	170	0.28	369
1-D	11632	6430	170	0.28	413
2-D	11293	6062	170	0.28	392
3-D	11422	6313	170	0.28	374
4-D	10339	5715	170	0.28	307

NOTES:

1. THE LINES ON THE SECTIONS BETWEEN SHOT POINTS AND GEOPHONE LOCATIONS INDICATE ONLY THE TRAVEL DIRECTION OF THE COMPRESSIONAL WAVE.
2. THE FOUNDATION ROCK IS COMPOSED OF THE CONASAUGA FORMATION. THIS FORMATION CONSISTS OF CONTOURED GRAY-GREEN SHALES INTERBEDDED WITH LENSES OF LIMESTONE.
3. THE ASSUMED DENSITIES AND POISSON'S RATIOS ARE BASED ON THE RESULTS FROM THE GEOPHONE SURVEY CONDUCTED BY THE GEOTECHNICAL DIVISION OF SLEIPER GRAPH SERVICE CORPORATION.


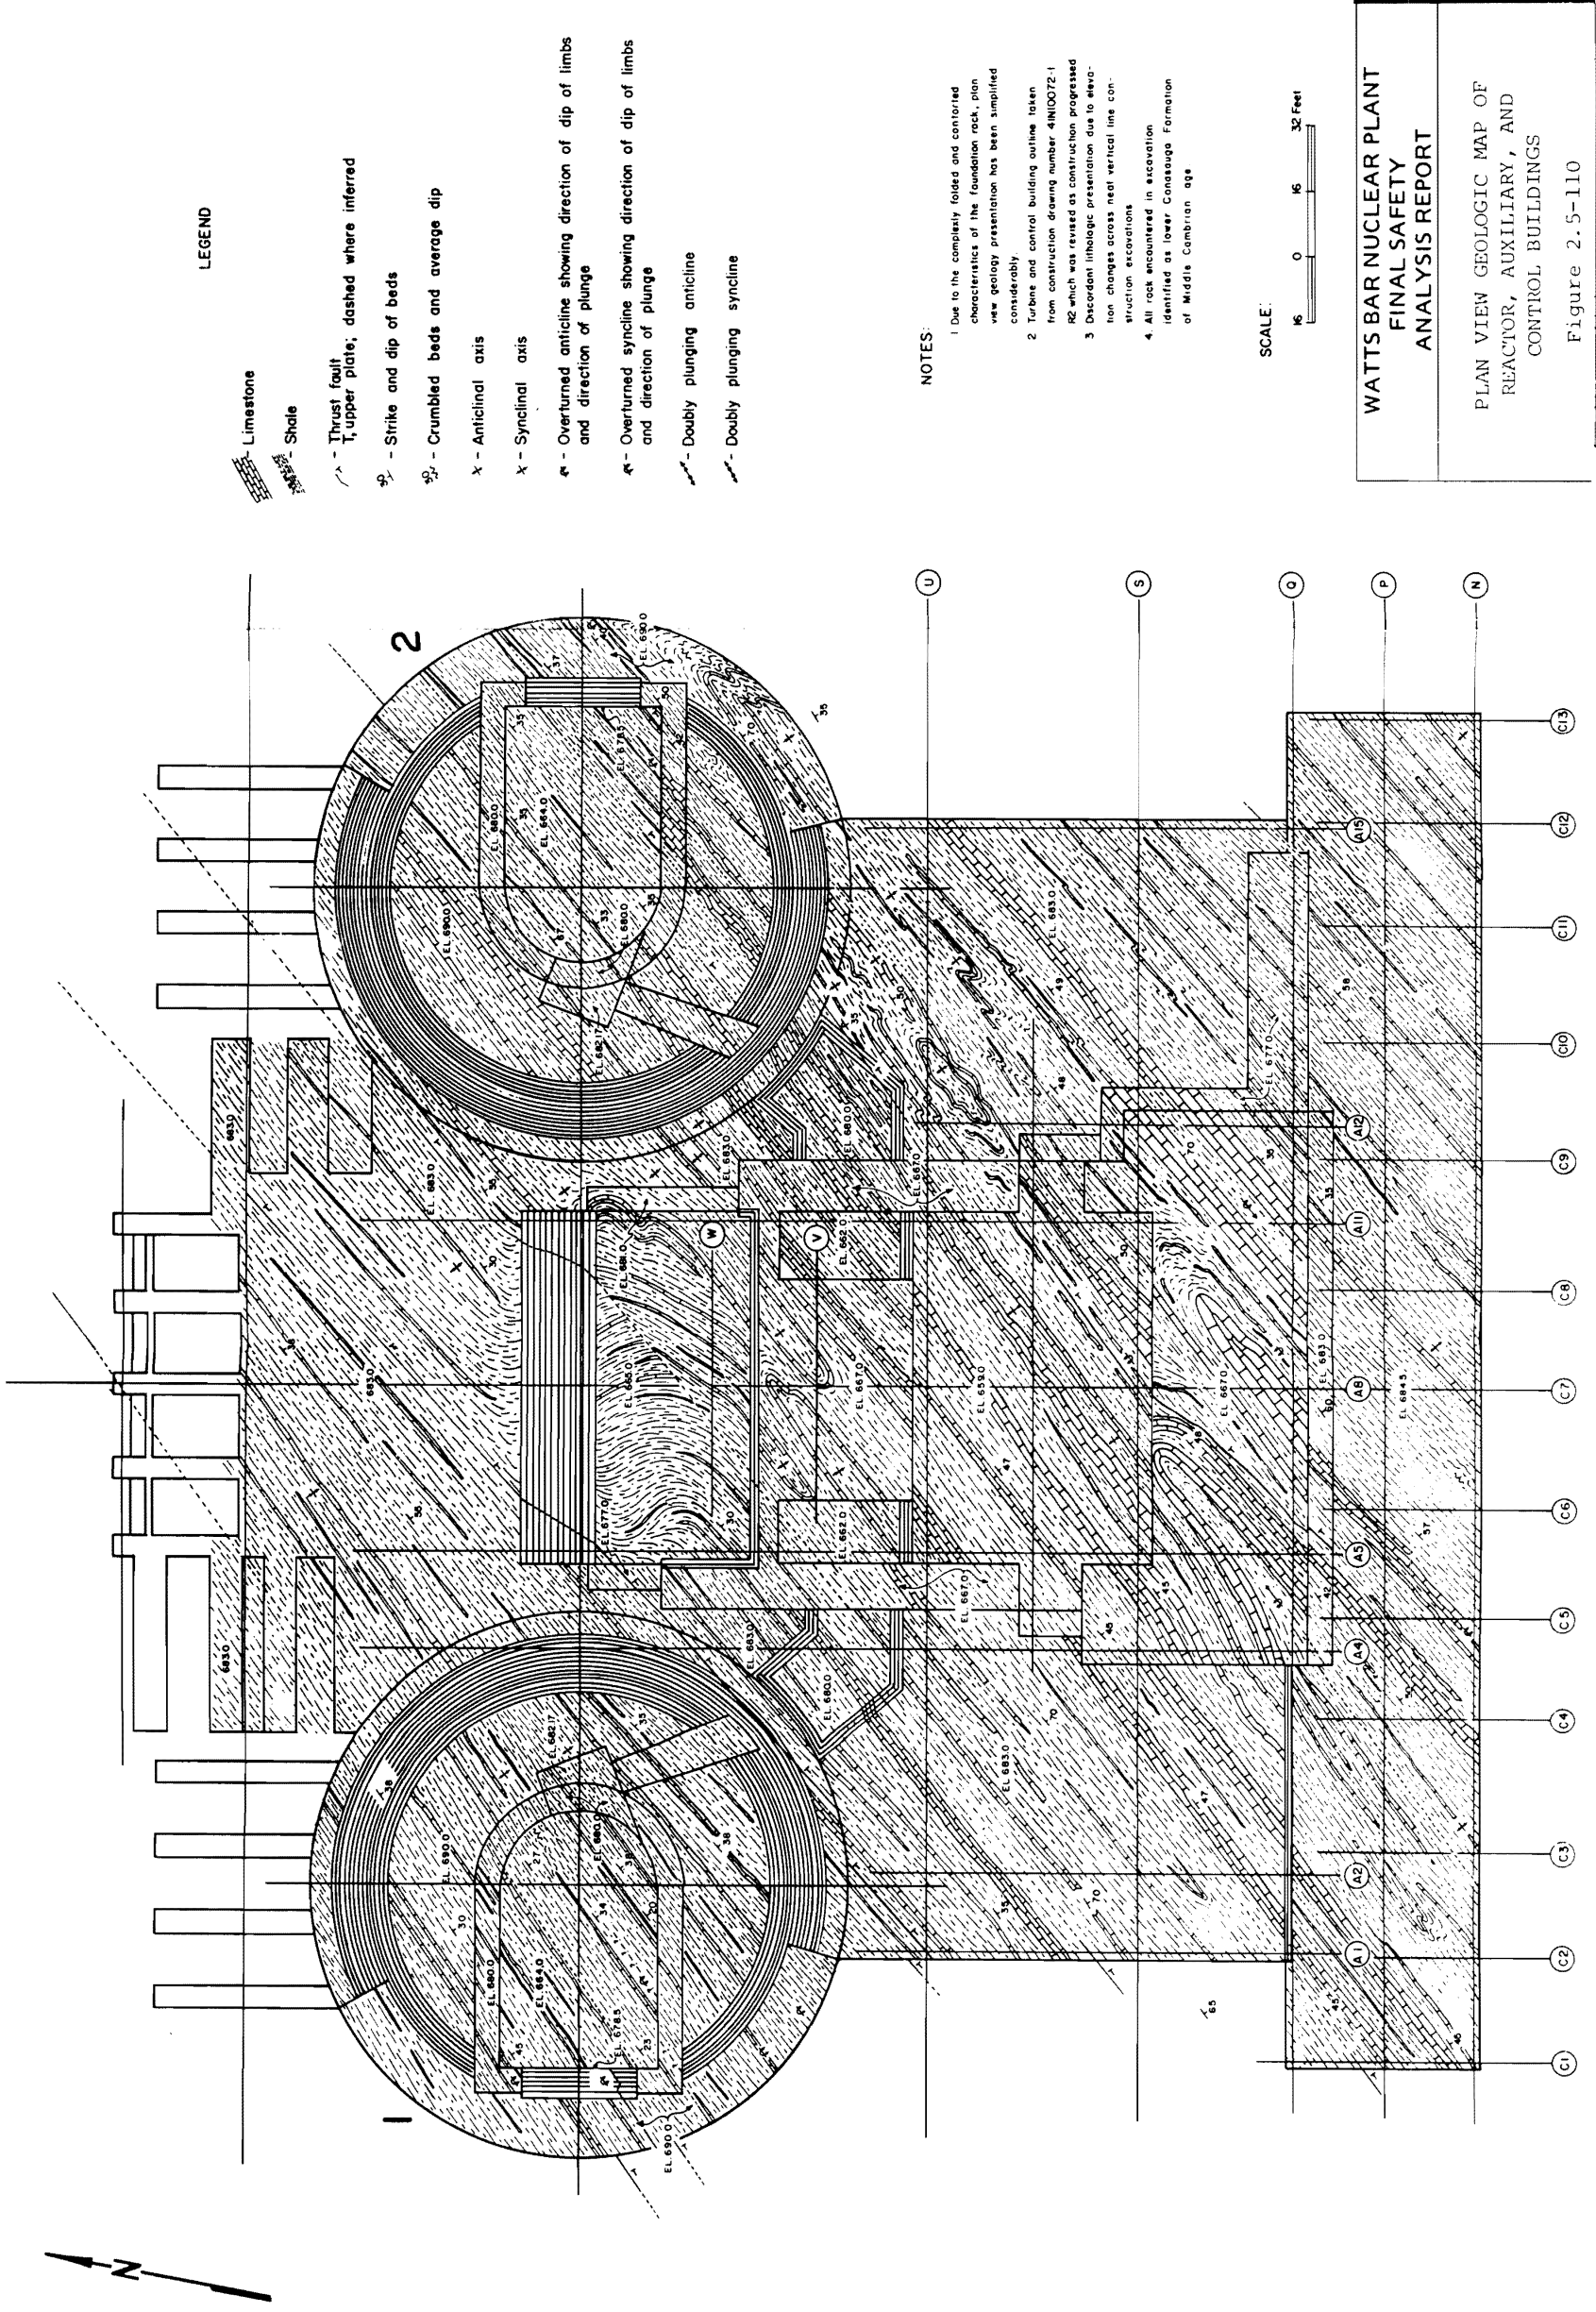


Figure 2.5-110 Plan View Geologic Map of Reactor, Auxiliary And Control Buildings

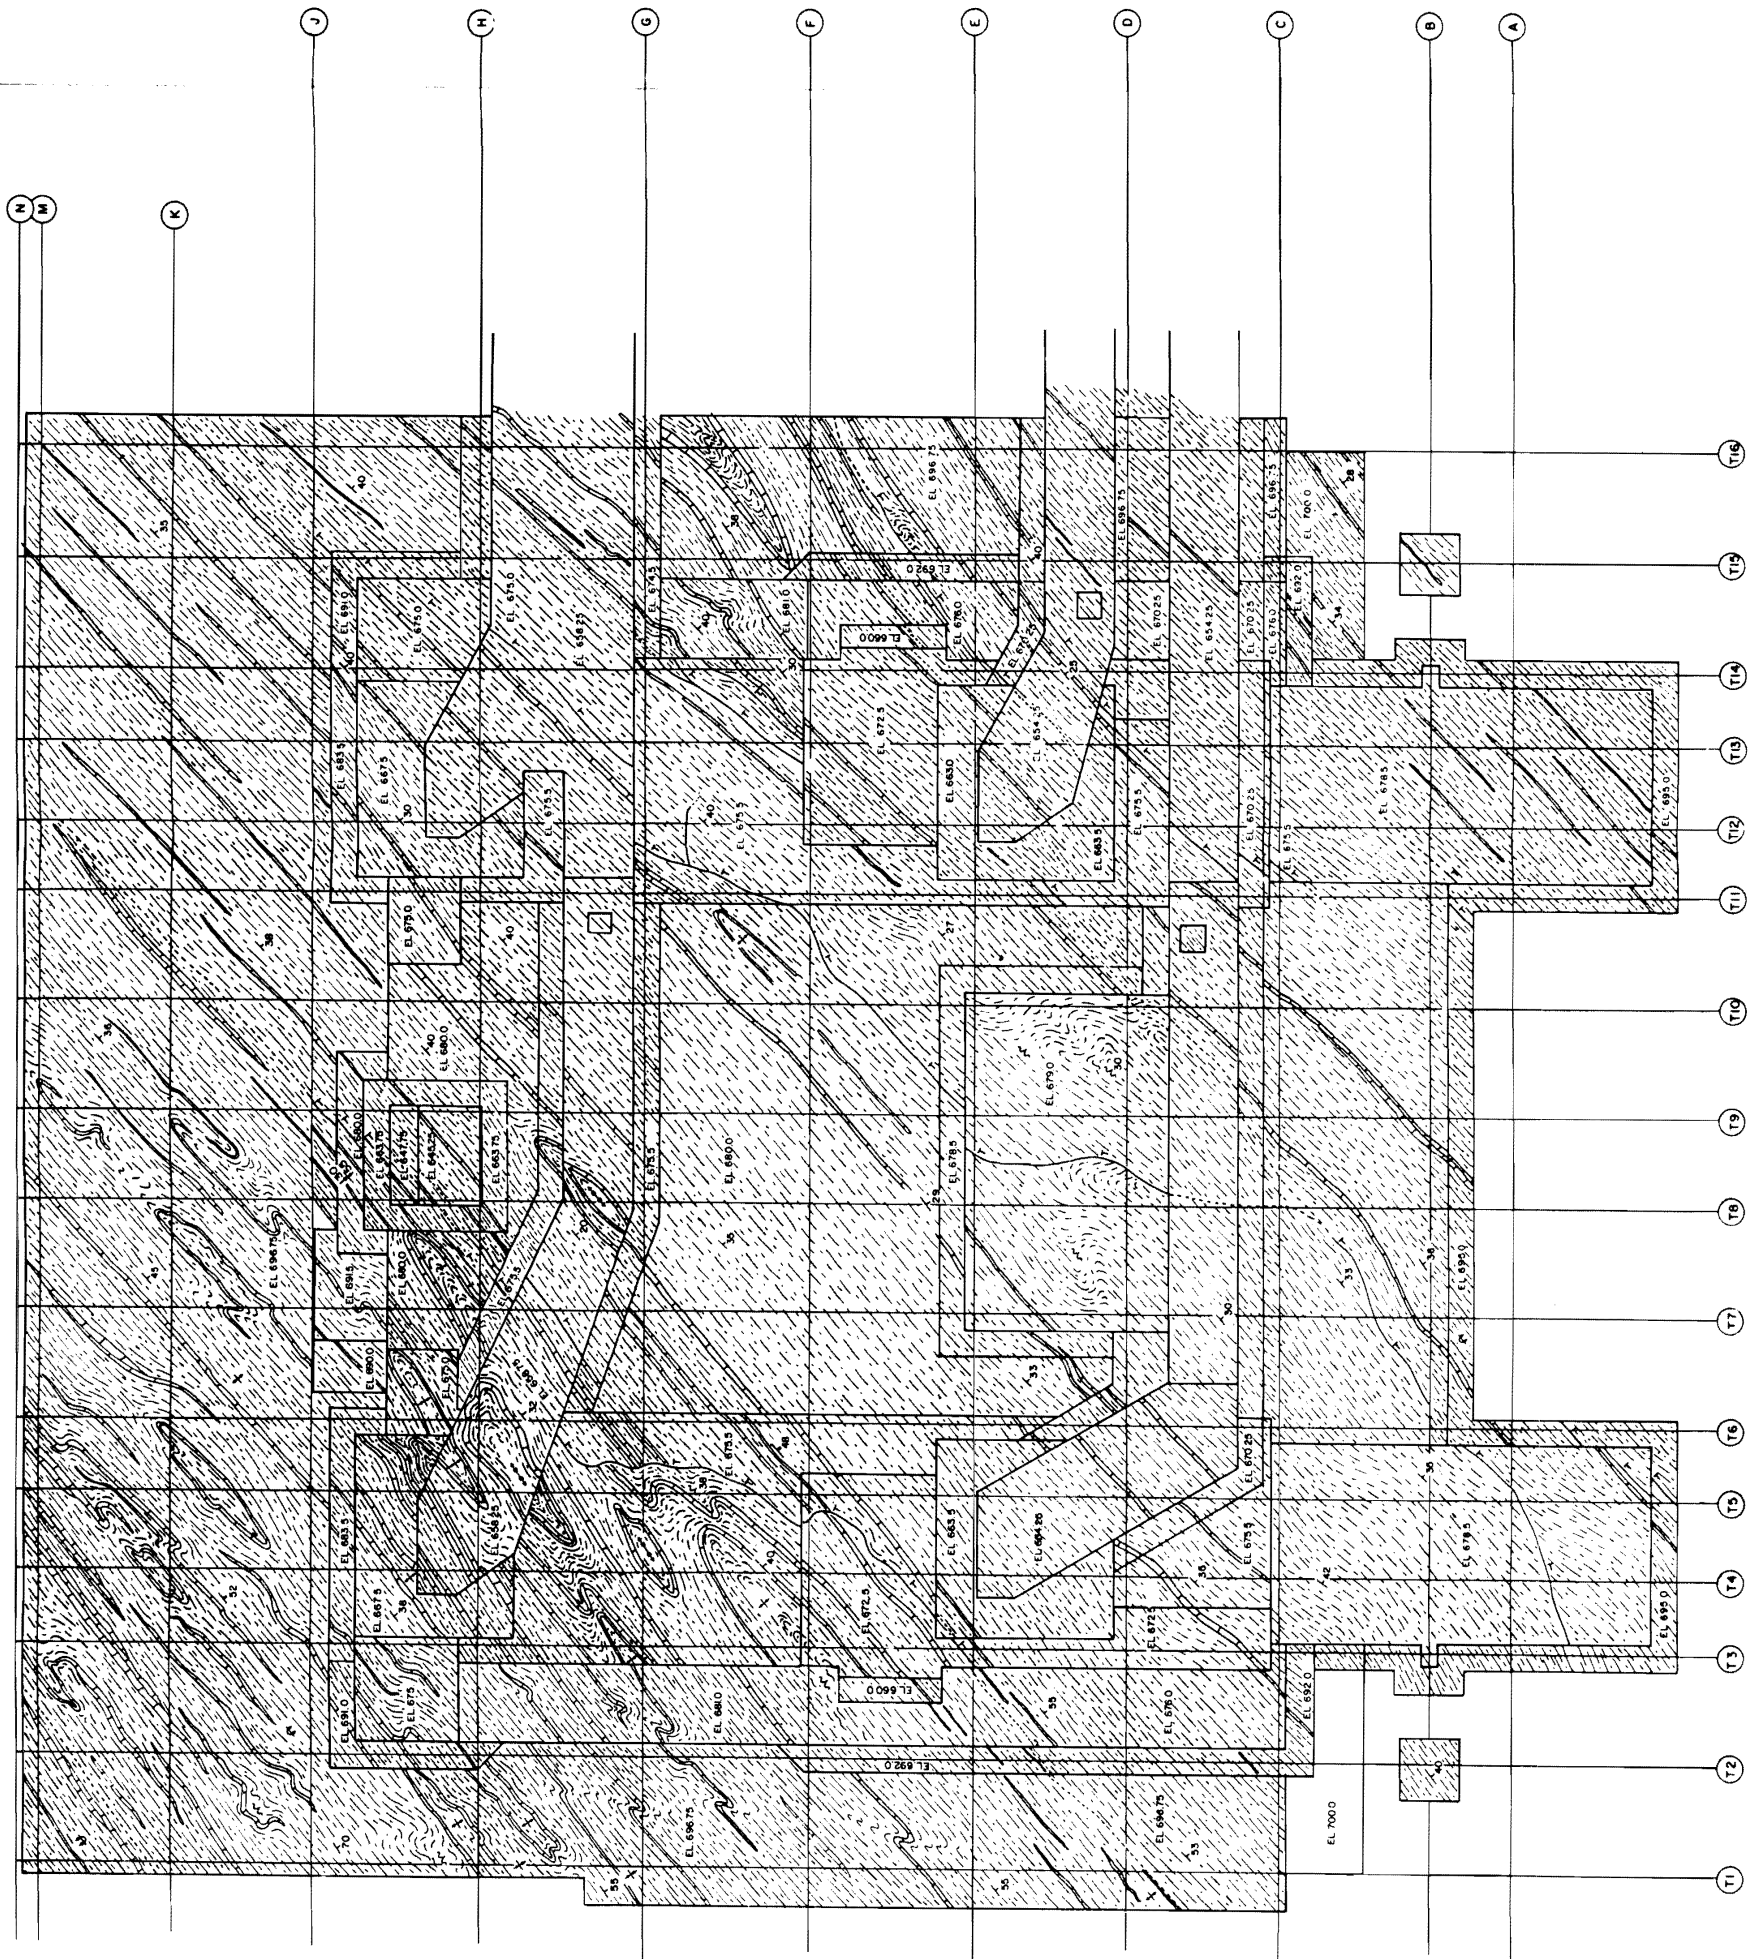

LEGEND

- Limestone
- Shale
- Thrust fault
T, upper plate, dashed where inferred
- Strike and dip of beds
- Crumpled beds and average dip
- X - Anticlinal axis
- X - Synclinal axis
- Overturned anticline showing direction of dip of limbs and direction of plunge
- Overturned syncline showing direction of dip of limbs and direction of plunge
- Doubly plunging anticline
- Doubly plunging syncline

NOTES:

1. Due to the complexly folded and contorted characteristics of the foundation rock, plan view geology presentation has been simplified considerably.
2. Turbine and control building outline taken from construction drawing number 41N0071-1 RB which was revised as construction progressed.
3. Discordant lithologic presentation due to elevation changes across near vertical line construction excavations.
4. All rock encountered in excavation identified as lower Cambrian formation of Middle Cambrian age.

SCALE:





WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

PLAN VIEW GEOLOGIC
MAP OF TURBINE BUILDING

Figure 2.5-111

Figure 2.5-111 Plan View Geologic Map of Turbine Building

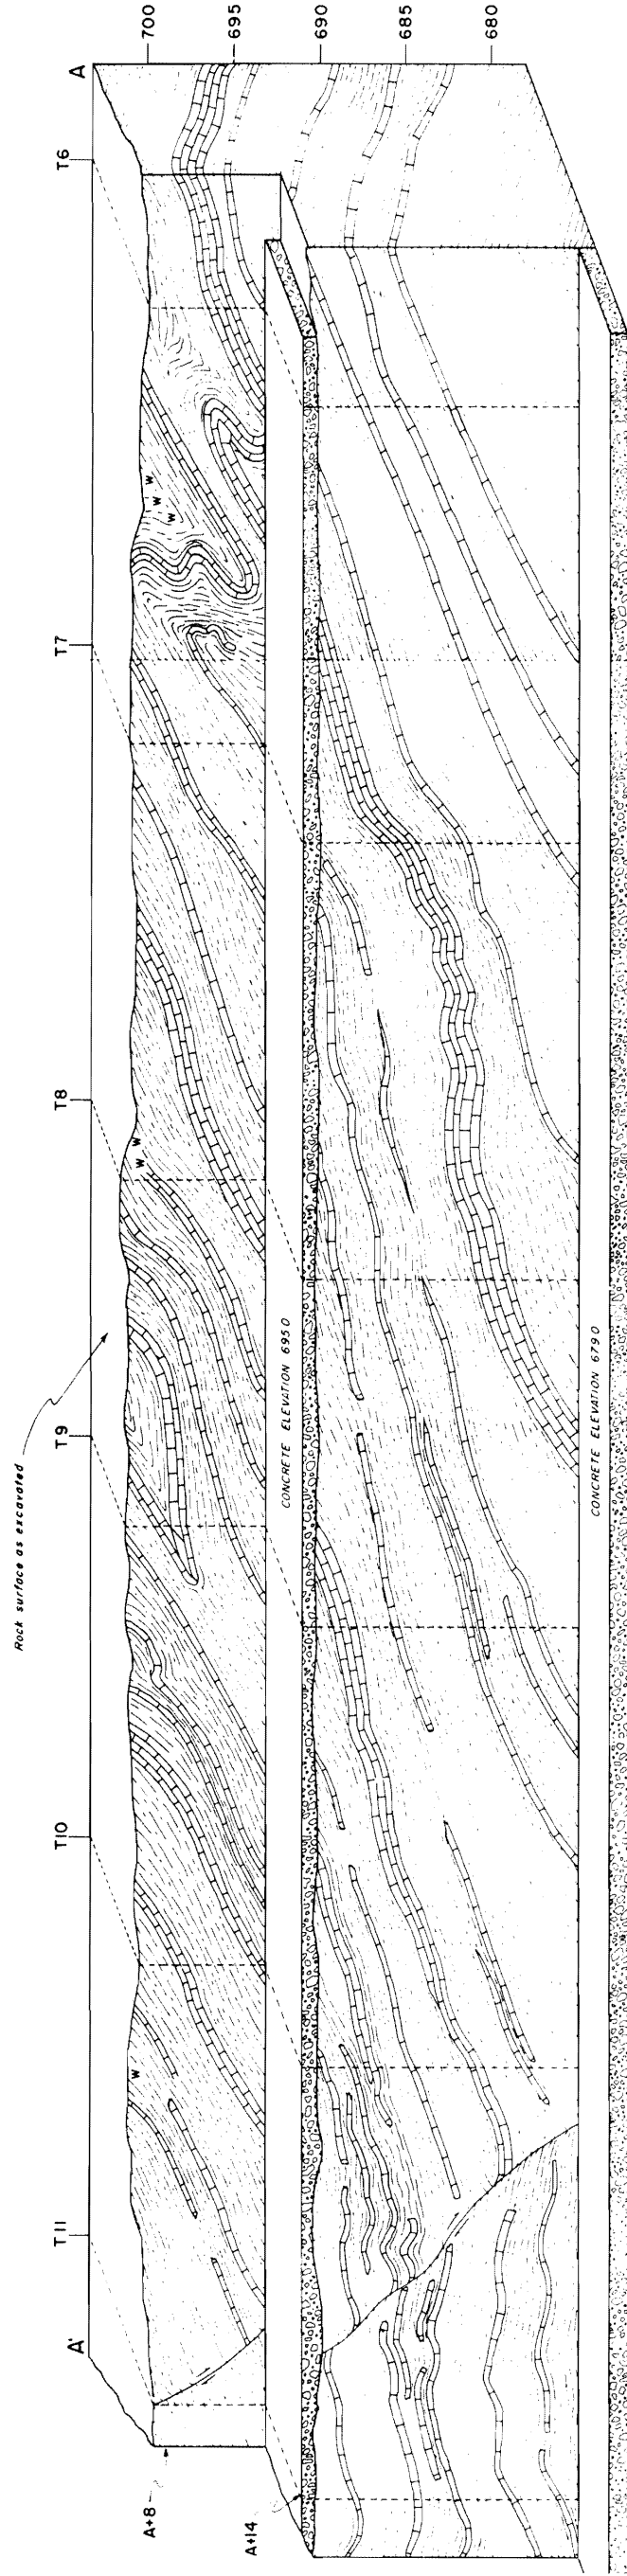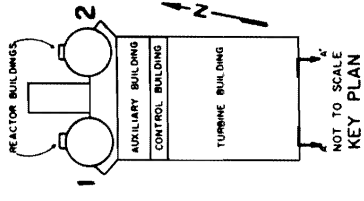


LEGEND

- THRUST FAULT
- LIMESTONE - FINE- TO COARSE-GRAINED, WHITE TO DARK GREY TO PINK, THIN, MEDIUM TO MASSIVE BEDDED, SOME BEDS GLAUCONITIC AND/OR ARGILLACEOUS.
- SHALE - VARIOLORED RED, GREY, GREEN AND PURPLE, FISSILE, CALCAREOUS SHALE WHICH FREQUENTLY IS TIGHTLY FOLDED, CRUMPLED, CONTORTED AND BOUNDED BY SLICKENSIDED SURFACES.
- WEATHERED - SLAKED, OR WEATHERED SHALE, WEATHERED GLAUCONITIC LIMESTONE AND/OR CLAY, REMOVED PRIOR TO EMBLEMENT OF PROTECTIVE CONCRETE.
- PROTECTIVE CONCRETE

NOTES:

- 1 All rock encountered in excavation identified as lower Cambrian formation of Middle Cambrian age.
- 2 Due to the complexly folded and contorted characteristics of the foundation rock, the geologic sections have been simplified.

SCALE:




WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

GEOLOGIC SECTION ALONG A+8
AND A+14 LINES FROM T6 TO T11

Figure 2.5-112

Figure 2.5-112 Geologic Section Along A+8 And A+14 Lines From T6 To T11

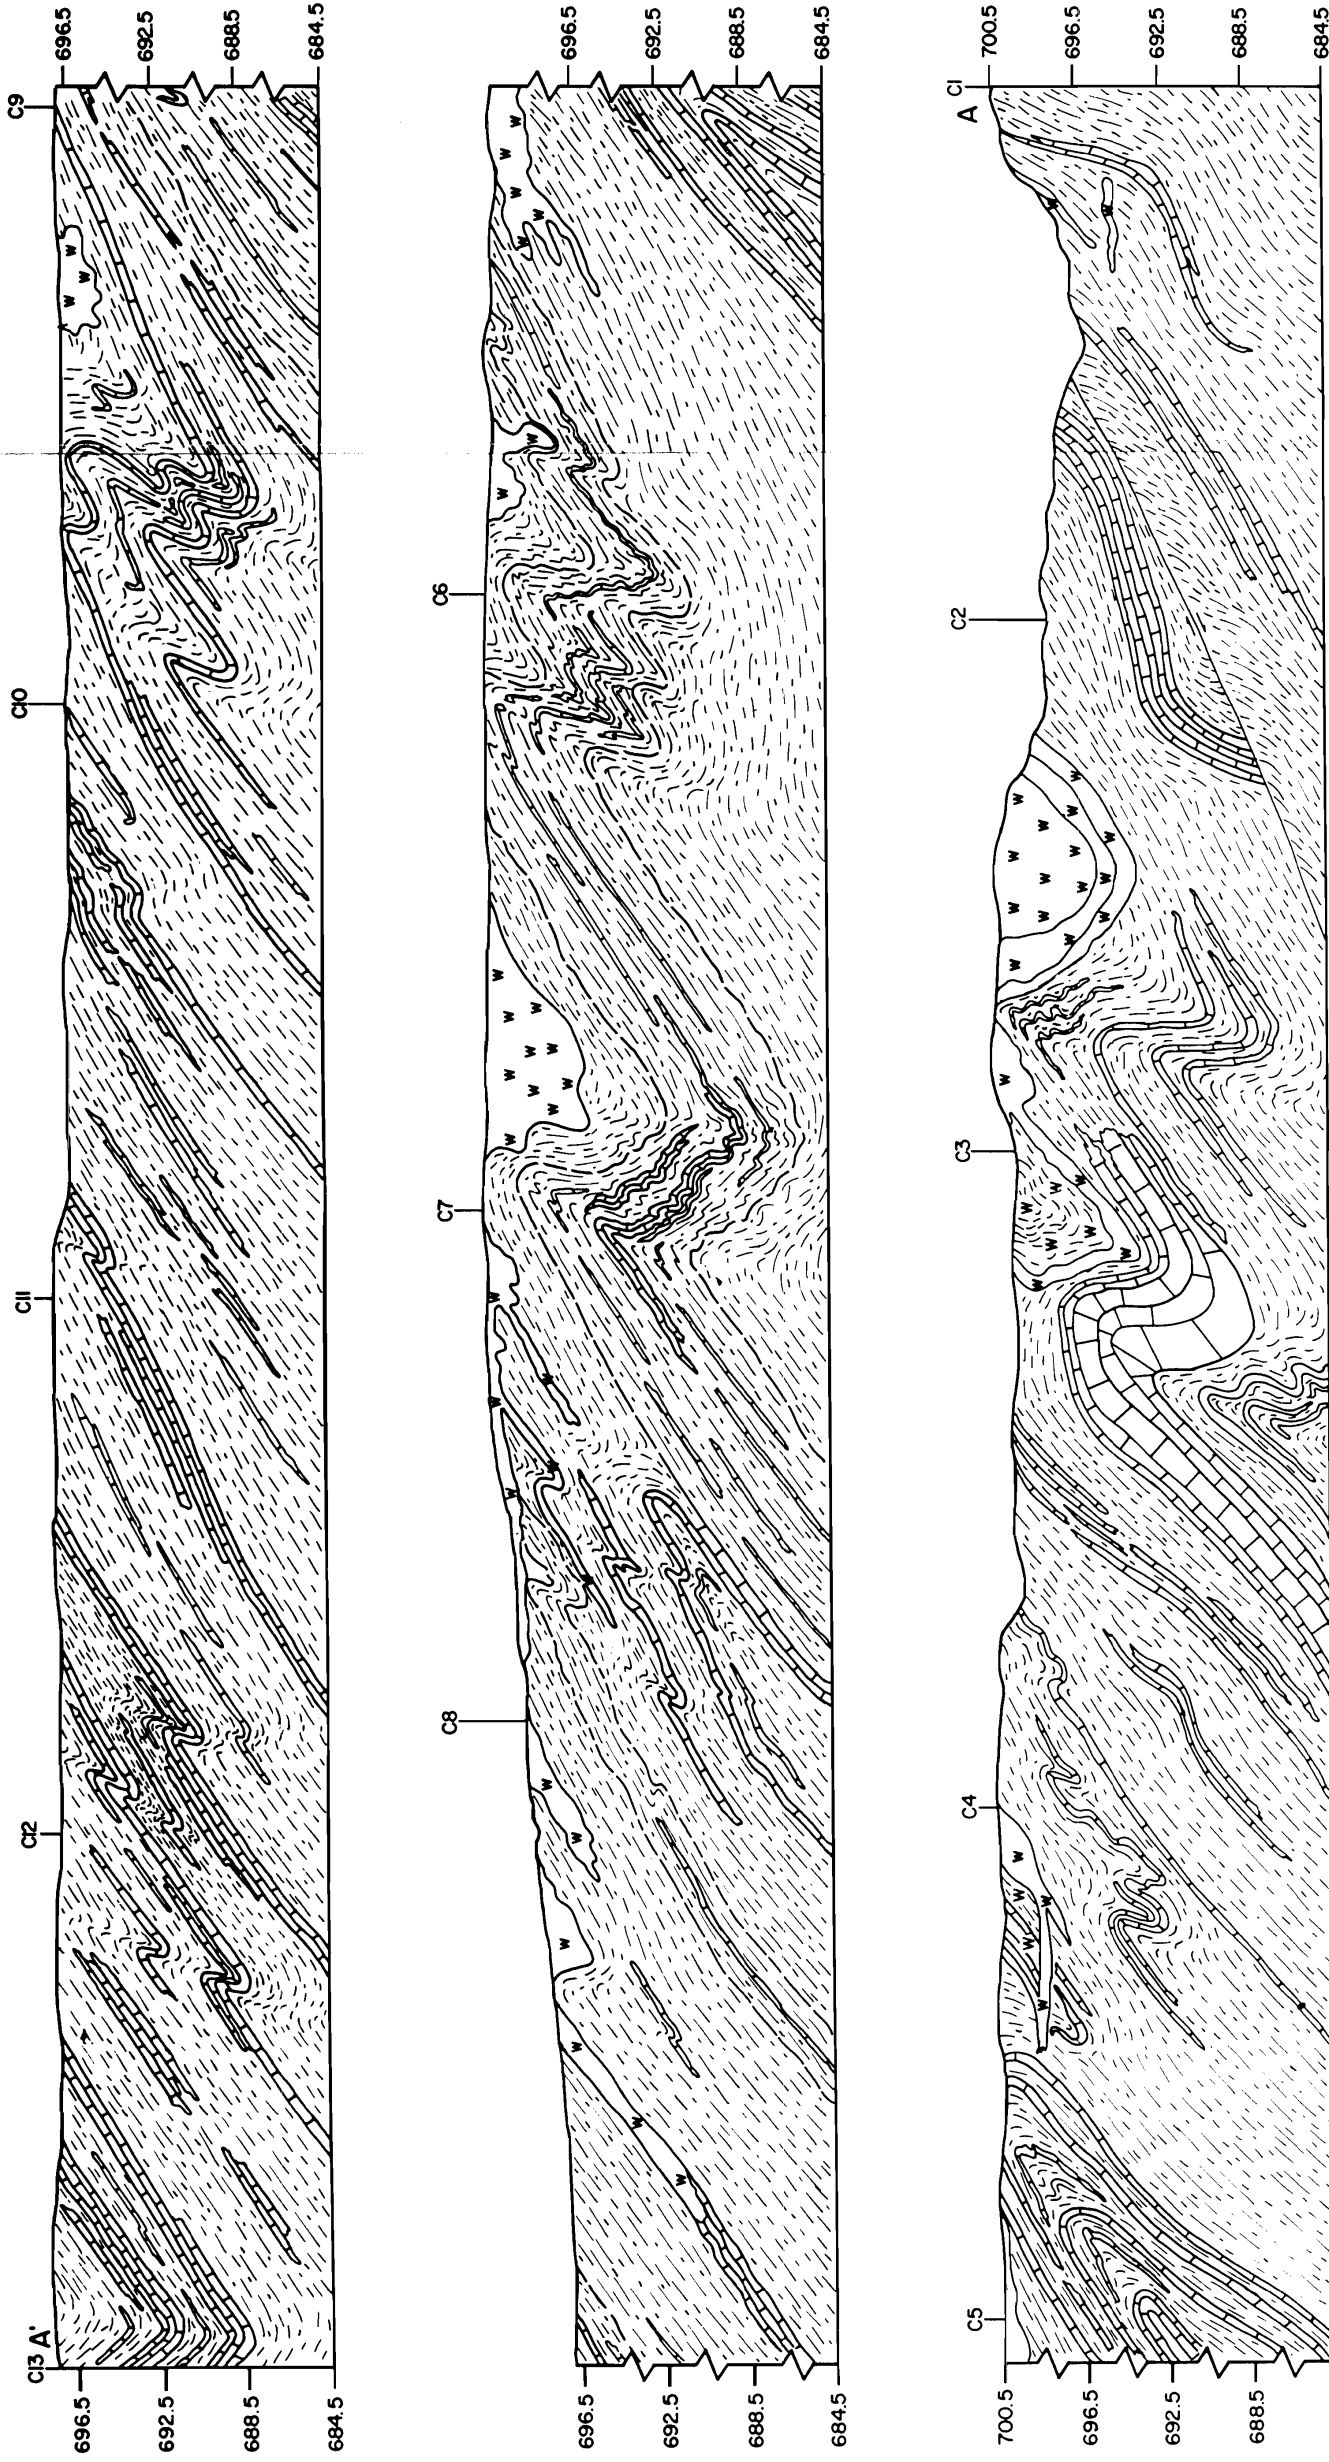

KEY PLAN

LEGEND

- THRUST FAULT
- LIMESTONE - FINE- TO COARSE-GRAINED, WHITE TO DARK GREY TO PINK, THIN, MEDIUM TO MASSIVE BEDDED, SOME BEDS GLAUCONITIC AND/OR ARGILLACEOUS.
- SHALE - VARIOLORED RED, GREY, GREEN AND PURPLE, FISSILE, CALCAREOUS SHALE WHICH FREQUENTLY IS TIGHTLY FOLDED, CRUMPLED, CONTORTED AND BOUNDED BY SLICKENSIDED SURFACES.
- WEATHERED - SLAKED, OR WEATHERED SHALE, WEATHERED GLAUCONITIC LIMESTONE AND/OR CLAY, REMOVED PRIOR TO EMPLOYMENT OF PROTECTIVE

NOTES:

1. All rock in excavation identified as lower Conasauga Formation of Middle Cambrian age.
2. Due to the complexly folded and contorted characteristics of the foundation rock, the geologic sections have been simplified considerably.
3. This section viewed south.

SCALE:

8 Feet

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

GEOLOGIC SECTION ALONG
N LINE FROM C1 TO C13

Figure 2.5-113

Figure 2.5-113 Geologic Section Along N Line From C1 To C13



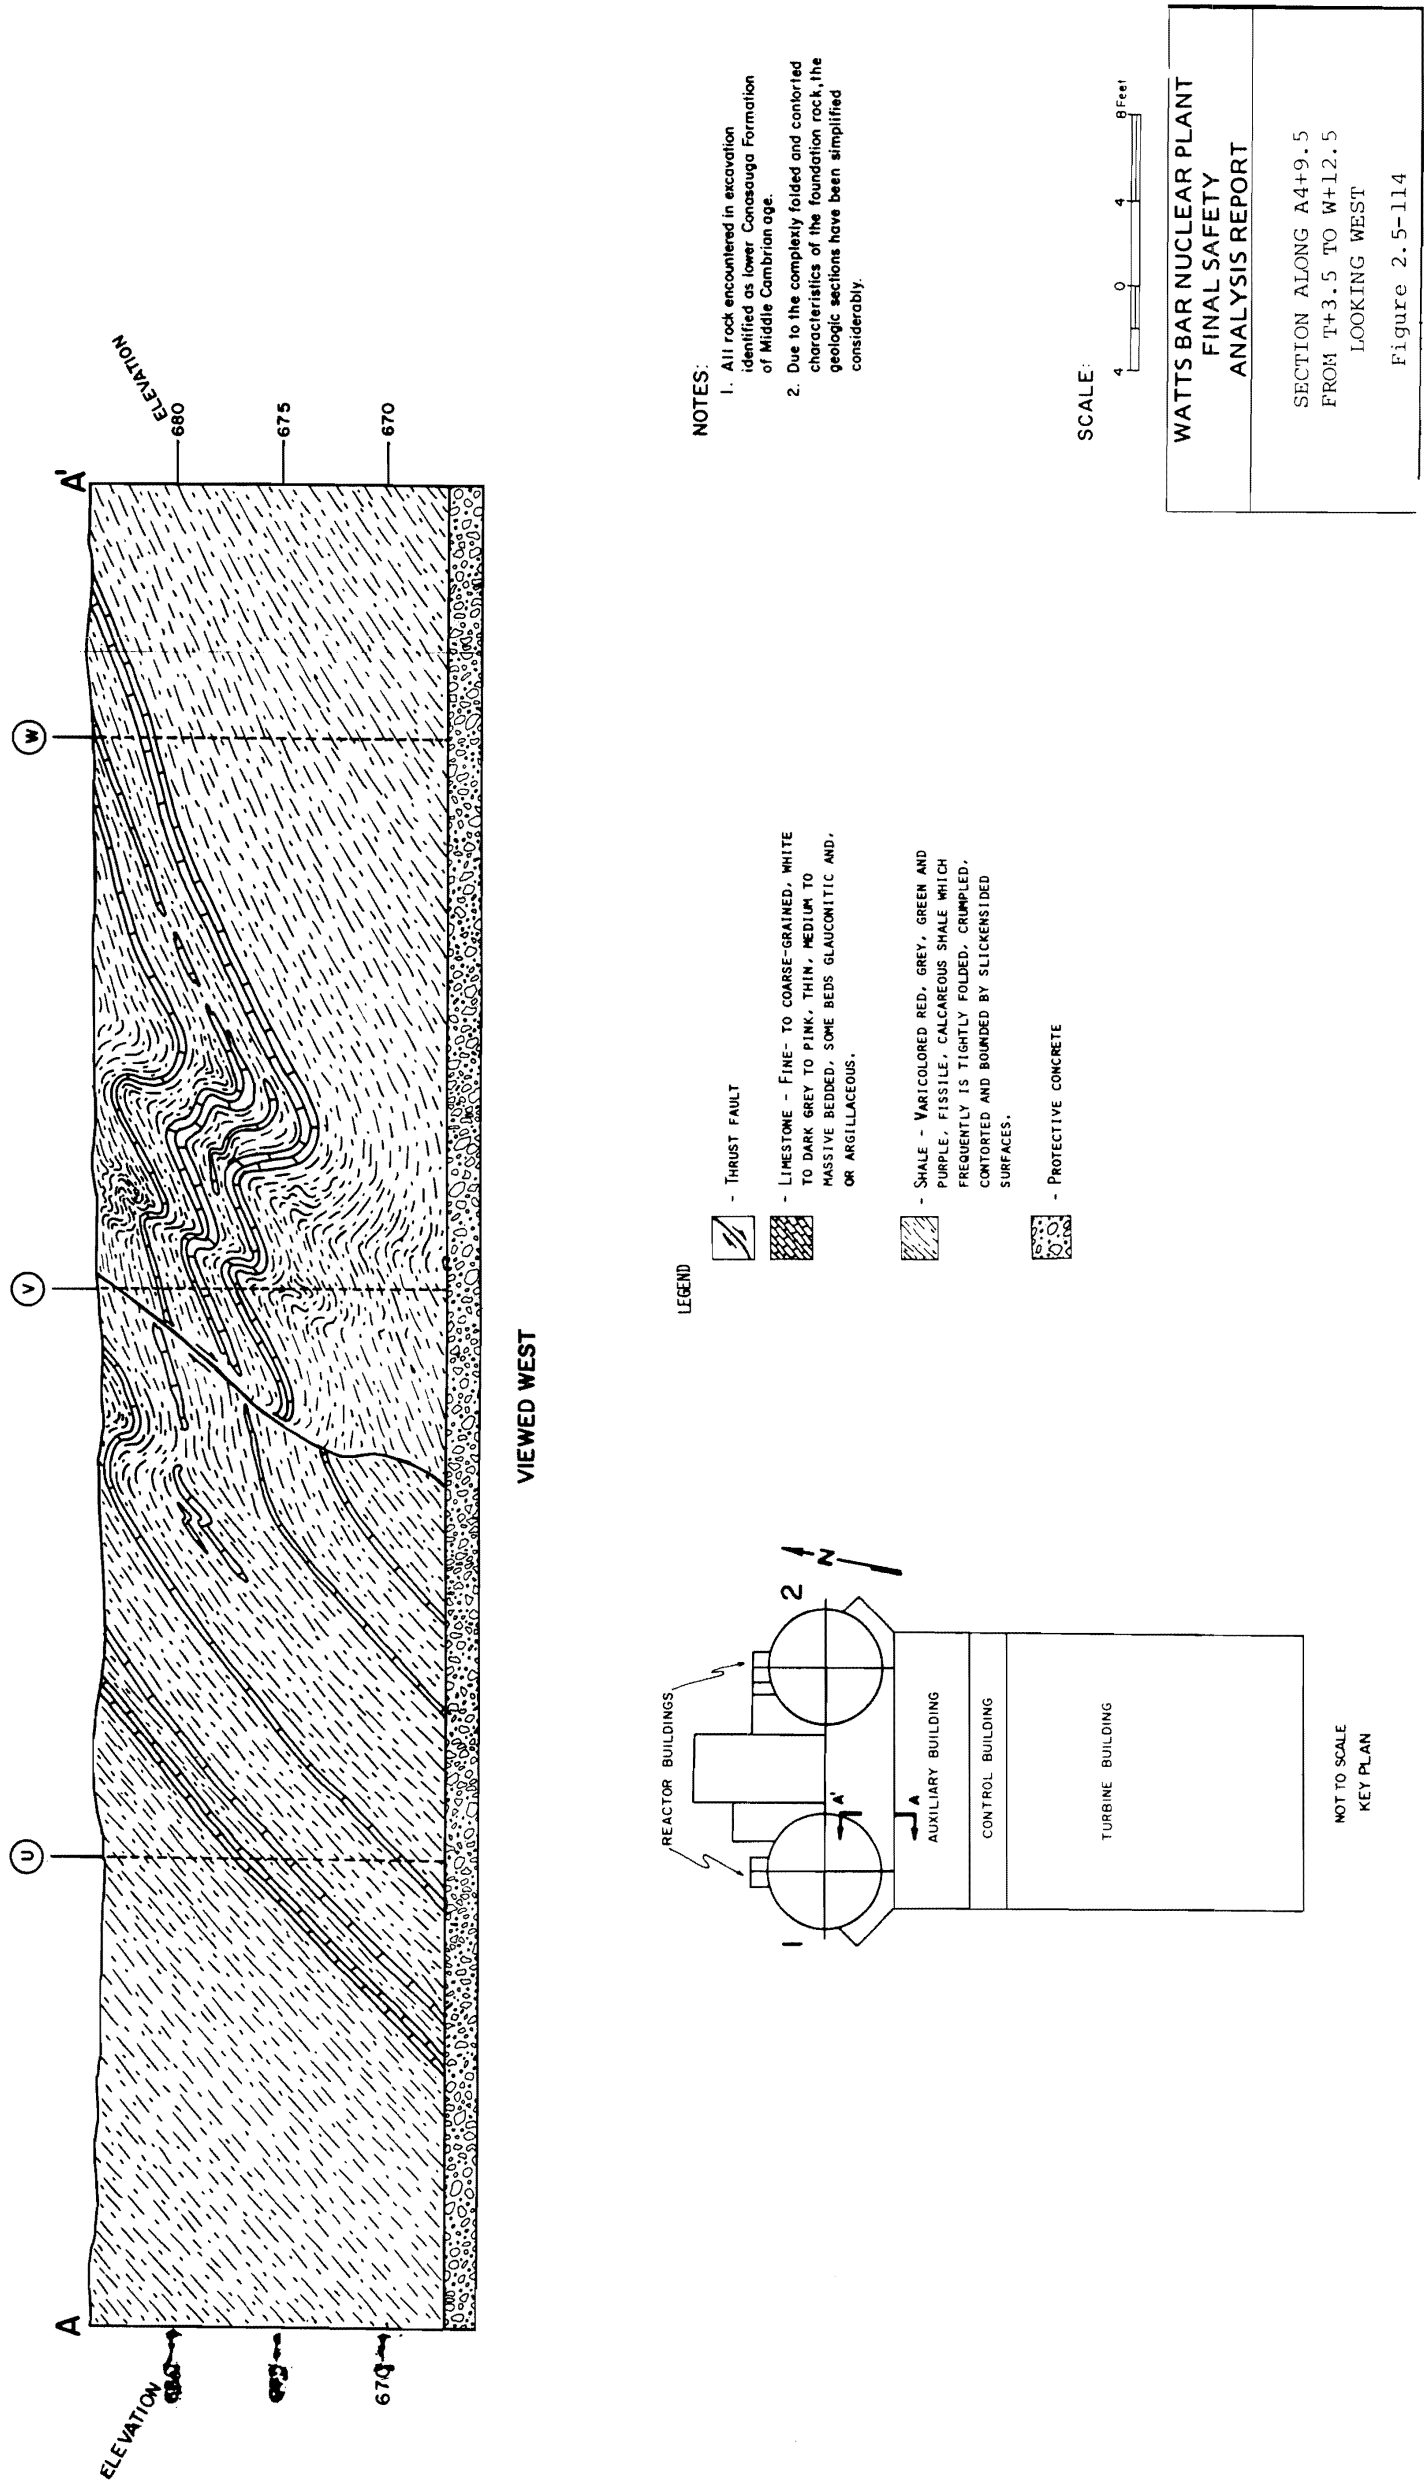


Figure 2.5-114 Section Along A4+9.5 From T+3.5 To W+12.5

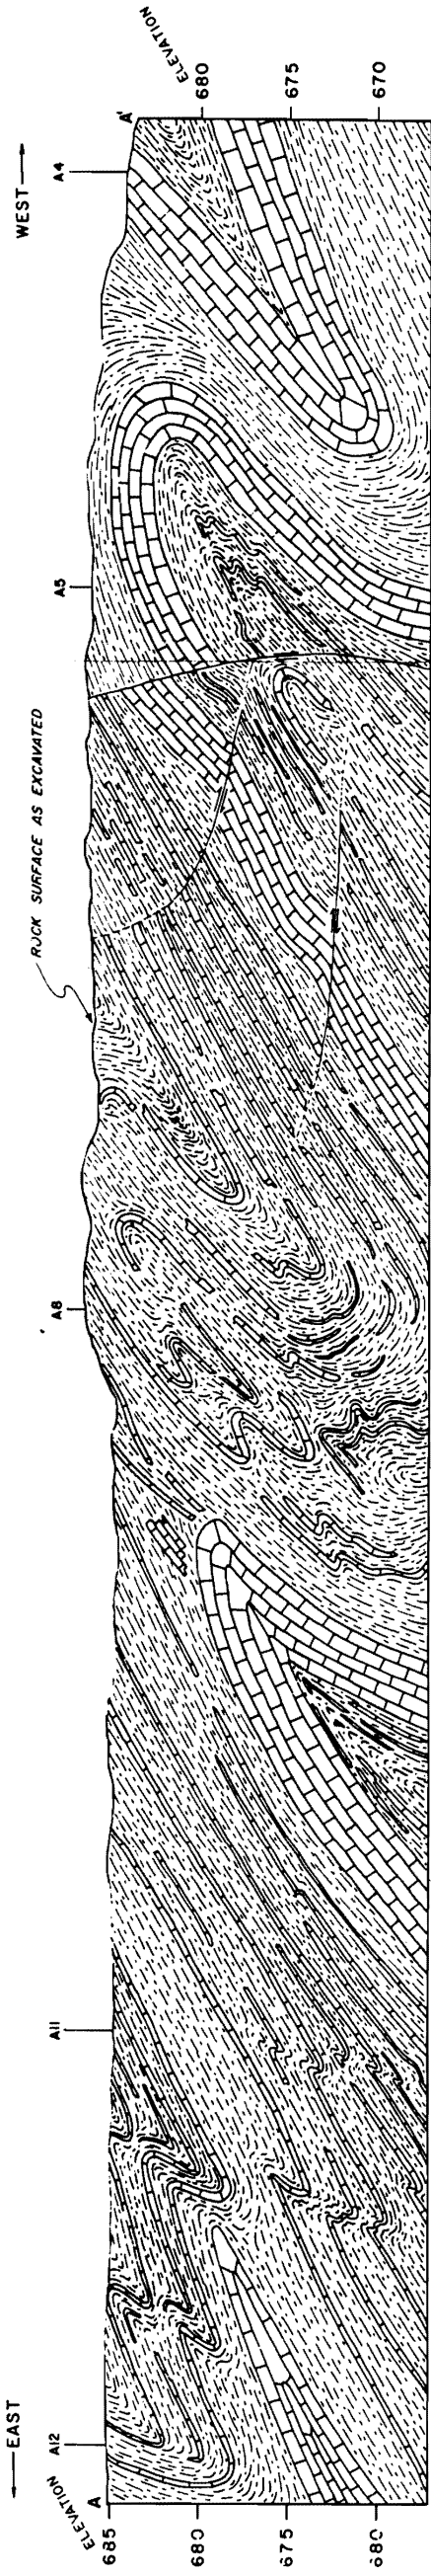

VIEWED SOUTH

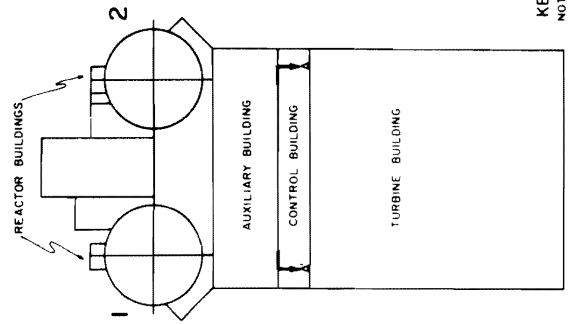

KEY PLAN
NOT TO SCALE

LEGEND

- THRUST FAULT
- LIMESTONE - FINE- TO COARSE-GRAINED, WHITE TO DARK GREY TO PINK, THIN, MEDIUM TO MASSIVE BEDDED, SOME BEDS GLAUCONITIC AND/OR ARGILLACEOUS.
- SHALE - VARICOLORED RED, GREY, GREEN AND PURPLE, FISSILE, CALCAREOUS SHALE WHICH FREQUENTLY IS TIGHTLY FOLDED, CRUMPLED, CONTORTED AND BOUNDED BY SLICKENSIDED SURFACES.

NOTES:

1. All rock encountered in excavation identified as Lower Cambrian Formation of Middle Cambrian age.
2. Due to complexly folded and contorted characteristics of the foundation rock, the geologic sections have been simplified considerably.

SCALE:





WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT


GEOLOGIC SECTION AND
PANORAMIC PHOTOGRAPH
Q-4 LINE FROM A4-3 TO A12+3

Figure 2.5-115

Figure 2.5-115 Geologic Section and Panoramic Photograph Q-4 Line From A4-3 To A12+3

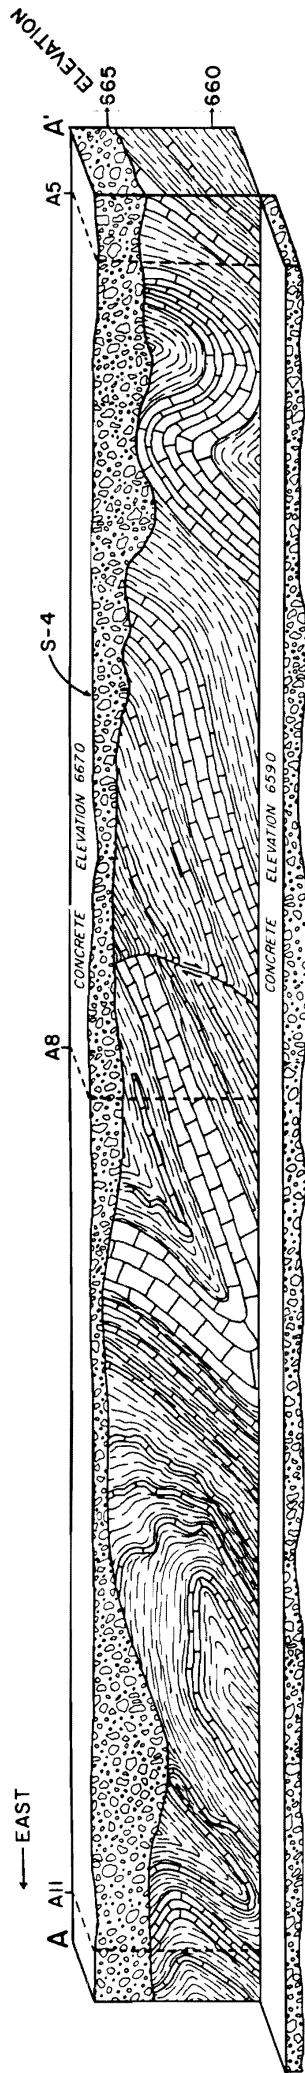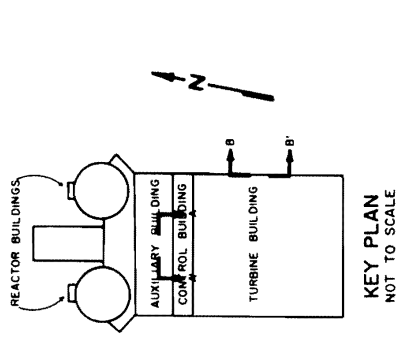

SECTION ALONG S-4
LOOKING SOUTH

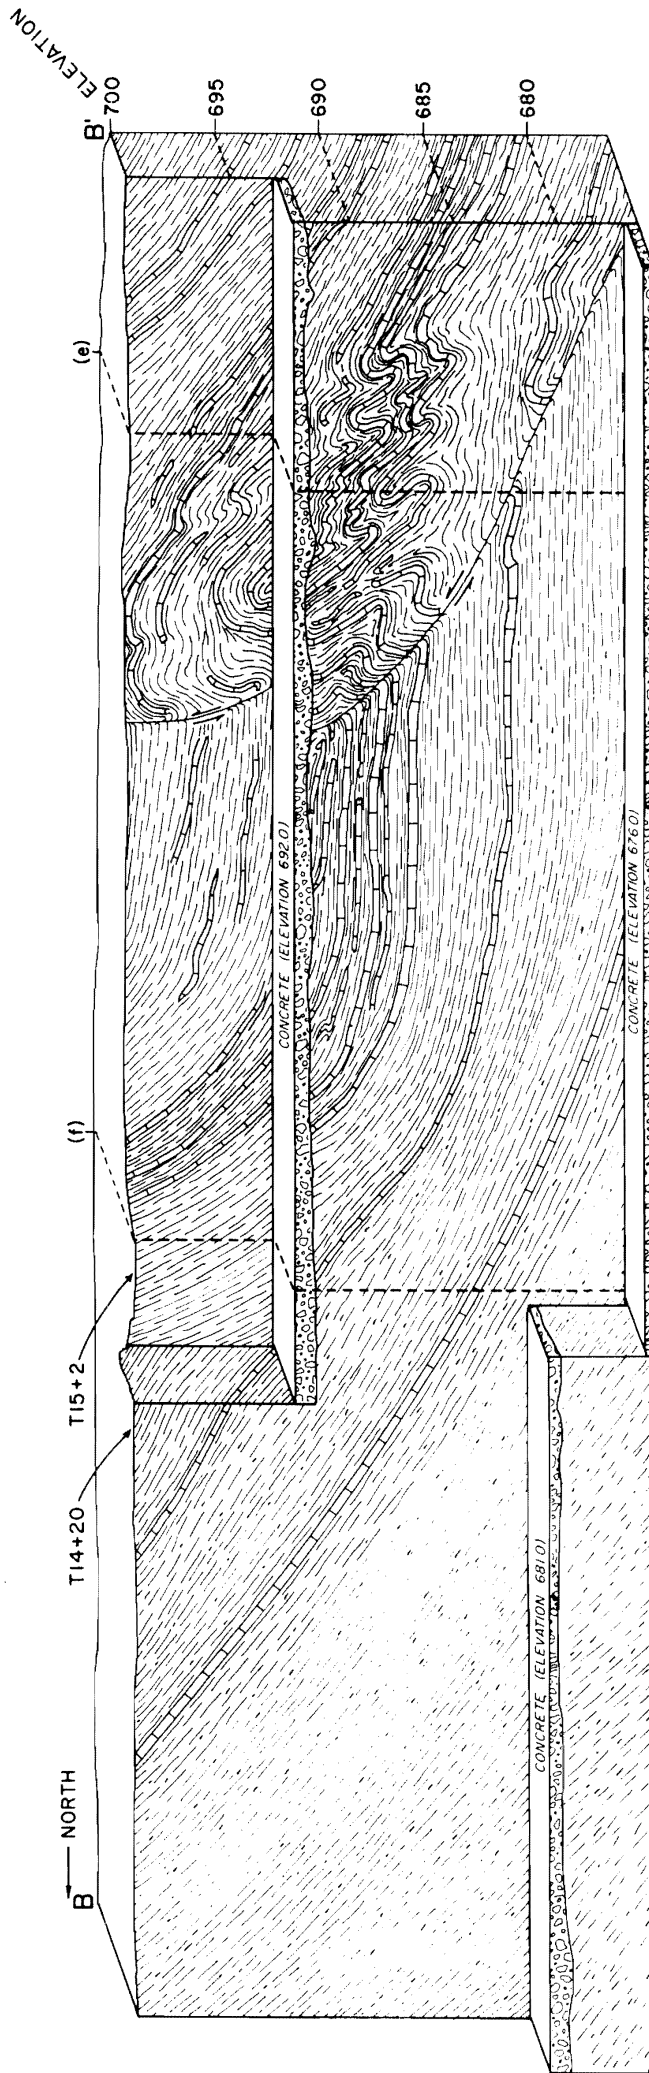

SECTION ALONG T14+20 & T15+2
LOOKING EAST

- LEGEND
- THRUST FAULT
 - LIMESTONE - FINE- TO COARSE-GRAINED, WHITE TO DARK GREY TO PINK, THIN, MEDIUM TO MASSIVE BEDDED, SOME BEDS GLAUCONITIC AND/OR ARGILLACEOUS.
 - SHALE - VARIOLORED RED, GREY, GREEN AND PURPLE, FISSILE, CALCAREOUS SHALE WHICH FREQUENTLY IS TIGHTLY FOLDED, CRUMPLED, CONTORTED AND BOUNDED BY SLICKENSIDED SURFACES.
 - PROTECTIVE CONCRETE



NOTES:

1. All rock encountered in excavation identified as lower Conasauga Formation of Middle Cambrian age.
2. Due to the complexly folded and contorted characteristics of the foundation rock, the geologic sections have been simplified.

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
GEOLOGIC SECTIONS AUXILIARY AND TURBINE BUILDINGS
Figure 2.5-116

Figure 2.5-116 Geologic Sections Auxiliary And Turbine Buildings






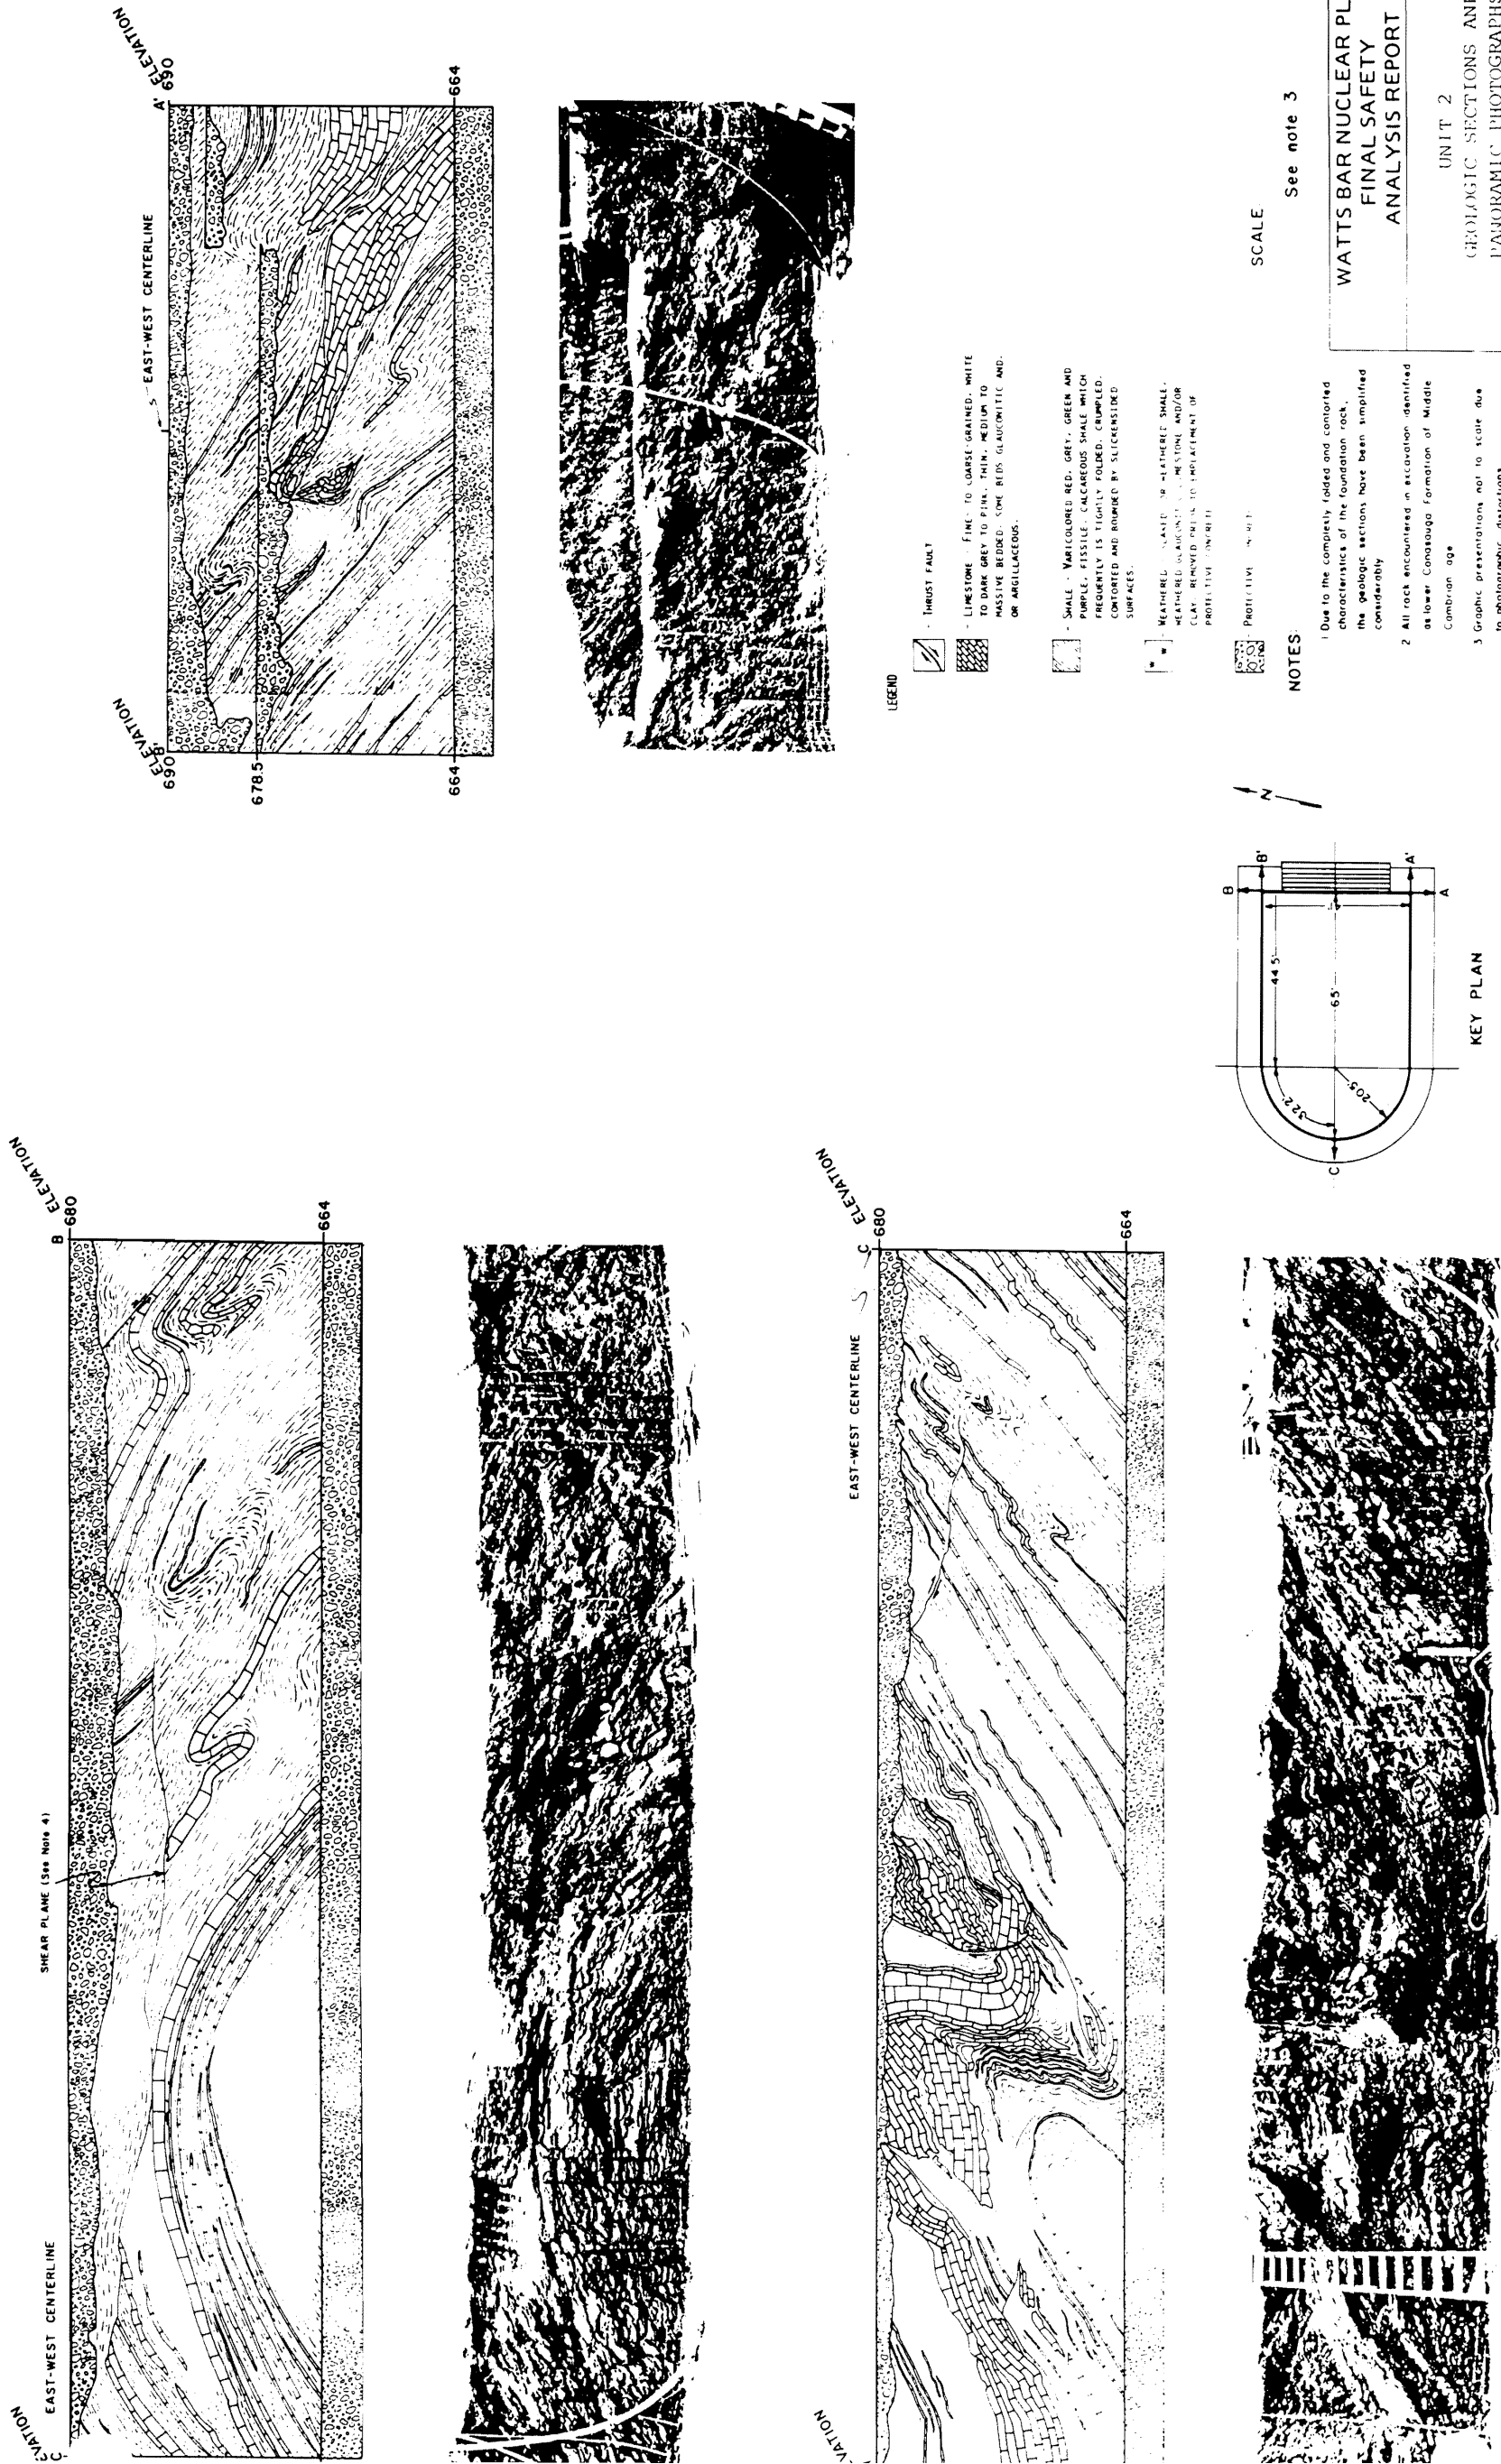


Figure 2.5-117 Geologic Sections And Panoramic Photographs (Unit 2)

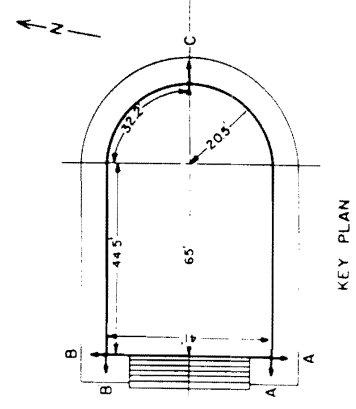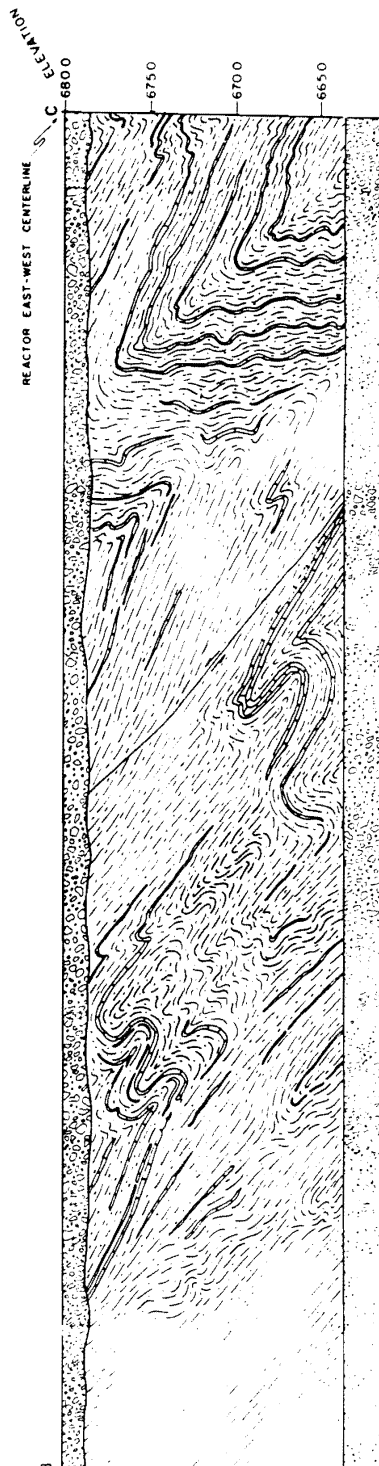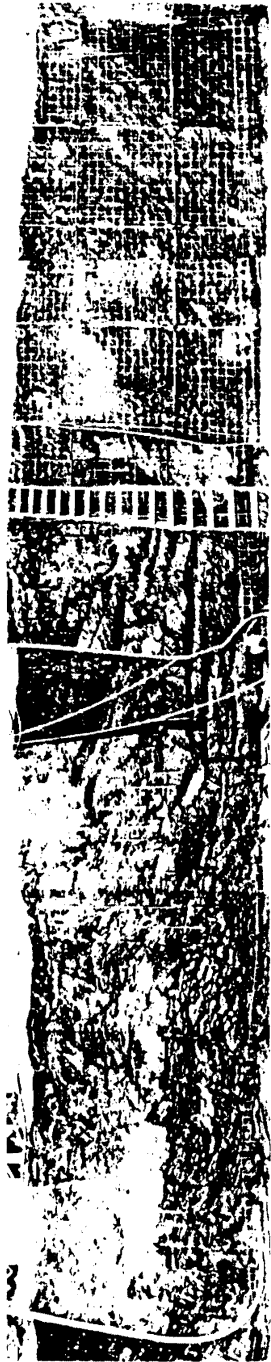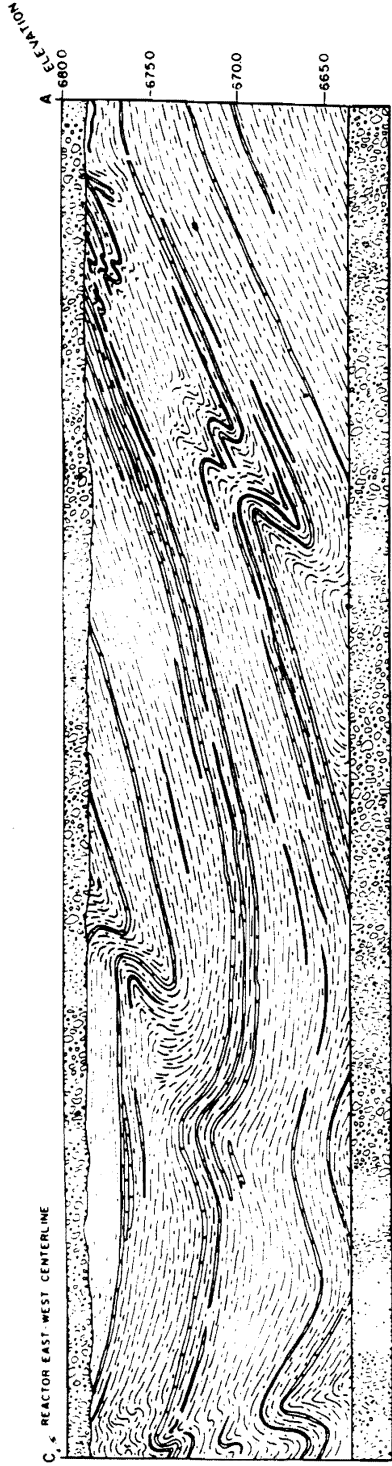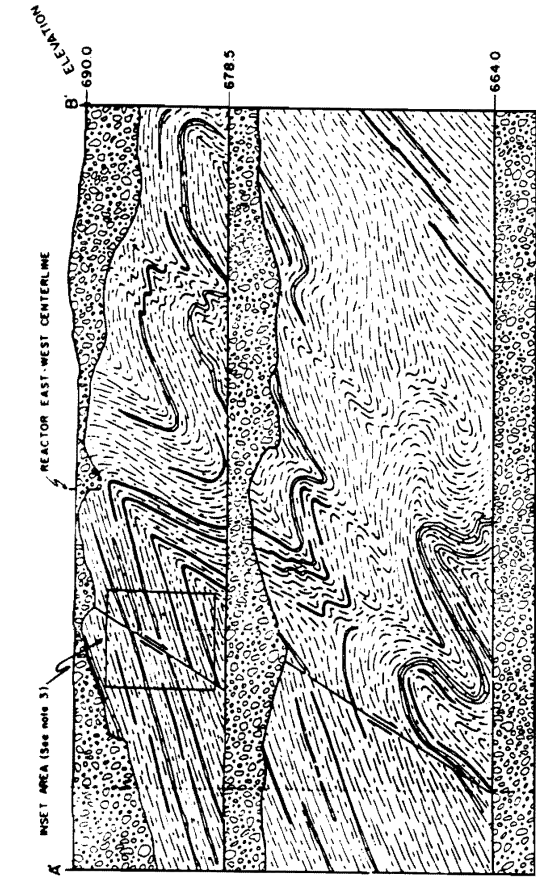



NOTES

- 1 Due to the completely folded and contorted characteristics of the foundation rock, the geologic sections have been simplified considerably.
- 2 Graphic presentations not to scale due to photographic distortions.
- 3 See closeup photograph of inset area (Photograph # 4486-1).
- 4 All rock encountered in excavation identified as Lower Cambrian Formation of Middle Cambrian age.

SCALE See note 3


<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>UNIT 1 GEOLOGIC SECTIONS AND PANORAMIC PHOTOGRAPHS</p>
<p>Figure 2.5-118</p>

Figure 2.5-118 Geologic Sections And Panoramic Photographs (Unit 1)

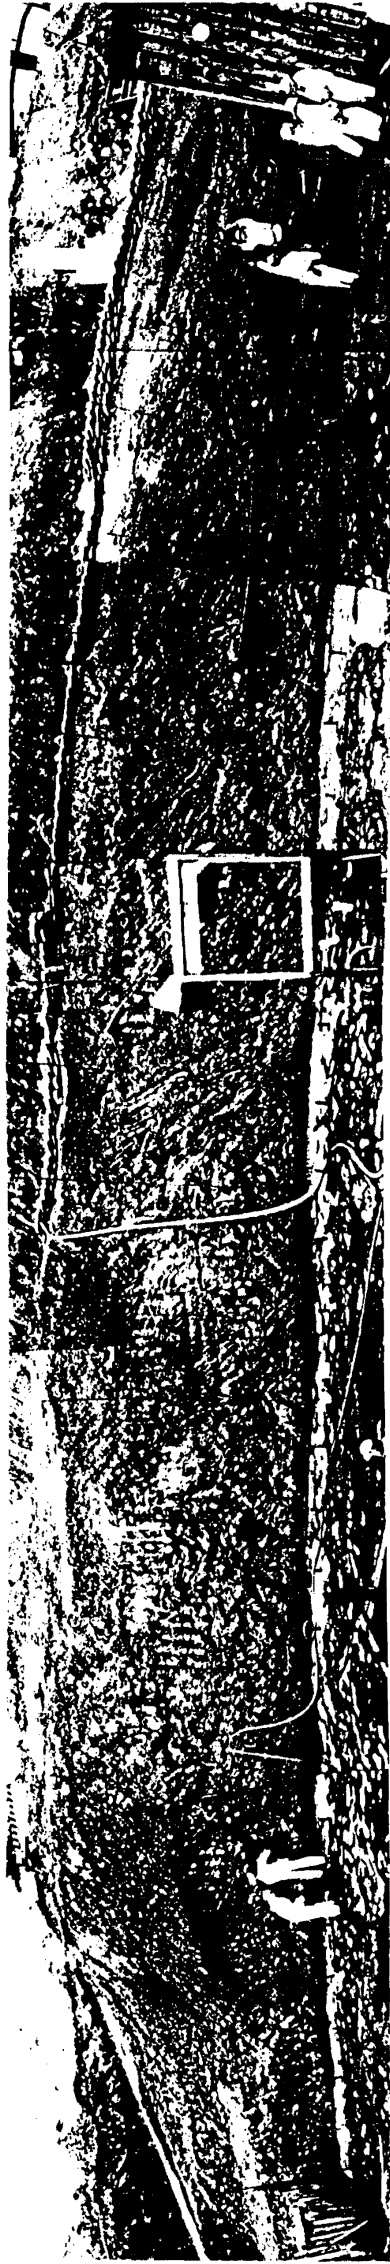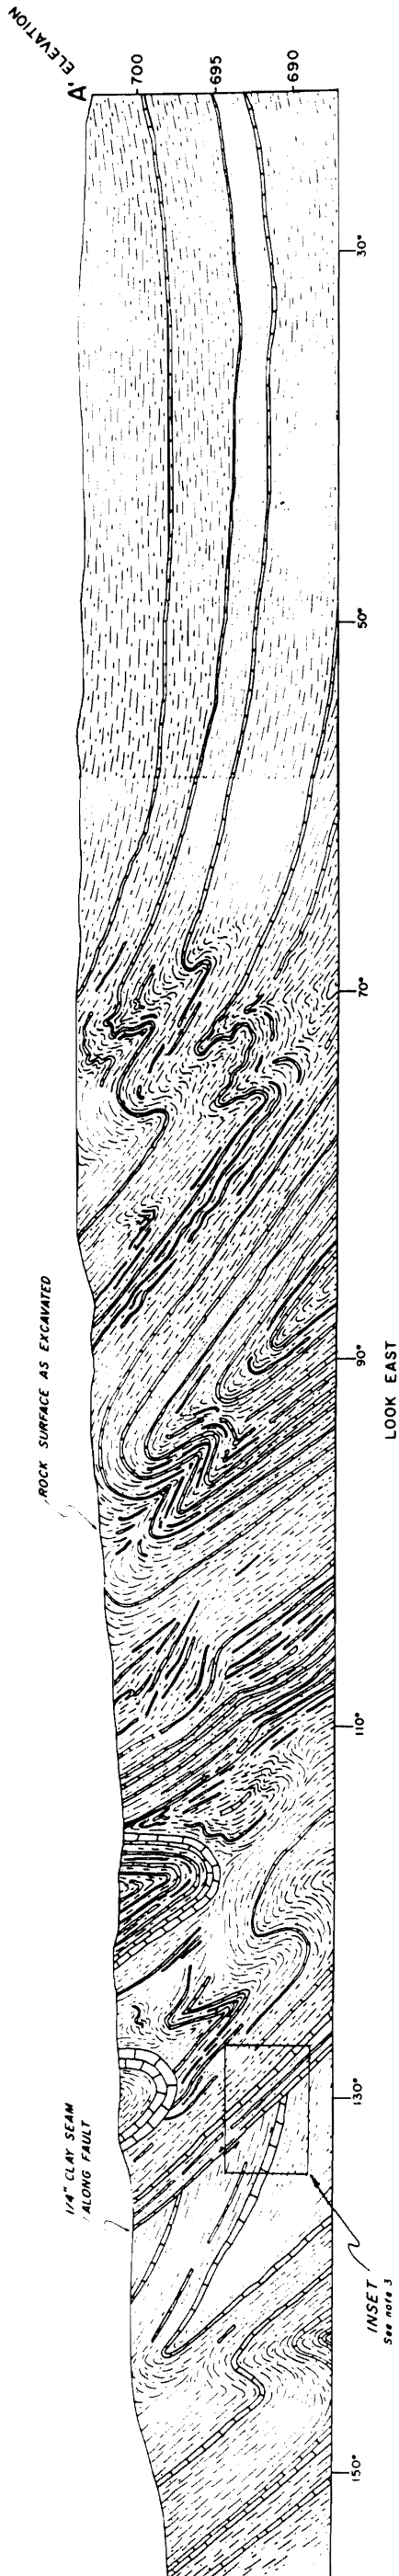

- NOTES:
- 1 All rock encountered in excavation identified as Cambrian age (photograph # 90863E)
 - 2 Due to the completely folded and contorted characteristics of the foundation rock, the geologic sections have been simplified.
 - 3 See closeup photograph of inset area (photograph # 90863E)

- LEGEND
- THRUST FAULT
 - LIMESTONE - FINE- TO COARSE-GRAINED, WHITE TO DARK GREY TO PINK, THIN, MEDIUM TO MASSIVE BEDDED, SOME BEDS GLAUCONITIC AND/OR ARGILLACEOUS.
 - SHALE - VARI-COLORED RED, GREY, GREEN AND PURPLE, FISSILE, CALCAREOUS SHALE WHICH FREQUENTLY IS TIGHTLY FOLDED, CRUMPLED, CONTORTED AND BOUNDED BY SLICKENSIDED SURFACES.

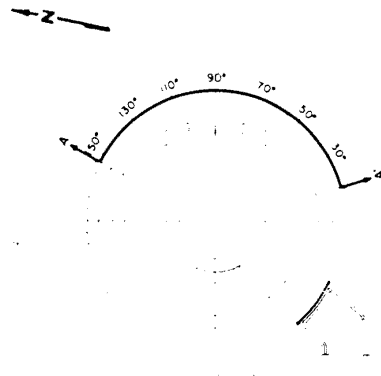

SCALE 1" = 10' FEET

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

GEOLOGIC SECTION AND PANORAMIC
PHOTOGRAPH OF REACTOR 2
EAST PERIMETER WALL

Figure 2.5-119

Figure 2.5-119 Geologic Sections and Panoramic Photographs of Reactor 2 East Perimeter Wall

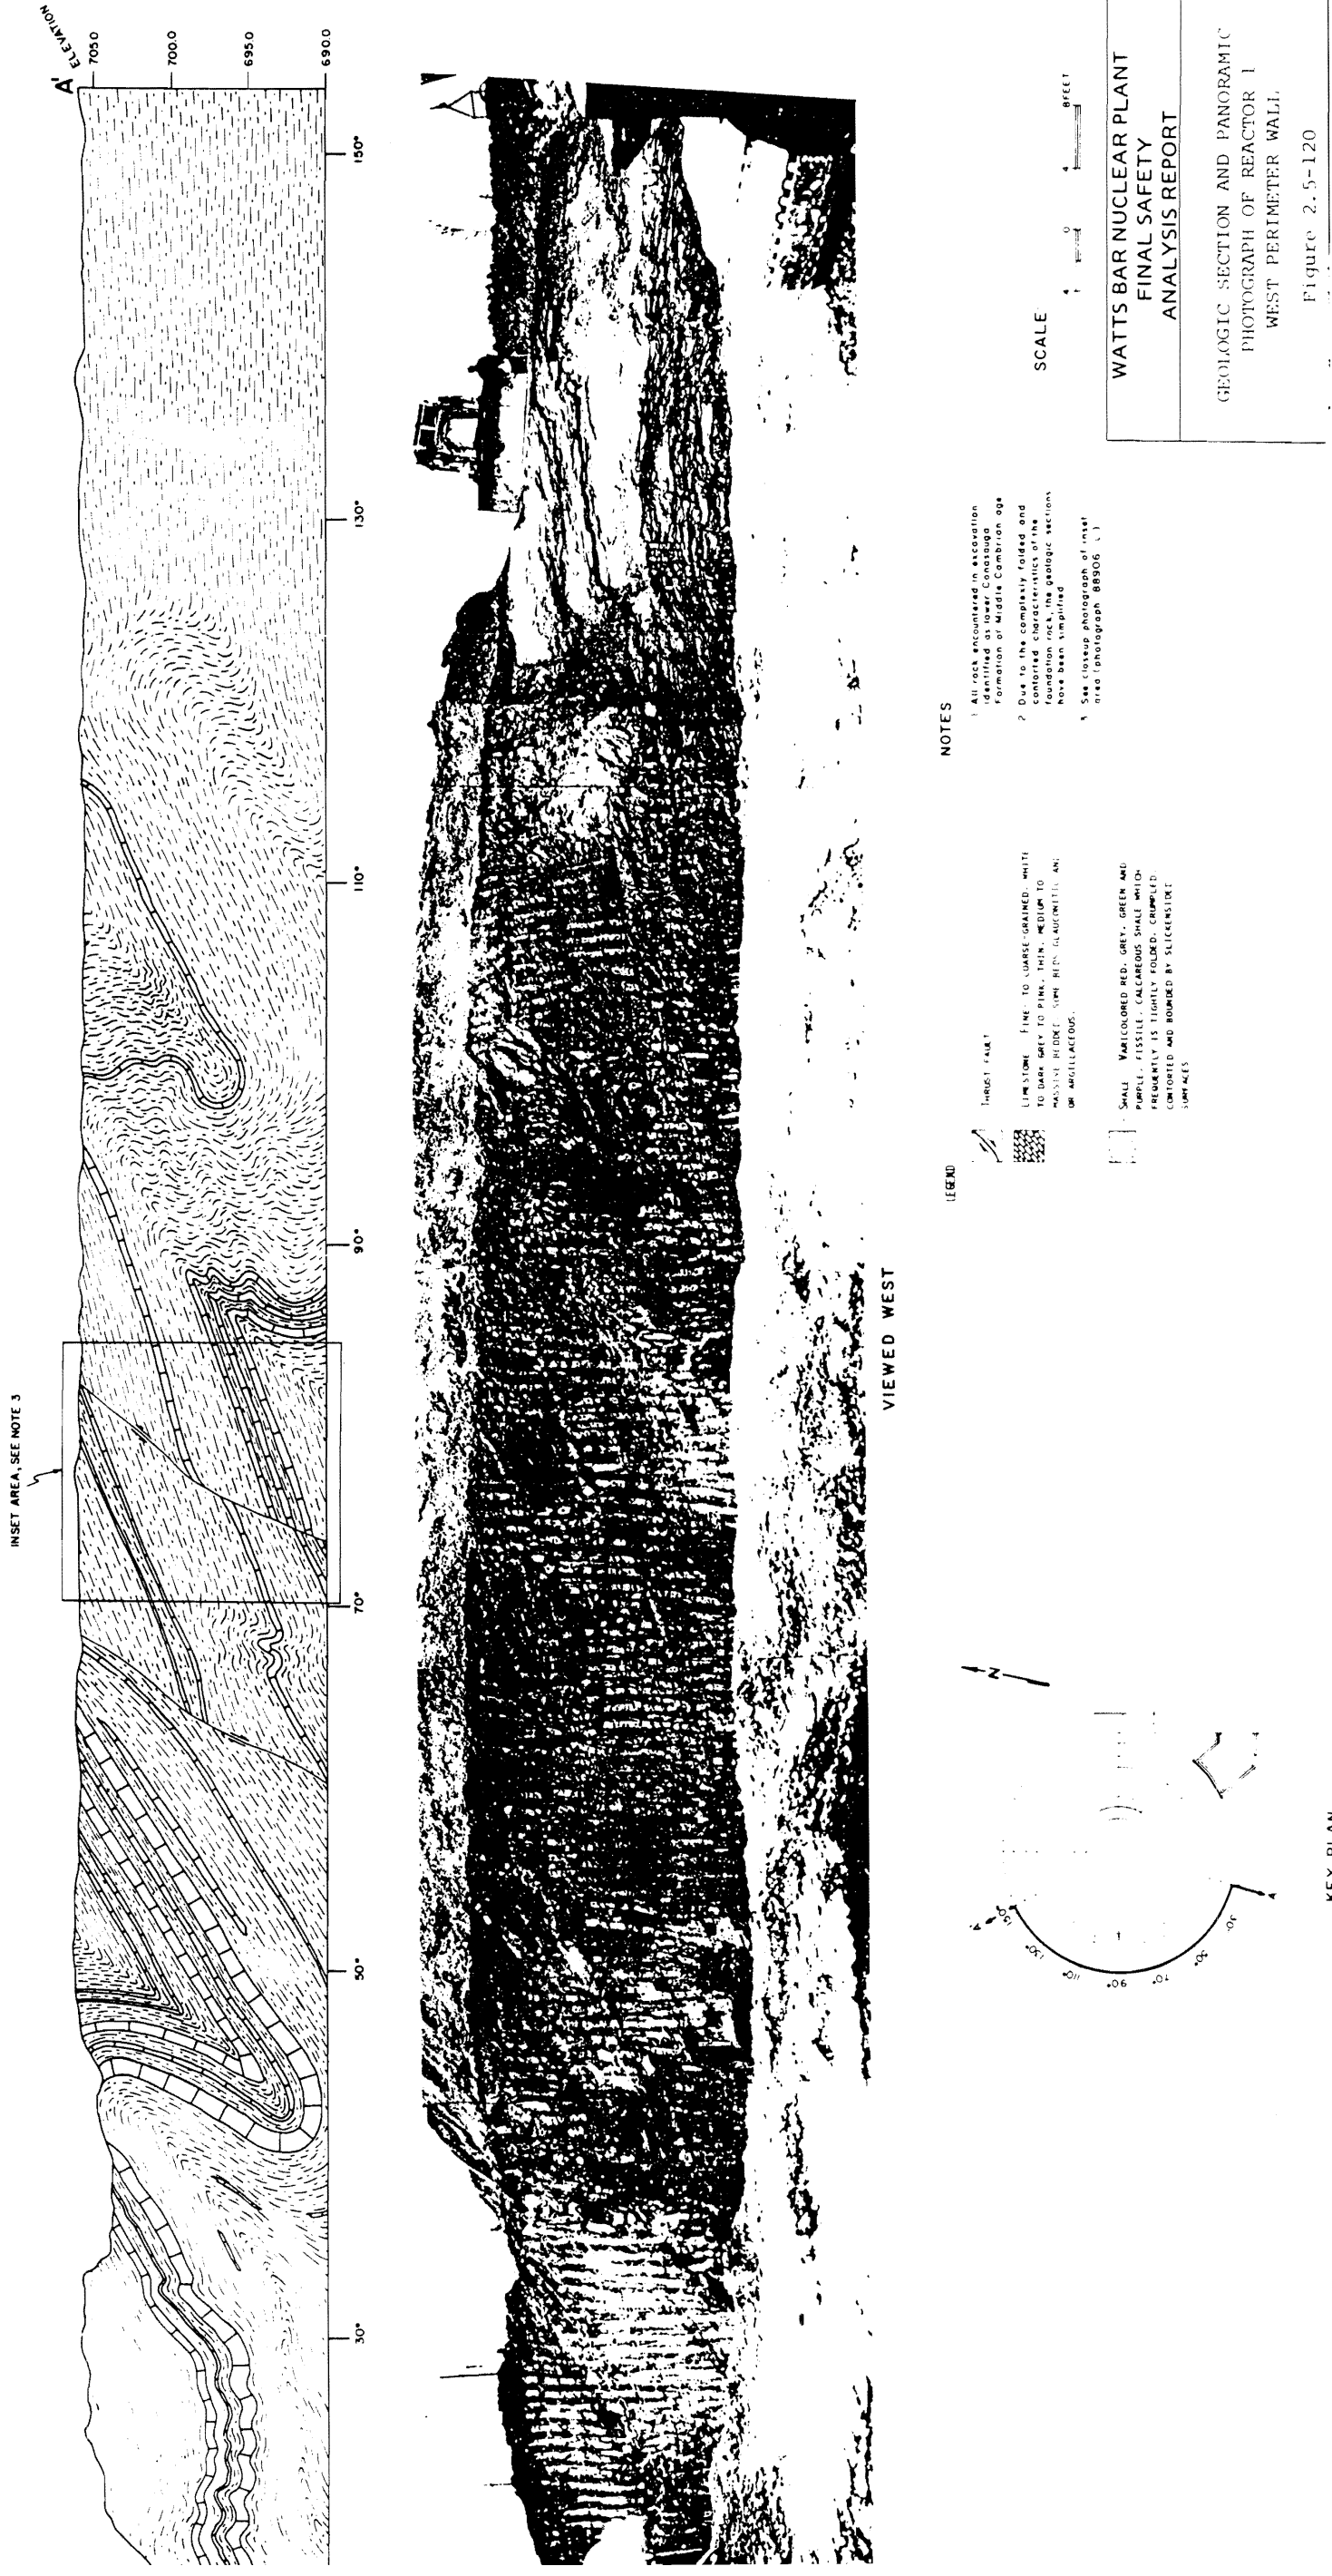


Figure 2.5-120 Geologic Section and Panoramic Photograph of Reactor 1 West Perimeter Wall


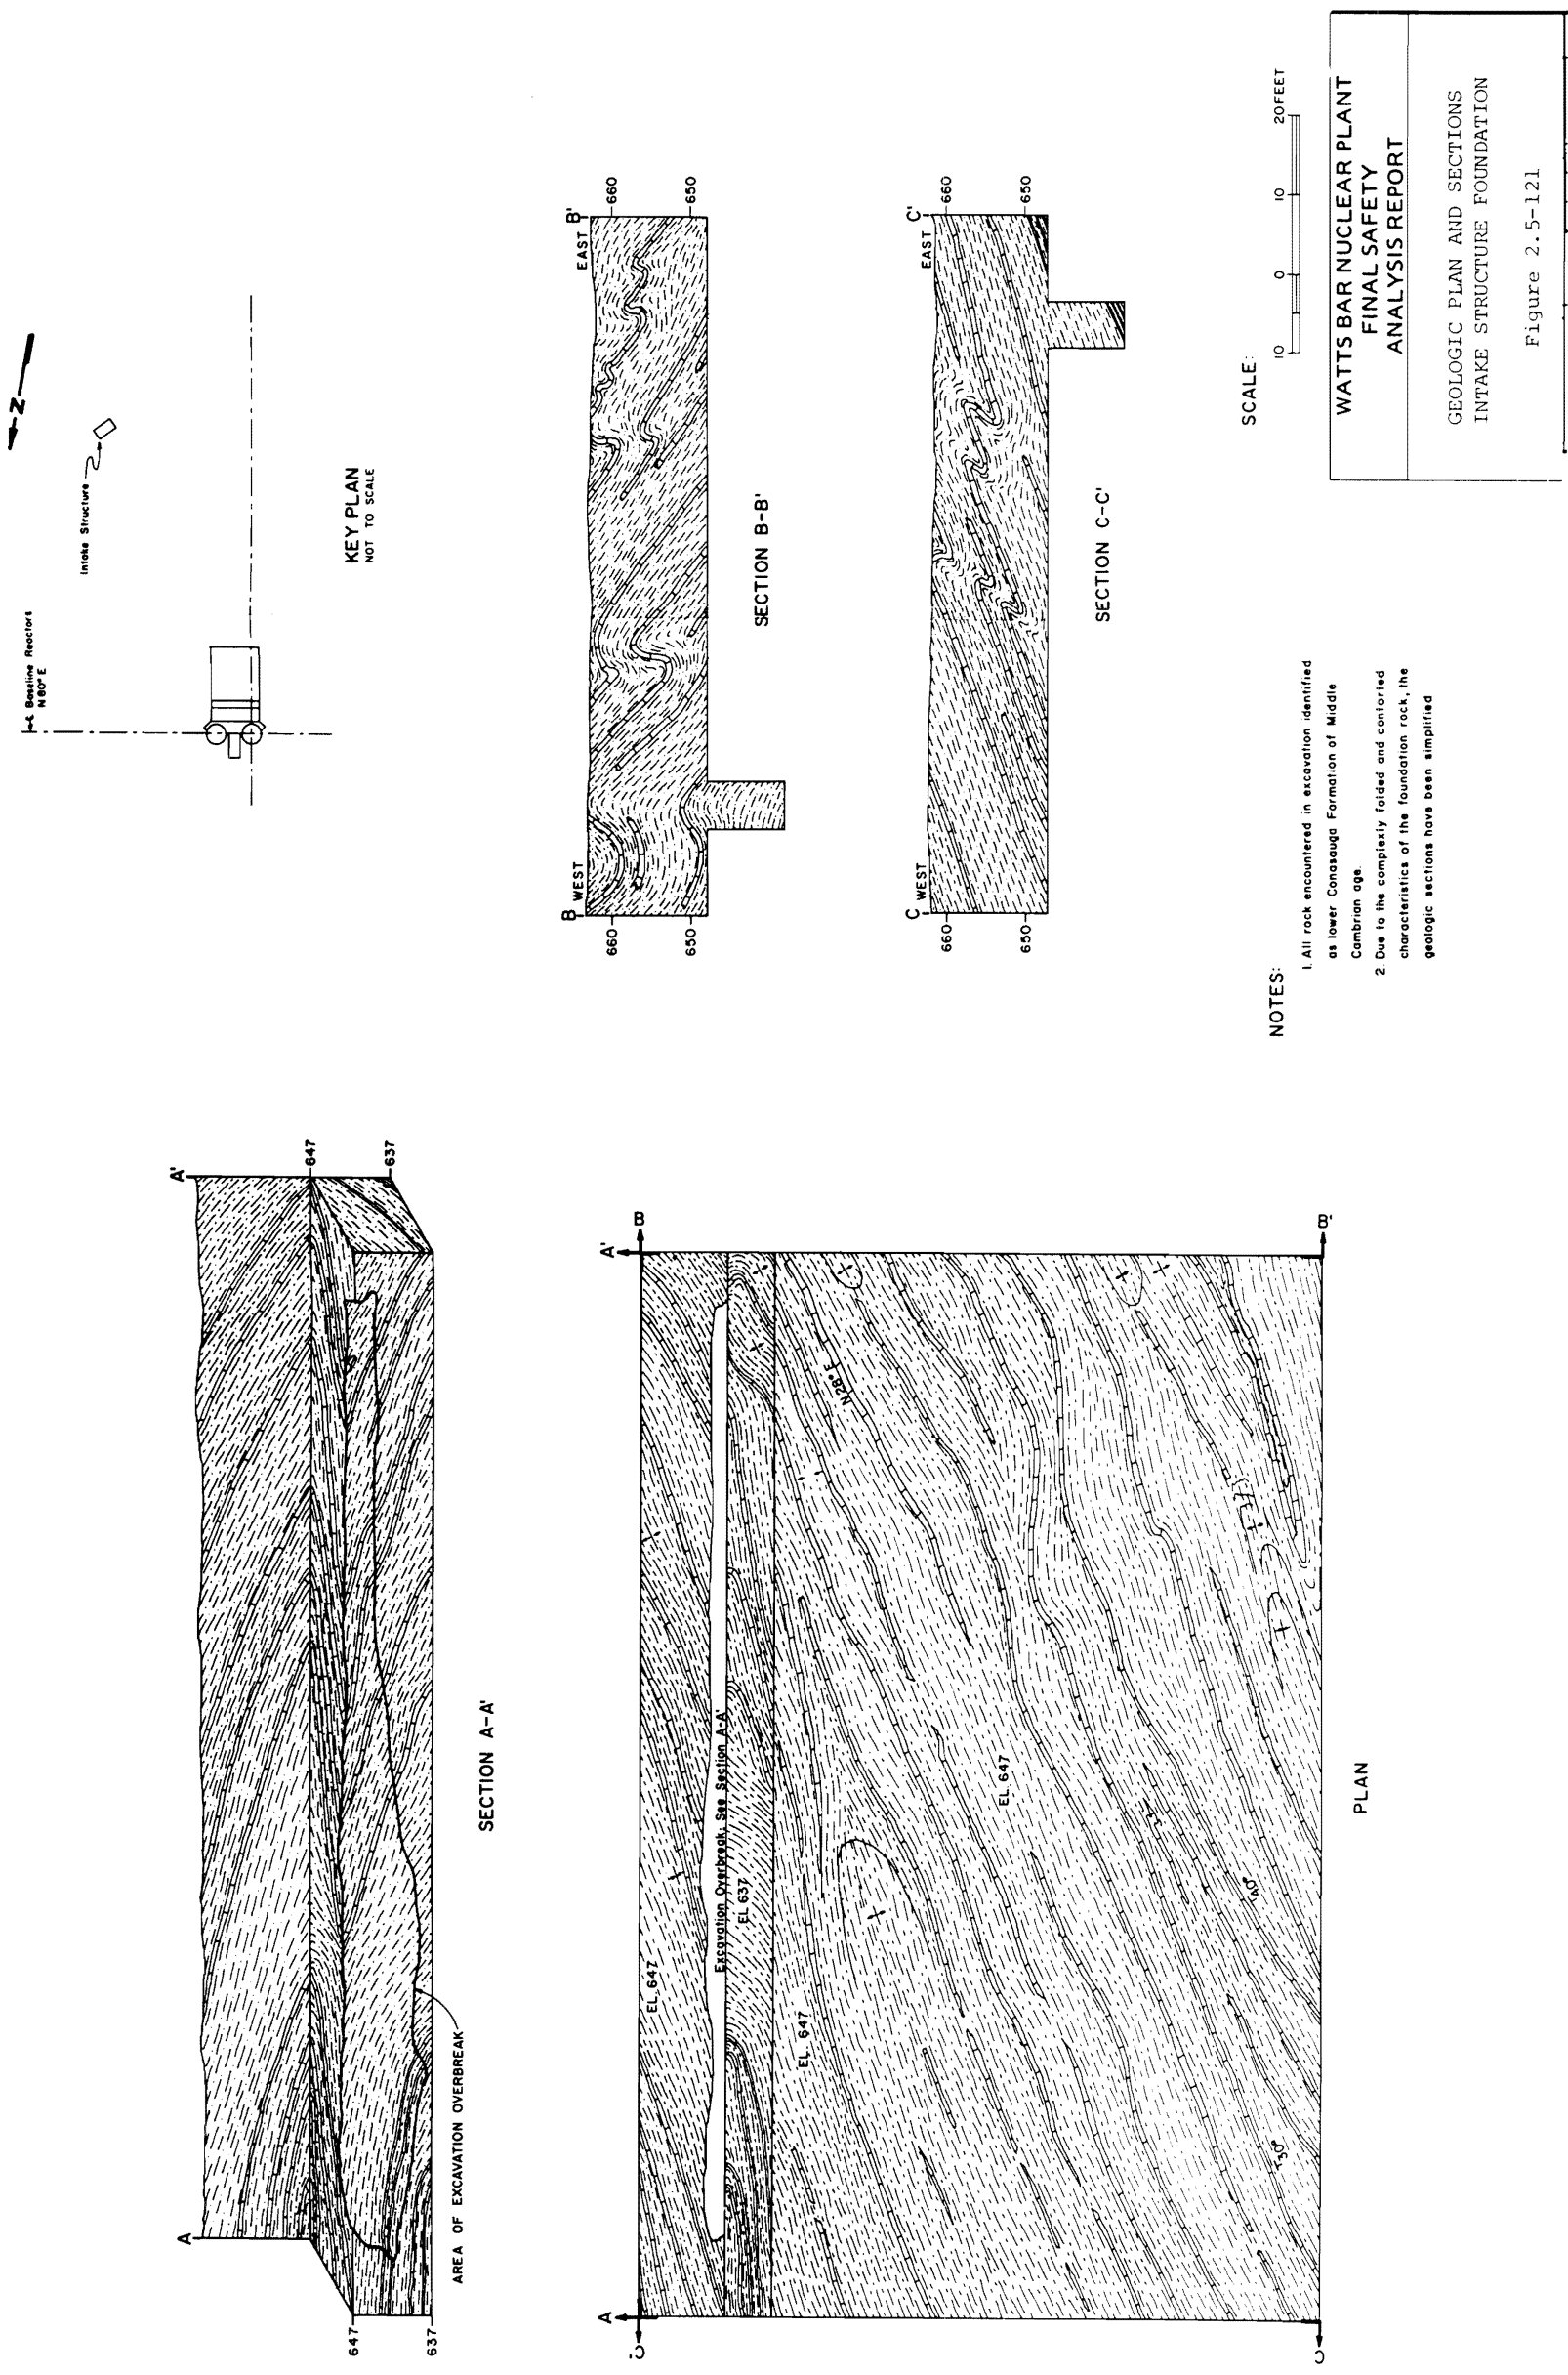


Figure 2.5-121 Geologic Plan And Sections Intake Structure Foundation

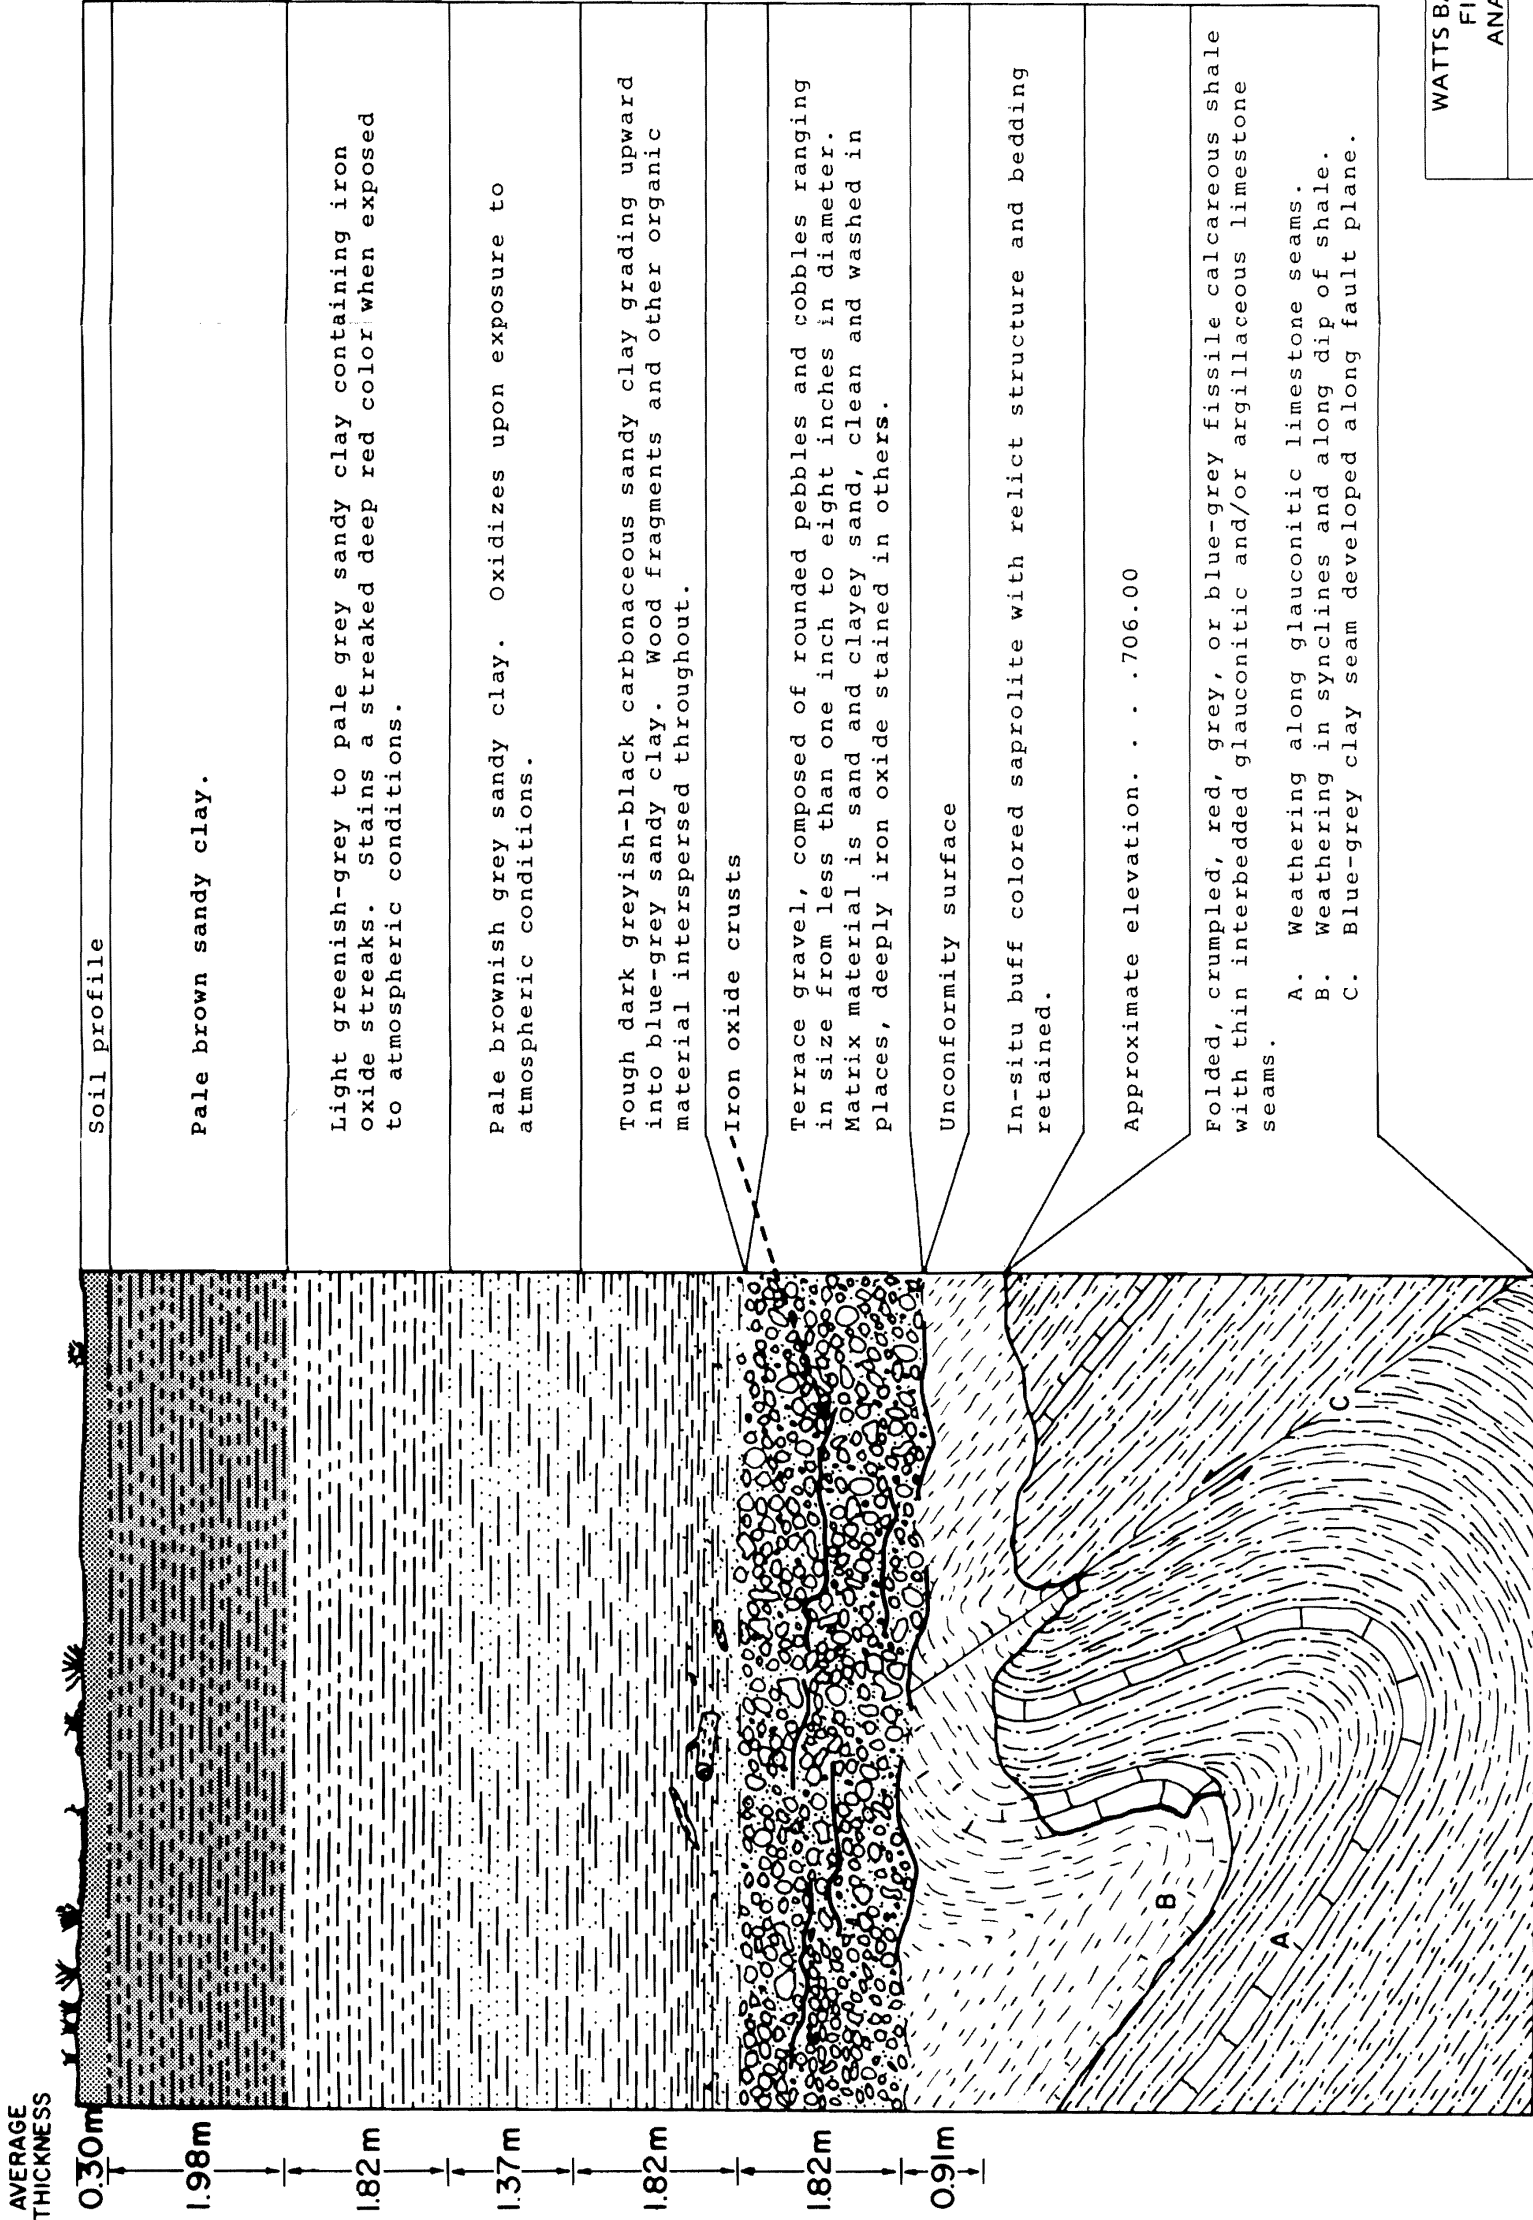

Soil profile

Pale brown sandy clay.

Light greenish-grey to pale grey sandy clay containing iron oxide streaks. Stains a streaked deep red color when exposed to atmospheric conditions.

Pale brownish grey sandy clay. Oxidizes upon exposure to atmospheric conditions.

Tough dark greyish-black carbonaceous sandy clay grading upward into blue-grey sandy clay. Wood fragments and other organic material interspersed throughout.

Iron oxide crusts

Terrace gravel, composed of rounded pebbles and cobbles ranging in size from less than one inch to eight inches in diameter. Matrix material is sand and clayey sand, clean and washed in places, deeply iron oxide stained in others.

Unconformity surface

In-situ buff colored saprolite with relict structure and bedding retained.

Approximate elevation. . . .706.00

Folded, crumpled, red, grey, or blue-grey fissile calcareous shale with thin interbedded glauconitic and/or argillaceous limestone seams.

A. Weathering along glauconitic limestone seams.
 B. Weathering in synclines and along dip of shale.
 C. Blue-grey clay seam developed along fault plane.

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

GENERALIZED GEOLOGIC SECTION
 AND SOIL PROFILE

Figure 2.5-122

Figure 2.5-122 Generalized Geologic Section And Soil Profile



Watts Bar Nuclear Plant
 Tennessee Valley Authority
 88902-F January 16, 1974
 Gary W. Krantz, Knoxville

Fault shown cutting across Auxiliary Building at A4+28 feet and east-west reactor center-line, through SE perimeter of Reactor #1, and into Auxiliary Building West Wall near U line. Viewed southwest.

Figure 2.5-123

Figure 2.5-123 Fault Shown Cutting Across Auxiliary Building at A4+28 Feet and East-West Reactor Centerline, Through SE Perimeter of Reactor #1, and Into Auxiliary Building West Wall Near U Line. Viewed Southwest.



Watts Bar Nuclear Plant
Tennessee Valley Authority
88906-H December 13, 1973
Gary W. Krantz, Knoxville

Fault in Auxiliary Building Wall, approximately 9 feet west of A5 and 6 feet south of east-west reactor centerline. Fault continues across SE perimeter of Reactor #1. Viewed southwest.

Figure 2.5-124

Figure 2.5-124 Fault In Auxiliary Building Wall, Approximately 9 Feet West Of A5 and 6 Feet South of East-West Reactor Centerline. Fault Continues Across SE Perimeter of Reactor #1. Viewed Southwest.




Watts Bar Nuclear Plant
Tennessee Valley Authority
90865-B March 7, 1974
Gary W. Krantz, Knoxville

Minor thrust fault and associated one-eighth inch clay seam located in east foundation cut at q line and C13+12 feet. Viewed east.

Figure 2.5-125

Figure 2.5-125 Minor Thrust Fault and Associated One-Eighth Inch Clay Seam Located In East Foundation Cut at Q Line and C13+12 Feet. Viewed East.

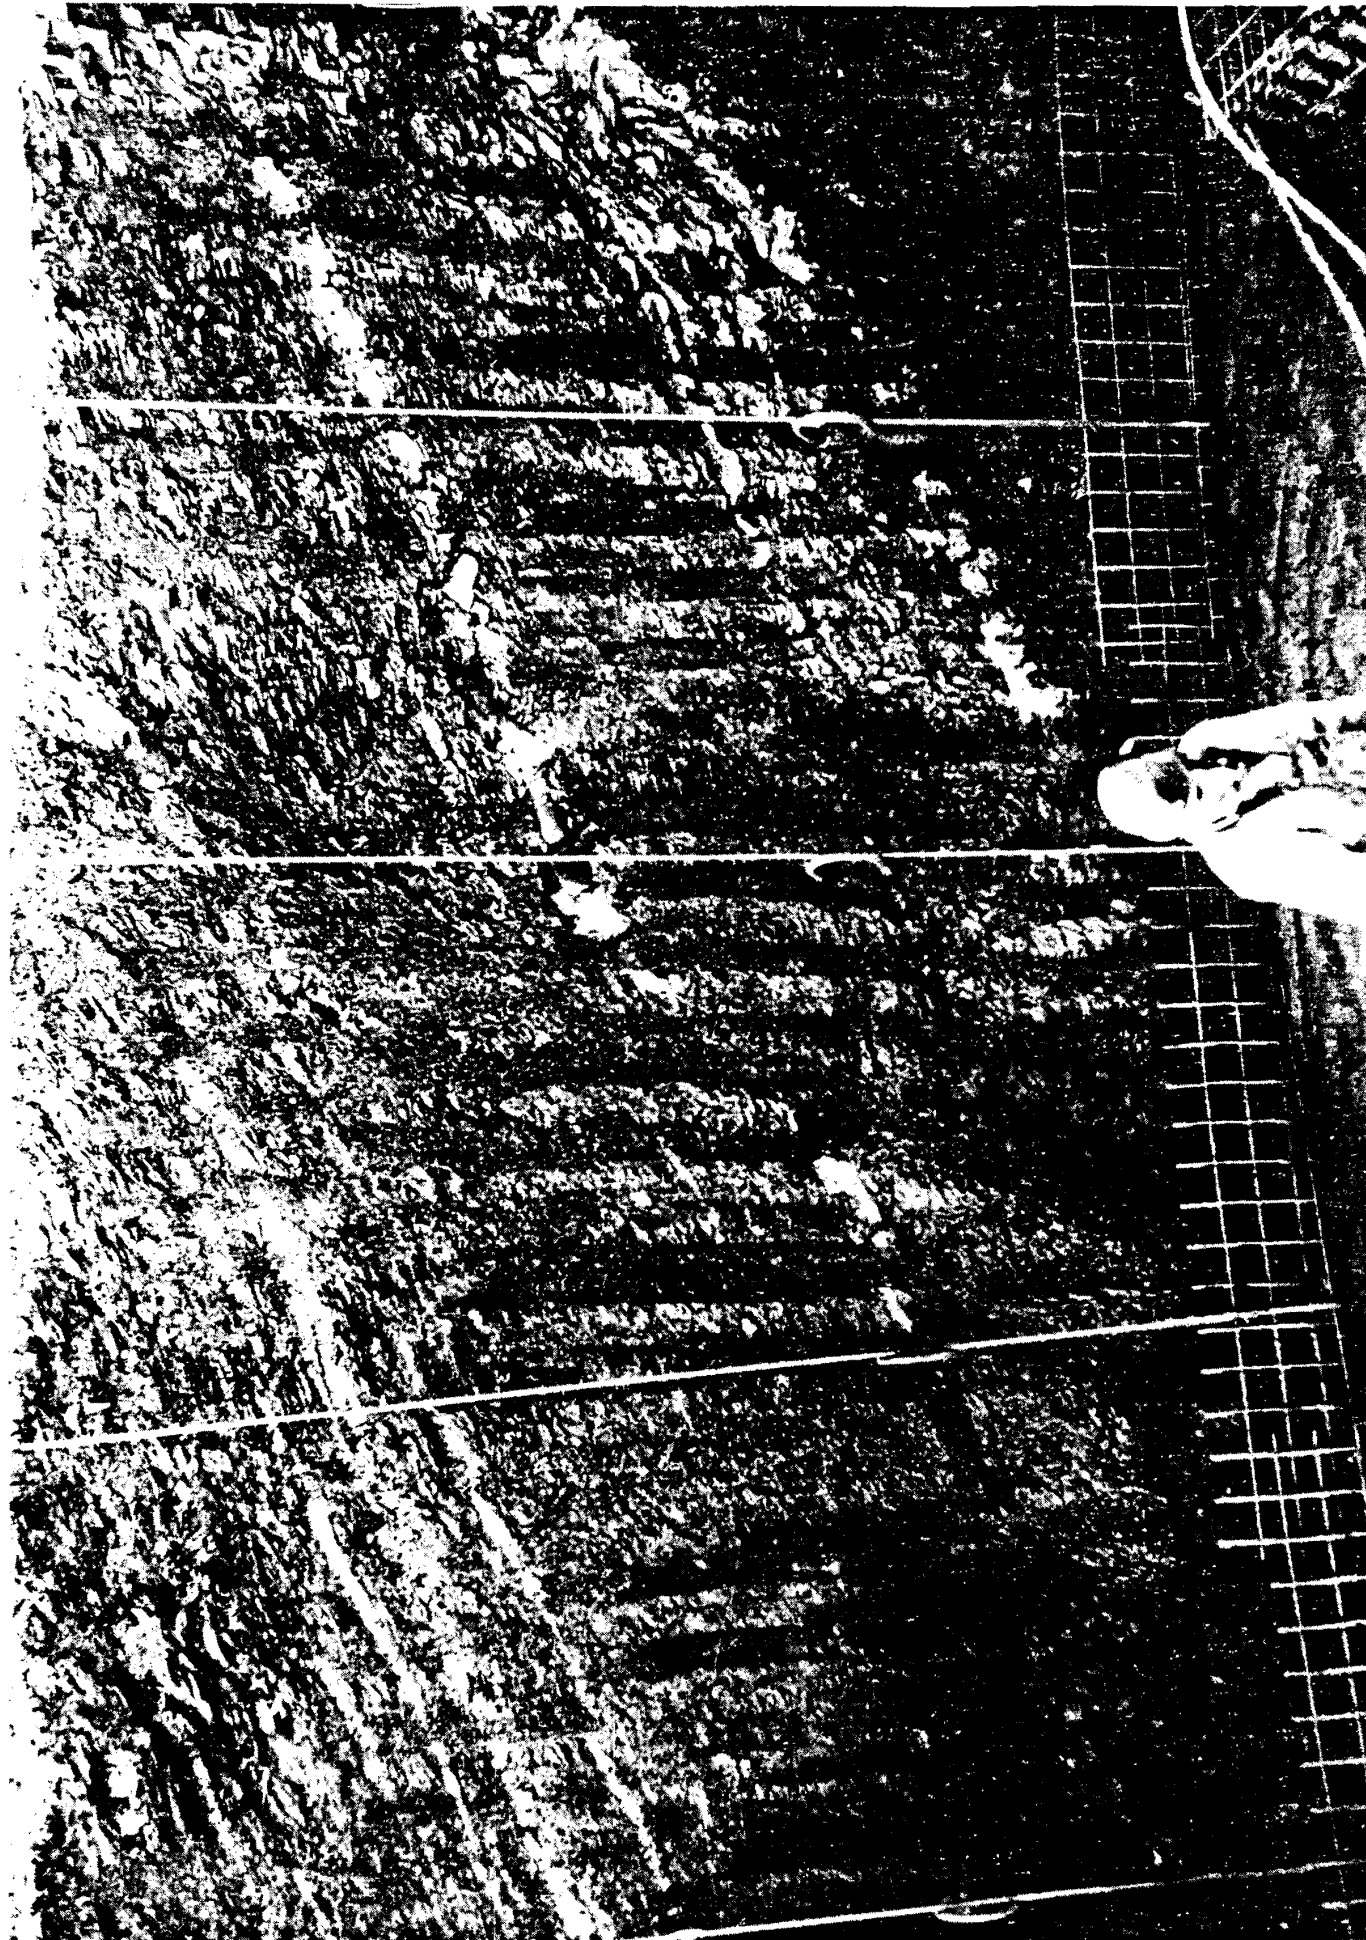

Watts Bar Nuclear Plant
Tennessee Valley Authority
88906-L December 17, 1973
Gary W. Krantz, Knoxville

Closeup of Reactor #1 normal fault at 72 degrees. Viewed west.

Figure 2.5-126 Closeup of Reactor #1 Normal Fault at 72 Degrees. Viewed West.

Figure 2.5-126



Watts Bar Nuclear Plant
Tennessee Valley Authority
14186-1 March 14, 1974
Gary W. Krantz, Knoxville

Closeup of fault in Reactor #1 cavity west wall between elevations of 678.5 and 690.0 feet. Viewed west. Scale: 1 inch = 0.56 feet.

Figure 2.5-127

Figure 2.5-127 Closeup of Fault In Reactor #1 Cavity West Wall Between Elevations of 678.5 And 690.0 Feet. Viewed West. Scale: 1 Inch = 0.56 Feet.



Watts Bar Nuclear Plant
 Tennessee Valley Authority
 88906-I December 13, 1973
 Gary W. Krantz, Knoxville

Fault in Auxiliary Building at All and east-west reactor centerline. Fault continues NE through NW perimeter of Reactor #2 Building. Viewed northeast.

Figure 2.5-128


Figure 2.5-128 Fault In Auxiliary Building at All And East-West Reactor Centerline. Fault Continues NE Through NW Perimeter of Reactor #2 Building. Viewed Northeast.



Watts Bar Nuclear Plant Tennessee Valley Authority 88902-J January 16, 1974 Gary W. Krantz, Knoxville	Gravity or normal fault on northeast Reactor #1 perimeter at 233 degrees. Fault plane dips north at 40 degrees. Viewed west.
--	--

Figure 2.5-129

Figure 2.5-129 Gravity or Normal Fault on Northeast Reactor #1 Perimeter at 233 Degrees. Fault Plane Dips North at 40 Degrees. Viewed West.

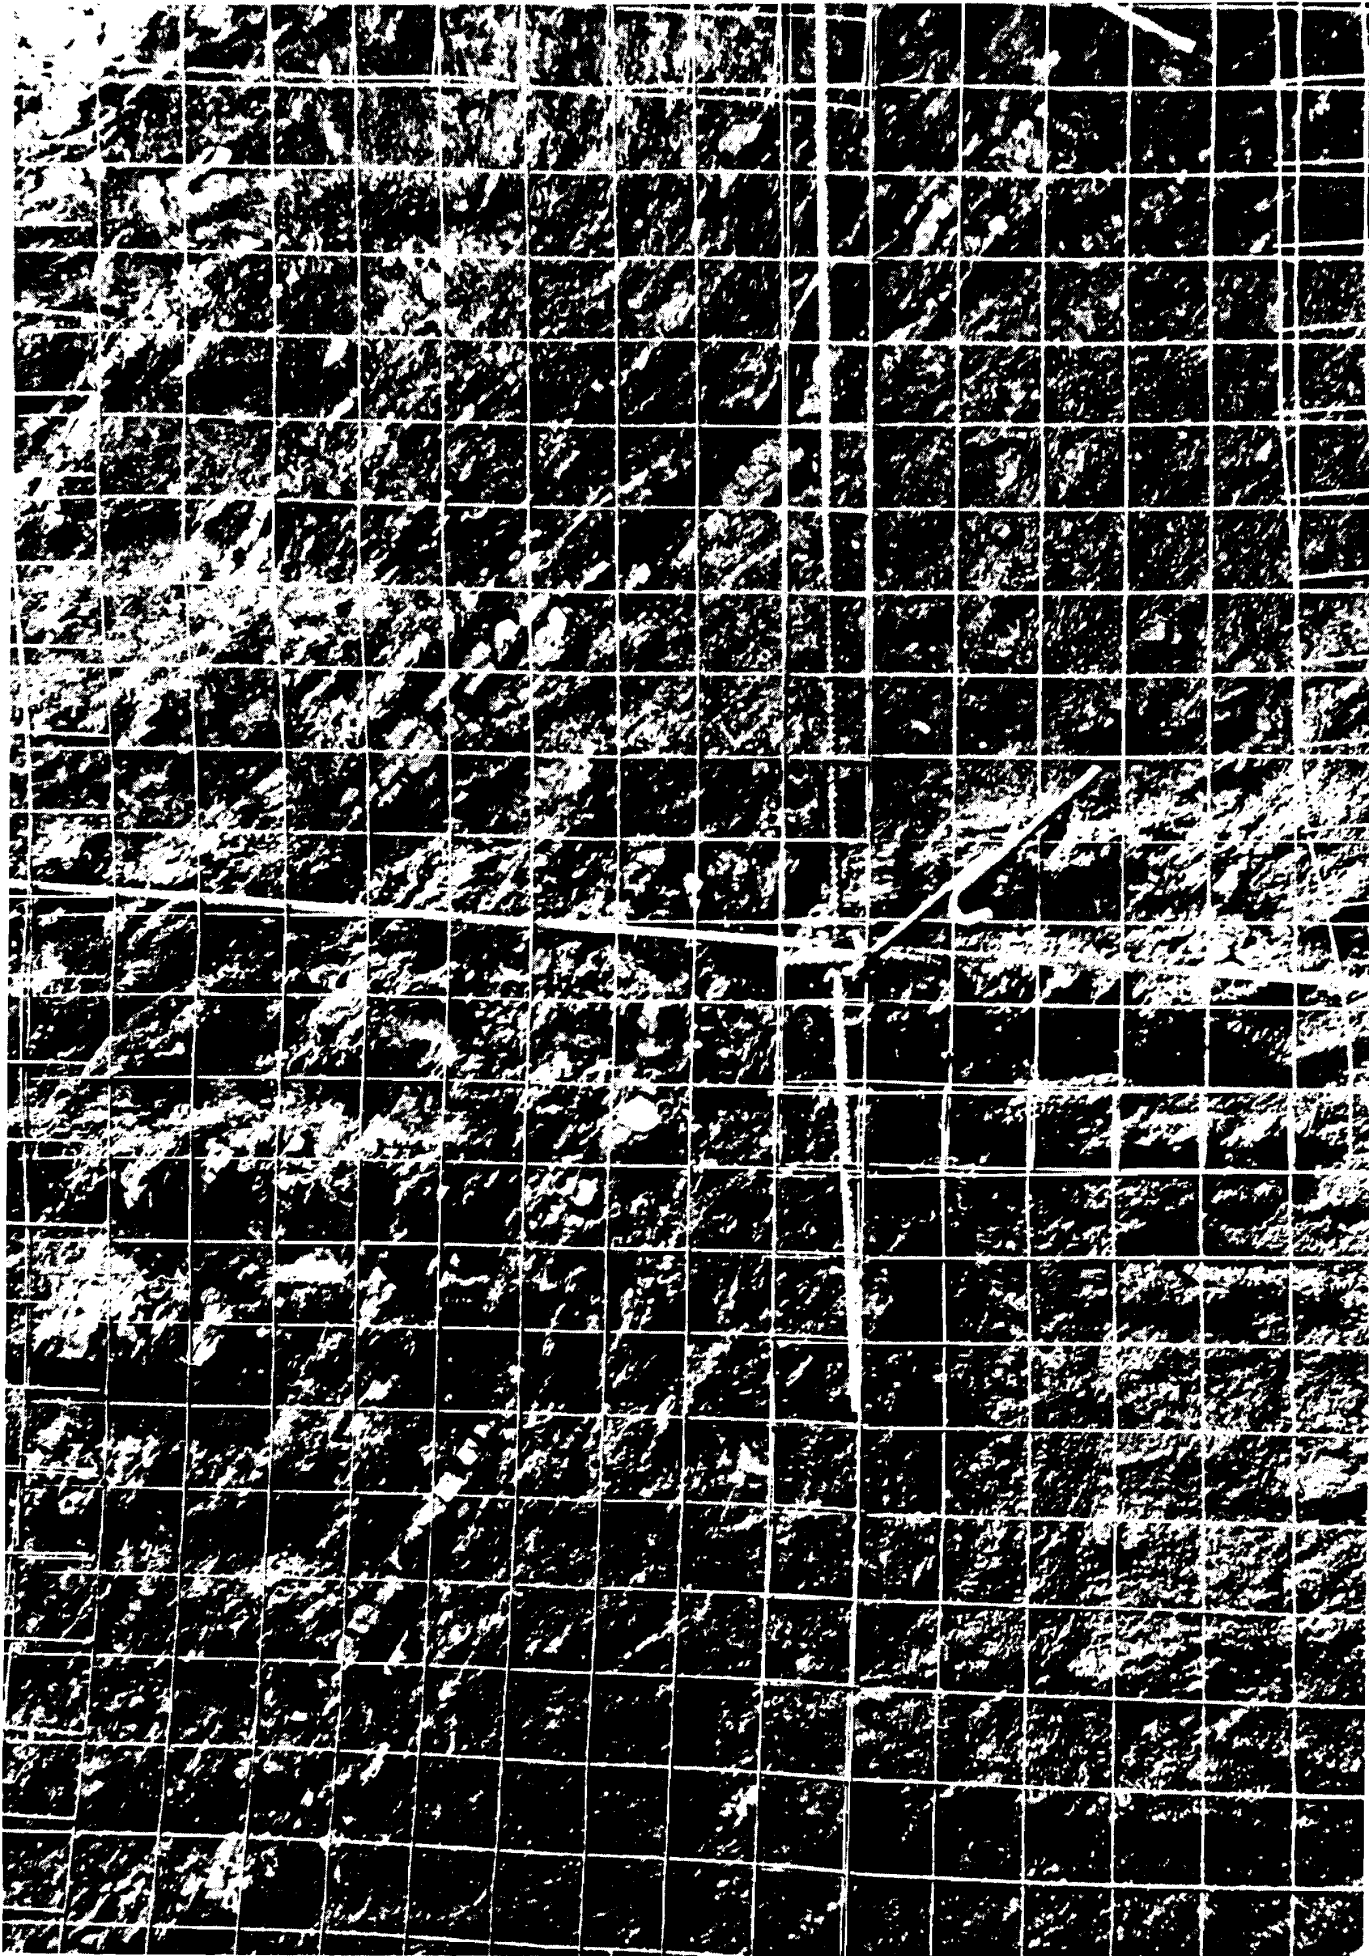


Watts Bar Nuclear Plant
Tennessee Valley Authority
90863 E February 1, 1974
Gary W. Krantz, Knoxville

Fault in Reactor #2 East Wall at approximately 130 degrees. Viewed east.

Figure 2.5-130 Fault in Reactor #2 East Wall at Approximately 130 Degrees. Viewed East.

Figure 2.5-130

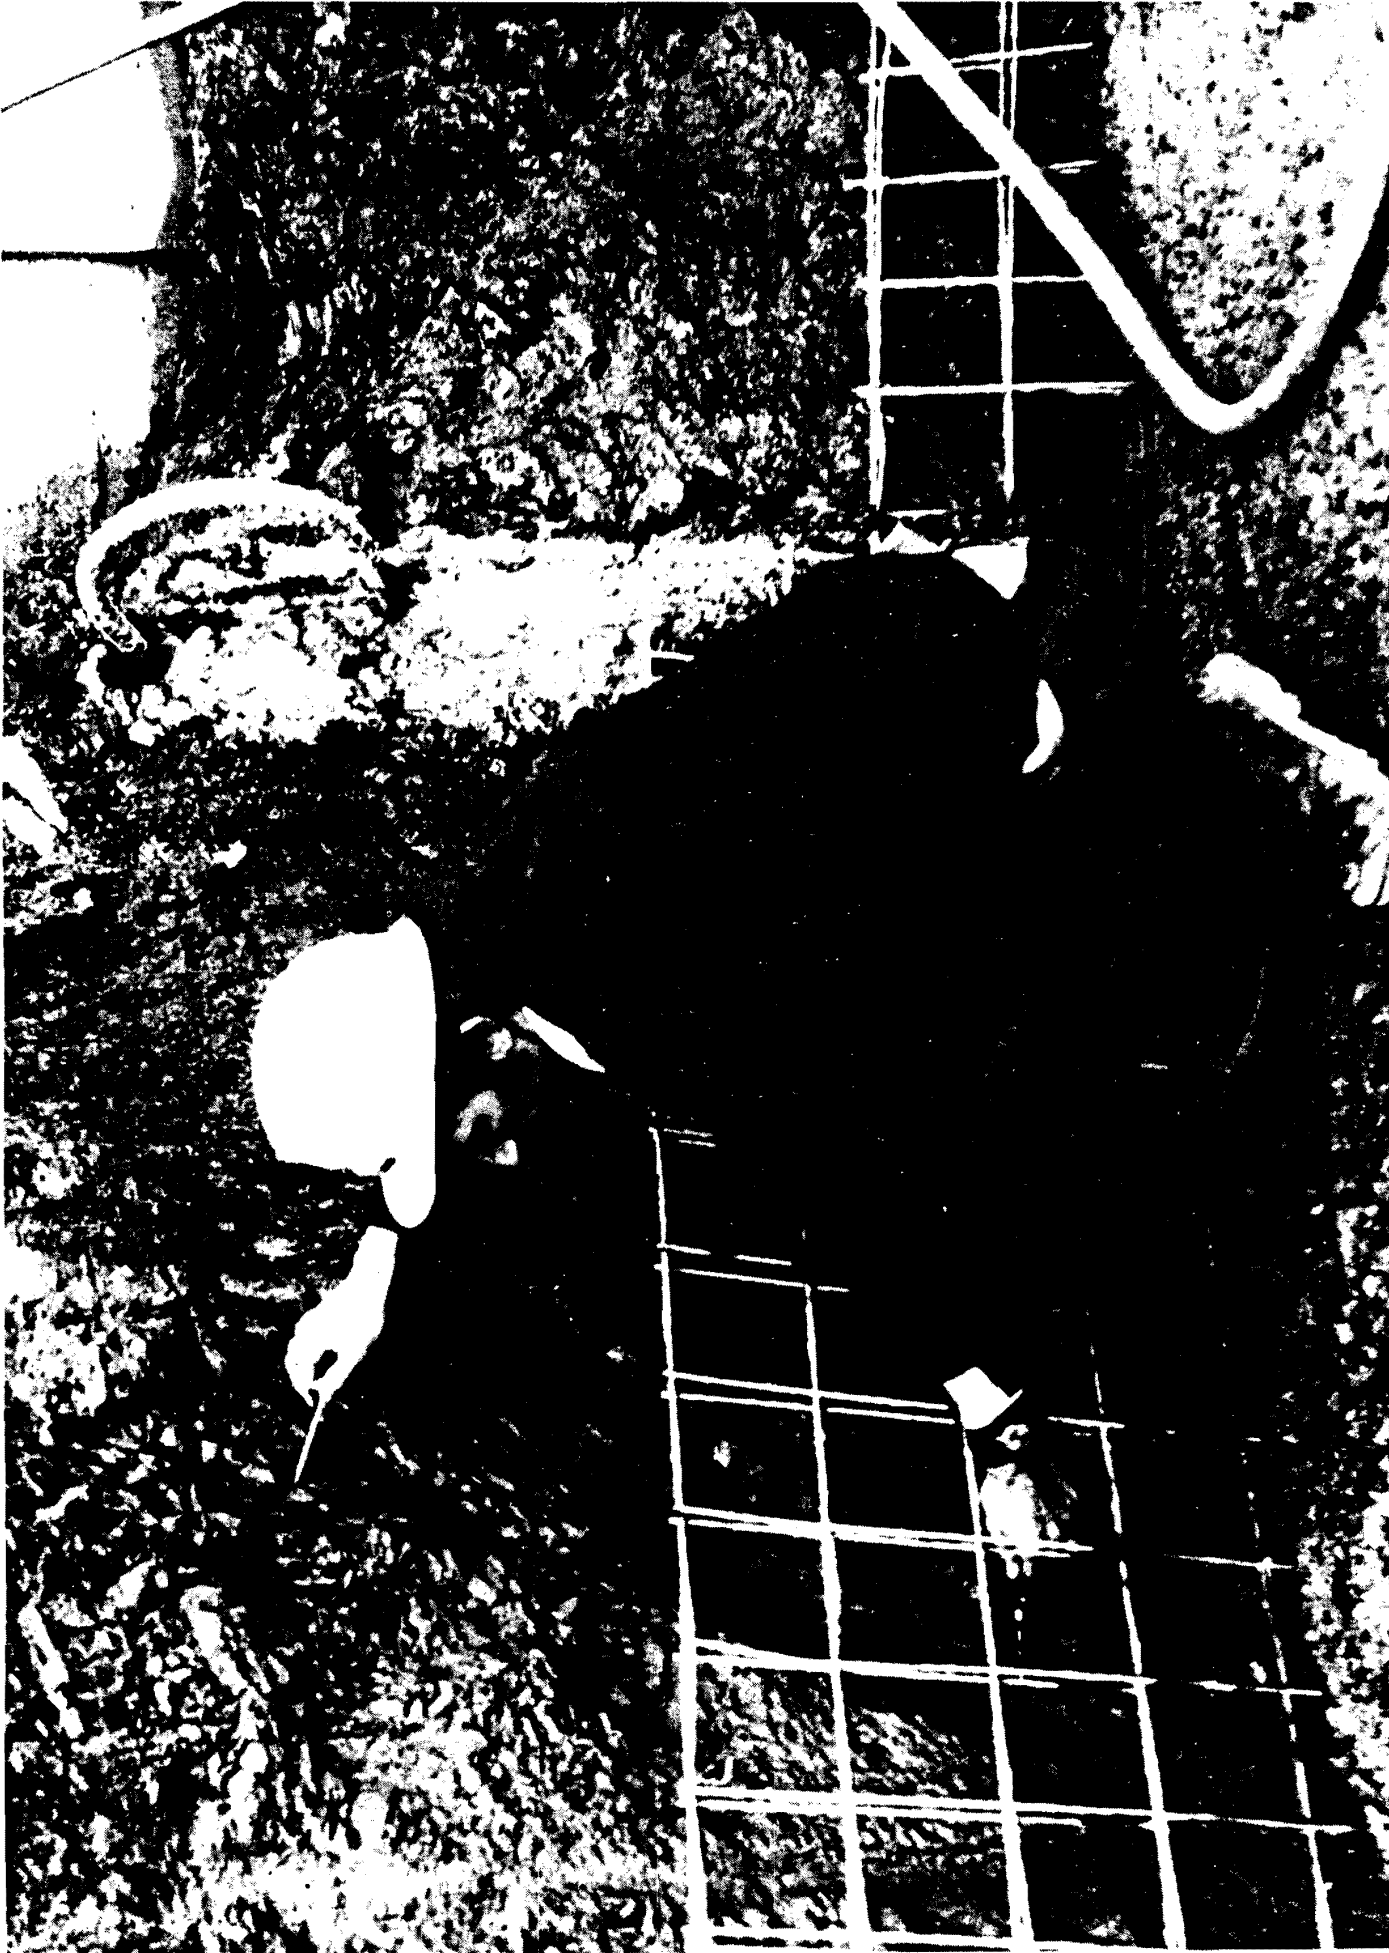

Watts Bar Nuclear Plant
Tennessee Valley Authority
90863 P February 20, 1974
Gary W. Krantz, Knoxville

Fault in Reactor #2 Cavity Wall at approximately 354 degrees. Elevation 680.0 at base.
Viewed southwest.

Figure 2.5-131

Figure 2.5-131 Fault in Reactor #2 Cavity Wall at Approximately 354 Degrees. Elevation 680.0 at Base. Viewed Southwest.



Watts Bar Nuclear Plant Tennessee Valley Authority 90865 H March 7, 1974 Gary W. Krantz Knoxville	Fault in south wall of discharge channel showing truncation by overlying terrace gravel deposit.
--	--

Figure 2.5-132 Fault In South Wall of Discharge Channel Showing Truncation By Overlying Terrace Gravel Deposit.

Figure 2.5-132



Watts Bar Nuclear Plant Tennessee Valley Authority 90865D March 7, 1974 Gary W. Krantz, Knoxville	Fault in north wall of discharge channel showing truncation by terrace gravel deposit.
--	--

Figure 2.5-133 Fault In North Wall of Discharge Channel Showing Truncation By Terrace Gravel Deposit.

Figure 2.5-133



Watts Bar Nuclear Plant Tennessee Valley Authority 88902-P January 16, 1974 Gary W. Krantz, Knoxville	Fault truncation by terrace gravel deposit at 20 feet east of A8 and 18.50 feet north of Y. Elevation at bench cut is 706.35. Viewed north. A = Terrace gravel deposit B = Iron oxide crust C = Buff colored saprolitic shale residuum D = Blue-grey clay seam along fault
--	--

Figure 2.5-134

Figure 2.5-134 Fault Truncation by Terrace Gravel Deposit at 20 Feet East of A8 and 18.50 Feet North of Y. Elevation at Bench Cut is 706.35. Viewed North.



Watts Bar Nuclear Plant
 Tennessee Valley Authority
 January 16, 1974
 Gary W. Krantz, Knoxville

Fault in vertical excavation cut at 20 feet east of A8 and 18.50 feet north of Y. Viewed north. For enlargement of inset area see next photograph.

Figure 2.5-135

Figure 2.5-135 Fault in Vertical Excavation Cut at 20 Feet East of A8 and 18.50 Feet North of Y. Viewed North.




Watts Bar Nuclear Plant
 Tennessee Valley Authority
 January 16, 1974
 Gary W. Krantz, Knoxville

Inset Area. Blue-grey clay seam along fault trace where truncated by terrace gravel deposit. Location: 20 feet east of A8 and 18.50 feet north of Y. Viewed north.

Figure 2.5-136

Figure 2.5-136 Inset Area. Blue-Grey Clay Seam Along Fault Trace Where Truncated by Terrace Gravel Deposit. Location: 20 Feet East of A8 And 18.50 Feet North of Y. Viewed North.

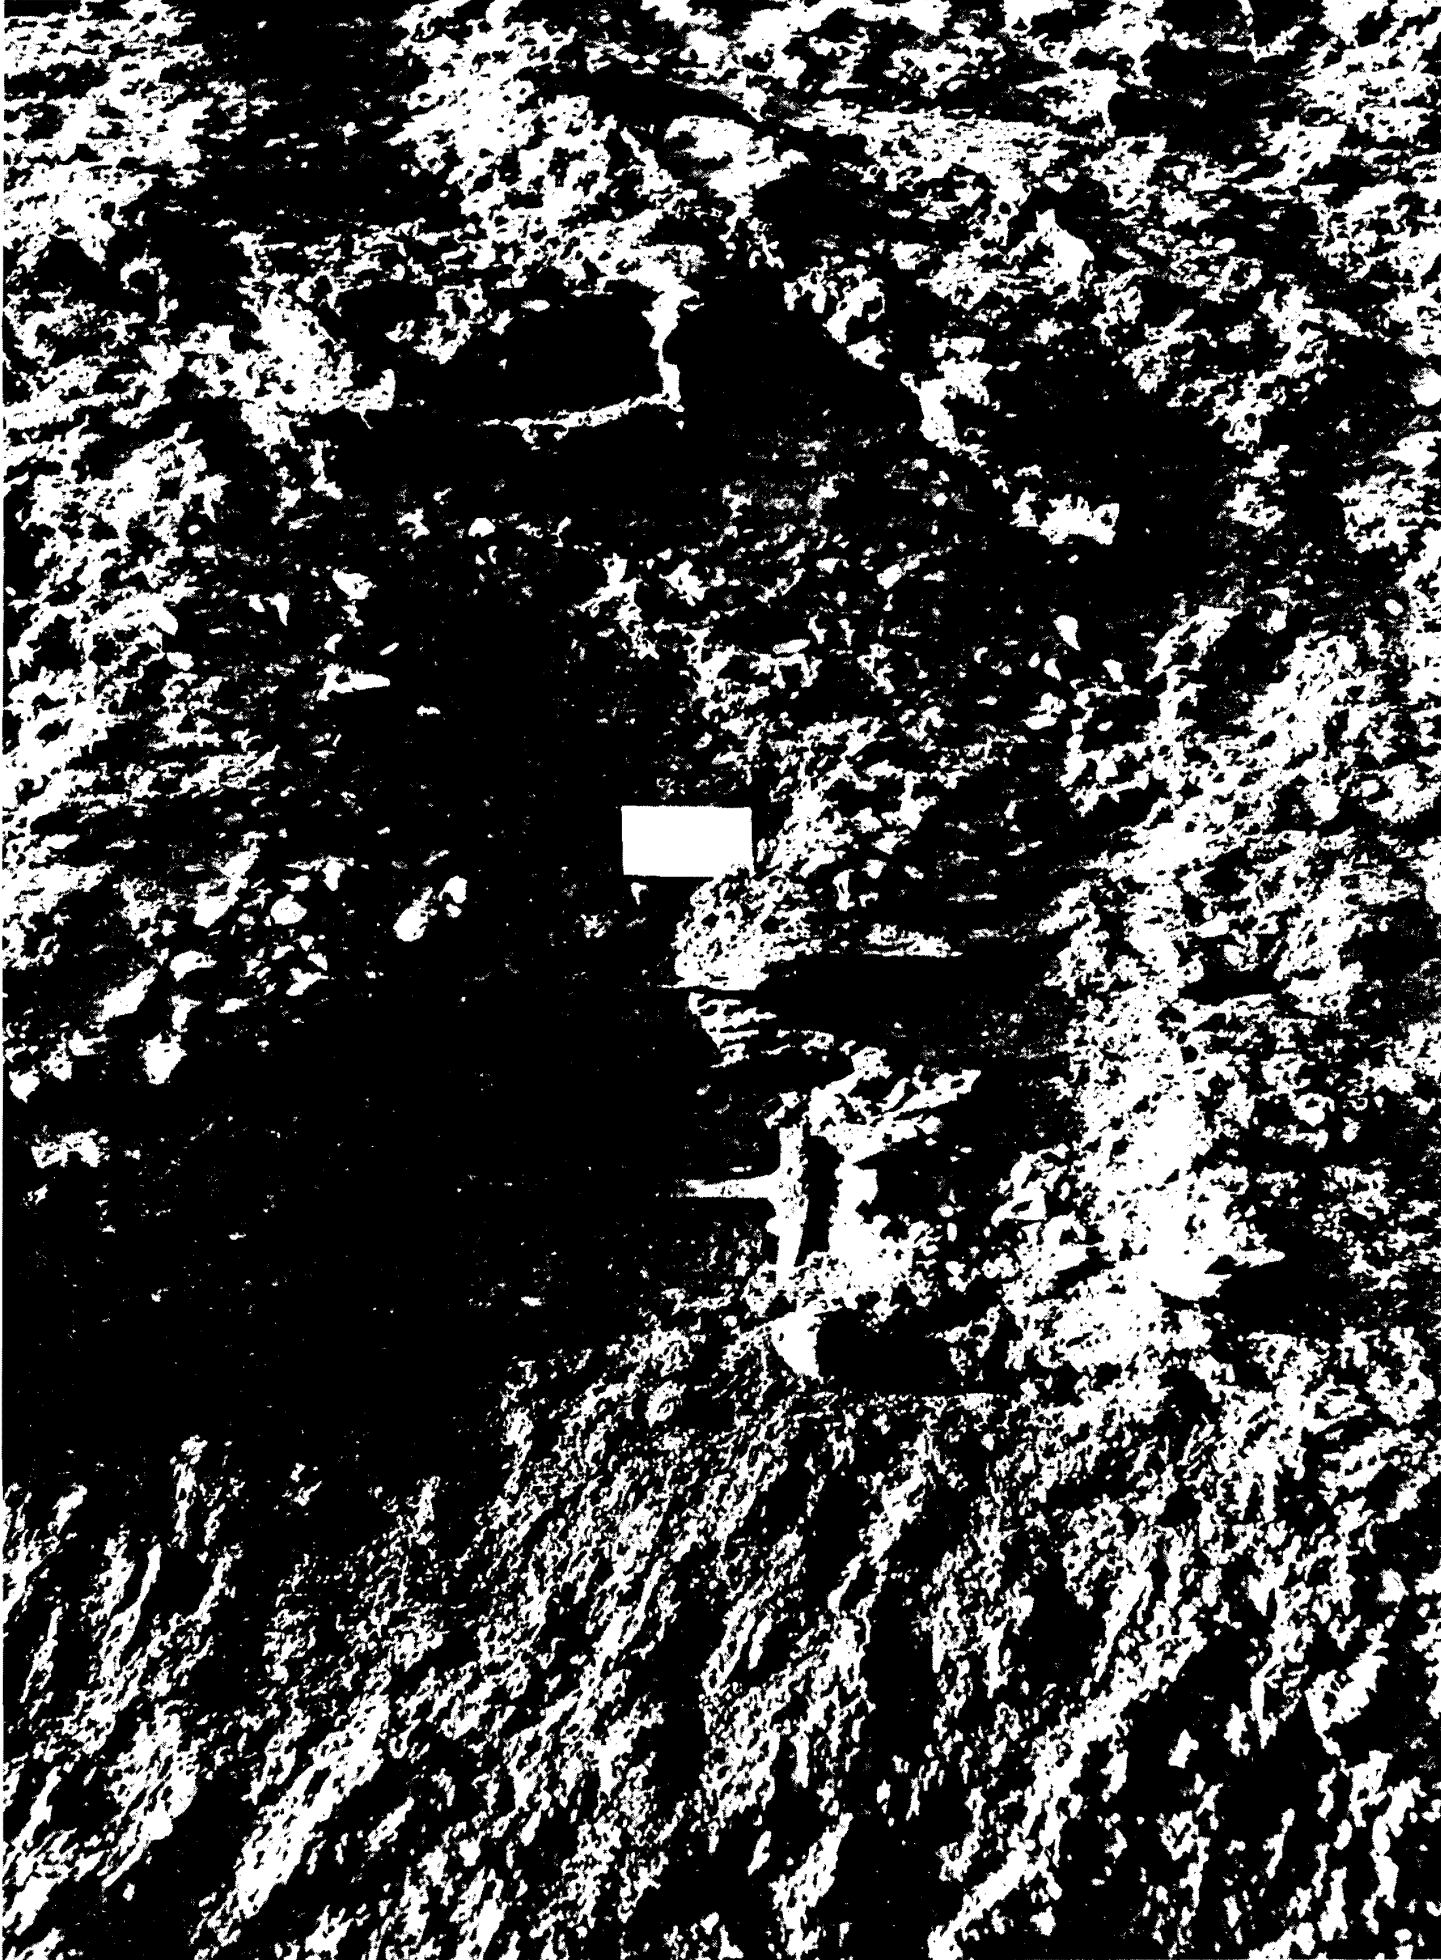

Watts Bar Nuclear Plant
Tennessee Valley Authority
90865-C March 7, 1974
Gary W. Krantz, Knoxville

Saprolite - terrace gravel contact. Hematitic crusts are seen to be dispersed at several levels in the terrace gravel. Viewed south in the exhaust cut approximately 150 feet east of the powerhouse foundation.

Figure 2.5-137

Figure 2.5-137 Saprolite - Terrace Gravel Contact. Hematitic Crusts are Seen to be Dispersed at Several Levels in the Terrace Gravel. Viewed South in the Exhaust Cut Approximately 150 Feet East of The Powerhouse Foundation.



<p>Watts Bar Nuclear Plant Tennessee Valley Authority 86554 P March 11, 1974 Gary W. Krantz Knoxville</p>	<p>Site of wood specimen collection for Carbon 14 age dating. Location is 3 feet above terrace gravel deposit. Scale: Opened Brunton compass = 8.5 inches. Location: Approximately 18.5' North of Y at A5 Line. Approximate elevation 717.5.</p>
---	--

Figure 2.5-138

Figure 2.5-138 Site of Wood Specimen Collection for Carbon 14 Age Dating. Location is 3 Feet Above Terrace Gravel Deposit. Scale: Opened Brunton Compass = 8.5 Inches. Location: Approximately 18.51 North of Y at A5 Line. Approximate Elevation 717.5.




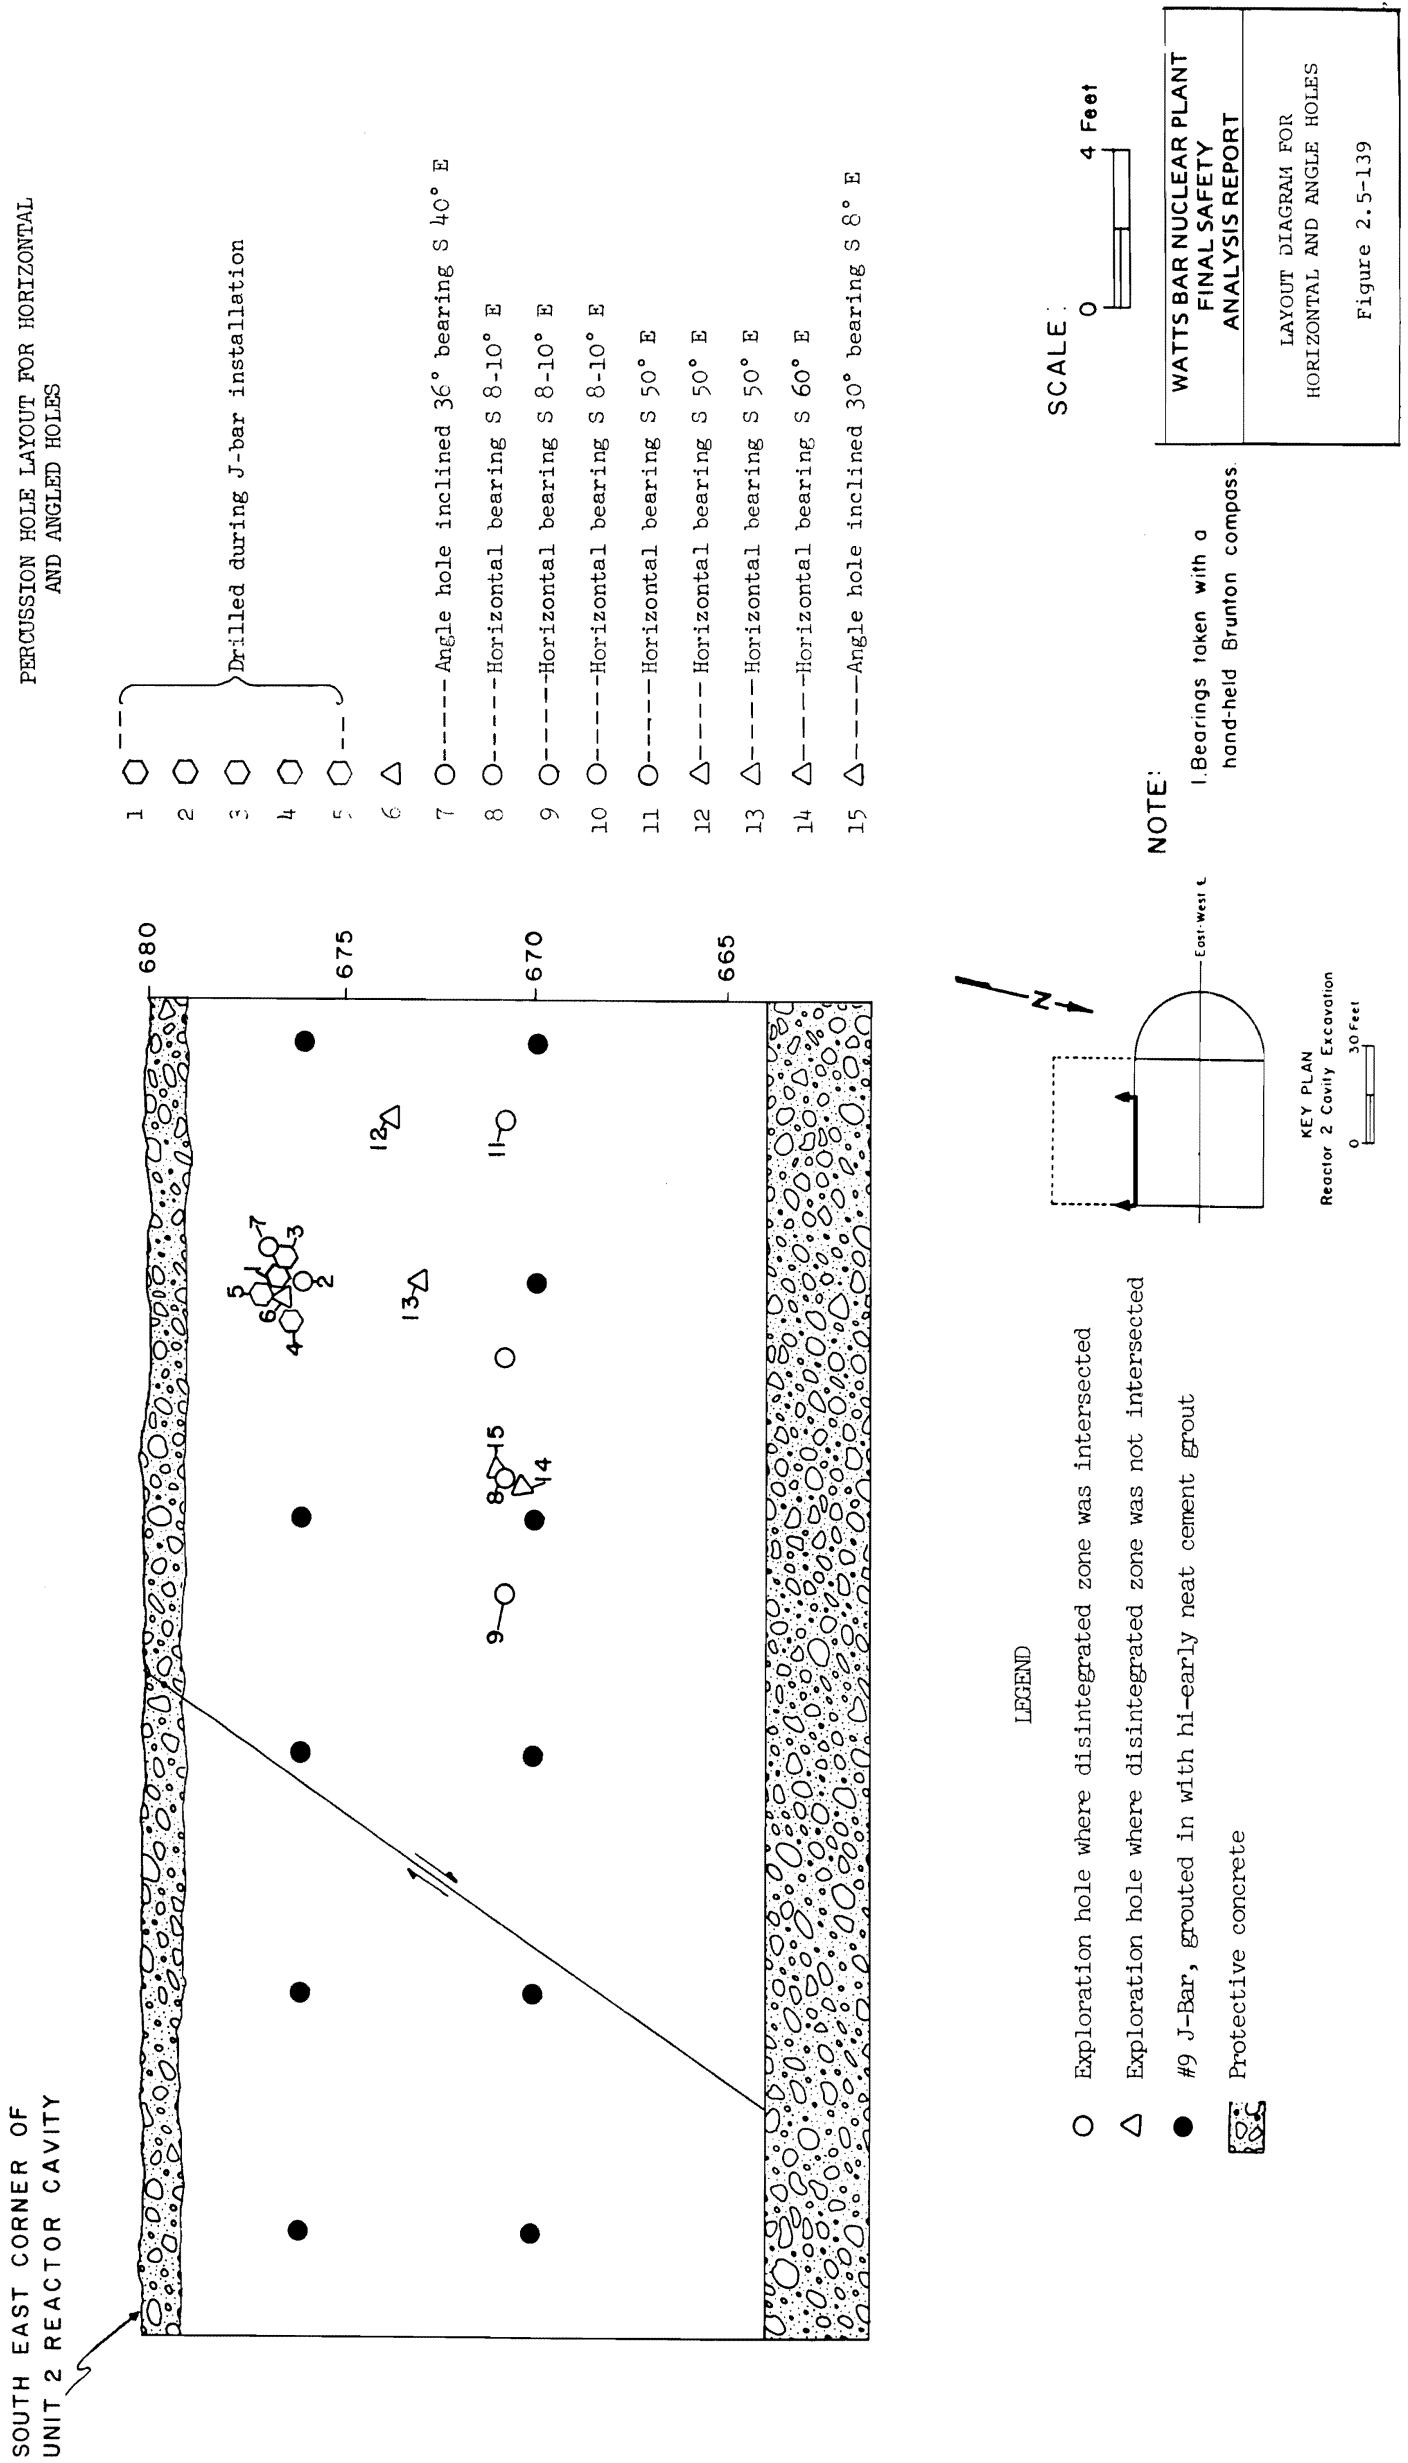


Figure 2.5-139 Layout Diagram For Horizontal and Angle Holes

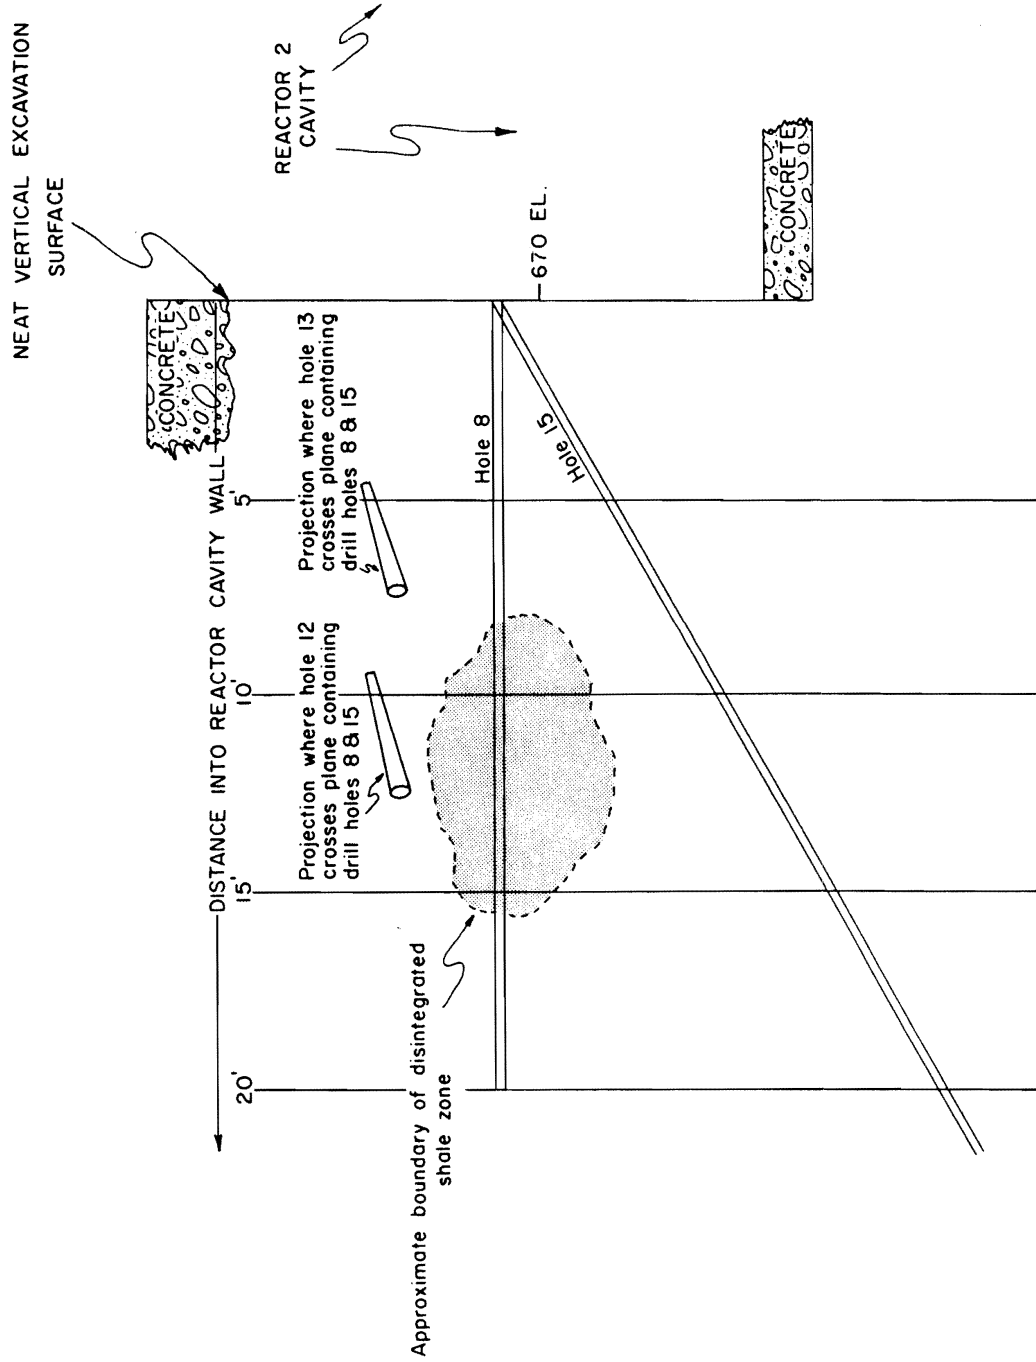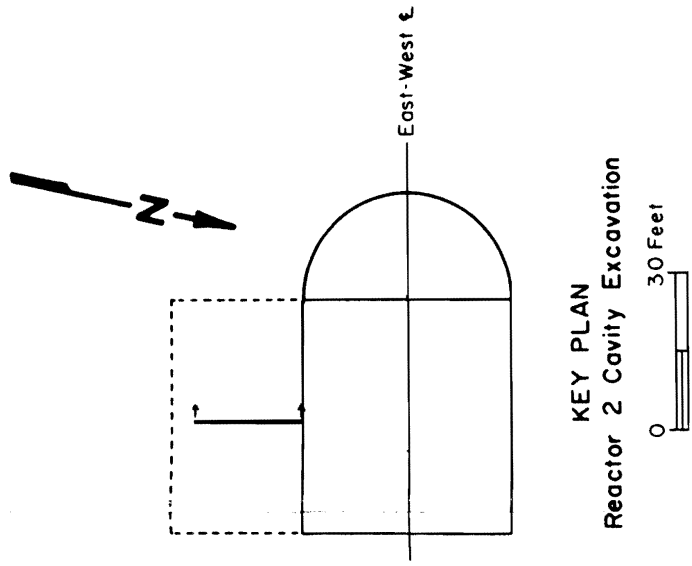

SCALE:



NOTE:

1. Bearings taken with a hand-held Brunton compass.

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
PLANE INTERSECTING DISINTEGRATED SHALE POCKET
Figure 2.5-140

Figure 2.5-140 Plane Intersecting Disintegrated Shale Pocket


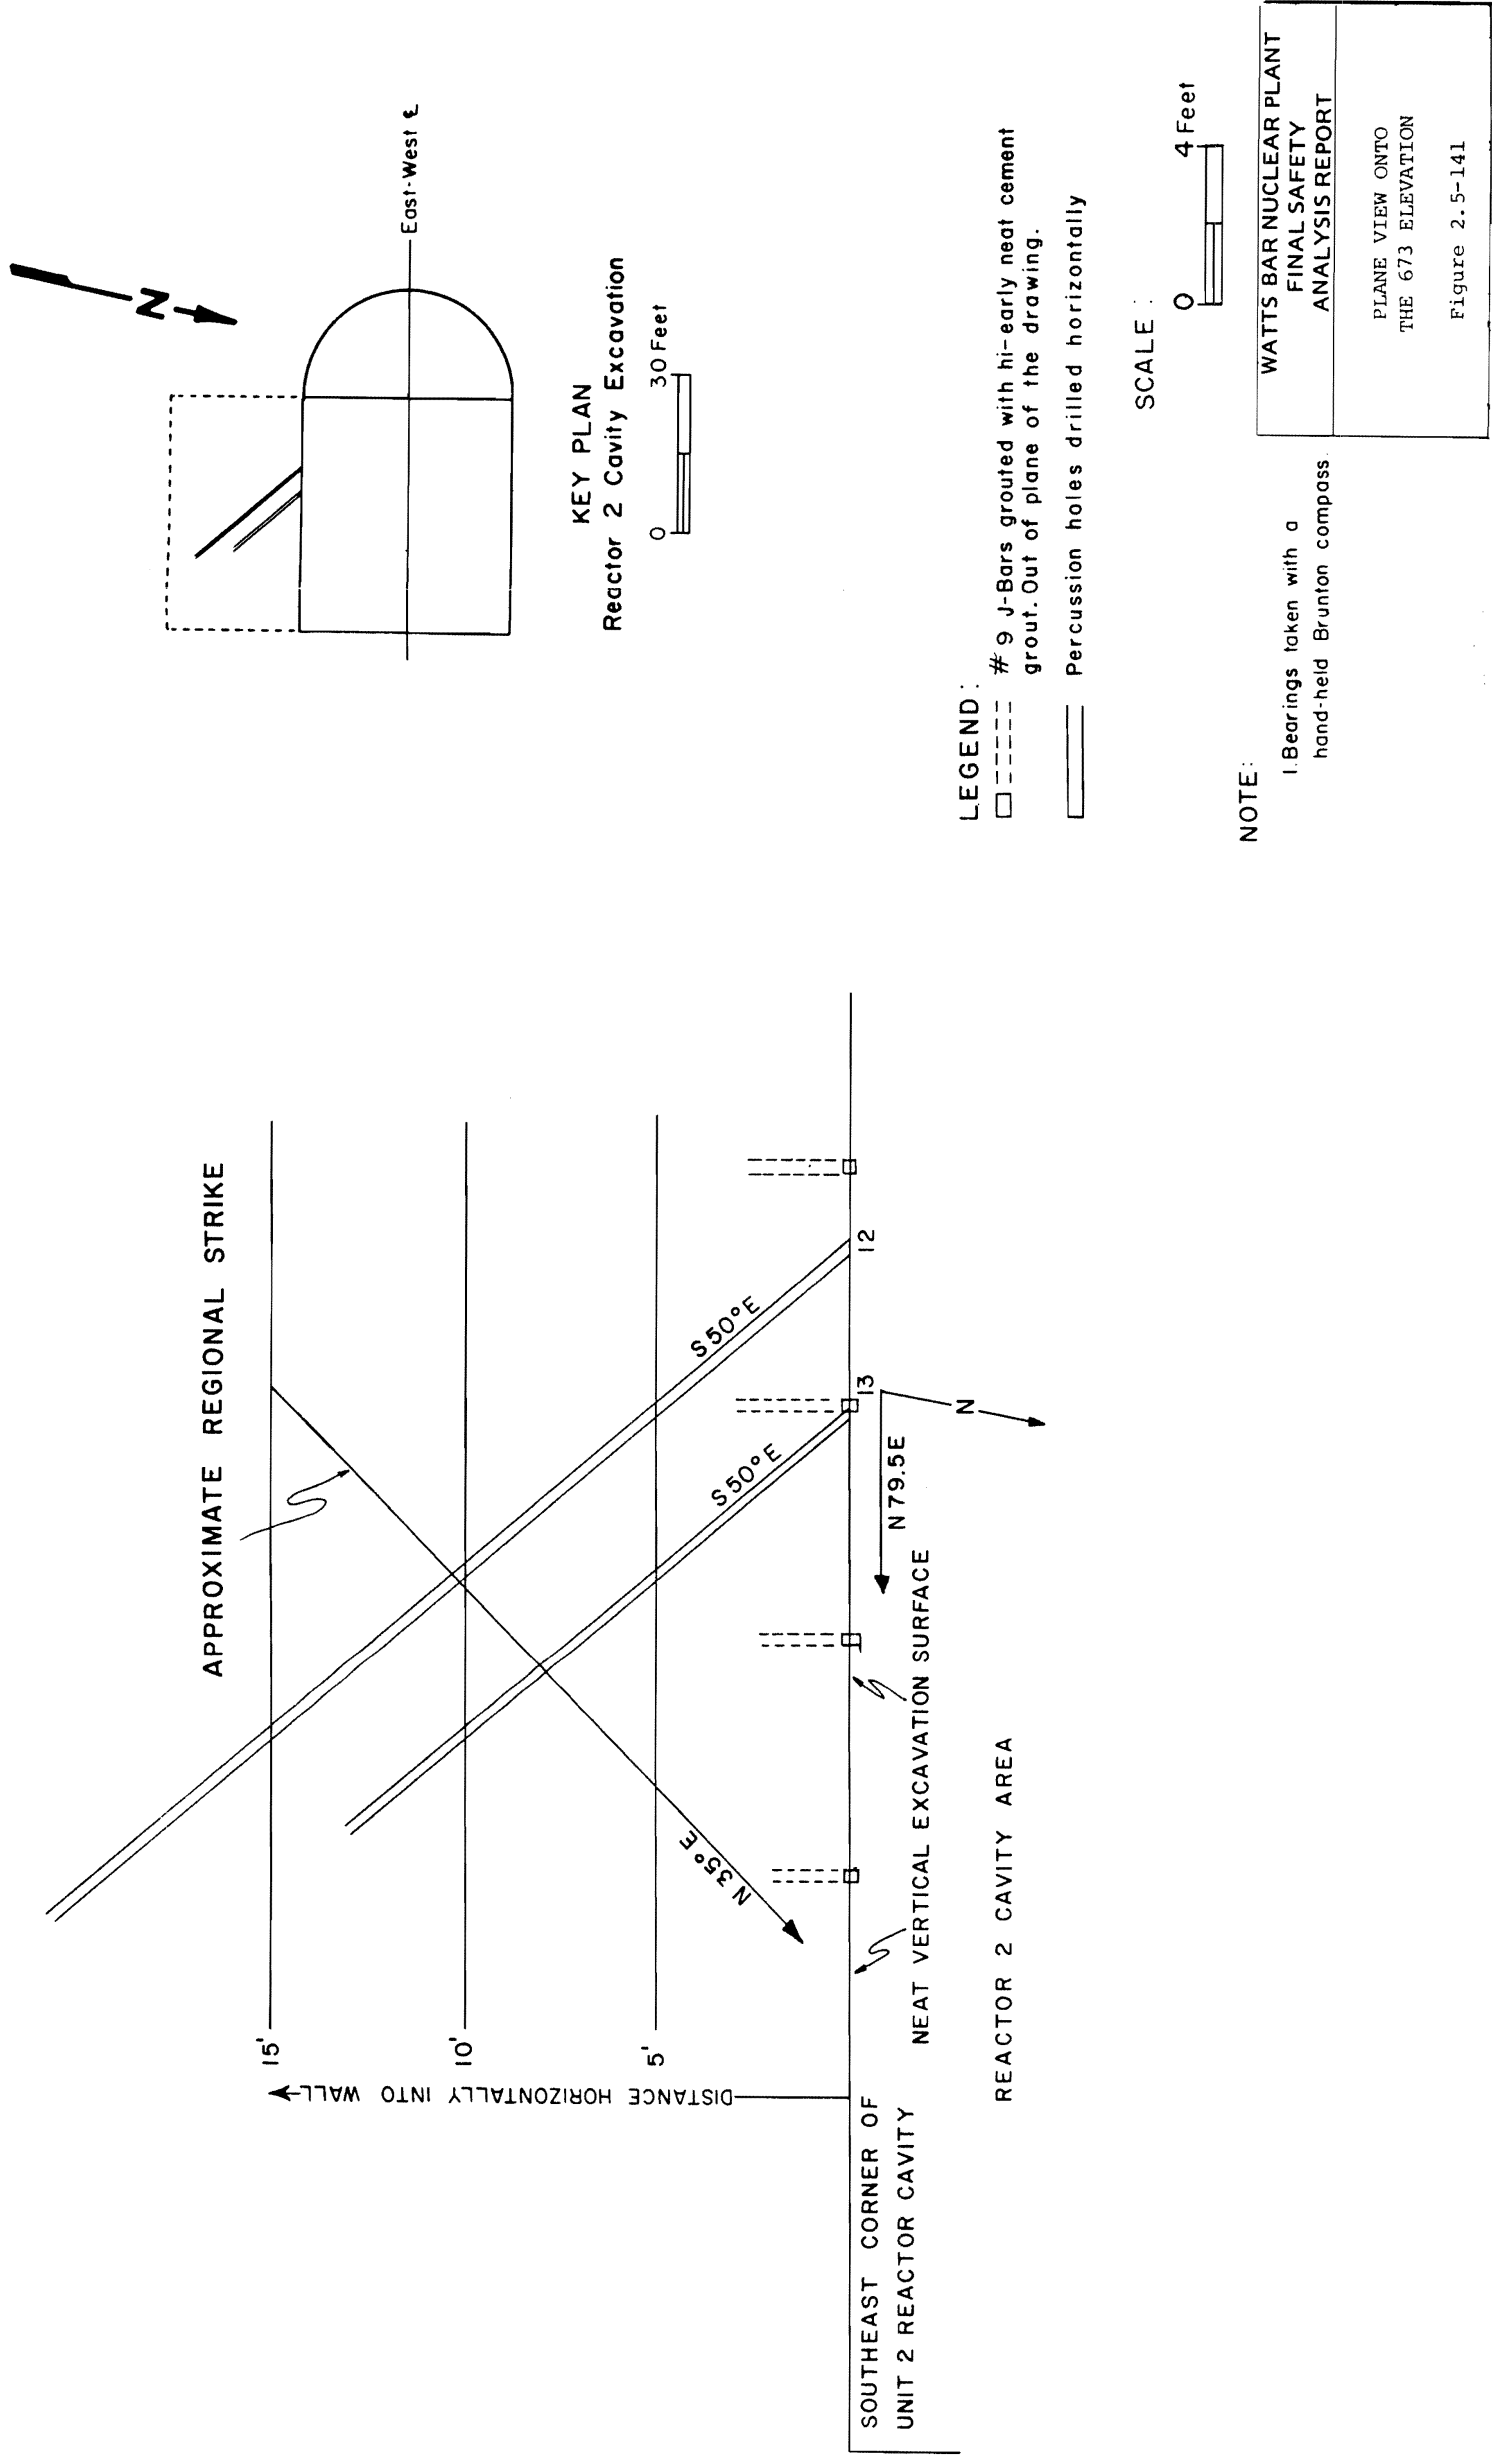


Figure 2.5-141 Plane View Onto The 673 Elevation

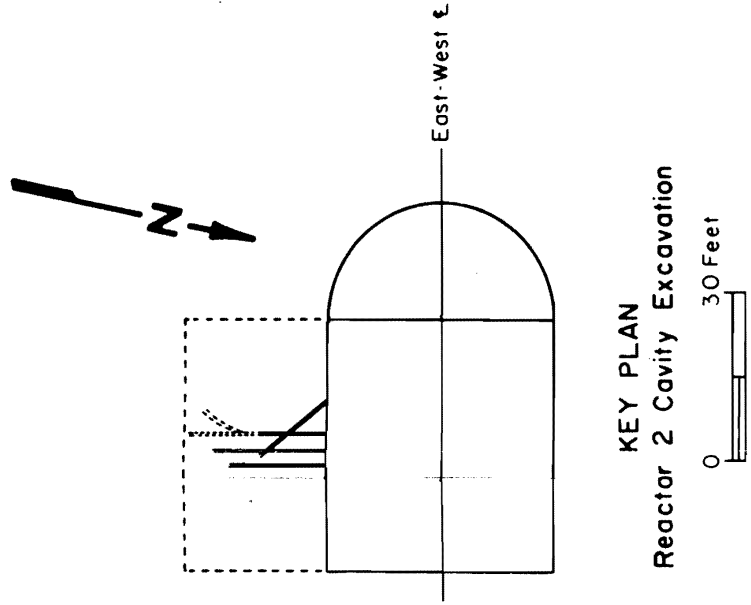

KEY PLAN
Reactor 2 Cavity Excavation

LEGEND:

- #9 J-Bars, grouted with hi-early neat cement grout
- ▬ Percussion holes drilled horizontally.

SCALE:
0 4 Feet

NOTE:

1. Bearings taken with a hand-held Brunton compass.

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
PLANE VIEW ONTO THE 671 ELEVATION
Figure 2.5-142


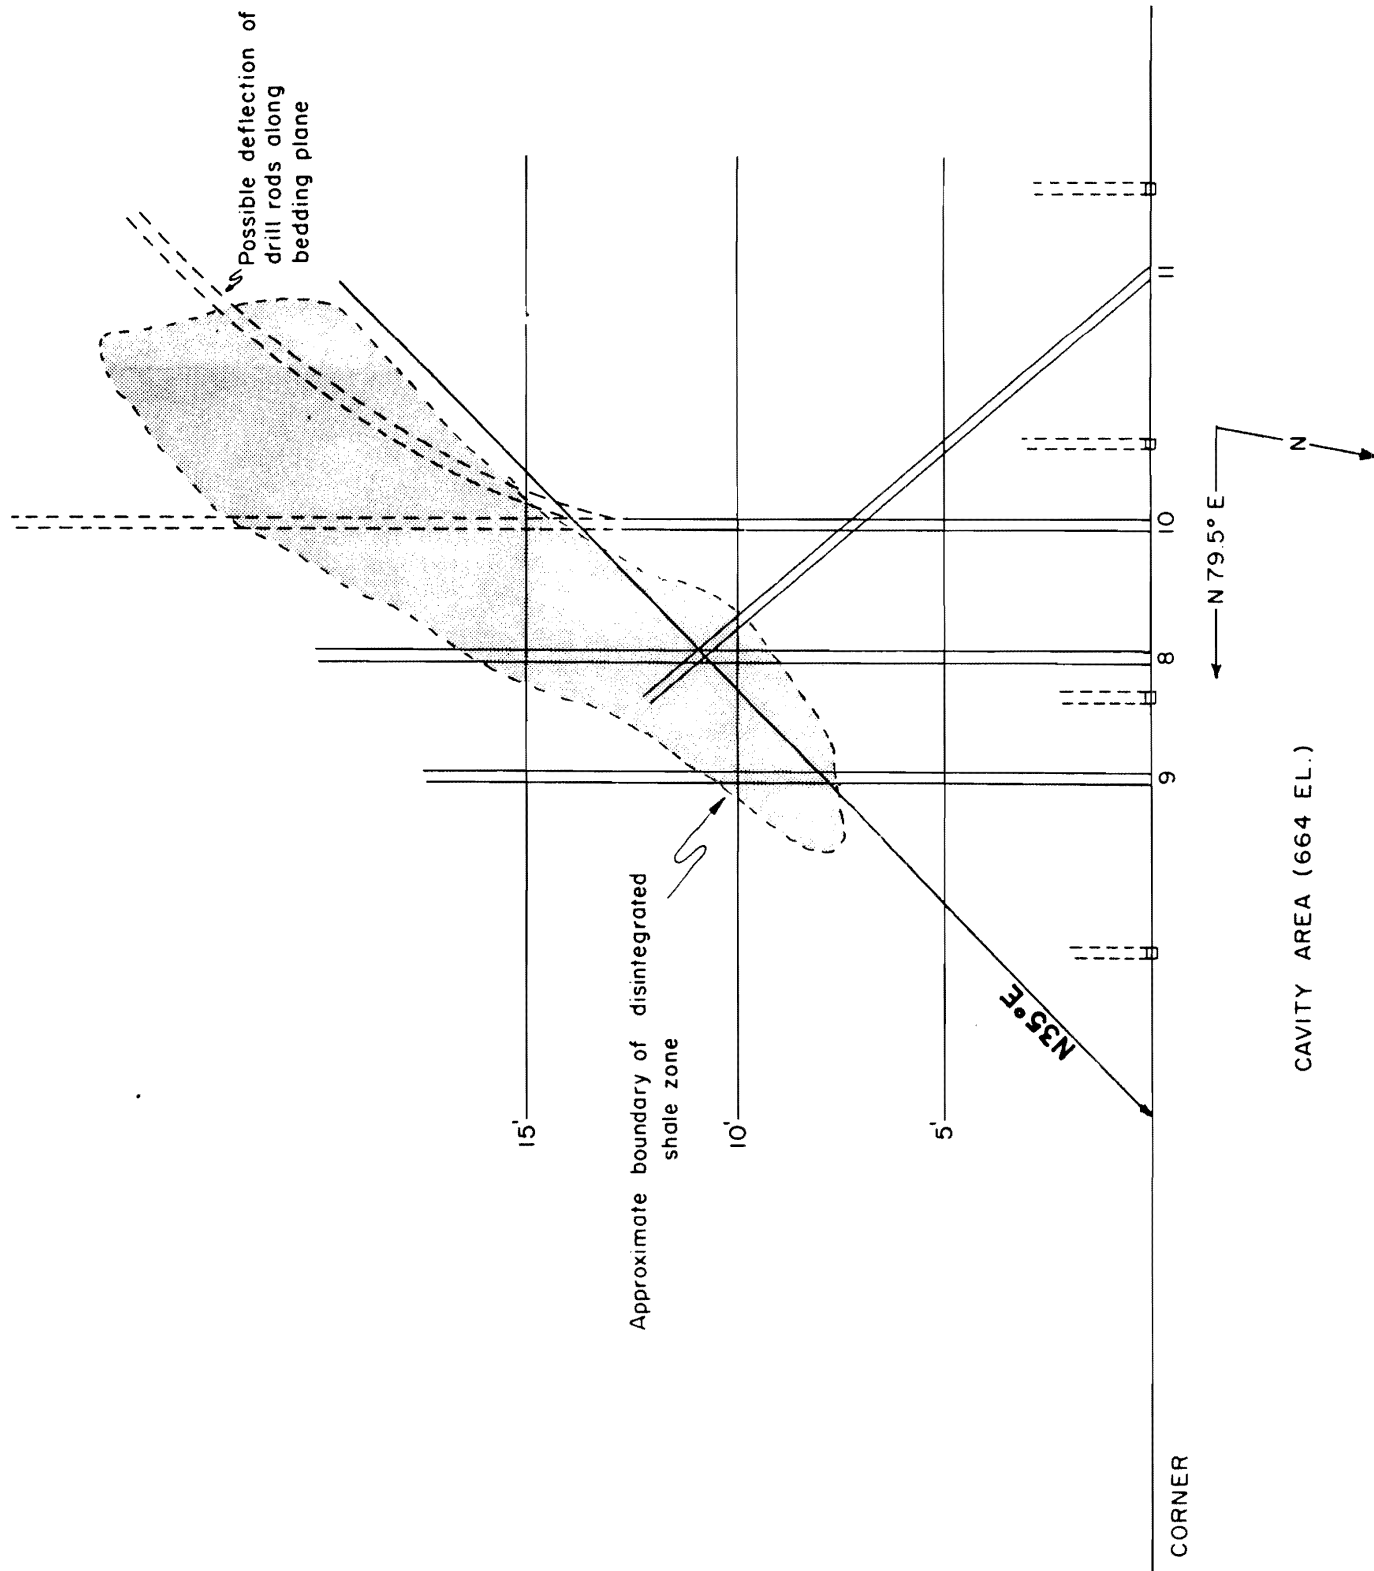


Figure 2.5-142 Plane View Onto The 671 Elevation

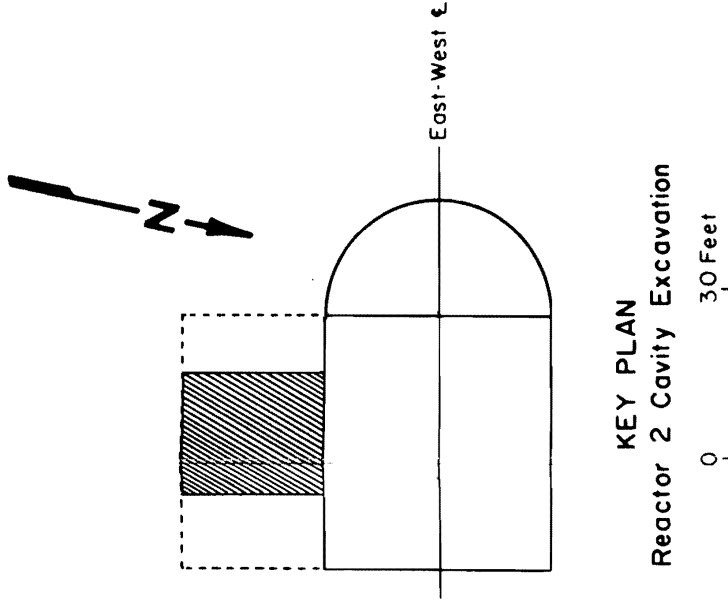

KEY PLAN
Reactor 2 Cavity Excavation

LEGEND:

- △ Drill hole...Zone of disintegrated shale not intersected.
- Drill hole...Zone of disintegrated shale intersected.

SCALE:



NOTE:

1. Bearings taken with a hand-held Brunton compass.

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

DRILL LAYOUT DIAGRAM FOR
VERTICAL HOLES VIEWED
ONTO THE 671 ELEVATION

Figure 2.5-143


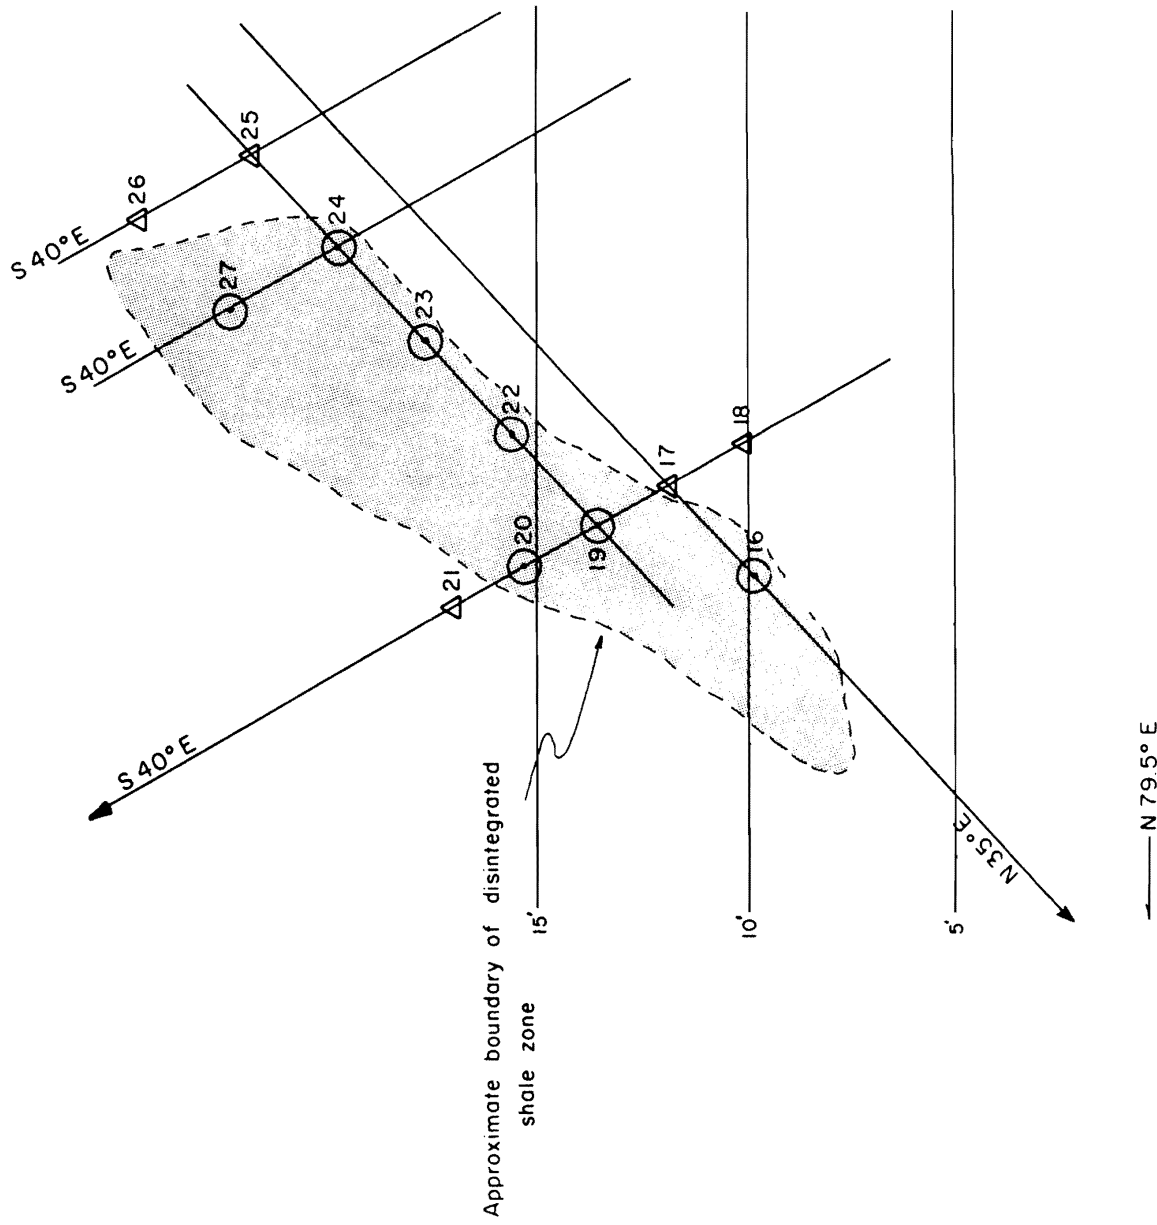


Figure 2.5-143 Drill Layout Diagram For Vertical Holes Viewed Onto The 671 Elevation

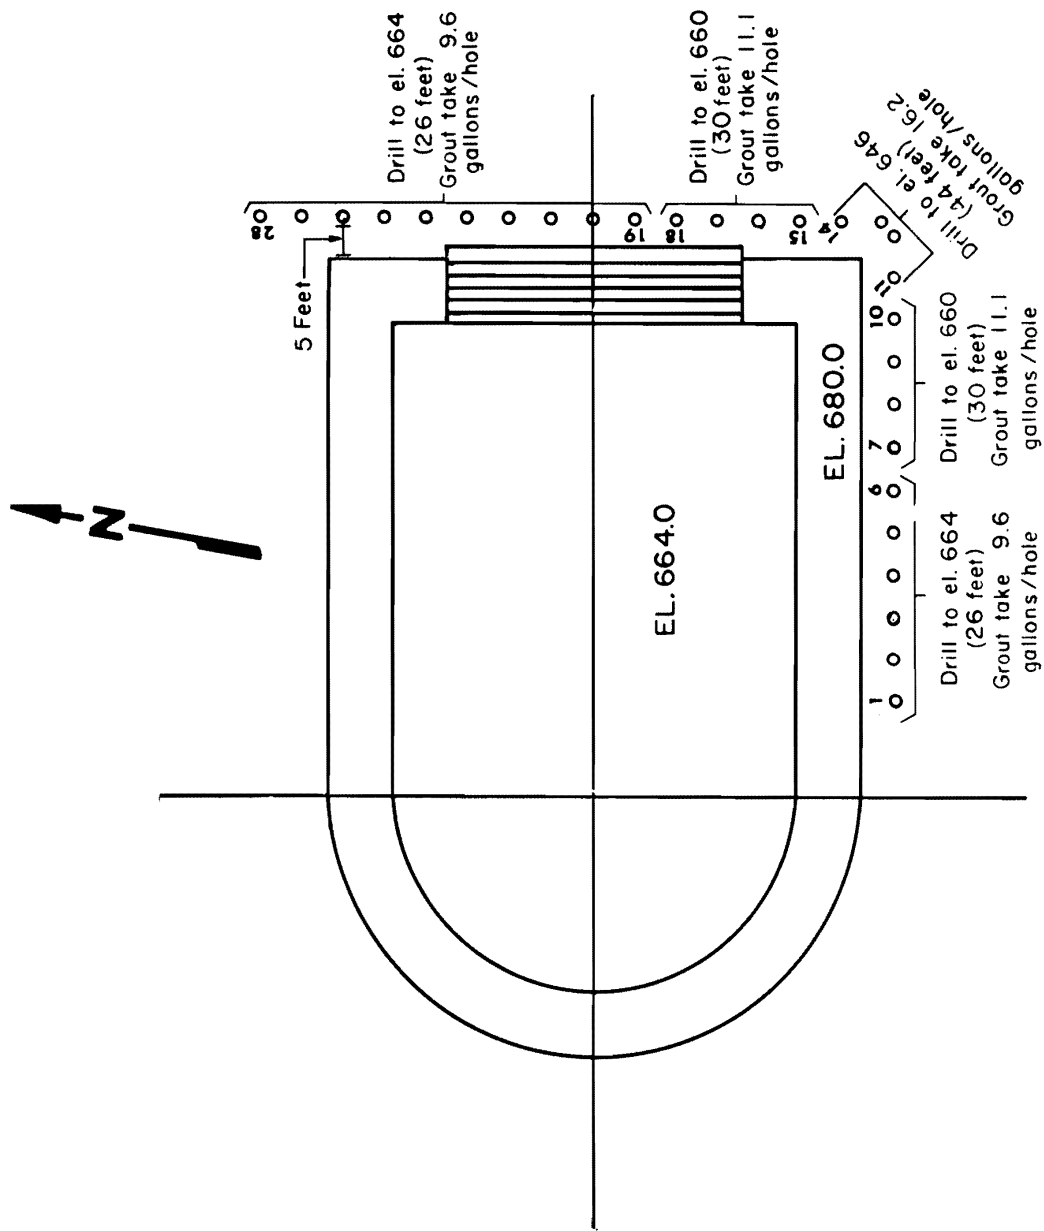

NOTES :

1. Drawing not to scale.
2. Grout take computations based on 3 inch percussion hole volumes.
3. Percussion holes drilled on 4 foot centers, 5 feet from vertical walls as shown.
4. Where grout takes occur in excess of 2 gallons more than specified, split space grout holes to 2 foot centers.

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
REACTOR 2 GROUT LAYOUT
Figure 2.5-144

Figure 2.5-144 Reactor 2 Grout Layout


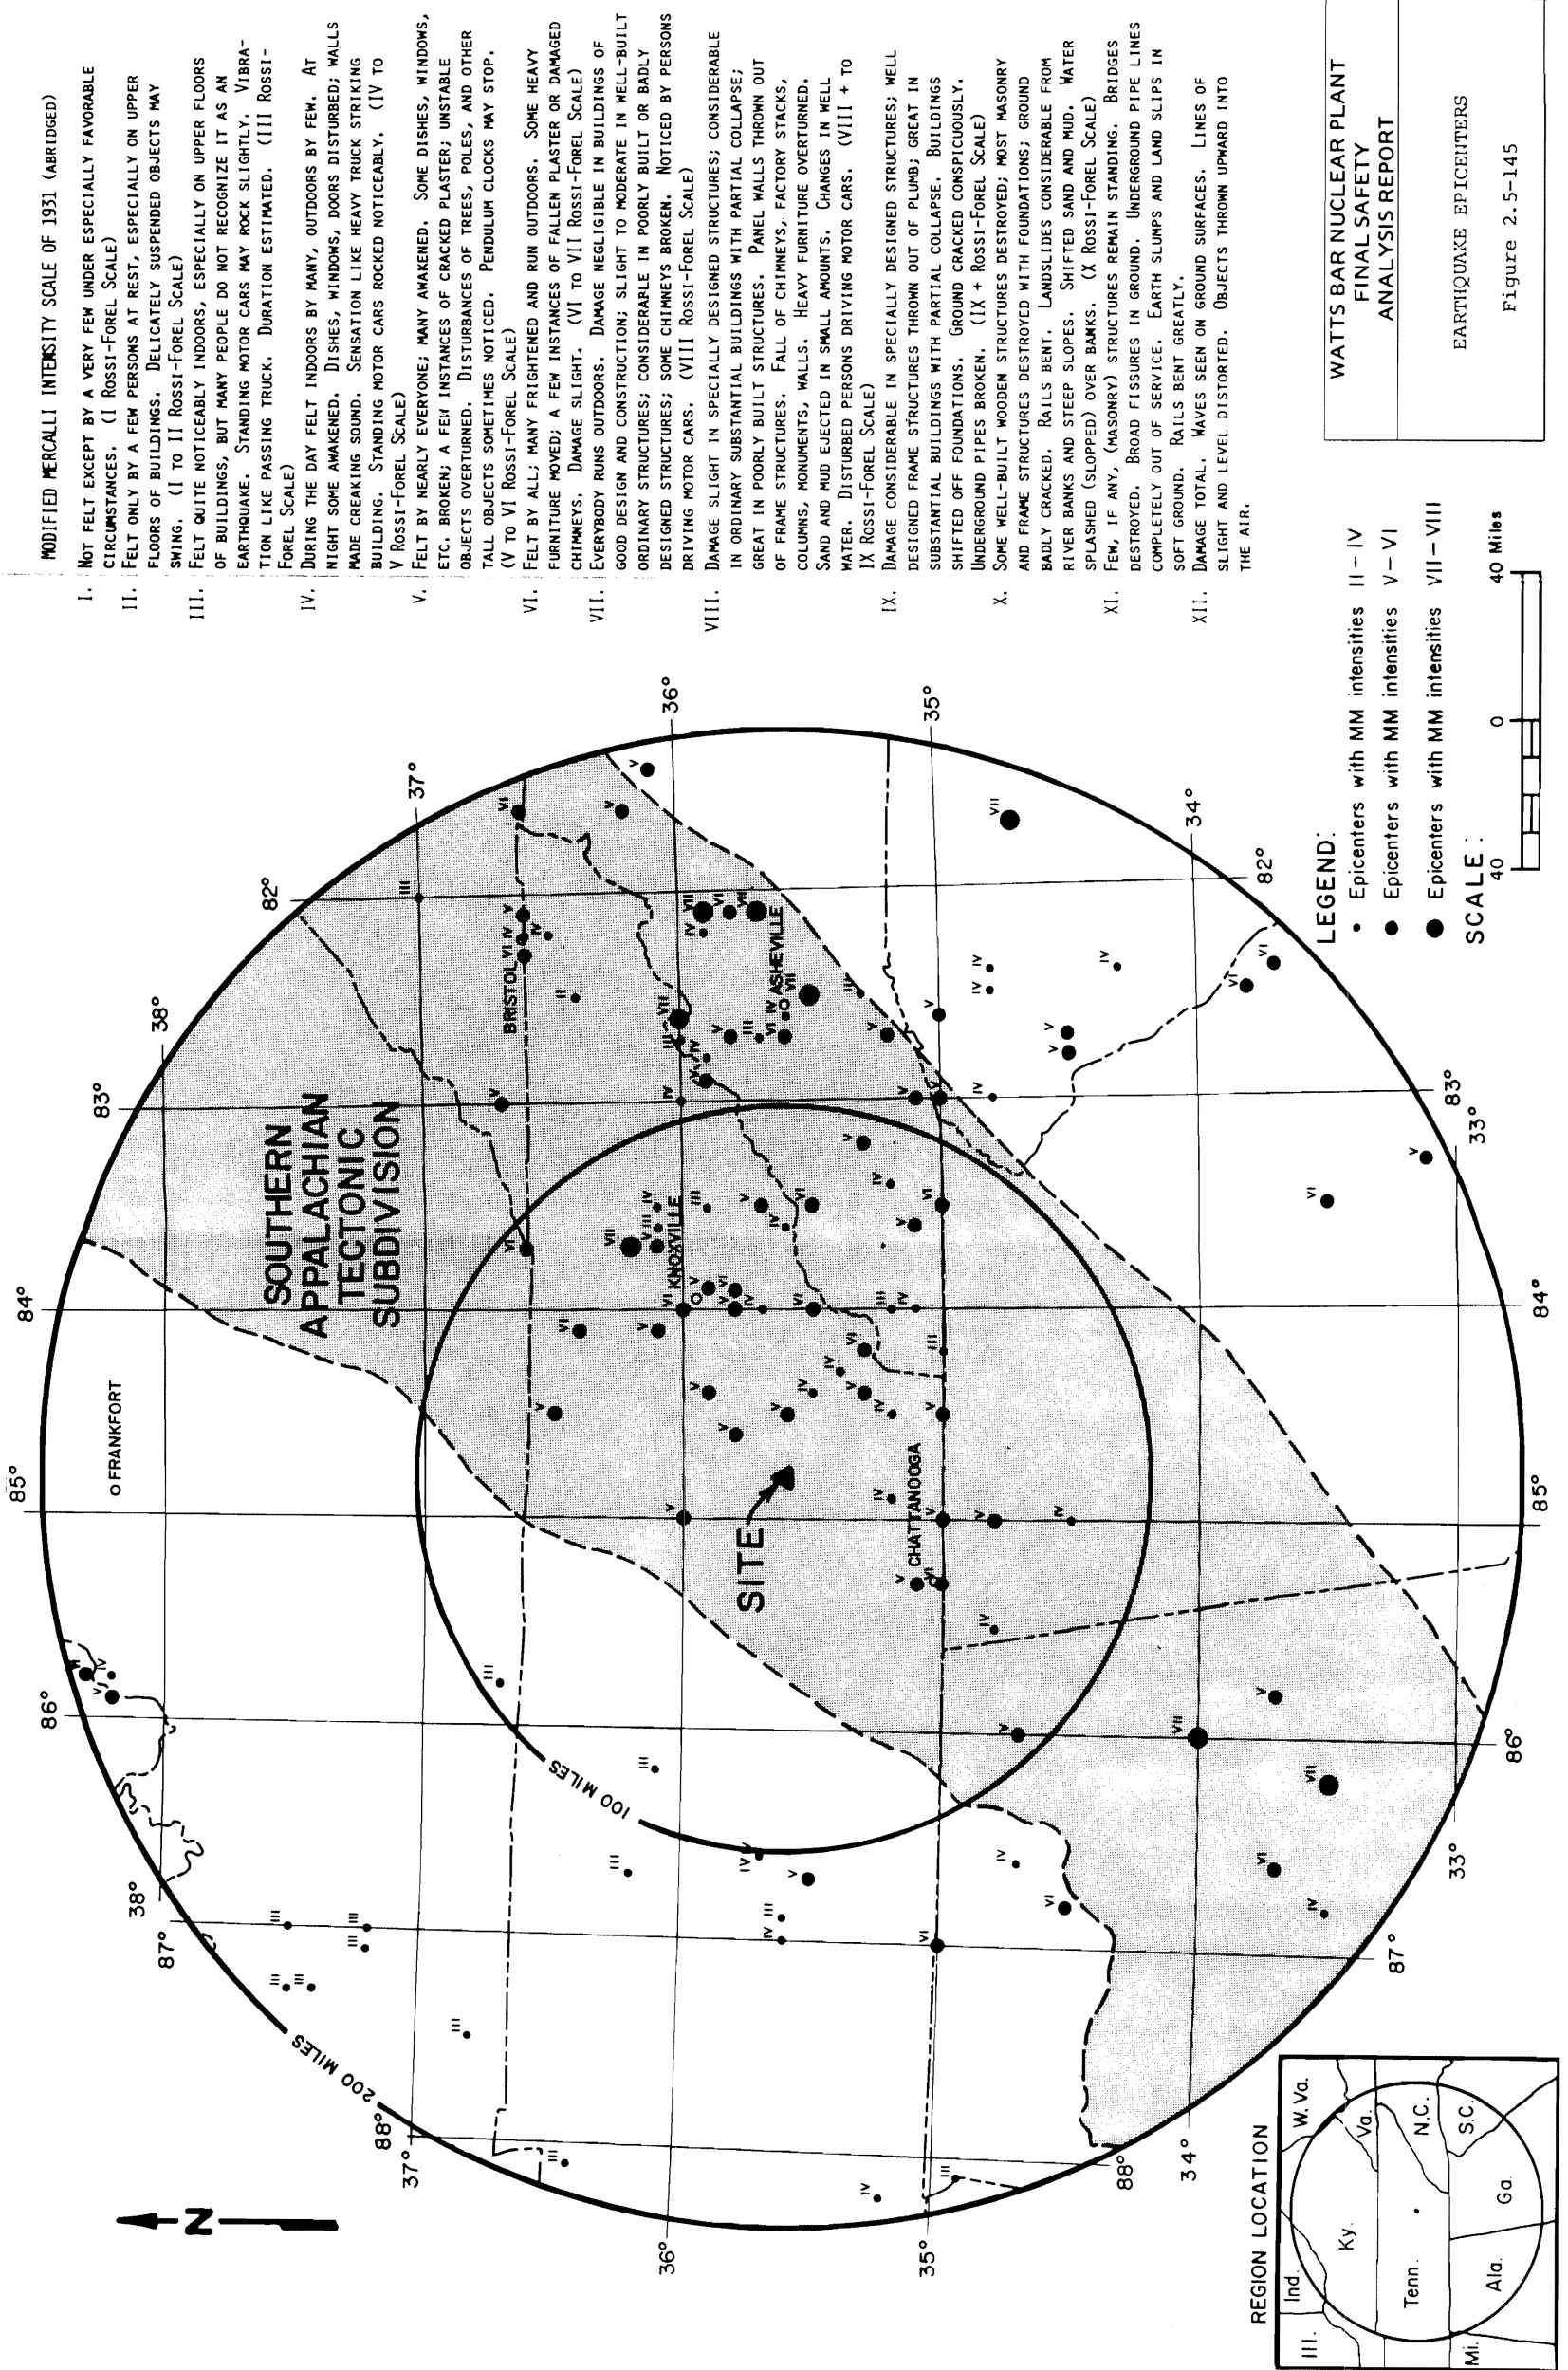


Figure 2.5-145 Earthquake Epicenters

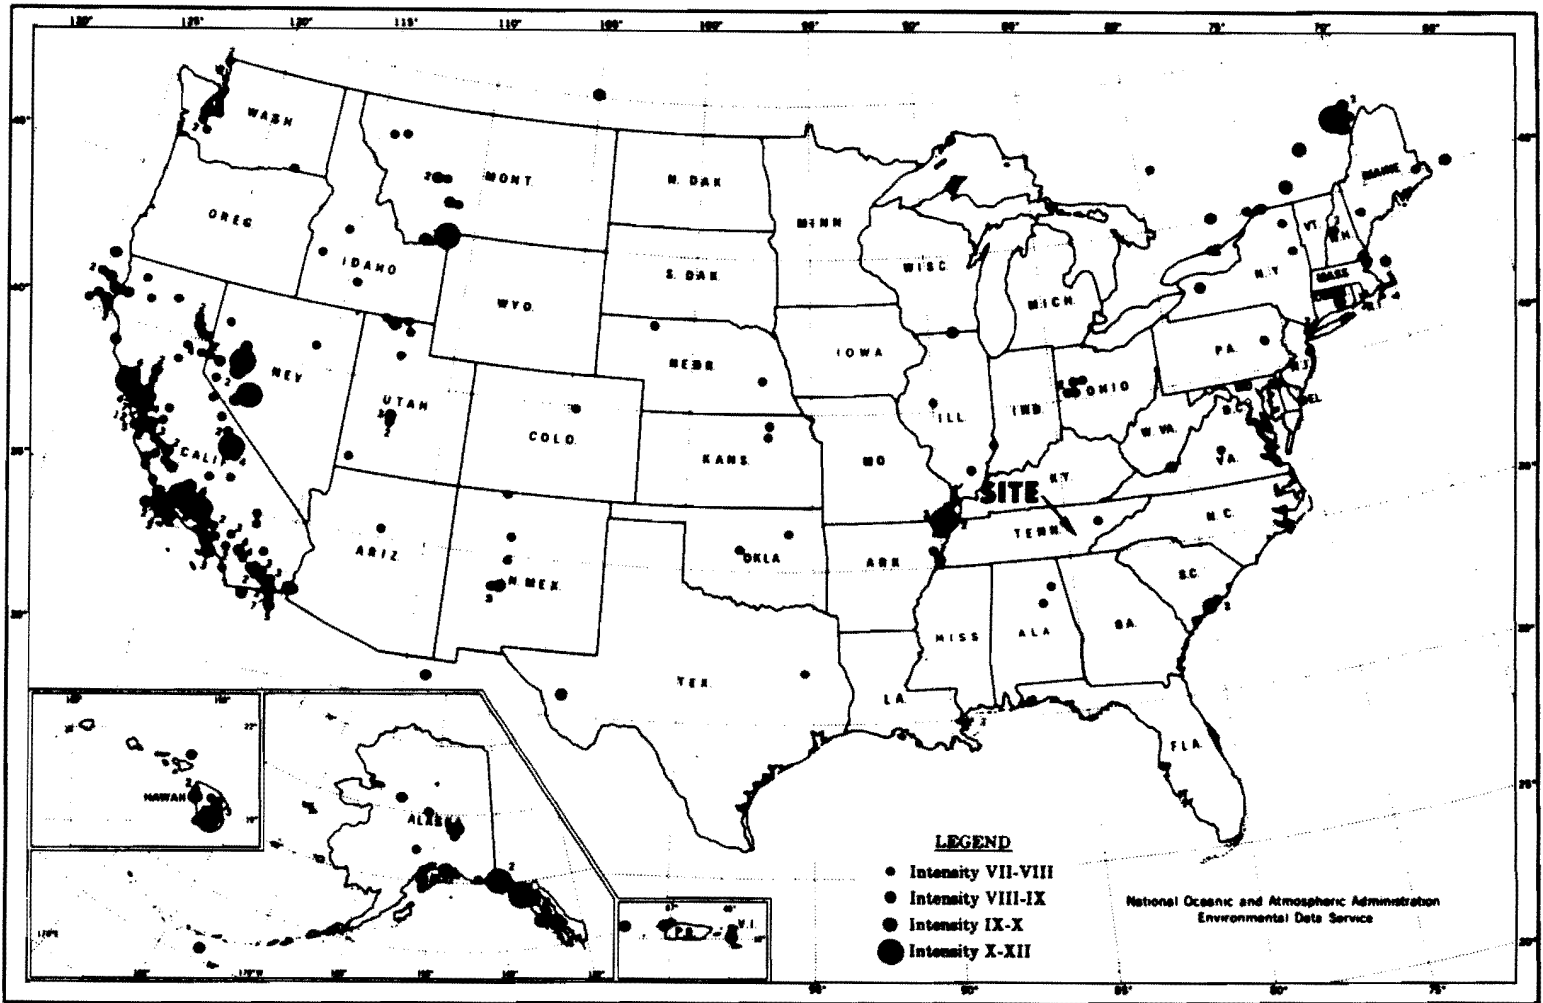


Damaging earthquakes in the United States from earliest history through 1972.
 (From NOAA, 1974)

**WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT**

MAJOR EARTHQUAKES IN
 UNITED STATES THROUGH 1972


Figure 2.5-146

Figure 2.5-146 Major Earthquake In United States Through 1972

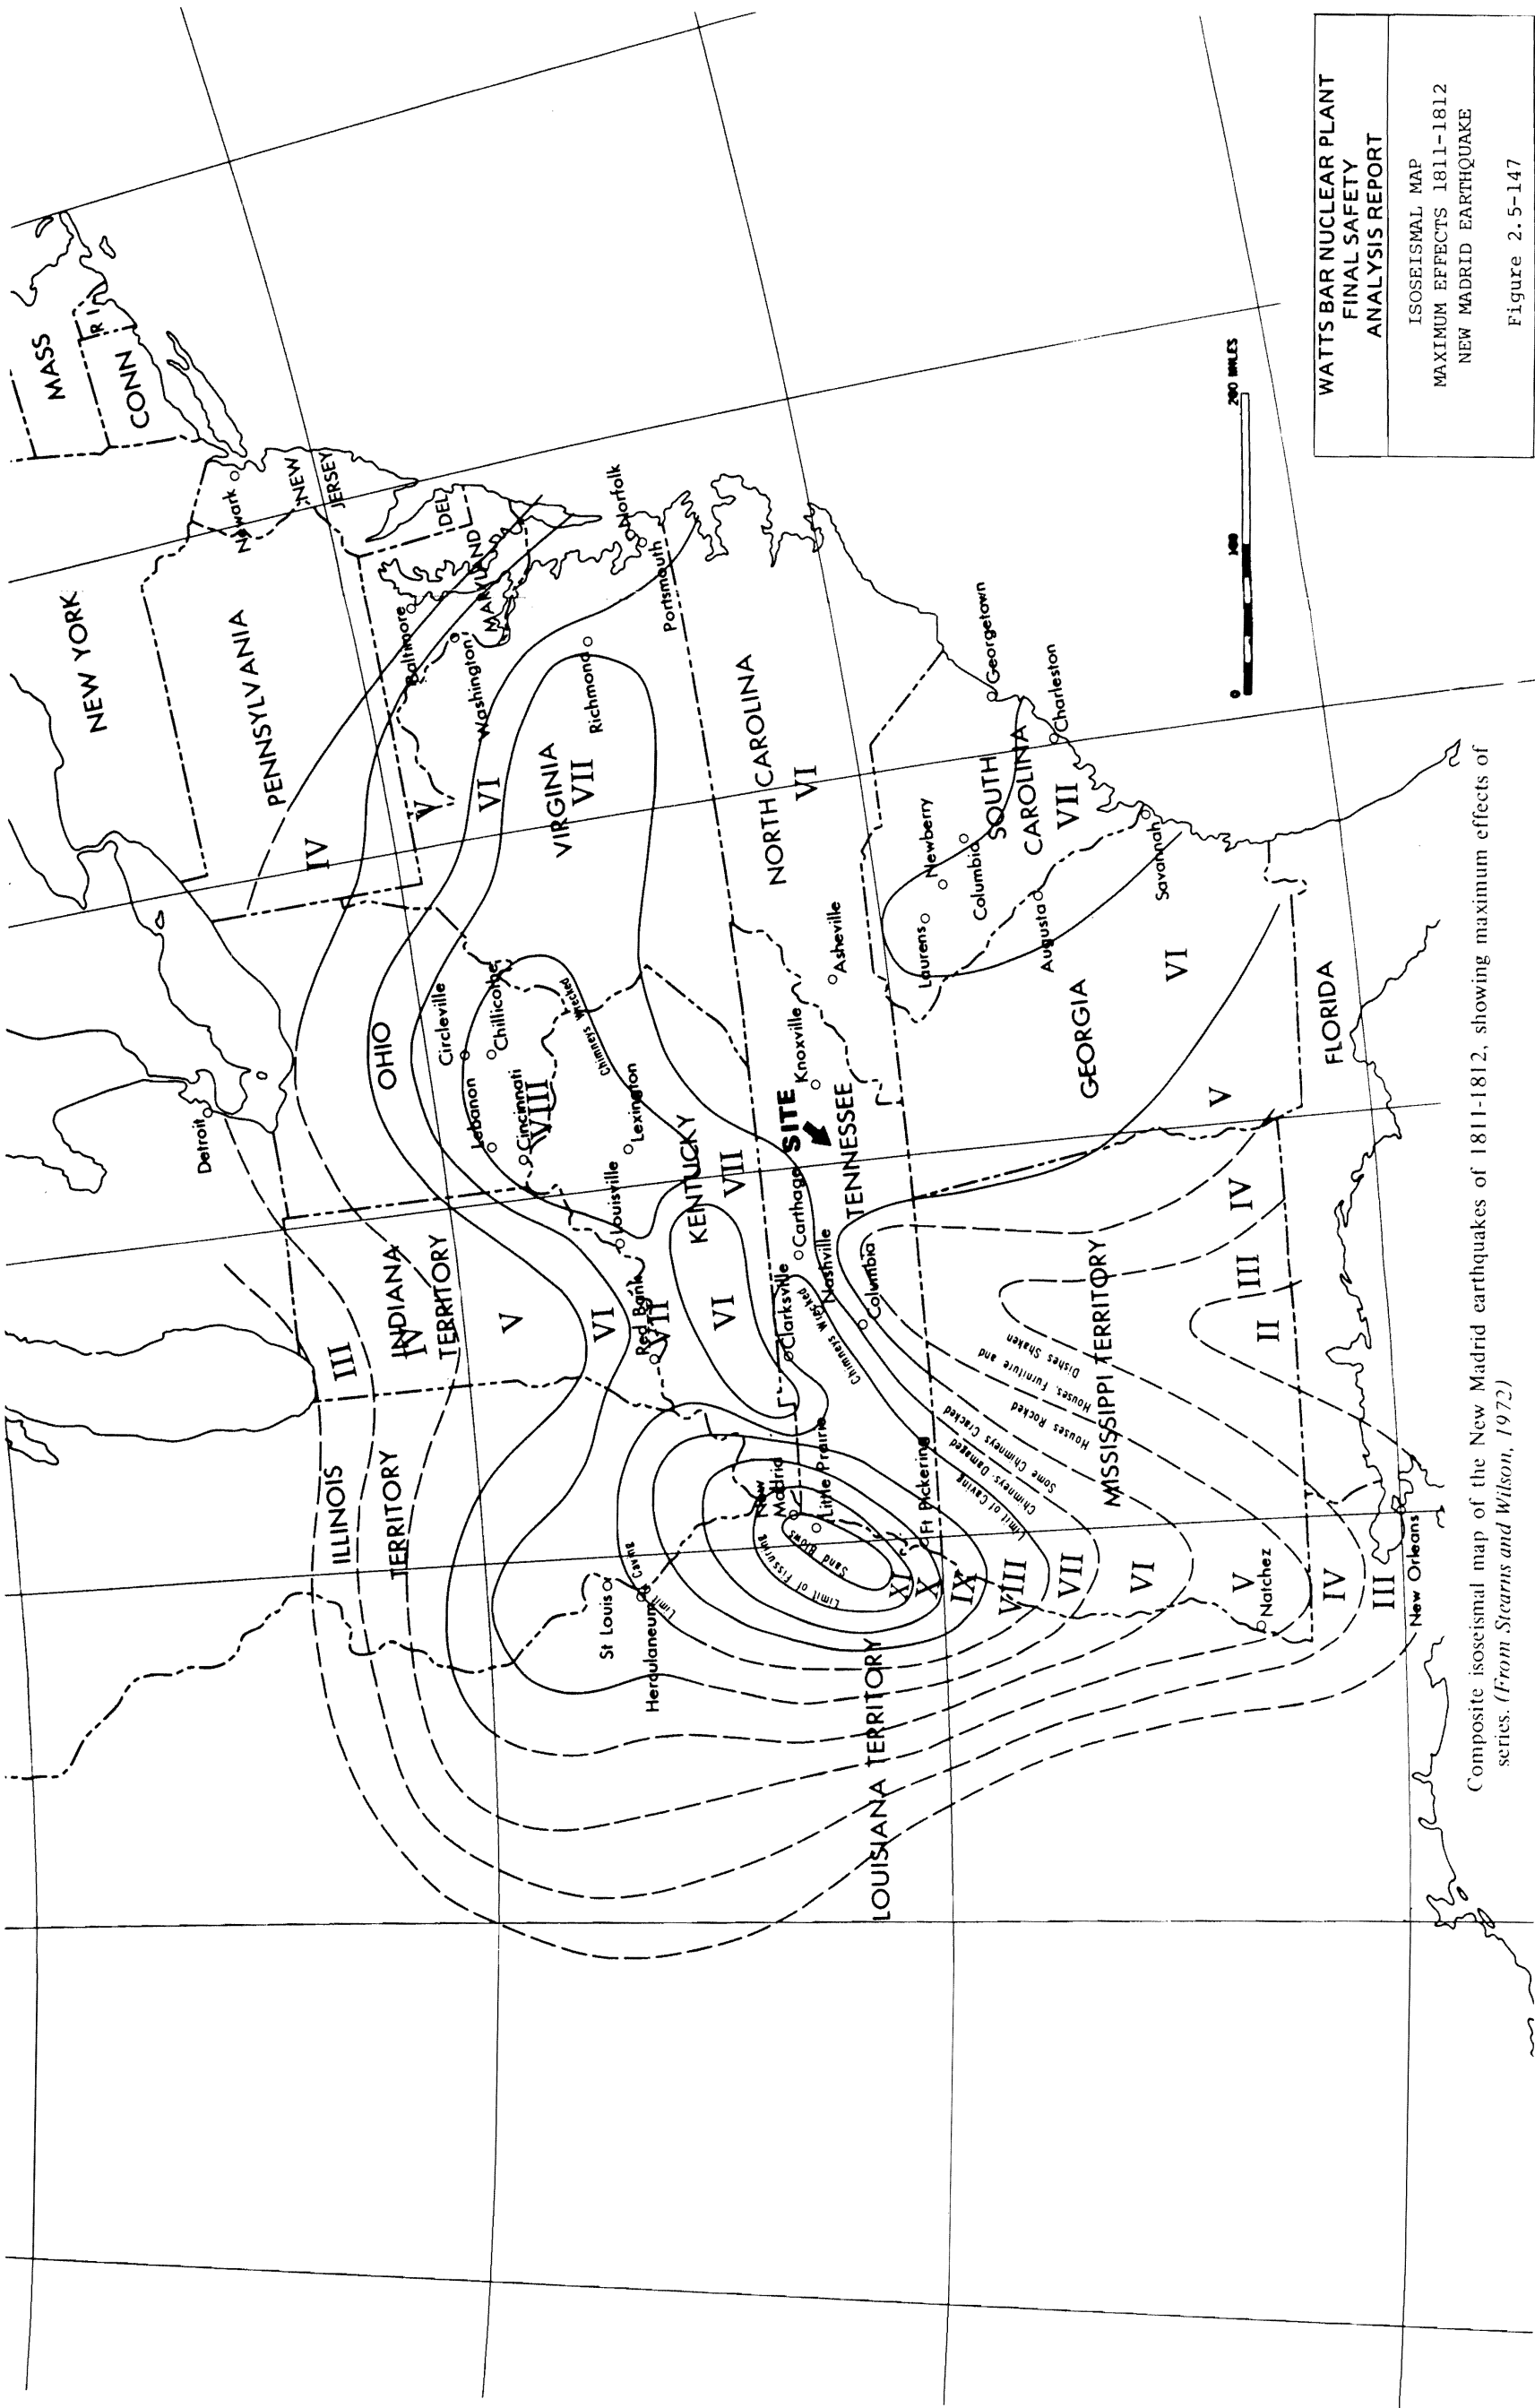

Composite isoseismal map of the New Madrid earthquakes of 1811-1812, showing maximum effects of series. (From Stearns and Wilson, 1972)

Figure 2.5-147 Isoseismal Map Maximum Effects 1811-1812 New Madrid Earthquake

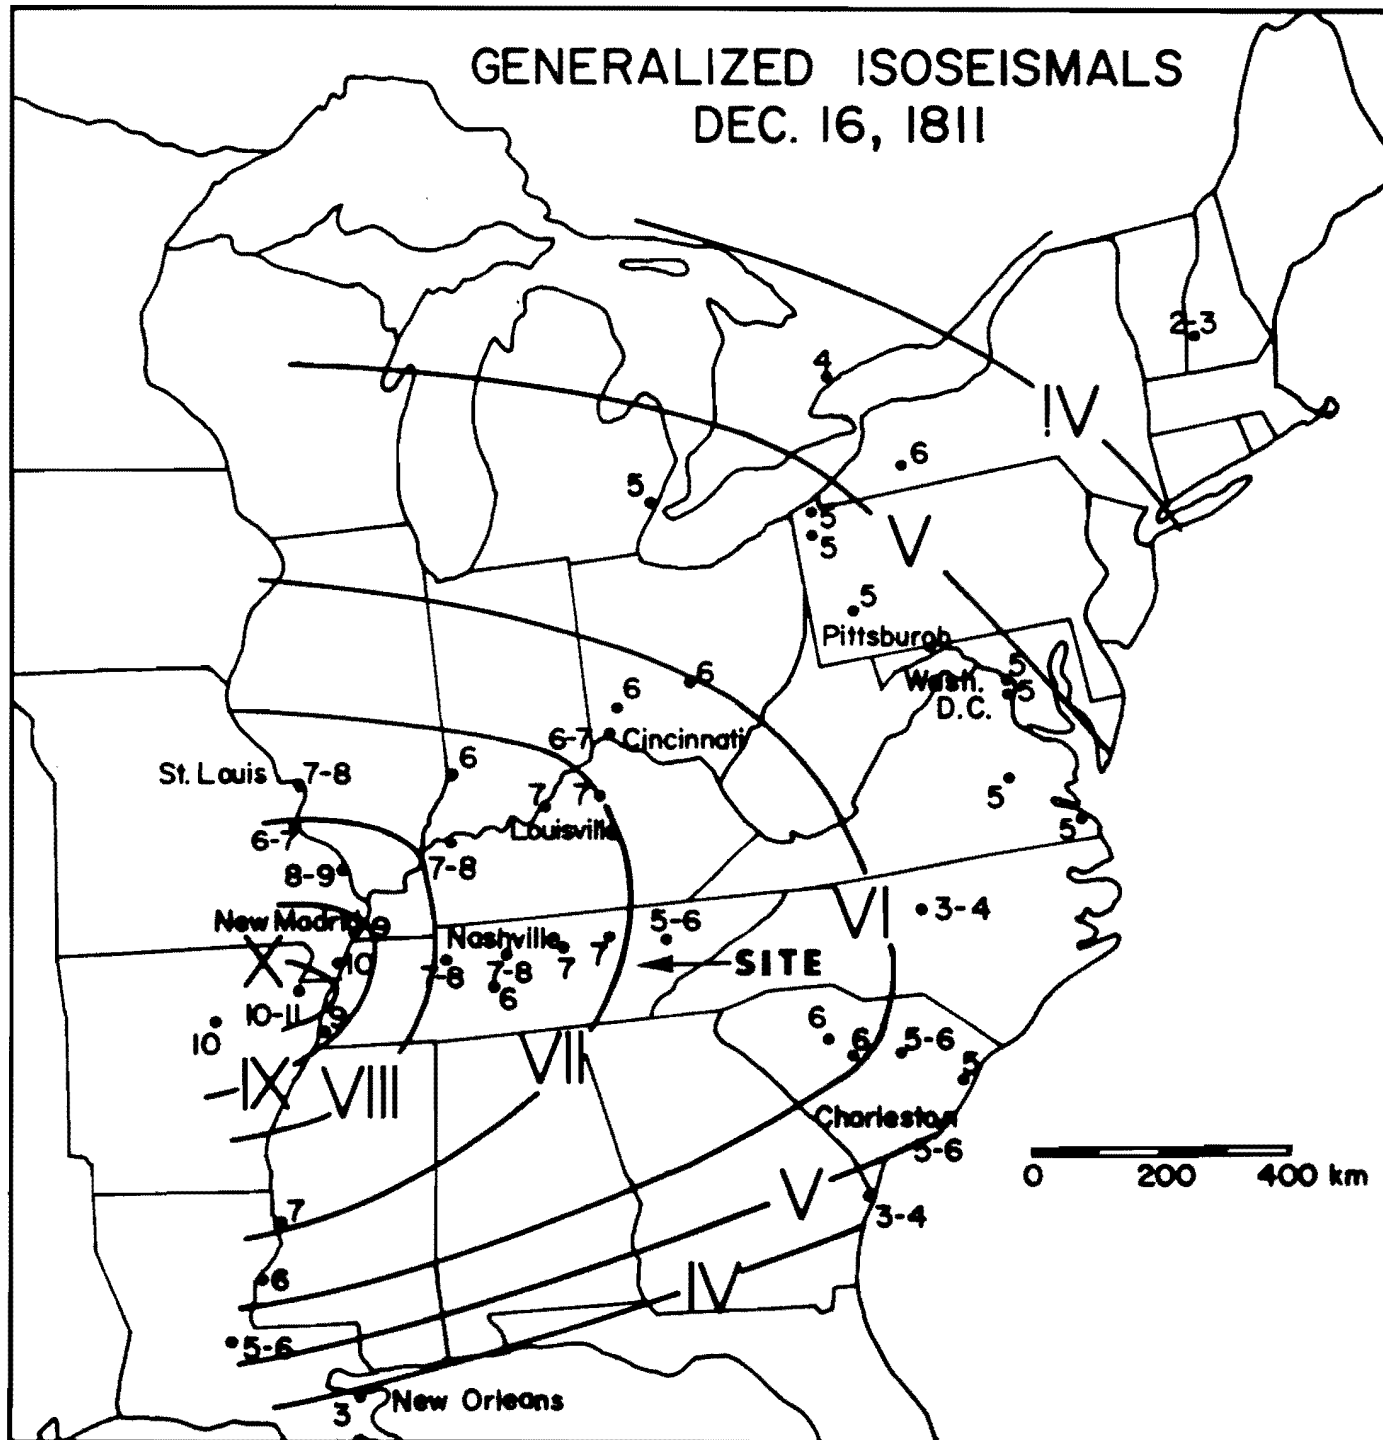


Generalized isoseismal map of the New Madrid earthquake of December 16, 1811.
(From Nuttli, 1972)

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
ISOSEISMAL MAP 1811 NEW MADRID EARTHQUAKE
Figure 2.5-148


Figure 2.5-148 Isoseismal Map 1811 New Madrid Earthquake

EARTHQUAKE OF MAY 31 1897 GILES COUNTY VIRGINIA
(MONDAY 1358 Hrs.) FELT AREA 280 000 SQ MI

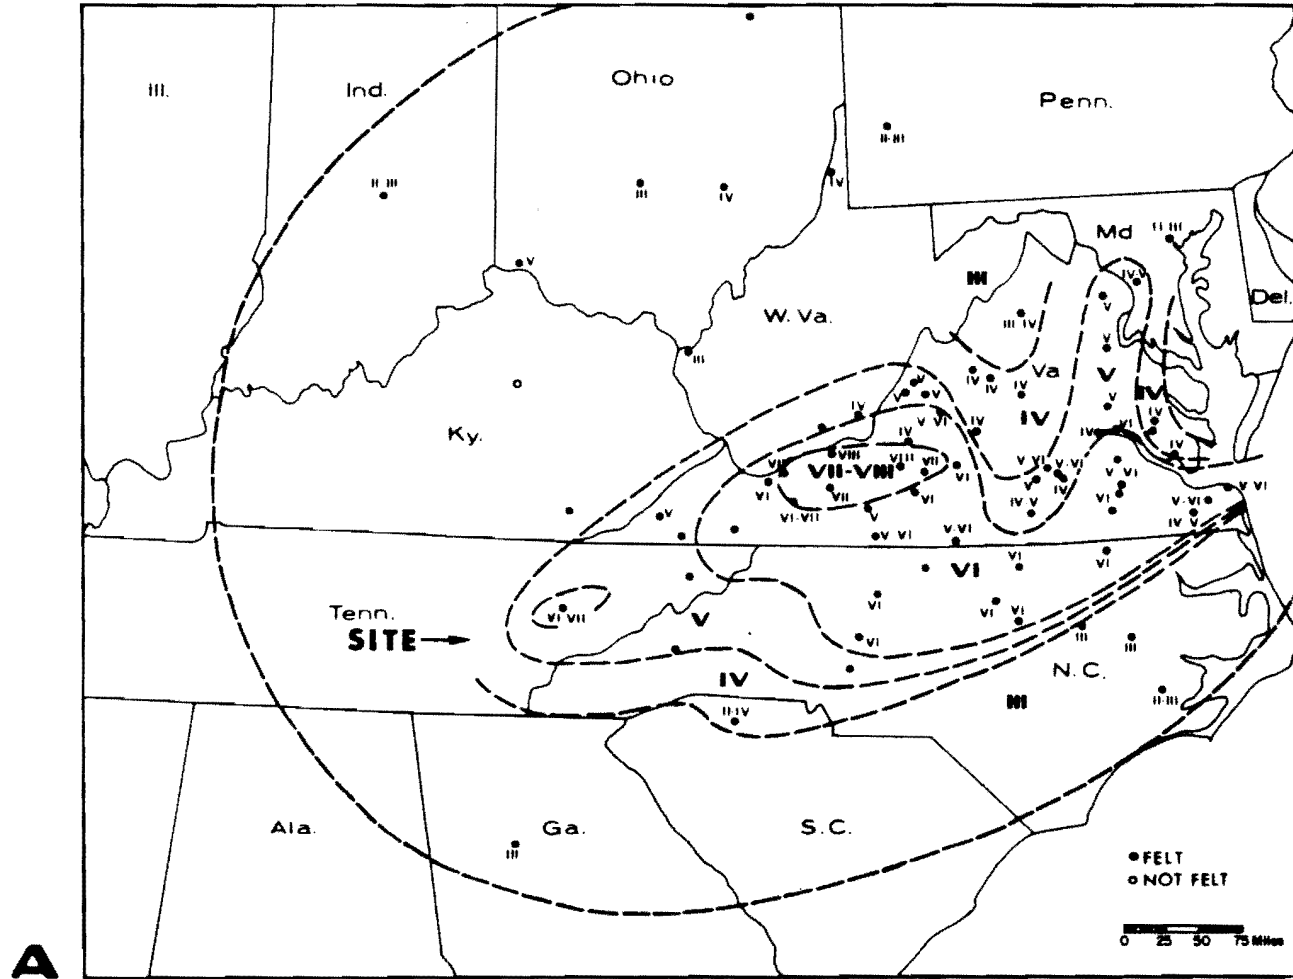

From Hopper and Bollinger, 1971

EARTHQUAKE OF AUGUST 31, 1861,
VIRGINIA, (SATURDAY, 0522 Hrs.),
FELT AREA: 300,000 SQ. MI., (BOLLINGER, 1969)

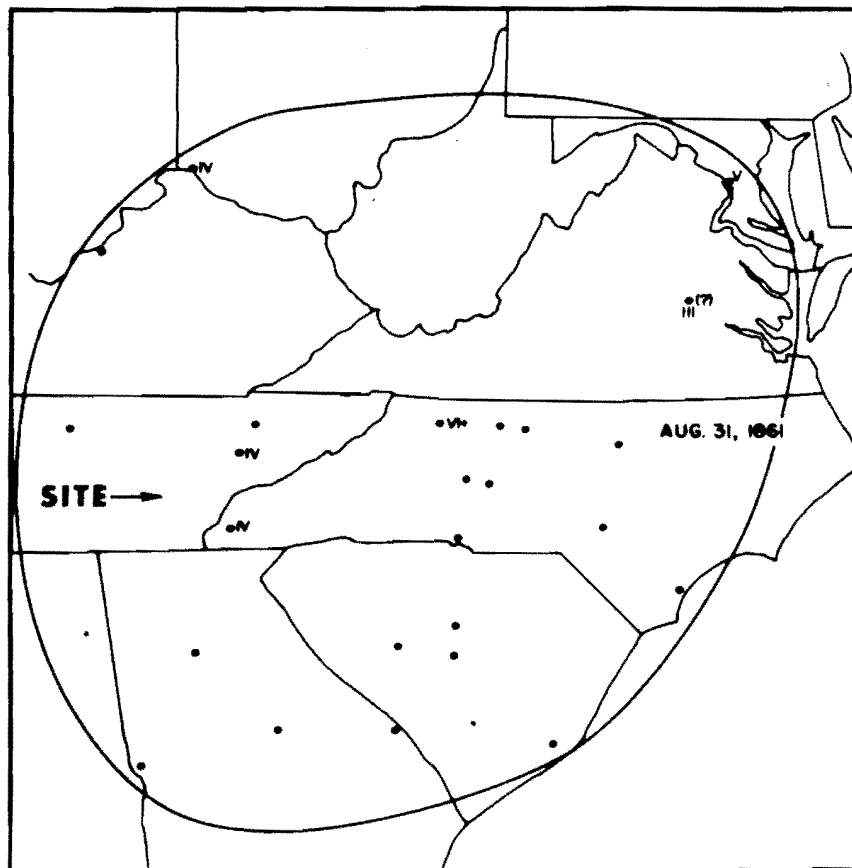

From Hopper and Bollinger, 1971

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

FELT AREA MAPS

Figure 2.5-149


Figure 2.5-149 Felt Area Maps



Isoseismal map of the Charleston, South Carolina earthquake of August 31, 1886.
(From Dutton, 1889)

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>ISOSEISMAL MAP 1886 CHARLESTON, S.C. EARTHQUAKE</p>
<p>Figure 2.5-150</p>


Figure 2.5-150 Isoseismal Map 1886 Charleston, S.C. Earthquake

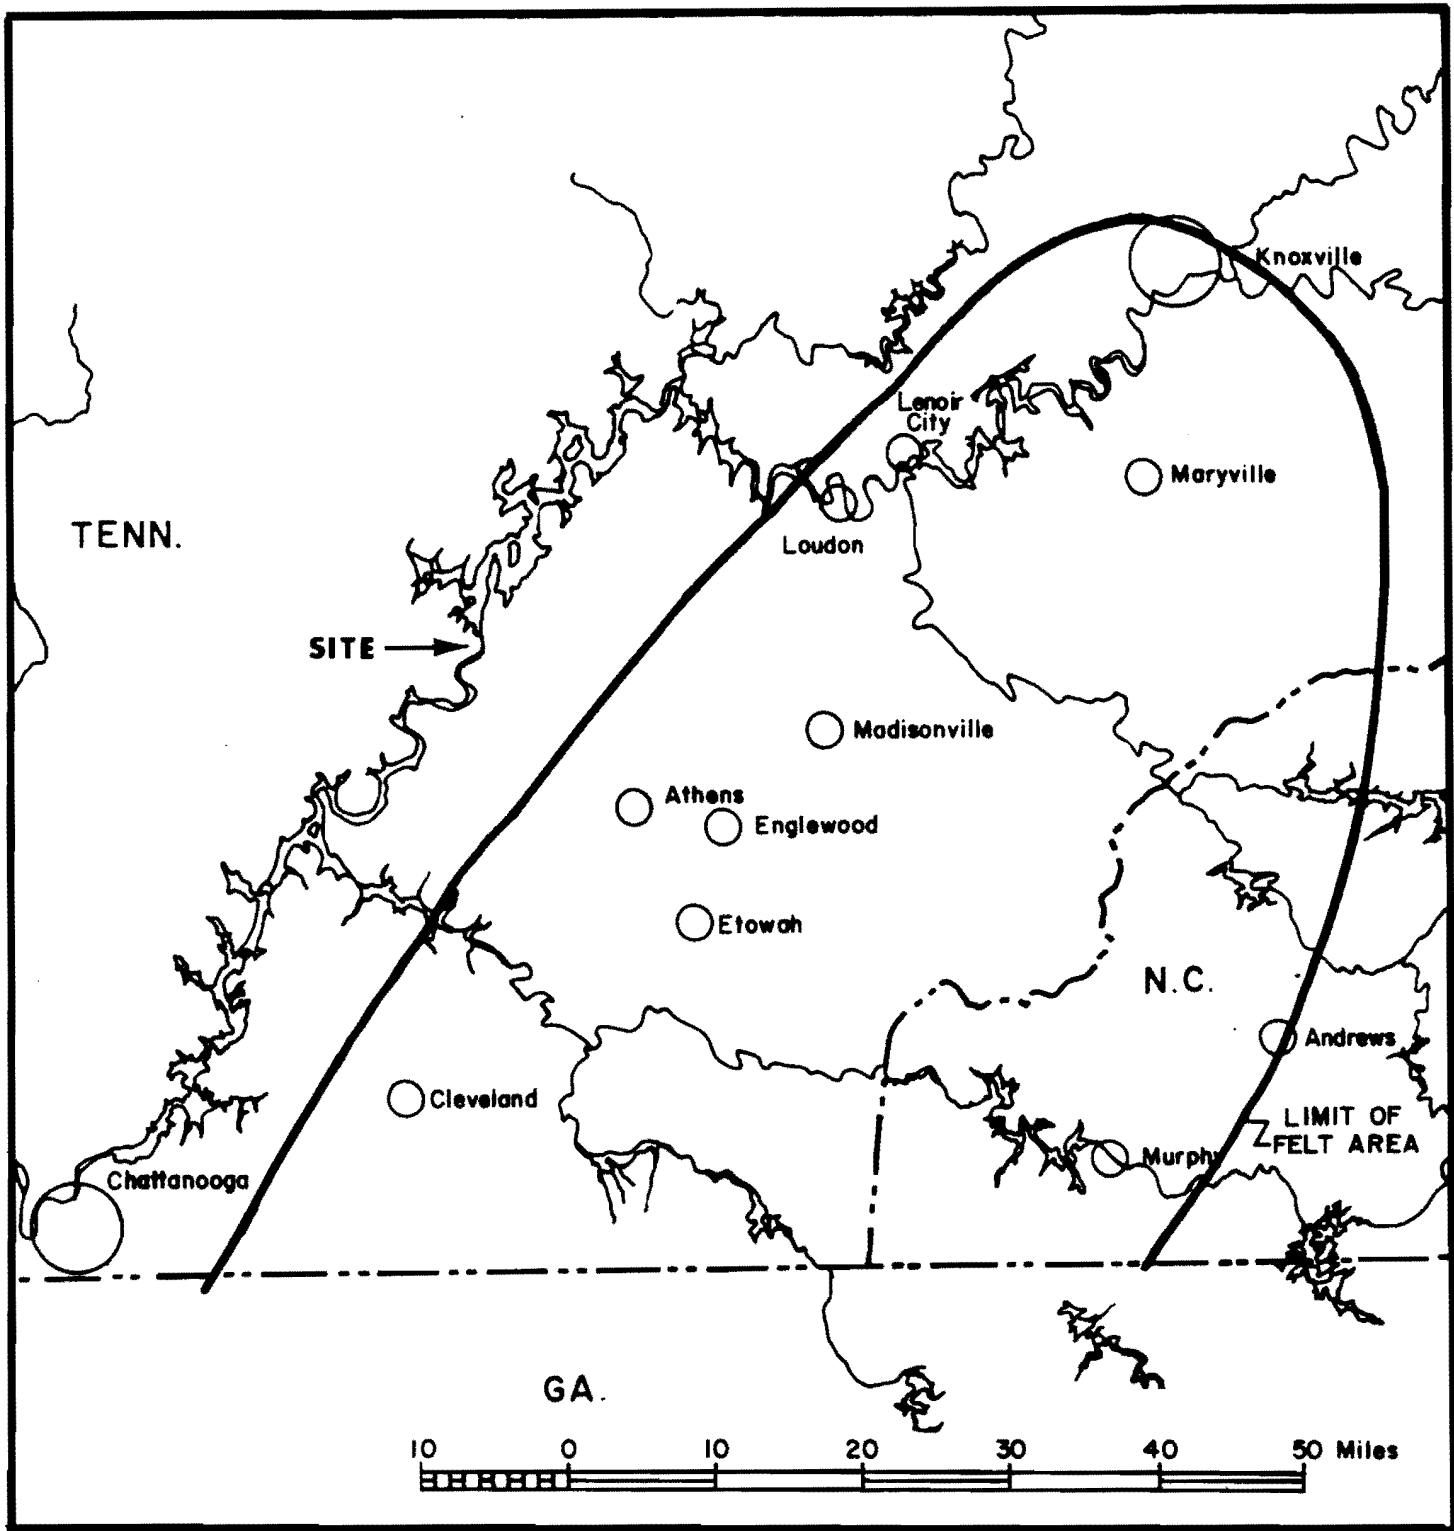

Felt area map of the east Tennessee earthquake of April 17, 1913.
(From Gordon, 1913)

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
FELT AREA MAP EAST TENNESSEE EARTHQUAKE OF APRIL 17, 1913 Figure 2.5-151


Figure 2.5-151 Felt Area Map East Tennessee Earthquake of April 17, 1913

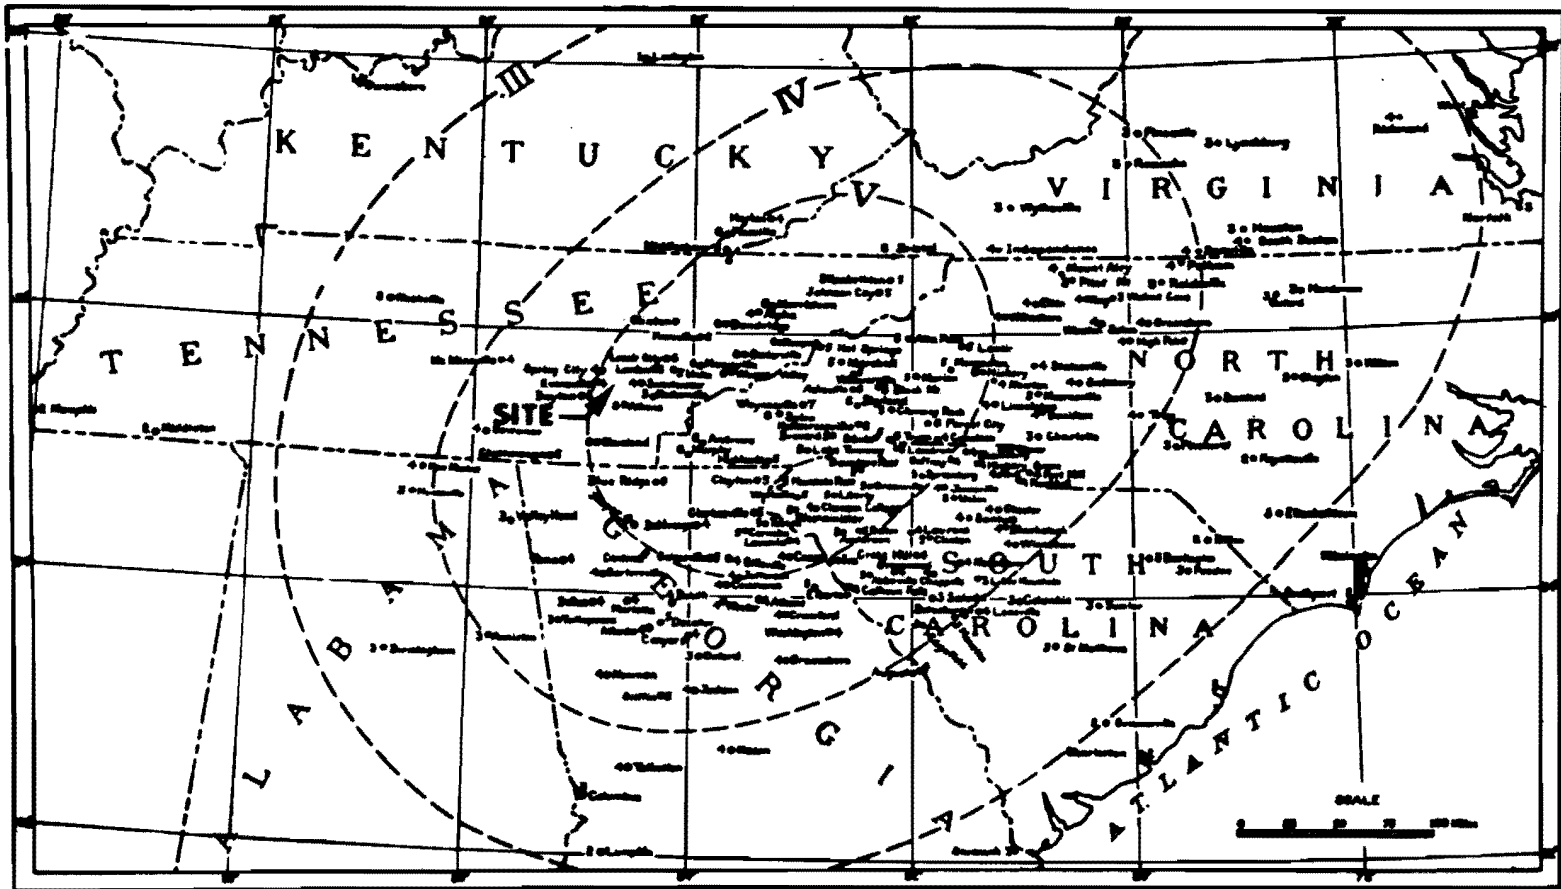

Iseismal map of the Southern Appalachians earthquake of February 21, 1916. (From Tabor, 1916)

<p style="text-align: center;">WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p style="text-align: center;">ISOSEISMAL MAP 1916 SOUTHERN APPALACHIAN EARTHQUAKE</p>
<p style="text-align: center;">Figure 2.5-152</p>


Figure 2.5-152 Iseismal Map 1916 Southern Appalachian Earthquake

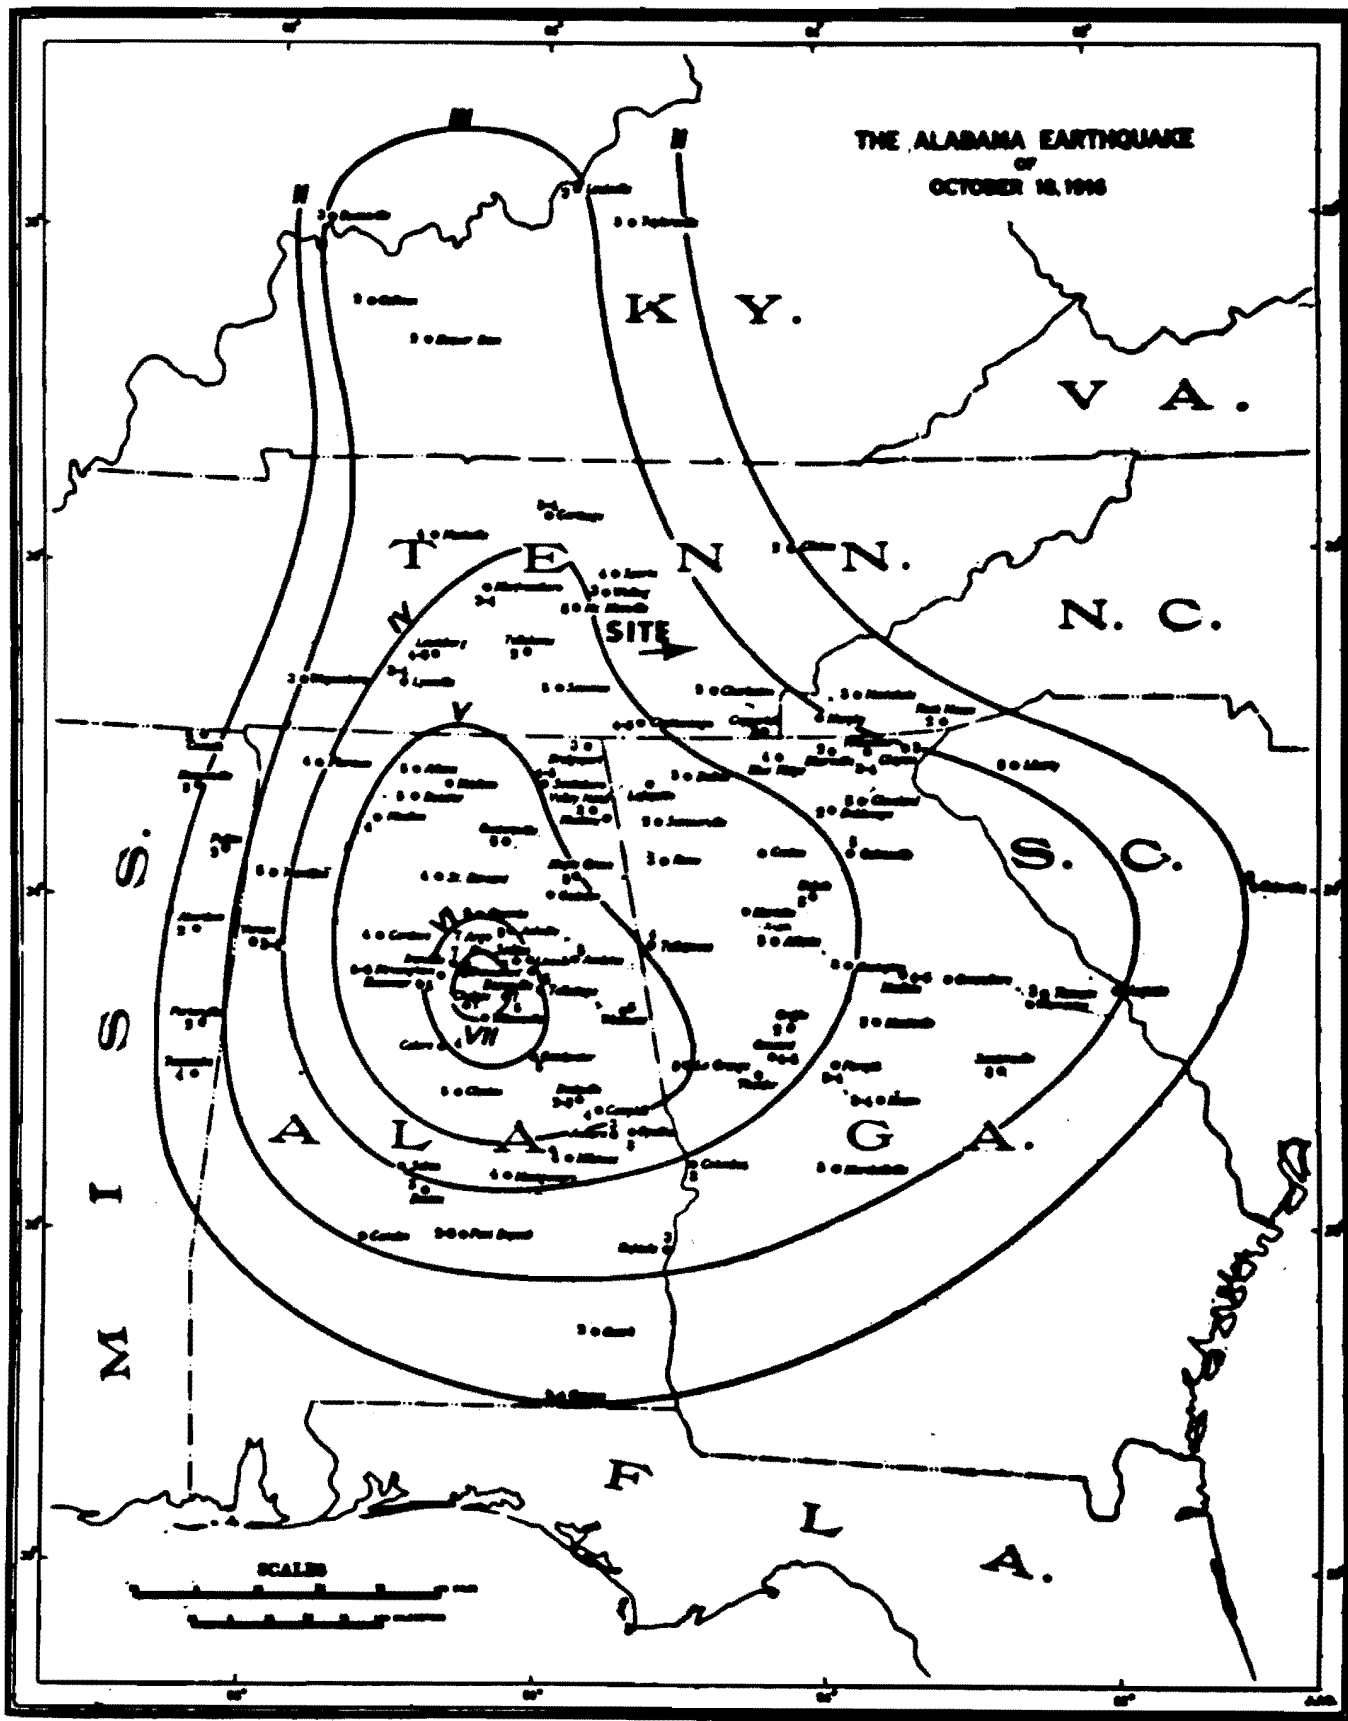

Isoseismal map of the Alabama earthquake of October 18, 1916. (From Finch, 1916)

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
ISOSEISMAL MAP 1916 ALABAMA EARTHQUAKE
Figure 2.5-153


Figure 2.5-153 Isoseismal Map 1916 Alabama Earthquake

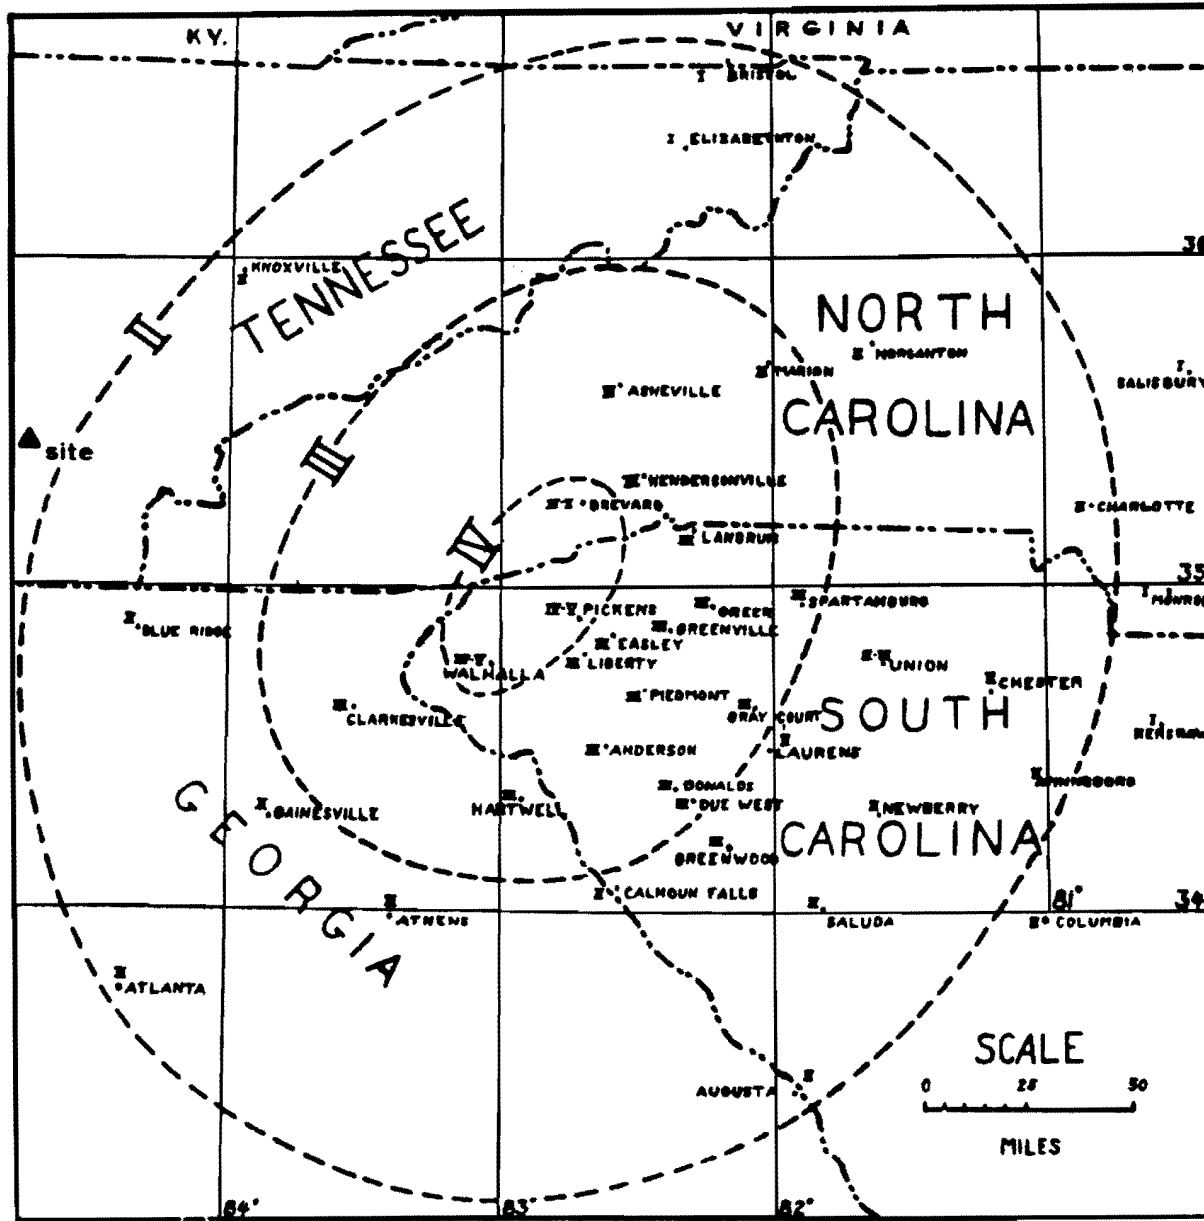

Isoseismal map of the Southern Appalachian earthquake of October 20, 1924. (From Neumann, 1924)

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>ISOSEISMAL MAP 1924 SOUTHERN APPALACHIAN EARTHQUAKE</p>
<p>Figure 2.5-154</p>


Figure 2.5-154 Isoseismal Map 1924 Southern Appalachian Earthquake

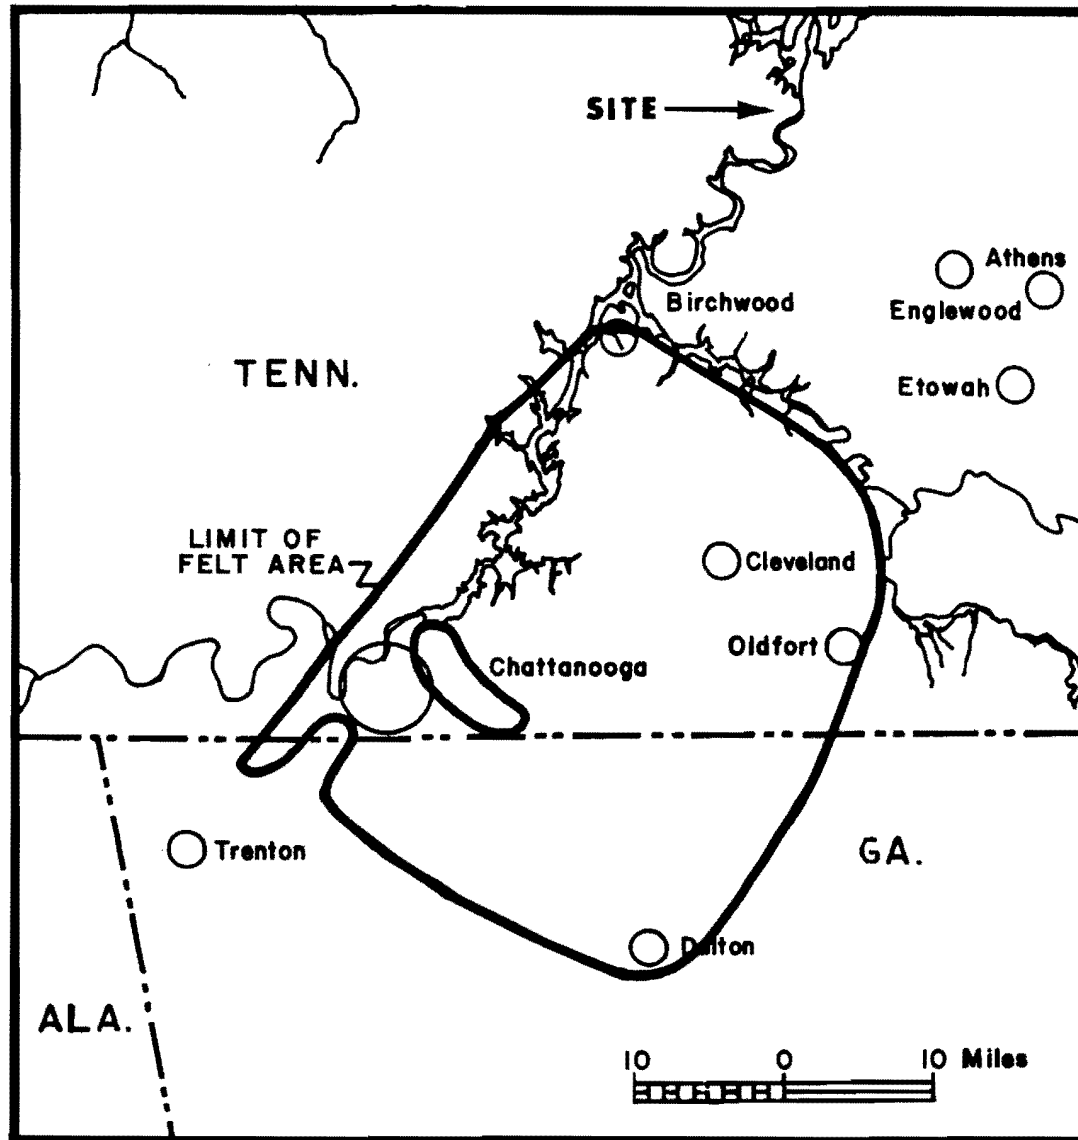

Felt area map of the Chattanooga earthquake of October 19, 1940.
(From Brill, 1940)

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
FELT AREA MAP 1940 CHATTANOOGA EARTHQUAKE
Figure 2.5-155


Figure 2.5-155 Felt Area Map 1940 Chattanooga Earthquake

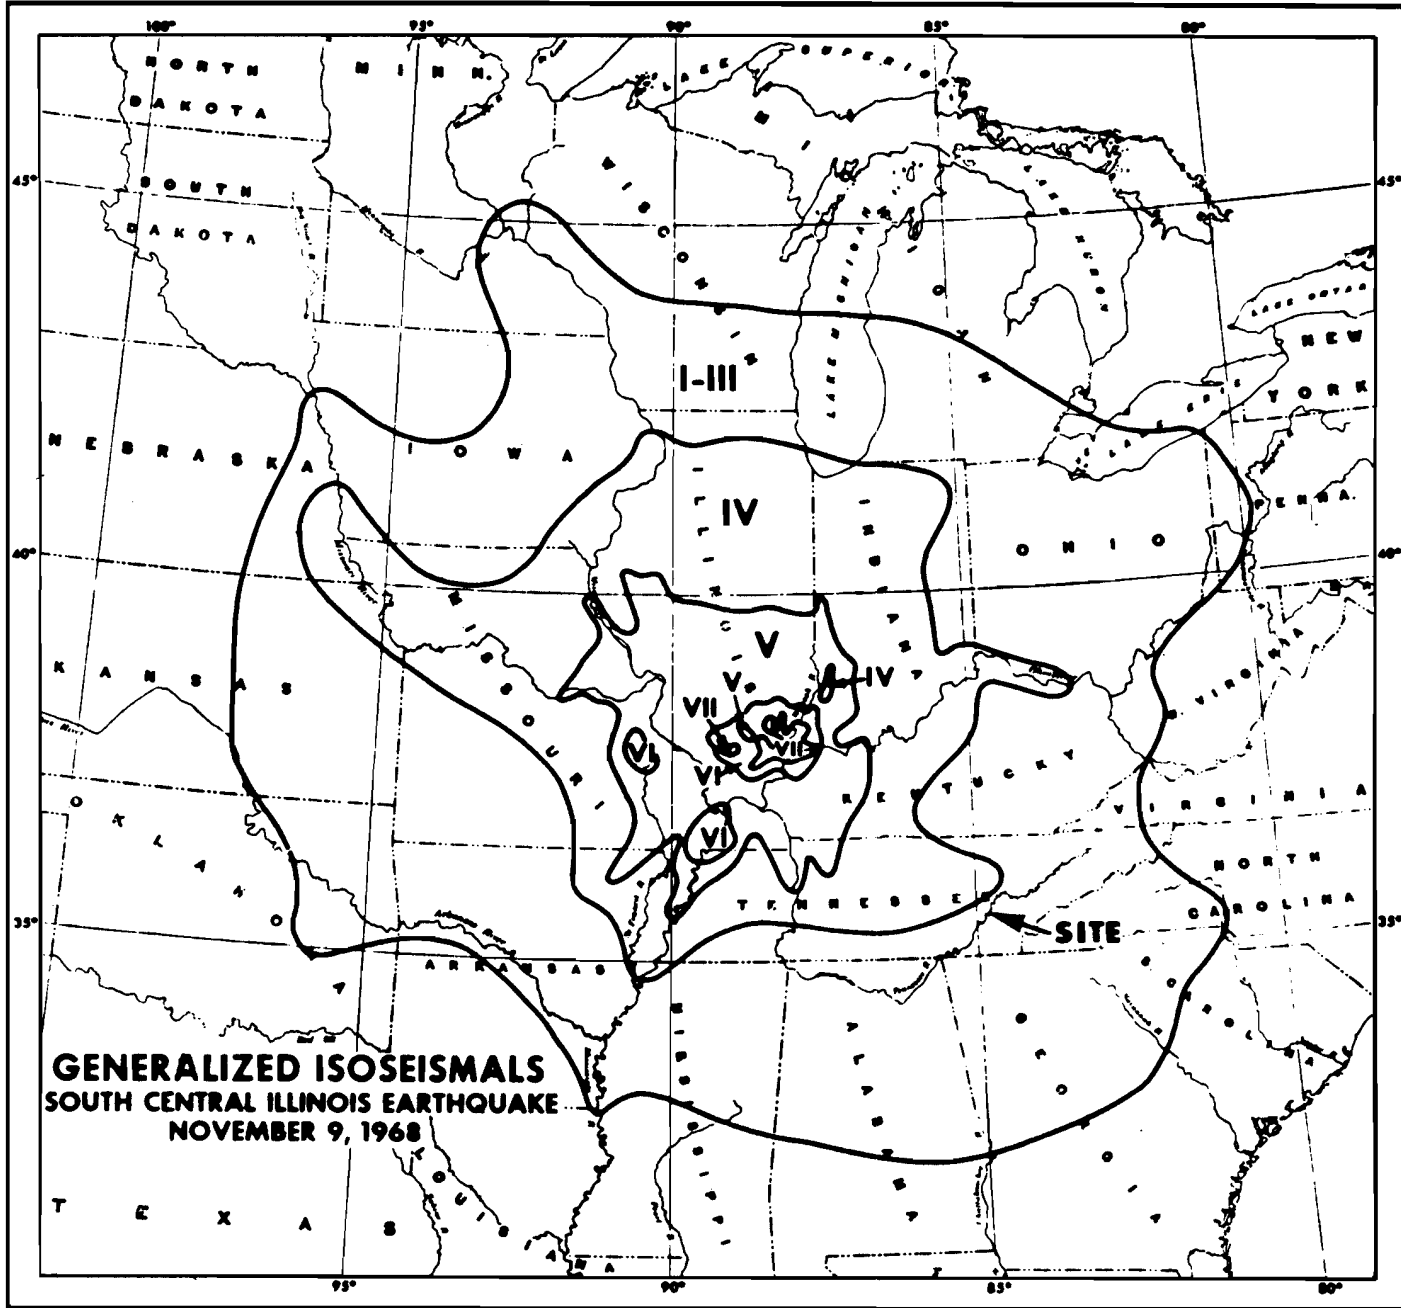

Isoseismal map of the Hamilton County, Illinois earthquake of November 9, 1968.
 (From Gordon and others, 1968)

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>ISOSEISMAL MAP 1968 SOUTHERN ILLINOIS EARTHQUAKE</p>
<p>Figure 2.5-156</p>


Figure 2.5-156 Isoseismal Map 1968 Southern Illinois Earthquake

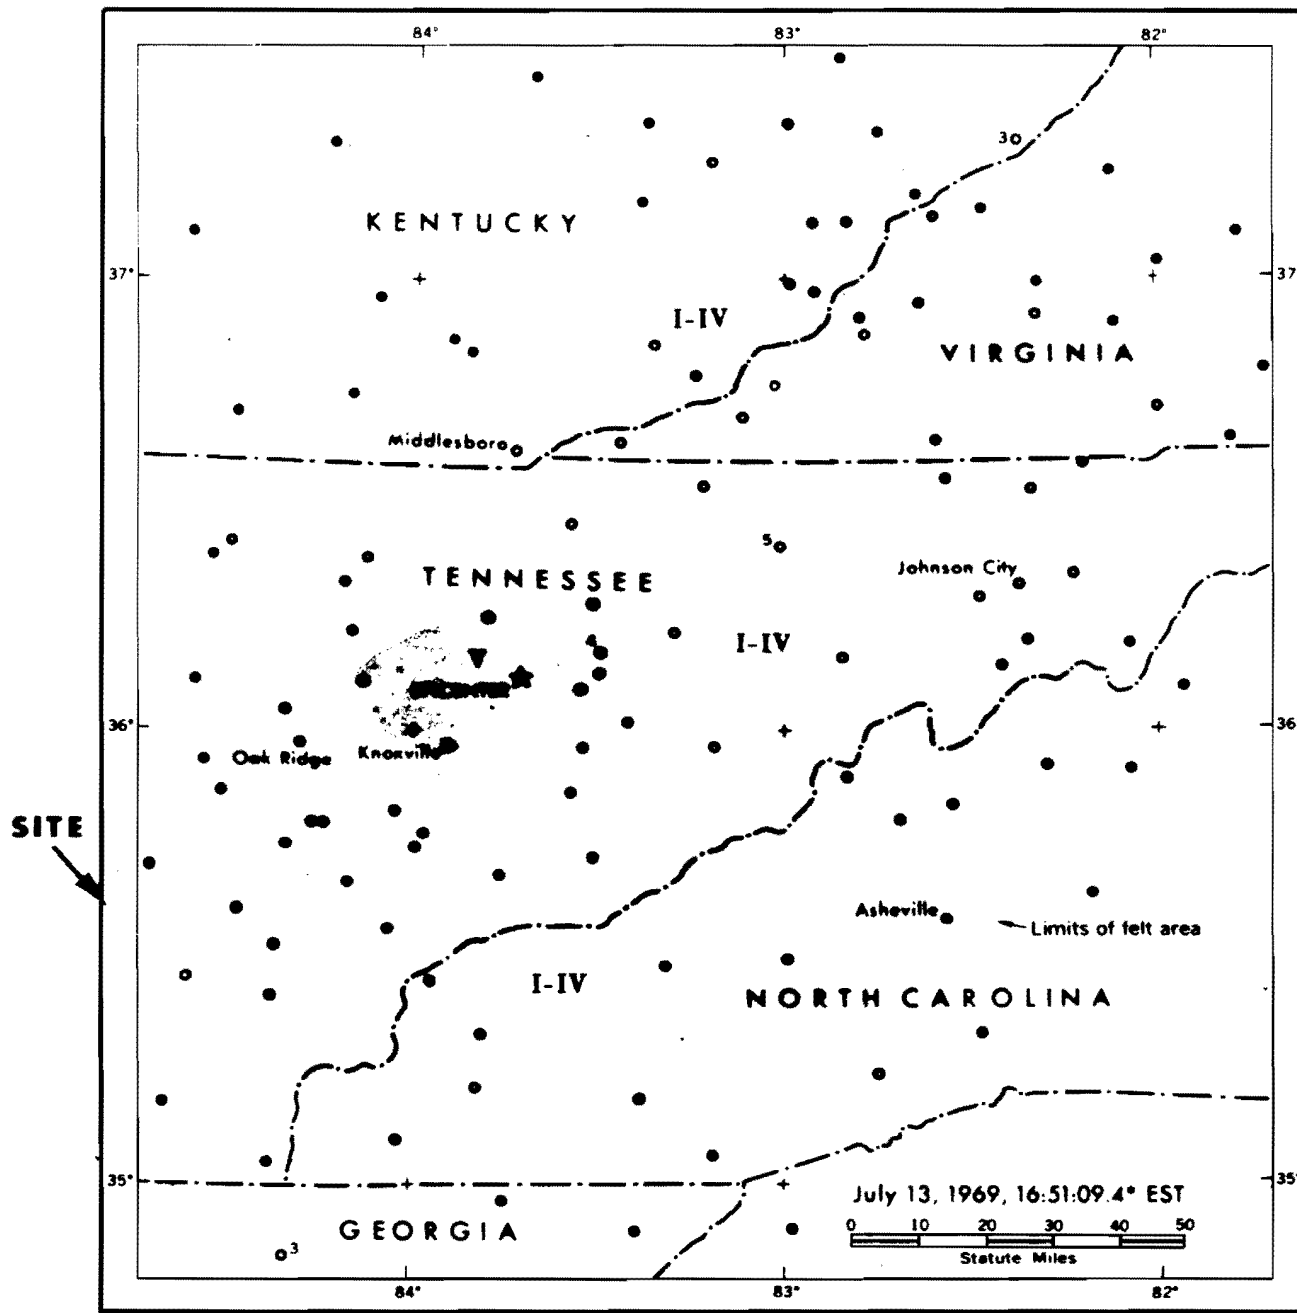

Felt area map of the East Tennessee earthquake of July 13, 1969. (From NOAA, 1971)

WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT
FELT AREA MAP EAST TENNESSEE EARTHQUAKE JULY 13, 1969
Figure 2.5-157


Figure 2.5-157 Felt Area Map East Tennessee Earthquake July 13, 1969

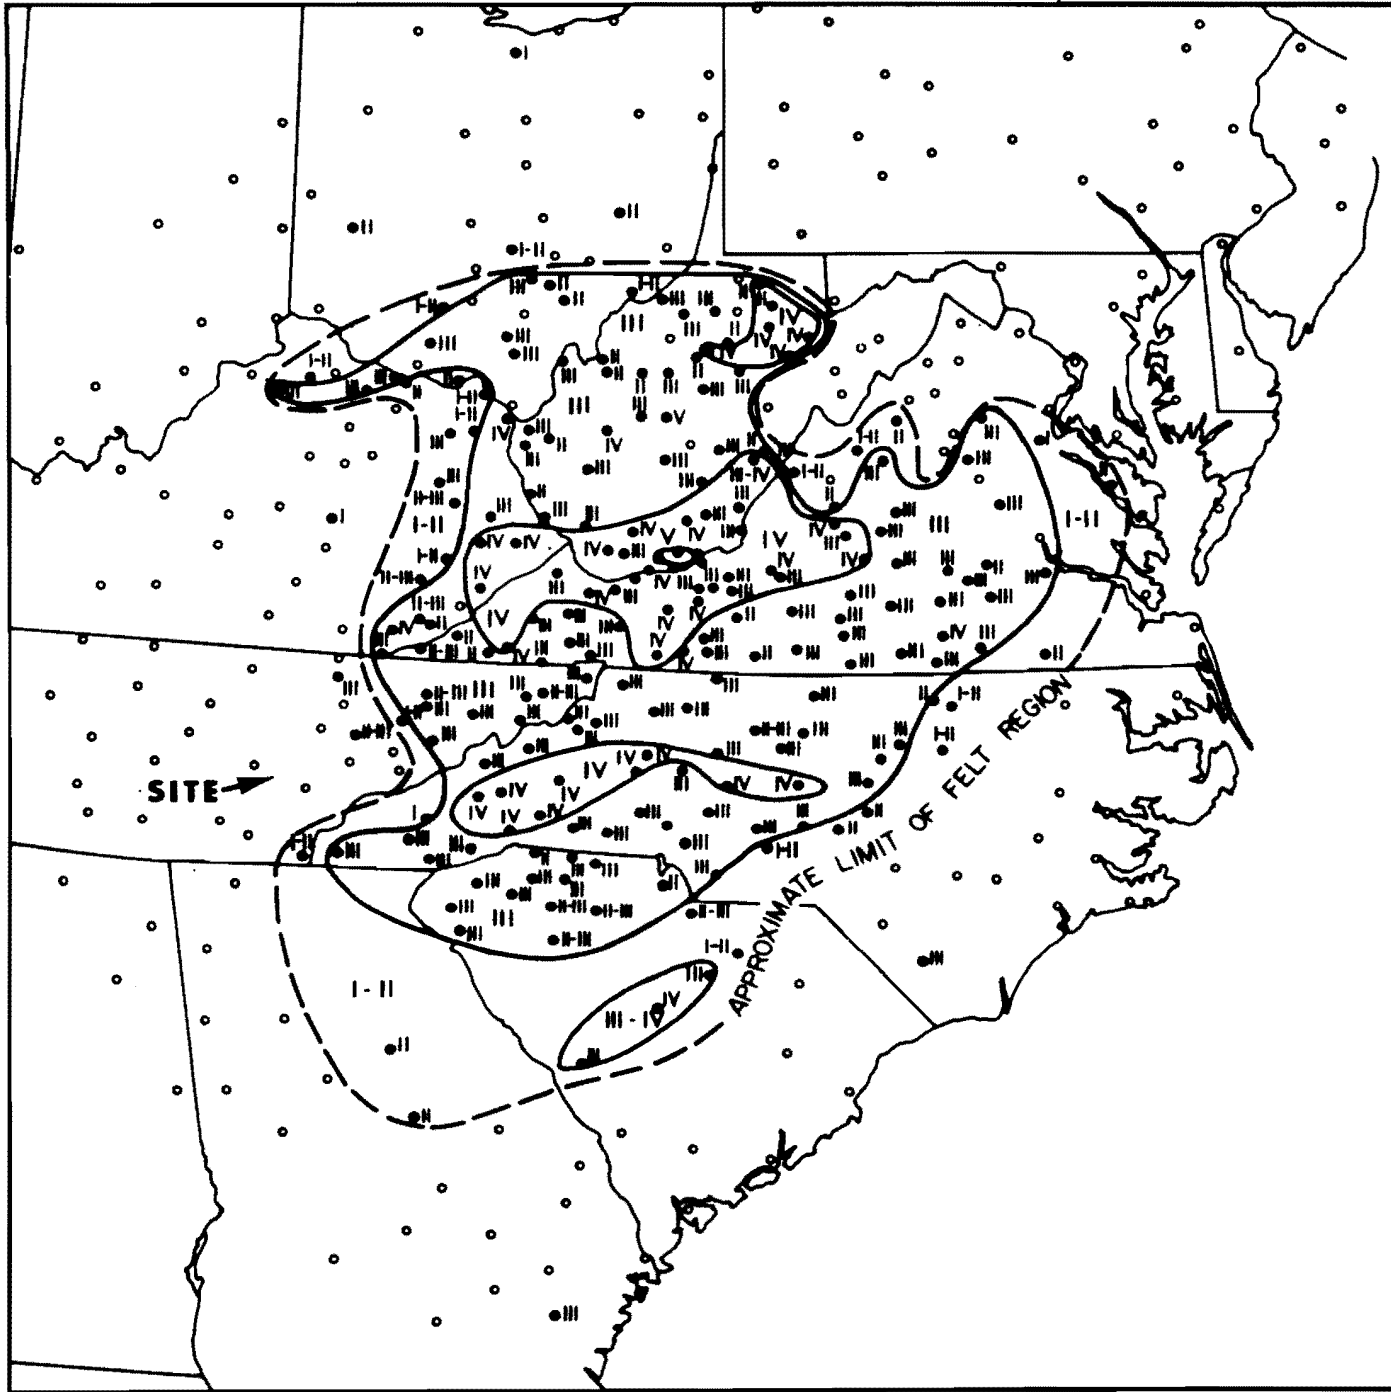

Isoseismal map of the Elsgood, West Virginia earthquake of November 19, 1969. (From Bollinger and Hopper, 1972)

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>ISOSEISMAL MAP ELSGOOD, WEST VIRGINIA EARTHQUAKE NOVEMBER 20, 1969</p>
<p>Figure 2.5-158</p>


Figure 2.5-158 Isoseismal Map Elsgood, West Virginia Earthquake (November 20, 1969)

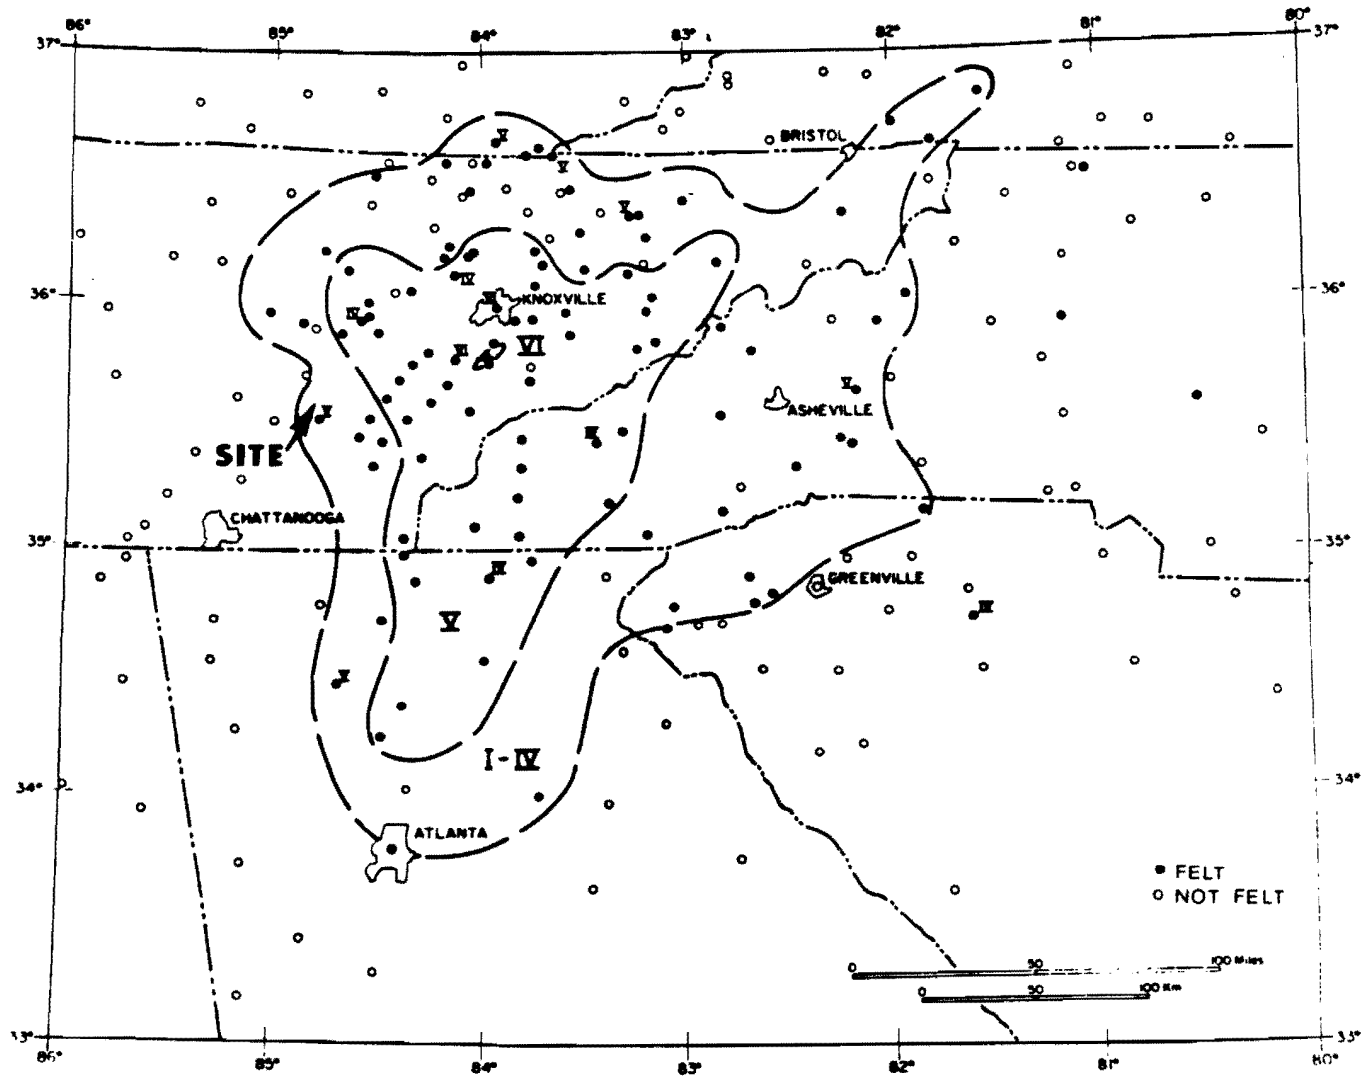

Isoseismal map of the Maryville-Alcoa, Tennessee earthquake of November 30, 1973.
 (From Bollinger and others, 1973)

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>ISOSEISMAL MAP MARYVILLE-ALCOA EARTHQUAKE NOVEMBER 30, 1973</p>
<p>Figure 2.5-159</p>

Figure 2.5-159 Isoseismal Map Maryville-Alcoa Earthquake November 30, 1973

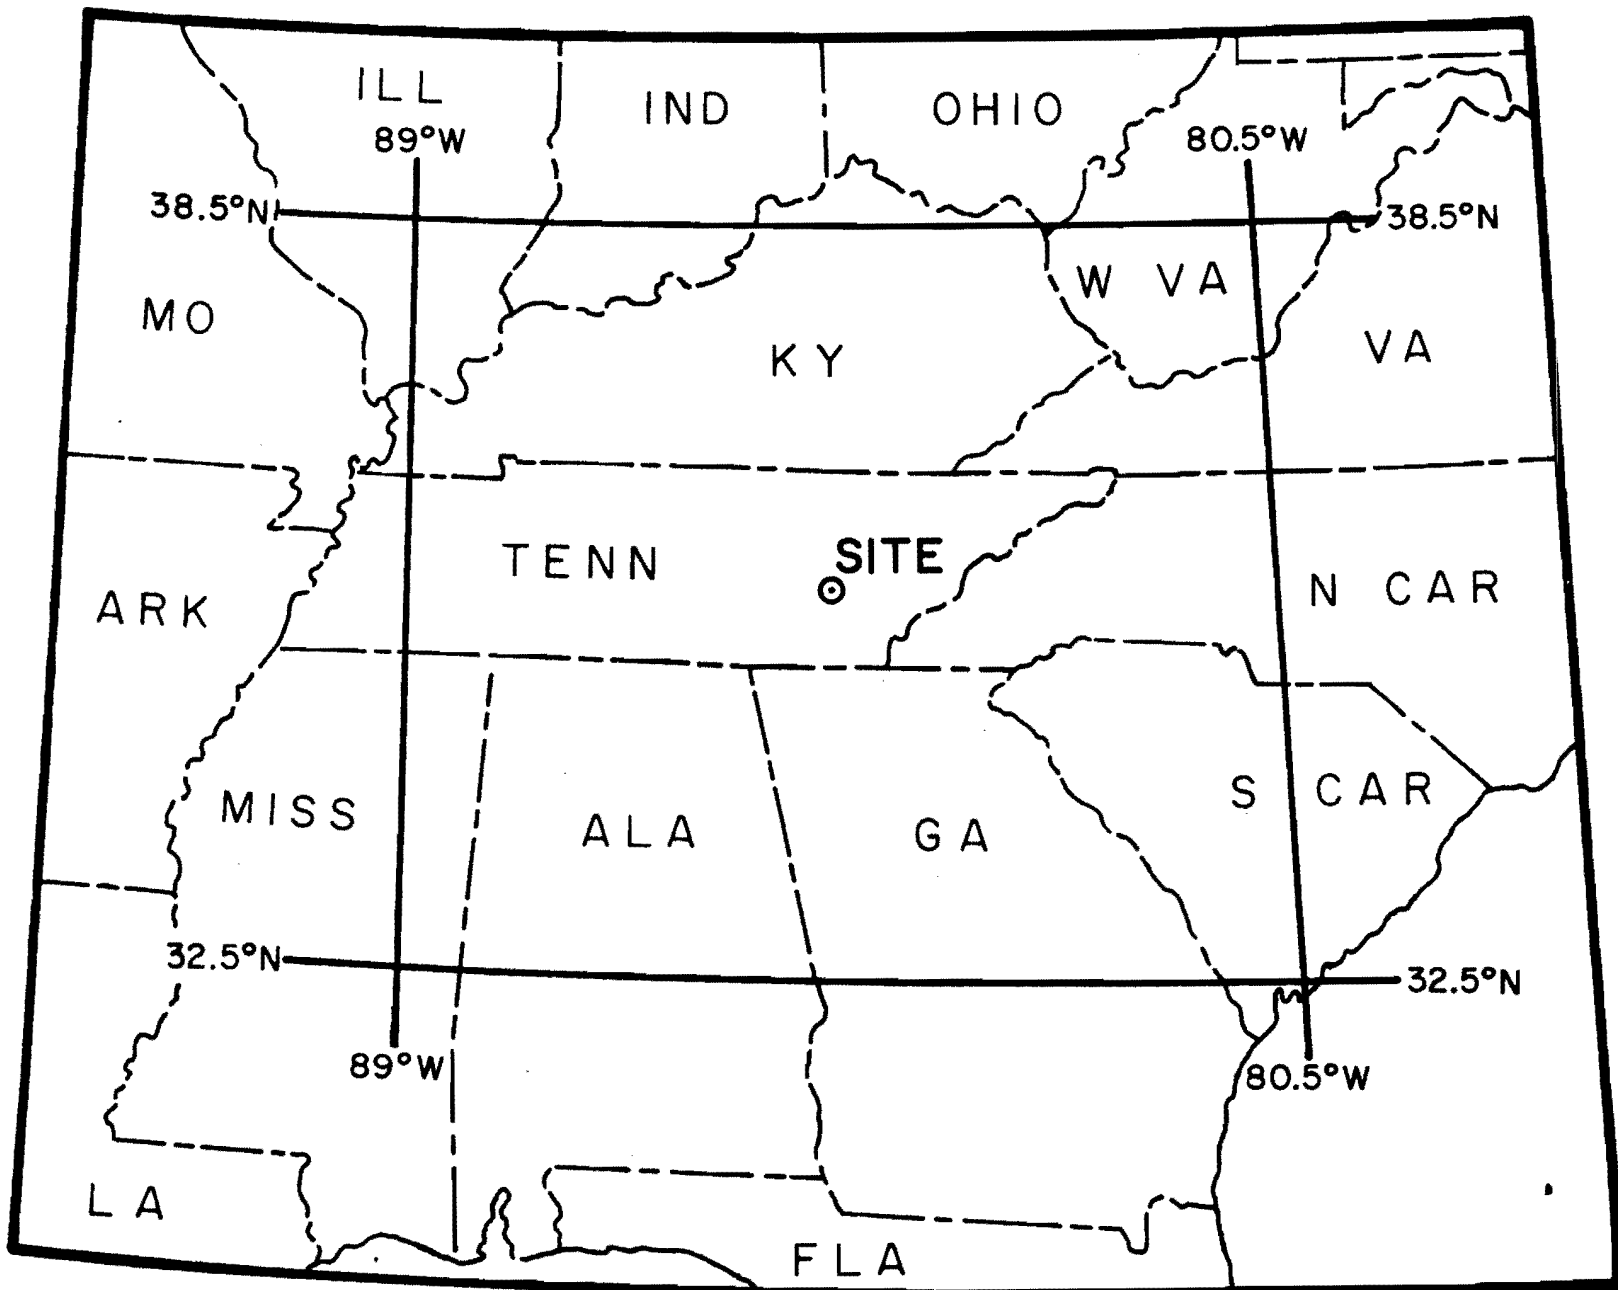

Revised by Amendment 33.

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

INDEX MAP - ALL EARTHQUAKES
LATITUDE 32.5-38.5 NORTH
LONGITUDE 80.5-89.0 WEST

Figure 2.5-161

Figure 2.5-161 Index Map - All Earthquakes Latitude 32.5-38.5 North Longitude 80.5-89.0 West

SEISMIC HISTORY OF THE SOUTHEAST REGION OF THE UNITED STATES

THIS IS A CHRONOLOGICAL LISTING OF ALL EARTHQUAKES HAVING EPICENTERS IN THE RECTANGULAR PORTION OF THE SOUTH-EAST REGION BOUNDED BY THE FOLLOWING GEODETIC COORDINATE LINES --

- SOUTHERN BOUNDARY - 32.5 -DEGREE NORTH LATITUDE
- NORTHERN BOUNDARY - 38.5 -DEGREE NORTH LATITUDE
- EASTERN BOUNDARY - 80.5 -DEGREE WEST LONGITUDE
- WESTERN BOUNDARY - 89.0 -DEGREE WEST LONGITUDE

YEAR	DATE	TIME-HR-MIN-SEC	LAT - LONG	LOCALITY AND NOTES	FELT-SQ.MI.	MAG/INT	REFERENCES
1776	NOV 6	0 0 0.0	(35.0 83.0)	JACKSON CO., WEST NC		IV-V	-6
1799	APR 11	8 20 0.0	(34.3 80.6)	CAMDEN, SC-STRONG			B-14
1817	JAN 8	9 34 0.0	(37.0 81.0)	VA-NC-SC-MD AREA			B-9
1829	MAY 0	0 0 0.0	(35.6 88.8)	JACKSON, TENN-STRONG			-7
1839	SEP 5	0 0 0.0	(36.7 88.6)	HAYFIELD, KY		III-IV	D-6
1843	AUG 9	0 0 0.0	(35.6 87.0)	COLUMBIA AND SOMERVILLE, TENN		III-IV	-6
1844	NOV 28	12 0 0.0	(36.0 84.0)	KNOXVILLE, TENN		VI	BD-5,6
1852	APR 29	18 0 0.0	(36.6 81.6)	VA-NC-TENN REGION	150000	VI	BD-5,6,10
1854	NOV 22	21 0 0.0	(37.1 81.5)	TAZEWELL CITY, VA			-9
1859	MAR 22	0 0 0.0	(37.2 81.5)	TAZEWELL CITY, VA			B-9
1872	MAR 26	0 0 0.0	(37.1 88.6)	PADUCAH, KY		III	-6
1872	JUN 17	20 0 0.0	(33.1 83.3)	MILLEDGEVILLE, GA		V	D-5
1874	FEB 10	0 0 0.0	(35.7 82.1)	MCDOWELL COUNTY, NC-50-100 SHOCKS FROM FEB 10 TO APR 17		II-VII	ABP-6,5
1874	FEB 22	0 0 0.0	(35.7 82.1)	MCDOWELL CO. NC-MOST SEVERE OF SERIES		II-VII	ABP-6,5
1874	MAR 17	0 0 0.0	(35.7 82.1)	MCDOWELL-AFTERSHOCK		II-VII	BP-6,5
1874	MAR 26	0 0 0.0	(35.7 82.1)	MCDOWELL-AFTERSHOCK		II-VII	BP-6,5
1874	APR 14	0 0 0.0	(35.7 82.1)	MCDOWELL-AFTERSHOCK		II-VII	BP-6,5
1874	APR 17	0 0 0.0	(35.7 82.1)	MCDOWELL-AFTERSHOCK		II-VII	BP-6,5
1875	JUL 28	23 5 0.0	(33.1 83.3)	MILLEDGEVILLE, GA			B-7
1875	NOV 2	2 55 0.0	(33.8 82.5)	NORTHERN GEORGIA	25000	VI	AB-5,6
1875	NOV 12	7 0 0.0	(35.9 83.9)	KNOXVILLE, TENN		III-IV	B-6
1876	SEP 25	6 0 0.0	(38.0 88.0)	S ILL-S IND-N KY AREA		VI	A-6
1876	SEP 25	6 15 0.0	(38.0 88.0)	S ILL-S IND-N KY-2ND AND STRONGEST SHOCK		VI	-6
1876	DEC 21	15 30 0.0	(36.9 81.1)	WYTHEVILLE, VA			-9
1877	APR 26	22 0 0.0	(35.2 83.4)	FRANKLIN, NC		III-IV	-6
1877	MAY 25	0 0 0.0	(35.9 83.9)	KNOXVILLE, TENN		III-IV	-6

Revised by Amendment 33.

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

EARTHQUAKE LISTING
ALL EARTHQUAKES
LATITUDE 32.5-38.5 NORTH
LONGITUDE 80.5-89.0 WEST
SHEET 1 OF 8
Figure 2.5-162

Figure 2.5-162 Earthquake Listing All Earthquakes Latitude 32.5-38.5 North Longitude 80.5-89.0 West

1877	NOV 16	7 20	0.0	(35.5	84.0)	W NC AND E TN- FELT AT KNOXVILLE, TN AND MURPHY, NC	5000	IV-V	D-9,5
1878	NOV 24	3 0	0.0	(35.1	84.0)	MURPHY, NC		III-IV	B-6,7
1879	JUL 26	17 45	0.0	(37.0	89.0)	CAIRO AND MOUND CITY, ILLINOIS		II-III	-6
1879	OCT 26	0 0	0.0	(34.5	81.1)	WINNSBORO, SC			-7
1879	DEC 12	24 0	0.0	(35.2	80.8)	CHARLOTTE, NC		V-VI	A-5
1879	DEC 13	7 0	0.0	(35.2	80.8)	CHARLOTTE-AFTERSHOCK			-5
1880	JAN 28	0 0	0.0	(36.0	82.7)	BALD MOUNTAIN, NC			AB-6
1880	JAN 29	0 0	0.0	(36.0	82.7)	BALD MTN-AFTERSHOCK		II-III	B-6
1880	FEB 10	0 0	0.0	(36.0	82.7)	BALD MTN-AFTERSHOCK		II-III	B-6
1882	OCT 15	17 30	0.0	(35.1	84.0)	MURPHY, NC		III-IV	-6
1884	MAR 31	10 0	0.0	(33.1	83.3)	MILLEDGEVILLE, GA		III	-7
1884	APR 30	11 46	0.0	(35.2	84.0)	OGFETA, CHEROKEE CO., NC-LOW RUMBLING SOUND OF EARTHQUAKE HEARD, NO TREMOR REPORTED			B-6
1884	AUG 25	0 45	0.0	(35.9	83.9)	KNOXVILLE, TENN		IV	4BD-6
1885	FEB 2	12 10	0.0	(36.9	81.1)	WYTHEVILLE, VA		IV	B-9
1885	AUG 6	13 0	0.0	(36.2	81.6)	BLUE RIDGE MTNS., WATAUGA CO., WEST NC		IV-V	BD-5
1885	AUG 13	0 0	0.0	(36.2	81.6)	BLUE RIDGE MTNS., WATAUGA CO., WEST NC		IV	-7
1885	OCT 17	22 30	0.0	(33.0	82.8)	SANDERSVILLE, GA		IV	-7
1886	FEB 5	1 0	0.0	(32.8	88.0)	SUMTER CO., ALA	1600	V	-5
1886	FEB 13	0 0	0.0	(32.8	88.0)	SUMTER CO., ALA			-5
1886	SEP 3	5 0	0.0	(36.9	81.1)	WYTHEVILLE, VA			-9
1886	SEP 25	2 56	0.0	(36.9	81.1)	WYTHEVILLE, VA			A-9
1886	SEP 25	3 10	0.0	(36.9	81.1)	WYTHEVILLE-AFTERSHOCK			A-9
1888	MAR 17	0 0	0.0	(36.4	82.5)	JONESBORO, TENN			F-6
1889	SEP 28	0 0	0.0	(35.2	84.5)	PARKSVILLE, POLK CO., TN-NIGHT, LIGHT SHOCK		III-IV	-6
1891	JUL 27	2 28	0.0	(37.9	87.5)	EVANSVILLE, IND		VI	D-5
1895	JUL 27	0 0	0.0	(35.2	88.2)	SAVANNAH, TENN		III-IV	-6
1895	OCT 3	0 0	0.0	(35.2	88.2)	MEMPHIS, TENN-LT SHOCK		III	-6
1897	MAY 1	4 0	0.0	(37.0	89.0)	ILL-W TN-W KY-S IND		IV-V	-5,6
1897	MAY 3	17 18	0.0	(37.1	80.7)	NEAR ROANOKE, VA	150000	VI-VII	BD-5,6,9
1897	MAY 31	18 58	0.0	(37.3	80.7)	GILES COUNTY, VA	280000	VIII	ABCD-5,6,9
1897	SEP 4	0 0	0.0	(36.9	81.1)	WYTHEVILLE, VA			-9
1897	OCT 22	3 20	0.0	(36.9	81.1)	WYTHEVILLE, VA	20000	V	F-5,9,6
1898	FEB 5	20 0	0.0	(37.0	81.0)	PULASKI-WYTHEVILLE, VA		IV	B-9
1898	MAR 30	0 30	0.0	(36.7	85.8)	MT. HERMON, MONROE CO., KENTUCKY		III	-6
1898	NOV 25	20 0	0.0	(37.0	81.0)	PULASKI-WYTHEVILLE, VA		IV-V	B-9
1899	FEB 13	9 30	0.0	(37.0	81.0)	WESTERN VA- 4 SHOCKS, STRONGLY FELT IN E TN	30000	V	AF-5,6,9
1899	APR 30	2 5	0.0	(38.5	87.0)	SOUTHWESTERN, IND	40000	VI-VII	D-5,6
1902	MAY 17	0 0	0.0	(37.3	80.7)	PEARISBURG, VA			-9
1902	MAY 29	7 30	0.0	(35.1	85.3)	CHATTANOOGA, TENN		V	BDF-5,6

Revised by Amendment 33.

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

EARTHQUAKE LISTING
ALL EARTHQUAKES
LATITUDE 32.5-38.5 NORTH
LONGITUDE 80.5-89.0 WEST
SHEET 2 OF 8
Figure 2.5-163

Figure 2.5-163 Earthquake Listing All Earthquakes Latitude 32.5-38.5 North Longitude 80.5-89.0 West

1902	OCT 18	18 0 0.0	(35.0 85.3)	SE TENN-NW GEORGIA	1500	III-V	AP-6
1904	OCT 18	22 0 0.0	(35.0 85.3)	TN-GA AREA-MAIN SHOCK	1500	V-VI	AP-6,5
1904	MAR 5	0 30 0.0	(35.7 83.5)	MARYVILLE, TENN	5000	V	BP-5,6
1905	JAN 27	0 0 0.0	(34.0 86.0)	NEAR GADSDEN, ALA	250000	VIII	ACD-6,5
1905	JAN 28	0 0 0.0	(34.0 86.0)	GADSDEN-SECOND SHOCK	250000	VIII	ACD-6,5
1908	DEC 31	0 0 0.0	(36.9 89.0)	BLANDVILLE, KY-SEVERAL LIGHT SHOCKS			
1909	OCT 8	10 0 0.0	(34.8 85.0)	NW GA-FELT AT DALTON AND RINGGOLD, GA	800	IV-V	-7
1911	APR 22	3 0 0.0	(35.2 82.7)	CAESAR'S HEAD, SC, BLUE RIDGE AT NC-SC BORDER	600	V	C-6,5,7
1912	OCT 23	1 15 0.0	(32.7 83.5)	DUBLIN, MACON AND PERRY, GA	1500	IV	-7
1912	DEC 7	19 10 0.0	(34.7 81.7)	UNION COUNTY, SC		III-IV	-6,5
1913	JAN 1	18 28 0.0	(34.7 81.7)	UNION COUNTY, SC	43000	VII-VIII	BD-5,6
1913	MAR 13	5 0 0.0	(34.5 85.0)	CALHOUN AND GORDON COUNTIES, GA		IV	-7
1913	MAR 28	21 50 0.0	(36.2 83.7)	KNOXVILLE, TENN	2700	VII	BD-6,5
1913	APR 17	16 30 0.0	(35.3 84.2)	NEAR DUCKTOWN, TN	3500	V-VI	BD-6,5
1913	MAY 2	6 0 0.0	(35.5 84.4)	NEAR MADISONVILLE, TN		III	H-6
1913	JUN 9	15 30 0.0	(35.8 88.9)	HUMBOLDT, TENN		III	BP-6
1913	AUG 3	16 45 0.0	(35.9 83.9)	KNOXVILLE, TENN		IV	B-6
1914	JAN 24	3 24 0.0	(35.6 84.5)	NIOTA AND SWEETWATER IN SE TENN		IV-V	AP-6,5
1914	JAN 24	3 41 0.0	(35.6 84.5)	NIOTA AND SWEETWATER IN SE TENN-AFTERSHOCK		IV-V	AP-6,5
1914	MAR 5	20 5 0.0	(33.5 83.5)	NEAR ATLANTA, GA	100000	VI	-6,5
1915	JAN 14	9 20 0.0	(36.6 82.1)	BRISTOL, TENN-VA		III-IV	-6
1915	FEB 5	6 55 0.0	(37.6 88.7)	HARRISBURG, ILL		IV-V	-7
1915	OCT 26	7 40 0.0	(36.7 88.6)	MAYFIELD, KY		V	DP-5,6
1915	OCT 29	6 0 0.0	(35.8 82.7)	NEAR MARSHALL, NC	1200	V	B-5,6
1916	FEB 21	22 39 0.0	(35.5 82.5)	NEAR WAYNESVILLE, NC	500000	VI-VII	ABD-6,5
1916	MAR 2	5 2 0.0	(34.5 82.7)	ANDERSON, SC-6 SHOCKS		IV-V	-7
1916	AUG 26	18 35 0.0	(36.0 81.0)	STATESVILLE AND TAYLORSVILLE, NC-STRONG, LINCOLN TON, NC REPORTED THREE SHOCKS	3800	V	AB-6
1916	AUG 26	19 36 0.0	(36.0 81.0)	STATESVILLE AND TAYLORSVILLE, NC-AFTERSHOCK	3800	V	AB-5,6
1916	OCT 18	22 4 0.0	(33.5 86.2)	BIRMINGHAM, ALA	170000	VII	ACD-6,5,7
1916	OCT 19	3 52 0.0	(33.5 86.2)	BIRMINGHAM-AFTERSHOCK			A-6
1916	OCT 19	8 0 0.0	(36.7 88.7)	MAYFIELD, KY		III	-6
1916	OCT 22	0 0 0.0	(33.5 86.2)	BIRMINGHAM-AFTERSHOCK			A-6
1916	NOV 4	12 15 0.0	(33.5 86.2)	BIRMINGHAM-AFTERSHOCK			A-6
1917	JAN 2	9 30 0.0	(36.1 83.9)	NEAR MCHILLAN, KNOX CO., TN-THOUGHT BY SOME TO BE EXPLOSION			P-6
1917	JAN 25	21 15 0.0	(36.1 83.5)	JEFFERSON CITY, TENN		III	A-6
1917	JAN 26	12 15 0.0	(36.1 83.5)	TALBOTT, JEFFERSON CO. TENN-AFTERSHOCK		III	A-6
1917	JAN 27	20 0 0.0	(36.1 83.5)	JEFFERSON CITY, TENN-AFTERSHOCK		III	-6

Revised by Amendment 33.

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

EARTHQUAKE LISTING
ALL EARTHQUAKES
LATITUDE 32.5-38.5 NORTH
LONGITUDE 80.5-89.0 WEST
SHEET 3 OF 8
Figure 2.5-164

Figure 2.5-164 Earthquake Listing All Earthquakes Latitude 32.5-38.5 North Longitude 80.5-89.0 West

1917	MAR 5	2 7 0.0	(35.9 83.9)	KNOXVILLE, TENN- ACCOUNT SUGGESTS ANOTHER UNREPORTED SHOCK A FEW DAYS EARLIER		III	D-6
1917	MAR 25	21 15 0.0	(36.1 83.5)	JEFFERSON CITY AND TALBOTT, TENN		III-IV	AB-6,7
1917	MAR 26	12 50 0.0	(36.1 83.5)	TALBOTT, TENN- AFTERSHOCK		III	B-6
1917	MAR 27	20 0 0.0	(36.1 83.5)	JEFFERSON CITY, TENN- TALBOTT AFTERSHOCK		III-IV	D-6
1917	APR 19	0 0 0.0	(37.0 82.0)	SW VIRGINIA		III	-9,6
1917	JUN 30	2 23 0.0	(32.7 87.5)	ROSEMARY, ALA		V	AB-6,5,7
1917	JUN 30	2 50 0.0	(32.7 87.5)	ROSEMARY-AFTERSHOCK		V	B-6,7
1918	JAN 16	15 45 0.0	(35.9 83.9)	KNOXVILLE, TENN		V	BD-6
1918	JUN 22	0 59 0.0	(36.1 84.1)	NEAR LENOIR CITY, TENN	3000	IV-V	AB-6,5,7
1920	APR 7	20 45 0.0	(36.4 88.1)	SPRINGVILLE, TENN-ONE SHOCK, A HEAVY JAR, QUAKE QUESTIONABLE		III	-6
1920	DEC 24	7 0 0.0	(36.0 85.0)	ROCKWOOD, TENN		V	B-6,5
1921	JUL 15	0 0 0.0	(36.6 82.3)	HENDOTA, VA		V-VI	D-6,5,9
1921	SEP 2	14 0 0.0	(36.2 86.3)	STATESVILLE, TENN- SEVERAL SHOCKS FELT		III	B-6
1921	DEC 15	13 20 0.0	(35.8 84.6)	NEAR KINGSTON, TENN- FELT FROM KINGSTON TO DAYTON, EAST TO ATHENS		V	BD-6
1922	MAR 22	22 30 0.0	(37.3 88.6)	SOUTHERN ILL	25000	V	AD-6,5
1922	MAR 23	2 20 0.0	(37.3 88.6)	S ILL-SECOND SHOCK	25000	V	D-6,5
1922	MAR 23	21 45 0.0	(37.0 88.0)	WESTERN KENTUCKY		V	-6,5
1922	MAR 30	2 20 0.0	(35.5 86.7)	FARMINGTON, MARSHALL CO., TENN		V	B-6
1922	MAR 30	2 21 0.0	(36.5 82.2)	ARCADIA, SULLIVAN CO., TENN		IV	A-6
1922	MAR 30	22 20 0.0	(36.5 82.2)	ARCADIA-AFTERSHOCK		IV	-6
1923	OCT 18	19 30 0.0	(35.3 82.5)	HENDERSONVILLE AND SALUDA, NC			-7
1923	OCT 28	17 15 0.0	(34.9 88.1)	RIVERTON, ALA		III	-7
1924	JAN 1	1 6 0.0	(34.8 82.5)	GREENVILLE, SC		IV	-7
1924	APR 2	11 15 0.0	(37.1 88.6)	PADUCAH, KY		IV	-6
1924	OCT 20	8 30 0.0	(35.0 82.6)	PICKENS COUNTY, SC	56000	V	BD-5,6
1924	NOV 13	5 30 0.0	(36.6 82.1)	BRISTOL, TENN-VA		IV-V	AD-6,7
1925	APR 27	4 5 0.0	(38.0 87.5)	SOUTHWESTERN, IND	100000	V-VI	BD-5,6
1925	MAY 13	12 0 0.0	(36.7 88.6)	MAYFIELD, KY	3000	V	-5,6
1925	MAY 15	0 0 0.0	(37.0 81.0)	SWIFT CREEK, VA			A-9
1925	SEP 2	11 55 0.0	(37.8 87.6)	NEAR HENDERSON, KY	75000	V-VI	ACD-5,6
1926	MAR 22	14 30 0.0	(37.6 88.7)	HARRISBURG, ILL		IV	-7
1926	JUL 8	9 50 0.0	(35.9 82.1)	SOUTH MITCHELL CO., NC		VI-VII	BCDF-6,5
1927	MAY 7	8 28 0.0	(36.5 89.0)	NEAR NEW MADRID, MO	130000	VII	BD-6,5
1927	JUN 16	12 0 0.0	(34.7 86.0)	NEAR SCOTTSBORO, ALA	2500	V	BDF-6,5
1927	JUL 20	8 58 0.0	(35.9 83.9)	KNOXVILLE, TENN-QUAKE QUESTIONABLE			BDF-6
1927	OCT 8	12 56 0.0	(35.0 85.3)	CHATTANOOGA, TENN		V	AD-6

Revised by Amendment 33.

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

EARTHQUAKE LISTING
ALL EARTHQUAKES
LATITUDE 32.5-38.5 NORTH
LONGITUDE 80.5-89.0 WEST
SHEET 4 OF 8
Figure 2.5-165

Figure 2.5-165 Earthquake Listing All Earthquakes Latitude 32.5-38.5 North Longitude 80.5-89.0 West

1928	MAR 7	2 45 0.0	(35.6 86.9)	REPORTED AT FRANKLIN, LYNNVILLE, COLUMBIA IN MIDDLE TENN		II-III	B-1,6
1928	NOV 3	4 3 0.0	(36.0 82.6)	NE TENN-W NC BORDER REGION-FELT IN ALA, GA, VA, KY AND SC	40000	VI-VII	CD-5,6,1,9
1928	NOV 20	3 45 0.0	(35.9 82.8)	W NC-E TENN BDR. AREA-FELT AT ASHVILLE AND HOT SPRINGS, NC, JOHNSON CITY AND GREENVILLE, TENN	10000	IV	-6
1929	OCT 28	2 15 0.0	(34.3 82.4)	DUE WEST, SC			B-1
1930	AUG 30	9 28 0.0	(35.9 84.4)	E TENN NEAR KINGSTON-FELT ALSO AT LENOIR CITY, OLIVER SPRINGS, AND LAWNVILLE, TENN		V	B-1,6
1930	OCT 16	21 50 0.0	(36.0 84.0)	KNOXVILLE, TENN		III-IV	ABD-1,6
1930	OCT 17	2 15 0.0	(36.0 84.0)	KNOXVILLE-AFTERSHOCK			-6
1930	DEC 10	0 2 0.0	(34.3 82.4)	DUE WEST, SC	300		A-1
1931	APR 1	23 30 0.0	(36.8 87.5)	HOPKINSVILLE AND LOVELACEVILLE, KY-FELT AT CAIRO, ILL		III	-1,6
1931	MAY 5	12 18 0.0	(33.7 86.6)	NORTHERN ALA-FELT IN GA AND POSSIBLY SC	6500	V-VI	BD-1,6,5
1931	MAY 6	12 18 0.0	(34.3 82.4)	DUE WEST, SC (POSSIBLE DATE MAY 5 TO CORRESPOND TO W ALA SHOCK)			B-1
1931	NOV 27	9 23 0.0	(36.2 86.7)	NASHVILLE, TENN		III	-6,1
1934	OCT 30	2 26 0.0	(37.5 88.5)	NEAR HARTSVILLE, POPE COUNTY, ILL-ON HEROD FAULT	1500	IV	-1
1935	JAN 1	8 15 0.0	(35.1 83.6)	GA-NC BORDER-DAMAGE AT DAHLONEGA, GA, AND ALMOND AND GAY, NC, CENTERED NEAR HAYESVILLE, NC, FELT IN TENN	7000	V	BD-6,5,1
1936	JAN 1	8 0 0.0	(35.0 84.2)	GA-NC BDR. BETWEEN BLUE RIDGE, GA AND MURPHY, NC-FELT ALSO IN DUCKTOWN BASIN OF TENN		III	-6,2
1938	MAR 31	10 10 0.0	(35.6 83.6)	NC-TENN BORDER AREA-FELT FROM ASHVILLE AND MURPHY, NC TO KNOXVILLE, TENN		III-IV	-6,2
1939	MAY 5	3 45 0.0	(33.7 85.8)	ANNISTON, ALA-FELT ALSO AT OXFORD LAKE, BLUE MTN., TALLEDEGA, CHOCCOLOCCO, JENIFER		V	D-5,6,2
1939	JUN 24	10 0 0.0	(34.7 86.6)	HUNTSVILLE, ALA			AD-2,6
1939	JUN 24	11 27 0.0	(34.7 86.6)	HUNTSVILLE-2ND AND STRONGEST SHOCK, FELT AT PULASKI, TENN		III-IV	AB-2,6
1939	JUN 24	12 45 0.0	(34.7 86.6)	HUNTSVILLE-AFTERSHOCK			B-2,6
1940	MAY 31	19 3 0.0	(37.1 88.6)	PADUCAH, KY-FELT AT CAIRO, ILL	1000	IV-V	D-6,2
1940	OCT 19	5 55 0.0	(35.0 85.0)	S TENN-N GA BDR AREA-FELT IN CHATTANOOGA, CLEVELAND, CHARLESTON, TENN, AND DALTON AND RINGGOLD, GA	500	IV	BD-6,2
1940	DEC 25	1 50 0.0	(35.9 82.9)	ASHEVILLE, NC-GREENVILLE, TENN BORDER RGN		III	A-2,6
1940	DEC 25	6 49 0.0	(35.9 82.9)	NC-TENN MAIN SHOCK	7000	V	ABD-6,2

Revised by Amendment 33.

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

**EARTHQUAKE LISTING
ALL EARTHQUAKES
LATITUDE 32.5-38.5 NORTH
LONGITUDE 80.5-89.0 WEST
SHEET 5 OF 8
Figure 2.5-166**

Figure 2.5-166 Earthquake Listing All Earthquakes Latitude 32.5-38.5 North Longitude 80.5-89.0 West

1940	DEC 26	5 0 0.0	(35.7 82.7)	NC-TENN AFTERSHOCK, FELT AT ASHEVILLE,NC		III	b-6
1941	MAR 4	6 15 0.0	(35.9 83.9)	KNOXVILLE,TENN-FELT AT ROCKFORD,BLOUNT COUNTY,TENN		III	B-3,6
1941	MAY 10	11 12 0.0	(35.6 82.6)	ASHEVILLE,NC		III	-6,3
1941	SEP 8	9 45 0.0	(35.0 85.3)	CHATTANOOGA,TENN	100	III-IV	B-3,6
1942	NOV 1	3 20 0.0	(34.5 81.1)	WINNSBORO,SC			F-3
1943	JUL 29	4 30 0.0	(33.5 82.0)	AUGUSTA,GA-SEISMIC ORIGIN QUESTIONED			-3
1945	JUN 14	3 25 0.0	(35.0 84.5)	CLEVELAND,TENN-FELT TO BLUE RIDGE,GA	4000	V	B-6,3,5
1945	JUL 26	11 32 20.0	34.3 81.4	MURRAY LAKE,SC-NEAR COLUMBIA	25000	IV-V	BD-6,3,5
1946	APR 7	5 0 0.0	(35.2 84.9)	CLEVELAND,TENN		III-IV	BF-3
1947	JUN 6	12 55 0.0	(35.9 83.9)	KNOXVILLE,TENN		III	B-6
1947	DEC 28	0 5 0.0	(35.0 85.3)	SE TENN-NW GA AREA- FELT STRONGLY IN MISSIONARY RIDGE AND CHATTANOOGA AREA OF TENN AND ROSSVILLE,GA	300	IV	D-6,3
1948	FEB 10	0 4 0.0	(36.4 84.1)	LAPOLLETTE,TENN		V-VI	B-6,3
1949	SEP 16	21 30 0.0	(36.7 83.0)	NEAR PENNINGTON GAP, LEE CO.,VA		II-III	A-6
1949	SEP 17	9 30 0.0	(36.7 83.0)	LEE CO.,VA-MAIN SHOCK,WIDELY FELT		IV-V	B-9,3,6
1950	JUN 19	4 19 0.0	(35.7 84.0)	ALCOA,TENN-FELT AT KNOXVILLE,TENN AND IN N CAROLINA		IV	BD-6,3,11
1952	FEB 6	16 12 0.0	(33.5 86.8)	BIRMINGHAM,ALA	100	IV	D-3
1952	JUN 11	20 20 0.0	(36.6 82.4)	JOHNSON CITY,TENN			-3
1953	NOV 10	14 53 0.0	(35.9 83.9)	KNOXVILLE,TENN			B-3,11
1953	DEC 5	13 45 0.0	(35.9 83.9)	KNOXVILLE,TENN			B-11
1954	JAN 2	2 25 0.0	(36.6 83.7)	MIDDLESBORO,KY-FELT IN KY,TN,VA AND NC		VI	D-3,5
1954	JAN 22	0 0 0.0	(35.3 84.4)	NEAR ETOWAH AND ATHENS,TENN		V	BD-3,5
1955	JAN 6	20 30 0.0	(36.6 82.2)	BRISTOL,TENN-VA-FELT BY FEW ON UPPER FLOOR OF TALL BLDGS IN KNOXVILLE,TENN		IV	-9,3
1955	JAN 12	17 25 0.0	(35.8 84.0)	BLOUNT AND KNOX CTYS. TN-FELT AT BLUE GRASS AND HARYVILLE,TENN		IV	-3
1955	JAN 25	19 34 0.0	(35.9 83.9)	KNOXVILLE,TENN		IV	B-3
1955	SEP 28	7 1 42.0	(36.6 81.4)	NC-VA BORDER AREA	1700	V	BD-3,5
1956	JAN 5	8 0 0.0	(34.3 82.4)	DUE WEST,SC		IV	A-3
1956	JAN 5	8 30 0.0	(34.3 82.4)	DUE WEST-AFTERSHOCK		IV	-3
1956	MAY 19	19 0 0.0	(34.3 82.4)	DUE WEST,SC		IV	AB-3
1956	MAY 27	23 25 0.0	(34.3 82.4)	DUE WEST-AFTERSHOCK		IV	B-3
1956	SEP 7	13 36 1.0	35.5 84.0	NEAR KNOXVILLE,TENN- FELT IN TN,KY AND NC	8300	VI	ABD-3,5,1
1956	SEP 7	13 49 20.0	35.5 84.0	EAST TENN-AFTERSHOCK	8300	VI	BD-3,5,11
1956	SEP 9	22 45 0.0	(35.7 86.6)	COLLEGE GROVE,TENN		IV	B-3
1957	JAN 25	18 15 0.0	(36.6 83.7)	MORTOWN,KY-A SUBURB OF MIDDLESBORO,KY		VI	-3

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING ALL EARTHQUAKES LATITUDE 32.5-38.5 NORTH LONGITUDE 80.5-89.0 WEST SHEET 6 OF 8 Figure 2.5-167</p>

Figure 2.5-167 Earthquake Listing All Earthquakes Latitude 32.5-38.5 North Longitude 80.5-89.0 West

1957	MAR 26	8 27 6.0	(37.0 88.4)	PADUCAH, KY-FELT AT SMITHLAND, KY		V	BDF-3,5
1957	APR 23	9 23 19.0	(34.5 86.8)	N ALA-FELT ALSO IN GA	11500	VI	BD-5,3,11
1957	MAY 14	14 24 58.0	(35.7 82.0)	W NC-FELT SC AND TN	8100	VI	BD-5,3,11
1957	JUN 23	6 34 18.0	36.5 84.5	E-CENTRAL TENN-FELT IN HARDIN VALLEY AND CLINCH R. VALLEY AND AT CONCORD, DIXIE LEE JUNCTION, OAK RIDGE, TN		V	-5,3,11
1957	JUL 2	9 33 1.0	(35.5 82.5)	W NC-FELT STRONGLY IN MADISON AND BUNCOMBE, COUNTY, NC AND DAMAGE AT FLAG POND, TENN		VI	D-5,3
1957	NOV 24	20 6 17.0	35.0 83.5	NC-TENN BDR.RGN.-FELT IN SC, NC, GA AND TENN	4100	VI	BD-5,3
1958	JAN 28	4 57 0.0	(37.0 89.0)	ILL-KY-MO BORDER AREA	300	V	D-3,5
1958	MAY 16	22 30 0.0	(35.6 82.6)	ASHEVILLE, NC		IV	-3
1958	OCT 20	6 16 0.0	(34.5 82.8)	ANDERSON, SC		V	BP-5,3
1958	NOV 8	2 41 43.0	38.4 87.9	ILL-IND BORDER-FELT IN ILL, IND, MO AND KY	33000	VI	D-3,5,11
1959	JUN 13	1 15 0.0	(35.4 84.3)	TELLICO PLAINS, TENN-FELT IN SEVERAL CTYS OF E TENN AND CHEROKEE CTY, NC	900	IV	B-3,5
1959	AUG 12	18 6 7.0	35.0 87.0	ALA-TN BORDER AREA	2800	VI	BD-3,5,11
1960	FEB 9	14 0 6.0	(35.3 82.5)	HENDERSON COUNTY, NC			-3
1960	APR 15	10 10 10.0	(35.8 84.0)	NEAR KNOXVILLE, TENN	1300	V	BD-3,5
1962	JUN 27	1 28 55.7	37.7 88.5	S ILL-FELT IN PADUCAH AND WICKLIFFE, KY AND IN MO		5.5	BD-3,5,11
1963	APR 11	17 45 0.0	(34.8 82.4)	GREENVILLE, SC		IV	B-3
1963	AUG 3	0 37 50.3	37.0 88.8	ILL-KY BORDER AREA-DEPTH ABOUT 13 KM		3.6	BD-3,5
1963	OCT 28	22 38 35.0	36.7 81.0	NEAR GALAX, VA-FELT IN VA AND NC	1300	V	ABD-3,5,9
1963	OCT 29	1 57 0.0	36.7 81.0	GALAX, VA-AFTERSHOCK	1300	V	BD-3,9
1964	JAN 20	13 37 52.0	(35.9 82.2)	CANE RIVER, NC AREA		IV	-3
1964	FEB 18	10 31 11.5	34.8 85.5	DE KALB CO., NE ALA-FELT IN GA, DEPTH 15KM		4.4	B-3
1964	MAR 13	1 20 18.1	32.8 83.4	CENTRAL GA-FELT IN BALDWIN, BIBB, JONES AND WILKINSON COUNTY	400	4.4	B-3
1964	APR 20	19 4 46.0	(34.0 81.0)	NEAR COLUMBIA, SC		V	B-3
1964	JUL 28	0 0 0.0	(36.0 83.9)	KNOXVILLE, TENN			-3
1964	OCT 13	16 30 0.0	(35.9 83.9)	KNOXVILLE, TENN			-3
1965	SEP 9	4 37 16.0	(34.7 81.2)	CHESTER, SC			A-3
1965	SEP 9	14 42 20.0	(34.7 81.2)	CHESTER, SC-AFTERSHOCK			A-3
1965	SEP 10	7 32 0.0	(34.7 81.2)	CHESTER, SC-AFTERSHOCK			A-3
1965	SEP 12	17 25 2.0	(34.7 81.2)	CHESTER, SC-AFTERSHOCK			A-3
1966	AUG 24	6 0 0.0	(35.9 83.9)	KNOXVILLE, TENN		IV	B-3
1967	OCT 23	9 4 10.0	33.4 80.7	S CENTRAL SC-FELT AT GOOSE CREEK, COLUMBIA COTTAGEVILLE, AND CHARLESTON		3.8	-3
1968	MAR 8	5 38 15.0	37.3 80.8	NEAR NARROWS, VA		3.9	-4,9,11
1968	SEP 22	21 41 18.0	34.0 81.5	CENTRAL SC-FELT AT COLUMBIA	400	3.7	B-4,11

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING ALL EARTHQUAKES LATITUDE 32.5-38.5 NORTH LONGITUDE 80.5-89.0 WEST SHEET 7 OF 8 Figure 2.5-168</p>


Figure 2.5-168 Earthquake Listing All Earthquakes Latitude 32.5-38.5 North Longitude 80.5-89.0 West

1968	NOV 9	17 1 41.0	38.0	88.5	SOUTHERN ILL-FELT IN 23 STATES AND CANADA	400000	5.3	D-4,11
1968	DEC 11	15 0 0.0	(38.3	85.7)	LOUISVILLE, KY		V	-3,16
1969	JUL 13	21 51 9.4	36.1	83.7	E TENN-FELT IN PARTS OF KY, NC, TENN, AND VA		3.5	A-4
1969	JUL 14	9 13 14.5	36.1	83.7	E TENN-APTERSNOCK		1.0	-12
1969	NOV 20	1 0 9.0	37.4	81.0	SOUTHERN PART W VA-FELT IN VA, GA, OHIO, KY, MD, NC, SC, W VA, AND TN , DEPTH ABOUT 3 KM		4.3	D-4
1969	DEC 13	10 19 34.3	35.1	83.0	E NC-FELT AT SYLVA AND COLUMBUS, NC, AND GREENVILLE, PICKENS, SC			-4
1970	SEP 10	1 41 10.0	36.1	81.4	NW NORTH CAROLINA FELT IN NW N. CAROLINA	2000	2.5	-4,12,3
1971	MAR 14	17 27 51.3	33.1	87.9	CARROLTON, ALA-FELT		4.5	-4
1971	MAY 19	12 54 3.4	33.3	80.6	ORANGEBURG-BOWMAN AREA , SC-FELT		3.4	-4
1971	JUL 13	11 41 44.0	(34.7	82.9)	SENECA, SC		IV	AP-13,12
1971	JUL 31	20 16 55.6	33.4	80.7	S CAROLINA-FELT IN ORANGEBURG, CO AREA	1300	III	-4,13
1971	AUG 11	3 52 7.0	(33.2	80.7)	ORANGEBURG, SC-SLIGHT			-13,12
1971	OCT 9	16 43 33.8	35.9	83.5	N CAROLINA-MINOR DAMAGE IN GATLINBURG-COSBY AREA		3.4	D-4
1973	JAN 7	22 56 6.1	37.4	87.3	KENTUCKY		3.2	-4
1973	OCT 30	22 58 39.0	35.8	84.0	E TENN		3.4	P-17
1973	NOV 30	7 48 41.2	35.8	84.0	E TENN-MINOR DAMAGE AT MARYVILLE		4.6	P-17
1974	AUG 2	8 52 9.8	33.8	82.4	GEORGIA-MINOR DAMAGE BOBBY BROWN ST. PARK		4.8	P-17
1975	FEB 10	18 52 48.3	36.1	83.6	E TENN		3.0	-12
1975	MAR 1	11 50 0.2	33.5	88.0	MISSISSIPPI		3.2	-17

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING ALL EARTHQUAKES LATITUDE 32.5-38.5 NORTH LONGITUDE 80.5-89.0 WEST SHEET 8 OF 8 Figure 2.5-169</p>

Figure 2.5-169 Index Map -Earthquakes 4.3 Richter or Greater Latitude 32.5-38.5 North Longitude 80.5-89.0 West

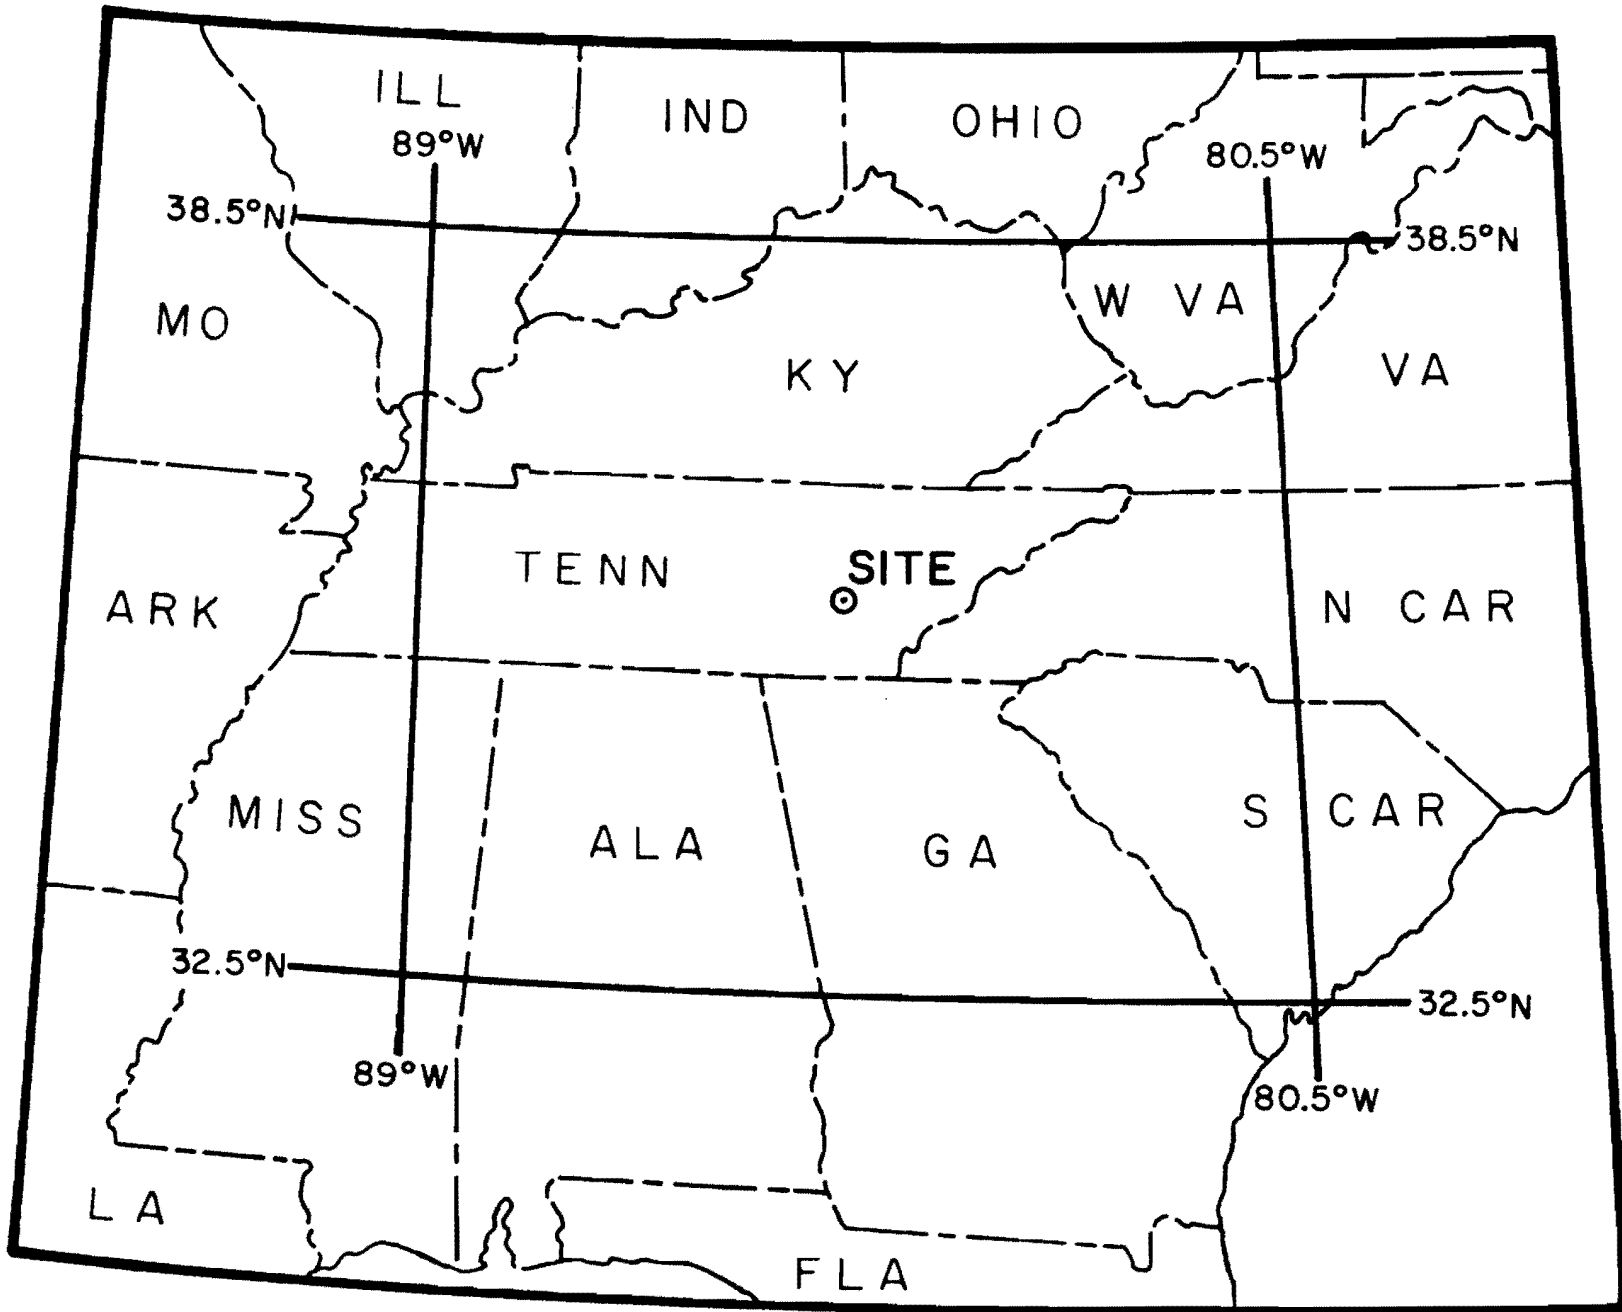

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>INDEX MAP - EARTHQUAKES 4.3 RICHTER OR GREATER LATITUDE 32.5-38.5 NORTH LONGITUDE 80.5-89.0 WEST</p>
<p>Figure 2.5-170</p>

Figure 2.5-170 Earthquake Listing 4.3 Richter or Greater Latitude 32.5-38.5 North Longitude 80.5-89.0 West

SEISMIC HISTORY OF THE SOUTHEAST REGION OF THE UNITED STATES

THIS IS A CHRONOLOGICAL LISTING OF ALL EARTHQUAKES HAVING EPICENTERS IN THE RECTANGULAR PORTION OF THE SOUTH-EAST REGION BOUNDED BY THE FOLLOWING GEODETIC COORDINATE LINES --

SOUTHERN BOUNDARY - 32.5 -DEGREE NORTH LATITUDE
 NORTHERN BOUNDARY - 38.5 -DEGREE NORTH LATITUDE
 EASTERN BOUNDARY - 80.5 -DEGREE WEST LONGITUDE
 WESTERN BOUNDARY - 89.0 -DEGREE WEST LONGITUDE

AND HAVING A RICHTER SCALE MAGNITUDE EQUAL TO OR GREATER THAN 4.3

YEAR	DATE	TIME-HR-MIN-SEC	LAT - LONG	LOCALITY AND NOTES	FELT-SQ.MI.	MAG/INT	REFERENCES
1844	NOV 28	12 0 0.0	(36.0 84.0)	KNOXVILLE, TENN		VI	BD-5,6
1852	APR 29	18 0 0.0	(36.6 81.6)	VA-NC-TENN REGION	150000	VI	BD-5,6,10
1872	JUN 17	20 0 0.0	(33.1 83.3)	MILLEDGEVILLE, GA		V	D-5
1875	NOV 2	2 55 0.0	(33.8 82.5)	NORTHERN GEORGIA	25000	VI	AB-5,6
1876	SEP 25	6 0 0.0	(38.0 88.0)	S ILL-S IND-N KY AREA		VI	A-6
1876	SEP 25	6 15 0.0	(38.0 88.0)	S ILL-S IND-N KY-2ND AND STRONGEST SHOCK		VI	-6
1879	DEC 12	24 0 0.0	(35.2 80.8)	CHARLOTTE, NC		V-VI	A-5
1886	FEB 5	1 0 0.0	(32.8 88.0)	SUMTER CO., ALA	1600	V	-5
1891	JUL 27	2 28 0.0	(37.9 87.5)	EVANSVILLE, IND		VI	D-5
1897	MAY 3	17 18 0.0	(37.1 80.7)	NEAR ROANOKE, VA	150000	VI-VII	BD-5,6,9
1897	MAY 31	18 58 0.0	(37.3 80.7)	GILES COUNTY, VA	280000	VIII	ABCD-5,6,9
1897	OCT 22	3 20 0.0	(36.9 81.1)	WYTHEVILLE, VA	20000	V	F-5,9,6
1899	FEB 13	9 30 0.0	(37.0 81.0)	WESTERN VA- 4 SHOCKS, STRONGLY FELT IN E TN	30000	V	AF-5,6,9
1899	APR 30	2 5 0.0	(38.5 87.0)	SOUTHWESTERN, IND	40000	VI-VII	D-5,6
1902	MAY 29	7 30 0.0	(35.1 85.3)	CHATTANOOGA, TENN		V	BDF-5,6
1902	OCT 18	22 0 0.0	(35.0 85.3)	TN-GA AREA-MAIN SHOCK	1500	V-VI	AF-5,5
1904	MAR 5	0 30 0.0	(35.7 83.5)	MARYVILLE, TENN	5000	V	BF-5,6
1905	JAN 27	0 0 0.0	(34.0 86.0)	NEAR GADSDEN, ALA	250000	VIII	ACD-6,5
1905	JAN 28	0 0 0.0	(34.0 86.0)	GADSDEN-SECOND SHOCK	250000	VIII	ACD-6,5
1911	APR 22	3 0 0.0	(35.2 82.7)	CAESAR'S HEAD, SC, BLUE RIDGE AT NC-SC BORDER	600	V	C-6,5,7
1913	JAN 1	18 28 0.0	(34.7 81.7)	UNION COUNTY, SC	43000	VII-VIII	BD-5,6
1913	MAR 28	21 50 0.0	(36.2 83.7)	KNOXVILLE, TENN	2700	VII	BD-6,5
1913	APR 17	16 30 0.0	(35.3 84.2)	NEAR DUCKTOWN, TN	3500	V-VI	BD-6,5
1914	MAR 5	20 5 0.0	(33.5 83.5)	NEAR ATLANTA, GA	100000	VI	-6,5
1915	OCT 26	7 40 0.0	(36.7 88.6)	MAYFIELD, KY		V	DF-5,6
1915	OCT 29	6 0 0.0	(35.8 82.7)	NEAR MARSHALL, NC	1200	V	B-5,6
1916	FEB 21	22 39 0.0	(35.5 82.5)	NEAR WAYNESVILLE, NC	500000	VI-VII	ABD-6,5

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING 4.3 RICHTER OR GREATER LATITUDE 32.5-38.5 NORTH LONGITUDE 80.5-89.0 WEST SHEET 1 OF 3 Figure 2.5-171</p>

Figure 2.5-171 Earthquake Listing 4.3 Richter or Greater Latitude 32.5-38.5 North Longitude 80.5-89.0 West

1916	AUG 26	18 35	0.0	(36.0	81.0)	STATESVILLE AND TAYLORSVILLE, NC-STRONG, LINCOLNTON, NC REPORTED THREE SHOCKS	3800	V	AB-6
1916	AUG 26	19 36	0.0	(36.0	81.0)	STATESVILLE AND TAYLORSVILLE, NC-AFTERSHOCK	3800	V	AB-5,6
1916	OCT 18	22 4	0.0	(33.5	86.2)	BIRMINGHAM, ALA	170000	VII	ACD-6,5,7
1917	JUN 30	2 23	0.0	(32.7	87.5)	ROSEMARY, ALA		V	AB-6,5,7
1917	JUN 30	2 50	0.0	(32.7	87.5)	ROSEMARY-AFTERSHOCK		V	B-6,7
1918	JAN 16	15 45	0.0	(35.9	83.9)	KNOXVILLE, TENN		V	BD-6
1920	DEC 24	7 0	0.0	(36.0	85.0)	ROCKWOOD, TENN		V	B-6,5
1921	JUL 15	0 0	0.0	(36.6	82.3)	MENDOTA, VA		V-VI	D-6,5,9
1921	DEC 15	13 20	0.0	(35.8	84.6)	NEAR KINGSTON, TENN- FELT FROM KINGSTON TO DAYTON, EAST TO ATHENS		V	BD-6
1922	MAR 22	22 30	0.0	(37.3	88.6)	SOUTHERN ILL	25000	V	AD-6,5
1922	MAR 23	2 20	0.0	(37.3	88.6)	S ILL-SECOND SHOCK	25000	V	D-6,5
1922	MAR 23	21 45	0.0	(37.0	88.0)	WESTERN KENTUCKY		V	-6,5
1922	MAR 30	2 20	0.0	(35.5	86.7)	FARMINGTON, MARSHALL CO., TENN		V	B-6
1924	OCT 20	8 30	0.0	(35.0	82.6)	PICKENS COUNTY, SC	56000	V	BD-5,6
1925	APR 27	4 5	0.0	(38.0	87.5)	SOUTHWESTERN, IND	100000	V-VI	BD-5,6
1925	MAY 13	12 0	0.0	(36.7	88.6)	HAYFIELD, KY	3000	V	-5,6
1925	SEP 2	11 55	0.0	(37.8	87.6)	NEAR HENDERSON, KY	75000	V-VI	ACD-5,6
1926	JUL 8	9 50	0.0	(35.9	82.1)	SOUTH MITCHELL CO., NC		VI-VII	BCDF-6,5
1927	MAY 7	8 28	0.0	(36.5	89.0)	NEAR NEW MADRID, MO	130000	VII	BD-6,5
1927	JUN 16	12 0	0.0	(34.7	86.0)	NEAR SCOTTSBORO, ALA	2500	V	BDP-6,5
1927	OCT 8	12 56	0.0	(35.0	85.3)	CHATTANOOGA, TENN		V	AD-6
1928	NOV 3	4 3	0.0	(36.0	82.6)	NE TENN-W NC BORDER REGION-FELT IN ALA, GA, VA, KY AND SC	40000	VI-VII	CD-5,6,1,9
1930	AUG 30	9 28	0.0	(35.9	84.4)	E TENN NEAR KINGSTON- FELT ALSO AT LENOIR CITY, OLIVER SPRINGS, AND LAWNVILLE, TENN		V	B-1,6
1931	MAY 5	12 18	0.0	(33.7	86.6)	NORTHERN ALA-FELT IN GA AND POSSIBLY SC	6500	V-VI	BD-1,6,5
1935	JAN 1	8 15	0.0	(35.1	83.6)	GA-NC BORDER-DAMAGE AT DAHLONEGA, GA, AND ALMOND AND GAY, NC, CENTERED NEAR HAYESVILLE, NC, FELT IN TENN	7000	V	BD-6,5,1
1939	MAY 5	3 45	0.0	(33.7	85.8)	ANNISTON, ALA-FELT ALSO AT OXFORD LAKE, BLUE MTH., TALLEDEGA, CHOCCOLOCCO, JENIFER		V	D-5,6,2
1940	DEC 25	6 49	0.0	(35.9	82.9)	NC-TENN MAIN SHOCK	7000	V	ABD-6,2
1945	JUN 14	3 25	0.0	(35.0	84.5)	CLEVELAND, TENN-FELT TO BLUE RIDGE, GA	4000	V	B-6,3,5
1948	FEB 10	0 4	0.0	(36.4	84.1)	LAPOLLETTE, TENN		V-VI	B-6,3
1954	JAN 2	2 25	0.0	(36.6	83.7)	MIDDLESBORO, KY-FELT IN KY, TN, VA AND NC		VI	D-3,5
1954	JAN 22	0 0	0.0	(35.3	84.4)	NEAR ETOWAH AND ATHENS, TENN		V	BD-3,5

Revised by Amendment 33.

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

**EARTHQUAKE LISTING
4.3 RICHTER OR GREATER
LATITUDE 32.5-38.5 NORTH
LONGITUDE 80.5-89.0 WEST
SHEET 2 OF 3
Figure 2.5-172**


Figure 2.5-172 Earthquake Listing 4.3 Richter or Greater Latitude 32.5-38.5 North Longitude 80.5-89.0 West

1955	SEP 28	7 1 42.0	(36.6 81.4)	NC-VA BORDER AREA	1700	V	BD-3,5
1956	SEP 7	13 36 1.0	35.5 84.0	NEAR KNOXVILLE, TENN- FELT IN TN, KY AND NC	8100	VI	ABD-3,5,11
1956	SEP 7	13 49 20.0	35.5 84.0	EAST TENN-AFTERSHOCK	8300	VI	BD-3,5,11
1957	JAN 25	18 15 0.0	(36.6 83.7)	NOETOWN, KY-A SUBURB OF MIDDLESBORO, KY		VI	-3
1957	MAR 26	8 27 6.0	(37.0 88.4)	PADUCAH, KY-FELT AT SMITHLAND, KY		V	BDP-3,5
1957	APR 23	9 23 39.0	(34.5 86.8)	W ALA-FELT ALSO IN GA	11500	VI	BD-5,3,11
1957	MAY 14	14 24 58.0	(35.7 82.0)	W NC-FELT SC AND TN	8100	VI	BD-5,3,11
1957	JUN 23	6 34 18.0	36.5 84.5	E-CENTRAL TENN-FELT IN HARDIN VALLEY AND CLINCH R. VALLEY AND AT CONCORD, DIXIE LEE JUNCTION, OAK RIDGE, TN		V	-5,3,11
1957	JUL 2	9 33 1.0	(35.5 82.5)	W NC-FELT STRONGLY IN MADISON AND BUNCOMBE, COUNTY, NC AND DAMAGE AT FLAG POND, TENN		VI	D-5,3
1957	NOV 24	20 6 17.0	35.0 83.5	NC-TENN BDR .RGN.-FELT IN SC, NC, GA AND TENN	4100	VI	BD-5,3
1958	JAN 28	4 57 0.0	(37.0 89.0)	ILL-KY-MO BORDER AREA	300	V	D-3,5
1958	OCT 20	6 16 0.0	(34.5 82.8)	ANDERSON, SC		V	BP-5,3
1958	NOV 8	2 41 43.0	38.4 87.9	ILL-IND BORDER-FELT IN ILL, IND, MO AND KY	33000	VI	D-3,5,11
1959	AUG 12	18 6 7.0	35.0 87.0	ALA-TN BORDER AREA	2800	VI	BD-3,5,11
1960	APR 15	10 10 10.0	(35.8 84.0)	NEAR KNOXVILLE, TENN	1300	V	BD-3,5
1962	JUN 27	1 28 55.7	37.7 88.5	S ILL-FELT IN PADUCAH AND WICKLIFFE, KY AND IN MO		5.5	BD-3,5,11
1963	OCT 28	22 38 35.0	36.7 81.0	NEAR GALAX, VA-FELT IN VA AND NC	1300	V	ABD-3,5,9
1963	OCT 29	1 57 0.0	36.7 81.0	GALAX, VA-AFTERSHOCK	1300	V	BD-3,9
1964	FEB 18	10 31 11.5	34.8 85.5	DE KALB CO., NE ALA-FELT IN GA, DEPTH 15KM		4.4	B-3
1964	MAR 13	1 20 18.1	32.8 83.4	CENTRAL GA-FELT IN BALDWIN, BIBB, JONES AND WILKINSON COUNTY	400	4.4	B-3
1964	APR 20	19 4 46.0	(34.0 81.0)	NEAR COLUMBIA, SC		V	B-3
1968	NOV 9	17 1 41.0	38.0 88.5	SOUTHERN ILL-FELT IN 23 STATES AND CANADA	400000	5.3	D-4,11
1968	DEC 11	15 0 0.0	(38.3 85.7)	LOUISVILLE, KY		V	-3,16
1969	NOV 20	1 0 9.0	37.4 81.0	SOUTHERN PART W VA-FELT IN VA, GA, OHIO, KY, MD, NC, SC, W VA, AND TN, DEPTH ABOUT 3 KM		4.3	D-4
1971	MAR 14	17 27 51.3	33.1 87.9	CAROLTON, ALA-FELT		4.5	-4
1973	NOV 30	7 48 41.2	35.8 84.0	E TENN-MINOR DAMAGE AT MARYVILLE		4.6	F-17
1974	AUG 2	8 52 9.8	33.8 82.4	GEORGIA-MINOR DAMAGE ROBBY BROWN ST. PARK		4.8	F-17

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING 4.3 RICHTER OR GREATER LATITUDE 32.5-38.5 NORTH LONGITUDE 80.5-89.0 WEST SHEET 3 OF 3 Figure 2.5-173</p>

Figure 2.5-173 Index Map -Earthquakes 4.3 Richter or Greater Latitude 30-37 North Longitude 78-92 West

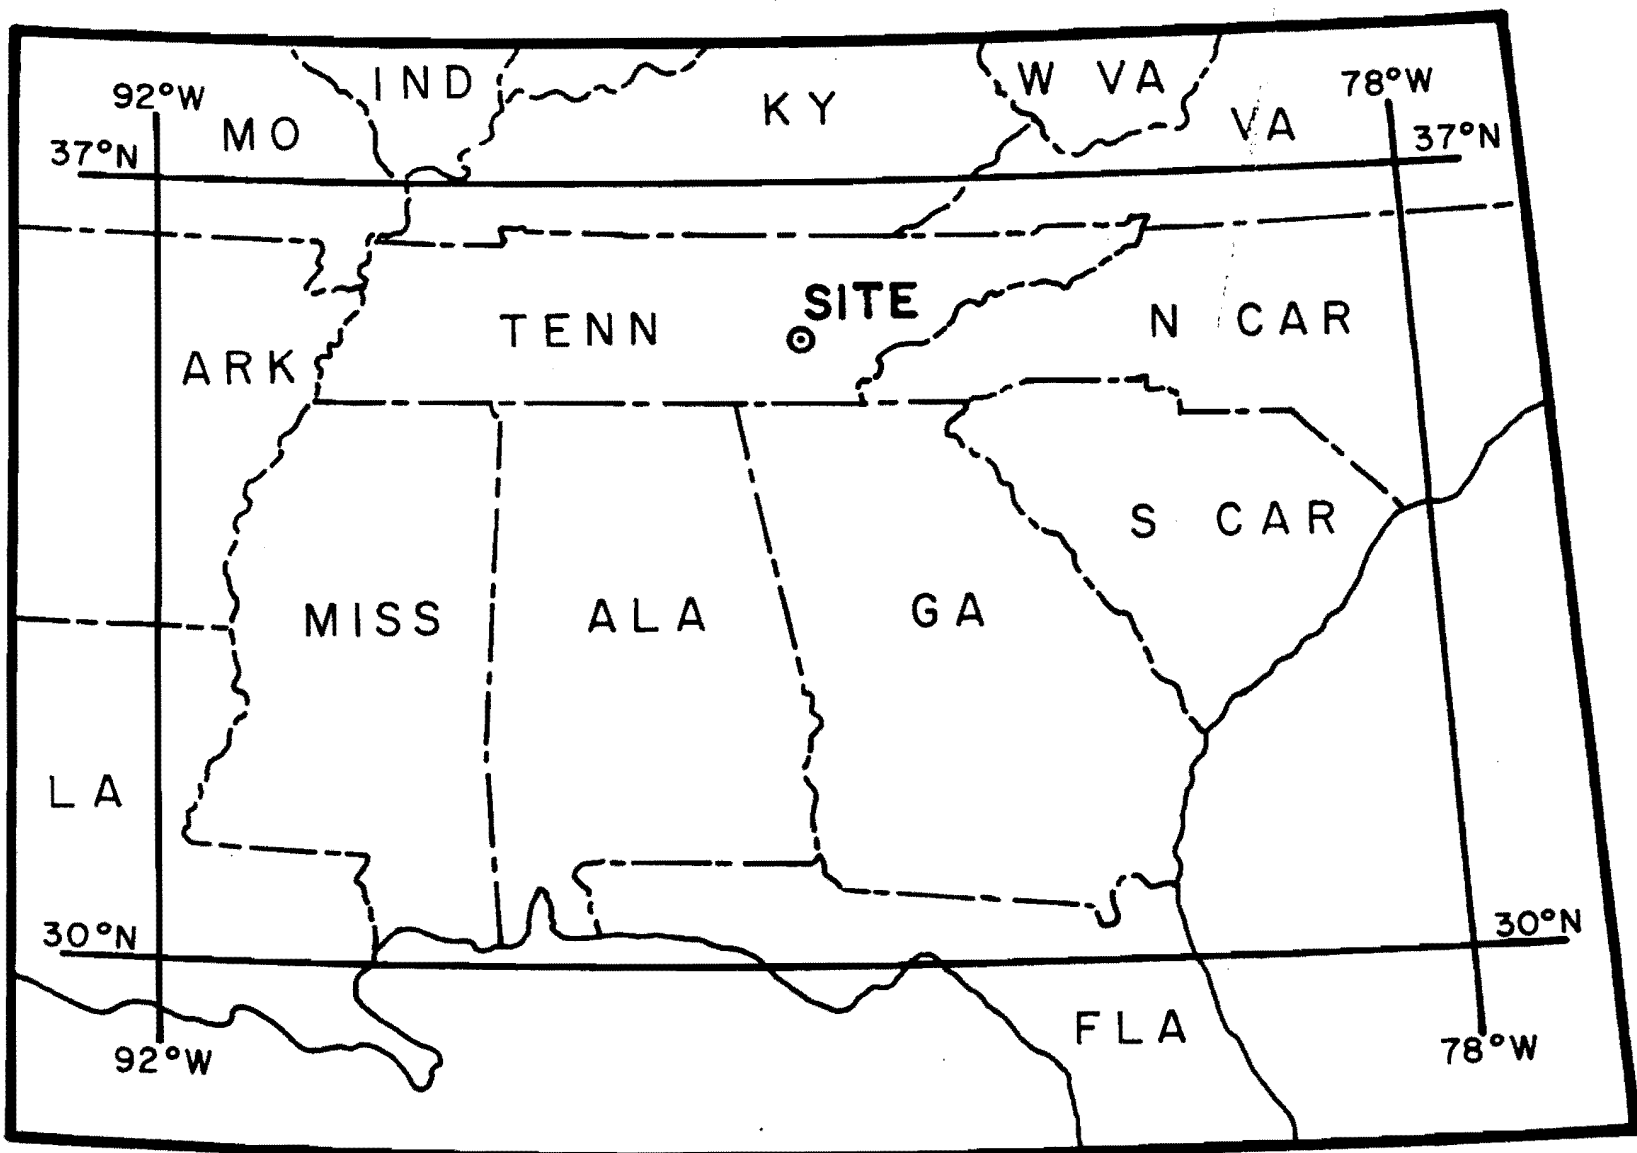

Revised by Amendment 33.

**WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT**

**INDEX MAP - EARTHQUAKES
4.3 RICHTER OR GREATER
LATITUDE 30-37 NORTH
LONGITUDE 78-92 WEST**

Figure 2.5-174

Figure 2.5-174 Earthquakes Listing 4.3 Richter or Greater Latitude 30-37 North Longitude 78-92 West

SEISMIC HISTORY OF THE SOUTHEAST REGION OF THE UNITED STATES

THIS IS A CHRONOLOGICAL LISTING OF ALL EARTHQUAKES HAVING EPICENTERS IN THE RECTANGULAR PORTION OF THE SOUTH-EAST REGION BOUNDED BY THE FOLLOWING GEODETIC COORDINATE LINES --

- SOUTHERN BOUNDARY - 30.0 -DEGREE NORTH LATITUDE
- NORTHERN BOUNDARY - 37.0 -DEGREE NORTH LATITUDE
- EASTERN BOUNDARY - 78.0 -DEGREE WEST LONGITUDE
- WESTERN BOUNDARY - 92.0 -DEGREE WEST LONGITUDE

AND HAVING A RICHTER SCALE MAGNITUDE EQUAL TO OR GREATER THAN 4.3

YEAR	DATE	TIME-HR-MIN-SEC	LAT - LONG	LOCALITY AND NOTES	FELT-SQ.MI.	MAG/INT	REFERENCES
1811	DEC 16	8 0 0.0	(36.6 89.6)	NEW MADRID, MO-FELT EXTENSIVELY EASTWARD, PERHAPS THE STRONGEST EVER IN U.S., LIMITED DAMAGE BECAUSE POP. SPARCE, INTENSITY-XII	2000000		ABCD -5,6
1812	JAN 23	15 0 0.0	(36.6 89.6)	NEW MADRID, MO-SECOND MAIN SHOCK OF SERIES, INTENSITY-XII	2000000		ABCD-5,6
1812	FEB 7	9 45 0.0	(36.6 89.6)	NEW MADRID, MO-THIRD MAIN SHOCK OF SERIES, INTENSITY-XII			ABCD-5,6
1841	DEC 28	5 50 0.0	(36.5 89.2)	NEAR HICKMAN, KY		V	-16
1843	JAN 5	1 0 0.0	(35.2 90.0)	W TENN-FELT TO EAST	400000	VII	BCD-5,6
1844	NOV 28	12 0 0.0	(36.0 84.0)	KNOXVILLE, TENN		VI	BD-5,6
1852	APR 29	18 0 0.0	(36.6 81.6)	VA-NC-TENN REGION	150000	VI	BD-5,6,10
1855	FEB 2	8 0 0.0	(37.0 78.6)	CHARLOTTE COURT HOUSE, VA	9000	V	-16
1861	AUG 31	10 22 0.0	(36.6 78.5)	VIRGINIA	300000	VI	D-5,9,6,10
1865	AUG 17	15 0 0.0	(36.5 89.5)	NEW MADRID, MO-FELT WIDELY OVER MISS VAL.	24000	VII	D-6,5
1872	JUN 17	20 0 0.0	(33.1 83.3)	MILLEDGEVILLE, GA		V	D-5
1875	NOV 2	2 55 0.0	(33.8 82.5)	NORTHERN GEORGIA	25000	VI	AB-5,6
1875	DEC 23	4 45 0.0	(36.6 78.5)	ARVONIA, VA-5 SHOCKS IN QUICK SUCCESSION	50000	VII	ABD-5,9
1878	MAR 12	10 0 0.0	(36.8 89.2)	COLUMBUS, KY		V	CP-5,6
1878	NOV 19	5 52 0.0	(36.7 90.4)	TENN-MO-KY-ILL AREA	150000	VI-VIII	AD-6,5
1879	DEC 12	24 0 0.0	(35.2 80.8)	CHARLOTTE, NC		V-VI	A-5
1883	JAN 11	7 12 0.0	(37.0 89.2)	CAIRO, ILL-MAIN SHOCK	80000	V-VI	AD-6,5
1883	APR 12	8 30 0.0	(37.0 89.2)	CAIRO, ILL-AFTERSHOCK		VI-VII	DF-5,6
1883	JUN 11	0 0 0.0	(35.2 90.0)	MEMPHIS, TENN		VI-VII	-7
1883	DEC 5	15 20 0.0	(36.3 91.8)	MFLBOURNE, ARK		V	BCD-5
1884	JAN 18	13 0 0.0	(34.3 78.0)	WILMINGTON, NC		V	D-5

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING 4.3 RICHTER OR GREATER LATITUDE 30-37 NORTH LONGITUDE 78-92 WEST SHEET 1 OF 6 Figure 2.5-175</p>

Figure 2.5-175 Earthquakes Listing 4.3 Richter or Greater Latitude 30-37 North Longitude 78-92 West

1886	FEB 5	1 0 0.0	(32.8 88.0)	SUMTER CO., ALA	1600	V	-5
1886	AUG 28	1 30 0.0	(33.1 80.2)	SUMMERVILLE, SC- CHARLESTON FORESHOCK		V	-14
1886	SEP 1	2 51 0.0	(32.9 80.0)	FIFTEEN MILES NW OF CHARLESTON, SC-ONE OF STRONGEST EVER TO OCCUR IN U.S., EXTEN- SIVE DAMAGE, INTEN- SITY X	2000000		ABCD-5,6,8
1886	SEP 1	2 59 0.0	(32.9 80.0)	CHARLESTON, SC-2ND MAIN SHOCK, INT-X	2000000		ABCD-5,6,8
1886	SEP 1	5 5 0.0	(32.9 80.0)	CHARLESTON-AFTERSHOCK			-14
1886	SEP 4	4 1 0.0	(32.9 80.0)	CHARLESTON-AFTERSHOCK		VI	-8,14
1886	SEP 6	4 6 0.0	(32.9 80.0)	CHARLESTON-AFTERSHOCK		VI	-8,14
1886	SEP 21	10 15 0.0	(32.9 80.0)	CHARLESTON-AFTERSHOCK		V-VI	-14
1886	SEP 27	19 2 0.0	(32.9 80.0)	CHARLESTON-AFTERSHOCK		VI	-14
1886	OCT 22	19 45 0.0	(32.9 80.0)	CHARLESTON-AFTERSHOCK	30000	VII-VIII	-5,8,14
1886	NOV 5	17 20 0.0	(32.9 80.0)	CHARLESTON-AFTERSHOCK	30000	VI-VII	-5,14
1887	JAN 4	11 44 0.0	(32.9 80.0)	CHARLESTON-AFTERSHOCK		VI	-14
1887	AUG 2	18 36 0.0	(37.0 89.2)	CAIRO, ILL		V	D-5,6
1888	JAN 12	15 54 0.0	(32.9 80.0)	CHARLESTON, SC		VII	-14
1889	JUL 20	1 32 0.0	(35.2 90.0)	MEMPHIS, TENN		V-VII	D-6,5
1891	SEP 27	4 55 0.0	(37.0 89.2)	CAIRO, ILL		V	D-5,6
1895	OCT 31	11 8 0.0	(37.0 89.4)	NEAR CHARLESTON, MO- 4 ACRES OF GROUND SANK FORMING A LAKE, CONSIDERABLE DAMAGE AT CAIRO, ILL, FELT EXTENSIVELY EASTWARD	1000000	VIII-IX	ACD-6,5
1897	OCT 22	1 20 0.0	(36.9 81.1)	WYTHEVILLE, VA	20000	V	F-5,9,6
1899	FEB 11	9 30 0.0	(37.0 1.0)	WESTERN VA- 4 SHOCKS, STRONGLY FELT IN E TN	30000	V	AP-5,6,9
1900	OCT 13	4 15 0.0	(30.4 81.7)	JACKSONVILLE, FLA-8 DISTINCT SHOCKS FELT		V	AP-5
1902	MAY 29	7 30 0.0	(35.1 85.3)	CHATTANOOGA, TENN		V	BDP-5,6
1902	OCT 18	22 0 0.0	(35.0 85.3)	TN-GA AREA-MAIN SHOCK	1500	V-VI	AP-6,5
1903	JAN 24	1 15 0.0	(32.1 81.1)	NEAR SAVANNAH, GA	10000	VI	BD-5
1904	MAR 5	0 30 0.0	(35.7 83.5)	MARYVILLE, TENN	5000	V	BP-5,6
1905	JAN 27	0 0 0.0	(34.0 86.0)	NEAR GADSDEN, ALA	250000	VIII	ACD-6,5
1905	JAN 29	0 0 0.0	(34.0 86.0)	GADSDEN-SECOND SHOCK	250000	VIII	ACD-6,5
1905	AUG 22	5 8 0.0	(36.9 89.6)	NEAR SIKESTON, MO-FELT OVER WIDE AREA	40000	IV VI	BD-6,7
1907	APR 19	8 30 0.0	(32.9 80.0)	CHARLESTON, SC	10000	V	D-5
1908	OCT 28	0 27 0.0	(37.0 89.2)	CAIRO, ILL	5000	V	B-6,5
1909	OCT 23	7 10 0.0	(37.0 89.5)	SOUTHEASTERN, MO	40000	V-VI	-5,6
1911	APR 22	3 0 0.0	(35.2 82.7)	CAESAR'S HEAD, SC, BLUE RIDGE AT NC-SC BORDER	600	V	C-6,5,7
1912	JUN 12	10 30 0.0	(32.9 80.0)	SUMMERVILLE, SC	35000	VII	D-5
1912	JUN 20	0 0 0.0	(32.0 81.0)	SAVANNAH, GA		V	F-5
1913	JAN 1	18 28 0.0	(34.7 81.7)	UNION COUNTY, SC	43000	VII-VIII	BD-5,6
1913	MAR 28	21 50 0.0	(36.2 83.7)	KNOXVILLE, TENN	2700	VII	BD-6,5

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING 4.3 RICHTER OR GREATER LATITUDE 30-37 NORTH LONGITUDE 78-92 WEST SHEET 2 OF 6 Figure 2.5-176</p>

Figure 2.5-176 Earthquakes Listing 4.3 Richter or Greater Latitude 30-37 North Longitude 78-92 West

1913	APR 17	16 30	0.0	(35.3	84.2)	NEAR DUCKTOWN,TN	3500	V-VI	BD-6,5
1914	MAR 5	20 5	0.0	(33.5	83.5)	NEAR ATLANTA,GA	100000	VI	-6,5
1914	SEP 22	7 4	0.0	(33.0	80.3)	NEAR SUMMERVILLE,SC	30000	V	B-5
1915	OCT 26	7 40	0.0	(36.7	88.6)	MAYFIELD,KY		V	DP-5,6
1915	OCT 29	6 0	0.0	(35.8	82.7)	NEAR MARSHALL,NC	1200	V	B-5,6
1915	DEC 7	18 40	0.0	(36.7	89.1)	CAIRO,ILL	60000	V-VI	D-6,5
1916	FEB 21	22 39	0.0	(35.5	82.5)	NEAR WAYNESVILLE,NC	500000	VI-VII	ABD-6,5
1916	AUG 26	18 35	0.0	(36.0	81.0)	STATESVILLE AND TAYLORSVILLE,NC-STRONG, LINCOLNTON,NC REPORTED THREE SHOCKS	3800	V	AB-6
1916	AUG 26	19 36	0.0	(36.0	81.0)	STATESVILLE AND TAYLORSVILLE,NC-AFTERSHOCK	3800	V	AB-5,6
1916	OCT 18	22 4	0.0	(33.5	86.2)	BIRMINGHAM,ALA	170000	VII	ACD-6,5,7
1916	DEC 19	5 42	0.0	(36.6	89.3)	HICKMAN,KY-TWO SHOCKS		V-VII	BD-6,5
1917	JUN 30	2 23	0.0	(32.7	87.5)	ROSEMARY,ALA		V	AB-6,5,7
1917	JUN 30	2 50	0.0	(32.7	87.5)	ROSEMARY-AFTERSHOCK		V	B-6,7
1918	JAN 16	15 45	0.0	(35.9	83.9)	KNOXVILLE,TENN		V	BD-6
1918	OCT 13	21 30	0.0	(36.1	91.1)	BLACK ROCK,ARK		V	AB-5,6
1920	DEC 24	7 0	0.0	(36.0	85.0)	ROCKWOOD,TENN		V	B-6,5
1921	JUL 15	0 0	0.0	(36.6	82.3)	MENDOTA,VA		V-VI	D-6,5,9
1921	DEC 15	13 20	0.0	(35.8	84.6)	NEAR KINGSTON,TENN-FELT FROM KINGSTON TO DAYTON,EAST TO ATHENS		V	BD-6
1922	MAR 23	21 45	0.0	(37.0	88.0)	WESTERN KENTUCKY		V	-6,5
1922	MAR 30	2 20	0.0	(35.5	86.7)	FARRINGTON,MARSHALL CO.,TENN		V	B-6
1922	MAR 30	4 53	0.0	(35.2	90.0)	MEMPHIS,TN-FELT IN TN,KY,MO AND ILL		V	-6
1923	OCT 28	17 10	0.0	(35.5	90.3)	HARKED TREE,ARK	40000	VII	CD-5,6,7
1923	NOV 26	23 25	0.0	(35.2	90.2)	E ARK AND W TENN-FELT STRONGLY AT MEMPHIS		VI	-6
1924	JAN 1	3 5	0.0	(35.4	90.3)	NEAR MEMPHIS,TENN	10000	V	-6,5
1924	MAR 2	11 18	0.0	(36.9	89.1)	E KY NEAR CAIRO,ILL	25000	V	-5,6
1924	OCT 20	8 30	0.0	(35.0	82.6)	PICKENS COUNTY,SC	56000	V	BD-5,6
1925	MAY 13	12 0	0.0	(36.7	88.6)	MAYFIELD,KY	3000	V	-5,6
1926	JUL 8	9 50	0.0	(35.9	82.1)	SOUTH MITCHELL CO.,NC		VI-VII	BCDF-6,5
1927	MAY 7	8 28	0.0	(36.5	89.0)	NEAR NEW MADRID,MO	130000	VII	BD-6,5
1927	JUN 16	12 0	0.0	(34.7	86.0)	NEAR SCOTTSBORO,ALA	2500	V	BDP-6,5
1927	AUG 13	16 0	0.0	(36.4	89.5)	TIPTONVILLE,TENN		V	D-6
1927	OCT 8	12 56	0.0	(35.0	85.3)	CHATTANOOGA,TENN		V	AD-6
1928	NOV 3	4 3	0.0	(36.0	82.6)	NE TENN-W NC BORDER REGION-FELT IN ALA,GA,VA,KY AND SC	40000	VI-VII	CD-5,6,1,9
1930	AUG 30	9 28	0.0	(35.9	84.4)	E TENN NEAR KINGSTON-FELT ALSO AT LENOIR CITY,OLIVER SPRINGS, AND LAWNVILLE,TENN		V	B-1,6
1931	MAY 5	12 18	0.0	(33.7	86.6)	NORTHERN ALA-FELT IN GA AND POSSIBLY SC	6500	V-VI	BD-1,6,5
1931	DEC 17	3 36	0.0	(34.0	89.7)	BATESVILLE,MISS	65000	VI-VII	D-5,6,1
1933	DEC 9	8 40	0.0	(35.8	90.2)	MANILA,ARK		V	DP-5,6,1

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING 4.3 RICHTER OR GREATER LATITUDE 30-37 NORTH LONGITUDE 78-92 WEST SHEET 3 OF 6 Figure 2.5-177</p>

Figure 2.5-177 Earthquakes Listing 4.3 Richter or Greater Latitude 30-37 North Longitude 78-92 West

1934	AUG 20	0 47 0.0	(37.0 89.2)	NEAR RODNEY, SE MO	30000	V-VI	AD-6, 1, 5
1935	JAN 1	8 15 0.0	(35.1 83.6)	GA-NC BORDER-DAMAGE AT DAHLONEGA, GA, AND ALMOND AND GAY, NC, CENTERED NEAR HAYESVILLE, NC, FELT IN TENN	7000	V	BD-6, 5, 1
1939	MAY 5	3 45 0.0	(33.7 85.8)	ANNISTON, ALA-FELT ALSO AT OXFORD LAKE, BLUE MTN., TALLADEGA, CHOCCOLOCCO, JENIPER		V	D-5, 6, 2
1940	DEC 25	6 49 0.0	(35.9 82.9)	NC-TENN MAIN SHOCK	7000	V	ABD-6, 2
1941	NOV 17	3 9 0.0	(35.5 89.7)	NEAR COVINGTON, TENN		V	BD-6, 3, 5
1945	JUN 14	3 25 0.0	(35.0 84.5)	CLEVELAND, TENN-FELT TO BLUE RIDGE, GA	4000	V	B-6, 3, 5
1947	DEC 16	3 27 0.0	(35.7 90.0)	NEAR OSCEOLA, ARK-IN THE MEMPHIS AREA	10000	V	D-6, 3
1948	FEB 10	0 4 0.0	(36.4 84.1)	LAFOLLETTE, TENN		V-VI	B-6, 3
1949	JAN 14	3 45 0.0	(36.5 89.5)	W TENN-E ARK-SE MO AREA-FELT STRONGLY AT TIPTONVILLE, MEMPHIS	7000	V	B-6, 3
1952	FEB 20	22 34 39.0	36.4 89.5	TENN-MO BORDER NEAR TIPTONVILLE, TENN-FELT ALSO IN ARK AND KY		V	D-3, 5
1952	JUL 16	23 48 10.0	36.2 89.6	DYERSBURG, TENN		VI	AD-3, 5
1952	NOV 19	0 0 0.0	(32.8 80.0)	CHARLESTON, SC		V	D-5, 3
1954	JAN 2	2 25 0.0	(36.6 83.7)	MIDDLESBORO, KY-FELT IN KY, TN, VA AND NC		VI	D-3, 5
1954	JAN 22	0 0 0.0	(35.3 84.4)	NEAR ETOWAH AND ATHENS, TENN		V	BD-3, 5
1954	FEB 2	4 53 0.0	(36.7 90.3)	POPLAR BLUFF, MO-FELT IN PARTS OF MO, ARK, ILL, AND TENN		VI	D-3, 5, 11
1955	JAN 25	7 24 30.0	35.6 90.3	TENN-ARK-MO BDR. RGN-FELT FROM LEPANTO, ARK TO PADUCAH, KY AND BIRMINGHAM, ALA	30000	VI	D-3, 5
1955	FEB 1	14 45 0.0	(30.4 89.1)	GULFPORT, MISS		V	BD-3, 5
1955	MAR 29	9 2 40.0	(36.0 89.5)	PINLEY, TENN-FELT AT CARUTHERSVILLE, MO		VI	BD-3, 5, 11
1955	SEP 5	1 45 0.0	(36.0 89.5)	NEAR PINLEY AND DYERSBURG, TENN		V	BD-3, 11
1955	SEP 28	7 1 42.0	(36.6 81.4)	NC-VA BORDER AREA	1700	V	BD-3, 5
1955	DEC 13	7 43 0.0	(36.0 89.5)	WESTERN DYER CO. TENN-FELT AT PINLEY, TENN		V	A-3, 5
1955	DEC 13	7 56 0.0	(36.0 89.5)	DYER CO.-AFTERSHOCK		V	-3, 5
1956	JAN 29	4 14 15.0	35.6 89.6	TENN-ARK BORDER NEAR COVINGTON, TENN		VI	D-3, 5
1956	SEP 7	13 36 1.0	35.5 84.0	NEAR KNOXVILLE, TENN-FELT IN TN, KY AND NC	8300	VI	ABD-3, 5, 11
1956	SEP 7	13 49 20.0	35.5 84.0	EAST TENN-AFTERSHOCK	8300	VI	BD-3, 5, 11
1956	OCT 29	9 23 44.0	(36.1 89.4)	CARUTHERSVILLE, MO		V	B-5, 3, 11
1957	JAN 25	18 15 0.0	(36.6 83.7)	MOETOWN, KY-A SUBURB OF MIDDLESBORO, KY		VI	-3
1957	MAR 26	8 27 6.0	(37.0 88.4)	PADUCAH, KY-FELT AT SMITHLAND, KY		V	BDF-3, 5
1957	APR 23	9 23 39.0	(34.5 86.8)	W ALA-FELT ALSO IN GA	11500	VI	BD-5, 3, 11
1957	MAY 14	14 24 58.0	(35.7 82.0)	W NC-FELT SC AND TN	8100	VI	BD-5, 3, 11

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

Revised by Amendment 33.

EARTHQUAKE LISTING
4.3 RICHTER OR GREATER
LATITUDE 30-37 NORTH
LONGITUDE 78-92 WEST
SHEET 4 OF 6
Figure 2.5-178

Figure 2.5-178 Earthquakes Listing 4.3 Richter or Greater Latitude 30-37 North Longitude 78-92 West

1957	JUN 23	6 34 18.0	36.5	84.5	E-CENTRAL TENN-FELT IN HARDIN VALLEY AND CLINCH R. VALLEY AND AT CONCORD, DIXIE LEE JUNCTION, OAK RIDGE, TN		V	-5,3,11
1957	JUL 2	9 33 1.0	(35.5	82.5)	W NC-FELT STRONGLY IN MADISON AND BUNCOMBE, COUNTY, NC AND DAMAGE AT FLAG POND, TENN		VI	D-5,3
1957	NOV 24	20 6 17.0	35.0	83.5	NC-TENN BDR. RGN.-FELT IN SC, NC, GA AND TENN	4100	VI	BD-5, 1
1958	JAN 26	16 56 0.0	(35.1	90.0)	MEMPHIS, TENN-FELT IN SE MO		V	D-3,5
1958	JAN 28	4 57 0.0	(37.0	89.0)	ILL-KY-MO BORDER AREA	300	V	D-3,5
1958	APR 8	22 25 33.0	(36.2	89.1)	OBION CO., TENN	400	V	B-3,5
1958	APR 26	7 30 0.0	(36.3	89.5)	LAKE CO., TENN-FELT AT CARUTHERSVILLE, MO		V	B-3,5
1958	OCT 20	6 16 0.0	(34.5	82.8)	ANDERSON, SC		V	BF-5,3
1958	NOV 19	18 15 0.0	(30.3	91.1)	BATON ROUGE, LA		V	P-3,5
1959	FEB 13	8 37 0.0	(36.2	89.5)	BOGOTO, TENN-2 SHOCKS	200	V	B-3,5
1959	AUG 3	6 8 30.0	33.0	79.5	SE S CAROLINA-FELT IN LARGE AREA OF E GA	25000	VI	BD-3,, 11
1959	AUG 12	18 6 7.0	35.0	87.0	ALA-TN BORDER AREA	2800	VI	BD-3,5,11
1959	OCT 27	2 7 28.0	(34.5	80.3)	NE S CAROLINA-FELT IN NC, STRONG AT MCBEE, SC	4800	VI	BD-3,5
1959	DEC 21	15 25 0.0	(36.0	89.5)	PINLEY, TENN-FELT IN SE MO	400	V	D-3,, 11
1960	JAN 28	21 38 0.0	(36.0	89.5)	DYER COUNTY, TENN		V	B-5,3
1960	MAR 12	12 47 40.0	33.0	79.0	NEAR COAST OF SC-FELT AT CHARLESTON	3500	V	-5,3
1960	APR 15	10 10 10.0	(35.8	84.0)	NEAR KNOXVILLE, TENN	1300	V	BD-3,5
1960	APR 21	10 45 0.0	(36.3	89.5)	LAKE COUNTY, TENN		V	BF-5,3
1960	JUL 24	3 37 30.0	(33.0	80.0)	CHARLESTON, SC		V	D-3,5
1962	FEB 2	6 43 34.0	36.5	89.6	NEW MADRID, MO-FELT IN ARK, ILL, KY, MO AND TN	35000	VI	BD-3,5,11
1962	JUL 23	6 5 18.4	36.1	89.8	SOUTHERN MO-FELT ALSO IN ARK AND TENN		VI	BD-3,5
1963	MAR 3	17 30 13.0	36.7	90.1	SE MO	100000	4.5	BD-5,3,11
1963	OCT 28	22 38 35.0	36.7	81.0	NEAR GALAX, VA-FELT IN VA AND NC	1300	V	ABD-3,5,9
1963	OCT 29	1 57 0.0	36.7	81.0	GALAX, VA-APTERS HOCK	1300	V	BD-3,9
1964	FEB 18	10 31 11.5	34.8	85.5	DE KALB CO., NE ALA-FELT IN GA, DEPTH 15KM		4.4	B-3
1964	MAR 13	1 20 18.1	32.8	83.4	CENTRAL GA-FELT IN BALDWIN, BIBB, JONES AND WILKINSON COUNTY	400	4.4	B-3
1964	APR 20	19 4 46.0	(34.0	81.0)	NEAR COLUMBIA, SC		V	B-3
1966	FEB 12	4 32 14.7	35.9	90.0	NE ARK-FELT AT DEL-BRIDGE, BLYTHEVILLE, MANILA, LEACHVILLE AND STEEL, ARK		4.3	-3
1968	FEB 10	1 34 32.0	36.6	89.5	NEW MADRID, MO REGION		4.5	-4,11
1970	DEC 24	10 17 57.1	36.7	89.5	NEW MADRID, MO-FELT AT POPLAR BLUFF		4.8	-4
1971	MAR 14	17 27 51.3	33.1	87.9	CARROLTON, ALA-FELT		4.5	-4
1971	OCT 1	18 49 39.4	35.8	90.4	JONESBORO, ARK-FELT IN ALA, IND, ILL, KY, MISS, MO AND TN		VJ	D-4

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING 4.3 RICHTER OR GREATER LATITUDE 30-37 NORTH LONGITUDE 78-92 WEST SHEET 5 OF 6 Figure 2.5-179</p>

Figure 2.5-179 Earthquakes Listing 4.3 Richter or Greater Latitude 30-37 North Longitude 78-92 West

1972	FEB 3	23 11 8.4	33.5	80.4	NEAR ORANGEBURG, SC- FELT THROUGHOUT SC, WESTERN NC AND AT AUGUSTA, GA. DEPTH 5KM	4.5	-4
1972	MAR 29	20 38 31.9	36.1	89.8	NEW MADRID, MO AREA- FELT IN MO, TN, ARK, ILL, KY AND MISS	V	-4
1972	JUN 19	5 46 15.3	37.0	89.1	CAPE GIRARDEAU, MO- FELT IN WICKLIPPE, MO AND KEVIL, KY	4.5	-4
1973	NOV 30	7 48 41.2	35.8	84.0	E TENN-MINOR DAMAGE AT HARYVILLE	4.6	F-17
1974	AUG 2	8 52 9.8	33.8	82.4	GEORGIA-MINOR DAMAGE BOBBY BROWN ST. PARK	4.8	F-17
1974	NOV 22	5 25 55.5	32.9	80.1	SOUTH CAROLINA NORTH CHARLESTON SUNNERSVILLE AREAS	4.7	F-17

Revised by Amendment 33.

<p>WATTS BAR NUCLEAR PLANT FINAL SAFETY ANALYSIS REPORT</p>
<p>EARTHQUAKE LISTING 4.3 RICHTER OR GREATER LATITUDE 30-37 NORTH LONGITUDE 78-92 WEST SHEET 6 OF 6 Figure 2.5-180</p>

Figure 2.5-180 Earthquakes Listing 4.3 Richter or Greater Latitude 30-37 North Longitude 78-92 West