


DRAFTING NOTE:
 CLOUDED WIRES & CABLES OR \odot CLOUDED WIRES & CABLES ARE NEW ADDED WIRES & CABLES. DO NOT DRAFT THE "O" ON THE WIRES & CABLES AT DCP CLOSURE.

24. TB3-87
 24T. FU-DC-12-2
 26. TB3-88
 26T. FU-DC-12-4

28. TB3-79
 28T. FU-DC-10-2
 30. TB3-81
 30T. FU-DC-11-2
 31. KS-84-31
 31. TB10-95
 31T. TB10-94
 32. KS-84-32
 32. TB10-96
 32T. KS-84-31T

- WIRING NOTES:**
- UNSHIELDED WIRE - ANACONDA ERICSSON FLAMEGUARD, TYPE NSINS, NO. 14 AWG UNLESS NOTED OTHERWISE.
 - SHIELDED WIRE - ANACONDA ERICSSON FLAMEGUARD, NO. 16 AWG, 2/C, SHIELDED PAIR, ETP-5600-18-25.
 - USE AMP UNSHIELDED RING TONGUE TERMINALS, SIZE AS REQ'D.
 - AC WIRING (MARKED \odot), CT WIRING (MARKED Δ) AND DC WIRING (NOT MARKED) SHALL BE BUNDLED SEPARATELY AND KEPT AT LEAST 4" APART IF POSSIBLE.
 - CT WIRING SHALL BE LABELED "CT" THROUGHOUT IT'S PATH WITHIN THE PANEL.

| RECEIVED | |
|----------|----|
| DATE | BY |
| | |

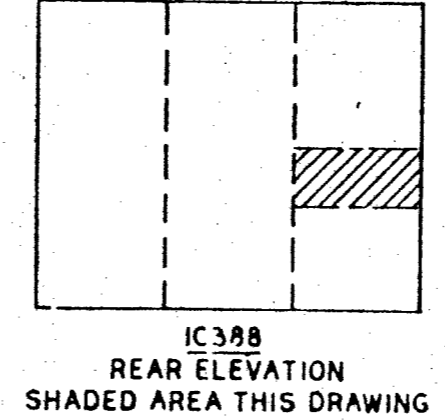

| | | | |
|----------------------------|-------------|-----------------------------------------------------------|--------|
| SI APERTURE CARD | | FRANK ELECTRIC CORPORATION | |
| DUANE ARNOLD ENERGY CENTER | | CONNECTION DIAGRAM-SH.7 REMOTE SHUTDOWN PANEL PANEL IC388 | |
| PROJECT NO. 009560 | DATE 3-7-84 | DRWING NO. E8-5229-21 | REV. B |

FOR DCP USE ONLY

REV. 0 PREPARED BY: [Signature] VERIFIED BY: [Signature]

8810120290

DCP PACKAGE INDEX
 ITEM NO. 6.3.11

CONSTRUCTION ADD.
 Iowa Electric Light & Power Co.

| REV | DATE | DESCRIPTION | BY | CHKD |
|-----|--------|---------------|----|------|
| 1 | 3/7/84 | ISSUED IN DCP | | |

Doc # 8810120290
 Control # 8810120290
 Date 3-7-84
 REGULATORY DOCKET FILE

FOR INFORMATION ONLY

6.3.11