

PROPOSED CHANGE RTS-131
TO
DUANE ARNOLD ENERGY CENTER
TECHNICAL SPECIFICATIONS


The holders of License DRP-49 for the Duane Arnold Energy Center propose to amend Appendix A (Technical Specifications) to said license by deleting current pages and replacing them with the attached new proposed pages. A list of the affected pages is included.

The justification for this change is the incorporation of administrative changes into various sections of the DAEC Technical Specifications as listed below:


- (1) Section 6.5 is revised to reflect that the Safety Committee shall be appointed by and report to the Executive Vice President, and that appropriate records shall be forwarded to the Executive Vice President.
- (2) Figure 6.2-1 is revised to reflect the DAEC Nuclear Plant Staffing Organization consisting of division of activities with three Assistant Chief Engineers.

LIST OF AFFECTED PAGES

6.2-4
6.5-5
6.5-6
6.5-9

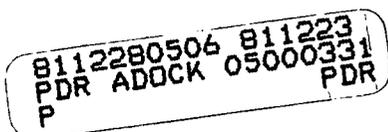

6.2-4

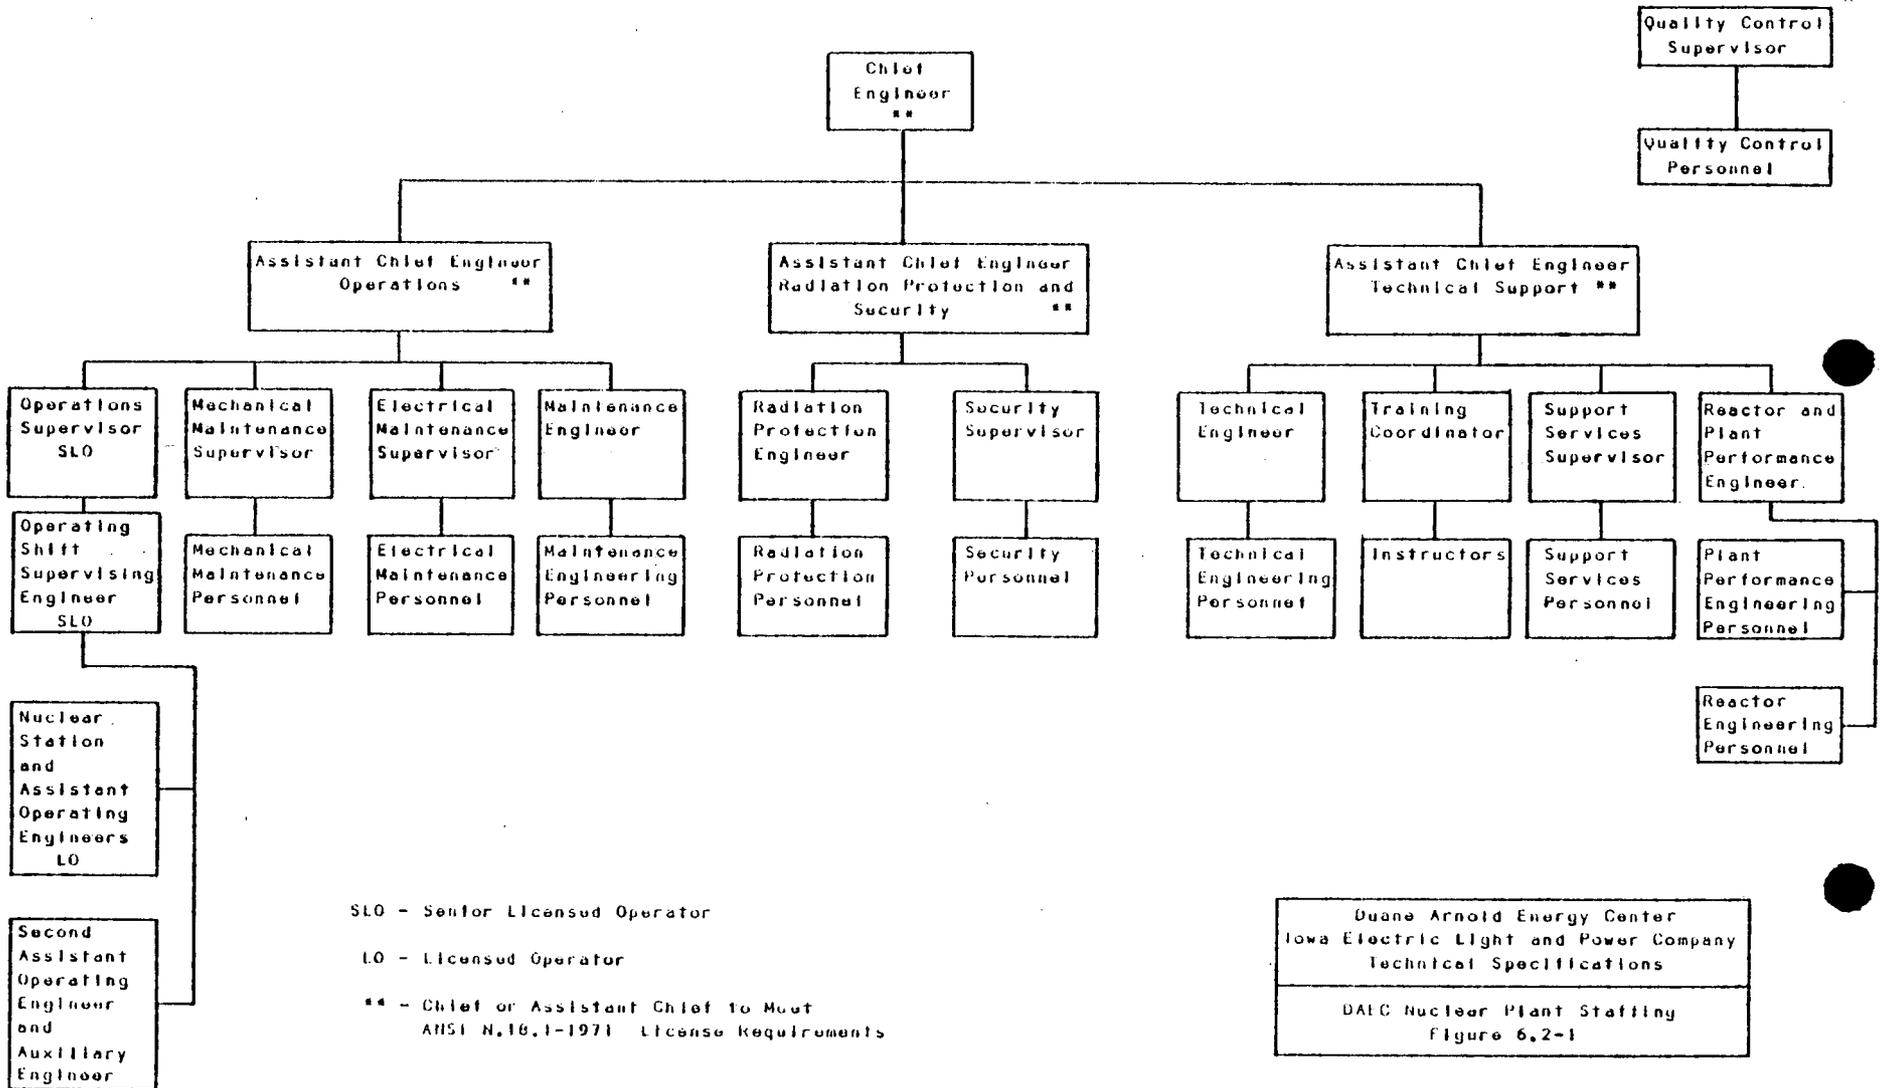

SLO - Senior Licensed Operator
 LO - Licensed Operator
 ** - Chief or Assistant Chief to Meet ANSI N.16.1-1971 License Requirements

Duane Arnold Energy Center
 Iowa Electric Light and Power Company
 Technical Specifications
 DAEC Nuclear Plant Staffing
 Figure 6.2-1

- c. Chemistry and radiochemistry.
- d. Metallurgy.
- e. Instrumentation and control.
- f. Radiological safety.
- g. Mechanical and electrical engineering.
- h. Quality assurance practices.

6.5.2.2 Composition

The Safety Committee shall be composed of persons who have been appointed in writing by the Executive Vice President to serve on a permanent basis and who collectively have or have access to applicable technical and experimental expertise in the following areas:

- a. Nuclear power plant operations.
- b. Nuclear engineering.
- c. Chemistry and radiochemistry.
- d. Instrumentation and control.
- e. Radiation protection.

f. Mechanical and electrical engineering.

g. Nuclear safety.

6.5.2.3 Alternates

All alternate members shall be appointed in writing by the Executive Vice President to serve on a permanent basis.

6.5.2.4 Consultants

Consultants shall be utilized as determined by the Safety Committee Chairman to provide expert advice to the Safety Committee.

6.5.2.5 Meeting Frequency

The Safety Committee shall meet at least once per calendar quarter during the initial year of facility operation following fuel loading and at least once per six months thereafter.

6.5.2.6 Quorum

A quorum of the Safety Committee shall consist of the Chairman or Vice Chairman and at least four members including alternates. No more than a minority of the quorum shall have line responsibility for operation of the facility.

- g. Any other area of facility operation considered appropriate by the Safety Committee or the Executive Vice President.
- h. Design change request safety evaluations.
- i. The DAEC Fire Protection Program and implementing procedures at least once per 24 months.

6.5.2.9 Authority

The Safety Committee shall report to and advise the Executive Vice President on those areas of responsibility specified in Specifications 6.5.2.7 and 6.5.2.8.

6.5.10 Records

Records of Safety Committee activities shall be prepared, approved and distributed as indicated below:

- a. Minutes of each Safety Committee meeting shall be prepared, approved and forwarded to the Executive Vice President within 14 days following each meeting.
- b. Reports of reviews encompassed by Specification 6.5.2.7 above, shall be prepared, approved and forwarded to the Executive Vice President within 14 days following completion of the review.
- c. Audit reports encompassed by Specification 6.5.2.8 above, shall be forwarded to the Executive Vice President and to the management positions responsible for the areas audited within 30 days after completion of the audit.