

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8607030179 DOC. DATE: 86/06/26 NOTARIZED: NO DOCKET #
 FACIL: 50-331 Duane Arnold Energy Center, Iowa Electric Light & Pow 05000331
 AUTH. NAME AUTHOR AFFILIATION
 MCGAUGHEY, R. W. Iowa Electric Light & Power Co.
 RECIP. NAME RECIPIENT AFFILIATION
 DENTON, H. Office of Nuclear Reactor Regulation, Director (post 851125)

SUBJECT: Provides addl info re application to amend License DPR-49,
 incorporating proposed Tech Spec Change RTS-190 re staffing
 changes, per request. Revised Figure 6.2-1 encl to clarify
 onsite & offsite mgt relationship.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME	COPIES			RECIPIENT ID CODE/NAME	COPIES	
		LTTR	ENCL			LTTR	ENCL
	BWR EB	1	1		BWR EICSB	2	2
	BWR FOB	1	1		BWR PD2 LA	1	0
	BWR PD2 PD 01	5	5		THADANI, M	1	1
	BWR PSB	1	1		BWR RSB	1	1
INTERNAL:	ADM/LFMB	1	0		ELD/HDS2	1	0
	NRR/ORAS	1	0		<u>REG FILE</u> 04	1	1
	RGN3	1	1				
EXTERNAL:	EG&G BRUSKE, S	1	1		LPDR 03	1	1
	NRC PDR 02	1	1		NSIC 05	1	1

Iowa Electric Light and Power Company

June 26, 1986
NG-86-2054

Mr. Harold Denton, Director
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, DC 20555

Subject: Duane Arnold Energy Center
Docket No: 50-331
Op. License No: DPR-49
Technical Specification Change (RTS-190)
Plant Staffing Changes
File: A-117, A-202

Dear Mr. Denton:

This letter provides additional information as requested by your staff regarding proposed Technical Specification Change RTS-190. This proposed amendment makes changes to a portion of the DAEC plant staffing and to the supervisory relationship between the DAEC site management and the off-site Nuclear Generation management.

Your staff requested clarification of the proposed change to the supervisory relationship between on-site and off-site management and also recommended that the relationship be shown in Figure 6.2-1, "DAEC Nuclear Plant Staffing," on page 6.2-4 of the Technical Specifications. Following this change, the Plant Superintendent, Nuclear will report directly to the Manager, Nuclear Division rather than to the Director, Nuclear Generation who, in turn, reports to the Manager, Nuclear Division as shown in the DAEC Updated Final Safety Analysis Report, Rev. 3, Figure 13.1-2. The change will provide a direct communication link between the Manager, Nuclear Division and the Plant Superintendent, Nuclear and facilitate management responsiveness to plant activities. The position of Director, Nuclear Generation will be eliminated after the approval of this change.

Figure 6.2-1, "DAEC Nuclear Plant Staffing," is being revised to add the position of Manager, Nuclear Division and show that the Plant Superintendent, Nuclear will report directly to that position. This addition clarifies the relationship between on-site and off-site management. A revised Figure 6.2-1 is attached to this letter.


8607030179 860626
PDR ADOCK 05000331
P PDR

Adol
11/1

Mr. Harold Denton
June 26, 1986
NG-86-2054
Page Two

This proposed change is purely administrative in nature, involves no physical changes to the plant and has no potential to affect the health or safety of the public.

Very truly yours,


A handwritten signature in dark ink, appearing to read "R W McGaughy". The signature is fluid and cursive, with the first and last names being more prominent.

Richard W. McGaughy
Manager, Nuclear Division

RWM/MJM/dmb

Attachment: Revised Page 6.2-4 (Figure 6.2-1)

cc: M. Murphy
L. Liu
L. Root
M. Thadani
NRC Resident Office
T. Houvenagle (ICC)

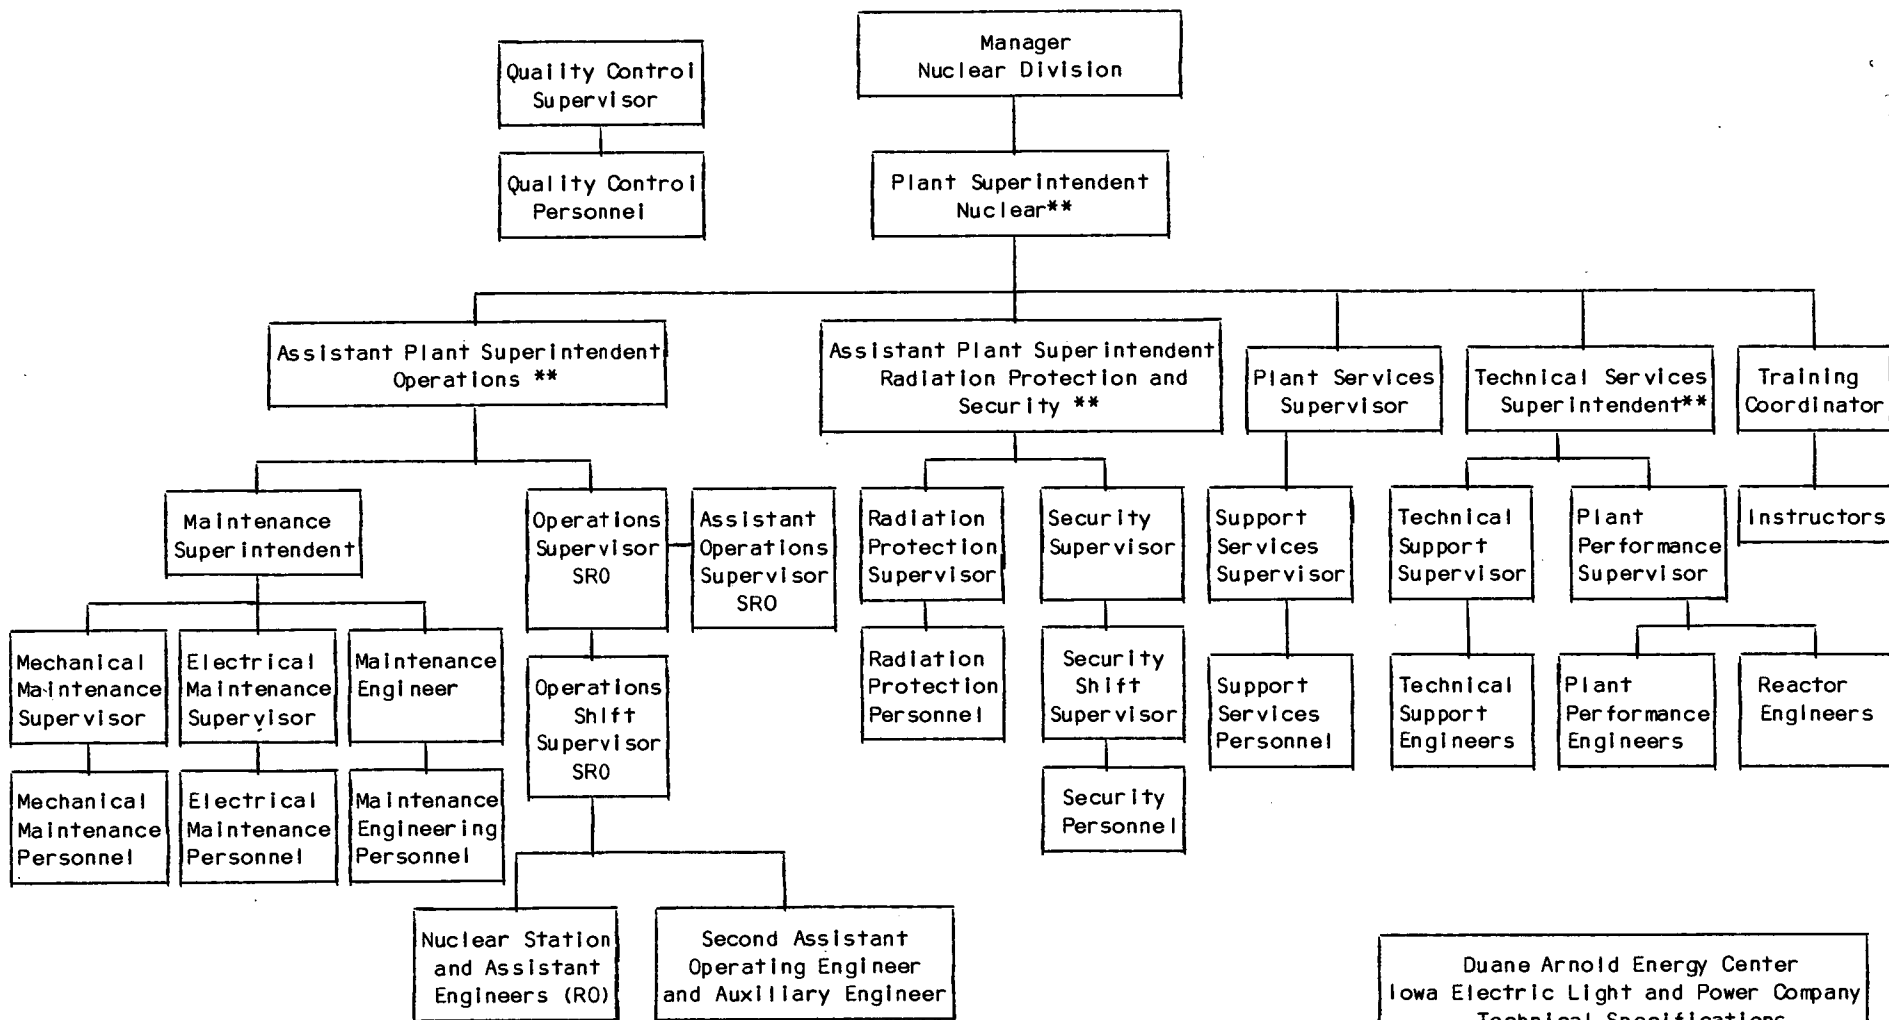

SRO - Senior Reactor Operator

RO - Reactor Operator

** - According to ANSI N18.1-1971, either the Plant Superintendent or one of his designated principal alternates shall have the experience and training normally required for a Senior Reactor Operator's license examination. (At least one of the people in the positions noted above shall meet that requirement.)

Duane Arnold Energy Center
Iowa Electric Light and Power Company
Technical Specifications

DAEC Nuclear Plant Staffing
Figure 6.2-1