


Active Earth Pressure on 1-ft Wide Vertical Strip

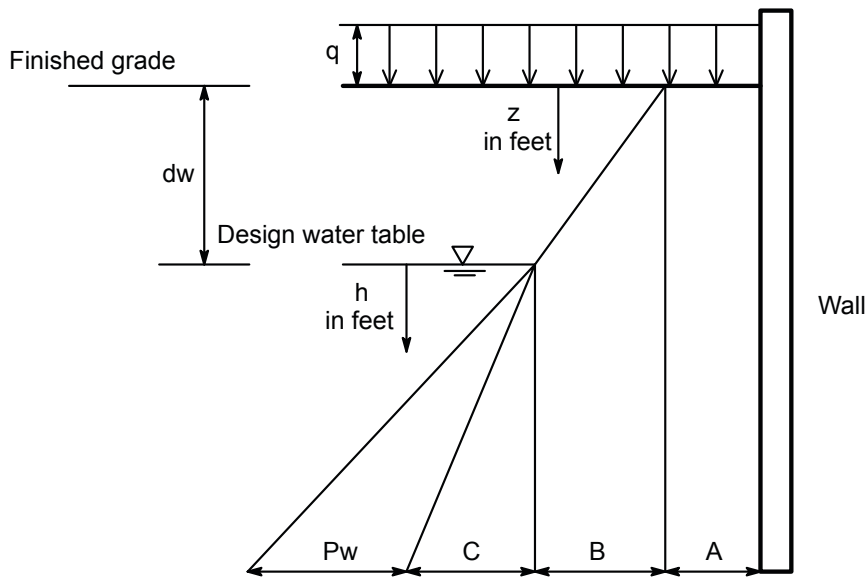

- A = $K_a (q)$ = Effect of uniform full coverage surface surcharge
- B = $K_a \gamma_s (z)$ = Active earth pressure above water table
- C = $K_a \gamma' (h)$ = Active earth pressure increment below water table
- Pw = 62.4 (h) = Hydrostatic pressure increment
- H = A + B = Static lateral earth pressure above water table ($z < dw$)
- H = A + $K_a \gamma_s (dw)$ + $K_a \gamma' (z - dw)$ = Static lateral earth pressure below water table ($z > dw$) (Pw not included)

Conditions on information:

- Units of pressure, psf
- Backfill of granular material compacted to 96% maximum dry density by ASTM D1557
- No heavy compaction equipment used within 5 ft of wall
- γ_s = saturated unit weight of granular backfill above water table, pcf
- γ' = submerged unit weight of granular backfill, pcf
- ϕ = 35 degrees = angle of internal friction of soil
- $K_a = \tan^2 (45 - \phi/2)$ = Active earth pressure coefficient of soil
- Plane strain conditions (corner adjustment factors not included)
- Dynamic soil pressure not included

USCS Type	γ_s	γ'	K_a
GW	150	87.6	0.271
GP	142	79.6	0.271
SW	136	73.6	0.271