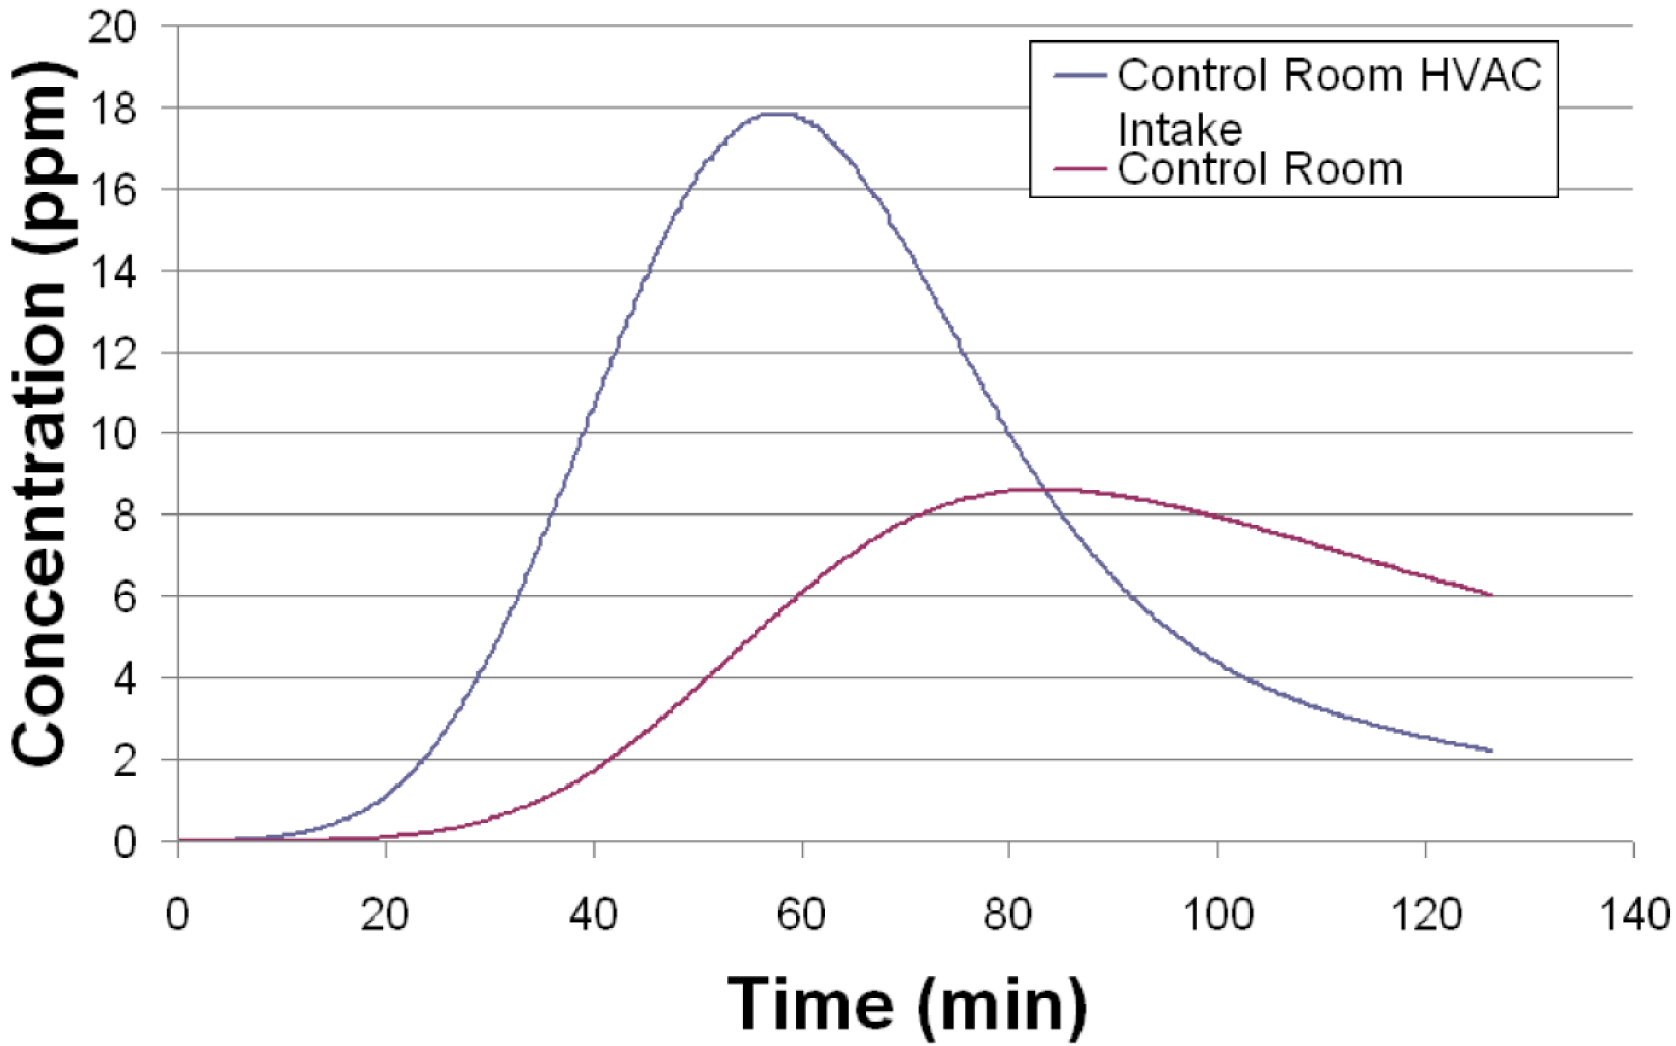

WILLIAM STATES LEE III
NUCLEAR STATION UNITS 1 & 2

Control Room and Control Room HVAC Intake Chlorine Concentrations at Wind Speed of 1 m/s

FIGURE 6.4-201 Rev 1