

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL

FILE NUMBER
INCIDENT REPORT

TO:

Mr. James G. Keppler

FROM:
Iowa Elec. Light & Pwr. Company
Cedar Rapids, Iowa
Ellery L. Hammond

DATE OF DOCUMENT
5/13/77

DATE RECEIVED
6/8/77

LETTER
 ORIGINAL
 COPY

NOTORIZED
 UNCLASSIFIED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED
1 SIGNED

DESCRIPTION

Consisting of information regarding design change to be installed during the 1977 refuel outage which would eliminate the problem of excessive moisture in the drywell particulate monitors.....

PLANT NAME:
Duane Arnold (1-P)

RJL 6/8/77

ENCLOSURE

DO NOT REMOVE

ACKNOWLEDGED

NOTE: IF PERSONNEL EXPOSURE IS INVOLVED
SEND DIRECTLY TO KREGER/J. COLLINS

FOR ACTION/INFORMATION

BRANCH CHIEF:	<i>LEAC</i>
W/3 CYS FOR ACTION	
LIC. ASST.:	<i>PARRISH</i>
W/1 CYS	
ACRS <i>16</i> CYS HOLDING/SENT <i>45 CAT 13</i>	

INTERNAL DISTRIBUTION

<input checked="" type="checkbox"/> REG FILE				
NRC PDR				
I & E (2)				
MIPC				
SCHROEDER/IPPOLITO				
HOUSTON				
NOVAK/CHECK				
GRIMES				
BUTLER				
HANAUER				
TEDESCO/MACCARY				
EISENHUT				
BAER				
SHAO				
VOLLMER/BUNCH				
KREGER/J. COLLINS				

EXTERNAL DISTRIBUTION

LPDR: <i>CEDAR RAPIDS 1A.</i>			
TIC:			
NSIC:			

CONTROL NUMBER

771600007

MA

60

D. Kaskan

IOWA ELECTRIC LIGHT AND POWER COMPANY

DUANE ARNOLD ENERGY CENTER


P. O. Box 351

Cedar Rapids, Iowa 52406

May 13, 1977

DAEC-77 -268

50-331

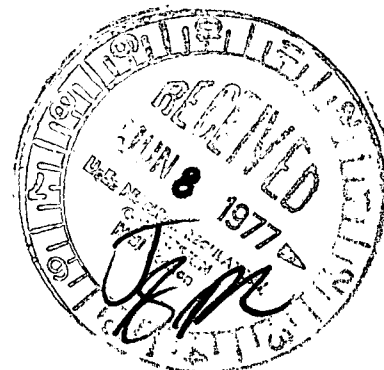

Mr. James G. Keppler, Director
Office of Inspection and Enforcement
U. S. Nuclear Regulatory Commission-Region III
799 Roosevelt Road
Glen Ellyn, Illinois 60137

Regulatory Docket File

Subject: Reportable Occurrence Report 77-04
Reference: Letter dated February 2, 1977, E.
Hammond to James Keppler
File: A-118a

Dear Mr. Keppler:

In the referenced letter we advised you that a design change would be installed during the 1977 refuel outage which would eliminate the problem of excessive moisture in the drywell particulate monitors. This letter is to advise you that due to a delay in procuring a necessary component, installation of the design change will not be completed during the outage. The installation will be completed at the first opportunity after the component is received.

Pending completion of the design change, the temporary requirement for daily draining of the particulate collector assemblies will remain in effect.

Very truly yours,

Ellery L. Hammond
Ellery L. Hammond
Chief Engineer, DAEC

ELH/DLW/mg

- cc: J. Wallace
- D. Mineck
- J. Gebert
- D. Rockhill
- D. Wilson

771600007

MAY 16 1977

RECEIVED DOCUMENT
PROCESSING UNIT

1977 JUN 7 AM 10 39