This drawing and the design it covers are the property of BECHTEL. They are merely loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited, or used except in the limited way and private use permitted by any written consent given by the lender to the borrower.

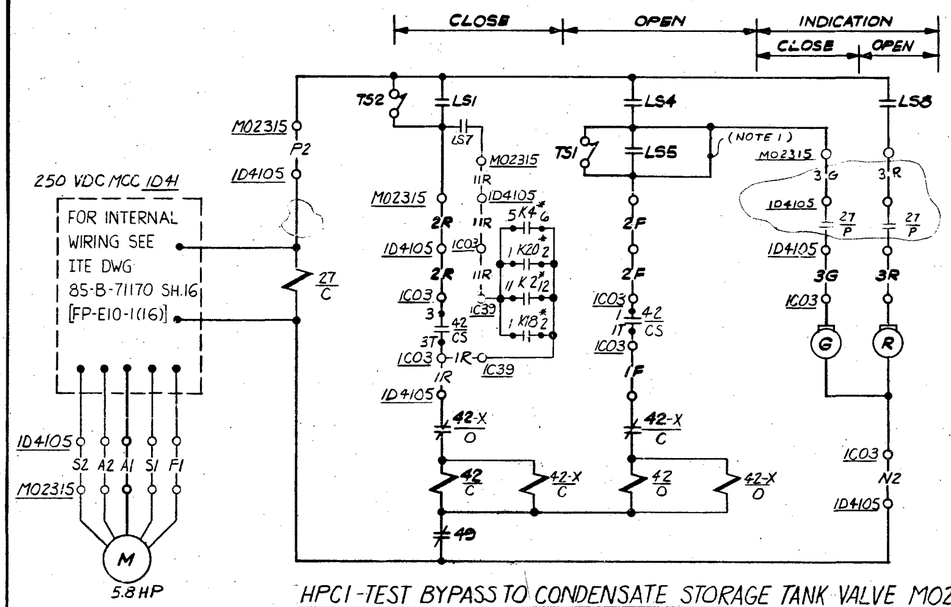

HPCI-TEST BYPASS TO CONDENSATE STORAGE TANK VALVE M02315

SCHEME 2D4105
(REF.-1, SH. 7)

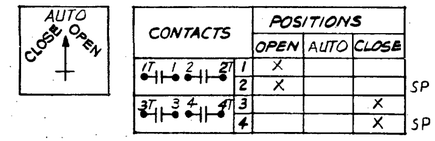

GE TYPE SBM SPRING RETURN TO AUTO
CONTROL SWITCH: 42/CS : HS2315

NOTES

1. FIELD MAKE THIS JUMPER AFTER PRE-OPERATING TEST IS COMPLETED

LIMIT SWITCH				
CONTACT	OPEN	INTER	CLOSE	
LS-1	X			
LS-2	X			SP
LS-3		X	X	SP
LS-4		X	X	
LS-5			X	
LS-6			X	SP
LS-7	X	X		
LS-8	X	X		
LS-9	X			
LS-10	X			
LS-11		X	X	
LS-12		X	X	SP
LS-13			X	
LS-14			X	
LS-15	X	X		
LS-16	X	X		

REF. DWG.

1. G.E. DWG. 791E420 RS ELEM. DIAG. HIGH PRESSURE COOLANT INJECTION. [F.P. 7884-AFED-E41-G]

* REF. DWG. 1

TS-1 OPENS WHEN PREDETERMINED TORQUE IN THE OPEN DIRECTION IS EXCEEDED

TS-2 OPENS WHEN PREDETERMINED TORQUE IN THE CLOSE DIRECTION IS EXCEEDED

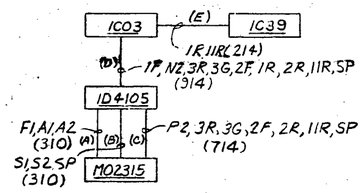

HIGH PRESSURE COOLANT INJECTION SYSTEM
(REF. DWG. 1)

FOR INFORMATION ONLY

STARTUP SYSTEM 52

REV.	DESCRIPTION	ENG.	DR.	CHK.	MATL.	APPROVAL	DATE
2	REVISED SIZE OF CABLE D						6-26-72
1	REVISED TO ADD LS7 IN CLOSE CKT & WIRE NO. IN CABLE (E)						2-2-72
3	REVISED PER D.C.P. #08 REV. 1						4-13-76

REACTOR CORE COOLING SYSTEMS

JOB No.	DRAWING No.	SHEET	REV.
7884	E-121	19	3

F508

B
16 X

TERA APERTURE CARD

8006260341 Q