


This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited, or used except in the limited way and under the terms of the agreement given by the lender to the borrower.

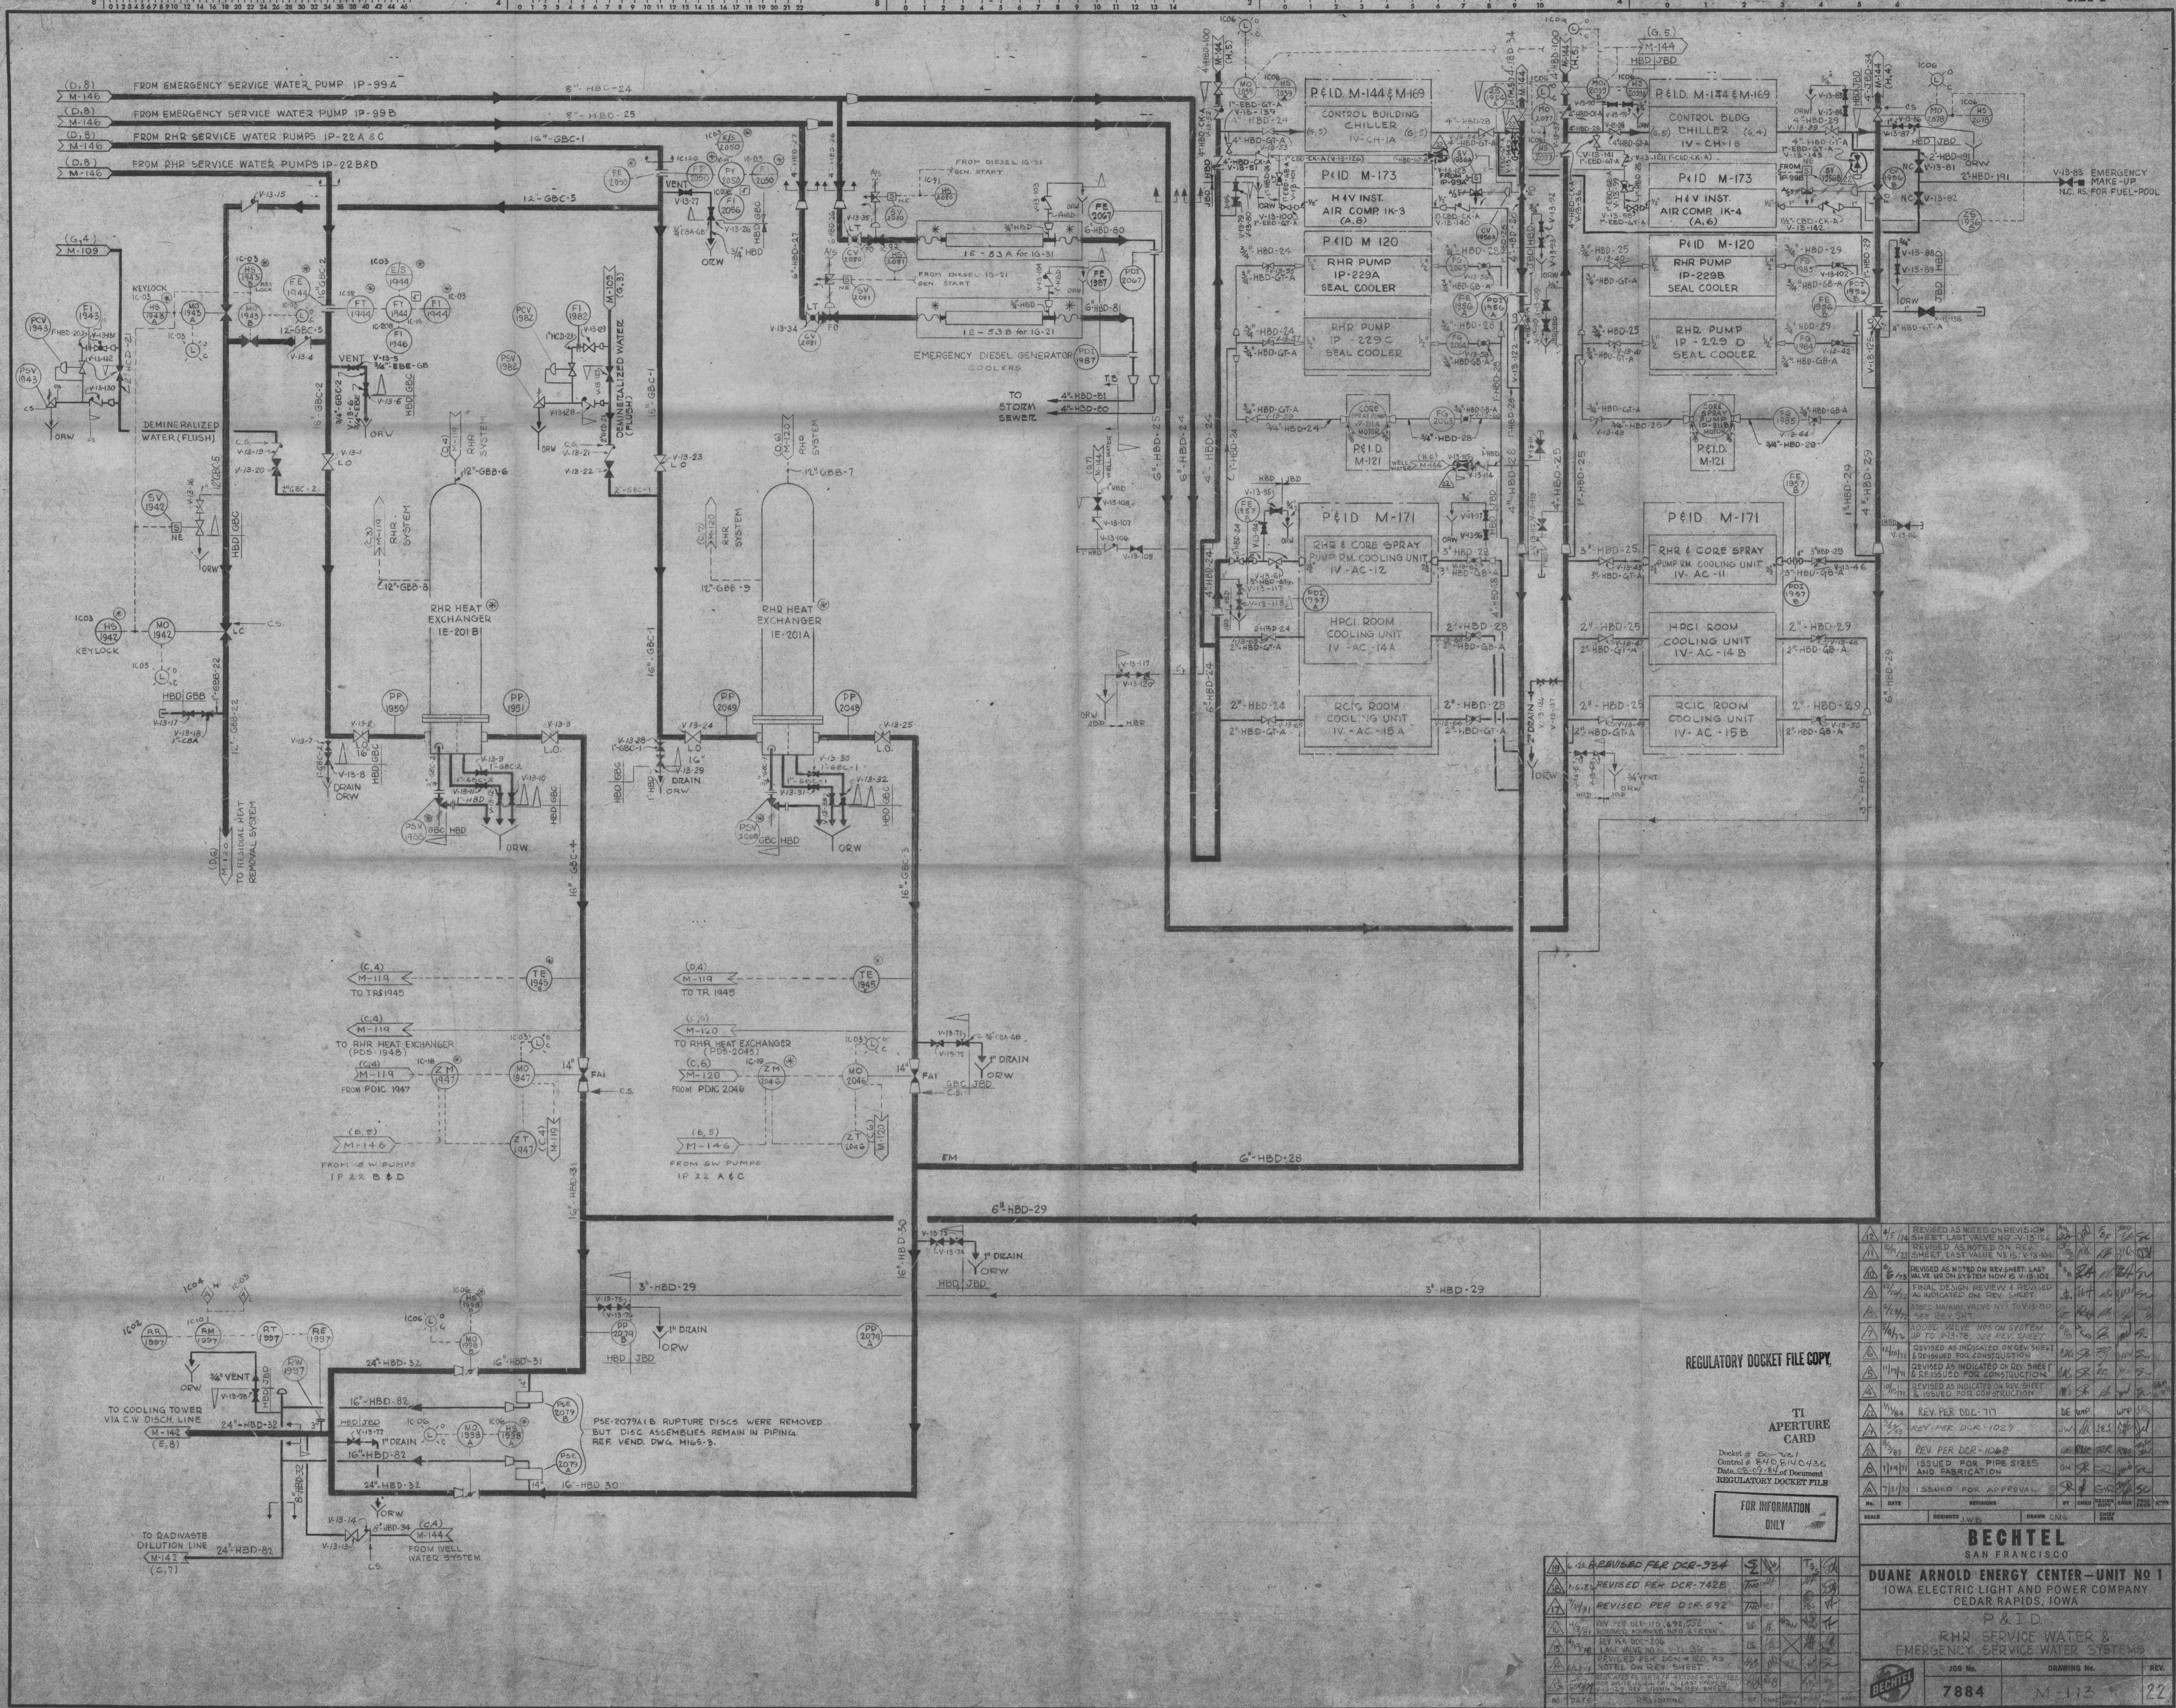

PSE-2079116 RUPTURE DISCS WERE REMOVED BUT DISC ASSEMBLIES REMAIN IN PIPING. REF VEND. DWG. M165-3.

REGULATORY DOCKET FILE COPY
 TI APERTURE CARD
 Docket # SC-201
 Control # 8406140436
 Data # 8502-8406 Document
 REGULATORY DOCKET FILE

| NO. | DATE | REVISIONS | BY | CHKD | APPD | DATE |
|-----|------|-----------|----|------|------|------|
| 1 | | | | | | |
| 2 | | | | | | |
| 3 | | | | | | |
| 4 | | | | | | |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |
| 22 | | | | | | |

| | | | | | |
|------|-------------------------------------------------------------|-----|-----|--|--|
| 1/15 | REVISED AS NOTED ON REVISION SHEET LAST VALVE HSD 2415-12 | | | | |
| 1/23 | REVISED AS NOTED ON REV SHEET LAST VALVE HSD 1515: V-13-304 | | | | |
| 2/13 | REVISED AS NOTED ON REV SHEET LAST VALVE HSD 1515: V-13-304 | | | | |
| 2/13 | FINAL DESIGN REVIEW 4 REVISED AS INDICATED ON REV SHEET | | | | |
| 2/13 | ADDED MANUAL VALVE HSD TO V-13-50 | | | | |
| 2/13 | SEE REV SHEET | | | | |
| 2/13 | ADDED VALVE HSD ON SYSTEM UP TO 13-78. SEE REV SHEET | | | | |
| 2/13 | REVISED AS INDICATED ON REV SHEET & ISSUED FOR CONSTRUCTION | | | | |
| 2/13 | REVISED AS INDICATED ON REV SHEET & ISSUED FOR CONSTRUCTION | | | | |
| 2/13 | REVISED AS INDICATED ON REV SHEET & ISSUED FOR CONSTRUCTION | | | | |
| 2/13 | REVISED AS INDICATED ON REV SHEET & ISSUED FOR CONSTRUCTION | | | | |
| 2/13 | REV PER DCR-711 | DE | WJP | | |
| 2/13 | REV PER DCR-1023 | JW | WJP | | |
| 2/13 | REV PER DCR-1062 | WJP | WJP | | |
| 2/13 | ISSUED FOR PIPE SIZES AND FABRICATION | ON | WJP | | |
| 2/13 | ISSUED FOR APPROVAL | ON | WJP | | |

BECHTEL
 SAN FRANCISCO

DUANE ARNOLD ENERGY CENTER - UNIT NO 1
 IOWA ELECTRIC LIGHT AND POWER COMPANY
 CEDAR RAPIDS, IOWA

P & I D
 RHR SERVICE WATER &
 EMERGENCY SERVICE WATER SYSTEMS

| JOB No. | DRAWING No. | REV. |
|---------|-------------|------|
| 7884 | M-113 | 22 |