

Residual Heat Removal System

- Low Pressure Coolant Injection (LPCI)
- Containment Spray
 - DW spray
 - SP Spray
- Suppression Pool Cooling.
- Shutdown Cooling
- Fuel Pool Cooling
- Standby Coolant Supply

Objectives

1. Identify the purposes of the residual heat removal (RHR) system.
2. Summarize the purpose, function and operation of the following major system components:
 - a. Suppression pool and shutdown cooling suction valves
 - b. RHR pumps
 - c. Minimum flow valve
 - d. RHR heat exchanger
 - e. Containment spray spargers
 - f. Line fill
3. Explain the purpose, operation and flow path for each of the following RHR system modes of operation:
 - a. Low pressure coolant injection (LPCI)
 - b. Containment spray
 - c. Suppression pool cooling
 - d. Shutdown cooling (SDC) and head spray
 - e. Standby coolant supply mode
 - f. Fuel pool cooling assist
 - g. Testing

Objectives

4. List the automatic and manual initiation signals for the LPCI mode of operation
5. Describe the system response to an automatic LPCI initiation signal from the standby alignment or while operating in any mode in objective 3
6. Describe how the residual heat removal (RHR) system interrelates with:
 - a. Reactor Recirculation system
 - b. Primary containment
 - c. Nuclear Steam Supply Shutoff system
 - d. Emergency AC power system
 - e. Automatic Depressurization system
 - f. Core Spray system
 - g. Reactor Building Closed Cooling Water system
 - h. Reactor Building Service Water System
 - i. Fuel pool Cooling and Clean up system

Residual Heat Removal System

PURPOSES:

Low Pressure Coolant Injection Mode:

auto initiates to restore and maintain desired water level in the reactor vessel following a Loss Of Coolant Accident (LOCA).

Containment Spray Mode:

condenses steam and reduces airborne activity in the primary containment following a LOCA. (SP and DW spray)

Suppression Pool Cooling Mode:

removes heat from the suppression pool.

Residual Heat Removal System

- **Shutdown Cooling and Head Spray Mode:**
removes decay heat from the reactor core following a reactor shutdown and removes residual heat from upper reactor vessel internals during a cooldown.
- **Standby Coolant Supply Mode:**
To provide a means of flooding the primary containment with service water.
- **Fuel Pool Cooling Mode:**
To provide fuel pool cooling when the capacity of the Fuel Pool Cooling and Cleanup system is not adequate.


Normal Line-up

- RHR is in the standby lineup for LPCI during normal operation.
- LPCI is the only mode that auto initiates to flood the vessel in an accident condition

Level 1 (-132.5 inches)

OR

High DW pressure (1.69 psig)

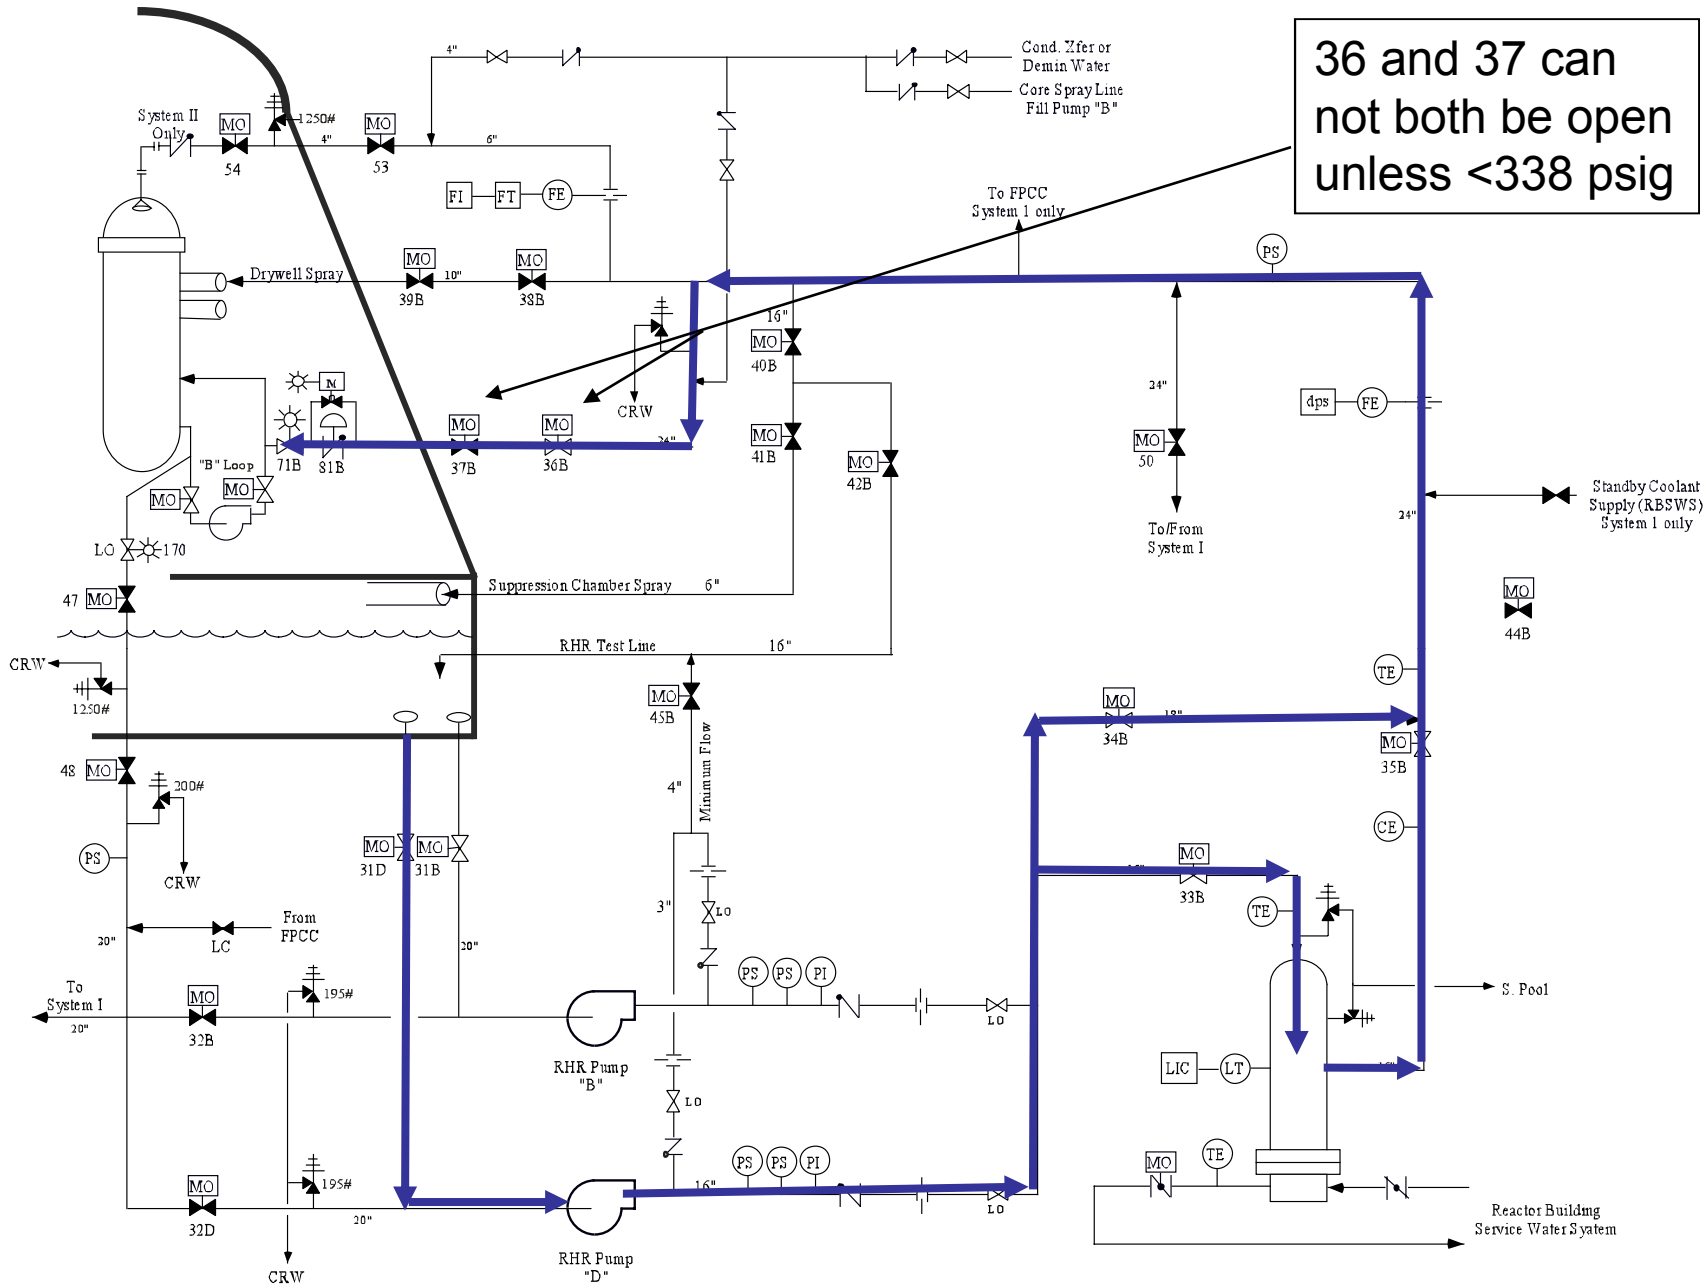

36 and 37 can not both be open unless <338 psig


Containment Modes

- Containment Spray and Suppression Pool Cooling modes assist in maintaining containment integrity.
 - Containment Spray is an emergency function.
 - Suppression Pool cooling may be either emergency or off-normal.

Containment Spray

- Drywell Spargers – 2 rings at top of drywell
- Suppression Chamber Spargers – 2 rings at top of suppression pool chambers
 - Division I supplies one sparger each in the Drywell and Suppression Pool
 - Division II supplies the 2nd DW and SP spargers.


Spray Lineups

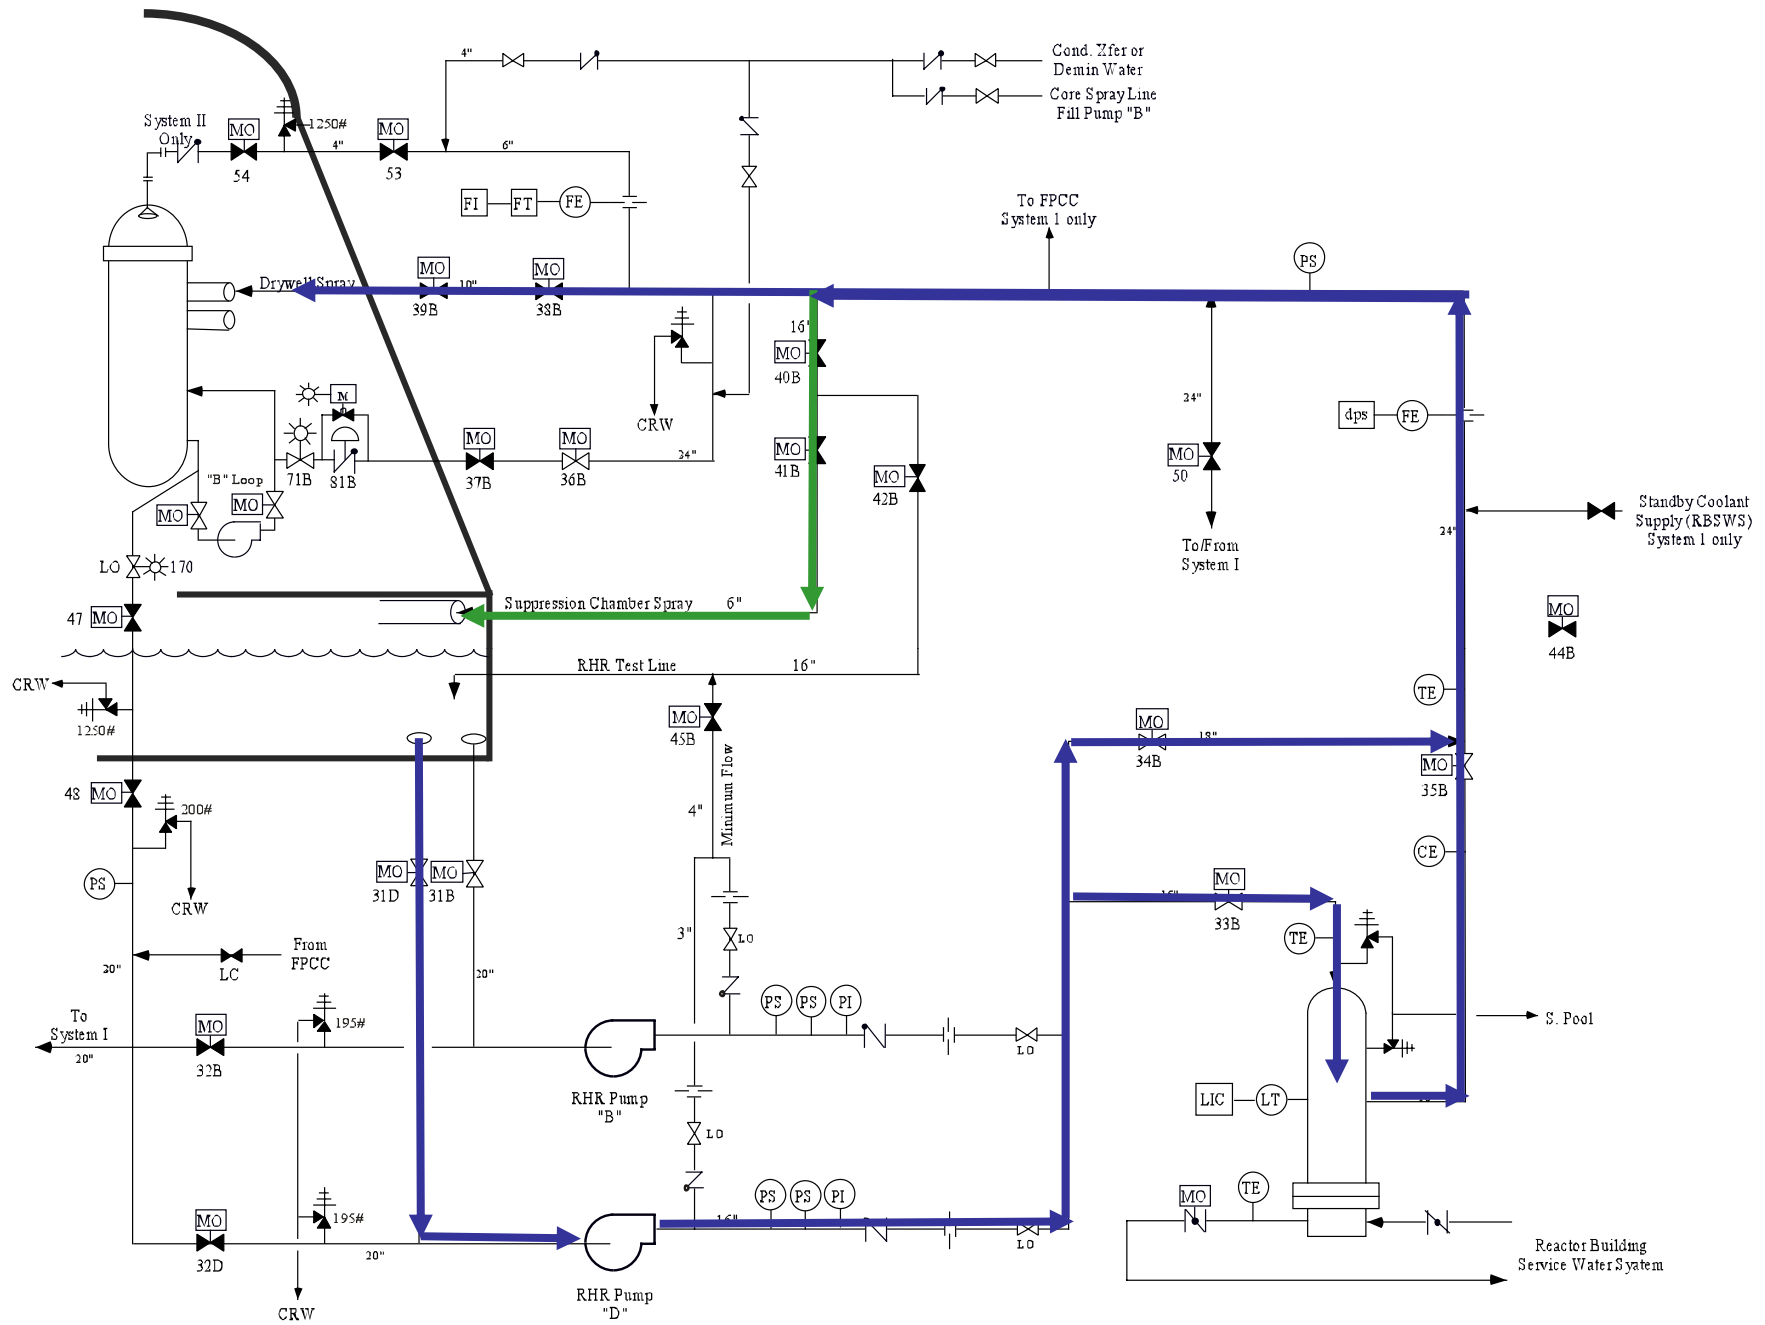

Suppression Pool Cooling

Water from suppression pool is cooled in the RHR heat exchangers.


- Heat comes from various sources
 - HPCI
 - RCIC
 - SRV's
 - LOCA
- Test Line up uses the same flow path

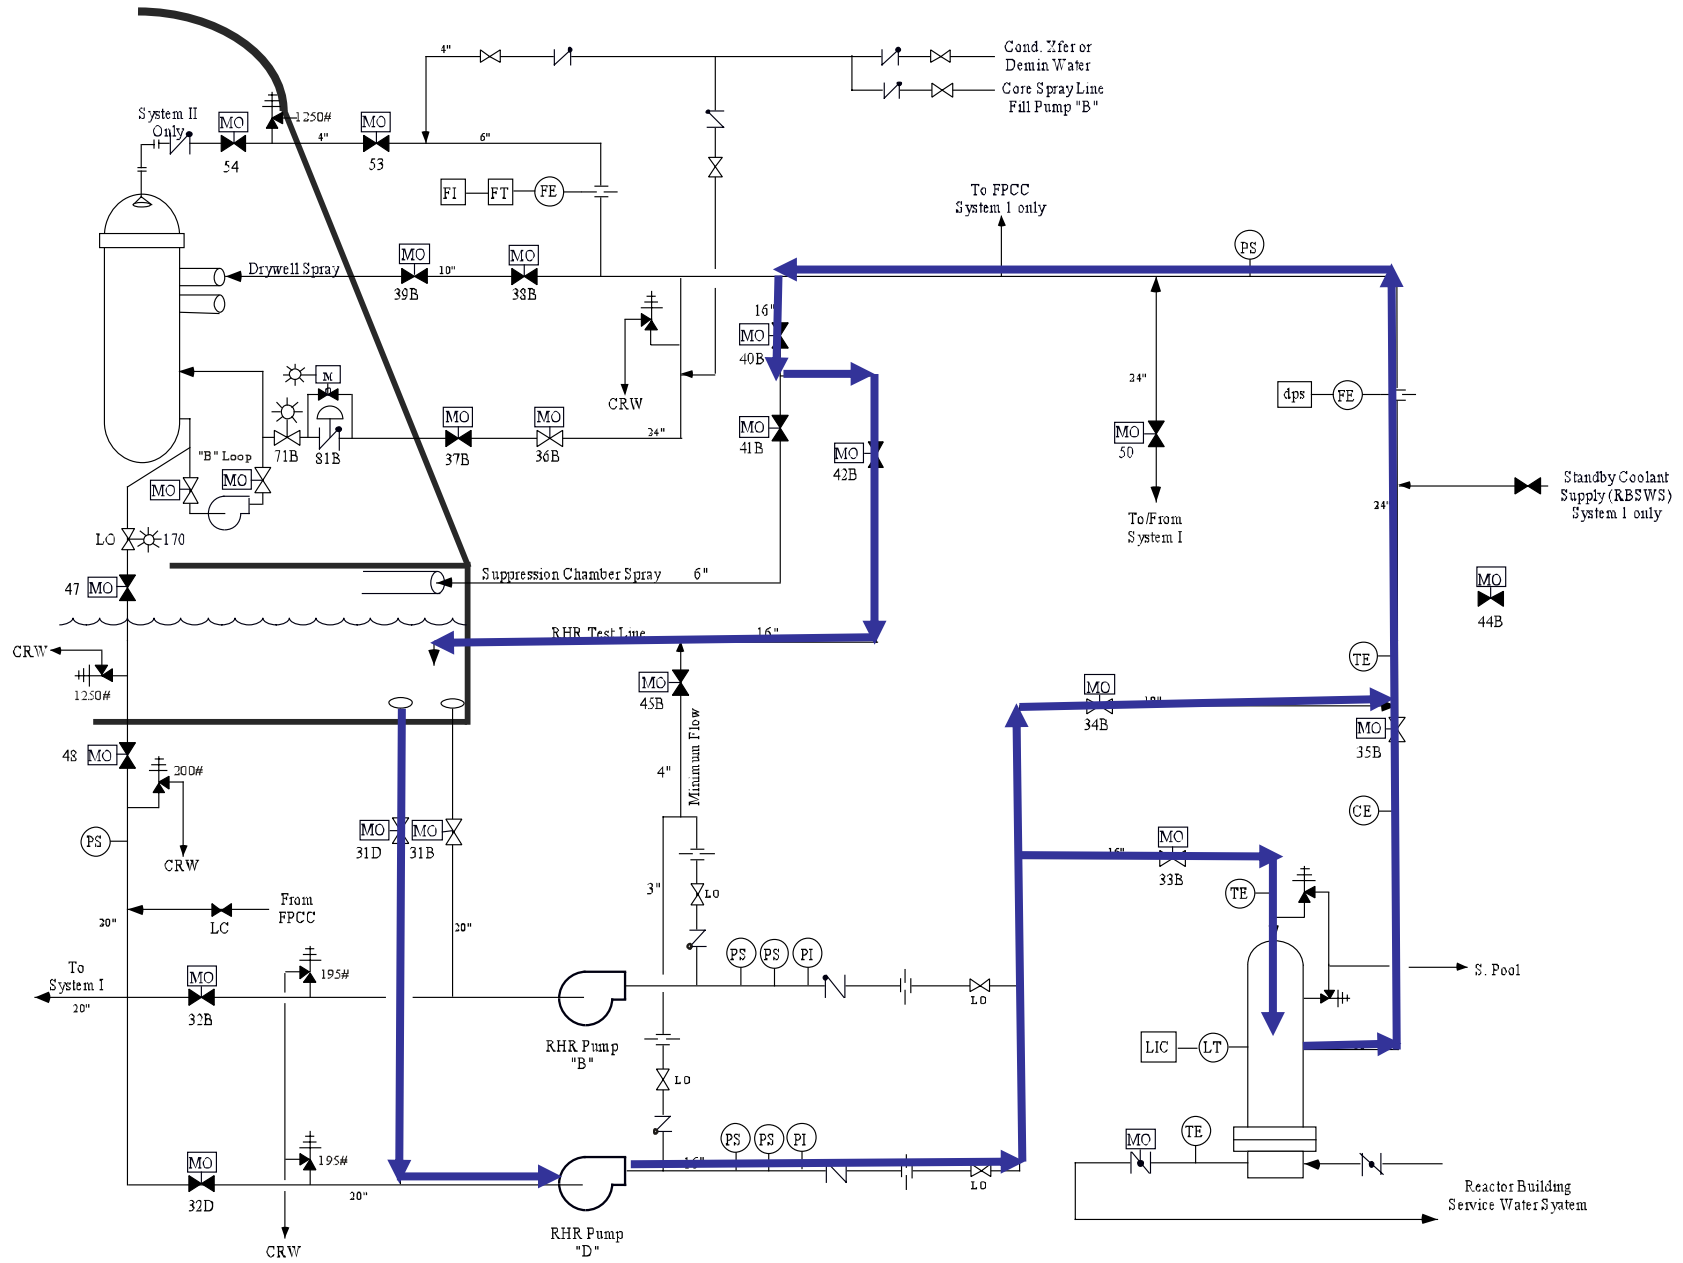

Fuel Pool Cooling

- FPCC Augmentation
- Early in refueling outages when off-load decay heat generation is highest

A loop only

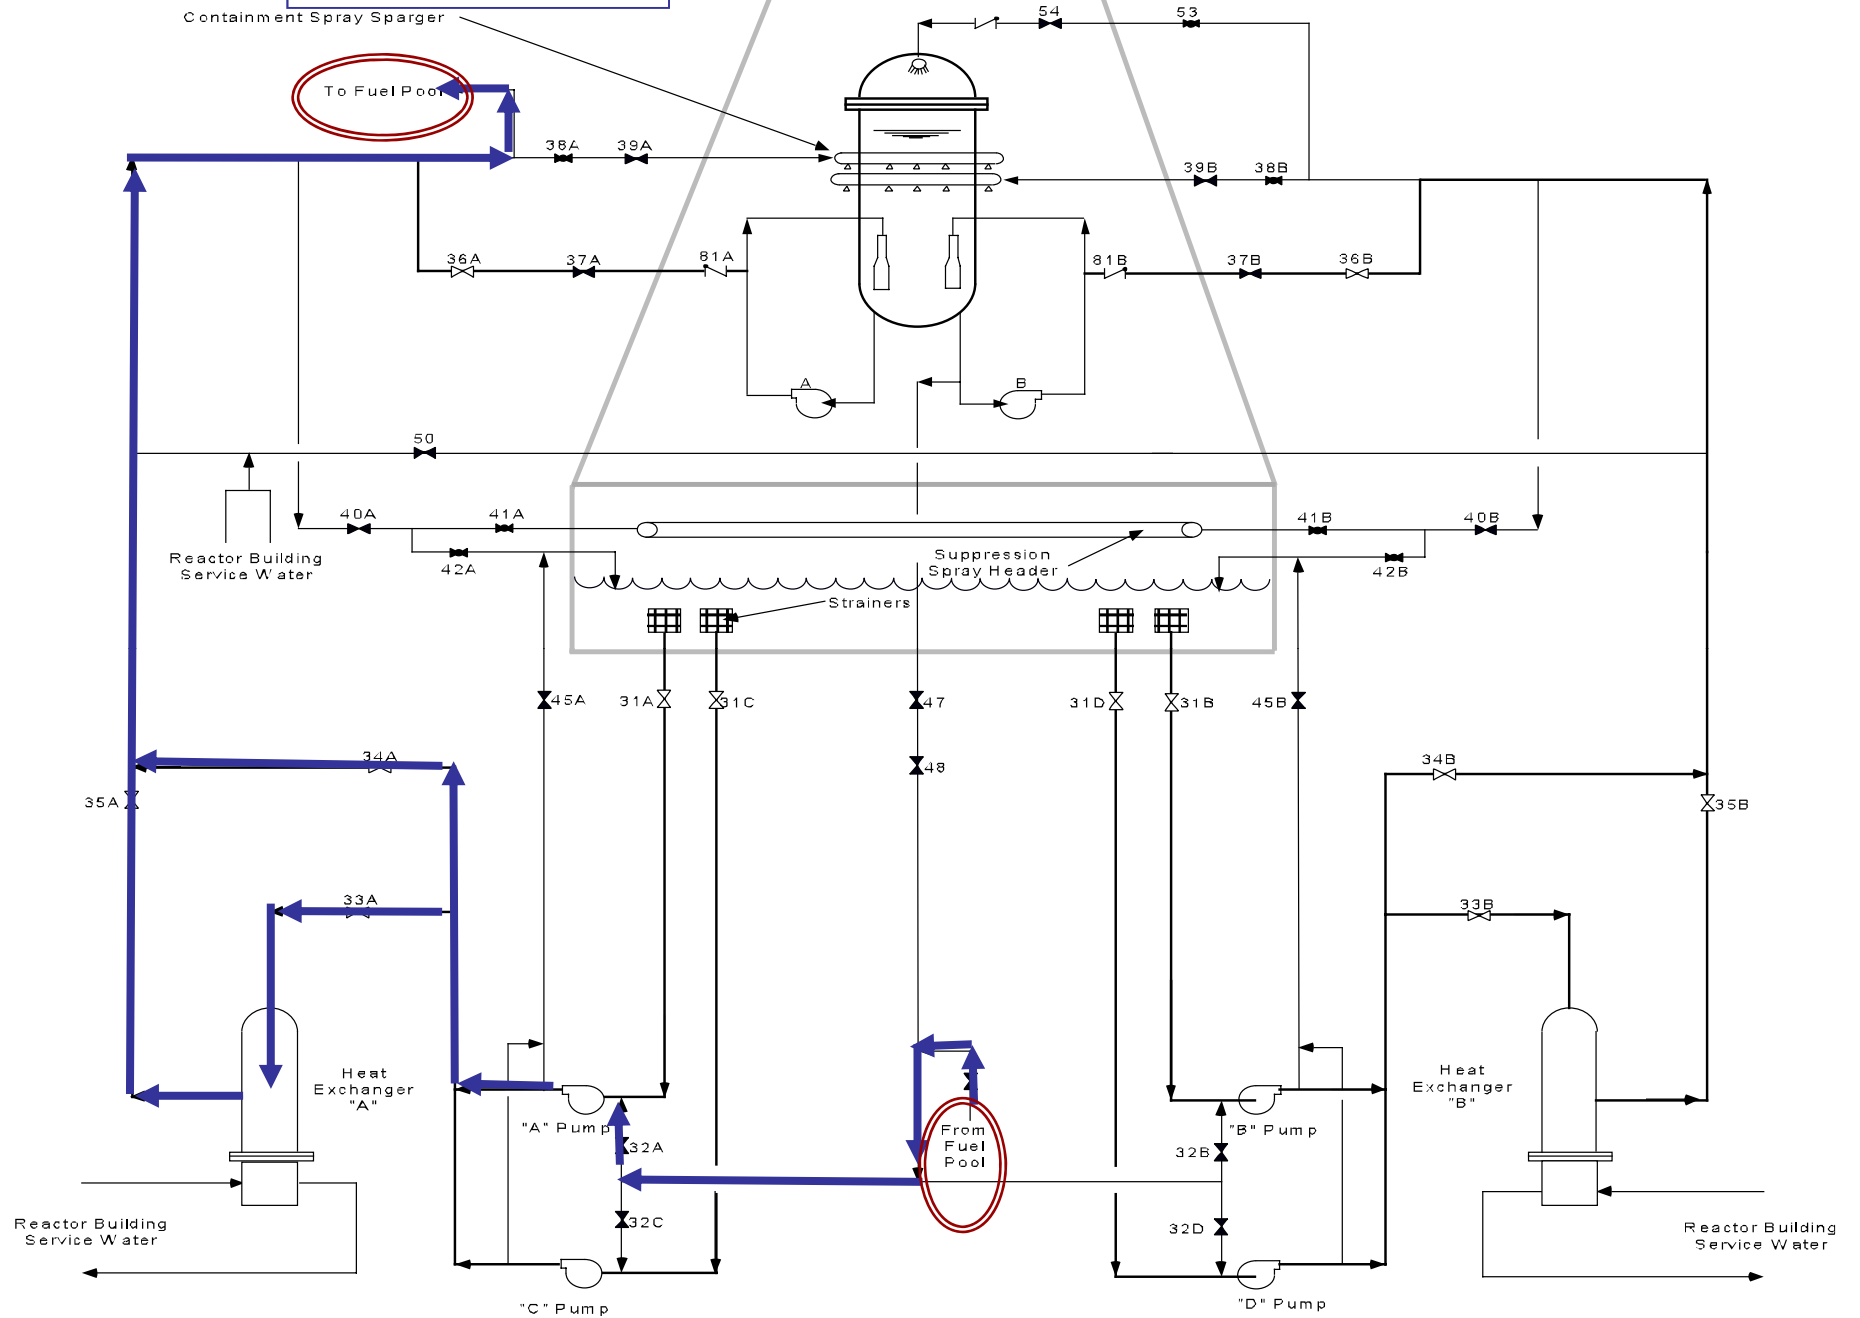


Shutdown Cooling Mode

- Removes decay heat when shutdown.
- Head Spray is used to remove heat from the thick upper head region

Conditions


- Reactor at low pressure
- Suction from A recirculation loop suction side
- Return to either recirculation loop discharge side
- Recirculation pump discharge valve shut to ensure flow to the vessel.

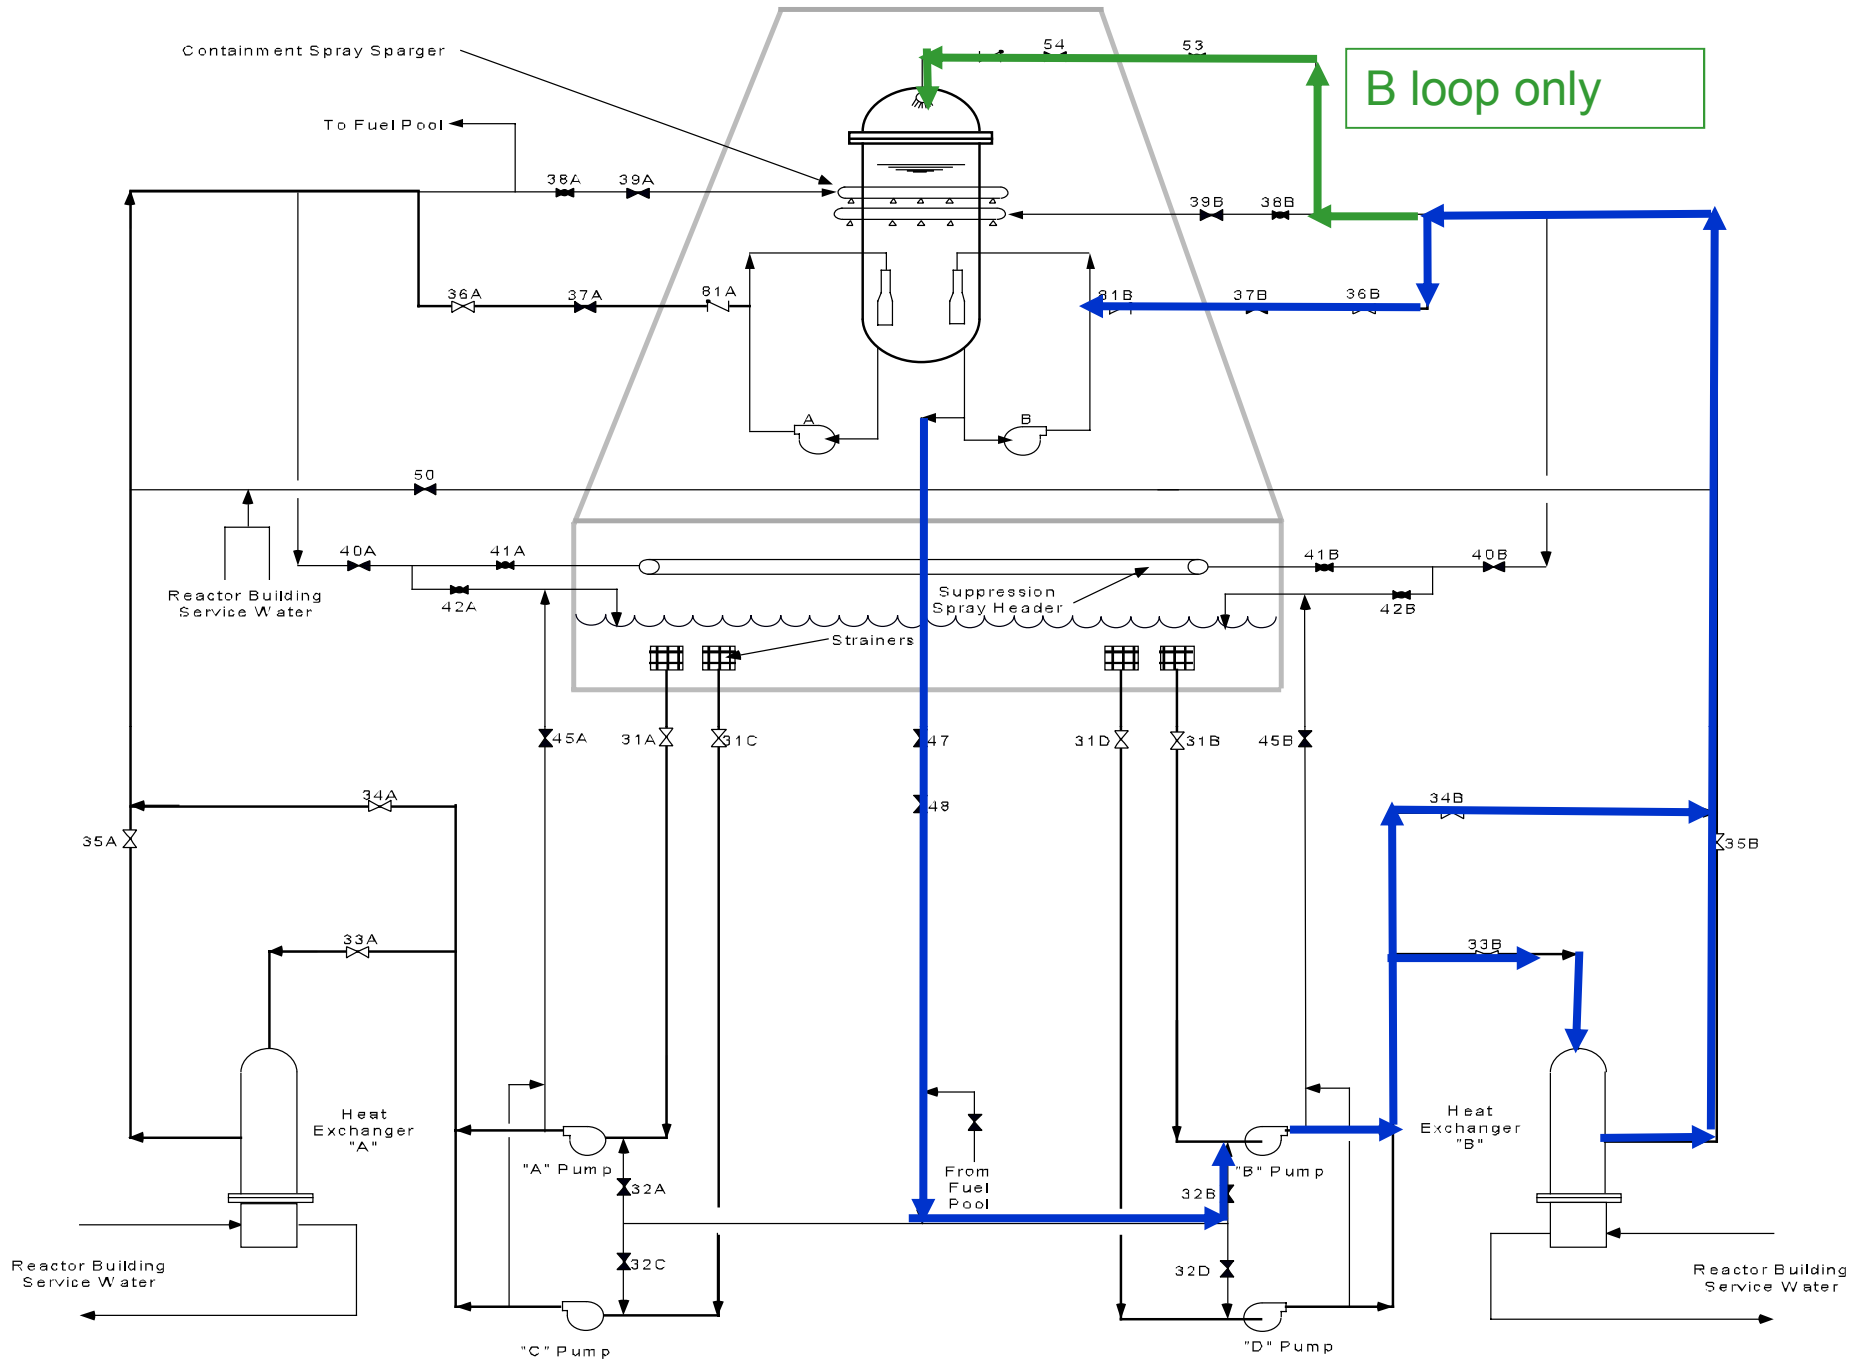

Line Fill

- Keeps discharge line full with water to minimize injection times
- Helps prevent water hammer.

**Uses the same pump as the Core
Spray Line Fill**

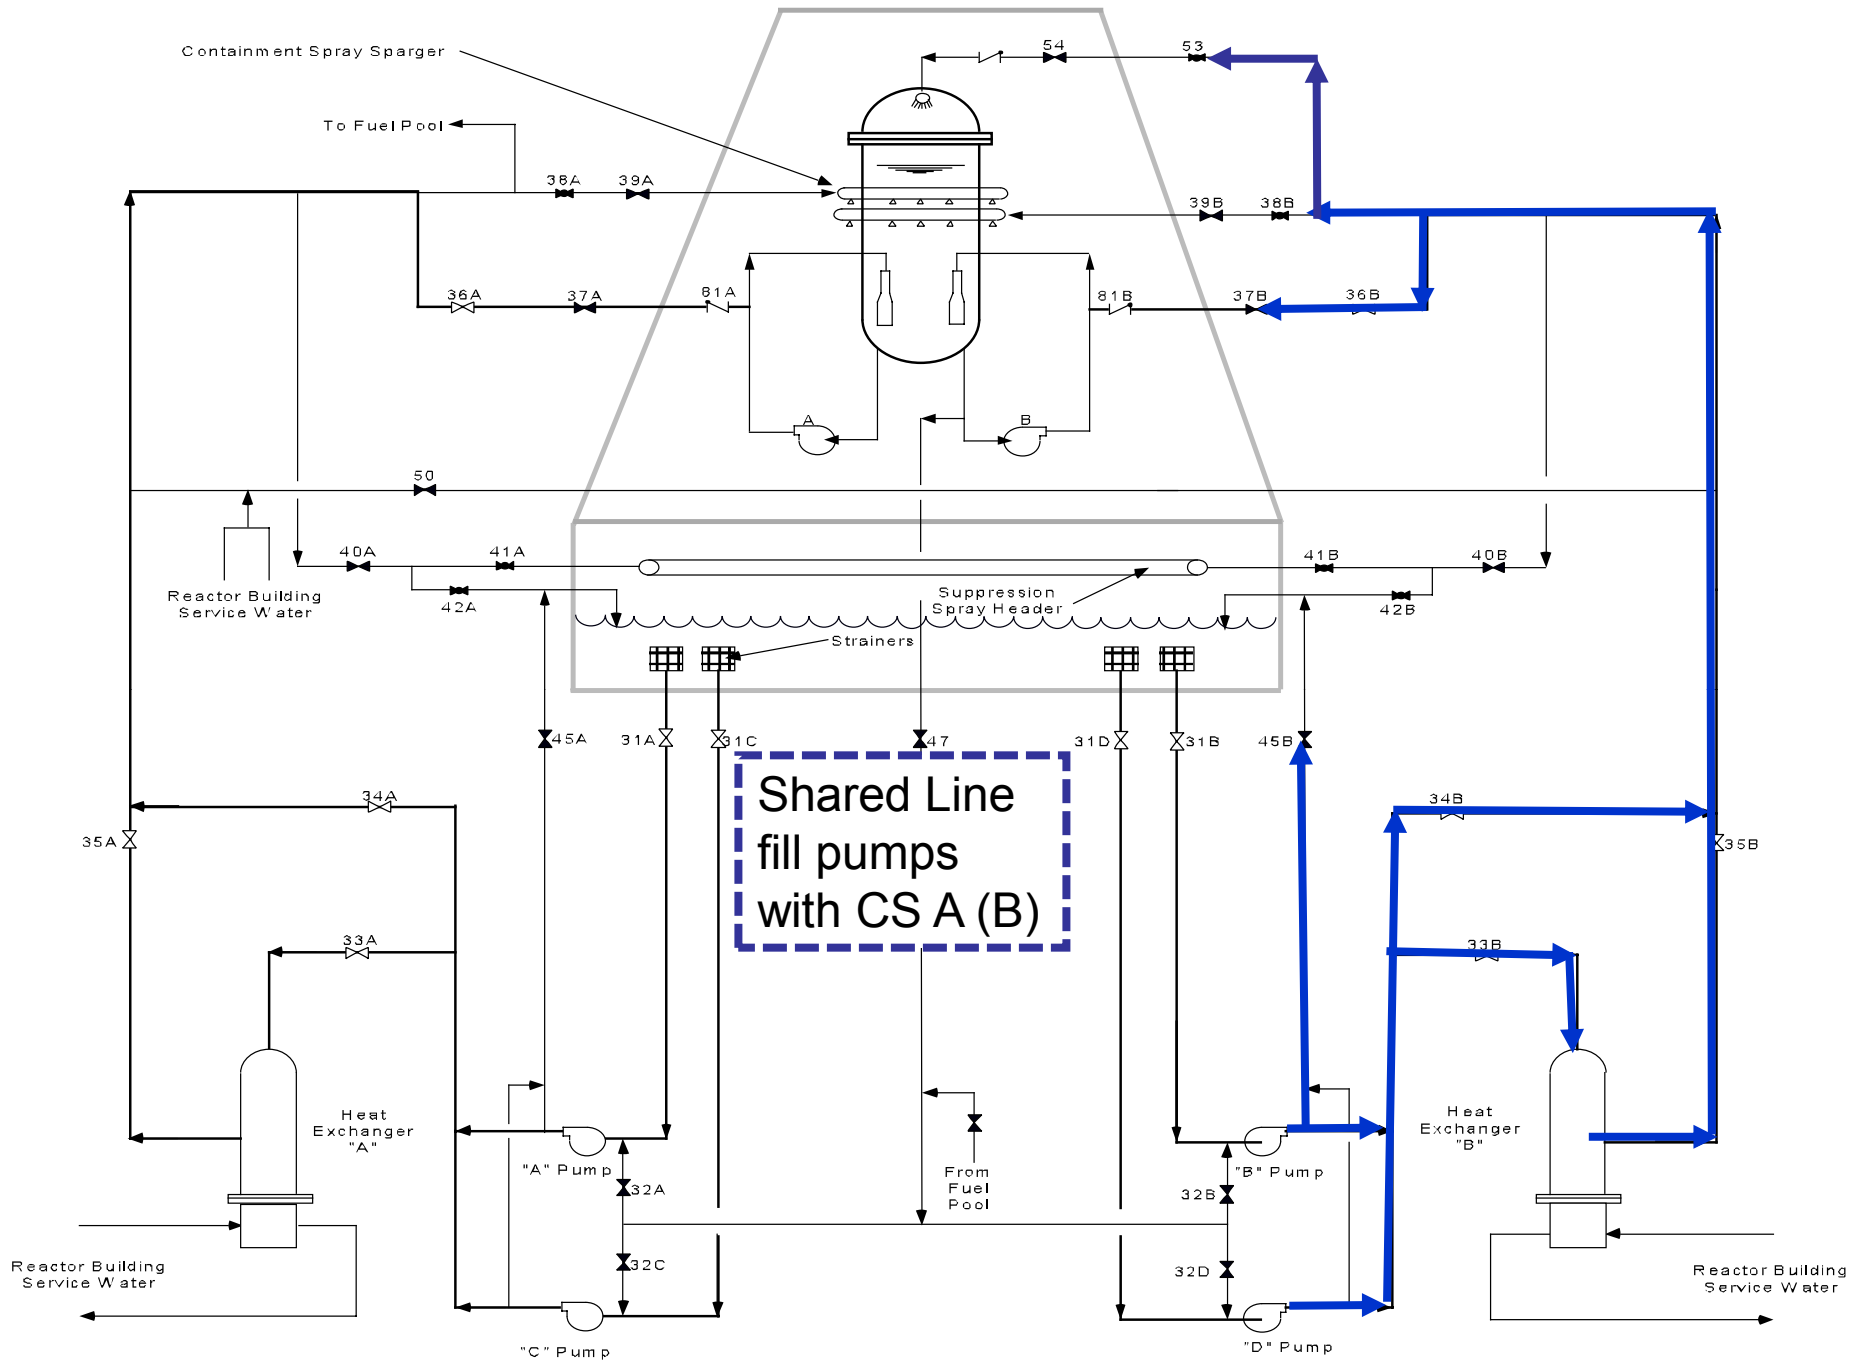

Standby Coolant Injection (SBCI)

- LPCI and CS don't work &
- Level continues to decrease!




- SBCI adds sea/lake/river water to the vessel

If that doesn't work!



Fill the DW with SBCI

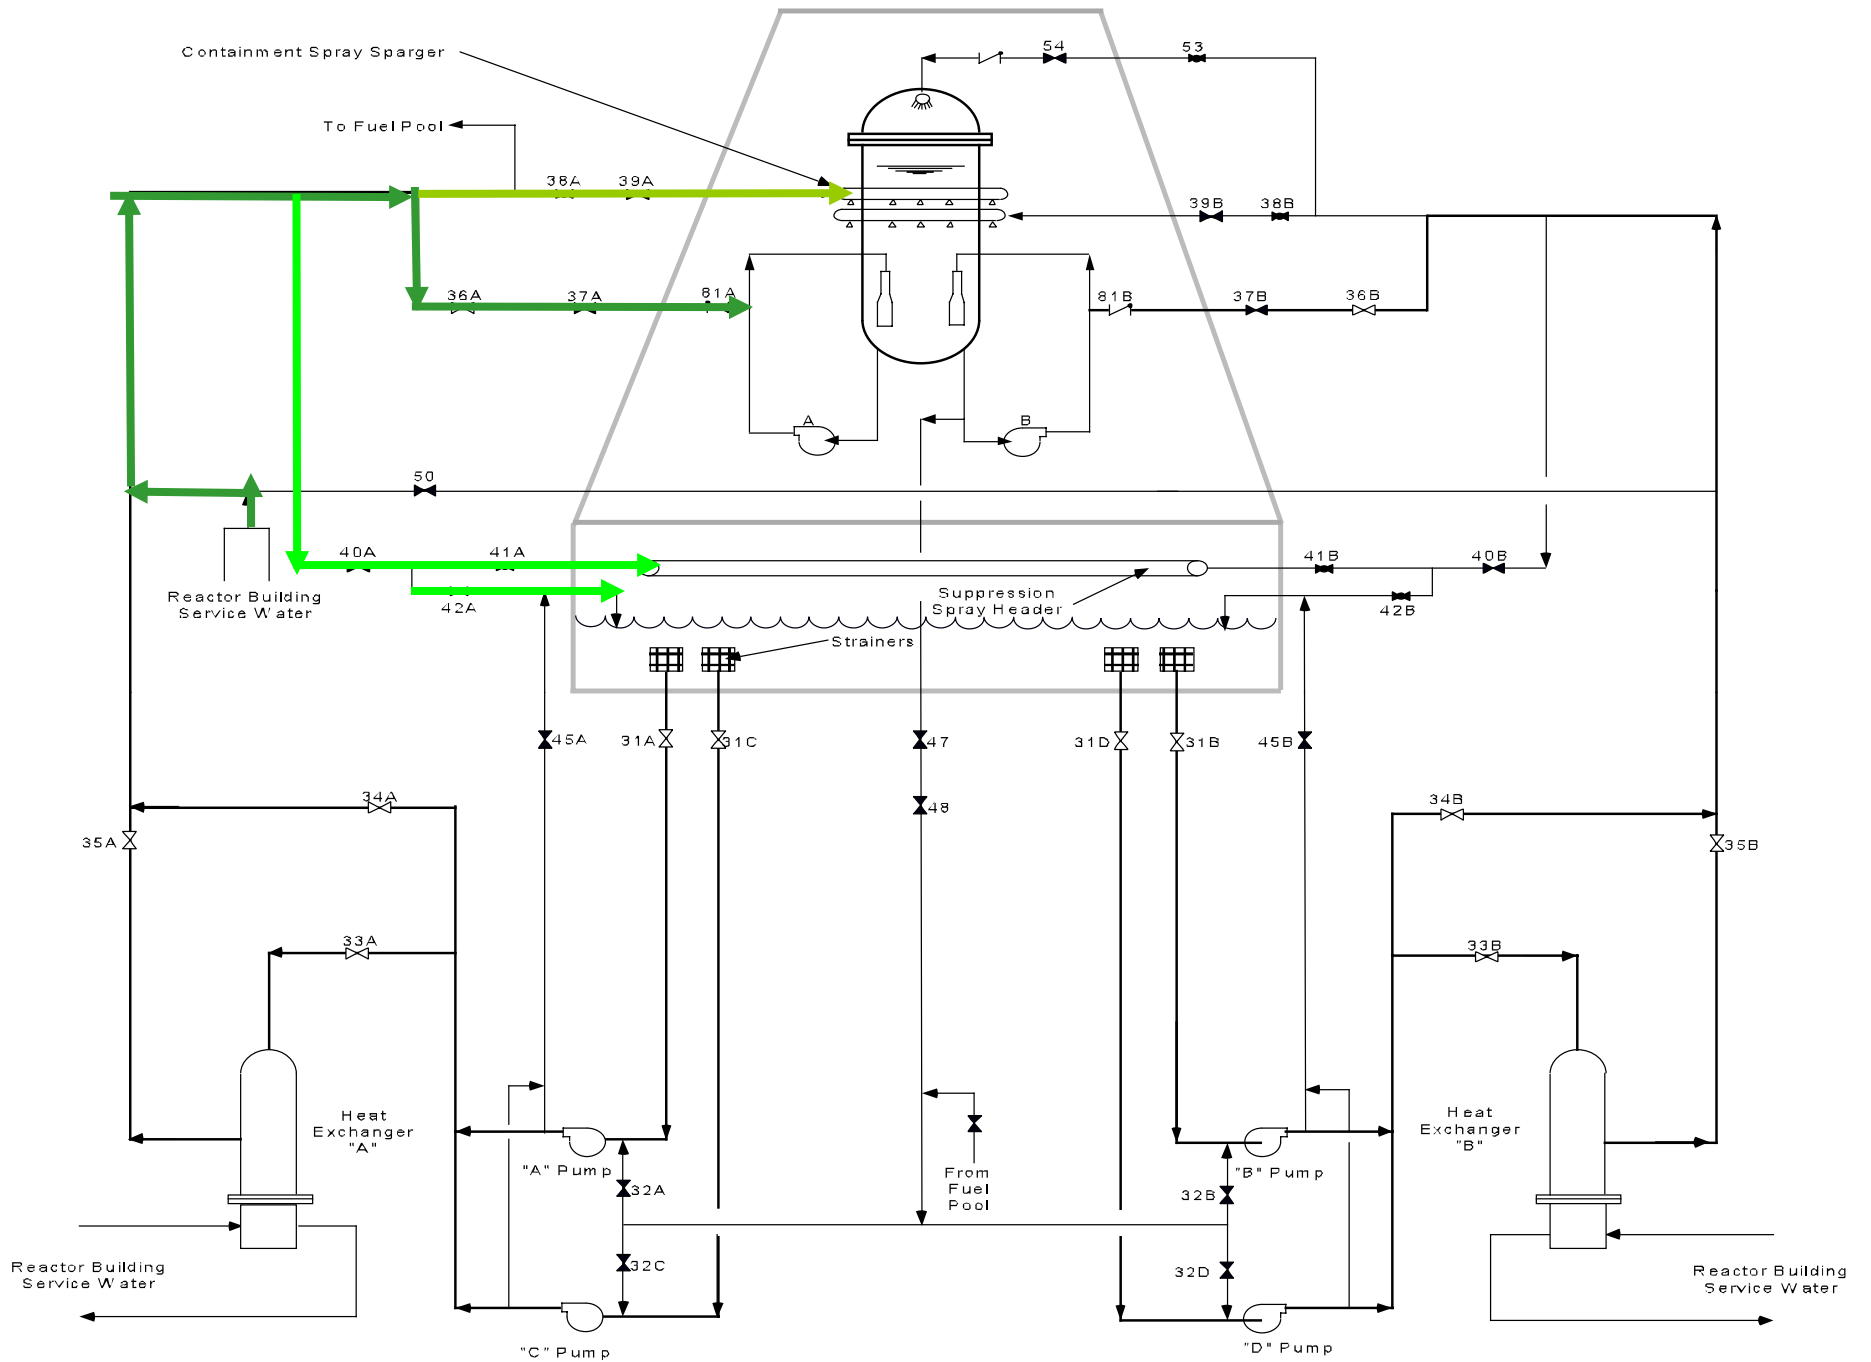

LPCI Initiation Signals align RHR from standby, SPC, test, SPS, and DWS to the LPCI mode

RPV level 1

OR

High Drywell Pressure

OR

Manual Arm and Depress Pushbuttons

Start Sequence

- Pumps start immediately and run on min flow to the SP.
- $RPV < 310$ psig, the Recirculation Pump Discharge valves close (shut in 33 seconds)
- Pump shutoff head is 238 psig.
- When system flow rises above 2350 gpm, into the vessel, minimum flow valve closes

LPCI / SDC Interlock

Prevents inadvertent draining of the reactor vessel.

- **Shutdown cooling suction valves are interlocked with the suppression pool suction valves.**
- **If the pumps SP suction valve is not fully closed, the SDC suction valve cannot be opened.**

System Interrelations

Recirculation system

- The SDC and HS mode suction is taken on the suction of the "B" loop. LPCI and SDC injection is into the discharge of both recirculation loops.
- A LPCI initiation signal shuts recirculation pump discharge valves at <310 psig.

Primary Containment system (Section 4.1)

- The RHR System's standby lineup suction path is from the suppression pool.
- RHR flow can be returned to the suppression pool from:
 - pump minimum flow
 - suppression chamber spray
 - test return
- Redundant drywell spray spargers are supplied from the RHR system.
- The standby coolant supply mode allows flooding the containment.

System Interrelations

Nuclear Steam Supply Shutoff system (Section 4.4)

- NSSSS sends isolation signals to various RHR valves.

Emergency AC Power system (Section 9.2)

- Emergency AC power system provides a reliable power source for RHR System.

Core Spray system (Section 10.2)

- Core Spray (CS) system shares line fill pumps with the RHR system. CS loop A (RHR A (system I). CS loop B (RHR B system II)

Automatic Depressurization System (Section 10.2)

- ADS receives an open permissive signal when RHR pump discharge pressure is >125 psig.

System Interrelations

Reactor Building Closed Loop Cooling Water System

- RBCLCW system provides cooling water to the RHR pump seals.

Reactor Building Service Water System

- Supplies cooling water for the RHR heat exchanger
- Can be used to flood containment via RHR lines in the RHR standby coolant supply mode.

Fuel Pool Cooling and Cleanup System

- System I (RHR A) of the RHR system may be used to assist in fuel pool cooling.