


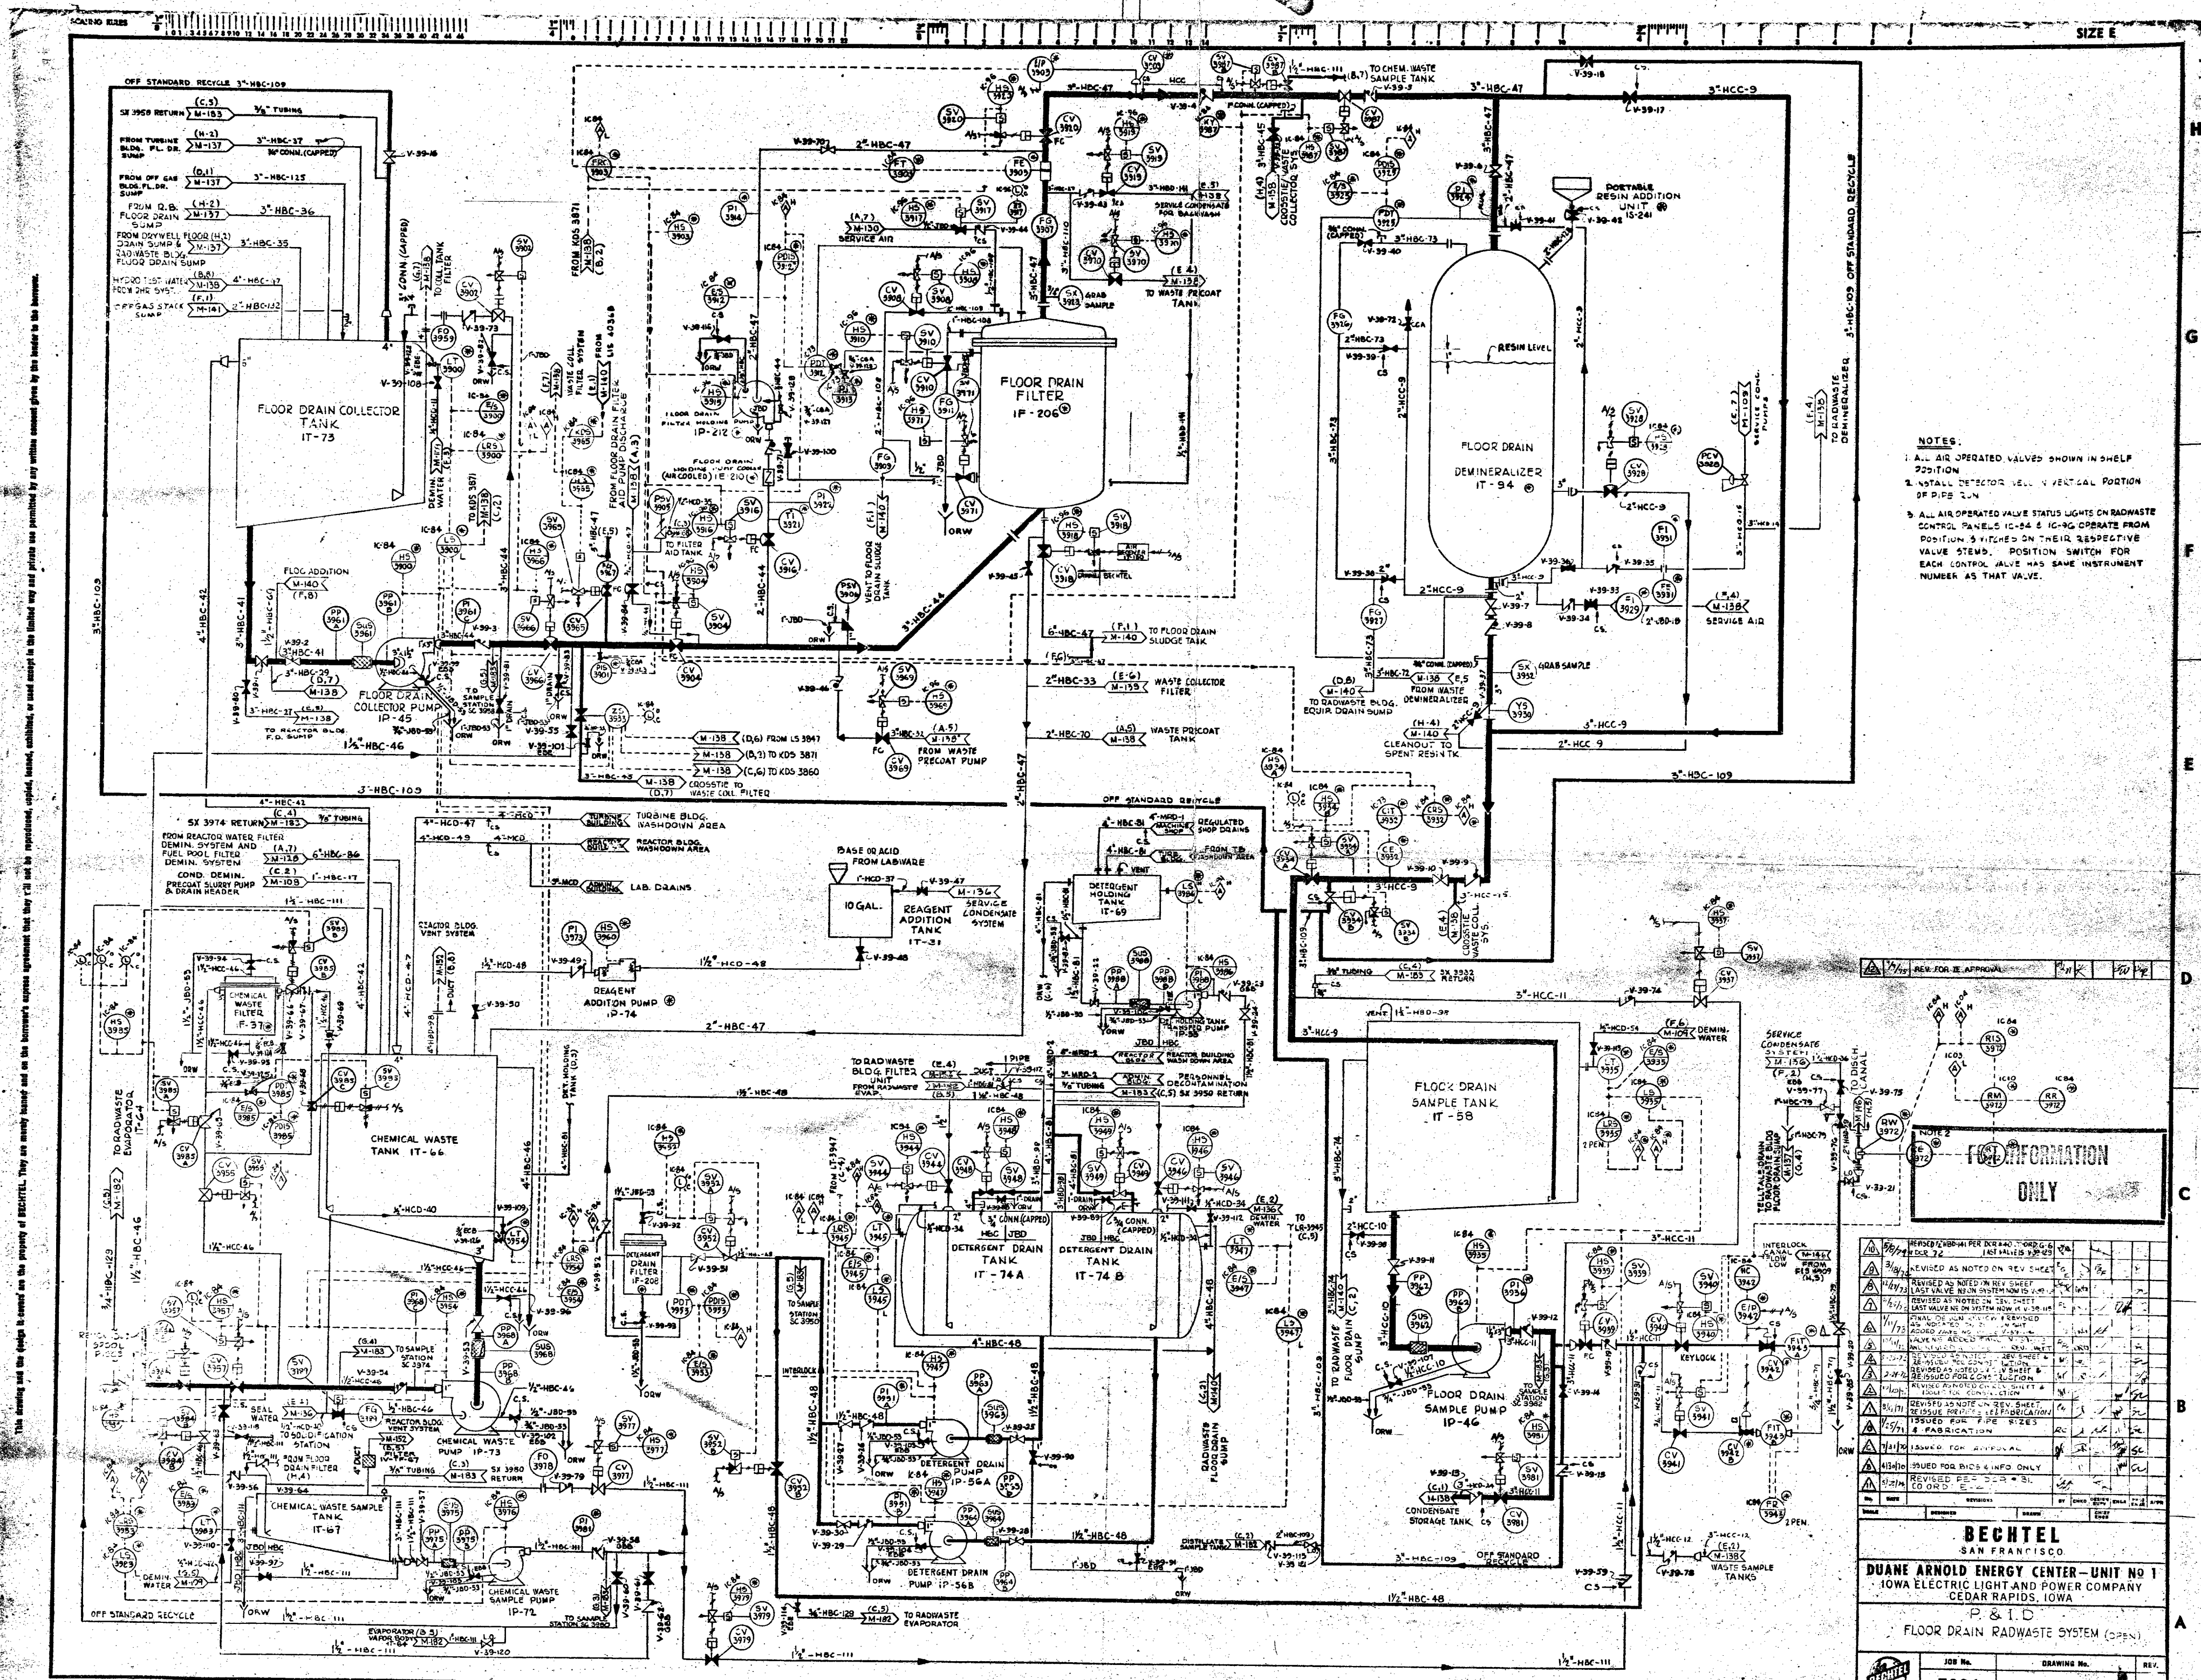

- NOTES:
1. ALL AIR OPERATED VALVES SHOWN IN SHELF POSITION
 2. INSTALL DETECTOR VELL VERTICAL PORTION OF PIPE LUN
 3. ALL AIR OPERATED VALVE STATUS LIGHTS ON RADWASTE CONTROL PANELS IC-84 & IC-96 OPERATE FROM POSITION 3 VEHICLED ON THEIR RESPECTIVE VALVE STEM. POSITION SWITCH FOR EACH CONTROL VALVE HAS SAME INSTRUMENT NUMBER AS THAT VALVE.

FOR INFORMATION ONLY

REVISION	DATE	BY	REASON
1	10/1/78	...	...
2	...	...	...
3	...	...	...
4	...	...	...
5	...	...	...
6	...	...	...
7	...	...	...
8	...	...	...
9	...	...	...
10	...	...	...
11	...	...	...
12	...	...	...

BECHTEL SAN FRANCISCO		
DUANE ARNOLD ENERGY CENTER - UNIT NO 1 IOWA ELECTRIC LIGHT & POWER COMPANY CEDAR RAPIDS, IOWA		
P. & I. D.		
FLOOR DRAIN RADWASTE SYSTEM (OPEN)		
JOB No.	DRAWING No.	REV.
7884	M-139	12

8805130043