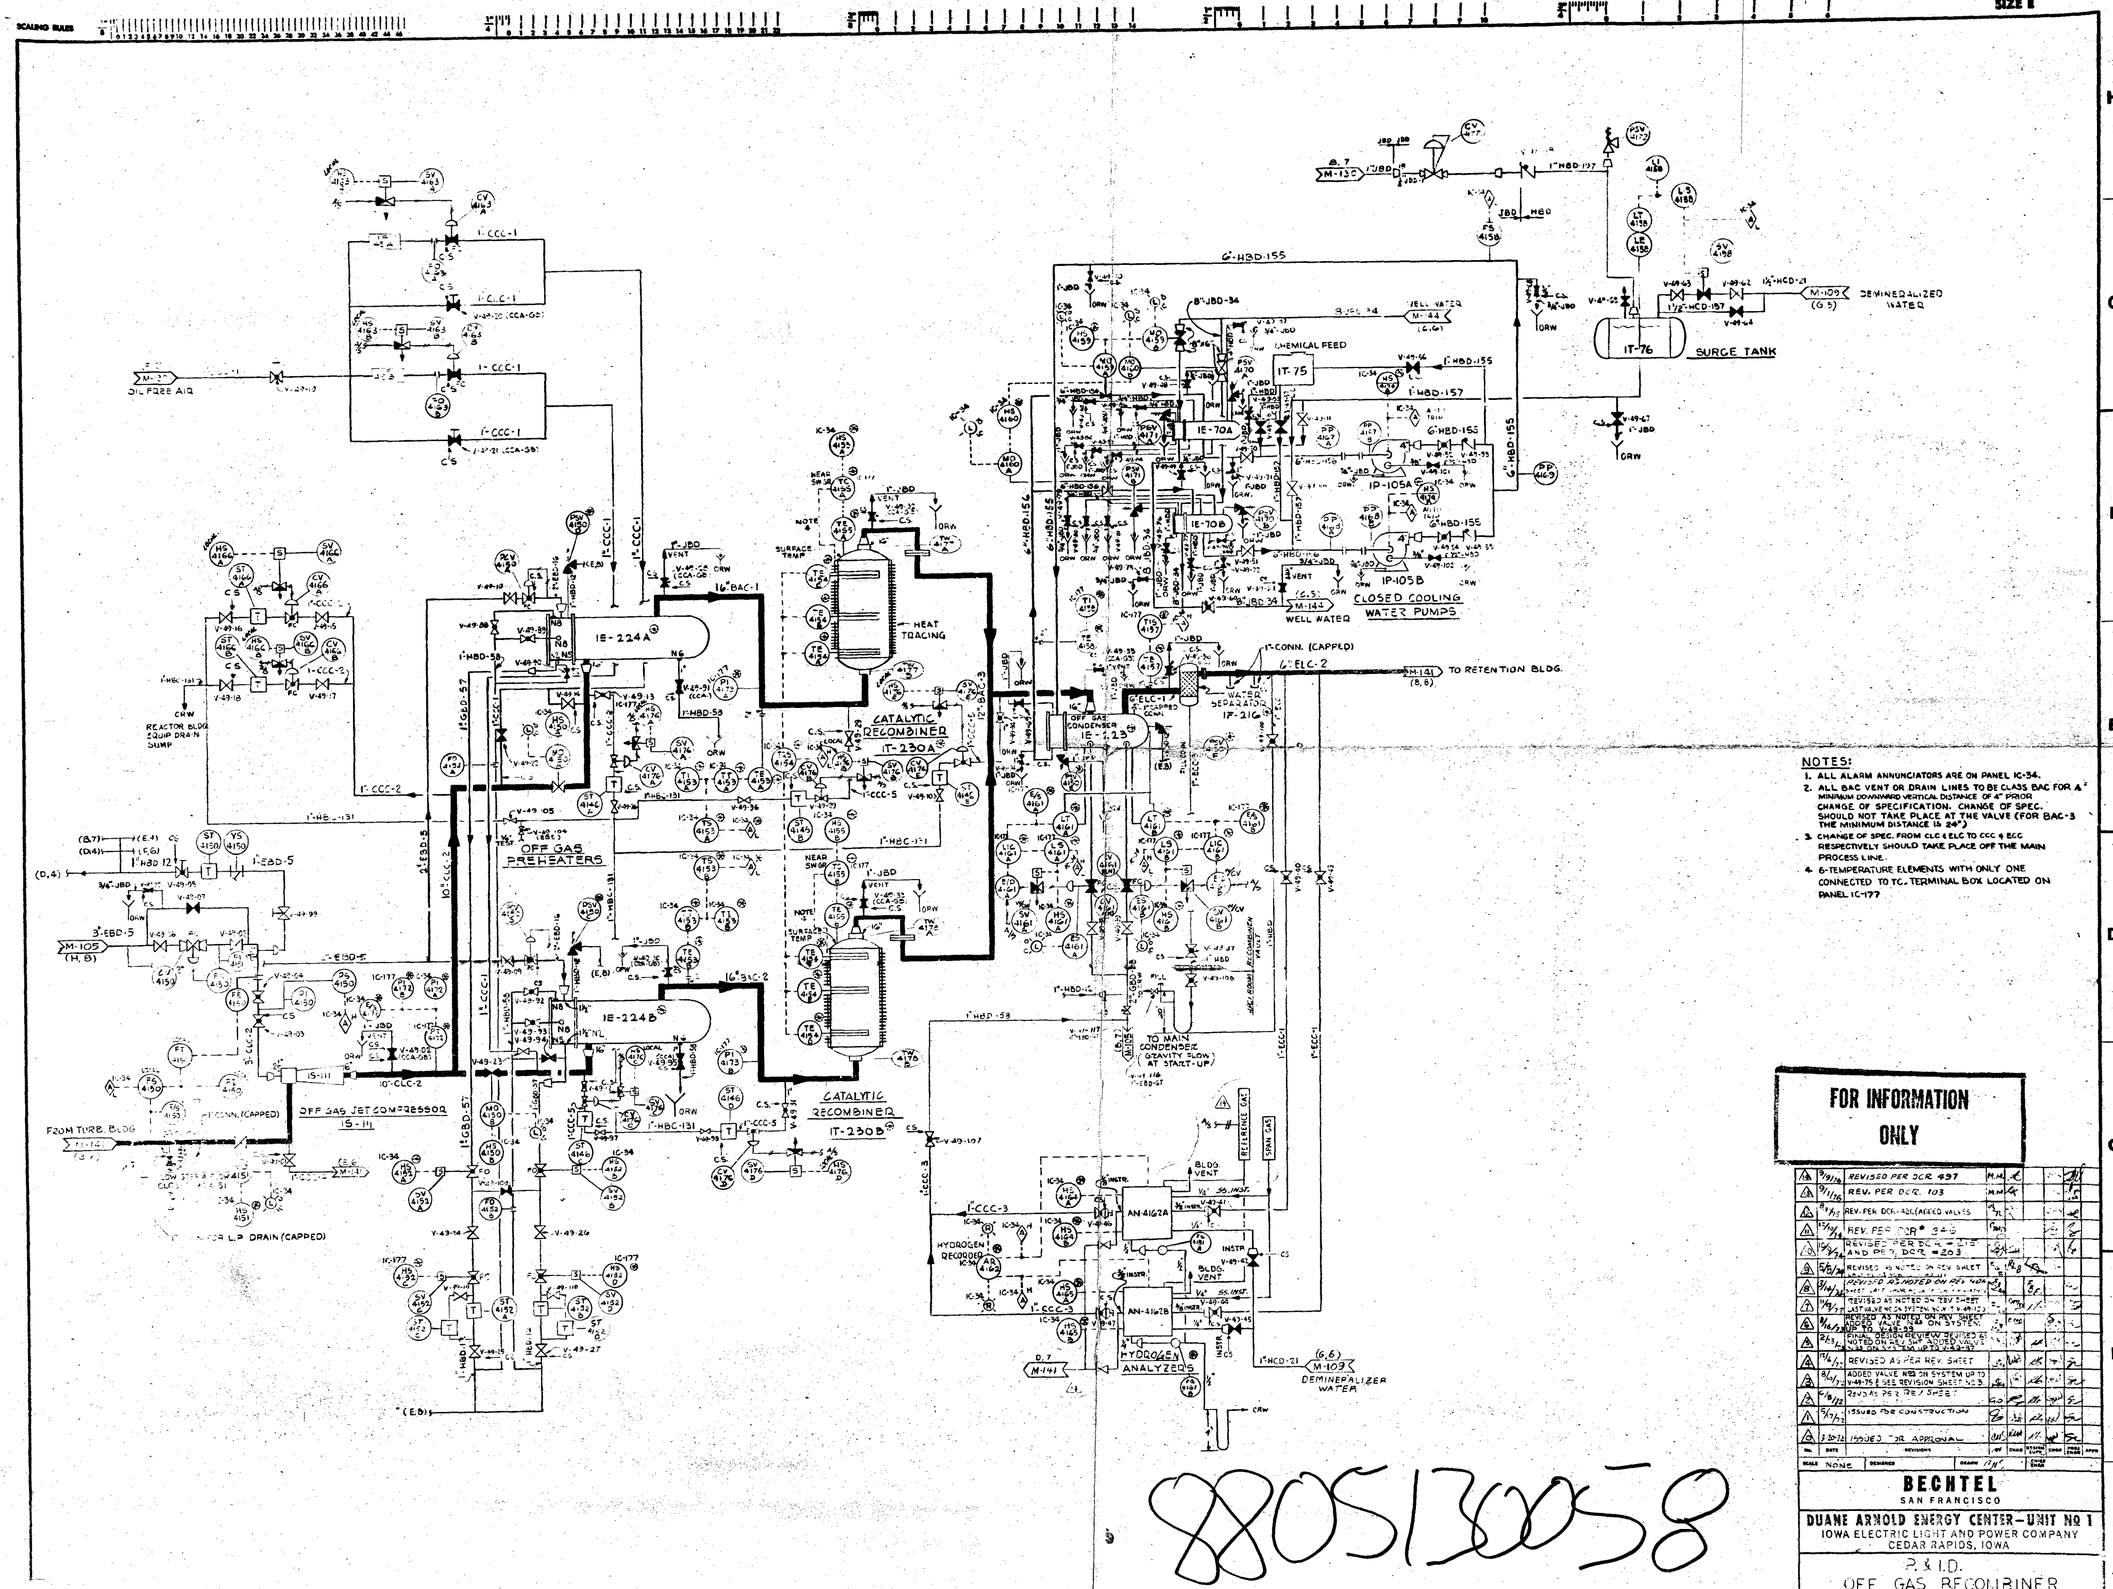

NOTES:

1. ALL ALARM ANNUNCIATORS ARE ON PANEL IC-34.
2. ALL BAC VENT OR DRAIN LINES TO BE CLASS BAC FOR A MINIMUM DOWNWARD VERTICAL DISTANCE OF 4" PRIOR CHANGE OF SPECIFICATION. CHANGE OF SPEC. SHOULD NOT TAKE PLACE AT THE VALVE (FOR BAC-3 THE MINIMUM DISTANCE IS 24")
3. CHANGE OF SPEC. FROM CLC & ELC TO CCC & ECC RESPECTIVELY SHOULD TAKE PLACE OFF THE MAIN PROCESS LINE.
4. 6-TEMPERATURE ELEMENTS WITH ONLY ONE CONNECTED TO TC. TERMINAL BOX LOCATED ON PANEL IC-177

FOR INFORMATION ONLY

NO.	DATE	REVISIONS	DR	CHKD	PROJ ENGR	CHIEF ENGR	PROJ MGR	APPR
16	9/9/76	REVISED PER DCR 497	M.M.					
15	7/1/76	REV. PER DCR. 103	M.M.					
14	8/1/75	REV. PER DCR-486 (ADDED VALVES						
13	12/3/74	REV. PER DCR # 346						
12	12/3/74	REVISED PER DCR # 275 AND PER DCR #203						
11	5/8/74	REVISED AS NOTED ON REV SHEET						
10	3/14/74	REVISED AS NOTED ON REV SHEET						
9	1/8/74	REVISED AS NOTED ON REV SHEET LAST VALVE NO. IN SYSTEM NOW V-49-123						
8	11/6/73	REVISED AS NOTED ON REV SHEET DCR 50 VALVE NO. ADDED ON SYSTEM						
7	2/23/73	FINAL DESIGN REVIEW REVISED AS NOTED ON REV SHEET ADDED VALVE NO. ON SYSTEM UP TO V-49-99						
6	12/6/72	REVISED AS PER REV. SHEET						
5	8/1/72	ADDED VALVE NO. ON SYSTEM UP TO V-49-75 & SEE REVISION SHEET NO. 5						
4	7/18/72	REVISED PER REV. SHEET						
3	5/17/72	ISSUED FOR CONSTRUCTION						
2	3-30-72	ISSUED FOR APPROVAL						

SCALE NONE | DESIGNED | DRAWN | CHIEF ENGR

BECHTEL
SAN FRANCISCO

DUANE ARNOLD ENERGY CENTER—UNIT NO 1
IOWA ELECTRIC LIGHT AND POWER COMPANY
CEDAR RAPIDS, IOWA

P. & I.D.
OFF GAS RECOMBINER

JOB No. 7384 | DRAWING No. M-149 | REV.

8805130058

E 30

This drawing and the design it covers are the property of BECHTEL. They are merely loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited, or used except in the limited way and private use permitted by any written consent given by the lender to the borrower.