2998-G-071

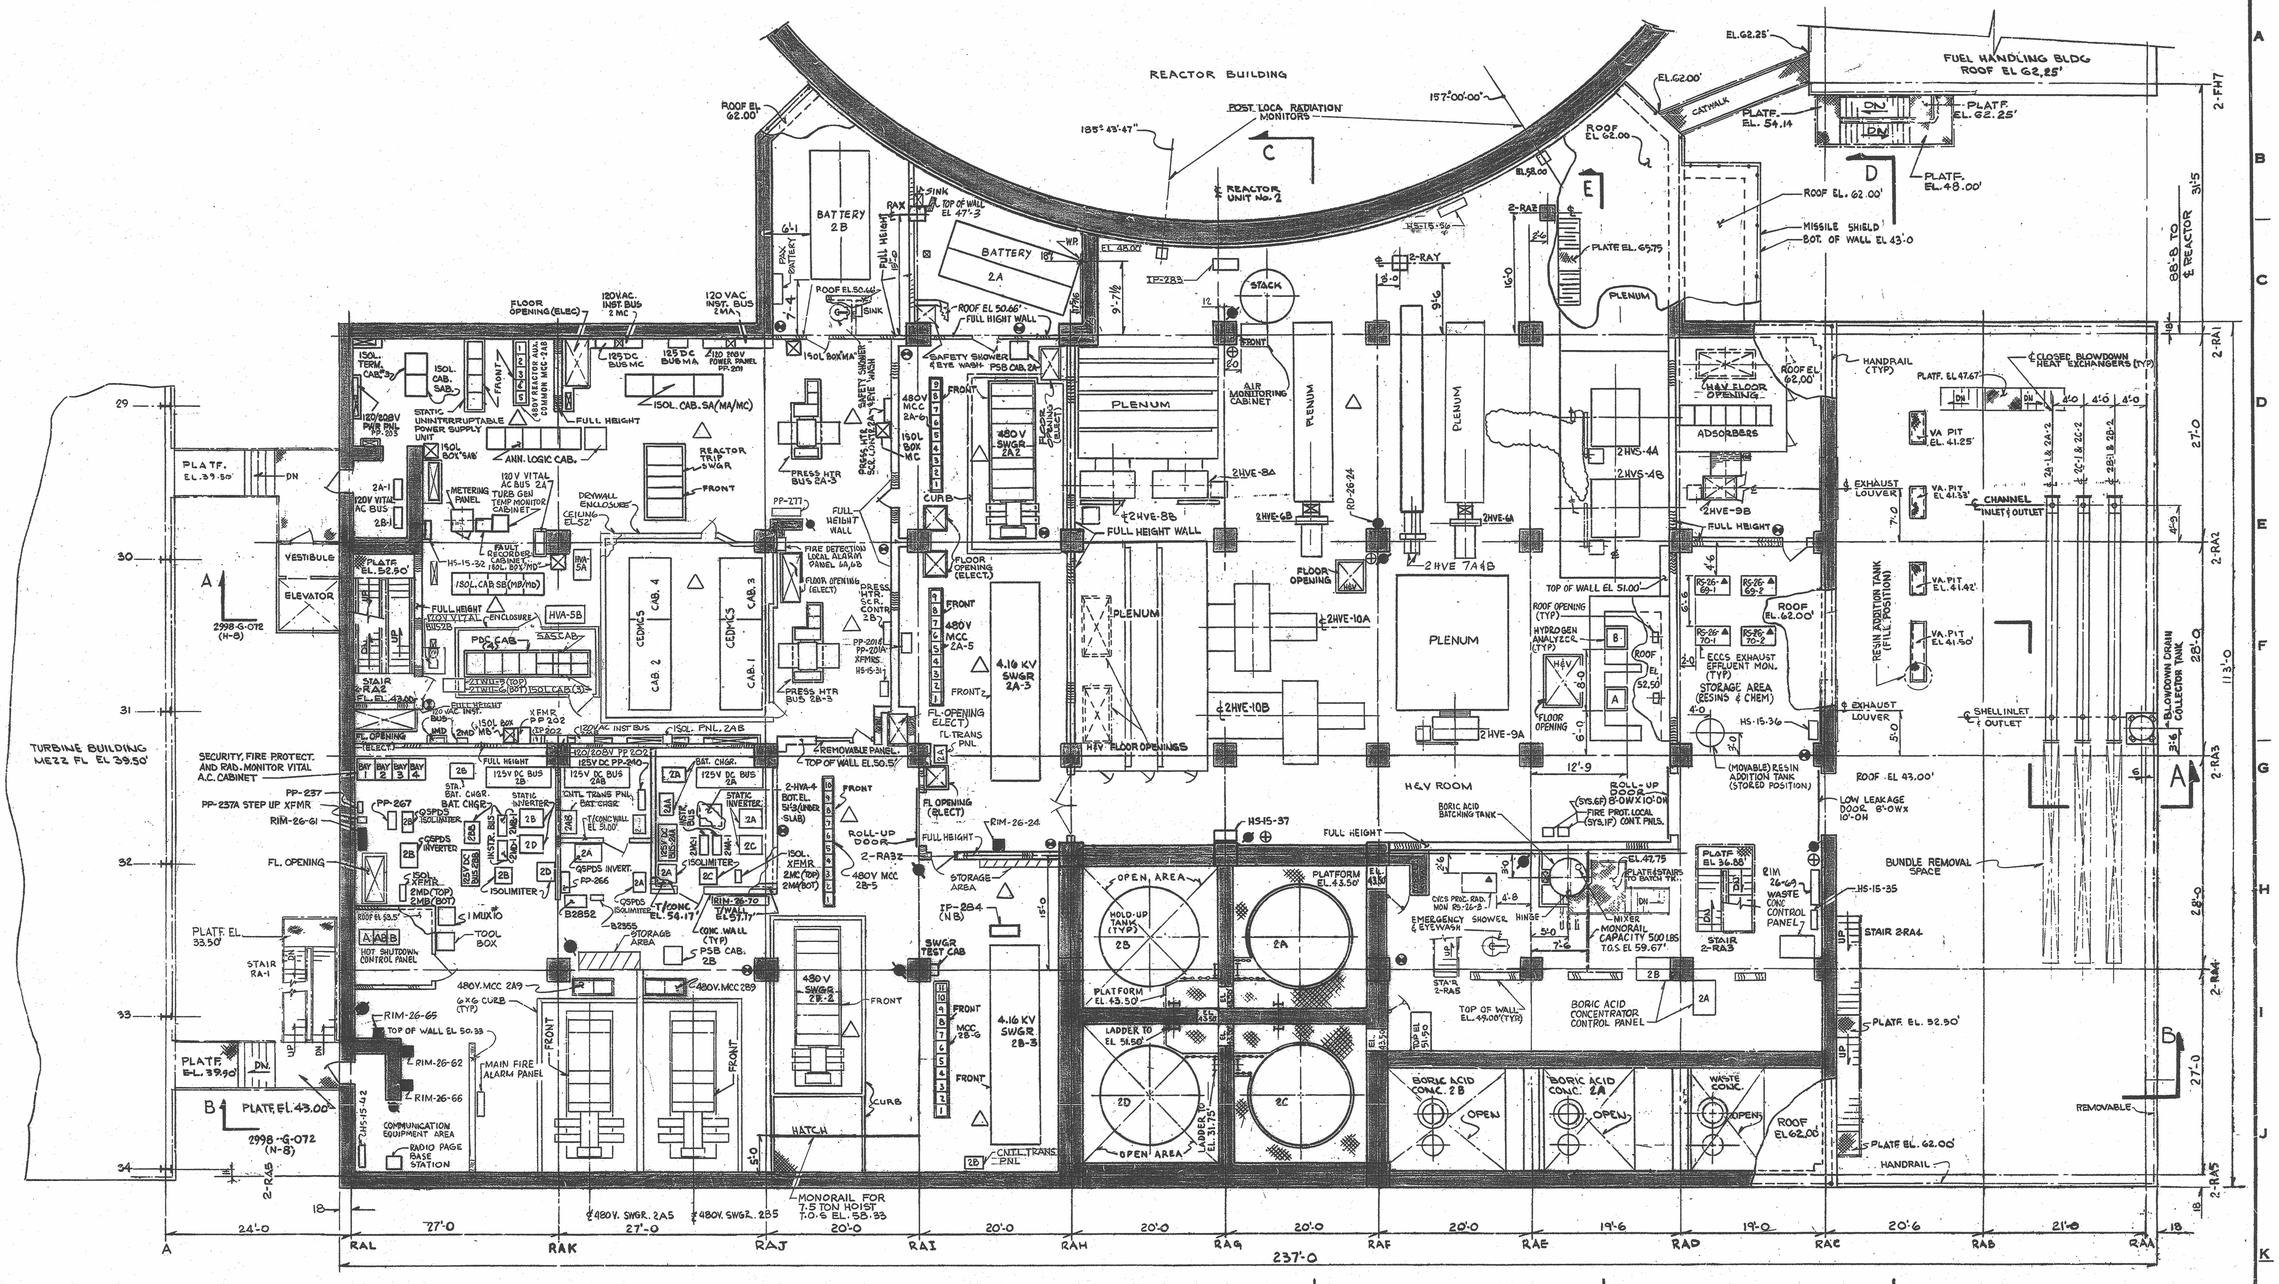

PLAN AT EL.43.00'

C 2998-G-073 (H,6)

E 2998-G-075 (H,14)

D 2998-G-075 (N,6)

NOTE

1. FOR GENERAL NOTES, REFERENCE DRAWINGS & LEGEND SEE 2998-G-069

NO.	DATE	REVISION	BY	CH.	APPROVED
24	7/5/00	DCR 000059 REV: (E8+F9) FIRE EXT.	DG	GW	[illegible]
23	4/14/00	PCM 99068 ADD:(B13) HOSE STATION.	GM	HS	[illegible]
22	6/25/97	PCM 96174: ADD:(D14) LEAD SHIELD WALL	[illegible]	[illegible]	[illegible]
21	3/6/97	DCR 960279: ADD: (E7-G8) CEDMCS ENCLOSURE	[illegible]	[illegible]	[illegible]
20	4-1-94	PCM 066-293: ADDED: (G5,H7) ISOLIMITER.	[illegible]	RAC	[illegible]
19	5-7-93	ADDED: (G10, H7) STORAGE AREAS & (H5) TOOL BOX PER PCM 1997-292	KAL	RLM	[illegible]
28	6/17/11	EC250356 DEL:(D14-E14) WALL.	GM	GW	— — [illegible]
27	6/23/09	PCM 05034 ADD:(D6) LOGIC CABINET. CRN 07127-18080 DEL:(I18-J19) JIB CRANE.	GM	GW	— — DG
26	09/11/03	PCM 02042 ADD:(E8) PP-277 RELOCATE FIRE EXT.	GM	GW	— — [illegible]
25	5/9/03	PCM 02077: ADD (E5-F6) HVA-5A & HVA-5B	GW	GM	[illegible]

THIS DOCUMENT HAS BEEN PHOTOGRAPHICALLY REPRODUCED. FOR PREVIOUS REV. BLOCKS SEE RECORD MYLAR 2998-G-071 REV 15

ALBERT J. UGELOW CERTIFICATE No. 31840 STATE OF FLORIDA REGISTERED ENGINEER

0 5 10 15 20 25 30 FT 1/8"=1'-0"

⚠ THE DESIGN INFORMATION FOR THE CHANGES SHOWN IN THIS REVISION HAS BEEN ENGINEERED BY FLORIDA POWER & LIGHT COMPANY.

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF SEPTEMBER 1, 1975 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983-890 MWe EXTENSION UNIT # 2

GENERAL ARRANGEMENT
REACTOR AUXILIARY BUILDING
PLAN SHEET 3

EBASCO SERVICES INCORPORATED

SCALE 1/8"=1'-0 | APPROVED | DATE May 13, 1986
DIV. MECH.
DR. N. AMOROS
CH. P. BERGERON
2998-G-071
28

CAD FILE: R2998-G-071_R28.dwg

D-07