



International Agreement Report

Full Scale Loop Seal Experiments with TRACE V5 Patch 1

Prepared by:
Seppo Hillberg

VTT – Technical Research Centre of Finland
Nuclear Power Plant Modeling
P.O.B. 1000
02044 VTT
Finland

A. Calvo, NRC Project Manager

Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

Manuscript Completed: January 2009
Date Published: December 2011

Prepared as part of
The Agreement on Research Participation and Technical Exchange
Under the Thermal-Hydraulic Code Applications and Maintenance Program (CAMP)

Published by
U.S. Nuclear Regulatory Commission

**AVAILABILITY OF REFERENCE MATERIALS
IN NRC PUBLICATIONS**

NRC Reference Material

As of November 1999, you may electronically access NUREG-series publications and other NRC records at NRC's Public Electronic Reading Room at <http://www.nrc.gov/reading-rm.html>. Publicly released records include, to name a few, NUREG-series publications; *Federal Register* notices; applicant, licensee, and vendor documents and correspondence; NRC correspondence and internal memoranda; bulletins and information notices; inspection and investigative reports; licensee event reports; and Commission papers and their attachments.

NRC publications in the NUREG series, NRC regulations, and *Title 10, Energy*, in the Code of *Federal Regulations* may also be purchased from one of these two sources.

1. The Superintendent of Documents
U.S. Government Printing Office
Mail Stop SSOP
Washington, DC 20402-0001
Internet: bookstore.gpo.gov
Telephone: 202-512-1800
Fax: 202-512-2250
2. The National Technical Information Service
Springfield, VA 22161-0002
www.ntis.gov
1-800-553-6847 or, locally, 703-605-6000

A single copy of each NRC draft report for comment is available free, to the extent of supply, upon written request as follows:

Address: U.S. Nuclear Regulatory Commission
Office of Administration
Publications Branch
Washington, DC 20555-0001

E-mail: DISTRIBUTION.RESOURCE@NRC.GOV
Facsimile: 301-415-2289

Some publications in the NUREG series that are posted at NRC's Web site address <http://www.nrc.gov/reading-rm/doc-collections/nuregs> are updated periodically and may differ from the last printed version. Although references to material found on a Web site bear the date the material was accessed, the material available on the date cited may subsequently be removed from the site.

Non-NRC Reference Material

Documents available from public and special technical libraries include all open literature items, such as books, journal articles, and transactions, *Federal Register* notices, Federal and State legislation, and congressional reports. Such documents as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings may be purchased from their sponsoring organization.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at—

The NRC Technical Library
Two White Flint North
11545 Rockville Pike
Rockville, MD 20852-2738

These standards are available in the library for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from—

American National Standards Institute
11 West 42nd Street
New York, NY 10036-8002
www.ansi.org
212-642-4900

Legally binding regulatory requirements are stated only in laws; NRC regulations; licenses, including technical specifications; or orders, not in NUREG-series publications. The views expressed in contractor-prepared publications in this series are not necessarily those of the NRC.

The NUREG series comprises (1) technical and administrative reports and books prepared by the staff (NUREG-XXXX) or agency contractors (NUREG/CR-XXXX), (2) proceedings of conferences (NUREG/CP-XXXX), (3) reports resulting from international agreements (NUREG/IA-XXXX), (4) brochures (NUREG/BR-XXXX), and (5) compilations of legal decisions and orders of the Commission and Atomic and Safety Licensing Boards and of Directors' decisions under Section 2.206 of NRC's regulations (NUREG-0750).

DISCLAIMER: This report was prepared under an international cooperative agreement for the exchange of technical information. Neither the U.S. Government nor any agency thereof, nor any employee, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus, product or process disclosed in this publication, or represents that its use by such third party would not infringe privately owned rights.



International Agreement Report

Full Scale Loop Seal Experiments with TRACE V5 Patch 1

Prepared by:
Seppo Hillberg

VTT – Technical Research Centre of Finland
Nuclear Power Plant Modeling
P.O.B. 1000
02044 VTT
Finland

A. Calvo, NRC Project Manager

Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

Manuscript Completed: January 2009

Date Published: December 2011

Prepared as part of
The Agreement on Research Participation and Technical Exchange
Under the Thermal-Hydraulic Code Applications and Maintenance Program (CAMP)

Published by
U.S. Nuclear Regulatory Commission

ABSTRACT

Full scale loop seal experiments have been simulated with thermal hydraulic simulation code TRACE V5 Patch 1. Multiple nodalizations were created different geometric accuracy. The main interest in the simulations was the residual water level in the horizontal pipe. Also pressure behaviour during the air blow to the loop seal and effects of different maximum time steps and initial liquid levels were studied.

Simulations revealed differencies in results obtained with different nodalizations. Most of the nodalizations produced reasonable results except a simple 90° bend that used grav terms elevation option (namelist variable `ielev=0`). This model cleared too much water out of the loop seal. A very similar model using cell angle elevation option didn't suffer from this problem.

CONTENTS

ABSTRACT	III
1 INTRODUCTION	1
2 THE LOOP SEAL FACILITY.....	2
3 MODELED PIPE GEOMETRIES FOR THE SIMULATIONS.....	3
4 RESULTS OF THE SIMULATIONS.....	9
5 SUMMARY	12
6 REFERENCES	13

FIGURES

Figure 1. Cross section of a partially water filled pipe.....	1
Figure 2. The loop seal facility /1/.....	2
Figure 3. Pressure oscillations in the loop seal experiment (Ref. 2).....	3
Figure 4. The model with single corner node (grav terms elevation option).....	3
Figure 5. The model with three corner nodes (grav terms elevation option).....	4
Figure 6. The model with no dedicated corner nodes (cell angle elevation option).....	5
Figure 7. The model with three corner nodes (cell angle elevation option).....	6
Figure 8. The model with short nodes, no dedicated corner nodes (cell angle elevation option).....	7
Figure 9. Residual water level with different simulated geometries.....	9
Figure 10. Residual water level. The effect different maximum time steps (IELEV=0, 3 corner nodes).....	10
Figure 11. Residual water level. The effect of different initial water levels (IELEV=0, 1 corner node, 1 ms maximum timestep).....	10
Figure 12. Pressure difference over the loop seal (IELEV=0, 1 corner node, 1 ms).....	11
Figure 13. Pressure difference over the loop seal (IELEV=0, 3 nodes, 1 ms).....	11

TABLES

Table 1. Node geometries: Grav terms elevation option, one corner node.....	4
Table 2. Node geometries: Grav terms elevation option, three corner nodes.....	5
Table 3. Cell geometries: Cell angle elevation option, no corner node, long nodes. ..	6
Table 4. Cell geometries: Cell angle elevation option, three corner nodes.....	7
Table 5. Cell geometries: Cell angle elevation option, no corner node, short nodes. .	8

1 INTRODUCTION

In a Loss of Coolant (LOCA) situation loop seal behaviour has potentially a strong impact on core cooling as it causes pressure difference which disturbs flows in the core area. This pressure difference is at its highest when the ascending pipe of the loop seal is full of water and much lower when the flow in the pipe is stratified.

In this report full scale Loop Seal Facility tests are simulated with TRACE (V5p1) thermal hydraulic simulation code and the results are compared to the facility data. Multiple nodalizations were created different geometric accuracy. The main interest in the simulations was the residual water level in the horizontal pipe. Also the effects of different maximum timesteps and different initial liquid levels were studied.

For better comparability the water levels in these simulations are defined as a division of water level and pipe diameter (Figure 1).

$$\tilde{h}_l = \frac{h_l}{D} \quad (1)$$

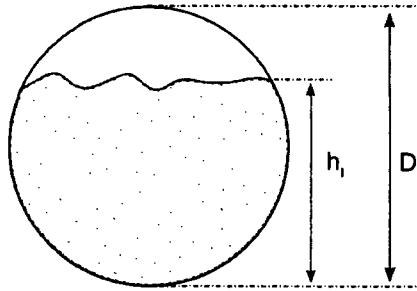


Figure 1. Cross section of a partially water filled pipe.

The Loop Seal facility tests were made in atmospheric pressure with cold water ($\sim 20^\circ\text{C}$) and air. These conditions are on the low end of the operational range of the simulation code. Therefore it should be kept in mind that the results may not be fully applicable at higher pressures and temperatures.

The Loop Seal Facility is presented in Chapter 2. The used geometries in TRACE simulations and their results are presented in Chapter 3. Similarly the APROS geometries and results can be found from Chapter 4. Summary is in Chapter 5.

2 THE LOOP SEAL FACILITY

The Loop Seal facility models a VVER-1000 primary circuit with a rupture in the cold leg. It has a speed-controlled fan which provides up to 9 m/s superficial velocities and a 10 m³ buffer tank to dampen the pressure oscillations. The loop seal part of the facility has an inner diameter of 0.85 m and length of 6,98 m between the vertical pipe centers. The vertical pipe which rises to the (non-existent) reactor coolant pump has elevation difference of 2,9 meters. The loop seal bottom bends have a radius of 1,34 m (Ref. 1). The facility is presented in Figure 2.

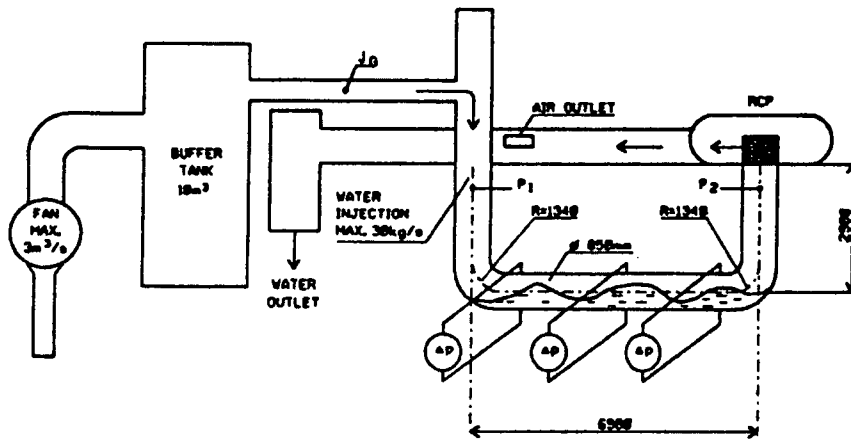


Figure 2. The loop seal facility /1/.

The main parameter in the tests was the residual water level. Also pressure difference over the loop seal was measured. In a publication "Two-Phase Flow in a Full-Scale Loop Seal Facility" (Ref. 2) Tuomisto and Kajanto present the Figure 3 which represents the pressure oscillations at superficial velocity of 5-6 m/s. The marked flow regimes in the figure are A) initial wavy stratified flow, B) transition to slug flow, C) slug flow period, D) transition back to stratified flow and E) stratified flow.

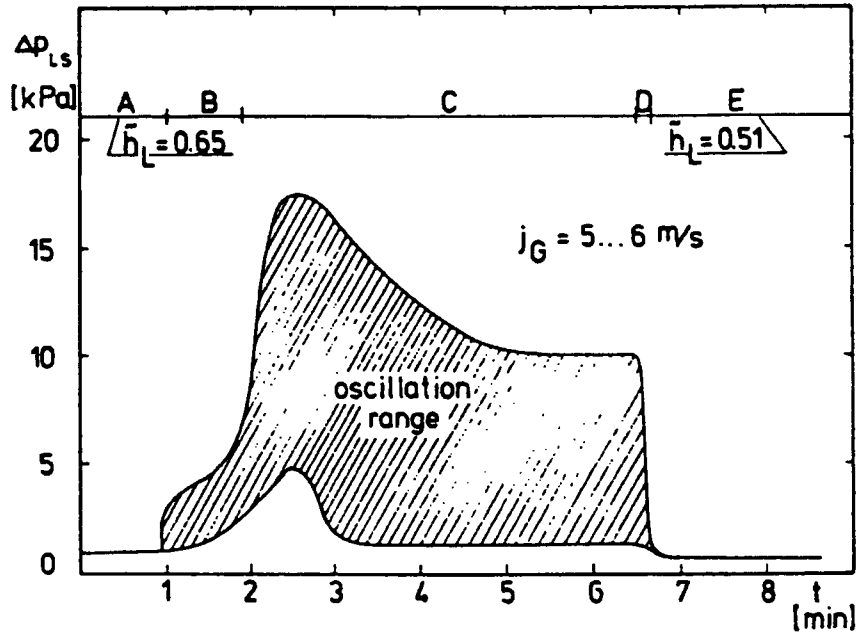


Figure 3. Pressure oscillations in the loop seal experiment (Ref. 2).

3 MODELED PIPE GEOMETRIES FOR THE SIMULATIONS

Five different nodalizations were used. All of the nodalizations had the same flow area of $0,567 \text{ m}^2$ and the same hydraulic diameter of $0,85 \text{ m}$. All of the models also had the same elevations changes of $2,9 \text{ m}$ and length between vertical pipe center lines was $6,98 \text{ m}$. Because the bottom bends of the pipe were modeled differently the straight horizontal and vertical lengths varied between the models.

The first geometry was modeled using grav terms elevation option (IELEV=0), using approximately 1 m long nodes and had its bottom bends modeled with a single 90° bent node. This geometry is presented in Figure 4 and Table 1.

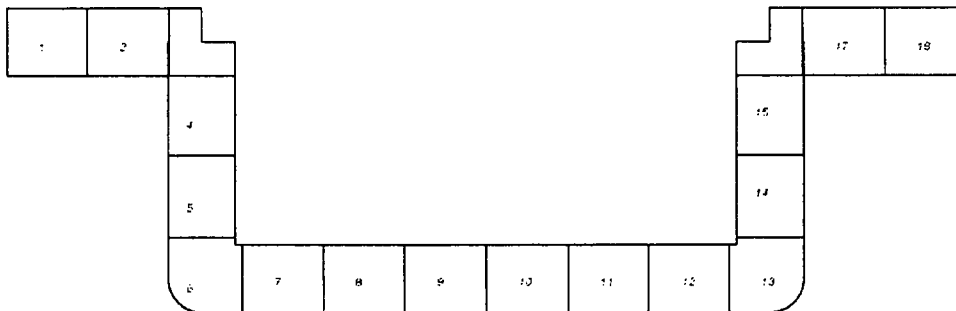


Figure 4. The model with single corner node (grav terms elevation option).

Table 1. Node geometries: Grav terms elevation option, one corner node.

Cell number	Cell volume [m ³]	Cell length [m]	Cell flow area [m ²]	Cell elevation change [m]
1	0,567	1,000	0,567	0,000
2	0,567	1,000	0,567	0,000
3	0,454	0,800	0,567	-0,400
4	0,567	1,000	0,567	-1,000
5	0,567	1,000	0,567	-1,000
6	0,567	1,000	0,567	-0,500
7	0,562	0,990	0,567	0,000
8	0,567	1,000	0,567	0,000
9	0,567	1,000	0,567	0,000
10	0,567	1,000	0,567	0,000
11	0,567	1,000	0,567	0,000
12	0,562	0,990	0,567	0,000
13	0,567	1,000	0,567	0,500
14	0,567	1,000	0,567	1,000
15	0,567	1,000	0,567	1,000
16	0,454	0,800	0,567	0,400
17	0,567	1,000	0,567	0,000
18	0,567	1,000	0,567	0,000

In the second geometry grav terms elevation option was also used, but the bottom bends were modeled with three nodes. This was one of the two nodings that were close to the original since they had the same bend radius of 1,34 m. The geometry is presented in Figure 5 and Table 2.

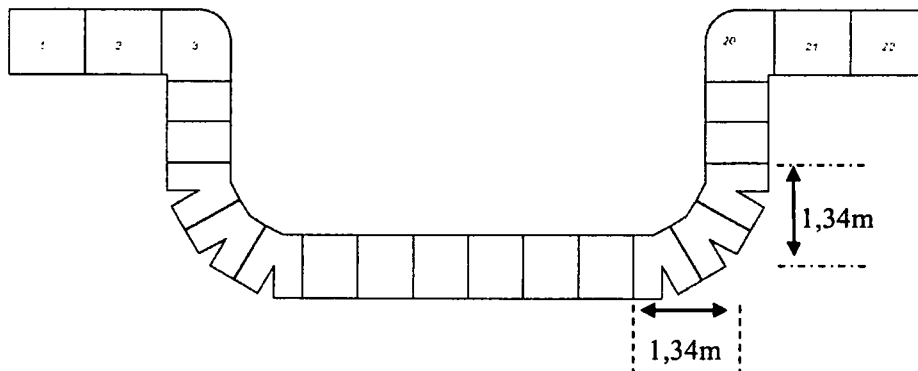


Figure 5. The model with three corner nodes (grav terms elevation option).

Table 2. Node geometries: Grav terms elevation option, three corner nodes.

Cell number	Cell volume [m ³]	Cell length [m]	Cell flow area [m ²]	Cell elevation change [m]
1	0,567	1,000	0,567	0,000
2	0,567	1,000	0,567	0,000
3	0,567	1,000	0,567	-0,500
4	0,301	0,530	0,567	-0,530
5	0,301	0,530	0,567	-0,530
6	0,407	0,718	0,567	-0,670
7	0,407	0,718	0,567	-0,491
8	0,407	0,718	0,567	-0,180
9	0,407	0,717	0,567	0,000
10	0,407	0,717	0,567	0,000
11	0,407	0,717	0,567	0,000
12	0,407	0,717	0,567	0,000
13	0,407	0,717	0,567	0,000
14	0,407	0,717	0,567	0,000
15	0,407	0,718	0,567	0,180
16	0,407	0,718	0,567	0,491
17	0,407	0,718	0,567	0,670
18	0,301	0,530	0,567	0,530
19	0,301	0,530	0,567	0,530
20	0,567	1,000	0,567	0,500
21	0,567	1,000	0,567	0,000
22	0,567	1,000	0,567	0,000

The third geometry is using cell angle elevation option (IELEV=2) and is, along with the first geometry (grav terms, one corner node), one of the simplest of the tested geometries. This geometry is presented in Figure 6 and Table 3.

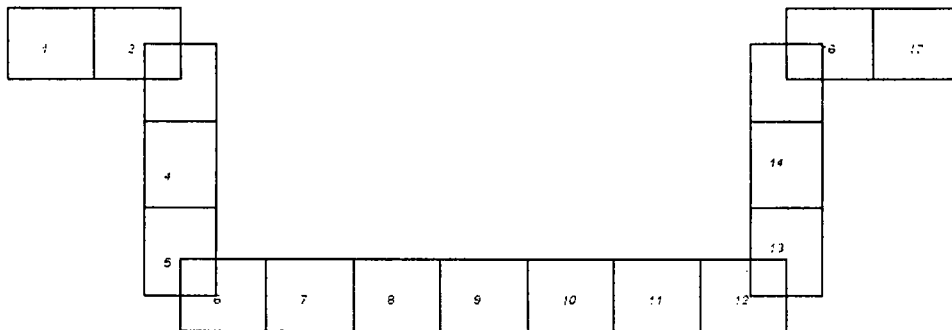


Figure 6. The model with no dedicated corner nodes (cell angle elevation option).

Table 3. Cell geometries: Cell angle elevation option, no corner node, long nodes.

Cell number	Cell volume [m ³]	Cell length [m]	Cell flow area [m ²]	Cell elevation change [m]
1	0,567	1,000	0,567	0,000
2	0,567	1,000	0,567	0,000
3	0,511	0,900	0,567	-0,900
4	0,567	1,000	0,567	-1,000
5	0,567	1,000	0,567	-1,000
6	0,562	0,990	0,567	0,000
7	0,567	1,000	0,567	0,000
8	0,567	1,000	0,567	0,000
9	0,567	1,000	0,567	0,000
10	0,567	1,000	0,567	0,000
11	0,567	1,000	0,567	0,000
12	0,562	0,990	0,567	0,000
13	0,567	1,000	0,567	1,000
14	0,567	1,000	0,567	1,000
15	0,511	0,900	0,567	0,900
16	0,567	1,000	0,567	0,000
17	0,567	1,000	0,567	0,000

Also a three corner node version was modeled using the cell angle elevation option. Along with the grav terms using three corner node version, this was closest to the test facility geometry. This geometry is presented in Figure 7 and Table 4.

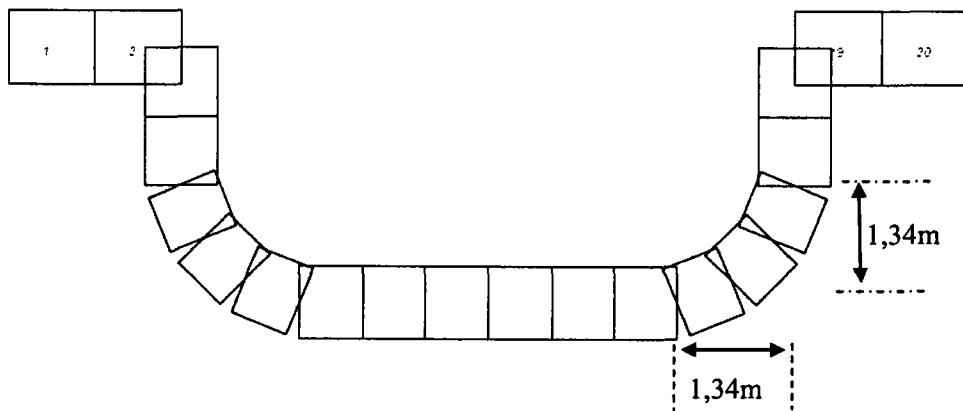


Figure 7. The model with three corner nodes (cell angle elevation option).

Table 4. Cell geometries: Cell angle elevation option, three corner nodes.

Cell number	Cell volume [m ³]	Cell length [m]	Cell flow area [m ²]	Cell elevation change [m]
1	0,567	1,000	0,567	0,000
2	0,567	1,000	0,567	0,000
3	0,443	0,780	0,567	-0,780
4	0,443	0,780	0,567	-0,780
5	0,378	0,665	0,567	-0,615
6	0,378	0,665	0,567	-0,470
7	0,378	0,665	0,567	-0,255
8	0,407	0,717	0,567	0,000
9	0,407	0,717	0,567	0,000
10	0,407	0,717	0,567	0,000
11	0,407	0,717	0,567	0,000
12	0,407	0,717	0,567	0,000
13	0,407	0,717	0,567	0,000
14	0,378	0,665	0,567	0,255
15	0,378	0,665	0,567	0,470
16	0,378	0,665	0,567	0,615
17	0,443	0,780	0,567	0,780
18	0,443	0,780	0,567	0,780
19	0,567	1,000	0,567	0,000
20	0,567	1,000	0,567	0,000

The last modeled geometry is a variation of the cell angle version without dedicated corner nodes. That version was renodalized and had most of its nodes split in three. This geometry is presented in Figure 8 and Table 5.

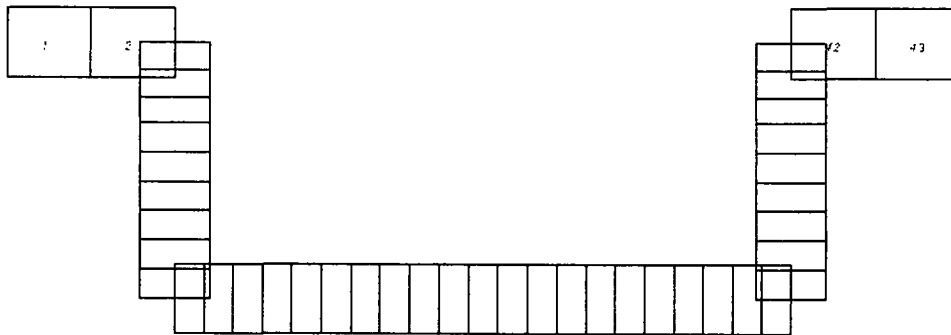


Figure 8. The model with short nodes, no dedicated corner nodes (cell angle elevation option).

Table 5. Cell geometries: Cell angle elevation option, no corner node, short nodes.

Cell number	Cell volume [m ³]	Cell length [m]	Cell flow area [m ²]	Cell elevation change [m]
1	0,567	1,000	0,567	0,000
2	0,567	1,000	0,567	0,000
3	0,170	0,300	0,567	-0,300
4	0,170	0,300	0,567	-0,300
5	0,170	0,300	0,567	-0,300
6	0,189	0,333	0,567	-0,333
7	0,189	0,333	0,567	-0,333
8	0,189	0,333	0,567	-0,333
9	0,189	0,333	0,567	-0,333
10	0,189	0,333	0,567	-0,333
11	0,189	0,333	0,567	-0,333
12	0,187	0,330	0,567	0,000
13	0,187	0,330	0,567	0,000
14	0,187	0,330	0,567	0,000
15	0,189	0,333	0,567	0,000
16	0,189	0,333	0,567	0,000
17	0,189	0,333	0,567	0,000
18	0,189	0,333	0,567	0,000
19	0,189	0,333	0,567	0,000
20	0,189	0,333	0,567	0,000
21	0,189	0,333	0,567	0,000
22	0,189	0,333	0,567	0,000
23	0,189	0,333	0,567	0,000
24	0,189	0,333	0,567	0,000
25	0,189	0,333	0,567	0,000
26	0,189	0,333	0,567	0,000
27	0,189	0,333	0,567	0,000
28	0,189	0,333	0,567	0,000
29	0,189	0,333	0,567	0,000
30	0,187	0,330	0,567	0,000
31	0,187	0,330	0,567	0,000
32	0,187	0,330	0,567	0,000
33	0,189	0,333	0,567	0,333
34	0,189	0,333	0,567	0,333
35	0,189	0,333	0,567	0,333
36	0,189	0,333	0,567	0,333
37	0,189	0,333	0,567	0,333
38	0,189	0,333	0,567	0,333
39	0,170	0,300	0,567	0,300
40	0,170	0,300	0,567	0,300
41	0,170	0,300	0,567	0,300
42	0,567	1,000	0,567	0,000
43	0,567	1,000	0,567	0,000

4 RESULTS OF THE SIMULATIONS

The inlet component had a state of 20 °C temperature and 1 bar pressure. Its void fraction was set to be 1 and the gas was fully noncondensable. The simulations initiated with a 50 second ramp from zero velocity to the currently simulated superficial velocity. Then followed a steady 650 second period when the flow was kept steady. After this the velocity was dropped back to zero and once the possible oscillations had soothed down the residual void fractions were read. After this the residual water levels were solved numerically.

Figure 9 shows the residual water levels of simulations with different geometries. In all of the cases the maximum time step was 1 ms and only the horizontal tube was filled with water. The only model that produced results that clearly differed from the rest was the simple 90° bend using grav terms elevation option (the first nodalization).

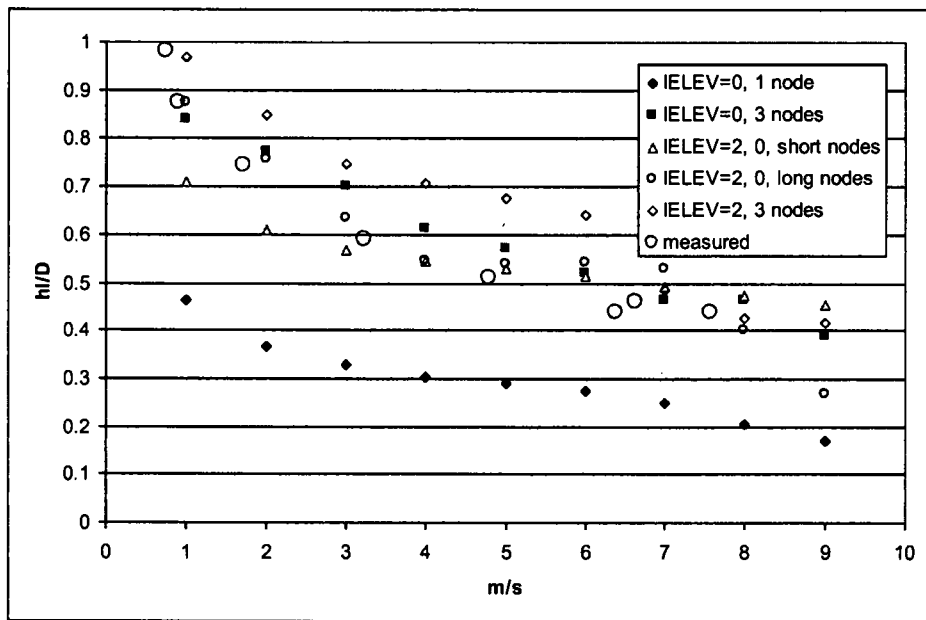


Figure 9. Residual water level with different simulated geometries.

The effect of maximum time steps (1 ms, 10 ms and 100 ms) was tested with the 90° bend model that used grav terms. All of the the results, however, turned to be identical. This same simulation was then run with the 3 corner nodes grav terms using model. The results of the latter simulation are presented in Figure 10.

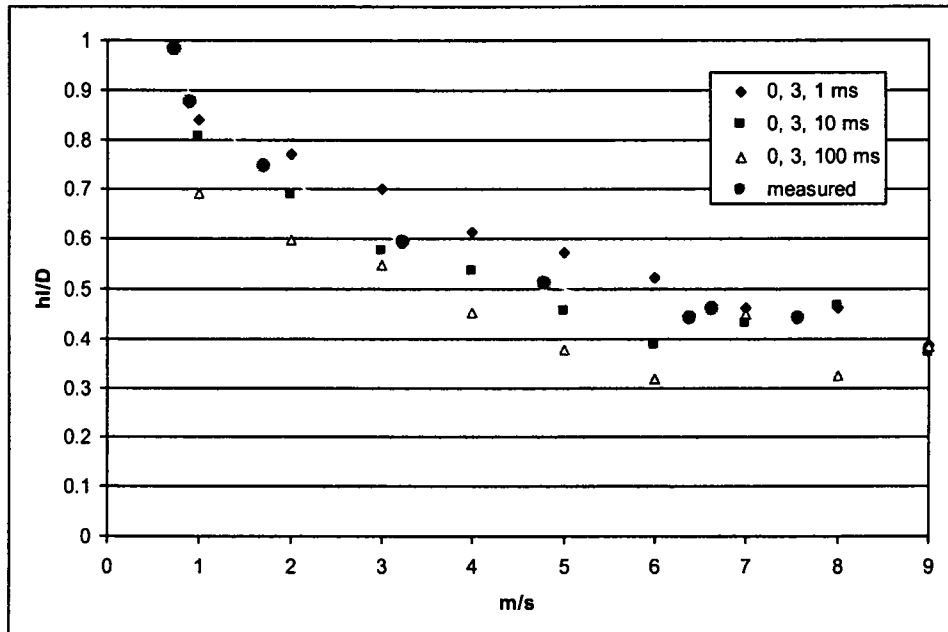


Figure 10. Residual water level. The effect different maximum time steps (IELEV=0, 3 corner nodes).

The effect of initial water level was studied with the 90° bend model that used grav terms. In the first case the loop seal was fully filled with water (zero void fraction in the vertical pipes). In the second case only the horizontal pipe was filled with water. In the third case the horizontal pipe had initial void fraction of 20%. All of the simulated cases produced identical results (Figure 11).

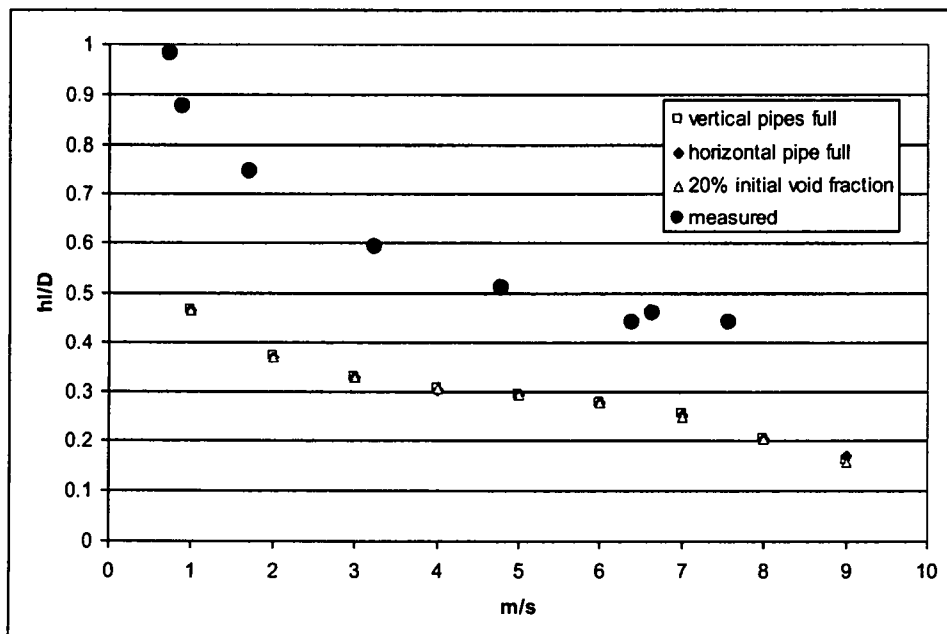


Figure 11. Residual water level. The effect of different initial water levels (IELEV=0, 1 corner node, 1 ms maximum timestep).

The pressure oscillation behaviour that was observed in the facility (Figure 3) was studied with the 90° bend and three corner node models that used grav terms. The results are presented in Figures 12 and 13. Transitions to slug flow and back to stratified flow are best seen in 5 m/s simulation of the three corner node model.

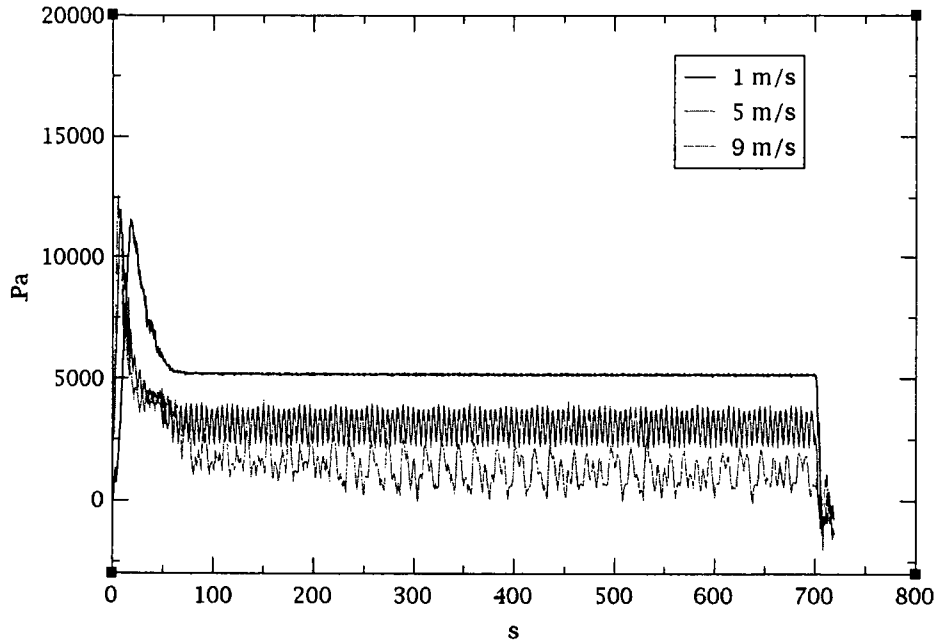


Figure 12. Pressure difference over the loop seal (IELEV=0, 1 corner node, 1 ms).

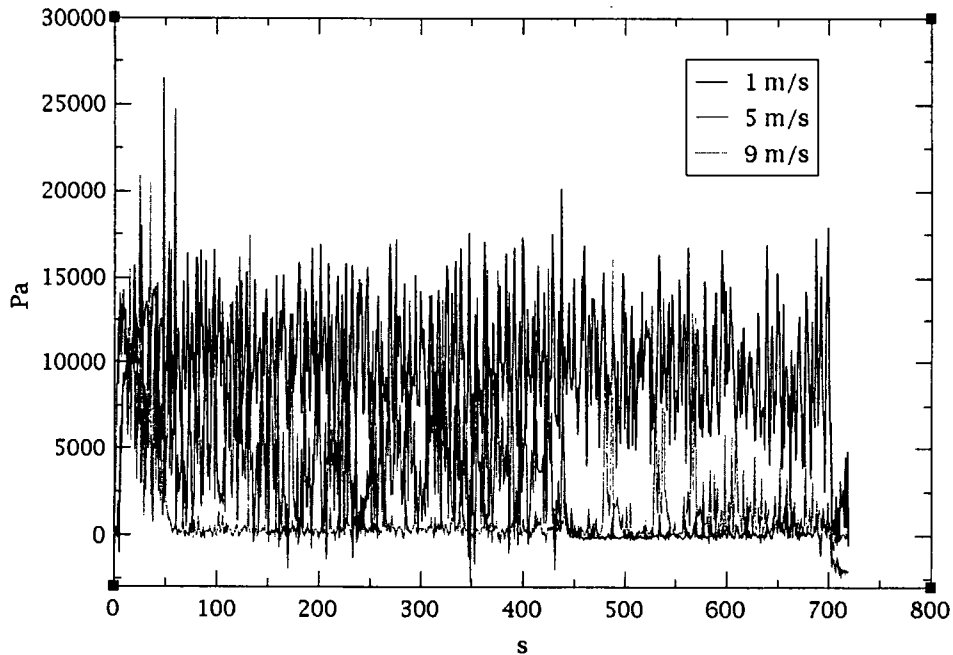


Figure 13. Pressure difference over the loop seal (IELEV=0, 3 nodes, 1 ms)

5 SUMMARY

Full scale loop seal experiments have been simulated with thermal hydraulic simulation code TRACE V5 Patch 1. Multiple nodalizations were created with different geometric accuracy. The main interest in the simulations was the residual water level in the horizontal pipe. Also pressure behaviour during the air blow to the loop seal and effects of different maximum time steps and initial liquid levels were studied.

Simulations revealed differences in results obtained with different nodalizations. Most of the nodalizations produced reasonable results except a simple 90° bend that used grav terms elevation option (namelist variable `ielev=0`). This model cleared too much water out of the loop seal. A very similar model using cell angle elevation option didn't suffer from this problem.

6 REFERENCES

- /1/ Kymäläinen O. 1992. The assesment of RELAP5/MOD2 Against IVO Loop Seal Tests. Imatran Voima Oy, Finland. NUREG/IA-0082.
- /2/ Tuomisto H., Kajanto P. 1988. TWO-PHASE FLOW IN A FULL SCALE LOOP SEAL FACILITY. Nuclear Engineering and Design 107 295-305.

<p>NRC FORM 335 (9-2004) NRCMD 3.7</p> <p style="text-align: center;">U.S. NUCLEAR REGULATORY COMMISSION</p> <p style="text-align: center;">BIBLIOGRAPHIC DATA SHEET <i>(See instructions on the reverse)</i></p>	<p>1. REPORT NUMBER (Assigned by NRC, Add Vol., Supp., Rev., and Addendum Numbers, if any.) NUREG/IA-0403</p>				
<p>2. TITLE AND SUBTITLE Full Scale Loop Seal experiments with TRACE V5 Patch 1</p>	<p>3. DATE REPORT PUBLISHED</p> <table border="1"> <tr> <td style="text-align: center;">MONTH</td> <td style="text-align: center;">YEAR</td> </tr> <tr> <td style="text-align: center;">December</td> <td style="text-align: center;">2011</td> </tr> </table> <p>4. FIN OR GRANT NUMBER</p>	MONTH	YEAR	December	2011
MONTH	YEAR				
December	2011				
<p>5. AUTHOR(S) Seppo Hillberg</p>	<p>6. TYPE OF REPORT Technical</p> <p>7. PERIOD COVERED <i>(Inclusive Dates)</i></p>				
<p>8. PERFORMING ORGANIZATION - NAME AND ADDRESS <i>(If NRC, provide Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address; if contractor, provide name and mailing address.)</i> VTT – Technical Research Centre of Finland Nuclear Power Plant Modelling P.O.B. 1000 02044 VTT, Finland</p>					
<p>9. SPONSORING ORGANIZATION - NAME AND ADDRESS <i>(If NRC, type "Same as above"; if contractor, provide NRC Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address.)</i> Division of Systems Analysis Office of Nuclear Regulatory Research U.S. Nuclear Regulatory Commission Washington, DC 20555-0001</p>					
<p>10. SUPPLEMENTARY NOTES A. Calvo, NRC Project Manager</p>					
<p>11. ABSTRACT <i>(200 words or less)</i> Full scale loop seal experiments have been simulated with thermal hydraulic simulation code TRACE V5 Patch 1. Multiple nodalizations were created different geometric accuracy. The main interest in the simulations was the residual water level in the horizontal pipe. Also pressure behaviour during the air blow to the loop seal and effects of different maximum time steps and initial liquid levels were studied.</p> <p>Simulations revealed differencies in results obtained with different nodalizations. Most of the nodalizations produced reasonable results except a simple 90° bend that used grav terms elevation option (namelist variable ielev=0). This mode cleared too much water out of the loop seal. A very similar model using cell angle elevation option didn't suffer from this problem.</p>					
<p>12. KEY WORDS/DESCRIPTORS <i>(List words or phrases that will assist researchers in locating the report.)</i> TRACE V5 Patch 1 VTT – Technical Research Centre of Finland Finland Code Applications Maintenance Program (CAMP) VVER-1000 Two-Phase Flow in a Full-Scale Loop Seal Facility Loop Seal Facility tests Loss of Coolant (LOCA) Tuomisto and Kajanto</p>	<p>13. AVAILABILITY STATEMENT unlimited</p> <p>14. SECURITY CLASSIFICATION</p> <p><i>(This Page)</i> unclassified</p> <p><i>(This Report)</i> unclassified</p> <p>15. NUMBER OF PAGES</p> <p>16. PRICE</p>				



Federal Recycling Program



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, DC 20555-0001

OFFICIAL BUSINESS