




REACTOR BUILDINGS

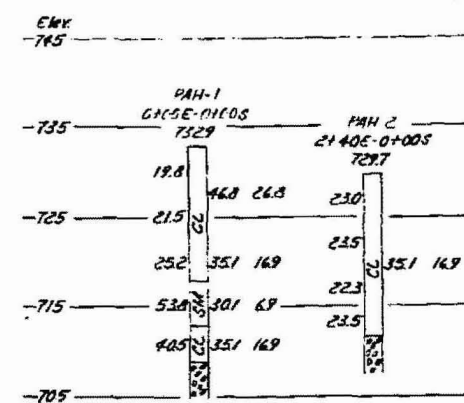


PLANT BUILDINGS

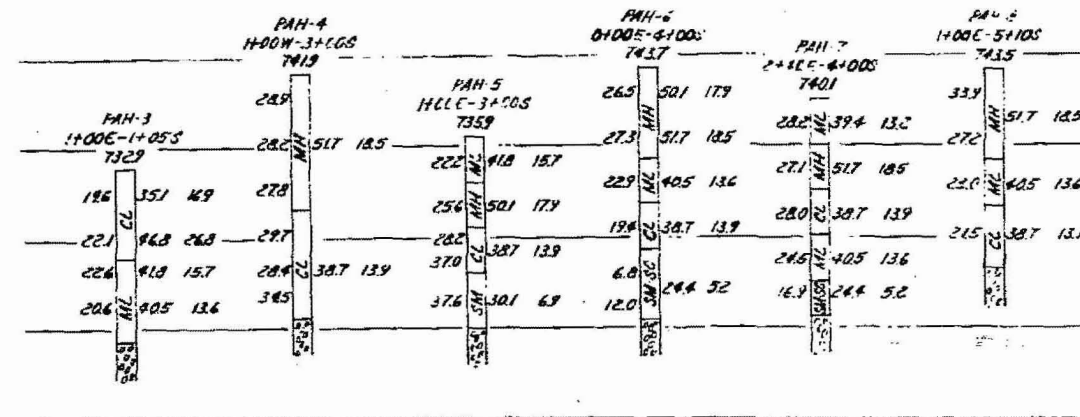


TRANSFORMER YARD & 500 KV SWITCHYARD

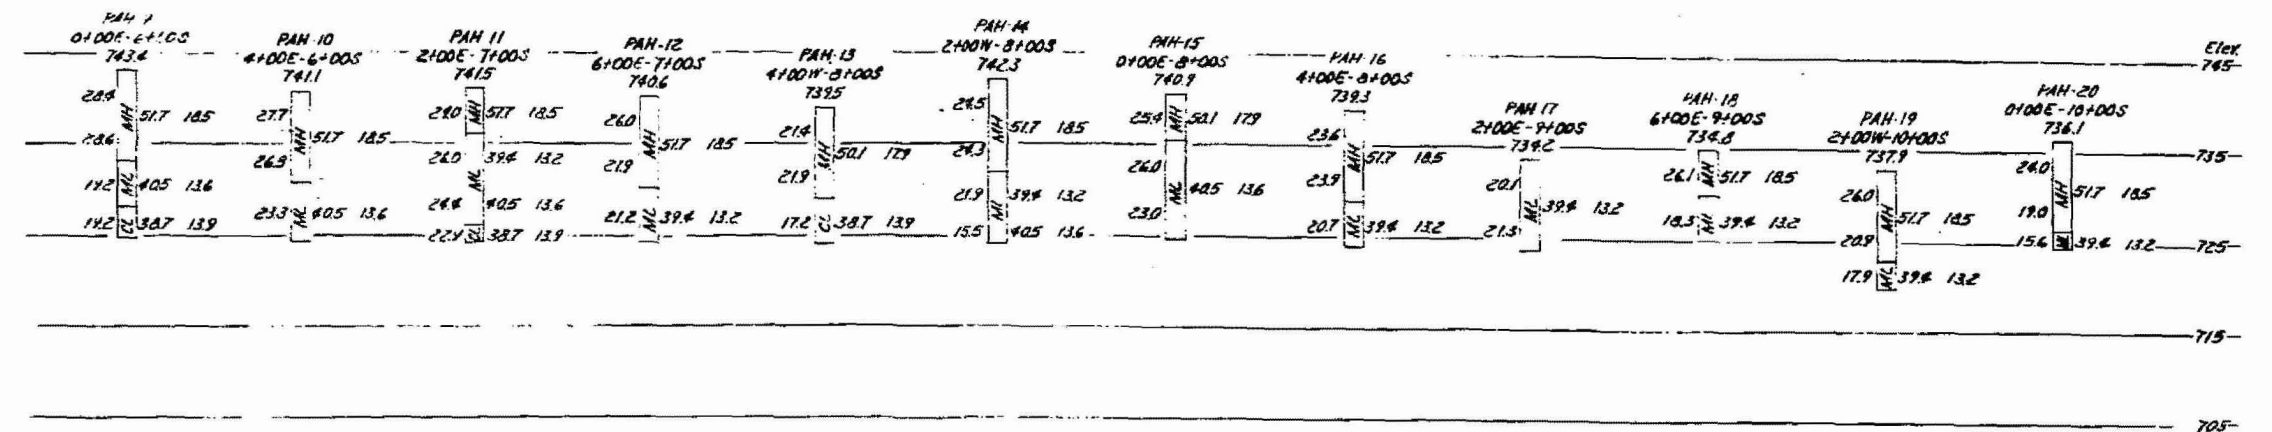


COOLING TOWERS

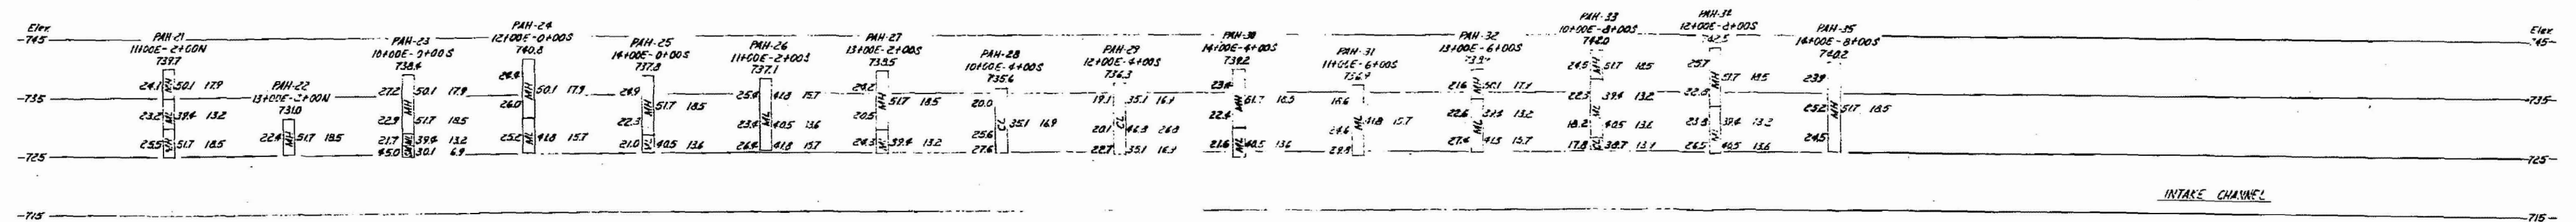

INTAKE CHANNEL

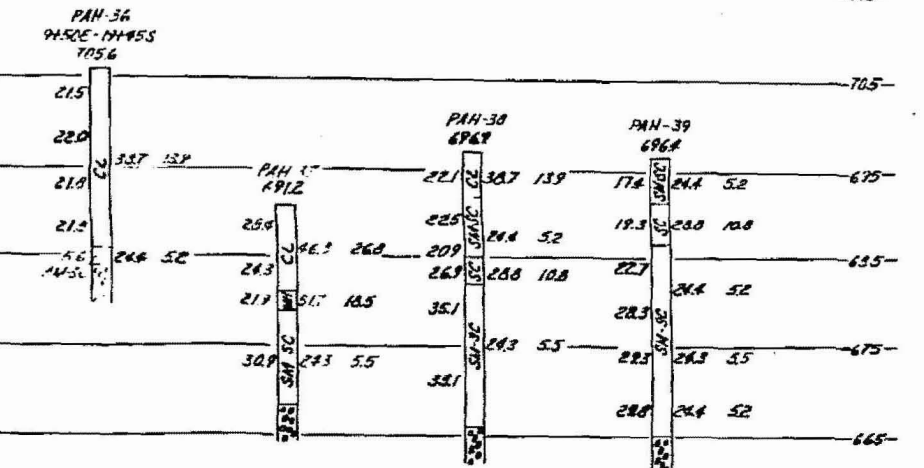

LEGEND

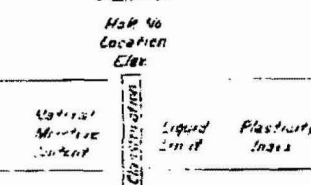

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

BORROW INVESTIGATION

Figure 2.5-222