


33

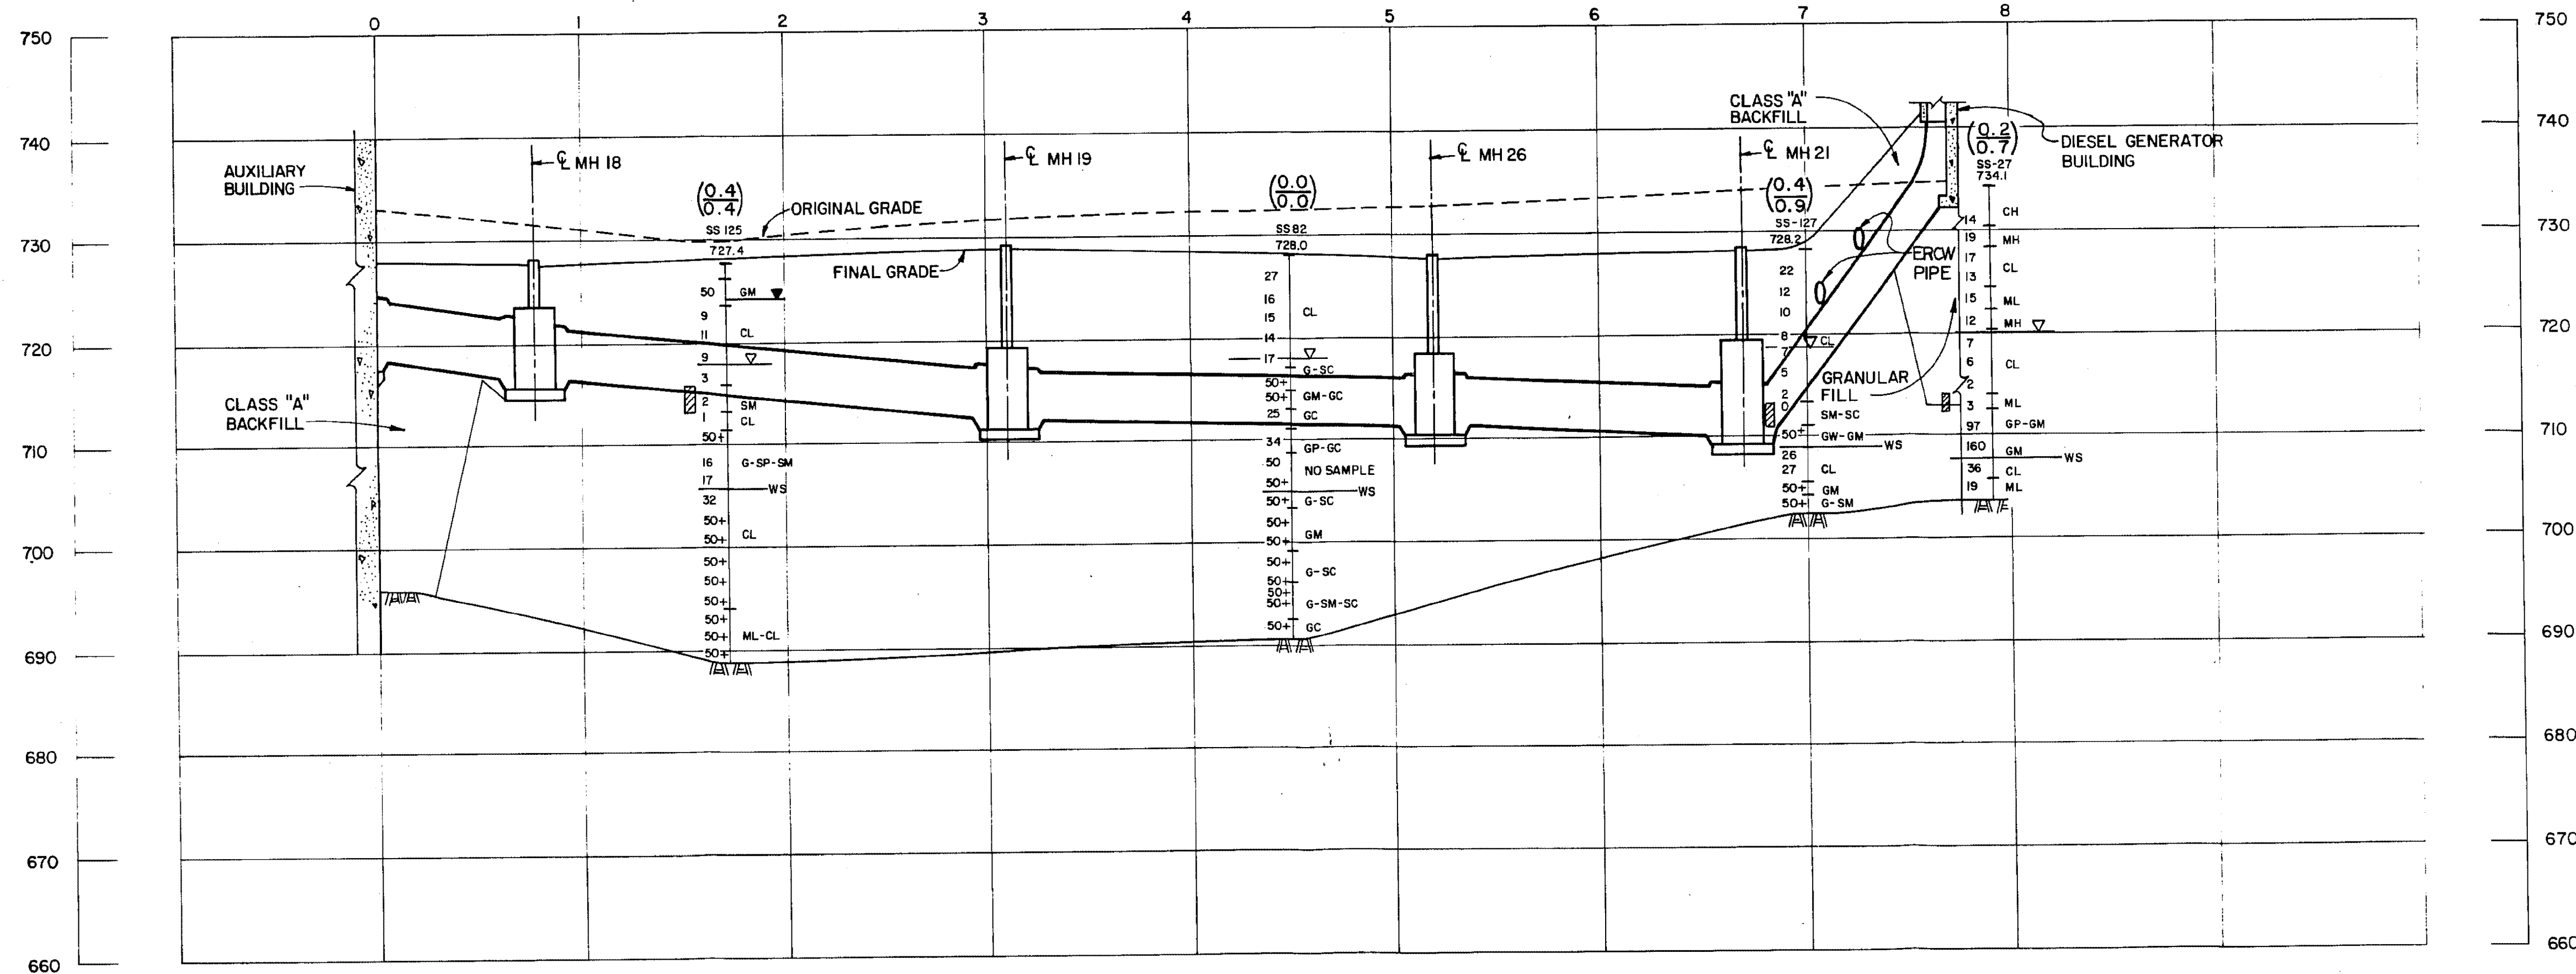

G-G

POTENTIAL SETTLEMENT BASED ON 1.5 %  $\epsilon$  CRITERIA (INCHES)  
 (0.2)  
 (0.7) POTENTIAL SETTLEMENT BASED ON 6 %  $\epsilon$  CRITERIA (INCHES)

▽ DESIGN WATER TABLE  
 ▼ WATER TABLE (24 HR)  
 MH SOIL CLASSIFICATION  
 13 BLOW COUNT  
 ▨ POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)  
 -WS WEATHERED SHALE

NOTE:  
 1. LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.4g AND SEED - IDRISS (1971) CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT  
 FINAL SAFETY  
 ANALYSIS REPORT

CATEGORY I ELECTRICAL CONDUITS  
 SECTION G-G  
 FIGURE 2.5-577