


57

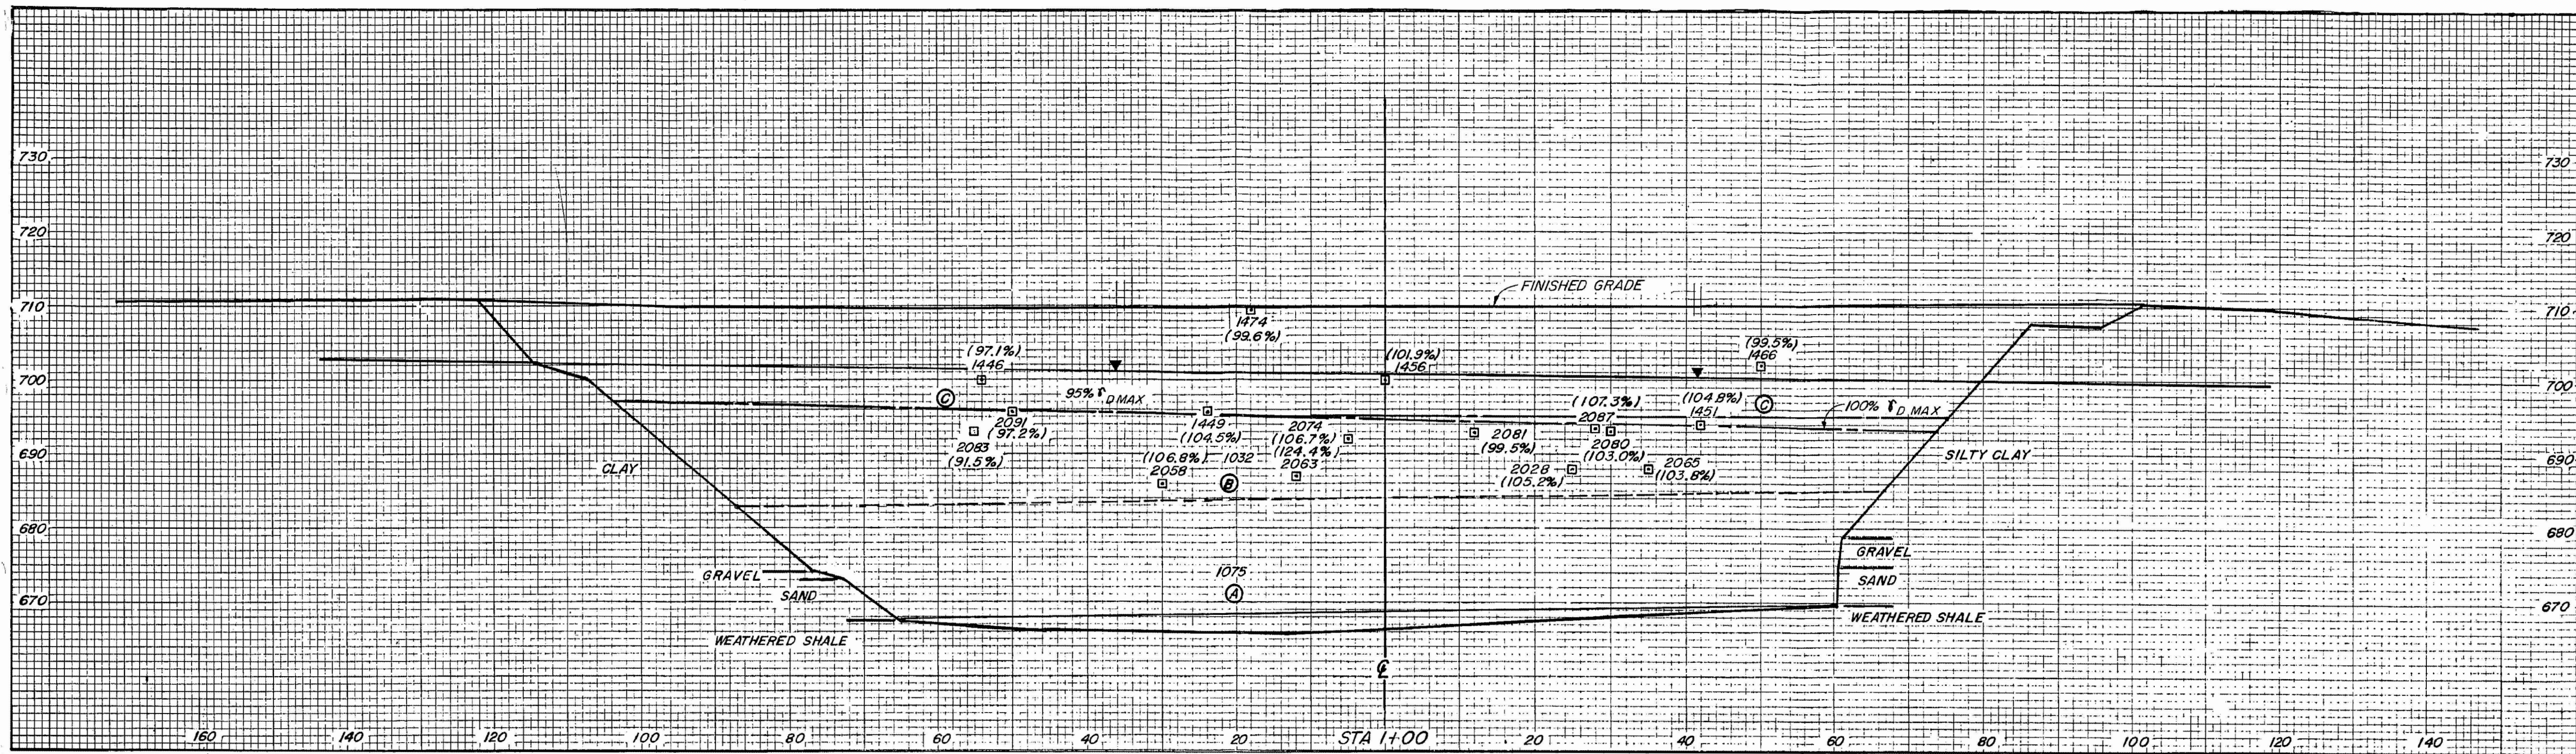

ADDED BY AMENDMENT 59

NO.	DATE	BY	FOR
103	10/23/59	...	...
YARD			
UNDERGROUND BARRIER			
TRENCH B			
STA 1+00			
WATTS BAR NUCLEAR PLANT			
TENNESSEE VALLEY AUTHORITY			
DIVISION OF ENGINEERING DESIGN			
DESIGNED	CHECKED	APPROVED	
...	...	...	
KNOXVILLE		FSAR 2.5-602 RO	