

DPG 12-197

March 29, 2012

U.S. Nuclear Regulatory Commission Document Control Desk Washington, DC 20555

Docket No. 50-312 Rancho Seco Nuclear Generating Station License No. DPR-54

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT FOR 2011

Attention: John Hickman

In accordance with 10 CFR 50.36a(a)(2) and Rancho Seco Quality Manual, Appendix A, Section 1.5.3, we are submitting the Rancho Seco 2011 Annual Radioactive Effluent Release Report for the period of January 1 through December 31, 2011.

If you or members of your staff have questions requiring additional information or clarification, please contact me at (916) 732-4817.

Sincerely,

Einar T. Ronningen

Superintendent, Rancho Seco Assets


cc with attachment: NRC, Region IV

Attachment: Rancho Seco Annual Radioactive Effluent Release Report for 2011

TSHE20

RANCHO SECO NUCLEAR GENERATING STATION

LICENSE NUMBERS DPR-54 and SNM-2510

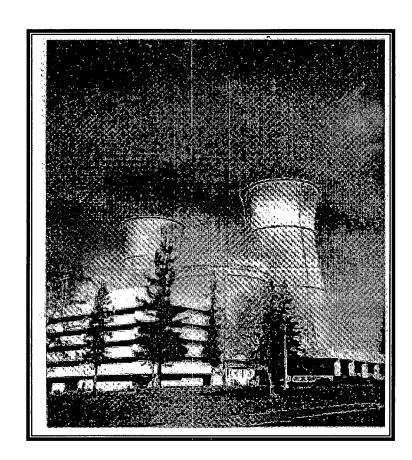

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT

JANUARY - DECEMBER 2011

TABLE OF CONTENTS

INTR	ODUCTION	1
i.	SUPPLEMENTAL INFORMATION	2 3 4 5
H.	ESTIMATION OF ERROR	6
III.	GASEOUS EFFLUENTS TABLE III-A: GASEOUS EFFLUENTS - SUMMATION OF ALL RELEASES TABLE III-B: GASEOUS EFFLUENTS - GROUND LEVEL RELEASES TABLE III-C: GASEOUS EFFLUENTS - TYPICAL LOWER LIMITS OF DETECTION TABLE III-D: RADIOLOGICAL IMPACT ON MAN DUE TO GASEOUS EFFLUENT RELEASES	8 9 10
IV.	LIQUID EFFLUENTS	13 14 15
V.	SOLID WASTE	17

ATTACHMENTS

None

INTRODUCTION

Rancho Seco Nuclear Generating Station (RSNGS) Unit No. 1 is located in Sacramento County, California approximately 25 miles southeast of Sacramento and 26 miles north-northeast of Stockton. Rancho Seco Unit No. 1 began commercial operation on April 17, 1975. The single unit on the Rancho Seco site was a pressurized water reactor supplied by Babcock and Wilcox. The rated capacity was 913 megawatts electrical. Because of a public vote on June 6, 1989, Sacramento Municipal Utility District (SMUD) shutdown the Rancho Seco Nuclear Generating Station and completed defueling operations on December 8, 1989. Transfer of the spent fuel rod assemblies from the Spent Fuel Pool into dry storage at the Independent Spent Fuel Storage Installation (ISFSI) was completed on August 21, 2002. Radiological dismantlement of the nuclear facility was completed in December 2008 and the release of the Rancho Seco property, except for the area associated with the Interim Onsite Storage Installation (IOSB), from NRC license DPR-54 was approved on September 25, 2009. With the completion of Phase I of decommissioning, the facility is in a SAFSTOR-type condition awaiting a suitable disposal option for the low-level radioactive waste in storage in the IOSB.

This Annual Radioactive Effluent Release Report (ARERR) provides a summary of gaseous and liquid effluent releases made from Rancho Seco during the period of January 1 through December 31, 2011. This report also provides a summary of solid radioactive waste shipments during the reporting period.

In the current condition, there are no radioactive liquids or liquid systems at the facility, and all solid material is stored in containers designed for shipping the material. Therefore, there is no projected need to process or otherwise handle the material in storage at the Rancho Seco facility and therefore little probability that any material would be released from the facility in liquid or gaseous effluents. Accordingly, there were no radioactive liquid or gaseous effluent releases made from Rancho Seco during the reporting period. In addition, no shipments of solid radioactive waste were made during the reporting period.

This report has been prepared by SMUD to meet the requirements of Rancho Seco Quality Manual (RSQM), Appendix A, Section 1.5.3 and Offsite Dose Calculation Manual (ODCM) Revision 23, Step 6.12. It is presented in accordance with the format of USNRC Regulatory Guide 1.21. Radiation doses associated with radioactive effluents in liquids and gasses would be calculated for a hypothetical individual who receives the maximum possible exposure at or beyond the applicable Site Boundary, had any releases occurred.

Since there were no releases of radioactivity in gaseous and liquid effluents during this report period, the limits of 10 CFR 20 were not exceeded, nor were the numerical guidelines of 10 CFR 50, Appendix I exceeded. A 40 CFR 190 dose evaluation is not required because radioactive effluent releases did not exceed twice the numerical guidelines of 10 CFR 50, Appendix I.

I. SUPPLEMENTAL INFORMATION

A. Regulatory Limits & Guidelines for Effluent Releases

1. Gaseous Effluents

 Dose rate limit at or beyond the Site Boundary for Gaseous Effluents for Tritium and radioactive material in particulate form with half-lives greater than 8 days (ODCM Technical Requirement 6.9.3):

1500 mrem/year to any organ

- Dose commitment to a member of the public at or beyond the Site Boundary for Gaseous Effluents from Tritium and radioactive material in particulate form with half-lives greater than 8 days (ODCM Technical Requirement 6.9.4, numerical guidelines of 10 CFR 50, Appendix I):
 - 7.5 mrem per calendar quarter to any organ
 - 15 mrem per calendar year to any organ

2. Liquid Effluents

- a. The concentration of radioactive material in liquid effluents released beyond the Site Boundary for Liquid Effluents shall not exceed the limits of 10 CFR 20, Appendix B, Table 2, Column 2.
- b. Dose commitment to a member of the public at or beyond the Site Boundary for Liquid Effluents from radioactive materials in liquid effluents shall be limited to (numerical guidelines of 10 CFR 50, Appendix I):
 - 1.5 mrem per calendar quarter to the total body
 - 5 mrem per calendar quarter to any organ
 - 3 mrem per calendar year to the total body
 - 10 mrem per calendar year to any organ

NOTE: The noble gas source term was removed when spent fuel transfer to the ISFSI was completed in August 2002. Reference to noble gases was completely removed from the ODCM.

B. Maximum Effluent Concentrations

1. Gaseous Effluents

The concentrations listed in 10 CFR 20, Appendix B, Table 2, Column 1 (air) are not directly used in calculations for determining permissible gaseous effluent release rates. The annual dose limits of 10 CFR 20 for unrestricted areas are the doses associated with the concentrations of 10 CFR 20, Appendix B, Table 2, Column 1. ODCM Technical Requirement dose rate limits (mrem/yr) for gaseous effluents are provided to ensure that the dose rate from gaseous effluents at any time at the Site Boundary for Gaseous Effluents will be within the annual dose limits of 10 CFR 20 for unrestricted areas. These dose rate limits (listed above in part A) are used for determining permissible gaseous effluent release rates.

2. Liquid Effluents

The concentration values listed in 10 CFR 20, Appendix B, Table 2, Column 2 are used in calculations to determine permissible liquid discharge flow rates. The most conservative Maximum Effluent Concentration (MEC) value for each radionuclide detected in the liquid effluent sample is used in the calculations.

C. Measurement Methods for Total Radioactivity

The methods listed below are examples should radioactive effluents be discharged.

1. Gaseous Effluents

Liquid Scintillation (H-3)

Gamma Spectroscopy (HPGe)

Beta Proportional (Sr-90, gross beta)

Alpha Proportional (gross alpha)

2. Liquid Effluents

Gamma Spectroscopy (HPGe)

Liquid Scintillation (H-3)

Beta Proportional (Sr-90, gross beta)

Alpha Proportional (gross alpha)

NOTE: HPGe refers to Hyper-Pure Germanium

D. Batch Releases (via monitored pathways)

1.	Liqui	d Discharges	Quarter 1	Quarter 2	Quarter 3	Quarter 4
	a.	Number of batch releases	0	0	0	0
	b. releas	Total time period for batch ses (hours)	N/A	N/A	N/A	N/A
	c. batch	Maximum time period for a release (hours)	N/A	N/A	N/A	N/A
	d. batch	Average time period for a release (hours)	N/A	N/A	N/A	N/A
	e. batch	Minimum time period for a release (hours)	N/A	N/A	N/A	N/A
	f. (cfs)	Average Plant Effluent Flow	N/A	N/A	N/A	N/A

E. Unplanned Releases This section describes unplanned releases of radioactivity in liquid and gaseous effluent. Gaseous None Liquid None

F. Radioactive Effluent Monitoring Instrumentation Inoperable for Greater Than 30 Days
None

II. ESTIMATION OF ERROR

The methods for establishing error estimates included review of applicable station procedures, inspection of sampling equipment, engineering estimates, statistical applications, review of calibration setpoint data, and communication with plant personnel. The various sources of error (s) in reported values of gaseous effluents, liquid effluents, and solid waste are assumed to be independent, and thus the total error is calculated according to the formula:

Total Error =
$$\sqrt{\sigma_1^2 + \sigma_2^2 + \sigma_3^2 \dots + \sigma_i^2}$$

where: σ_i = relative error associated with component i

Sources of error for gaseous effluents include fan error (flow), grab sampling, collection, filter efficiency, counting, and calibration.

Sources of error for liquid effluents include collection container volume, dilution water flow rate, grab sampling, counting, and calibration.

Sources of error for solid waste include offsite lab smear analysis, dose rate meter calibration, dose rate meter reading, computer program dose-to-curie calculation, sample volume measurement, gamma spec counting, gamma spec calibration, and waste volume determination.

III. GASEOUS EFFLUENTS

Table III-A, Gaseous Effluents - Summation of All Releases, provides a detailed summary of gaseous effluent releases per quarter. This table summarizes releases of tritium and particulates with half-lives greater than 8 days. The methodology used to calculate the Percent of ODCM Technical Requirement limit is as follows:

% Tech Req Limit =
$$\frac{\sum_{i} [(F_i)(Avg Rel Rate)(X/Q)(Dose Factor)]}{(Dose Rate Limit)} \times 100\%$$

where:

Fi = The fraction of the total number of Curies of nuclide i out of the total curies in that category for that quarter (unitless).

NOTE: F_i always equals 1.0 for H-3 because it is the only nuclide in the category.

Avg Rel Rate =
$$\frac{\left(\text{Total Curies per category per quarter}\right)\left(\frac{1 \text{ E} + 06 \,\mu\text{Ci}}{\text{Ci}}\right)}{\left(\text{\# seconds in the quarter}\right)}$$

X/Q = A default dispersion factor determined to be conservative when compared to the use of actual data (sec/m3).

Dose Factor = The values derived for each nuclide i from NRC Regulatory Guide 1.109 (Ki, Li+1.1Mi, or Raij). [Units in (mrem/yr)/(μCi/m3)]

Dose Rate Limit = The Technical Requirement (i.e., Regulatory) limits for dose rate listed in Section I of this report (mrem/yr).

NOTE: Particulates with half-lives less than 8 days are not included in this calculation.

The methodology used to calculate the Estimated Total Error (%) in Table III-A is presented in Section II of this report.

Table III-B, Gaseous Effluents - Ground Level Releases, provides a complete quarterly summary of the amount of radioactivity (Ci) released per radionuclide in each quarter. Data from continuous and batch releases are provided for particulates and tritium. Data reported for batch releases results only from unplanned releases.

Table III-C, Gaseous Effluents - Typical Lower Limits of Detection, provides a listing of the typical lower limit of detection (LLD) concentrations in µCi/cc for various radionuclides.

Table III-D, Radiological Impact on Man Due to Gaseous Effluent Releases, provides a summary of calculated radiation doses delivered to a maximum exposed hypothetical individual at the Site Boundary for Gaseous Effluents (actual doses will be assessed in the 2011 Annual REMP Report). The maximum calculated organ dose is listed for each quarter along with an annual total. The direct radiation dose results, based on monitoring badge dosimetry, are also listed. Presented in this table for each category is a comparison versus ODCM Technical Requirement dose limits with the exception of direct radiation measurements.

TABLE III-A: GASEOUS EFFLUENTS - SUMMATION OF ALL RELEASES

			<u>Unit</u>	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Est. Total Error, %
A.	Part	iculates						
	1.	Particulates with half-lives>8 days	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	N/A
	2.	Average Release Rate for period	μCi/sec	0.00E+00	0.00E+00	0.00E+00	0.00E+00	
	3.	Percent of Tech Req limit	%	N/A	N/A	N/A	N/A	
	4.	Gross Alpha radioactivity	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	
В.	Triti	um						
	1.	Total Release	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	N/A
	2.	Average Release Rate for period	μCi/sec	0.00E+00	0.00E+00	0.00E+00	0.00E+00	
	3.	Percent of Tech Req limit	%	N/A	N/A	N/A	N/A	

TABLE III-B: GASEOUS EFFLUENTS - GROUND LEVEL RELEASES

Nuclides Released

1. Particulates

None

2. Tritium

None

TABLE III-C: GASEOUS EFFLUENTS - TYPICAL LOWER LIMITS OF DETECTION

RADI	<u>ONUCLIDES</u>	LLD (µCi/cc)
1.	Tritium (H-3)	2.27 E-10
2.	Particulates:	
	Manganese-54 Cobalt-58 Iron-59 Cobalt-60 Strontium-89 Strontium-90 Cesium-134 Cesium-137 Barium-140 Cerium-141	2.08 E-12 2.29 E-12 5.89 E-12 3.11 E-12 2.00 E-15 5.00 E-15 1.52 E-12 1.88 E-12 3.06 E-12 1.15 E-12
	Cerium-144	3.69 E-12

TABLE III-D: RADIOLOGICAL IMPACT ON MAN DUE TO GASEOUS EFFLUENT RELEASES

CALCULATED RADIATION DOSES AT THE SITE BOUNDARY FOR GASEOUS EFFLUENTS:

		<u>Unit</u>	Quarter 1	Quarter 2	Quarter 3	Quarter 4	2011 <u>Annual</u>
A.	Tritium, Particulate						
1.	Maximum Organ Dose	mrem	0.00 E+00				
2.	Percent Tech Req limit	%	N/A	N/A	N/A	N/A	N/A
В.	Direct Radiation						
1.	Dose (Monitoring Badges) ¹	mrem	0.00 E+00				
2.	Percent of Tech Req limit	%	N/A	N/A	N/A	N/A	N/A

NOTE: No releases of gaseous radioactive effluent were made from Rancho Seco Nuclear Generating Station in 2011.

¹ None of the Indicator stations indicate significant radiation attributable to facility operations.

IV. LIQUID EFFLUENTS

Table IV-A, Liquid Effluents - Summation of All Releases, provides a detailed summary of liquid effluent releases per quarter. This table summarizes releases of fission and activation products, tritium, dissolved and entrained gases, and gross alpha radioactivity. Also listed is the volume of waste released prior to dilution and the volume of dilution water used during each quarter.

The following methodology is used to calculate the Average Diluted Concentration and the Percent of ODCM Technical Requirement Limit in Table IV-A:

% Tech Req Limit =
$$\sum_{i}^{n} \left[\frac{C_{i}}{MEC_{i}} \right]$$

where:

n = The total number of radionuclides identified

C_i = The average diluted concentration of radionuclide i

$$= \frac{\text{(Total Release per Category per Quarter in } \mu\text{Ci)}}{\text{(Total Release Volume (part F in Table IV - A) in ml)}}$$

MEC_i = The MEC of the ith radionuclide, from 10 CFR 20, Appendix B, Table 2, Column 2

The methodology used to calculate the estimated total error in Table IV-A is presented in Section II of this report.

Table IV-B, Liquid Effluents, provides a complete quarterly summary of the amount of radioactivity (Ci) released per radionuclide in each quarter. Data is provided for fission and activation products, and for dissolved and entrained gases. Tritium and gross alpha are not included in this table (they are listed in Table IV-A). Since no continuous releases of liquid radioactive effluent are made from RSNGS, data is provided only for batch releases.

Table IV-C, Liquid Effluents - Typical Lower Limits of Detection, provides a listing of the typical lower limit of detection (LLD) concentrations in μ Ci/ml for various radionuclides.

Table IV-D, Radiological Impact on Man Due To Liquid Effluent Releases, provides a summary of calculated radiation doses delivered to a maximum exposed hypothetical individual at the Site Boundary for Liquid Effluents (actual doses will be assessed in the 2011 Annual REMP Report). The maximum calculated total body dose and organ dose are listed for each quarter along with an annual total. A comparison versus ODCM Technical Requirement dose limits is also presented.

TABLE IV-A: LIQUID EFFLUENTS - SUMMATION OF ALL RELEASES

	<u>Unit</u>	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Est. Total <u>Error, %</u>
A. Fission & Activation Products						
1. Total Release (not including tritium, gases, alpha)	Ci	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00	N/A
2. Average diluted concentration during period	μCi/ml	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00	
3. Percent of Tech Req limit	%	N/A	N/A	N/A	N/A	
B. Tritium						
1. Total Release	Ci	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00	N/A
2. Average diluted concentration during period	μCi/ml	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00	
3. Percent of Tech Req limit	%	N/A	N/A	N/A	N/A	
C. Dissolved and Entrained Gases						
1. Total Release	Ci	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00	N/A
2. Average diluted concentration during period	μCi/ml	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00	
D. Gross Alpha radioactivity						
1. Total Release	Ci	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00	N/A
E. Volume of Waste Released (prior to dilution)	Liters	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00	N/A
F. Volume of dilution water used during period	Liters	N/A	N/A	N/A	N/A	N/A

TABLE IV-B: LIQUID EFFLUENTS

Nuclides Released

 Fission and activation products (excluding tritium, gross alpha)
 None

2. <u>Dissolved and entrained gases</u>

None

NOTE: No releases of liquid radioactive effluent were made from Rancho Seco Nuclear Generating Station in 2011.

TABLE IV-C: LIQUID EFFLUENTS - TYPICAL LOWER LIMITS OF DETECTION

1. Tritium (H-3) 2.60 E-06 2. Particulates: Manganese-54 2.11 E-09 Iron-59 3.71 E-09 Cobalt-57 2.12 E-09 Cobalt-58 1.93 E-09 Cobalt-60 1.98 E-09 Zinc-65 4.34 E-09 Strontium-90 5.00 E-10 Ruthenium-106 1.79 E-08 Silver-110m 1.94 E-09 Antimony-125 5.78 E-09 Cesium-134 1.93 E-09 Cesium-136 2.23 E-09 Cesium-137 2.30 E-09 Barium-140 7.75 E-09 Cerium-141 3.60 E-09		RADIONUCLIDES	BATCH MODE: LLD (µCi/ml)
Manganese-542.11 E-09Iron-593.71 E-09Cobalt-572.12 E-09Cobalt-581.93 E-09Cobalt-601.98 E-09Zinc-654.34 E-09Strontium-905.00 E-10Ruthenium-1061.79 E-08Silver-110m1.94 E-09Antimony-1255.78 E-09Cesium-1341.93 E-09Cesium-1362.23 E-09Cesium-1372.30 E-09Barium-1407.75 E-09Cerium-1413.60 E-09	1.	Tritium (H-3)	2.60 E-06
Iron-59 3.71 E-09 Cobalt-57 2.12 E-09 Cobalt-58 1.93 E-09 Cobalt-60 1.98 E-09 Zinc-65 4.34 E-09 Strontium-90 5.00 E-10 Ruthenium-106 1.79 E-08 Silver-110m 1.94 E-09 Antimony-125 5.78 E-09 Cesium-134 1.93 E-09 Cesium-136 2.23 E-09 Cesium-137 2.30 E-09 Barium-140 7.75 E-09 Cerium-141 3.60 E-09	2.	Particulates:	
Cerium-144 1.59 E-08		Iron-59 Cobalt-57 Cobalt-58 Cobalt-60 Zinc-65 Strontium-90 Ruthenium-106 Silver-110m Antimony-125 Cesium-134 Cesium-136 Cesium-137 Barium-140	3.71 E-09 2.12 E-09 1.93 E-09 1.98 E-09 4.34 E-09 5.00 E-10 1.79 E-08 1.94 E-09 5.78 E-09 1.93 E-09 2.23 E-09 2.30 E-09 7.75 E-09

TABLE IV-D: RADIOLOGICAL IMPACT ON MAN DUE TO LIQUID EFFLUENT RELEASES

CALCULATED RADIATION DOSE COMMITMENTS FOR LIQUID EFFLUENTS:

		<u>Unit</u>	Quarter 1	Quarter 2	Quarter 3	Quarter 4	2011 <u>Annual</u>
A.	Maximum Total Body Dose	mrem	0.00 E+00°	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00
	Percent Tech Req limit	%	N/A	N/A	N/A	N/A	N/A
B.	Maximum Organ Dose	mrem	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00	0.00 E+00
	Percent Tech Req limit	%	N/A	N/A	N/A	N/A	N/A

V. SOLID WASTE

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not irradiated fuel)

1. Type of Waste:

,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	Volume (m³)	Total Activity (Curies)	Est. Total Error (%)	
Spent Resins, filter sludges, evaporator bottoms, etc.	0.00 E+00	0.00 E+00	N/A	
B. Dry compressible waste, contaminated equipment, etc	0.00 E+00	0.00 E+00	N/A	
C. Irradiated components, control rods, etc.	0.00 E+00	0.00 E+00	N/A	
D. Other (primary metals, valves, piping)	0.00 E+00	0.00 E+00	N/A	

2. Estimate of major nuclide composition Category A and Category B waste

	(Category A	Category B		
Radionuclide	Activity	Percentage	Activity	Percentage	
	(Ci)	(%)	(Ci)	(%)	

None

3. Estimate of major nuclide composition Category C and Category D waste

	Category C		Category D		
Radionuclide	Activity (Ci)	Percentage (%)	Activity (Ci)	Percentage (%)	

None

4. Solid Waste Disposition

Number of Shipments	Mode of Transportation	Destination
None	N/A	N/A

- 5. Type of Container
 - a. Not applicable
- 6. Solidification Agent
 - a. Not applicable
- **B. IRRADIATED FUEL SHIPMENTS (Disposition)**

Number of Shipments

None