


**Yearly Maximum Average Daily Streamflow Measurements - Cape Fear River at Lillington
Monitoring Station**

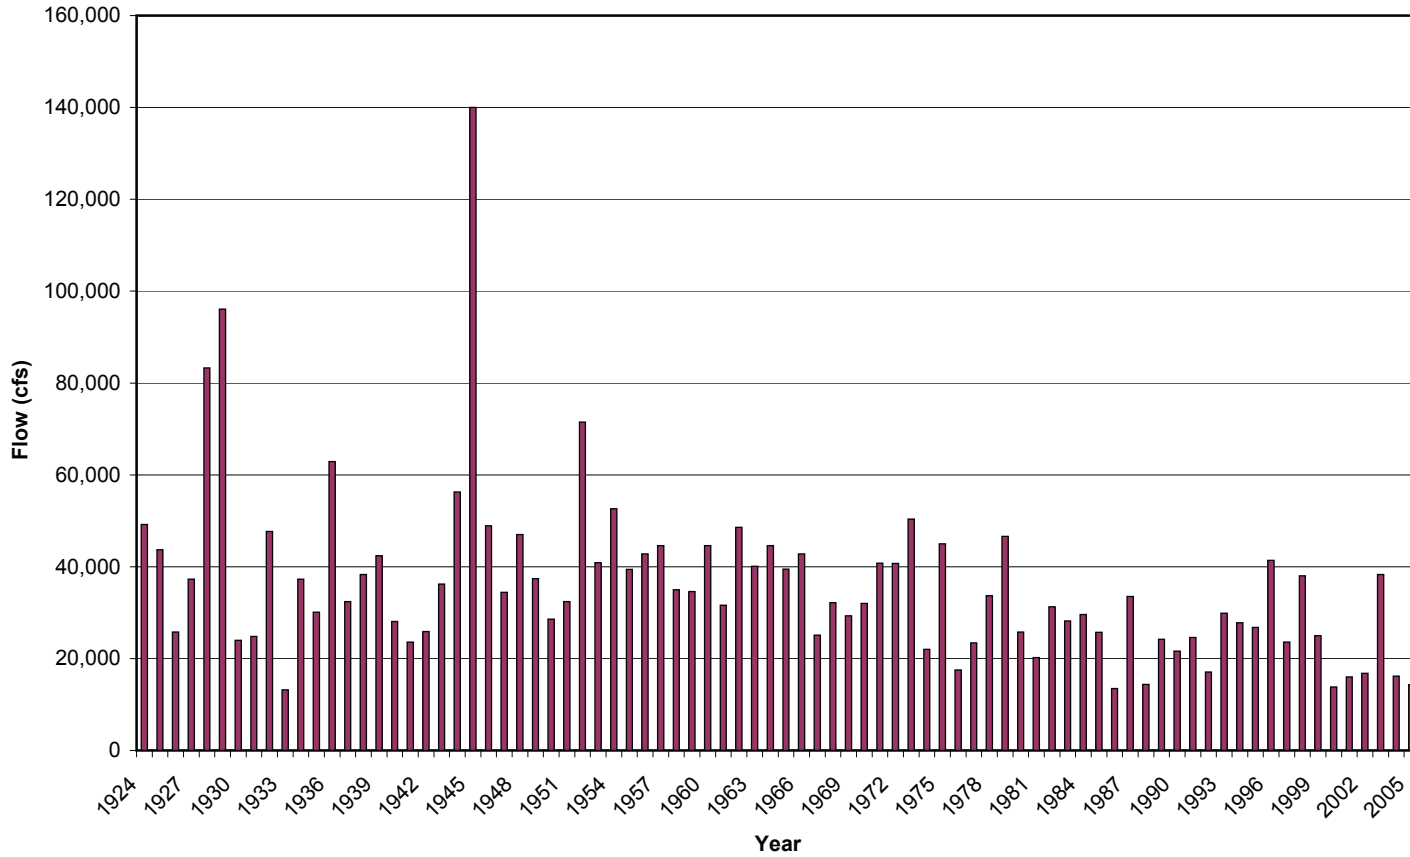

Progress Energy Carolinas
**Shearon Harris Nuclear Power Plant
Units 2 and 3
Part 2, Final Safety Analysis Report**
New Hill, North Carolina

Yearly Maximum Average Daily Streamflow Measurements -
Cape Fear River at Lillington Monitoring Station

FIGURE 2.4.2-202