

444 South 16th Street Mall
Omaha, NE 68102-2247

May 30, 2012
LIC-12-0064

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555-0001

- References:
1. Docket No. 50-285
 2. Letter from OPPD (S. K. Gambhir) to NRC (Document Control Desk), *Responses to Request for Additional Information (RAI) for the Review of the License Renewal Application for Fort Calhoun Station, Unit 1*, dated December 19, 2002 (ML023610070) (LIC-02-0147)
 3. Letter from OPPD (S. K. Gambhir) to NRC (Document Control Desk), *Responses to Potential Open Items for the Review of the License Renewal Application for Fort Calhoun Station, Unit 1*, dated March 14, 2003 (ML030790091) (LIC-03-0035)

SUBJECT: Deletion of License Renewal Commitments Due to Replacement of Components

The purpose of this letter is to notify the NRC that two (2) license renewal commitments made by the Omaha Public Power District (OPPD) in References 2 and 3 are no longer necessary due to the replacement of the affected equipment. Therefore, OPPD is informing the NRC that these commitments are deleted. The commitments are as follows:

Commitment No. 1

OPPD has conservatively included Loss of Material as an AERM [Aging Effect Requiring Management] for Alloy 600 in borated treated water...To validate the effectiveness of the Chemistry program, OPPD will determine the worst-case location for the potential occurrence of this AERM and perform a one-time inspection of this location prior to the period of extended operation. (Response to Item 3.1.2-5. See Page 133 of Attachment to Reference 2)

Justification

After the commitment was made, OPPD elected to replace this equipment (i.e., reactor pressure vessel head, steam generators, and pressurizer), which occurred during the

2006 refueling outage. The replacement components are not fabricated with Alloy 600 but rather with Alloy 690 or stainless steel.

Commitment No. 2

OPPD commits to performance of a one-time inspection prior to the period of extended operation to determine the condition of the fire protection fuel oil tank and verify it is not in a degraded condition. (Response to POI-7c. See Page 54 of Attachment to Reference 3)


Justification

The fire protection fuel oil tank was replaced in 2010 due to Environmental Protection Agency (EPA) requirements for inspecting diesel fuel oil tanks. The old tank could not be inspected due to the enclosure around the tank; the new tank does not have an enclosure.

No additional commitments to the NRC are contained in this letter.

If you have any additional questions, or require further information, please contact Mr. Bill R. Hansher at (402) 533-6894.

Sincerely,

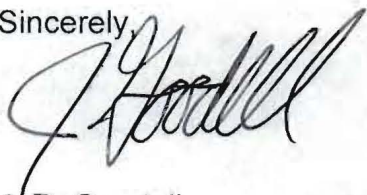

J. R. Goodell
Division Manager-Nuclear Performance Improvement & Support

JRG/KGM/mle

c: E. E. Collins, Jr., NRC Regional Administrator, Region IV
L. E. Wilkins, NRC Project Manager
J. C. Kirkland, NRC Senior Resident Inspector