



61


REACTOR BUILDINGS

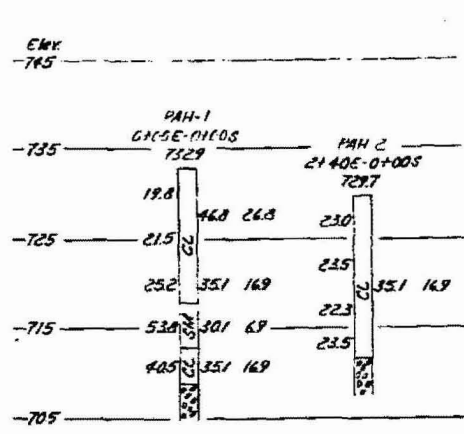


PLANT BUILDINGS

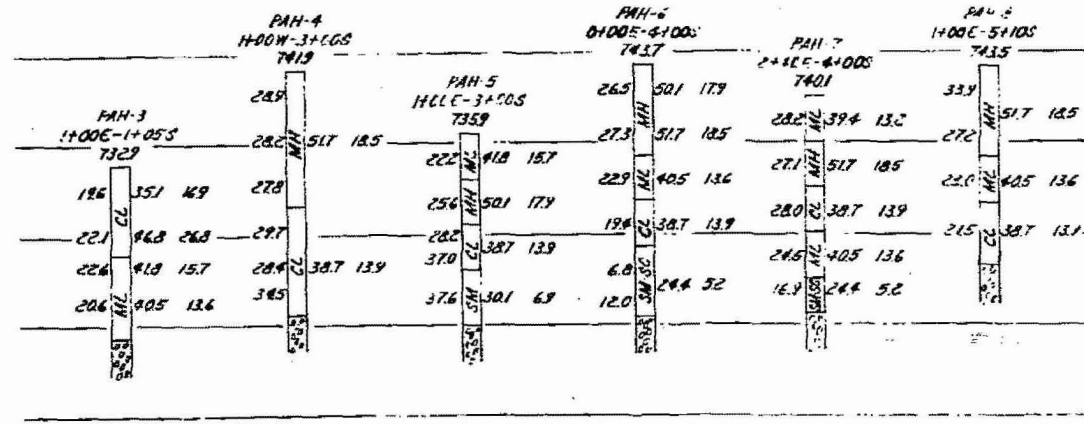


TRANSFORMER YARD & 500 KV SWITCHYARD

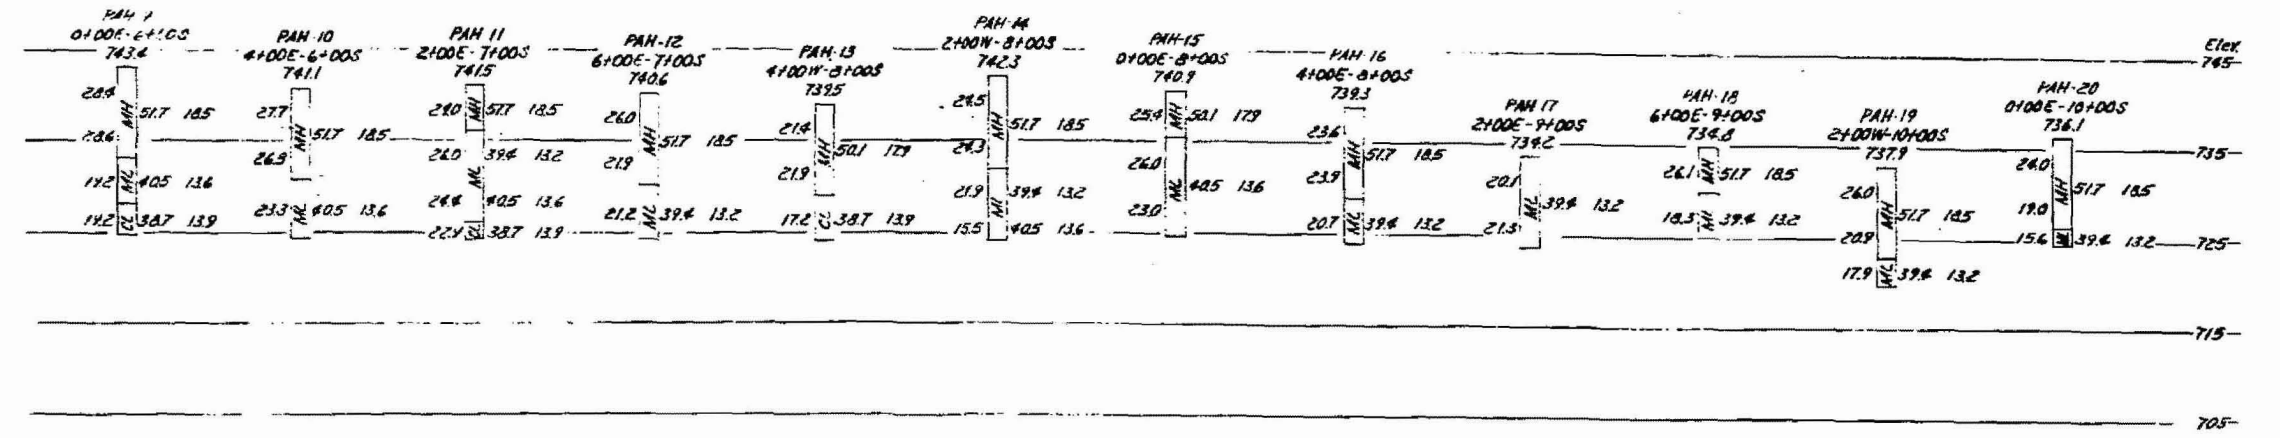

COOLING TOWERS

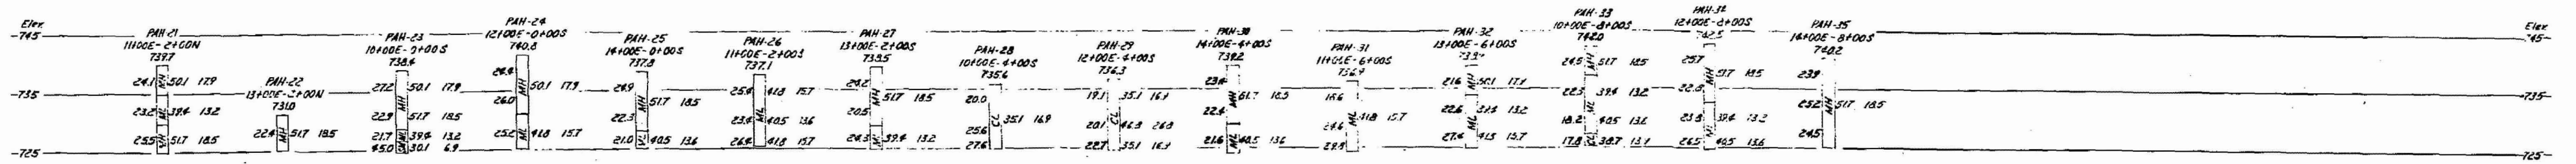

INTAKE CHANNEL

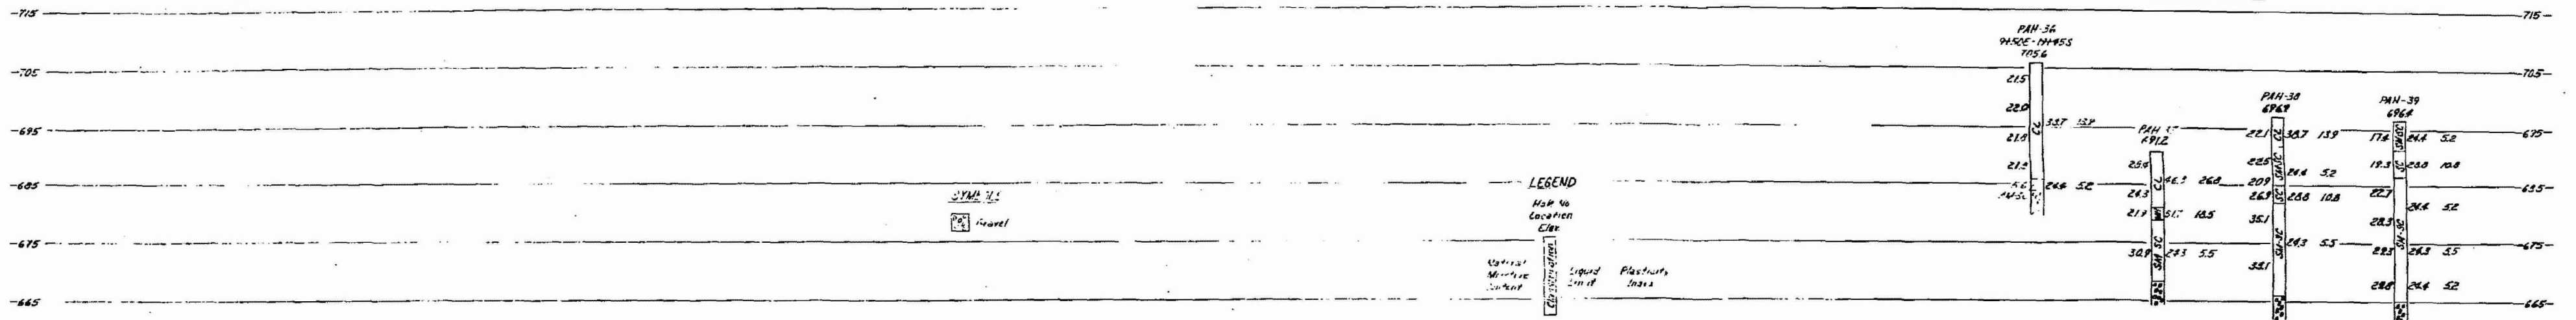

SYMBOLS
[Symbol] Ground

LEGEND
[Symbol] Map to Location
[Symbol] Elev. of Office
[Symbol] Liquid Limit
[Symbol] Plasticity Index

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

BORROW INVESTIGATION

Figure 2.5-222