




REACTOR BUILDINGS

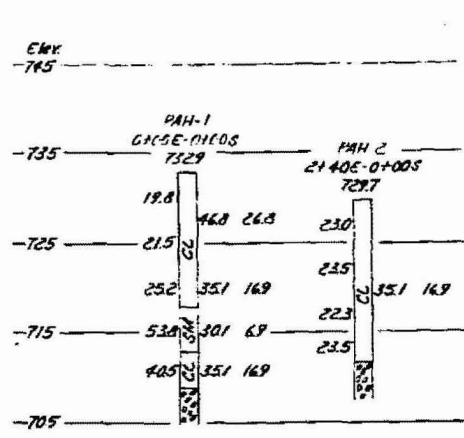


PLANT BUILDINGS

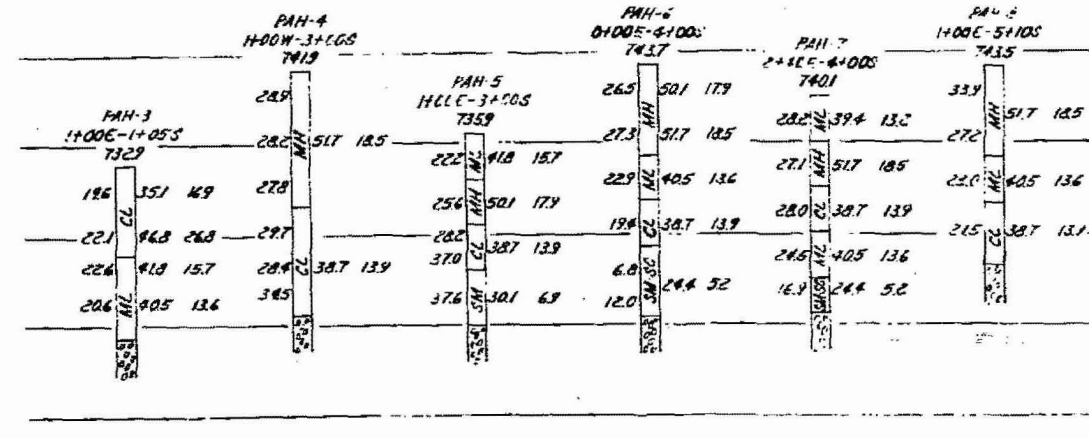


TRANSFORMER YARD & 500 KV SWITCHYARD

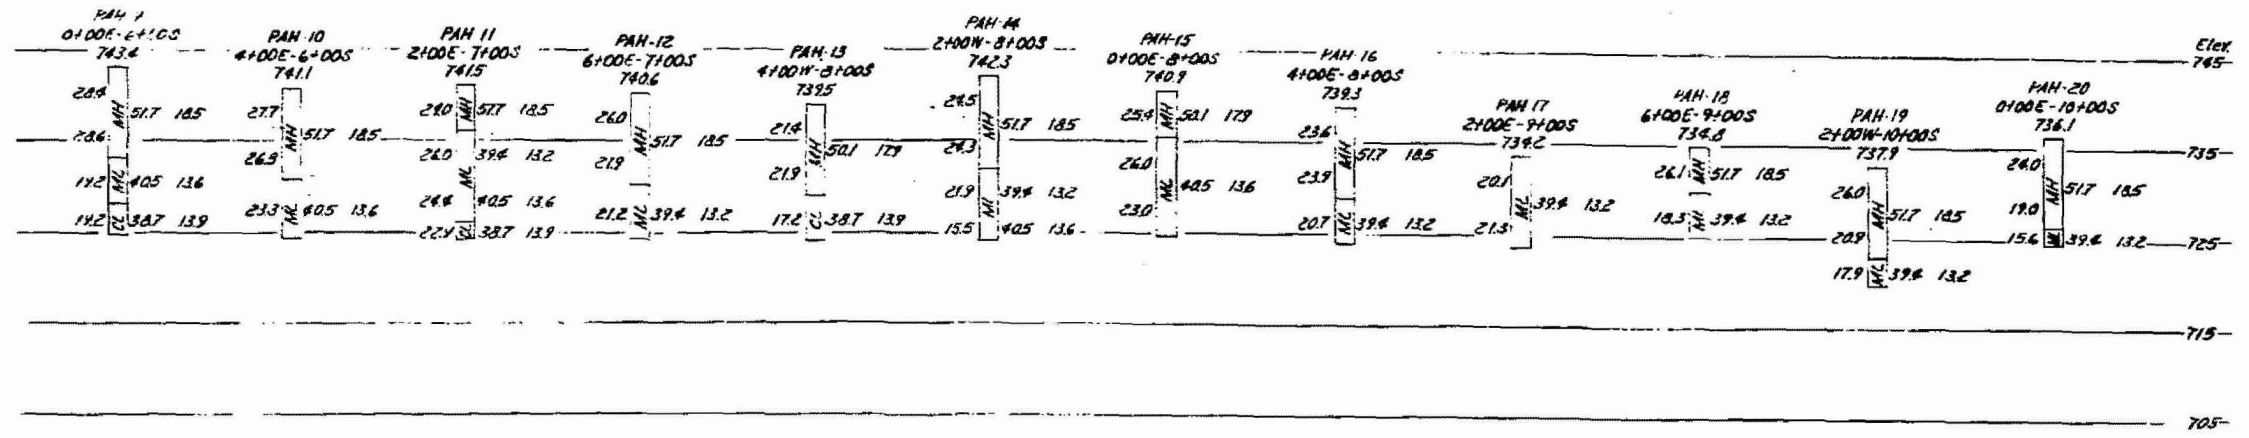

COOLING TOWERS

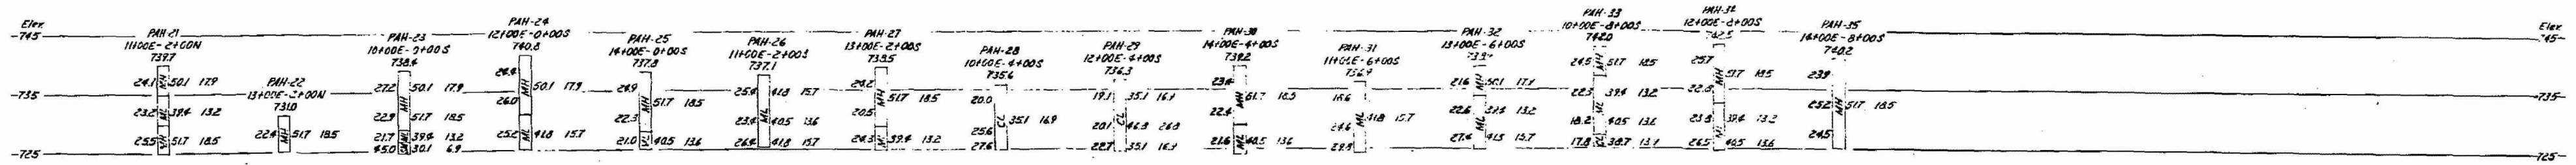

INTAKE CHANNEL

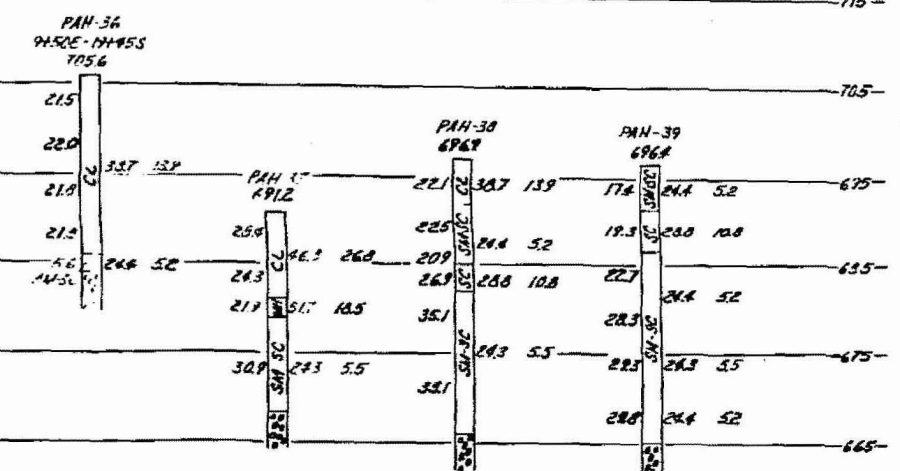

SYMBOLS  
 Ground

LEGEND

- Stationary Structure
- Liquid Containment
- Plasticity Index

WATTS BAR NUCLEAR PLANT  
 FINAL SAFETY  
 ANALYSIS REPORT  
 BORROW INVESTIGATION  
 Figure 2.5-222