

5.0 ADMINISTRATIVE CONTROLS

5.1 Responsibility

5.1.1 The [Plant Superintendent] shall be responsible for overall unit operation and shall delegate in writing the succession to this responsibility during his absence.

The [Plant Superintendent], or his designee, in accordance with approved administrative procedures, shall approve, prior to implementation, each proposed test or experiment and proposed changes and modifications to unit systems or equipment that affect nuclear safety.

5.1.2 The [Shift Supervisor (SS)] shall be responsible for the control room command function. A management directive to this effect, signed by the [highest level of corporate or site management] shall be issued annually to all station personnel. During any absence of the [SS] from the control room while the unit is in MODE 1, 2, or 3, an individual with an active Senior Reactor Operator (SRO) license shall be designated to assume the control room command function. During any absence of the [SS] from the control room while the unit is in MODE 4 or 5, an individual with an active SRO license or Reactor Operator license shall be designated to assume the control room command function.

5.0 ADMINISTRATIVE CONTROLS

5.2 Organization

5.2.1 Onsite and Offsite Organizations

Onsite and offsite organizations shall be established for unit operation and corporate management, respectively. The onsite and offsite organizations shall include the positions for activities affecting safety of the nuclear power plant.

- a. Lines of authority, responsibility, and communication shall be defined and established throughout highest management levels, intermediate levels, and all operating organization positions. These relationships shall be documented and updated, as appropriate, in organization charts, functional descriptions of departmental responsibilities and relationships, and job descriptions for key personnel positions, or in equivalent forms of documentation. These requirements shall be documented in the [applicant's FSAR];
- b. The [Plant Superintendent] shall be responsible for overall safe operation of the plant and shall have control over those onsite activities necessary for safe operation and maintenance of the plant;
- c. The [a specified corporate executive position] shall have corporate responsibility for overall plant nuclear safety and shall take any measures needed to ensure acceptable performance of the staff in operating, maintaining, and providing technical support to the plant to ensure nuclear safety; and
- d. The individuals who train the operating staff, carry out health physics, or perform quality assurance functions may report to the appropriate onsite manager; however, these individuals shall have sufficient organizational freedom to ensure their independence from operating pressures.

5.2 Organization

5.2.2 Unit Staff

The unit staff organization shall include the following:

- a. A non-licensed operator shall be assigned to each reactor containing fuel and an additional non-licensed operator shall be assigned for each control room from which a reactor is operating.¹
- b. At least one licensed Reactor Operator (RO) shall be present in the control room when fuel is in the reactor. In addition, while the unit is in MODE 1, 2, or 3, at least one licensed Senior Reactor Operator (SRO) shall be present in the control room.
- c. A [Health Physics Technician] shall be on site when fuel is in the reactor. The position may be vacant for not more than 2 hours, in order to provide for unexpected absence, provided immediate action is taken to fill the required position.
- d. The [Operations Manager or Assistant Operations Manager] shall hold an active SRO license.
- e. The Shift Technical Advisor (STA) shall provide advisory technical support to the Shift Supervisor (SS) in the areas of thermal hydraulics, reactor engineering, and plant analysis with regard to the safe operation of the unit. In addition, the STA shall meet the qualifications specified by the Commission Policy Statement on Engineering Expertise on Shift.

¹ Two unit sites with both units shutdown or defueled require a total of three non-licensed operators for the two units

5.0 ADMINISTRATIVE CONTROLS

5.3 Unit Staff Qualifications

Reviewer's Note: Minimum qualifications for members of the unit staff shall be specified by use of an overall qualification statement referencing an ANSI Standard acceptable to the NRC staff or by specifying individual position qualifications. Generally, the first method is preferable; however, the second method is adaptable to those unit staffs requiring special qualification statements because of unique organizational structures.

- 5.3.1 Each member of the unit staff shall meet or exceed the minimum qualifications of [Regulatory Guide 1.8, Revision 2, 1987, or more recent revisions, or ANSI Standard acceptable to the NRC staff]. The staff not covered by [Regulatory Guide 1.8] shall meet or exceed the minimum qualifications of [Regulations, Regulatory Guides, or ANSI Standards acceptable to NRC staff].
-
-

5.0 ADMINISTRATIVE CONTROLS

5.4 Technical Specifications (TS) Bases Control

- 5.4.1 Changes to the Bases of the TS shall be made under appropriate administrative controls and reviews.
- 5.4.2 Licensees may make changes to Bases without prior NRC approval provided the changes do not involve either of the following:
- a. A change in the plant-specific TS, or plant-specific DCD Tier 1 or Tier 2* information; or
 - b. A change to the site-specific portion of the FSAR or Bases that requires NRC approval pursuant to 10 CFR 50.59, or a change to Tier 2 of the ABWR DCD that requires NRC approval pursuant to the design certification rule for the ABWR (Appendix A to 10 CFR 52).
- Changes to the Bases implemented without prior NRC approval shall be provided to the NRC on a frequency consistent with 10 CFR 50.71.
- 5.4.3 The Bases Control Program shall contain provisions to ensure that the Bases are maintained consistent with the FSAR, which consists of the plant-specific DCD and the site-specific portion of the FSAR.
- 5.4.4 Proposed changes that meet the criteria of Specification 5.4.2.a or Specification 5.4.2.b above shall be reviewed and approved by the NRC prior to implementation.
-
-

5.0 ADMINISTRATIVE CONTROLS

5.5 Procedures, Programs, and Manuals

5.5.1 Procedures

5.5.1.1 Scope

Written procedures shall be established, implemented, and maintained covering the following activities:

- a. The applicable procedures recommended in Regulatory Guide 1.33, Revision 2, Appendix A, February 1978;
- b. The emergency operating procedures required to implement the requirements of NUREG-0737 and NUREG-0737, Supplement 1, as stated in [Generic Letter 82-33];
- c. Quality assurance for effluent and environmental monitoring;
- d. Fire Protection Program implementation; and
- e. All programs specified in Specification 5.5.2.

5.5.2 Programs and Manuals

The following programs shall be established, implemented, and maintained:

5.5.2.1 Offsite Dose Calculation Manual (ODCM)

- a. The ODCM shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring alarm and trip setpoints, and in the conduct of the Radiological Environmental Monitoring Program; and
- b. The ODCM shall also contain the Radioactive Effluent Controls program required by Specification 5.5.2.4, and descriptions of the information that should be included in the Annual Radiological Environmental Operating, and Radioactive Effluent Release, reports required by Specification 5.7.1.2 and Specification 5.7.1.3.

5.5 Procedures, Programs, and Manuals

5.5.2.1 Offsite Dose Calculation Manual (ODCM) (continued)

Licensee initiated changes to the ODCM:

- a. Shall be documented and records of reviews performed shall be retained. This documentation shall contain:
 1. sufficient information to support the change(s) together with the appropriate analyses or evaluations justifying the change(s), and
 2. a determination that the change(s) maintain the levels of radioactive effluent control required pursuant to 10 CFR 20.1302, 40 CFR 190, 10 CFR 50.36a, and 10 CFR 50, Appendix I, and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations;
- b. Shall become effective after review and acceptance by plant reviews and the approval of the [Plant Superintendent]; and
- c. Shall be submitted to the NRC in the form of a complete, legible copy of the entire ODCM as a part of, or concurrent with, the Radioactive Effluent Release Report for the period of the report in which any change in the ODCM was made. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (i.e., month and year) the change was implemented.

5.5.2.2 Primary Coolant Sources Outside Containment

This program provides controls to minimize leakage from those portions of systems outside containment that could contain highly radioactive fluids during a serious transient or accident to levels as low as practicable. The systems include the Low Pressure Core Flooder, High Pressure Core Flooder, Residual Heat Removal, Reactor Core Isolation Cooling, Post Accident Sampling, Standby Gas Treatment, Suppression Pool Cleanup, Reactor Water Cleanup, Fuel Pool Cooling and Cleanup, Process Sampling, Containment Atmospheric Monitoring, and Fission Product Monitor. The program shall include the following:

- a. Preventive maintenance and periodic visual inspection requirements; and
- b. Integrated leak test requirements for each system at refueling cycle intervals or less.

5.5 Procedures, Programs, and Manuals

5.5.2.3 Post Accident Sampling

This program provides controls that ensure the capability to obtain and analyze reactor coolant, radioactive gases, and particulates in plant gaseous effluents and containment atmosphere samples under accident conditions. The program shall include the following:

- a. Training of personnel;
- b. Procedures for sampling and analysis; and
- c. Provisions for maintenance of sampling and analysis equipment.

5.5.2.4 Radioactive Effluent Controls Program

This program conforms to 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to members of the public from radioactive effluents as low as reasonably achievable. The program (1) shall be contained in the ODCM, (2) shall be implemented by procedures, and (3) shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- a. Limitations on the functional capability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the ODCM;
- b. Limitations on the concentrations of radioactive material released in liquid effluents to unrestricted areas, conforming to 10 times the concentration values in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2401;
- c. Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents pursuant to 10 CFR 20.1302 and with the methodology and parameters in the ODCM;
- d. Limitations on the annual and quarterly doses or dose commitment to a member of the public from radioactive materials in liquid effluents released from each unit to unrestricted areas, conforming to 10 CFR 50, Appendix I;
- e. Determination of cumulative and projected dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the ODCM at least every 31 days;

5.5 Procedures, Programs, and Manuals

5.5.2.4 Radioactive Effluent Controls Program (continued)

- f. Limitations on the functional capability and use of the liquid and gaseous effluent treatment systems to ensure that appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a period of 31 days would exceed 2 percent of the guidelines for the annual dose or dose commitment, conforming to 10 CFR 50, Appendix I;
- g. Limitations on the dose rate resulting from radioactive material released in gaseous effluents to areas beyond the site boundary conforming to the dose associated with 10 CFR 20, Appendix B, Table II, Column 1;
- h. Limitations on the annual and quarterly air doses resulting from noble gases released in gaseous effluents from each unit to areas beyond the site boundary, conforming to 10 CFR 50, Appendix I;
- i. Limitations on the annual and quarterly doses to a member of the public from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half lives > 8 days in gaseous effluents released from each unit to areas beyond the site boundary, conforming to 10 CFR 50, Appendix I; and
- j. Limitations on the annual dose or dose commitment to any member of the public due to releases of radioactivity and to radiation from uranium fuel cycle sources, conforming to 40 CFR 190.

5.5.2.5 Component Cyclic or Transient Limit

This program provides controls to track the cyclic and transient occurrences in DCD Tier 2, Section 3.9.1.1 to ensure that components are maintained within the design limits.

5.5.2.6 Inservice Testing Program

This program provides controls for inservice testing of ASME Code Class 1, 2, and 3 components. This program shall include the following:

- a. Testing frequencies specified in the applicable edition and addenda of the ASME Code for Operations and Maintenance of Nuclear Power Plants (ASME OM Code):

5.5 Procedures, Programs, and Manuals

5.5.2.6 Inservice Testing Program (continued)

ASME OM Code and applicable Addenda terminology for inservice testing activities	Required Frequencies for performing inservice testing activities
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days

- b. The provisions of SR 3.0.2 are applicable to the above required Frequencies and to other normal and accelerated Frequencies specified as 2 years or less in the Inservice Testing Program for performing inservice testing activities;
- c. The provisions of SR 3.0.3 are applicable to inservice testing activities; and
- d. Nothing in the ASME OM Code shall be construed to supersede the requirements of any TS.

5.5.2.7 Ventilation Filter Testing Program (VFTP)

A program shall be established to implement the following required testing of Engineered Safety Feature (ESF) filter ventilation systems at the frequencies specified in [Regulatory Guide], and in accordance with Regulatory Guide 1.52, Revision 2; ASME N510-1989; and AG-1-1991, as specified below:

- a. Demonstrate for each of the ESF systems that an inplace test of the high efficiency particulate air (HEPA) filters shows a penetration and system bypass < [0.05]% when tested in accordance with Regulatory Guide 1.52, Revision 2; ASME N510-1989 at the system flowrate specified below [\pm 10%]:

ESF Ventilation System	Flowrate
Control Room Habitability System	<div style="border: 1px solid black; width: 100px; height: 100px; margin: 0 auto;"></div>
Standby Gas Treatment System	

5.5 Procedures, Programs, and Manuals

5.5.2.7

Ventilation Filter Testing Program (VFTP) (continued)

- b. Demonstrate for each of the ESF systems that an in-place test of the charcoal adsorber shows a penetration and system bypass < [0.05]% when tested in accordance with Regulatory Guide 1.52, Revision 2, and ASME N510-1989 at the system flowrate specified below [$\pm 10\%$]:

ESF Ventilation System	Flowrate
Control Room Habitability System	
Standby Gas Treatment System	

- c. Demonstrate for each of the ESF systems that a laboratory test of a sample of the charcoal adsorber, when obtained as described in Regulatory Guide 1.52, Revision 2, shows the methyl iodide penetration less than the value specified below when tested in accordance with [ASTM D3803-1989] at a temperature of $\leq [30^{\circ}\text{C}]$ and greater than or equal to the relative humidity specified below:

ESF Ventilation System	Penetration	RH
Control Room Habitability System		
Standby Gas Treatment System		

Reviewer's Note: Allowable penetration = $[100\% - \text{methyl iodide efficiency for charcoal credited in staff safety evaluation}] / (\text{safety factor})$.

Safety factor = [5] for systems with heaters.

- d. Demonstrate for each of the ESF systems that the pressure drop across the combined HEPA filters, the prefilters, and the charcoal adsorbers is less than the value specified below when tested in accordance with Regulatory Guide 1.52, Revision 2, and ASME N510-1989 at the system flowrate specified below [$\pm 10\%$]:

5.5 Procedures, Programs, and Manuals

5.5.2.7 Ventilation Filter Testing Program (VFTP) (continued)

ESF Ventilation System	Delta P	Flowrate
Control Room Habitability System		
Standby Gas Treatment System		

- e. Demonstrate that the heaters for each of the ESF systems dissipate the value specified below [$\pm 10\%$] when tested in accordance with ASME N510-1989:

ESF Ventilation System	Wattage
Control Room Habitability System	
Standby Gas Treatment System	

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the VFTP test frequencies.

5.5.2.8 Explosive Gas Radioactivity Monitoring Program

This program provides controls for potentially explosive gas mixtures contained in the Offgas System. The gaseous radioactivity quantities shall be determined following the methodology in Branch Technical Position (BTP) ETSB 11-5, "Postulated Radioactive Release due to Waste Gas System Leak or Failure".

The program shall include:

- a. The limits for concentrations of hydrogen and oxygen in the Offgas System and a surveillance program to ensure the limits are maintained. Such limits shall be appropriate to the system's design criteria (i.e., whether or not the system is designed to withstand a hydrogen explosion);
- b. A surveillance program to ensure that the quantity of radioactivity in the Offgas System is less than the amount that would result in a whole body exposure of ≥ 25 mSv to any individual in an unrestricted area, in the event of inadvertent bypass of the Offgas Systems charcoal beds as analyzed in DCD Tier 2, Section 15.7.1.

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Explosive Gas Radioactivity Monitoring Program surveillance frequencies.

5.5 Procedures, Programs, and Manuals

5.5.2.9 Diesel Fuel Oil Testing Program

A diesel fuel oil testing program to implement required testing of both new fuel oil and stored fuel oil shall be established. The program shall include sampling and testing requirements, and acceptance criteria, all in accordance with applicable ASTM Standards. The purpose of the program is to establish the following:

- a. Acceptability of new fuel oil for use prior to addition to storage tanks by determining that the fuel oil has:
 1. an API gravity or an absolute specific gravity within limits,
 2. a flash point and kinematic viscosity within limits for ASTM 2D fuel oil, and
 3. a clear and bright appearance with proper color;
- b. Other properties for ASTM 2D fuel oil are within limits within 31 days following sampling and addition to storage tanks; and
- c. Total particulate concentration of the fuel oil is ≤ 10 mg/l when tested every 31 days in accordance with ASTM D-2276, Method A-2 or A-3.

5.5.2.10 Software Error Evaluation Program

This program provides controls to ensure that appropriate software error evaluation procedures, to protect the plant from common mode software errors, are established to ensure that redundant system capability is not adversely affected. This program shall evaluate the cause of the inoperability, the affected components, and the plans and schedule for completing proposed remedial actions. If a determination is made that a common mode software error exists, then a Special Report shall be submitted in accordance with Specification 5.7.2.b.

5.5.2.11 Setpoint Control Program (SCP)

- a. The Setpoint Control Program (SCP) implements the regulatory requirement of 10 CFR 50.36(c)(1)(ii)(A) that technical specifications will include items in the category of limiting safety system settings (LSSS), which are settings for automatic protective devices related to those variables having significant safety functions.

5.5 Procedures, Programs, and Manuals

5.5.2.11

Setpoint Control Program (SCP) (continued)

- b. The Nominal Trip Setpoint (NTS), Allowable Value (AV), As-Found Tolerance (AFT), and As-Left Tolerance (ALT) for each Technical Specification required automatic protection instrumentation function shall be calculated in conformance with the NRC approved WCAP-17119-P "Methodology for South Texas Project Units 3 & 4 ABWR Technical Specification Setpoints, Revision 2." Additionally, the NRC approved methodology shall define acceptable margin as margin greater than or equal to the ALT.
- c. For each Technical Specification required automatic protection instrumentation function, performance of a SENSOR CHANNEL CALIBRATION, CHANNEL CALIBRATION, or CHANNEL FUNCTIONAL TEST (CFT) surveillance "in accordance with the Setpoint Control Program" shall include the following:
 - 1. The as-found value of the instrument channel trip setting shall be compared with the specified NTS.
 - i. If the as-found value of the instrument channel trip setting differs from the specified NTS by more than the pre-defined test acceptance criteria band (i.e., the specified AFT), then the instrument channel shall be evaluated to verify that it is functioning in accordance with its design basis before declaring the surveillance requirement met and returning the instrument channel to service. An Instrument Channel is determined to be functioning in accordance with its design basis if it can be recalibrated to within the ALT. This as-found condition shall be entered into the plant's corrective action program.
 - ii. If the as-found value of the instrument channel trip setting is less conservative than the specified AV, the surveillance requirement is not met and the instrument channel shall be immediately declared inoperable.
 - 2. The instrument channel trip setting shall be set to a value within the specified ALT around the specified NTS at the completion of the surveillance; otherwise, the surveillance requirement is not met and the instrument channel shall be immediately declared inoperable.

5.5 Procedures, Programs, and Manuals

5.5.2.11

Setpoint Control Program (SCP) (continued)

- d. The difference between the instrument channel trip setting as-found value and the previous as-left value for each Technical Specification required automatic protection instrumentation function shall be trended and evaluated to verify that the instrument channel is functioning in accordance with its design basis.
 - e. The SCP shall establish a document containing the current value of the specified NTS, AV, AFT, and ALT for each Technical Specification required automatic protection instrumentation function and references to the calculation documentation. Changes to this document shall be governed by the regulatory requirement of 10 CFR 50.59. In addition, changes to the specified NTS, AV, AFT, and ALT values shall be governed by the NRC approved setpoint methodology. This document, including any midcycle revisions or supplements, shall be provided upon issuance for each reload cycle to the NRC.
-
-

5.0 ADMINISTRATIVE CONTROLS


5.6 Safety Function Determination Program (SFDP)

- 5.6.1 This program ensures loss of safety function is detected and appropriate actions taken. Upon failure to meet two or more LCOs at the same time, an evaluation shall be made to determine if loss of safety function exists. Additionally, other appropriate limitations and remedial or compensatory actions may be identified to be taken as a result of the support system inoperability and corresponding exception to entering supported system Condition and Required Actions. This program implements the requirements of LCO 3.0.6.
- 5.6.2 The SFDP shall contain the following:
- a. Provisions for cross division checks to ensure a loss of the capability to perform the safety function assumed in the accident analysis does not go undetected;
 - b. Provisions for ensuring the plant is maintained in a safe condition if a loss of function condition exists;
 - c. Provisions to ensure that an inoperable supported system's Completion Time is not inappropriately extended as a result of multiple support system inoperabilities; and
 - d. Other appropriate limitations and remedial or compensatory actions.
- 5.6.3 A loss of safety function exists when, assuming no concurrent single failure, a safety function assumed in the accident analysis cannot be performed. For the purpose of this program, a loss of safety function may exist when a support system is inoperable, and:
- a. A required system redundant to system(s) supported by the inoperable support system is also inoperable (Case A); or
 - b. A required system redundant to system(s) in turn supported by the inoperable supported system is also inoperable (Case B); or
 - c. A required system redundant to support system(s) for the supported systems (a) and (b) above is also inoperable (Case C).

5.6 Safety Function Determination Program (SFDP)

5.6.3 (continued)

Generic Example:

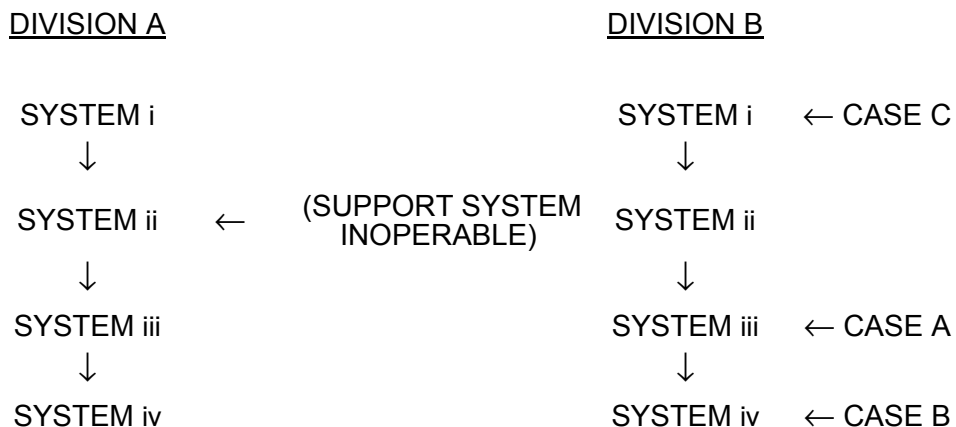

5.6.4 The SFDP identifies where a loss of safety function exists. If a loss of safety function is determined to exist by this program, the appropriate Conditions and Required Actions of the LCO in which the loss of safety function exists are required to be entered.

5.0 ADMINISTRATIVE CONTROLS

5.7 Reporting Requirements

5.7.1 Routine Reports

The following reports shall be submitted in accordance with 10 CFR 50.4.

5.7.1.1 Annual Reports

-----NOTE-----
A single submittal may be made for a multiple unit station. The submittal should combine sections common to all units at the station.

Annual Reports covering the activities of the unit as described below for the previous calendar year shall be submitted by April 30 of each year. [The initial report shall be submitted by April 30 of the year following initial criticality.]

Reports required on an annual basis include:

a. Occupational Radiation Exposure Report

A tabulation on an annual basis of the number of station, utility, and other personnel (including contractors) for whom monitoring was required, receiving an annual deep dose equivalent > 1 mSv and the associated collective deep dose equivalent (reported in person-rem) according to work and job functions (e.g., reactor operations and surveillance, inservice inspection, routine maintenance, special maintenance [describe maintenance], waste processing, and refueling). This tabulation supplements the requirements of 10 CFR 20.2206. The dose assignments to various duty functions may be estimated based on pocket dosimeter, thermoluminescent dosimeter (TLD), or film badge measurements. Small exposures totalling < 20% of the individual total dose need not be accounted for. In the aggregate, at least 80% of the total deep dose equivalent received from external sources should be assigned to specific major work functions; and

b. Any other unit unique reports required on an annual basis.

5.7 Reporting Requirements

5.7.1.2 Annual Radiological Environmental Operating Report

-----NOTE-----
A single submittal may be made for a multiple unit station. The submittal should combine sections common to all units at the station.

The Annual Radiological Environmental Operating Report covering the operation of the unit during the previous calendar year shall be submitted by May 15 of each year. The report shall include summaries, interpretations, and analyses of trends of the results of the Radiological Environmental Monitoring Program for the reporting period. The material provided shall be consistent with the objectives outlined in the Offsite Dose Calculation Manual (ODCM), and in 10 CFR 50, Appendix I, Sections IV.B.2, IV.B.3, and IV.C.

The Annual Radiological Environmental Operating Report shall include the results of analyses of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to the locations specified in the table and figures in the ODCM, as well as summarized and tabulated results of these analyses and measurements [in the format of the table in the Radiological Assessment Branch Technical Position, Revision 1, November 1979]. [The report shall identify the TLD results that represent collocated dosimeters in relation to the NRC TLD program and the exposure period associated with each result.] In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted in a supplementary report as soon as possible.

5.7.1.3 Radioactive Effluent Release Report

-----NOTE-----
A single submittal may be made for a multiple unit station. The submittal should combine sections common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

5.7 Reporting Requirements

5.7.1.3 Radioactive Effluent Release Report (continued)

The Radioactive Effluent Release Report covering the operation of the unit during the previous year shall be submitted prior to May 1 of each year in accordance with 10 CFR 50.36a. The report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit. The material provided shall be consistent with the objectives outlined in the ODCM and Process Control Program and in conformance with 10 CFR 50.36a and 10 CFR 50, Appendix I, Section IV.B.1.

5.7.1.4 Monthly Operating Reports

Routine reports of operating statistics and shutdown experience[, including documentation of all challenges to the safety/relief valves,] shall be submitted on a monthly basis no later than the 15th of each month following the calendar month covered by the report.

5.7.1.5 CORE OPERATING LIMITS REPORT (COLR)

- a. Core operating limits shall be established prior to each reload cycle, or prior to any remaining portion of a reload cycle, and shall be documented in the COLR for the following:

[The individual specifications that address core operating limits must be referenced here.]

- b. The analytical methods used to determine the core operating limits shall be those previously reviewed and approved by the NRC, specifically those described in the following documents:

[Identify the Topical Report(s) by number, title, date, and NRC staff approval document, or identify the staff Safety Evaluation Report for a plant specific methodology by NRC letter and date.]

- c. The core operating limits shall be determined such that all applicable limits (e.g., fuel thermal mechanical limits, core thermal hydraulic limits, Emergency Core Cooling Systems (ECCS) limits, nuclear limits such as SDM, transient analysis limits, and accident analysis limits) of the safety analysis are met.
- d. The COLR, including any midcycle revisions or supplements, shall be provided upon issuance for each reload cycle to the NRC.

5.7 Reporting Requirements

5.7.1.6 Reactor Coolant System (RCS) PRESSURE AND TEMPERATURE LIMITS REPORT (PTLR)

The RCS pressure and temperature limits, including heatup and cooldown rates, criticality, and hydrostatic and leak test limits, shall be established and documented in the PTLR. [The individual Specifications that address the reactor vessel pressure and temperature limits and the heatup and cooldown rates may be referenced.] The analytical methods used to determine the pressure and temperature limits including the heatup and cooldown rates shall be those previously reviewed and approved by the NRC in [Topical Report(s), number, title, date, and NRC staff approval document, or staff safety evaluation report for a plant specific methodology by NRC letter and date]. The reactor vessel pressure and temperature limits, including those for heatup and cooldown rates, shall be determined so that all applicable limits (e.g., heatup limits, cooldown limits, and inservice leak and hydrostatic testing limits) of the analysis are met. The PTLR, including revisions or supplements thereto, shall be provided upon issuance for each reactor vessel fluency period.

5.7.2 Special Reports

Special Reports may be required covering inspection, test, and maintenance activities. These special reports are determined on an individual basis for each unit, and their preparation and submittal are designated in the Technical Specifications.

Special Reports shall be submitted in accordance with 10 CFR 50.4 within the time period specified for each report.

The following Special Reports shall be submitted:

- a. When a Special Report is required by Condition C of LCO 3.3.3.1, "Essential Communication Functions," a report shall be submitted within the following 14 days. The report shall outline the cause of the inoperability, consideration of common mode failures, and the plans and schedule for restoring the data communication transmission segments to OPERABLE status.
- b. When a Special Report is required by Specification 5.5.2.10, "Software Error Evaluation Program," a report shall be submitted within the following 7 days. The report shall outline the cause of the inoperability, the affected components, and the plans and schedule for completing proposed remedial actions.