


Comanche Peak Nuclear Power Plant, Units 3 & 4
 COL Application
 Part 3 - Environmental Report

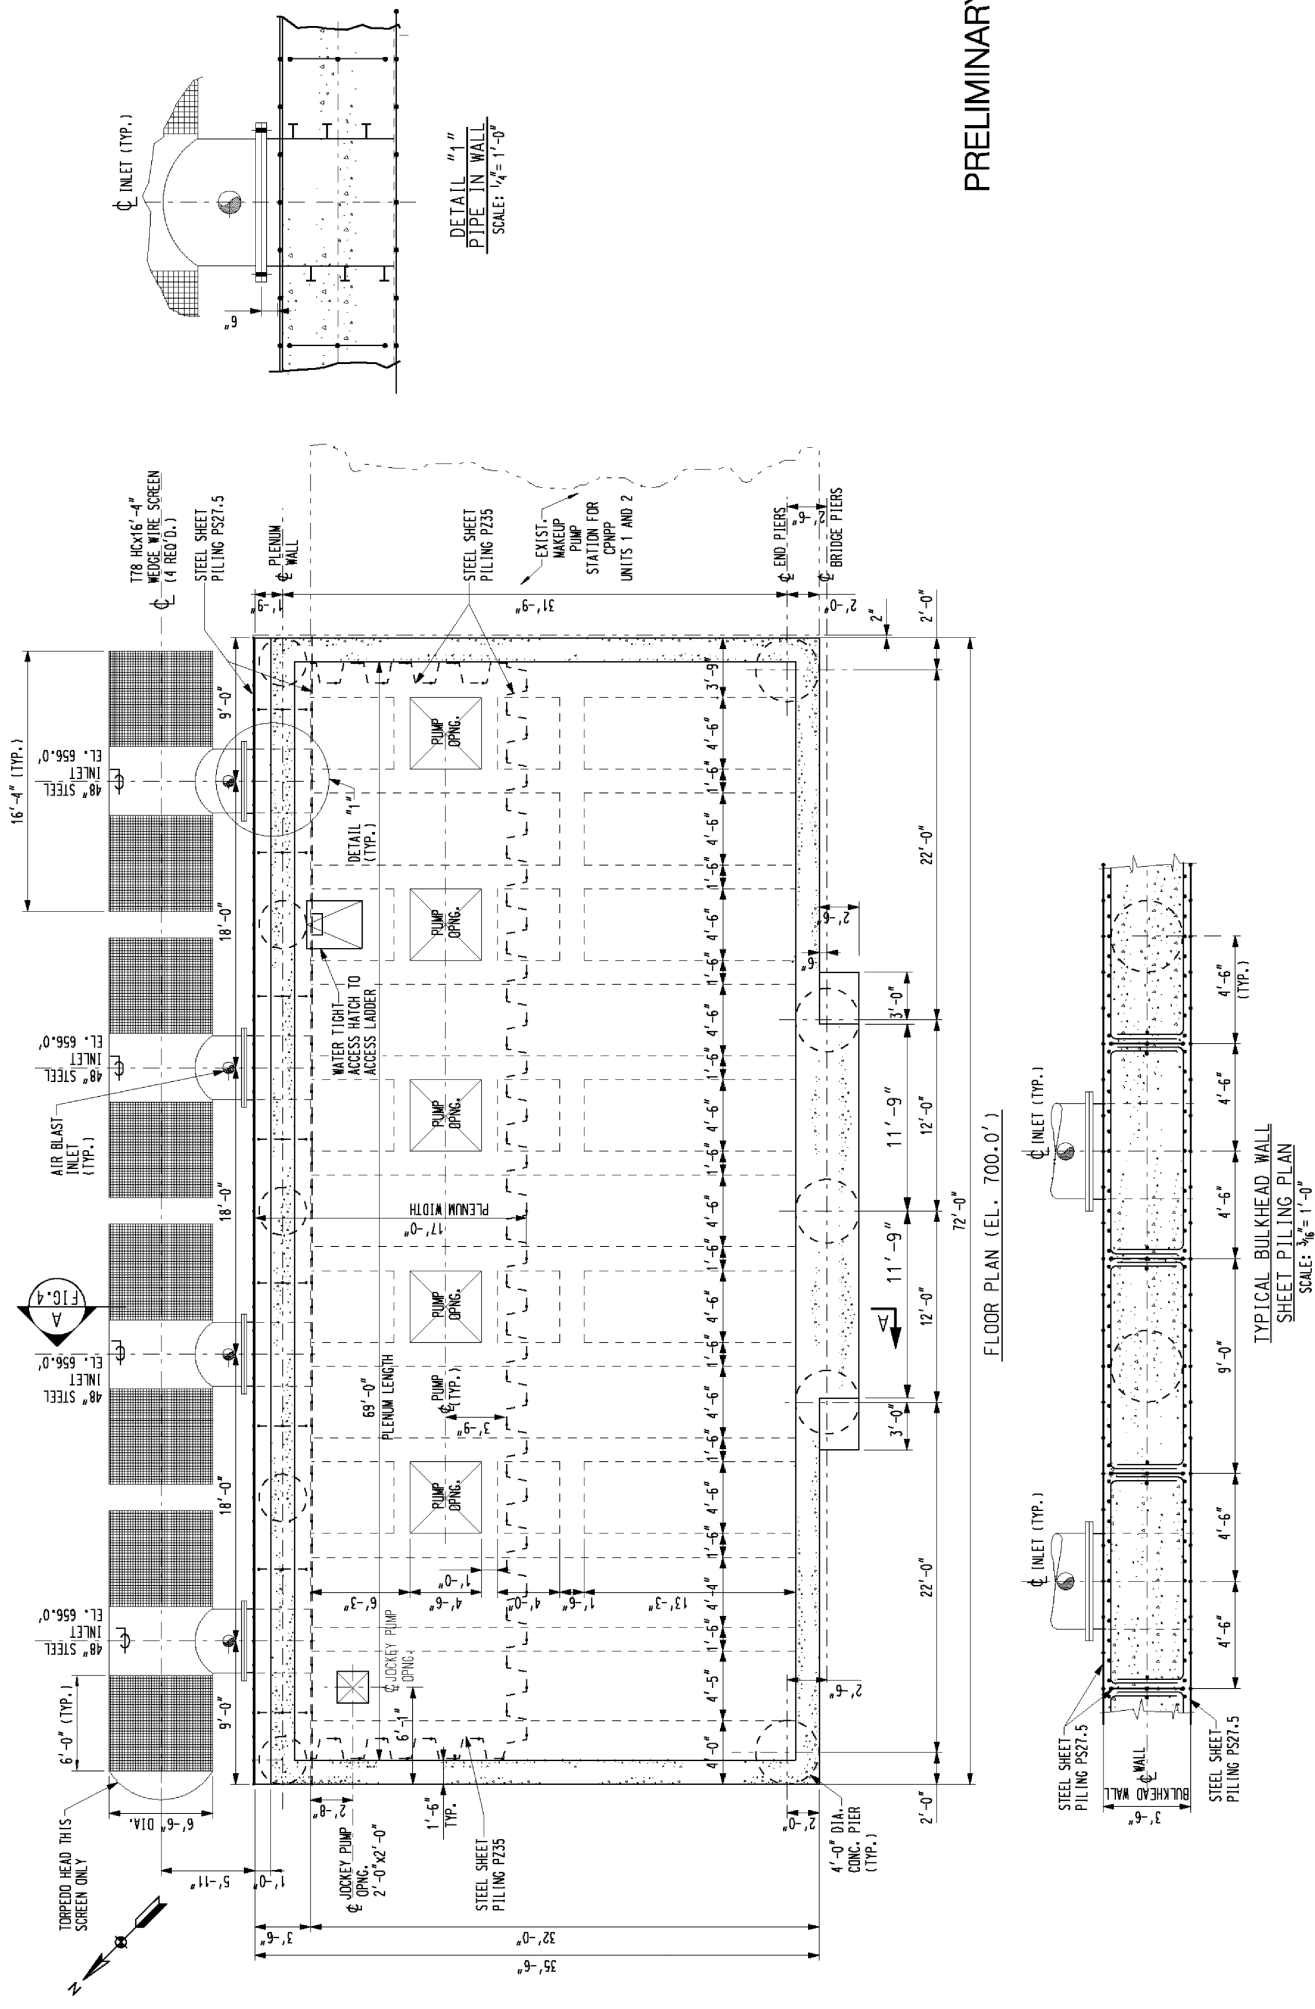

PRELIMINARY

Figure 3.4-4 Makeup Water Intake Structure Floor Plan