

Comanche Peak Nuclear Power Plant, Units 3 & 4  
 COL Application  
 Part 3 - Environmental Report

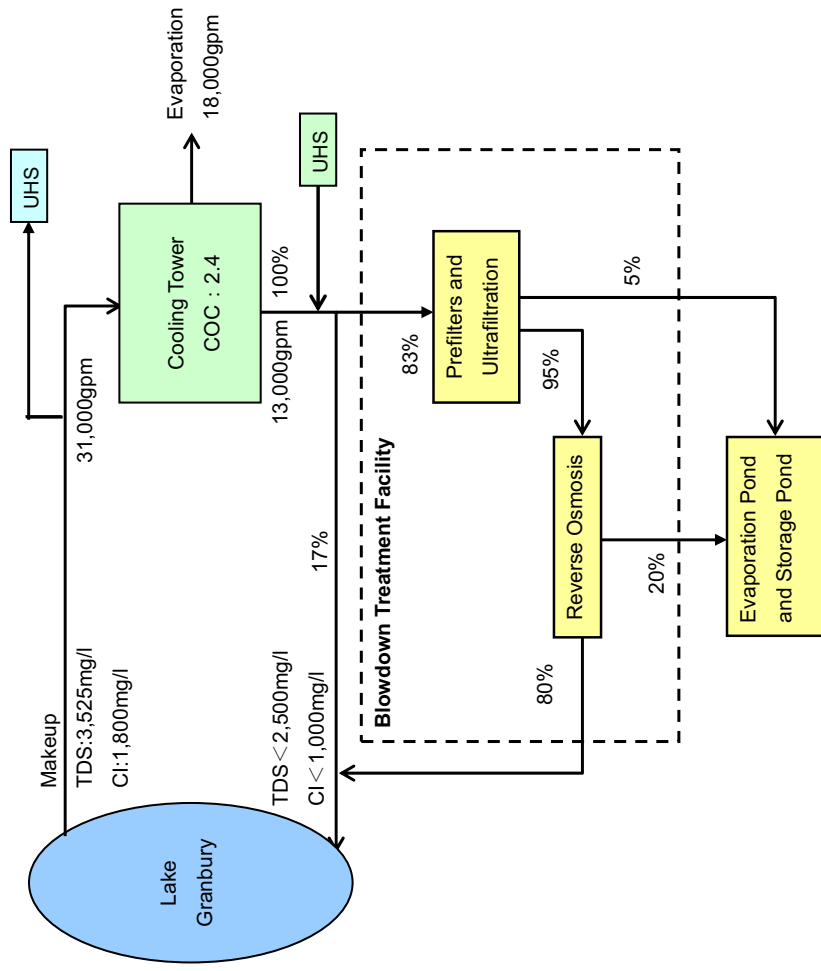


Figure 3.6-1 Sketch of Blowdown Water Treatment Facility Per Unit