


**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR**

Equivalent radial ice thicknesses due to freezing rain with concurrent 3-second gust speeds, for a 100-year mean recurrence interval

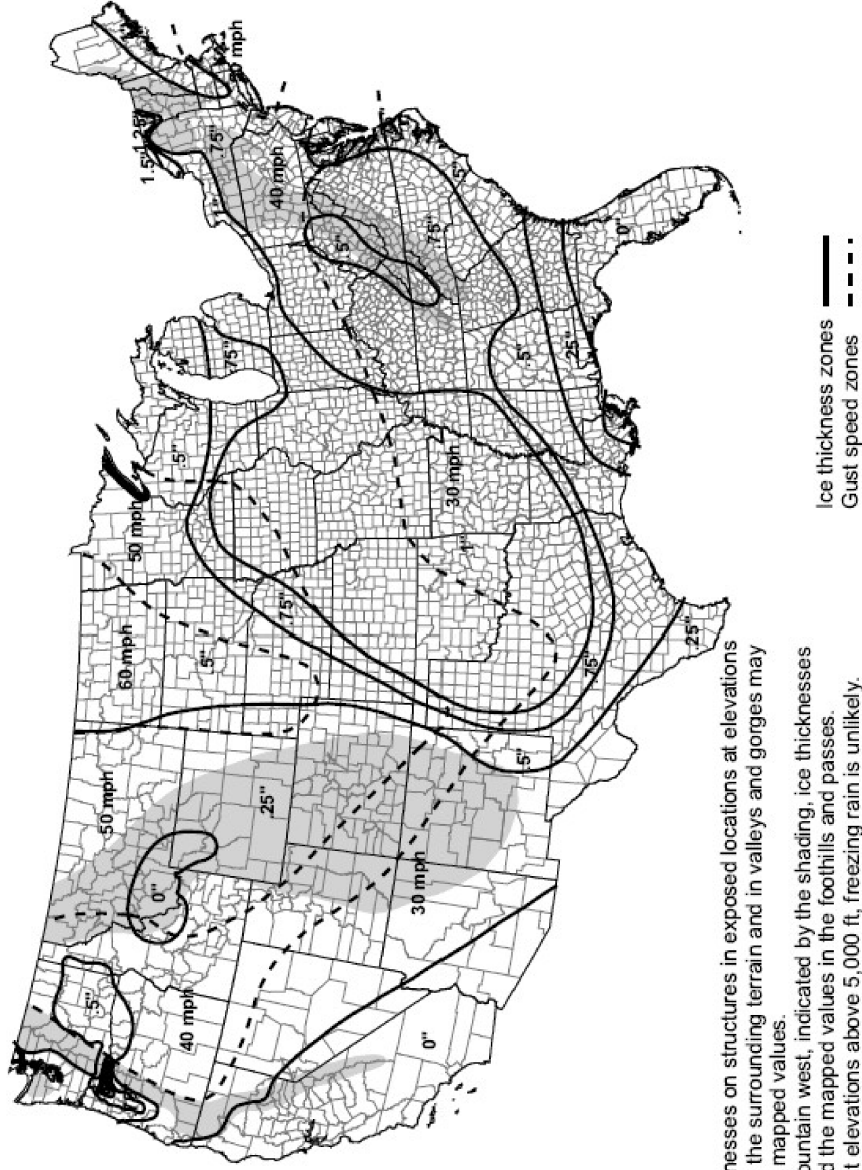

Notes:

1. Ice thicknesses on structures in exposed locations at elevations higher than the surrounding terrain and in valleys and gorges may exceed the mapped values.
2. In the mountain west, indicated by the shading, ice thicknesses may exceed the mapped values in the foothills and passes. However, at elevations above 5,000 ft, freezing rain is unlikely.
3. In the Appalachian Mountains, indicated by the shading, ice thicknesses may vary significantly over short distances.

Appendix A
Page 7 of 21

Reference: American Lifelines Alliance, Extreme Ice Thicknesses from Freezing Rain, September 2004.
www.americanlifelinesalliance.org

Figure 2.3-250 Ice Thickness For a 100-year Recurrence Interval