

Comanche Peak Nuclear Power Plant, Units 3 & 4  
 COL Application  
 Part 2, FSAR

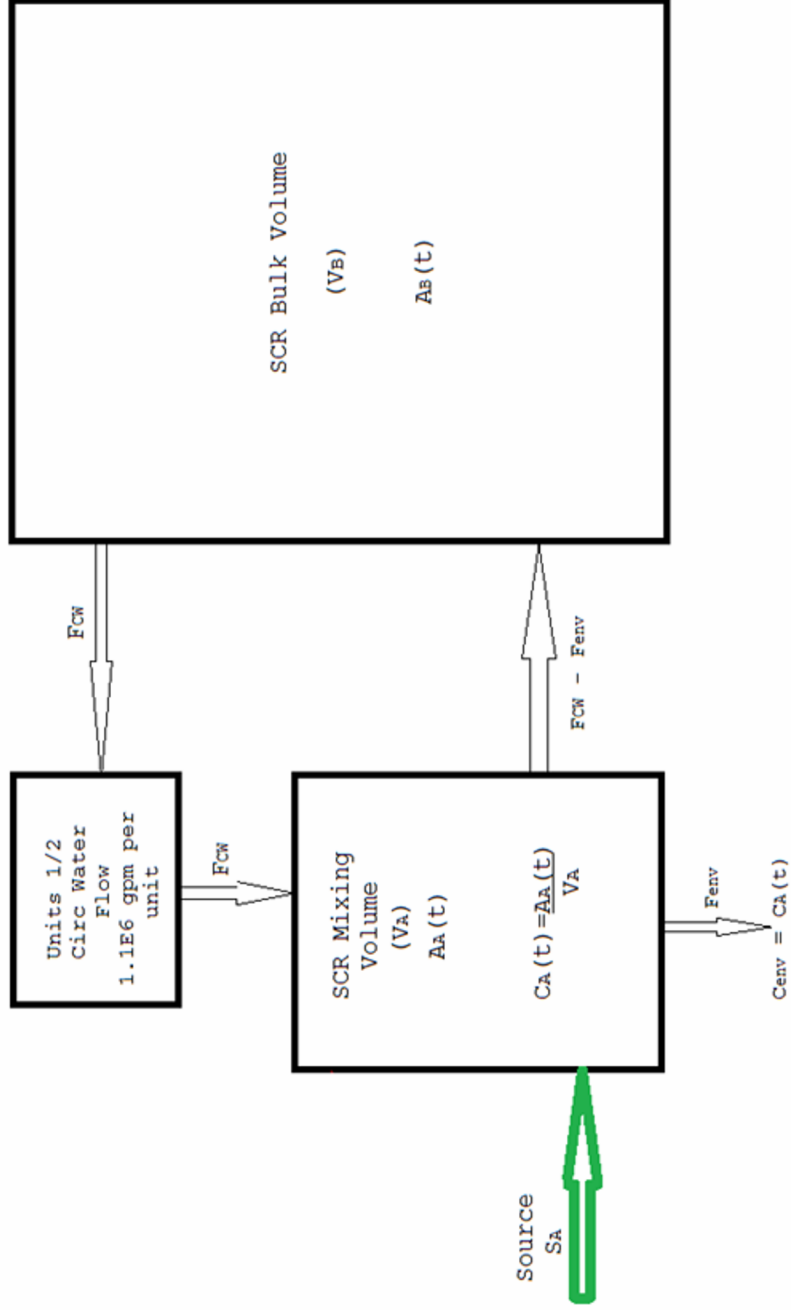


Figure 2.4.13-202 Simple Diagram of Source Term Activity Dilution and Mixing Effect in SCR