

Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR

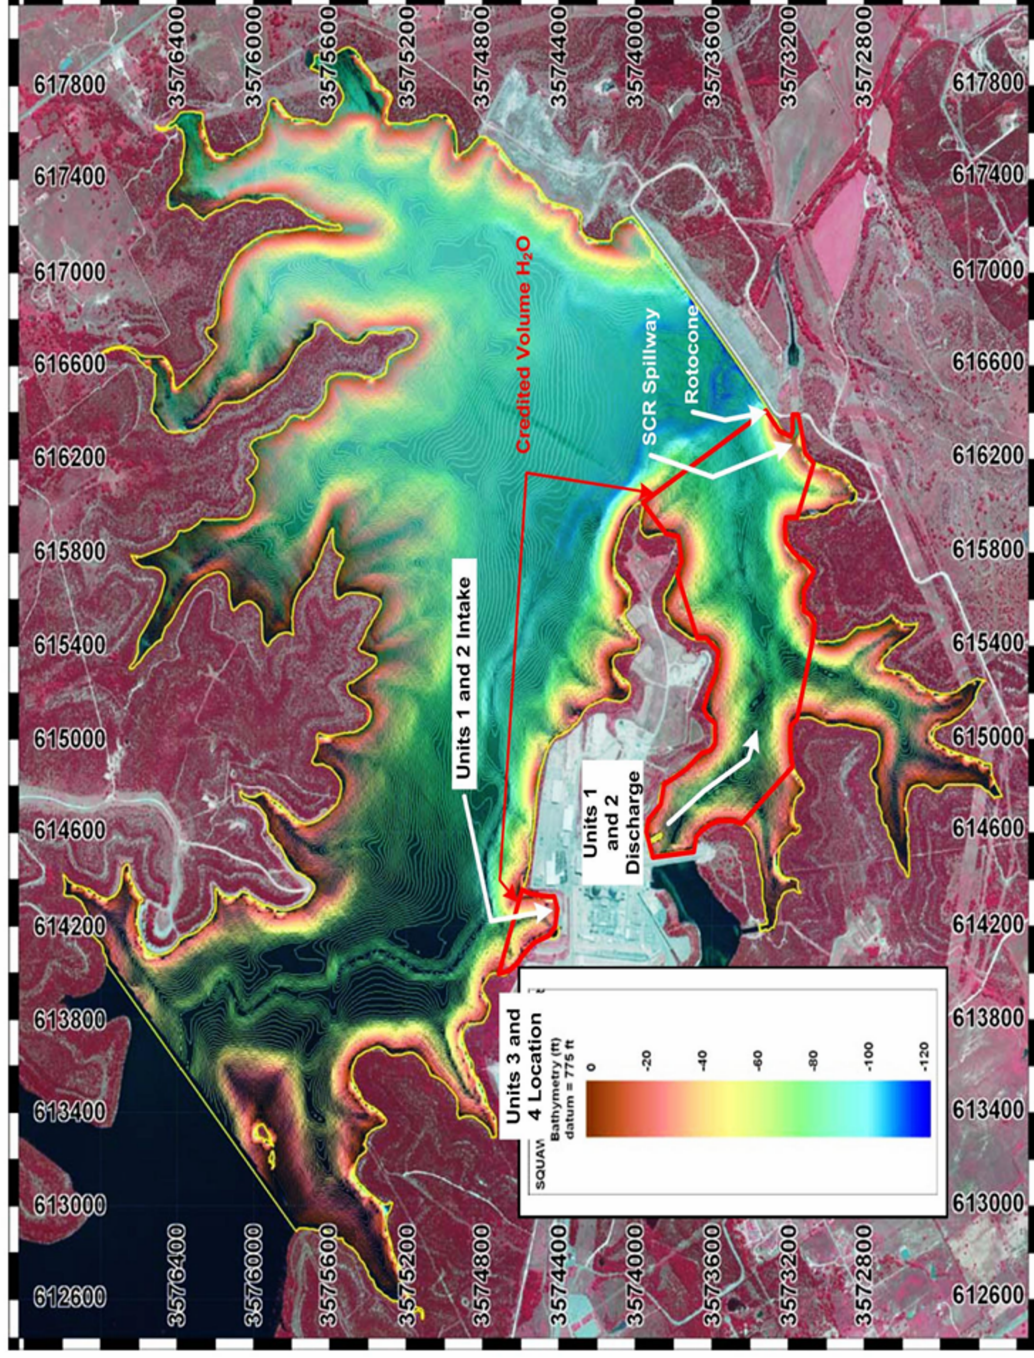


Figure 2.4.13-205 SCR Volume Credited with Dilution and Full CW Pump Operation