

Comanche Peak Nuclear Power Plant, Units 3 & 4
 COL Application
 Part 2, FSAR

1Hz+2.5Hz, 10^{-5}

- ε: 2+ (Red)
- ε: 1 to 2 (Orange)
- ε: 0 to 1 (Yellow)
- ε: -1 to 0 (Green)
- ε: -2 to -1 (Blue)

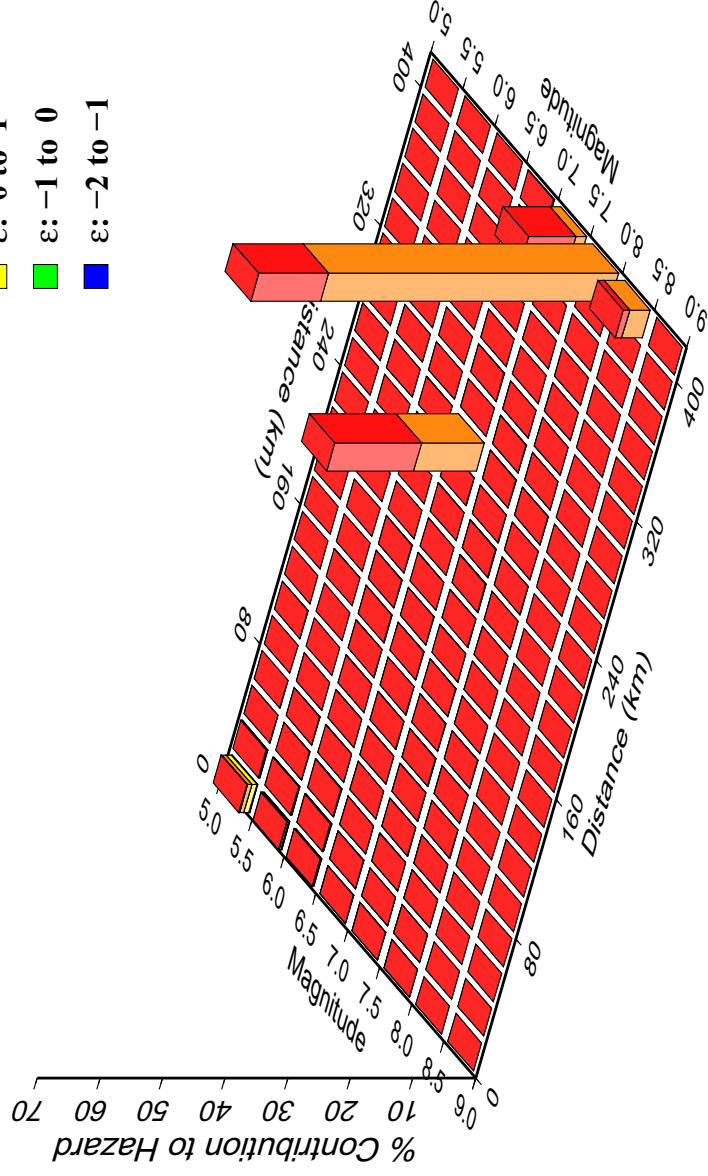


Figure 2.5.2-226 Deaggregation of 10^{-5} Rock Hazard for 1 and 2.5 Hz