

Comanche Peak Nuclear Power Plant, Units 3 & 4
 COL Application
 Part 2, FSAR

1Hz+2.5Hz, 10^{-6}

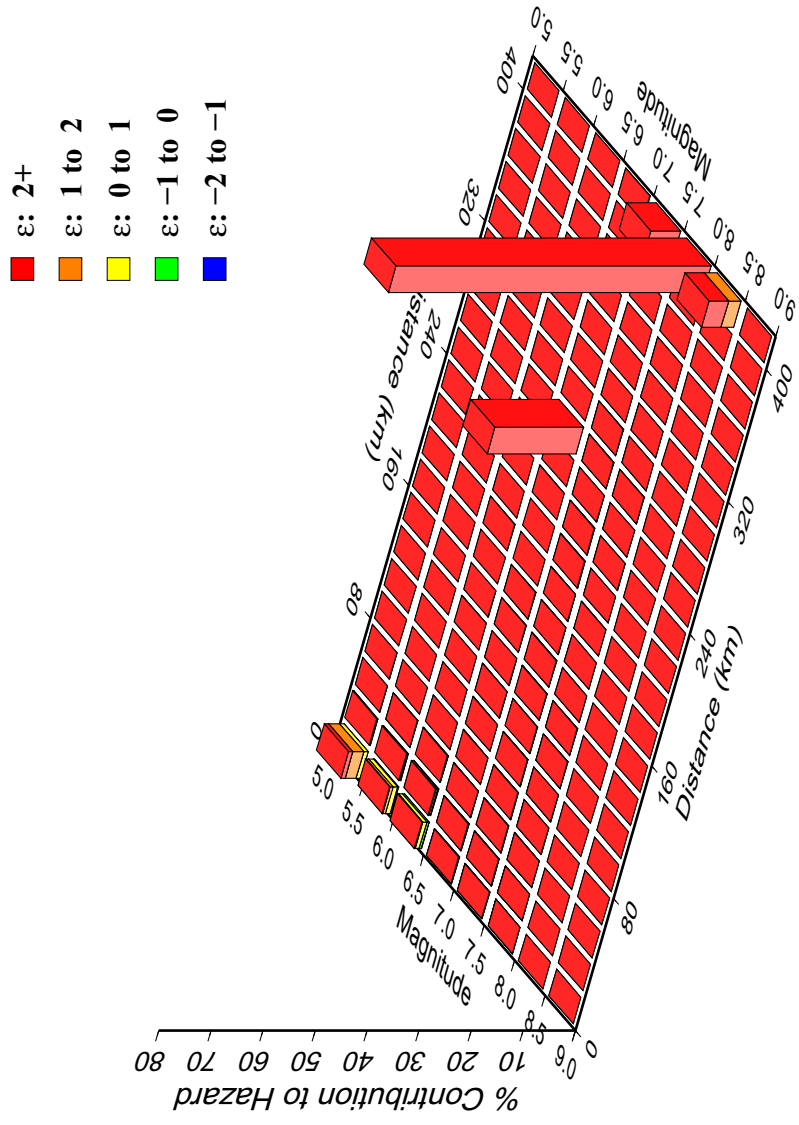


Figure 2.5.2-228 Deaggregation of 10^{-6} Rock Hazard for 1 and 2.5 Hz