

Comanche Peak Nuclear Power Plant, Units 3 & 4  
 COL Application  
 Part 2, FSAR

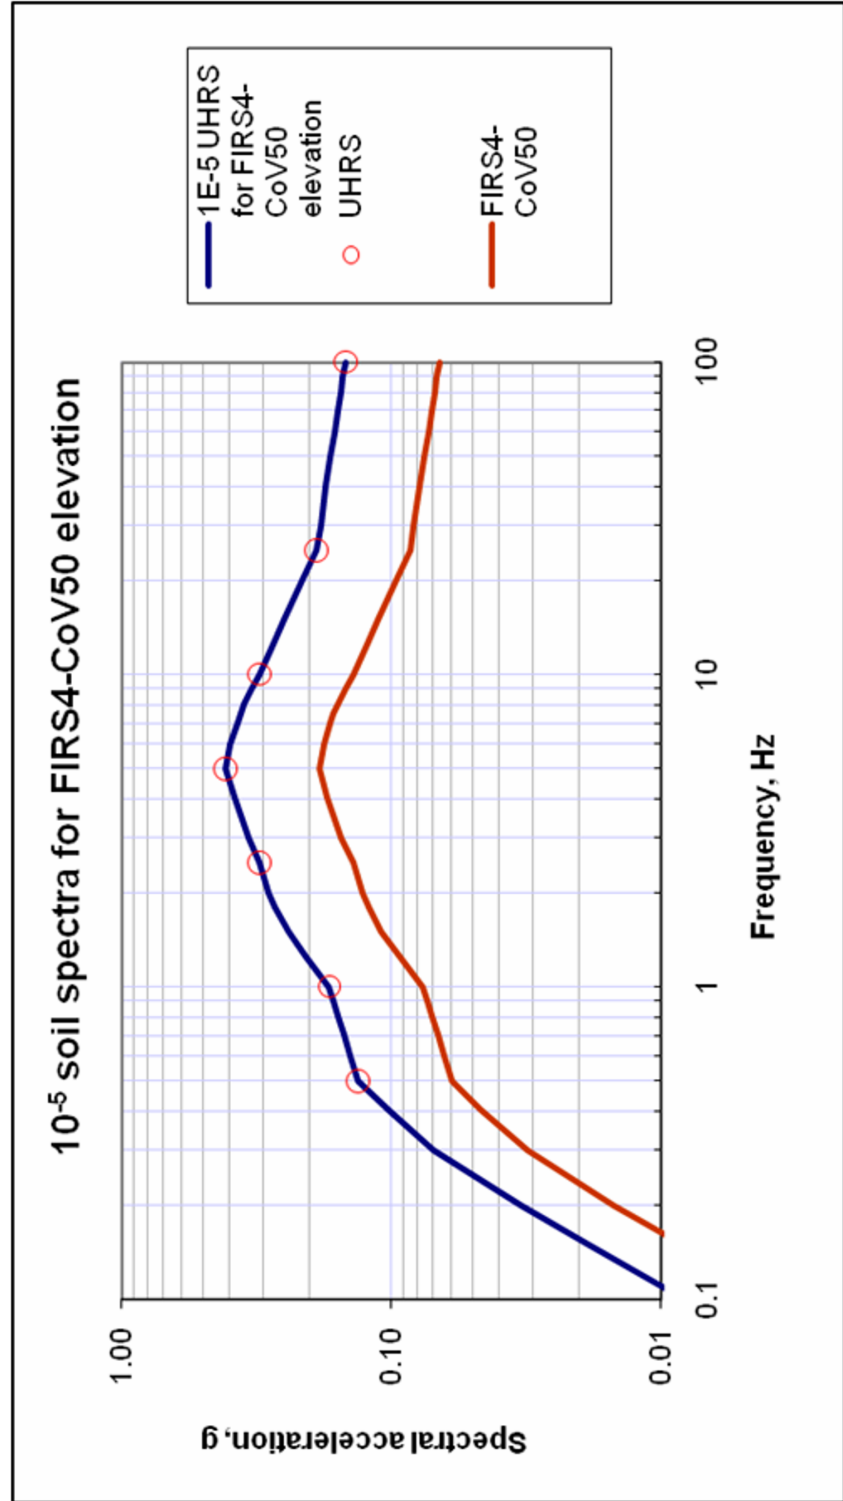


Figure 2.5.2-251 Comanche Peak 1E-5 UHRS (for FIRS4-CoV50 Conditions) and FIRS4-CoV50, Horizontal