

Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 2, FSAR

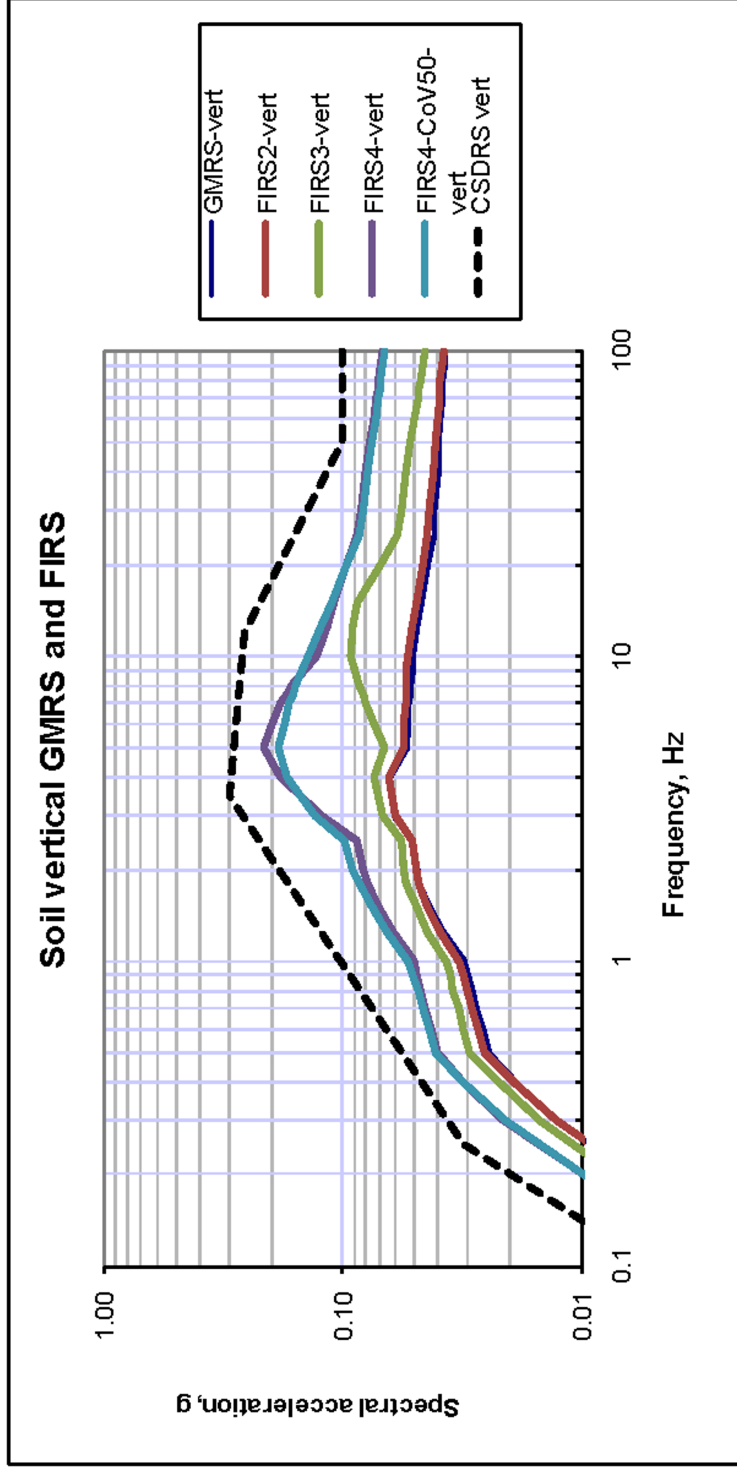


Figure 2.5.2-258 Vertical GMRS and FIRS spectra plotted with minimum CSDRS spectra, 5% damping